


NOTES:

1. WARNING: This drawing does not completely illustrate the installation methods required for hazardous locations. Prior to any installation in a Classified Hazardous Location, verify installation methods by the Control Drawing referenced on the product's name tag and national and local codes.

2. In this configuration, the Micro Motion 1700/2700 Coriolis Unit power is supplied by the customer.

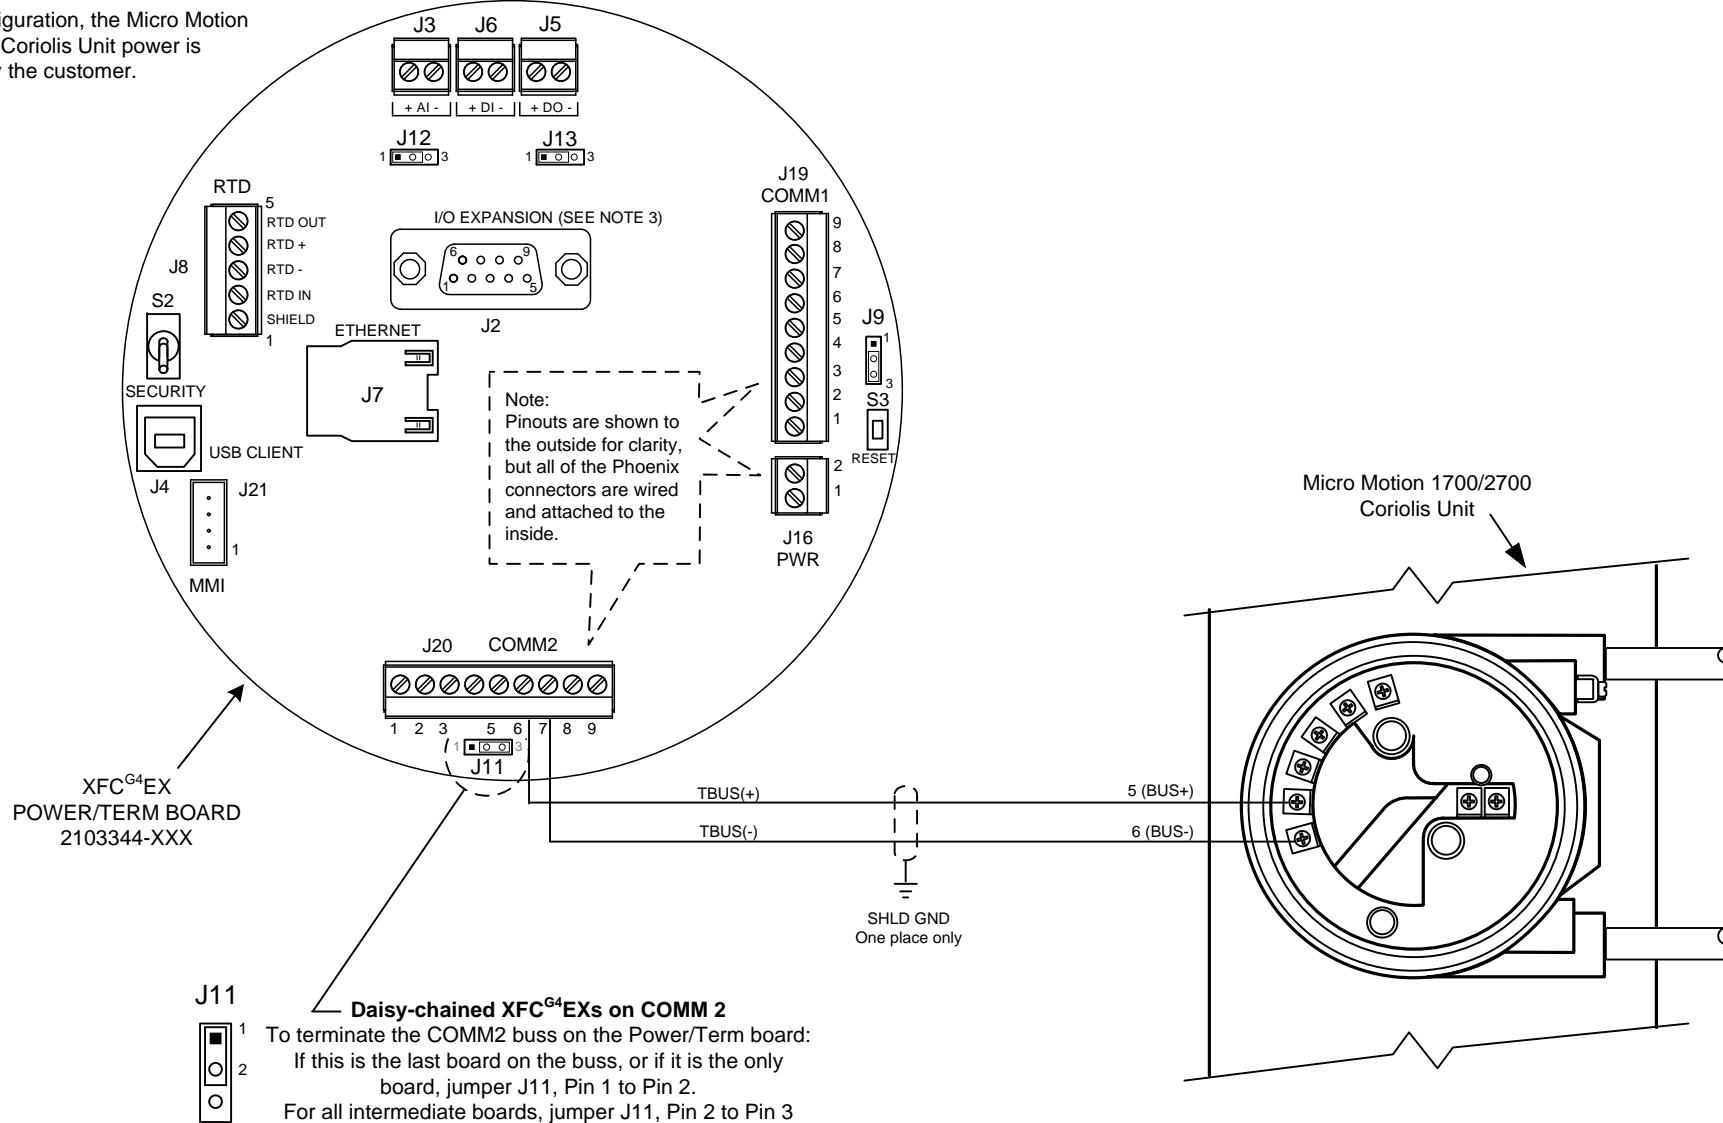

TOTALFLOW
Products

ACTION
L22145

DOC TYPE
UD

TITLE
XFC^{G4}EX (2103344 BOARD) COMM2 TO MICRO
MOTION 1700/2700 CORIOLIS (RS-485)

DWG NO.
2104236

REV
AA

SHEET
1 OF 1

REF:N/A