

TECHNICAL CHARACTERISTICS

SACE Tmax XT

Low voltage molded case circuit-breakers

**Break new ground**

- Data and connectivity
- Ease of use and installation
- Performance and protection
- Safety and reliability

SACE Tmax XT

The complete offering

OVERALL
DIMENSIONS

WIRING DIAGRAMS

Installation

Installation environment

- 1/2** Temperature
- 1/2** Environmental conditions
- 1/2** Shocks and vibrations
- 1/2** Electromagnetic compatibility
- 1/3** Degrees of protection
- 1/3** Installation position

Temperature performance

- 1/4** Circuit-breakers with thermal-magnetic trip units
- 1/6** Circuit-breaker with magnetic only or electronic trip units and switch-disconnectors
- 1/8** Power losses

Insulation distances

- 1/10** Clearances for installation in metallic cubicles
- 1/12** Alternating Current (AC) application
- 1/13** Direct Current (DC) application
- 1/14** Minimum clearance between two side by side circuit-breakers
- 1/16** Minimum clearance between two superimposed circuit-breakers
- 1/17** The first insulated anchor

Special applications

- 1/19** Use of direct current apparatus
- 1/22** Magnetic trip values
- 1/24** Use of apparatus at 16 2/3Hz
- 1/26** Use of apparatus at 400Hz

Coordination

Characteristic curves

- 1/30** Example of curves reading
- 1/33** Trip curves with thermal-magnetic trip unit
- 1/38** Trip curves with electronic trip unit Ekip Dip
- 1/51** Trip curves with electronic trip unit Ekip Touch and Hi-Touch
- 1/62** Specific let-through energy curves
- 1/72** Limiting curves

Installation environment

Temperature

The Tmax XT circuit-breakers can be used in environmental conditions where the ambient air temperature varies between -25°C and +70°C, and can be stored at temperatures between -40 °C and +70 °C. Circuit-breakers fitted with thermomagnetic trip units have their thermal element set for a reference temperature. For temperatures other than the reference, a trip threshold variation must be taken into account. Electronic trip units do not undergo any variations in performance as the temperature varies, but, in the case of temperatures exceeding +40°C, the maximum setting for protection L (protection against overloads) must be reduced, as indicated in the derating graph, to take into account the heating phenomena which occur in the copper parts of the circuit-breaker which the phase current passes through. For temperatures above +70°C the circuit-breaker performances are not guaranteed.

Environmental conditions

The Tmax XT circuit-breakers are designed to operate in environments with a pollution degree of 3 according to the IEC 60947-2 Standard classification.

Altitude

Up to an altitude of 2000m, the Tmax XT circuit-breakers do not undergo any alteration in their rated performances. As the altitude increases, the atmospheric properties are altered in terms of composition, dielectric resistance, cooling capacity and pressure. Therefore, some performance aspects of the circuit-breaker (e.g. the maximum rated operating voltage and the rated uninterrupted current) undergo derating.

| Altitude | 2000m | 3000m | 4000m | 5000m |
|-----------------------------|---------|-------|-------|-------|
| Rated service voltage, Ue | [V] 690 | 621 | 540 | 470 |
| Rated uninterrupted current | % 100 | 98 | 93 | 90 |

Shocks and vibrations


The Tmax XT circuit-breakers are unaffected by vibrations generated mechanically and due to electromagnetic effects, in compliance with the IEC 60068-2-6 Standards and the regulations of the major shipping registers including:

- RINA
- Det Norske Veritas
- Bureau Veritas
- Lloyd's Register of Shipping
- Germanischer Lloyd
- ABS
- Russian Maritime Register of Shipping
- Nippon Kaiji Kyokai.

The Tmax XT circuit-breakers are also tested according to the IEC 60068-2-27 Standard to resist shocks up to 15g for 11 ms.

Electromagnetic compatibility

Protection is guaranteed in the presence of interference caused by electronic apparatus, atmospheric disturbances or electrical discharges by using the electronic trip units and the electronic residual current releases. No interference with other electronic apparatus near the place of installation is generated either. This is in compliance with the IEC 60947-2 Annex B + Annex F Standards and European Directive No. 2014/30/EC regarding EMC - electromagnetic compatibility.



Degrees of protection


The IP degree of the circuit-breaker can vary depending on the area considered and on the presence of accessories such as a motor or terminal cover.

The following table indicates the degrees of protection guaranteed by Tmax XT circuit-breakers according to the prescriptions of the IEC 60529 Standard, in the different configurations. Furthermore, special kits are available to achieve IP54 with the MOE or RHD installed on the XT5, XT6 and XT7.

| | With front | Without front | With FLD | With RHD | With RHE | Motor operator MOD, MOE or MOE-E | Residual current devices | | | | | |
|--------------------------------------|-------------------|--------------------------------|---------------------|---|------------------------|---|---|--|--|--|--|--|
| A | IP40 | IP20 | IP40 ⁽¹⁾ | IP40 ⁽¹⁾ | IP40 ⁽¹⁾⁽²⁾ | IP30 | IP40 | | | | | |
| (1) XT5 W - XT6 W: IP30 | | | | | | | | | | | | |
| (2) XT5-XT6-XT7: IP65 | | | | | | | | | | | | |
| <hr/> | | | | | | | | | | | | |
| Without TC | | With HTC | | With LTC | | | | | | | | |
| B | IP20 | | IP40 | | IP40 | | | | | | | |
| C | NC | | IP40 | | IP30 | | | | | | | |
| <hr/> | | | | | | | | | | | | |
| Protection kits for | RHE | RHD | | MOE | | | | | | | | |
| XT1 , XT2, XT3,XT4 | IP54 | - | | - | | | | | | | | |
| XT5, XT6, XT7 | - | IP54 | | IP54 | | | | | | | | |
| <hr/> | | | | | | | | | | | | |
| Residual current RCQ020 | | | | Automatic Transfer Switch ATS021, ATS022 | | | | | | | | |
| On front | IP41 | | IP40 | | | | | | | | | |

Installation position

It is possible to mount circuit-breakers in the fixed, plug-in or withdrawable version in horizontal, vertical or lying down positions without any derating of the rated characteristics.



Temperature performance

Circuit-breakers with thermal-magnetic trip units

The circuit-breakers fitted with thermal-magnetic trip units have the thermal element set for a reference temperature of +40°C. With the same setting, for temperatures other than +40°C there is a variation in the thermal trip threshold as indicated in the tables below.

XT1

| Ambient T (°C) | 10 | 20 | 30 | 40 | 45 | 50 | 60 | 70 |
|-------------------|---------|---------|---------|---------|---------|---------|---------|---------|
| In [A] | MIN [A] | MAX [A] | MIN [A] | MAX [A] | MIN [A] | MAX [A] | MIN [A] | MAX [A] |
| 16 | 13 | 18 | 12 | 18 | 11.9 | 17 | 11.2 | 16 |
| 20 | 16 | 23 | 15 | 22 | 14.7 | 21 | 14 | 20 |
| 25 | 20 | 29 | 19 | 28 | 18.2 | 26 | 17.5 | 25 |
| 32 | 26 | 37 | 25 | 35 | 23.8 | 34 | 22.4 | 32 |
| 40 | 32 | 46 | 31 | 44 | 29.4 | 42 | 28 | 40 |
| 50 | 40 | 58 | 39 | 55 | 37.1 | 53 | 35 | 50 |
| 63 | 51 | 72 | 49 | 69 | 46.2 | 66 | 44.1 | 63 |
| 80 | 64 | 92 | 62 | 88 | 58.8 | 84 | 56 | 80 |
| 100 | 81 | 115 | 77 | 110 | 73.5 | 105 | 70 | 100 |
| 125 | 101 | 144 | 96 | 138 | 91.7 | 131 | 87.5 | 125 |
| 160 | 129 | 184 | 123 | 176 | 117.6 | 168 | 112 | 160 |

XT2 with thermal-magnetic trip units

| Ambient T (°C) | 10 | 20 | 30 | 40 | 45 | 50 | 60 | 70 |
|-------------------|---------|---------|---------|---------|---------|---------|---------|---------|
| In [A] | MIN [A] | MAX [A] | MIN [A] | MAX [A] | MIN [A] | MAX [A] | MIN [A] | MAX [A] |
| 1.6 | 1.3 | 1.8 | 1.2 | 1.8 | 1.2 | 1.7 | 1.1 | 1.6 |
| 2 | 1.6 | 2.3 | 1.5 | 2.2 | 1.5 | 2.2 | 1.4 | 2.0 |
| 2.5 | 2.0 | 2.9 | 1.9 | 2.8 | 1.8 | 2.6 | 1.8 | 2.5 |
| 3.2 | 2.5 | 3.6 | 2.5 | 3.5 | 2.5 | 3.5 | 2.0 | 3.2 |
| 4 | 3.2 | 4.6 | 3.1 | 4.4 | 2.9 | 4.2 | 2.8 | 4.0 |
| 5 | 4 | 5.7 | 3.9 | 5.5 | 3.7 | 5.3 | 3.5 | 5 |
| 6.3 | 5.0 | 7.2 | 4.9 | 6.9 | 4.6 | 6.6 | 4.4 | 6.3 |
| 8 | 6.4 | 9.2 | 6.2 | 8.8 | 5.9 | 8.4 | 5.6 | 8.0 |
| 10 | 8.1 | 11.5 | 7.7 | 11.0 | 7.4 | 10.5 | 7.0 | 10.0 |
| 12.5 | 10.1 | 14.4 | 9.7 | 13.8 | 9.2 | 13.2 | 8.8 | 12.5 |
| 16 | 13 | 18.0 | 12.0 | 18.0 | 11.9 | 17.0 | 11.2 | 16.0 |
| 20 | 16 | 23.0 | 15.4 | 22.0 | 14.7 | 21.0 | 14.0 | 20.0 |
| 25 | 20 | 29.0 | 19.6 | 28.0 | 18.2 | 26.0 | 17.5 | 25.0 |
| 32 | 26 | 37.0 | 24.5 | 35.0 | 23.8 | 34.0 | 22.4 | 32.0 |
| 40 | 32 | 46.0 | 30.8 | 44.0 | 29.4 | 42.0 | 28.0 | 40.0 |
| 50 | 40 | 57.0 | 38.5 | 55.0 | 37.1 | 53.0 | 35.0 | 50.0 |
| 63 | 50 | 72.0 | 48.3 | 69.0 | 46.2 | 66.0 | 44.1 | 63.0 |
| 80 | 64 | 92.0 | 61.6 | 88.0 | 58.8 | 84.0 | 56.0 | 80.0 |
| 100 | 81 | 115.0 | 77.0 | 110.0 | 73.5 | 105.0 | 70.0 | 100.0 |
| 125 | 101 | 144.0 | 96.6 | 138.0 | 92.4 | 132.0 | 87.5 | 125.0 |
| 160 | 129 | 184.0 | 123.0 | 178.0 | 117.6 | 168.0 | 112.0 | 160.0 |

XT3

| Ambient T (°C) | 10 | 20 | 30 | 40 | 45 | 50 | 60 | 70 | | | | | | |
|-------------------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|---------|
| In [A] | MIN [A] | MAX [A] | MIN [A] | MAX [A] | MIN [A] | MAX [A] | MIN [A] | MAX [A] | MIN [A] | MAX [A] | MIN [A] | MAX [A] | MIN [A] | MAX [A] |
| 63 | 51 | 72 | 49 | 69 | 46 | 66 | 44 | 63 | 43 | 61 | 41 | 59 | 39 | 55 |
| 80 | 64 | 92 | 62 | 88 | 59 | 84 | 56 | 80 | 54 | 77 | 53 | 75 | 48 | 69 |
| 100 | 80 | 115 | 77 | 110 | 74 | 105 | 70 | 100 | 68 | 97 | 65 | 93 | 61 | 87 |
| 125 | 101 | 144 | 96 | 138 | 92 | 132 | 88 | 125 | 85 | 121 | 81 | 116 | 76 | 108 |
| 160 | 129 | 184 | 123 | 176 | 118 | 168 | 112 | 160 | 108 | 155 | 104 | 149 | 97 | 139 |
| 200 | 161 | 230 | 154 | 220 | 148 | 211 | 140 | 200 | 136 | 194 | 130 | 186 | 121 | 173 |
| 250 | 201 | 287 | 193 | 278 | 184 | 263 | 175 | 250 | 169 | 242 | 163 | 233 | 151 | 216 |

XT4 with thermal-magnetic trip units

| Ambient T (°C) | 10 | 20 | 30 | 40 | 45 | 50 | 60 | 70 | | | | | | |
|-------------------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| In [A] | MIN[A] | MAX[A] |
| 16 | 13 | 19 | 13 | 18 | 12 | 17 | 11 | 16 | 11 | 15 | 10 | 14 | 9 | 13 |
| 20 | 19 | 27 | 17 | 24 | 16 | 23 | 14 | 20 | 14 | 19 | 12 | 17 | 11 | 15 |
| 25 | 21 | 30 | 20 | 28 | 19 | 27 | 18 | 25 | 17 | 24 | 16 | 23 | 15 | 21 |
| 32 | 26 | 43 | 24 | 39 | 25 | 36 | 22 | 32 | 22 | 31 | 19 | 27 | 17 | 24 |
| 40 | 33 | 48 | 32 | 45 | 30 | 43 | 28 | 40 | 27 | 39 | 26 | 37 | 24 | 34 |
| 50 | 37 | 62 | 35 | 58 | 38 | 54 | 35 | 50 | 34 | 48 | 32 | 46 | 29 | 42 |
| 63 | 53 | 75 | 50 | 71 | 47 | 67 | 44 | 63 | 43 | 61 | 41 | 58 | 37 | 53 |
| 80 | 59 | 98 | 55 | 92 | 60 | 86 | 56 | 80 | 54 | 77 | 52 | 74 | 46 | 66 |
| 100 | 83 | 118 | 79 | 113 | 74 | 106 | 70 | 100 | 68 | 97 | 67 | 95 | 60 | 85 |
| 125 | 102 | 145 | 100 | 140 | 94 | 134 | 88 | 125 | 85 | 121 | 81 | 115 | 74 | 105 |
| 160 | 130 | 185 | 123 | 176 | 118 | 168 | 112 | 160 | 108 | 155 | 105 | 150 | 96 | 137 |
| 200 | 161 | 230 | 154 | 220 | 147 | 210 | 140 | 200 | 136 | 194 | 133 | 190 | 123 | 175 |
| 225 | 188 | 269 | 179 | 255 | 168 | 241 | 158 | 225 | 152 | 218 | 146 | 208 | 133 | 190 |
| 250 | 200 | 285 | 193 | 275 | 183 | 262 | 175 | 250 | 169 | 242 | 168 | 240 | 161 | 230 |

XT5 TMA/TMG

| Ambient T (°C) | 10 | 20 | 30 | 40 | 45 | 50 | 60 | 70 |
|-------------------|--------|--------|--------|--------|--------|--------|--------|--------|
| In [A] | MIN[A] | MAX[A] | MIN[A] | MAX[A] | MIN[A] | MAX[A] | MIN[A] | MAX[A] |
| 320 | 285 | 360 | 245 | 345 | 235 | 335 | 225 | 320 |
| 400 | 370 | 465 | 315 | 450 | 310 | 420 | 280 | 400 |
| 500 | 485 | 605 | 400 | 570 | 375 | 535 | 350 | 500 |
| 630 | 540 | 675 | 460 | 660 | 450 | 645 | 440 | 630 |

XT6 TMA

| Ambient T (°C) | 10 | 20 | 30 | 40 | 45 | 50 | 60 | 70 |
|-------------------|--------|--------|--------|--------|--------|--------|--------|--------|
| In [A] | MIN[A] | MAX[A] | MIN[A] | MAX[A] | MIN[A] | MAX[A] | MIN[A] | MAX[A] |
| 630 | 560 | 700 | 470 | 670 | 450 | 645 | 440 | 630 |
| 800 | 770 | 960 | 635 | 910 | 600 | 860 | 560 | 800 |

Temperature performance

Circuit-breaker with magnetic only or electronic trip units and switch-disconnectors

The electronic overcurrent trip units do not undergo any variations in performance as the temperature varies. However, even though heating does not affect the trip thresholds of the electronic trip units, in the case of temperatures exceeding +40°C it is advisable to reduce the maximum L (protection against overloads) setting to protect the copper parts of the circuit-breaker against high temperatures.

The same considerations can be made for the switch-disconnectors and magnetic only circuit-breakers. The table below shows the maximum value at which the threshold of I₁ of the overcurrent protection (L) must be set according to the ambient temperature and for the type of terminals used.

| | | | | 40°C | 45°C | 50°C | 55°C | 60°C | 65°C | 70°C |
|------------------------------|-----|----------|-----------------|----------------------|----------------------|----------------------|----------------------|----------------------|----------------------|----------------------|
| | | | | I _{max} [A] |
| XT1 | F | M-SD | F-EF-ES-FCCu-R | 160 | 160 | 160 | 153 | 140 | | |
| | P | M-SD | EF-HR/VR | 125 | 117 | 110 | 108 | 100 | | |
| XT2 | F | M-ELT | F-FCCu | 160 | 160 | 160 | 160 | 145 | | |
| | P/W | M-ELT | EF-HR/VR | 160 | 160 | 160 | 160 | 148 | | |
| XT3 | F | M-SD | F-FCCu | 250 | 250 | 250 | 228 | 204 | | |
| | P | M-SD | EF-HR/VR | 250 | 222 | 196 | 196 | 170 | | |
| XT4 | F | M-ELT-SD | F-FCCu | 250 | 250 | 250 | 238 | 213 | | |
| | P/W | M-ELT-SD | EF-HR/VR | 250 | 231 | 211 | 211 | 190 | | |
| XT5 400 | F | M-ELT-SD | F | 400 | 400 | 400 | 400 | 383 | 365 | 346 |
| | | | VR, ES, EF | 400 | 400 | 400 | 400 | 400 | 381 | 362 |
| | | | FC CuAl | 400 | 400 | 400 | 400 | 383 | 365 | 346 |
| | | | HR | 400 | 400 | 400 | 400 | 383 | 365 | 346 |
| | P/W | M-ELT-SD | VR, ES, EF | 400 | 385 | 370 | 355 | 338 | 321 | 302 |
| | | | FC CuAl | 400 | 385 | 370 | 355 | 338 | 321 | 302 |
| | | | HR | 400 | 385 | 370 | 355 | 338 | 321 | 302 |
| | | | | | | | | | | |
| XT5 630 | F | M-ELT-SD | F | 630 | 630 | 630 | 630 | 590 | 550 | 505 |
| | | | VR, ES, EF | 630 | 630 | 630 | 630 | 601 | 570 | 537 |
| | | | FC CuAl | 630 | 630 | 630 | 630 | 601 | 570 | 537 |
| | | | HR | 630 | 630 | 630 | 630 | 590 | 550 | 505 |
| | P/W | M-ELT-SD | VR, ES, EF | 600 | 578 | 555 | 532 | 507 | 481 | 454 |
| | | | FC CuAl | 600 | 578 | 555 | 532 | 507 | 481 | 454 |
| | | | HR | 600 | 565 | 530 | 507 | 484 | 457 | 430 |
| | | | | | | | | | | |
| XT6 800 | F | ELT-SD | F-ES-EF-FC CuAl | 800 | 800 | 800 | 780 | 760 | 740 | 720 |
| | | | VR | 800 | 800 | 800 | 800 | 800 | 780 | 760 |
| | | | HR | 800 | 800 | 800 | 760 | 720 | 680 | 640 |
| | | | | | | | | | | |
| | W | ELT-SD | ES-EF-FC CuAl | 800 | 780 | 760 | 740 | 720 | 680 | 640 |
| | | | VR | 800 | 800 | 800 | 780 | 760 | 740 | 720 |
| | | | HR | 800 | 780 | 760 | 740 | 720 | 680 | 640 |
| | | | | | | | | | | |
| XT6 1000¹⁾ | F | ELT-SD | F-EF-FC CuAl | 1000 | 980 | 960 | 918.5 | 877 | 830.5 | 784 |
| | | | ES | 1000 | 950 | 900 | 860 | 820 | 770 | 720 |
| | | | VR | 1000 | 1000 | 1000 | 956.5 | 913 | 865 | 817 |
| | | | HR | 1000 | 963 | 926 | 885.5 | 845 | 800.5 | 756 |

(1) XT6 1000 is supplied by default with EF connection terminals

| | | | | 40°C | 45°C | 50°C | 55°C | 60°C | 65°C | 70°C |
|------------------|---|--------|-----------------|----------------------|----------------------|----------------------|----------------------|----------------------|----------------------|----------------------|
| | | | | I _{max} [A] |
| XT7 800A | F | ELT | F | 800 | 800 | 800 | 800 | 800 | 750 | 700 |
| | | | VR, ES, FCCuAl | 800 | 800 | 800 | 800 | 800 | 778 | 755 |
| | | | HR, EF | 800 | 800 | 800 | 800 | 800 | 750 | 700 |
| | W | ELT | EF, ES | 800 | 800 | 800 | 766 | 730 | 693 | 653 |
| | | | HR, SHR | 800 | 800 | 800 | 800 | 800 | 750 | 700 |
| | | | VR, Rear FCCuAl | 800 | 800 | 800 | 800 | 800 | 759 | 716 |
| XT7 1000A | F | ELT-SD | F | 1000 | 1000 | 1000 | 971 | 942 | 885 | 827 |
| | | | VR, ES, FCCuAl | 1000 | 1000 | 1000 | 1000 | 949 | 885 | 894 |
| | | | HR, EF | 1000 | 1000 | 1000 | 971 | 942 | 885 | 827 |
| | W | ELT-SD | EF, ES | 1000 | 1000 | 961 | 920 | 877 | 832 | 784 |
| | | | HR, SHR | 1000 | 1000 | 1000 | 971 | 942 | 885 | 827 |
| | | | VR, Rear FCCuAl | 1000 | 1000 | 1000 | 1000 | 953 | 905 | 853 |
| XT7 1250A | F | ELT-SD | F with 2x40x10 | 1250 | 1250 | 1250 | 1184 | 1118 | 1049 | 980 |
| | | | F with 2x50x10 | 1250 | 1250 | 1250 | 1240 | 1182 | 1122 | 1057 |
| | | | VR, ES, FCCuAl | 1250 | 1250 | 1250 | 1250 | 1192 | 1131 | 1066 |
| | W | ELT-SD | HR, EF | 1250 | 1250 | 1250 | 1184 | 1118 | 1049 | 980 |
| | | | EF, ES | 1250 | 1205 | 1157 | 1108 | 1056 | 1002 | 945 |
| | | | HR, SHR | 1250 | 1250 | 1250 | 1184 | 1118 | 1049 | 980 |
| XT7 1600A | F | ELT-SD | VR, Rear FCCuAl | 1250 | 1250 | 1250 | 1250 | 1192 | 1131 | 1066 |
| | | | F with 2x50x10 | 1400 | 1350 | 1296 | 1240 | 1183 | 1122 | 1058 |
| | | | F with 3x50x10 | 1600 | 1541 | 1481 | 1417 | 1352 | 1281 | 1209 |
| | W | ELT-SD | VR, ES, FCCuAl | 1600 | 1600 | 1537 | 1470 | 1403 | 1329 | 1255 |
| | | | HR, EF | 1600 | 1541 | 1481 | 1417 | 1352 | 1281 | 1209 |
| | | | EF, ES | 1400 | 1350 | 1296 | 1240 | 1183 | 1122 | 1058 |
| | | | HR, SHR | 1600 | 1541 | 1481 | 1417 | 1352 | 1281 | 1209 |
| | | | VR, Rear FCCuAl | 1600 | 1600 | 1537 | 1470 | 1403 | 1329 | 1255 |

Temperature performance

Power losses

To ensure service continuity of the plants, careful assessment of how to keep temperatures within acceptable levels is necessary to guarantee operation of all devices (e.g. by using forced ventilation in switchboards and installation rooms).

The table below shows the dissipated power values per single pole at the rated current I_n for each circuit-breaker used. The total maximum dissipated power for a circuit-breaker used at 50/60Hz is equal to the power per single pole multiplied by the number of poles.

| Power [W/pole] | I_n [A] | XT1 | | XT2 | | XT3 | | XT4 | | XT5 | | XT6 | |
|------------------------------|--------------|-------|-------|-------|-------|-------|-------|-------|-------|------|------|------|------|
| | | F | P | F | P/W | F | P | F | P/W | F | P/W | F | W |
| Thermomagnetic | 1.6 | | | 2.00 | 2.40 | | | | | | | | |
| or magnetic only | 2 | | | 2.40 | 2.80 | | | | | | | | |
| trip unit: | 2.5 | | | 2.50 | 2.80 | | | | | | | | |
| TMD | 3.2 | | | 2.80 | 3.20 | | | | | | | | |
| TMA | 4 | | | 2.50 | 2.80 | | | | | | | | |
| TMG | 6.3 | | | 3.30 | 3.90 | | | | | | | | |
| MF | 8 | | | 2.60 | 3.00 | | | | | | | | |
| MA | 10 | | | 2.90 | 3.40 | | | 2.00 | 2.20 | | | | |
| | 12.5 | | | 1.00 | 1.20 | | | 2.30 | 2.40 | | | | |
| | 16 | 1.50 | 1.60 | 1.30 | 1.50 | | | 2.50 | 2.60 | | | | |
| | 20 | 1.80 | 2.00 | 1.60 | 1.90 | | | 2.60 | 2.70 | | | | |
| | 25 | 2.00 | 2.80 | 2.00 | 2.5 | | | 2.70 | 2.80 | | | | |
| | 32 | 2.10 | 3.20 | 2.60 | 3.00 | | | 4.40 | 4.50 | | | | |
| | 40 | 2.60 | 4.60 | 3.70 | 4.40 | | | 4.50 | 4.70 | | | | |
| | 50 | 3.70 | 5.00 | 4.10 | 4.70 | | | 4.70 | 4.90 | | | | |
| | 63 | 4.30 | 6.00 | 4.80 | 5.70 | 4.30 | 5.10 | 5.30 | 5.70 | | | | |
| | 80 | 4.80 | 7.20 | 5.80 | 6.80 | 4.80 | 5.80 | 5.50 | 6.10 | | | | |
| | 100 | 7.00 | 10.00 | 8.10 | 9.50 | 5.60 | 6.80 | 6.20 | 7.20 | | | | |
| | 125 | 10.70 | 14.70 | 11.40 | 14.00 | 6.60 | 7.90 | 7.40 | 9.00 | | | | |
| | 160 | 15.00 | | 16.10 | 19.00 | 7.90 | 9.50 | 8.90 | 10.80 | | | | |
| | 200 | | | | | 13.20 | 15.80 | 11.90 | 14.90 | | | | |
| | 250 | | | | | 17.80 | 21.40 | 16.40 | 21.10 | | | | |
| | 320 | | | | | | | | | 16.9 | 23 | | |
| | 400 | | | | | | | | | 24.1 | 33.6 | | |
| | 500 | | | | | | | | | 33.5 | 45.8 | | |
| | 630 | | | | | | | | | 47.8 | 67.3 | 34.4 | 42.5 |
| | 800 | | | | | | | | | | 54.2 | 67.7 | |
| Electronic trip unit: | 10 | | | 0.10 | 0.10 | | | | | | | | |
| Ekip Dip | 25 | | | 0.80 | 0.90 | | | | | | | | |
| Ekip Touch | 40 | | | | | 0.60 | 0.70 | | | | | | |
| | 63 | | | 1.70 | 2.10 | | | 1.40 | 1.80 | | | | |
| | 100 | | | 4.20 | 5.20 | | | 3.50 | 4.50 | | | | |
| | 160 | | | 10.80 | 13.40 | | | 8.90 | 11.50 | | | | |
| | 250 | | | | | 16.40 | 22.70 | 8 | 11.7 | | | | |
| | 320 | | | | | | | | | 11.6 | 17.7 | | |
| | 400 | | | | | | | | | 19 | 27.6 | | |
| | 500 | | | | | | | | | 28.3 | 40.6 | | |
| | 630 | | | | | | | | | 45 | 64.5 | 33.2 | 41.5 |
| | 800 | | | | | | | | | | 53.4 | 66.7 | |
| | 1000 | | | | | | | | | | 83.5 | | |

| Power [W/pole] | In [A] | XT7- XT7 M | |
|-------------------|-----------|------------|-----|
| | | F | w |
| Ekip Dip | 800 | 24 | 35 |
| Ekip Touch | 1000 | 37 | 55 |
| | 1250 | 57 | 86 |
| | 1600 | 94 | 141 |

Power losses gives indication of the heat generated under specified conditions. Measurement of power losses are performed on new samples in free air (according to Annex G of IEC).

The measurement of resistance cannot be directly related to the power loss of the device and is not enough to ascertain the quality of the contacts.

Insulation distances

Clearances for installation in metallic cubicles

This section provides the compliance clearances for the installation of the circuit-breaker inside a metal cubicle.

The cubicle is the reference for the metallic parts of the switchgear assembly adjacent to the circuit-breaker and is used as a reference to define the clearances to be observed to permit the free evacuation of ionized gases and metal vapors and to prevent the ignition of adjacent parts. The clearances refer to the tests carried out in compliance with the IEC 60947-2 Standard.

The installation modality in relation to the type of circuit-breaker and the compulsory protections that must be used depending on the connection terminals is summarized in the tables below.

For further details about installation, please see the related instructions provided with the circuit-breaker.

| | LTC | HTC | HTC-ES | PB 25mm | PB 100mm | PB 200mm |
|------------|--------------------|-----|--------|---------|----------|----------|
| XT1 | F | - | R | - | S | R |
| | EF | - | R | - | - | S |
| | ES | - | - | - | - | S |
| | FC Cu | - | R | - | S | R |
| | FC CuAl 1x1.5...70 | - | R | - | S | R |
| | FC CuAl 1x35...95 | - | S | - | - | - |
| | FB | - | R | - | S | R |
| | MC | - | S | - | - | - |
| | R | S | - | - | - | - |
| XT2 | F | - | R | - | S | R |
| | EF | - | S | - | - | S |
| | ES | - | - | - | - | S |
| | FC Cu | - | R | - | S | R |
| | FC CuAl 1x1...95 | - | R | - | S | R |
| | FC CuAl 1x70...185 | - | S | - | - | - |
| | FC CuAl 2x35...70 | - | S | - | - | - |
| | FB | - | R | - | S | R |
| | MC | - | S | - | - | - |
| XT3 | F | - | R | - | S | R |
| | EF | - | R | - | - | S |
| | ES | - | - | - | - | S |
| | FC Cu | - | R | - | S | R |
| | FC CuAl 1x35...150 | - | R | - | S | R |
| | FC CuAl 1x95...185 | - | R | - | S | R |
| | FC CuAl 2x35...120 | - | S | - | - | - |
| | FB | - | R | - | S | R |
| | MC | - | S | - | - | - |
| | R | S | - | - | - | - |

| | | LTC ³⁾ | HTC | HTC-ES | PB 25mm | PB 100mm | PB 200mm |
|----------------------------|----------------------|-------------------|-----|--------|------------------|------------------|----------|
| XT4 | F | - | R | - | S | R | R |
| | EF | - | S | - | - | S | R |
| | ES | - | - | - | - | - | S |
| | FC Cu | - | R | - | S | R | R |
| | FC CuAl 1x1...150 | - | R | - | S | R | R |
| | FC CuAl 2x35...120 | - | S | - | - | - | - |
| | FB | - | R | - | S | R | R |
| | MC | - | S | - | - | - | - |
| | R | S | - | - | - | - | - |
| XT5 | F | - | R | - | S ⁽¹⁾ | R | R |
| | EF | - | R | - | - | S ⁽²⁾ | R |
| | ES | - | - | R | - | - | S |
| | R | S | - | - | - | - | - |
| | FC CuAl 1x35-185 | - | R | - | S | R | R |
| | FC CuAl 1x120-240 | - | R | - | S | R | R |
| | FC CuAl 1x185-300 | - | R | - | S | R | R |
| | FC CuAl 2x70-240 | - | R | - | - | S | R |
| XT6 | F | R | R | - | - | R | R |
| | EF 800A | - | R | - | - | S | R |
| | EF 1000A | - | - | - | - | - | S |
| | ES | - | - | R | - | - | S |
| | R | S | - | - | - | - | - |
| | Fc CuAl 2x 120...240 | R | R | - | - | R | R |
| | Fc CuAl 3x 70...185 | - | S | - | - | - | - |
| | Fc CuAl 4x 70...150 | - | S | - | - | - | - |
| XT7 XT7 M | F | R | R | - | - | R | R |
| | EF | - | R | - | - | S | R |
| | ES | - | - | R | - | - | S |
| | HR/VR | S | - | - | - | - | - |
| | FC CuAl 4x240 | - | S | - | - | - | - |
| | FC CuAl 2x185...240 | S | R | - | - | S | R |

(1) above 500V AC

(2) PBs 50mm for W/P versions

(3) For XT5 LTC height is 25mm

Insulation distances

Alternating Current (AC) application

| | No accessories | | | Low terminal cover (LTC) | | | High terminal cover (HTC) | | | Phase separators 25mm | | | Phase separators 100mm | | | Phase separators 200mm | | | |
|-------------|---------------------------------|-----|----|--------------------------|-----|-------------------|---------------------------|----|----|-----------------------|----|-------------------|------------------------|----|----|------------------------|---|---|-------------------|
| | T | D | L | T | D | L | T | D | L | T | D | L | T | D | L | T | D | L | |
| XT1 | U < 440 V | - | - | - | 25 | 20 | 20 | 10 | 5 | 20 | 0 | 0 | 20 | 0 | 0 | 20 | 0 | 0 | 20 ⁽¹⁾ |
| | 440 V < U < 500V | - | - | - | 25 | 20 | 20 | 10 | 5 | 20 | 0 | 0 | 20 | 0 | 0 | 20 | 0 | 0 | 20 ⁽¹⁾ |
| | 500 V ≤ U ≤ 690V | - | - | - | 25 | 20 | 20 | 10 | 5 | 20 | 0 | 0 | 20 | 0 | 0 | 20 | 0 | 0 | 20 ⁽¹⁾ |
| XT2 | U < 440 V | - | - | - | 30 | 25 | 10 | 20 | 15 | 10 | 5 | 0 | 10 | 0 | 0 | 10 | 0 | 0 | 10 ⁽¹⁾ |
| | 440 V < U < 500V | - | - | - | 50 | 45 | 20 | 40 | 35 | 20 | 25 | 20 | 20 | 0 | 0 | 20 | 0 | 0 | 20 ⁽¹⁾ |
| | 500 V ≤ U ≤ 690V | - | - | - | 50 | 45 | 20 | 40 | 35 | 20 | 25 | 20 | 20 | 0 | 0 | 20 | 0 | 0 | 20 ⁽¹⁾ |
| XT3 | U < 440 V | - | - | - | 50 | 20 | 20 | 45 | 15 | 20 | 25 | 0 | 20 | 0 | 0 | 20 | 0 | 0 | 20 ⁽¹⁾ |
| | 440 V < U < 500V | - | - | - | 50 | 20 | 20 | 45 | 15 | 20 | 25 | 0 | 20 | 0 | 0 | 20 | 0 | 0 | 20 ⁽¹⁾ |
| | 500 V ≤ U ≤ 690V | - | - | - | 50 | 20 | 20 | 45 | 15 | 20 | 25 | 0 | 20 | 0 | 0 | 20 | 0 | 0 | 20 ⁽¹⁾ |
| XT4 | U < 440 V | - | - | - | 30 | 25 | 10 | 25 | 20 | 10 | 5 | 0 | 10 | 0 | 0 | 10 | 0 | 0 | 10 ⁽¹⁾ |
| | 440 V < U < 500V | - | - | - | 50 | 45 | 20 | 45 | 40 | 20 | 25 | 20 | 20 | 10 | 5 | 20 | 0 | 0 | 20 ⁽¹⁾ |
| | 500 V ≤ U ≤ 690V ⁽³⁾ | - | - | - | 50 | 45 ⁽²⁾ | 20 | 45 | 40 | 20 | 25 | 20 ⁽²⁾ | 20 | 10 | 5 | 20 | 0 | 0 | 20 ⁽¹⁾ |
| XT4X | U ≤ 690V AC | - | - | - | 100 | 100 | 50 | 40 | 40 | 50 | 75 | 75 | 50 | 10 | 10 | 50 | 0 | 0 | 20 ⁽¹⁾ |
| XT5 | U ≤ 440 V AC | 30 | 25 | 25 | 5 | 5 | 25 | 10 | 10 | 25 | 10 | 10 | 25 | 10 | 10 | 25 | 0 | 0 | 25 ⁽¹⁾ |
| | 440 V AC < U < 500V AC | 30 | 25 | 25 | 5 | 5 | 25 | 10 | 10 | 25 | 10 | 10 | 25 | 10 | 10 | 25 | 0 | 0 | 25 ⁽¹⁾ |
| | 500 V AC ≤ U ≤ 690 V AC | - | - | - | 35 | 20 | 25 | 40 | 40 | 25 | 35 | 20 | 25 | 10 | 10 | 25 | 0 | 0 | 50 ⁽¹⁾ |
| XT6 | U ≤ 440 V AC | 35 | 20 | 25 | 35 | 20 | 25 | 35 | 20 | 25 | - | - | - | 0 | 0 | 25 | 0 | 0 | 25 ⁽¹⁾ |
| | 440 V AC < U < 500V AC | 100 | 20 | 25 | 100 | 20 | 25 | 35 | 20 | 25 | - | - | - | 0 | 0 | 25 | 0 | 0 | 25 ⁽¹⁾ |
| | 500 V AC ≤ U ≤ 690 V AC | 100 | 20 | 25 | 100 | 20 | 25 | 35 | 20 | 25 | - | - | - | 0 | 0 | 25 | 0 | 0 | 25 ⁽¹⁾ |
| XT7 | U < 440 V | 50 | 10 | 20 | 50 | 10 | 20 | 5 | 0 | 5 | - | - | - | 0 | 0 | 20 | 0 | 0 | 20 ⁽¹⁾ |
| | 440 V < U < 500V | 100 | 10 | 20 | 100 | 10 | 20 | 40 | 10 | 5 | - | - | - | 50 | 0 | 20 | 0 | 0 | 20 ⁽¹⁾ |
| | 500 V ≤ U ≤ 690V | 100 | 10 | 20 | 100 | 10 | 20 | 40 | 10 | 5 | - | - | - | 50 | 0 | 20 | 0 | 0 | 20 ⁽¹⁾ |

(1) In case of ES terminals this distance has to be considered starting from terminal edge

(2) XT4V only: 50mm with LTC and 25mm with PSs 25mm


(3) XT4V only: for application at 690VAC the insulation distances to be used are the same of XT4X

Direct Current (DC) application

| | No accessories | | | Low terminal cover (LTC) | | | High terminal cover (HTC) | | | Phase separators 25mm | | | Phase separators 100mm | | | Phase separators 200mm | | | |
|----------------|------------------------|-----|----|--------------------------|-----|----|---------------------------|----|----|-----------------------|----|----|------------------------|----|----|------------------------|---|-------------------|-------------------|
| | T | D | L | T | D | L | T | D | L | T | D | L | T | D | L | T | D | L | |
| XT1 | U ≤ 250V | - | - | 25 | 20 | 20 | 10 | 5 | 20 | 0 | 0 | 20 | 0 | 0 | 20 | 0 | 0 | 20 ⁽¹⁾ | |
| | 250V < U ≤ 500V | - | - | 25 | 20 | 20 | 10 | 5 | 20 | 0 | 0 | 20 | 0 | 0 | 20 | 0 | 0 | 20 ⁽¹⁾ | |
| XT2 | U ≤ 250V | - | - | 50 | 45 | 50 | 40 | 35 | 50 | 25 | 20 | 50 | 0 | 0 | 50 | 0 | 0 | 50 ⁽¹⁾ | |
| | 250V < U ≤ 500V | - | - | 50 | 45 | 50 | 40 | 35 | 50 | 25 | 20 | 50 | 0 | 0 | 50 | 0 | 0 | 50 ⁽¹⁾ | |
| XT3 | U ≤ 250V | - | - | 50 | 20 | 20 | 45 | 15 | 20 | 25 | 0 | 20 | 0 | 0 | 20 | 0 | 0 | 20 ⁽¹⁾ | |
| | 250V < U ≤ 500V | - | - | 50 | 20 | 20 | 45 | 15 | 20 | 25 | 0 | 20 | 0 | 0 | 20 | 0 | 0 | 20 ⁽¹⁾ | |
| XT4 | U ≤ 250V | - | - | 30 | 25 | 20 | 25 | 20 | 20 | 5 | 0 | 20 | 0 | 0 | 20 | 0 | 0 | 20 ⁽¹⁾ | |
| | 250V < U ≤ 500V | - | - | 50 | 45 | 50 | 45 | 40 | 50 | 25 | 20 | 50 | 10 | 5 | 50 | 0 | 0 | 50 ⁽¹⁾ | |
| XT4V/X* | U ≤ 500V | - | - | 50 | 45 | 50 | 45 | 40 | 50 | 25 | 20 | 50 | 10 | 5 | 50 | 0 | 0 | 50 | |
| | 500V < U ≤ 750V | - | - | 100 | 100 | 50 | 45 | 40 | 50 | 75 | 75 | 50 | 10 | 5 | 50 | 0 | 0 | 50 | |
| XT5 | U ≤ 250 V DC | 30 | 25 | 25 | 5 | 0 | 25 | 10 | 10 | 25 | 10 | 10 | 25 | 10 | 10 | 25 | 0 | 0 | 25 ⁽¹⁾ |
| | U ≤ 500 V DC | - | - | - | 40 | 0 | 25 | 40 | 40 | 25 | 40 | 40 | 25 | 10 | 10 | 25 | 0 | 0 | 25 ⁽¹⁾ |
| | 500 V DC < U ≤ 750V DC | - | - | - | 40 | 20 | 25 | 60 | 60 | 50 | 60 | 60 | 50 | 10 | 10 | 50 | 0 | 0 | 50 ⁽¹⁾ |
| XT6 | U ≤ 500 V DC | 35 | 20 | 25 | 35 | 20 | 25 | 35 | 20 | 25 | - | - | - | 0 | 0 | 25 | 0 | 0 | 25 ⁽¹⁾ |
| | 500 V DC < U ≤ 750V DC | 100 | 20 | 25 | 100 | 20 | 25 | 35 | 20 | 25 | - | - | - | 0 | 0 | 25 | 0 | 0 | 25 ⁽¹⁾ |
| XT7 | U ≤ 500V | 50 | 10 | 20 | 50 | 10 | 20 | 5 | 0 | 5 | - | - | - | 0 | 0 | 20 | 0 | 0 | 20 ⁽¹⁾ |
| | 500V < U ≤ 750V | 100 | 10 | 20 | 100 | 10 | 20 | 30 | 10 | 5 | - | - | - | 50 | 0 | 20 | 0 | 0 | 20 ⁽¹⁾ |

* Considered only FC CuAl with PB 25mm configuration

(1) in case of ES terminals this distance has to be considered starting from the terminal edge

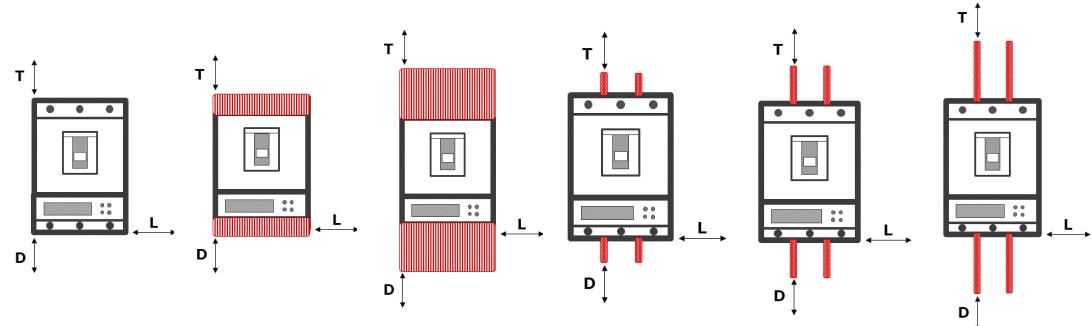

Insulation distances

Minimum clearance between two side by side circuit-breakers

This section gives the clearances to be observed for side by side installation of SACE Tmax XT circuit-breakers in plants with voltages up to 690V AC.

The following table show the minimum center distance between two circuit-breaker side by side. When side by side breakers are different in size, the larger reference clearance should be considered.

In case of Tmax XT1 up to XT5⁽¹⁾, the values are valid only when they have an HTC or a phase separator is inserted in the slot formed when placing the two fixed circuit-breakers side by side (see Fig.1 and Fig.2). For further details about installation, please see the related instructions provided with the circuit-breaker."

| | Circuit-breaker width (mm) | | Centre distance I (mm) | |
|------------|----------------------------|---------|------------------------|--------------------|
| | 3 poles | 4 poles | 3 poles | 4 poles |
| XT1 | 76 | 102 | 76 | 102 |
| XT2 | 90 | 120 | 90 | 120 |
| XT3 | 105 | 140 | 105 | 140 |
| XT4 | 105 | 140 | 105 | 140 |
| XT5 | 140 | 186 | 140 | 186 |
| XT6 | 210 | 280 | 210 | 280 |
| XT7 | 210 | 280 | 210 ⁽²⁾ | 280 ⁽²⁾ |

(1) XT5: HTC or phase separators requested for installation voltage values $U_e \geq 500V$ only

(2) for installation with F terminals only. With other connections refer to distances fixed by dimensions of back insulating plates requested

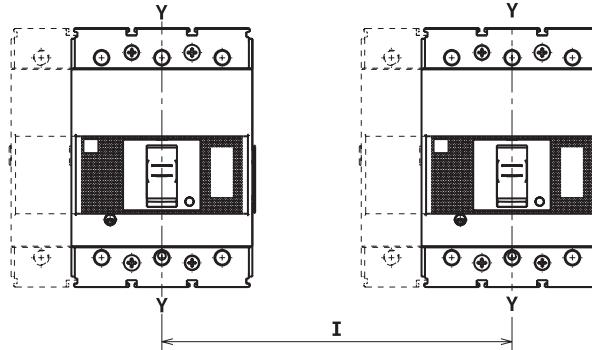


Fig. 1
Side by side XT1...
XT5⁽¹⁾ with HTC

Fig. 2
Side by side XT1...XT5⁽¹⁾
with phase separators

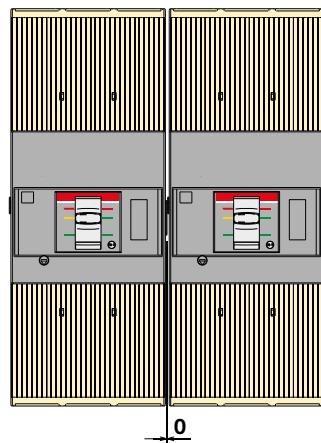


Fig. 1


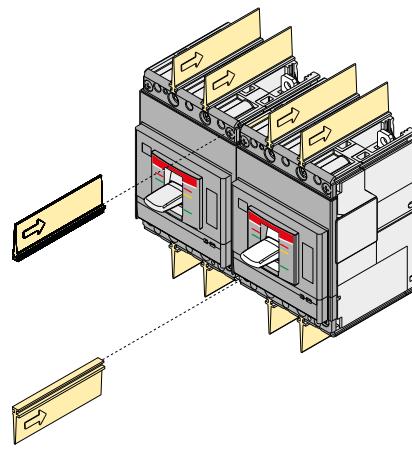


Fig. 2

If the conditions written above are not fulfilled, SACE Tmax XT circuit-breakers can be installed side by side with a minimum clearance D as shown in the following table:

| Circuit-breaker | Terminals | D [mm] |
|-----------------|--------------------------|---------------------------|
| XT1-XT3 F-P | ES | 35 |
| | EF | 35 |
| | Other types of terminals | 25 |
| XT2-XT4 F-P-W | ES | 120 |
| | EF | 35 |
| | Other types of terminals | 25 |
| XT5 F-P-W | ES | 120 |
| | EF | 150 |
| | Other types of terminals | 50 |
| XT6 F-W | ES | 120 |
| | EF | 150 |
| | Other types of terminals | 50 |
| XT7 F-W | ES | 150 |
| | EF | 70 |
| | Other types of terminals | 0 fixed - 70 withdrawable |

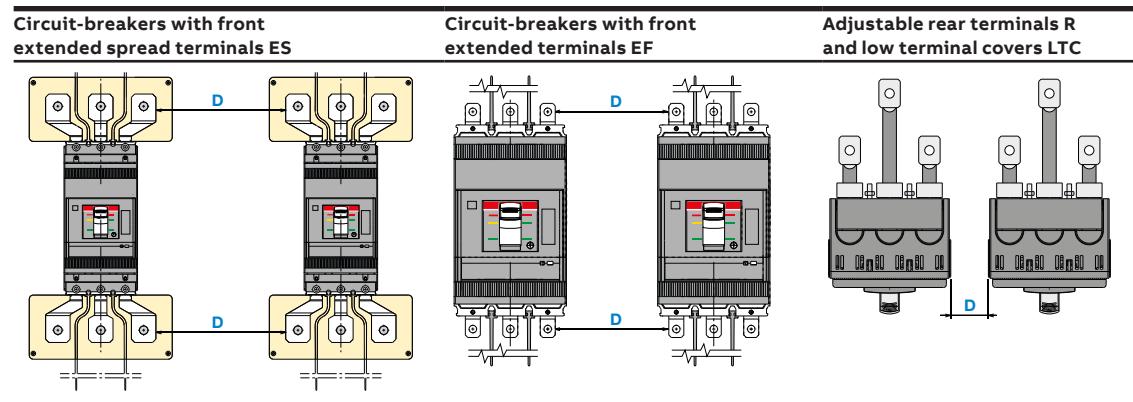


Insulation distances

Minimum clearance between two superimposed circuit-breakers

This section gives the clearances H to meet for superimposed mounting of the SACE Tmax XT circuit-breakers in installations with voltages up to 690Vac. Verify that the bare bars or connection cables do not reduce the recommended clearances.

The distances given in the table refer to the maximum overall dimensions of the circuit-breakers in the different versions (F/W/P), with terminals and metallic lugs of insulated cables included, for example. When superimposed circuit-breakers are different in size, the larger reference clearance should be considered.

| Circuit-breaker | H [mm] |
|-----------------|--------|
| XT1 | 80 |
| XT2 | 100 |
| XT3 | 140 |
| XT4 | 150 |
| XT5 | 200 |
| XT6 | 180 |
| XT7 | 180 |

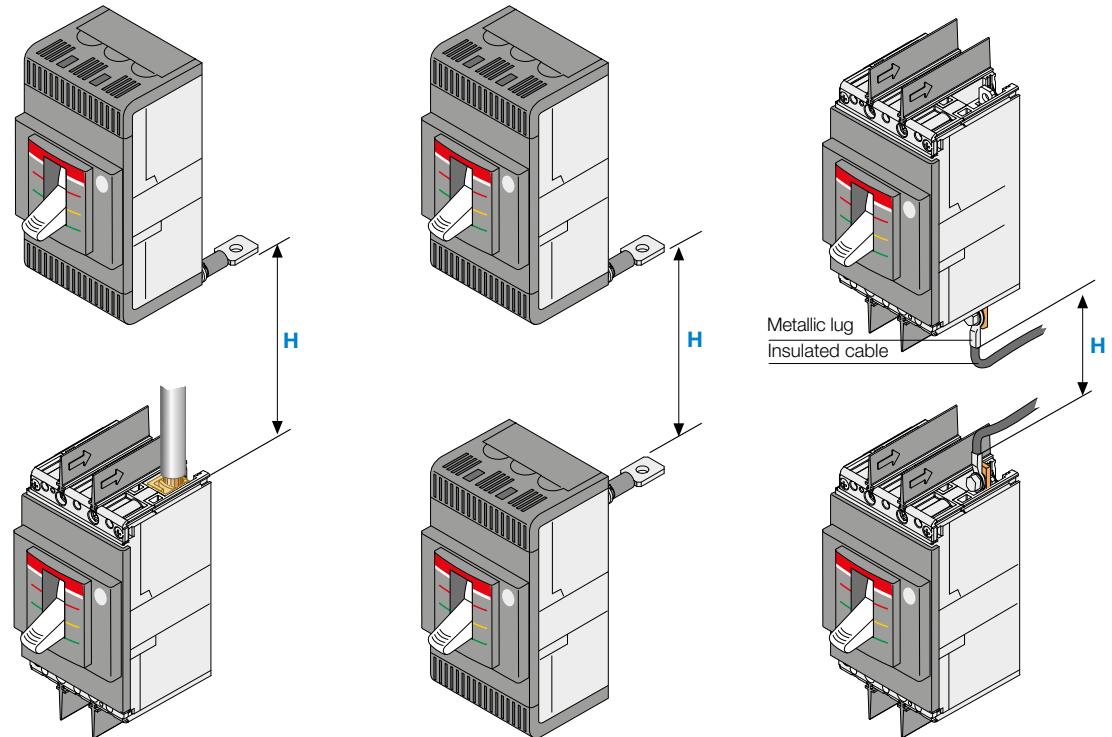


In case of cables with metallic lugs, an insulating screen behind the metallic lugs (on the rear of the circuit-breaker) or high terminal covers is mandatory.

The first insulated anchor


For the Tmax XT molded-case circuit-breakers, the figure below gives an example of the maximum recommended distance (in mm) within which the first insulated anchor should be positioned according to the highest admissible peak current value of the circuit-breaker and according to the cross-sectional area of the cable.

The maximum recommended distance is also valid for busbar connections. For further information and details circuit-breaker instruction manuals should be consulted.


SACE Tmax XT1

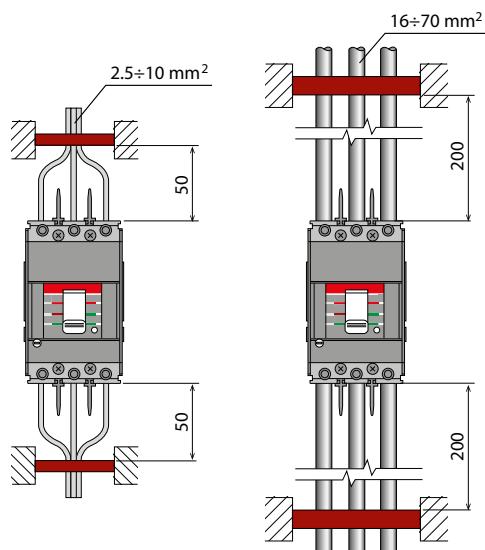


SACE Tmax XT2

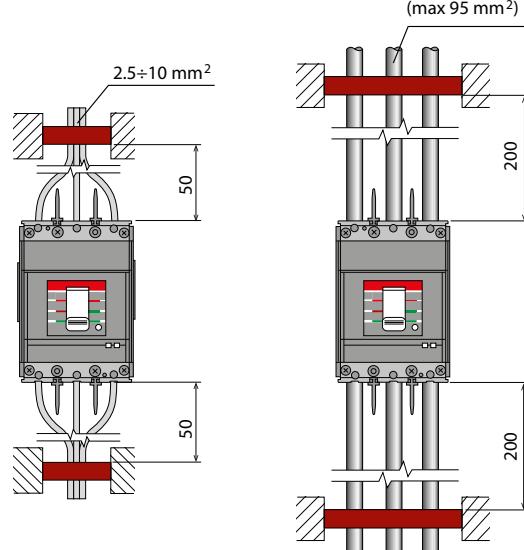

SACE Tmax XT3

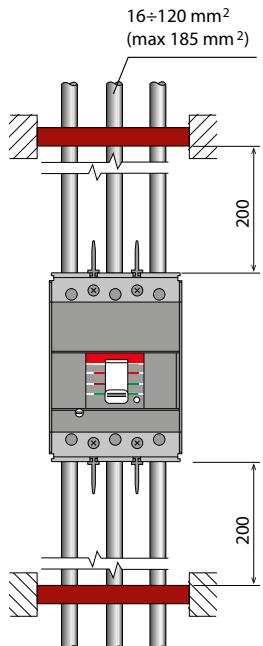


SACE Tmax XT4

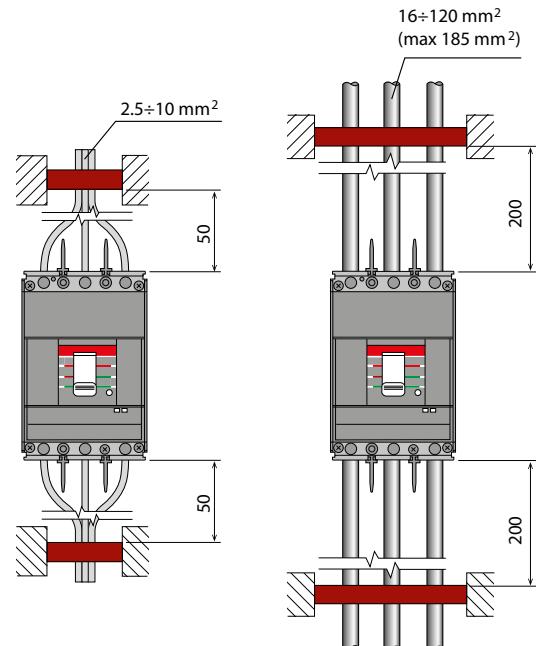


Insulation distances


SACE Tmax XT5

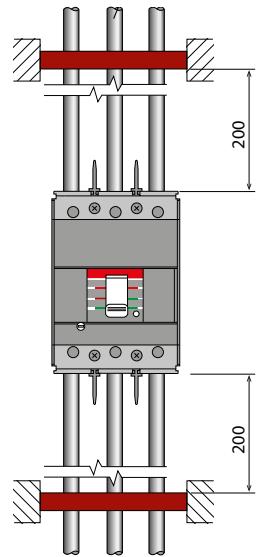

SACE Tmax XT6

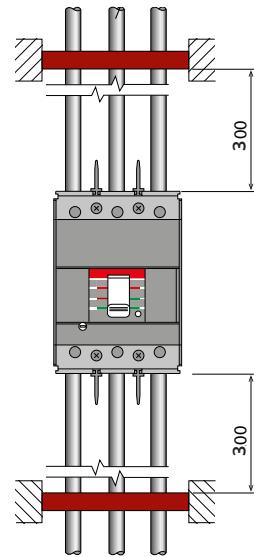

SACE Tmax XT7

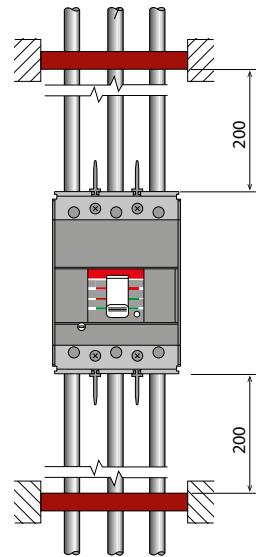

Special applications

Use of direct current apparatus

Variation in magnetic tripping

The thermal-magnetic trip units of the SACE Tmax XT circuit-breakers are suitable for use in direct current applications. For the protection thresholds against short-circuits, correction values (K_m) must be used, according to the type of distribution network and to the number of poles to be connected in series (the thermal threshold does not undergo any alteration).

The correction value to be used can be found in the following tables.



Connection diagrams of poles in an insulated network

| Insulated network | | ≤ 250 | ≤ 500 | ≤ 750 |
|-------------------|----------------------------------|------------|------------|------------|
| Un | Protection + insulation function | | | |
| XT1 | | 1.6 | | 1.6 |
| XT2 | | 1.5 | 1.5 | |
| XT3 | | 1.35 | 1.35 | |
| XT4 | | 1.5 | 1.5 | 1.5 |
| XT5 | | 1.1 | 1.1 | 1.1 |
| XT6 | | 1.1 | 1.1 | 1 |

Special applications



Connection diagrams of poles in a network with one grounded polarity

Network with one grounded polarity

| Un | ≤ 250 | ≤ 500 |
|----------------------------------|---|---|
| Protection + insulation function |  |  |
| XT1 | | |
| XT2 | | 1.5 |
| XT3 | | 1.35 |
| XT4 | | 1.5 |
| XT5 | 1.1 | 1.1 |
| XT6 | 1.1 | 1.1 |




Note: in the considered connections, the earthed polarity is the negative one.

Network with one grounded polarity

| Un | ≤ 500 | ≤ 750 |
|---------------------|---|---|
| Protection function |  |  |
| XT1 | 1.6 | 1.6 |
| XT2 | 1.5 | 1.5 |
| XT3 | 1.35 | 1.35 |
| XT4 | 1.5 | 1.5 |
| XT5 | | 1.1 |
| XT6 | | 1 |

Note: in the considered connections, the earthed polarity is the negative one.

Connection diagrams of poles in switch-disconnectors
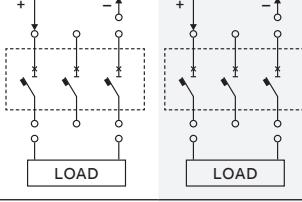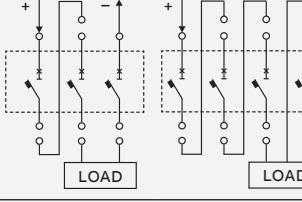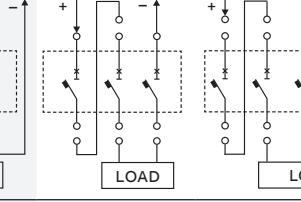
| Switch-disconnectors | | ≤ 250 | ≤ 500 | ≤ 750 |
|----------------------|----------------------------------|---|---|--|
| Un | Protection + insulation function | | | |
| | |  |  |  |
| XT1 | | ■ | | ■ |
| XT3 | | ■ | ■ | |
| XT4 | | ■ | ■ | |
| XT5 | | ■ | ■ | ■ |
| XT6 | | ■ | ■ | ■ |
| XT7 | | ■ | ■ | ■ |

Special applications

Magnetic trip values in single phase application

| Breaker | Trip Unit | I_n [A] | I_3 [A] | Single-phase trip current (%I_3)⁽¹⁾ |
|----------------|---------------------------|---------------------------------|---------------------------------|--|
| XT1 | TMD | 16..160 | 450..1600 | 150% |
| XT2 | MF/MA | 1..160 | 14..2240 | 150% |
| | TMD/TMA | 1.6..160 | 16..1600 | 150% |
| | TMG | 16..160 | 160..480 | 150% |
| | Ekip Dip LS/I | 10..160 | 1..10xIn | 100% |
| | Ekip Dip LIG | 10..160 | 1..10xIn | 100% |
| | Ekip Dip LSI | 10..160 | 1..10xIn | 100% |
| | Ekip Dip LSIG | 10..160 | 1..10xIn | 100% |
| | Ekip M Dip I | 10..160 | 1..10xIn | 100% |
| | Ekip M Dip LIU | 25..160 | 6..13xIn | 100% |
| | Ekip G Dip LS/I | 25..160 | 1..10xIn | 100% |
| | Ekip Touch LSI | 40..160 | 1.5..10xIn | 100% |
| | Ekip Touch LSIG | 40..160 | 1.5..10xIn | 100% |
| | Ekip Touch Measuring LSI | 40..160 | 1.5..10xIn | 100% |
| | Ekip Touch Measuring LSIG | 40..160 | 1.5..10xIn | 100% |
| | Ekip Hi-Touch LSI | 40..160 | 1.5..10xIn | 100% |
| | Ekip Hi-Touch LSIG | 40..160 | 1.5..10xIn | 100% |
| | Ekip M Touch LRIU | 40..100 | 1.5..10xIn | 100% |
| XT3 | MA | 100..200 | 600..2400 | 150% |
| | TMD | 63..250 | 630..2500 | 150% |
| | TMG | 63..250 | 400..750 | 150% |
| XT4 | MA | 10..200 | 50..2000 | 150% |
| | TMD/TMA | 16..250 | 300..2500 | 150% |
| | Ekip Dip LS/I | 40..250 | 1..10xIn | 100% |
| | Ekip Dip LIG | 40..250 | 1..10xIn | 100% |
| | Ekip Dip LSI | 40..250 | 1..10xIn | 100% |
| | Ekip Dip LSIG | 40..250 | 1..10xIn | 100% |
| | Ekip M Dip I | 40..250 | 1..10xIn | 100% |
| | Ekip M Dip LIU | 40..160 | 6..13xIn | 100% |
| | Ekip G Dip LS/I | 40..250 | 1..10xIn | 100% |
| | Ekip Touch LSI | 100..250 | 1.5..10xIn | 100% |
| | Ekip Touch LSIG | 100..250 | 1.5..10xIn | 100% |
| | Ekip Touch Measuring LSI | 100..250 | 1.5..10xIn | 100% |
| | Ekip Touch Measuring LSIG | 100..250 | 1.5..10xIn | 100% |
| | Ekip Hi-Touch LSI | 100..250 | 1.5..10xIn | 100% |
| | Ekip Hi-Touch LSIG | 100..250 | 1.5..10xIn | 100% |
| | Ekip M Touch LRIU | 100..200 | 1.5..10xIn | 100% |

(1)Satisfy the requirements of the IEC 60947-2 Standard

| Breaker | Trip Unit | In [A] | I_3 [A] | Single-phase trip current (%I_3)⁽¹⁾ |
|----------------|---------------------------|-------------------|---------------------------------|--|
| XT5 | MA | 320..500 | 2240..6500 | 100% |
| | TMA | 320..630 | 1600..6300 | 100% |
| | TMG | 320..630 | 800..3150 | 100% |
| | Ekip Dip LS/I | 250..630 | 1..10xIn | 100% |
| | Ekip Dip LIG | 250..630 | 1..10xIn | 100% |
| | Ekip Dip LSI | 250..630 | 1..10xIn | 100% |
| | Ekip Dip LSIG | 250..630 | 1..10xIn | 100% |
| | Ekip M Dip I | 250..630 | 1..10xIn | 100% |
| | Ekip M Dip LIU | 250..500 | 6..13xIn | 100% |
| | Ekip G Dip LS/I | 250..630 | 1..10xIn | 100% |
| | Ekip Touch LSI | 250..630 | 1..5..10xIn | 100% |
| | Ekip Touch LSIG | 250..630 | 1..5..10xIn | 100% |
| | Ekip Touch Measuring LSI | 250..630 | 1..5..10xIn | 100% |
| | Ekip Touch Measuring LSIG | 250..630 | 1..5..10xIn | 100% |
| | Ekip Hi-Touch LSI | 250..630 | 1..5..10xIn | 100% |
| | Ekip Hi-Touch LSIG | 250..630 | 1..5..10xIn | 100% |
| XT6 | Ekip M Touch LRIU | 250..500 | 1..5..10xIn | 100% |
| | Ekip G Touch LSIG | 250..630 | 1..5..10xIn | 100% |
| | Ekip G Hi-Touch LSIG | 250..630 | 1..5..10xIn | 100% |
| | TMA | 630..800 | 3150..8000 | 100% |
| | Ekip Dip LS/I | 630..1000 | 1..10xIn | 100% |
| | Ekip Dip LIG | 630..1000 | 1..10xIn | 100% |
| | Ekip Dip LSI | 630..1000 | 1..10xIn | 100% |
| XT7 | Ekip Dip LSIG | 630..1000 | 1..10xIn | 100% |
| | Ekip M Dip I | 630..1000 | 1..10xIn | 100% |
| | Ekip M Dip LIU | 630..800 | 6..13xIn | 100% |
| | Ekip G Dip LS/I | 630..1000 | 1..10xIn | 100% |
| | Ekip Dip LS/I | 630..1600 | 1..10xIn | 100% |
| | Ekip Dip LIG | 630..1600 | 1..10xIn | 100% |
| | Ekip Dip LSI | 630..1600 | 1..15xIn | 100% |
| | Ekip Dip LSIG | 630..1600 | 1..15xIn | 100% |
| | Ekip M Dip I | 630..1600 | 1..10xIn | 100% |
| | Ekip G Dip LS/I | 630..1600 | 1..10xIn | 100% |
| | Ekip Touch LSI | 630..1600 | 1..5..15xIn | 100% |
| | Ekip Touch LSIG | 630..1600 | 1..5..15xIn | 100% |
| | Ekip Touch Measuring LSI | 630..1600 | 1..5..15xIn | 100% |
| | Ekip Touch Measuring LSIG | 630..1600 | 1..5..15xIn | 100% |
| | Ekip Hi-Touch LSI | 630..1600 | 1..5..15xIn | 100% |




(1)Satisfy the requirements of the IEC 60947-2 Standard




Special applications

Use of apparatus at 16 2/3 Hz

Single phase distribution with a frequency of 16 2/3 Hz was developed for electrical traction systems as an alternative to three phase 50 Hz systems, and to direct current systems.

We hereby confirm that ABB SACE Tmax XT1...XT6 equipped with thermo-magnetic protection release have the following electrical performance, according to IEC 60947-2 standard, at an operating frequency of 16 2/3 Hz.

| | | Breaking capacity (kA) | | |
|-------------------|-----------------------|--|--|--|
| Un (V) | | 250 | 500 | 750 |
| insulated network | |  |  |  |
| | XT1 | B C N S | 18 25 36 50 | |
| XT2 | N S H L | 36 50 70 85 | | 36 50 70 85 |
| XT3 | N | 36 | | 36 |
| XT4 | N S H L V | 36 50 70 85 | | 36 50 70 85 50 |
| XT5 | N S H L V | 25 35 50 70 85 | 25 35 50 70 85 | |
| XT6 | N S | 35 50 | 20 35 | 18 24 |

| | | Breaking capacity (kA) | | |
|--|---|---|---|--|
| Un (V) | | 250 | 500 | 750 |
| Network with one polarity earthed | |  |  |  |
| XT1 | B | 18 | | 18 |
| | C | 25 | | 25 |
| | N | 36 | | 36 |
| | S | 50 | | 50 |
| XT2 | N | 36 | 36 | 36 |
| | S | 50 | 50 | 50 |
| | H | 70 | 70 | 70 |
| | L | 85 | 85 | 85 |
| XT3 | N | 36 | 36 | 36 |
| XT4 | N | 36 | 36 | 36 |
| | S | 50 | 50 | 50 |
| | H | 70 | 70 | 70 |
| | L | 85 | 85 | 85 |
| | V | | | 50 |
| XT5 | N | 25 | | |
| | S | 35 | | |
| | H | 50 | | |
| | L | 70 | | |
| | V | 85 | | 85 |
| XT6 | N | 35 | | 18 |
| | S | 50 | | 24 |

The thermal and magnetic thresholds of protection release are the same as those given for a standard operating frequency $f = 50\text{Hz}$, with the connections indicated in the table above.

Special applications

Use of apparatus at 400 Hz

The following tables refer to circuit-breakers with thermomagnetic releases, with a breaking capacity limited to 36kA (XT1..XT4) and 10kA (XT5..XT6). These breaking capacities are normally more than sufficient for protection of 400 Hz plants, characterized by low short-circuit currents. As can be seen from the data indicated, the maximum ampere rating I_n decreases as the skin effect increases the thermal phenomena. Moreover, the magnetic threshold (I_3) increases with the frequency: for this reason, use of a 5- I_n version is recommended. In these tables, K_m is the multiplication factor to be applied to I_3 thresholds, due to the induced magnetic fields.

| Circuit Breaker | I_n | I_1 (50-60Hz) | | I_1 (400Hz) | | $K_m I_3$ (400 Hz) |
|-----------------|-------|-----------------|-------|---------------|-------|--------------------|
| | | min | max | min | max | |
| XT1 | 16 | 11 | 16 | 10.1 | 14.4 | 2 |
| | 20 | 14 | 20 | 12.6 | 18.0 | 2 |
| | 25 | 18 | 25 | 15.8 | 22.5 | 2 |
| | 32 | 22 | 32 | 20.2 | 28.8 | 2 |
| | 40 | 28 | 40 | 25.2 | 36.0 | 2 |
| | 50 | 35 | 50 | 31.5 | 45.0 | 2 |
| | 63 | 44 | 63 | 39.7 | 56.7 | 2 |
| | 80 | 56 | 80 | 50.4 | 72.0 | 2 |
| | 100 | 70 | 100 | 63.0 | 90.0 | 2 |
| | 125 | 88 | 125 | 78.8 | 112.5 | 2 |
| XT2 | 1.6 | 1.1 | 1.6 | 1.0 | 1.4 | 1.3 |
| | 2 | 1.4 | 2.0 | 1.3 | 1.8 | 1.3 |
| | 2.5 | 1.8 | 2.5 | 1.6 | 2.3 | 1.3 |
| | 3.2 | 2.2 | 3.2 | 2.0 | 2.9 | 1.3 |
| | 4 | 2.8 | 4.0 | 2.5 | 3.6 | 1.3 |
| | 5 | 3.5 | 5.0 | 3.2 | 4.5 | 1.3 |
| | 6.3 | 4.4 | 6.3 | 4.0 | 5.7 | 1.3 |
| | 8 | 5.6 | 8.0 | 5.0 | 7.2 | 1.3 |
| | 10 | 7.0 | 10.0 | 6.3 | 9.0 | 1.3 |
| | 12.5 | 8.8 | 12.5 | 7.9 | 11.3 | 1.3 |
| | 16 | 11.2 | 16.0 | 10.1 | 14.4 | 1.3 |
| | 20 | 14.0 | 20.0 | 12.6 | 18.0 | 1.3 |
| | 25 | 17.5 | 25.0 | 15.8 | 22.5 | 1.3 |
| | 32 | 22.4 | 32.0 | 20.2 | 28.8 | 1.3 |
| | 40 | 28.0 | 40.0 | 25.2 | 36.0 | 1.3 |
| | 50 | 35.0 | 50.0 | 31.5 | 45.0 | 1.3 |
| | 63 | 44.1 | 63.0 | 39.7 | 56.7 | 1.3 |
| | 80 | 56.0 | 80.0 | 50.4 | 72.0 | 1.3 |
| | 100 | 70.0 | 100.0 | 63.0 | 90.0 | 1.3 |
| | 125 | 87.5 | 125.0 | 78.8 | 112.5 | 1.3 |

| Circuit Breaker | In | I ₁ (50-60Hz) | | I ₁ (400Hz) | | Km I ₃ (400 Hz) |
|-----------------|-----|--------------------------|-----|------------------------|-------|----------------------------|
| | | min | max | min | max | |
| XT3 | 63 | 44 | 63 | 39.6 | 56.7 | 2 |
| | 80 | 56 | 80 | 50.4 | 72.0 | 2 |
| | 100 | 70 | 100 | 63.0 | 90.0 | 2 |
| | 125 | 88 | 125 | 79.2 | 112.5 | 2 |
| | 160 | 112 | 160 | 100.8 | 144.0 | 2 |
| | 200 | 140 | 200 | 126.0 | 180.0 | 2 |
| XT4 | 16 | 11 | 16 | 9.9 | 14.4 | 1.2 |
| | 20 | 14 | 20 | 12.6 | 18.0 | 1.2 |
| | 25 | 18 | 25 | 16.2 | 22.5 | 1.2 |
| | 32 | 22 | 32 | 19.8 | 28.8 | 1.2 |
| | 40 | 28 | 40 | 25.2 | 36.0 | 1.2 |
| | 50 | 35 | 50 | 31.5 | 45.0 | 1.2 |
| | 63 | 44 | 63 | 39.6 | 56.7 | 1.2 |
| | 80 | 56 | 80 | 50.4 | 72.0 | 1.2 |
| | 100 | 70 | 100 | 63.0 | 90.0 | 1.2 |
| | 125 | 88 | 125 | 79.2 | 112.5 | 1.2 |
| | 160 | 112 | 160 | 100.8 | 144.0 | 1.2 |
| | 200 | 140 | 200 | 126.0 | 180.0 | 1.2 |
| | 225 | 158 | 225 | 142.2 | 202.5 | 1.2 |
| | 320 | 224 | 320 | 201.6 | 288.0 | 1.1 |
| XT5 | 400 | 280 | 400 | 252.0 | 360.0 | 1.1 |
| | 500 | 350 | 500 | 315.0 | 450.0 | 1.1 |
| | 630 | 441 | 630 | 352.8 | 504.0 | 1.1 |

Coordination

Coordination between circuit-breakers

Selection of the protection system for electrical installation is fundamental both to guarantee correct economical and functional service of the whole installation and to reduce to a minimum the problems caused by abnormal service conditions or actual faults.

The coordination between the various devices dedicated to the protection of sections of installation or specific components has to be studied in order to have a protection system able to:

- detect what has happened and where, discriminating between abnormal but tolerable situations and fault situations within its zone of competence, thus avoiding unwanted trips which may cause unjustified stoppage of a properly operating part of the installation;
- act as rapidly as possible to limit the damage (destruction, accelerated ageing, etc.), thus safeguarding power supply continuity and stability.

In order to achieve these goals, it is necessary to know the operating coordination between an upstream circuit-breaker and the downstream one and choose the best combination that fits the installation specific needs.

Selectivity and back-up coordination

There are two different type of coordination between circuit-breakers.

If the priority of the installation is to assure service continuity, then selectivity is the coordination strategy. Selectivity, according to IEC 60947-1, is the coordination between the operating characteristics of two overcurrent protection devices. In the event of an overcurrent within established limits, only the circuit-breaker installed on the line affected by the fault (downstream) will trip. If the overcurrent value exceeds the selectivity limit, then also the upstream device will trip.

If the priority of the installation is to achieve economical savings of the components, then back-up is the suitable coordination. Back-up is the coordination between the operating characteristics of two overcurrent protection devices, so that the upstream protection supports the trip of the downstream protection in case of a short-circuit with a higher value than the short-circuit capacity of the downstream circuit-breaker. In this way, it is possible to optimize the breaking capacity of downstream protection devices by downsizing them.

Selected Optimized Coordination – SOC Online tool

ABB offers a quick and easy way to find the best coordination between circuit-breakers with [SOC Online tool](#).

This tool is not limited to molded-case circuit-breakers, but it includes constantly updated coordination tables for a wide range of ABB protection devices.

Tables can be examined directly online but is also possible to download a PDF version to have a ready to use project documentation.

Step 1

Set your country/language preferences or read the help pages

Choose the coordination type

Step 2

Set the

rated voltage*

Choose the upstream protection*

Choose the downstream protection*

Results MCCB/MCB

| Technology | MCCB | | | | | | | | | | | |
|------------|------------------|----|----|-----|-----|-----|----|----|----|----|----|----|
| | Tmax XT | | | | | | | | | | | |
| PR | N.S.H,L,V | | | | | | | | | | | |
| | 10 | 25 | 63 | 100 | 160 | 125 | 16 | 20 | 25 | 32 | 40 | 50 |
| Series | 3.6 | T | T | T | T | T | T | T | T | T | T | T |
| | 8 | T | T | T | T | T | T | T | T | T | T | T |
| Ch. | 5.5 | T | T | T | T | T | T | T | T | T | T | T |
| | 10 | T | T | T | T | T | T | T | T | T | T | T |
| Cu | 5.5 | T | T | T | T | T | T | T | T | T | T | T |
| | 13 | T | T | T | T | T | T | T | T | T | T | T |
| B.C | 5.5 | T | T | T | T | T | T | T | T | T | T | T |
| | 20 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 36,50,70,120,150 | | | | | | | | | | | |
| | 36 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3.3 | T | T | T | T | T | T | T | T | T | T | T |
| | 4.5 | T | T | T | T | T | T | T | T | T | T | T |
| TM | 7.5 | T | T | T | T | T | T | T | T | T | T | T |
| | 7.5 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 5 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 6 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 8 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 10 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 13 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 16 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 20 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 25 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 32 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 40 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 50 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 7.5 | T | T | T | T | T | T | T | T | T | T | T |
| | 7.5 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 5 | T | T | T | T | T | T | T | T | T | T | T |
| | 6 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 5 | T | T | T | T | T | T | T | T | T | T | T |
| | 7.5 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 6 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 7.5 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 10 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 13 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 16 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 20 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 25 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 32 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 40 | T | T | T | T | T | T | T | T | T | T | T |
| Icu | 3 | T | T | T | T | T | T | T | T | T | T | T |
| | 50 | T | T | T | T | T | T | T | T | T | T | T |

* Filters can be set without a fixed sequence. If a filter has been modified, others will be kept (if allowed by the conditions).

**This is only valid for selectivity.

Table with coordination results (expressed in kA):

- **numeric value:** represents the max value of short circuit current for which the upstream device is selective (or it guarantees back-up) towards the downstream device;
- **empty cells:** means that for the relative rated currents the selectivity/back-up cannot be achieved;
- **T**:** means that the upstream device assures selectivity up to the Icu value of the downstream device (Total Selectivity)

Characteristic curves

Example of curves reading

Example 1 - XT3N 250


Trip curves for distribution - (thermal magnetic trip unit)

These curves provide information about the tripping time of the thermal magnetic trip units. The red band indicates the hot trip times, that is with the breaker already loaded with its rated current once the overload has occurred.

The blue band gives the cold trip times, that is with no current flowing into the breaker before the fault.

The curves are assumed at reference air ambient temperature of 40°C and considering three phase overload with symmetrical and equilibrated currents.

Let us consider an XT3N 250 TMD In=250 A circuit-breaker. The trip time of the thermal protection varies considerably depending on the conditions when the overload occurs, i.e. whether the circuit-breaker is at the thermal regime (either cold or hot trip conditions). For example, for an overload current $3 \times I_1$, the trip time ranges from 107.9 s to 31.5 s for cold tripping and from 31.5 s to 7.0 s for hot tripping. For fault current values higher than 2500 A, the circuit-breaker trips with the instantaneous magnetic protection I_3 .

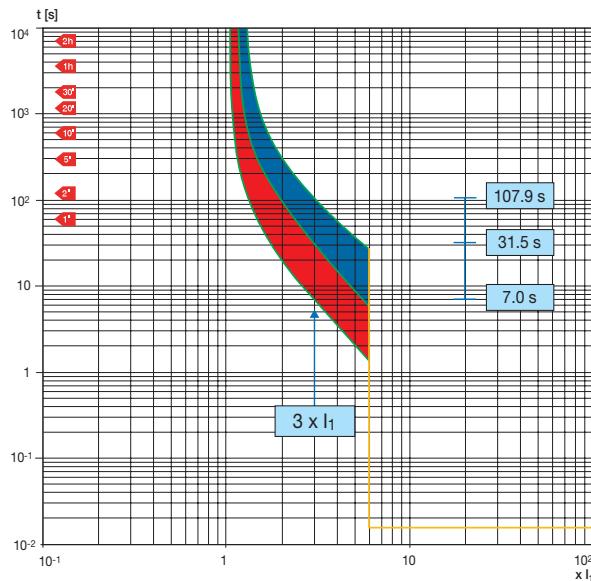


Example 2 - XT2N 160

Specific let-through energy curves

The following figure shows an example of the graph of the specific let-through energy of the XT2N 160 In=160A circuit-breaker at 220/230V. The prospective symmetrical short-circuit current is indicated on the x-axis, whereas the values of the specific let-through energy expressed in A²s are shown on the y-axis.

The circuit-breaker lets through a value of I^2t equal to $0.76 \cdot 10^6 \text{ A}^2\text{s}$ in correspondence with a short-circuit current of 20 kA.

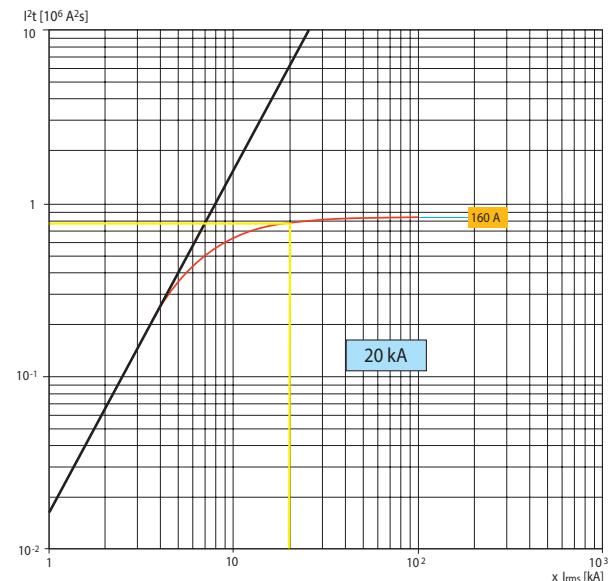


Example 3 - XT2N 160

Limitation curves

The figure below gives the trend of the limitation curves of the XT2N 160 $I_{n}=160$ A circuit-breaker. The effective value of the prospective symmetrical short-circuit current is given on the x-axis of the graph, whereas the peak value of the short-circuit current is indicated on the y-axis.

The limiting effect can be evaluated by comparing the peak value corresponding to the prospective short-circuit current (curve A) with the peak limited value (curve B), at the same value of symmetrical short-circuit current.

For a fault current of 20 kA, the XT2N 160 circuit-breaker with a thermal magnetic trip unit $I_n = 160$ A limits the peak prospective short-circuit current to 13.5 kA at a voltage of 500 V, with a reduction of 36.5 kA in relation to the peak value of the prospective short-circuit current.

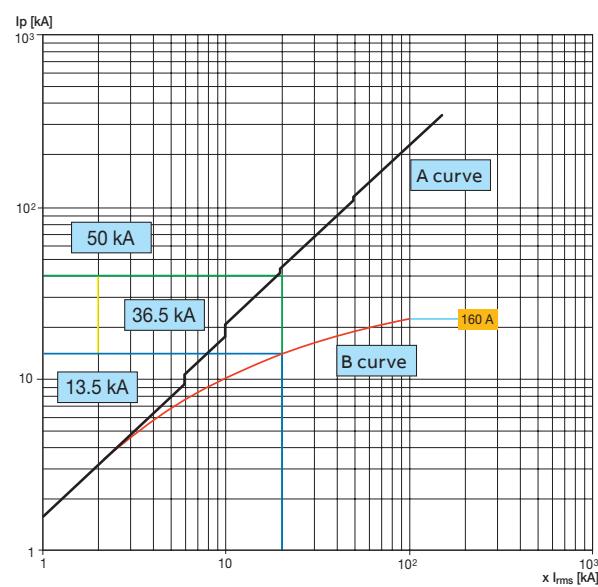

Characteristic curves



Example of curves reading

Example 4 - XT4N 250 Ekip M-LIU

Cold trip / hot trip curves

The first curve shows the time of intervention of the trip unit in case of fault under cold conditions. Each curve is related to a single operating class defined by Standard IEC 60947-4-1 (3E, 5E, 10E or 10E). The second curve, hot trip, must be read in relation to the previous one. Considering the time the circuit-breaker has remained open after the first trip ($t\text{-off}$ on the x-axis), the $t\text{-hot}/t\text{-cold}$ ratio can be identified on the y-axis.

Once the cold trip time has been identified on the first graph in relation to a fault current, the hot trip time can be calculated on the second graph, based on $t\text{-off}$ and class of intervention. For a XT4N 250 $I_n=200A$ in the operating class 10E, given a fault current of $0.8kA$ ($4\times I_n$), the cold trip time for intervention is 7s. If we consider a $t_{off} = 90s$, $t\text{-hot}/t\text{-cold} = 0.4$, the hot trip time results 2.8s.

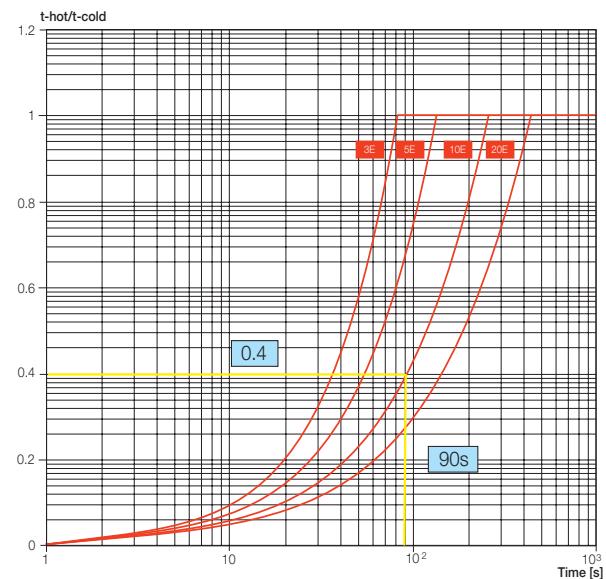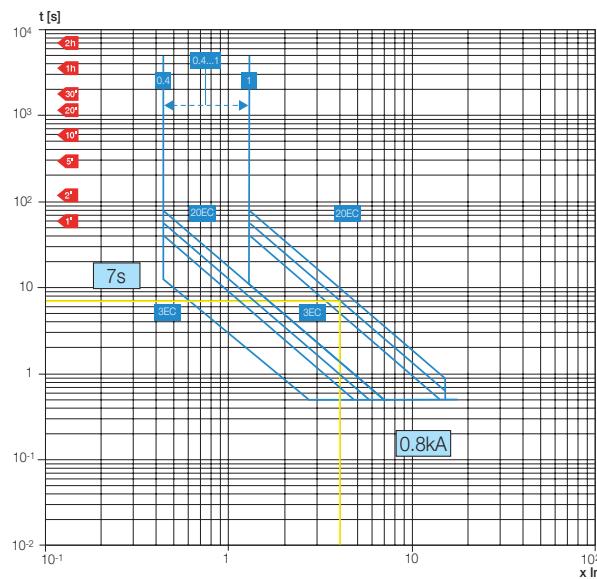


Characteristic curves


Trip curves with thermal magnetic trip unit

Trip curves for distribution


XT1 160 TMD In=16...63A

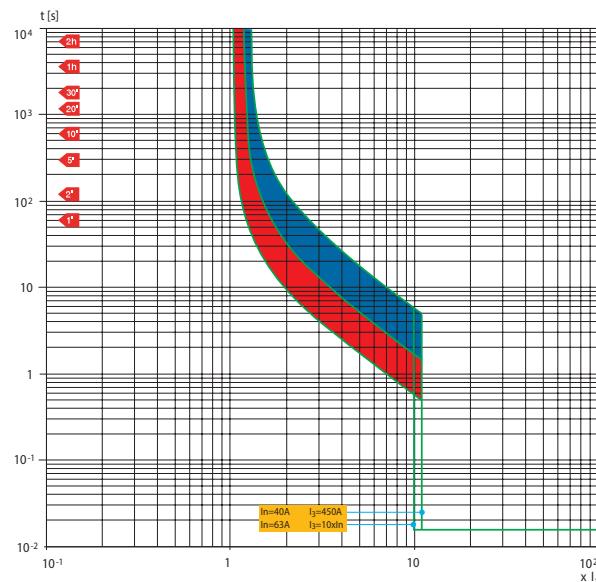


XT1 160 TMD In=80...160A

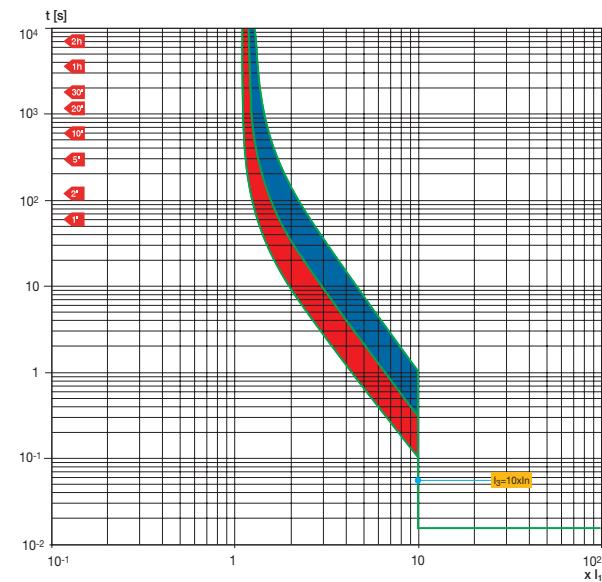

XT2 160 TMA In=1.6...50A

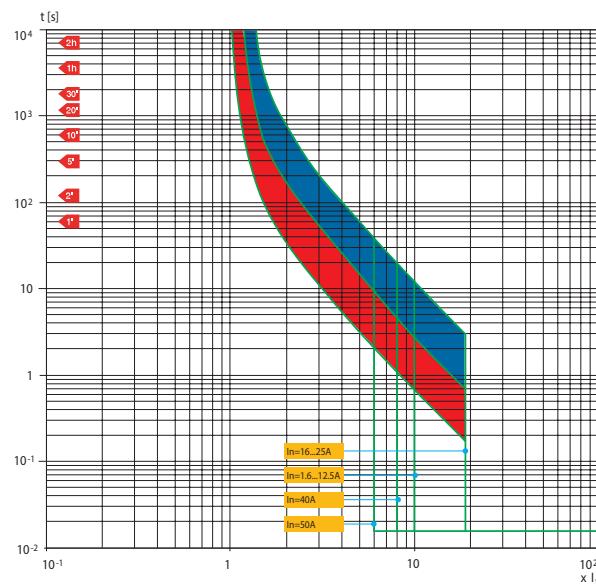


XT2 160 TMA In=63...160A

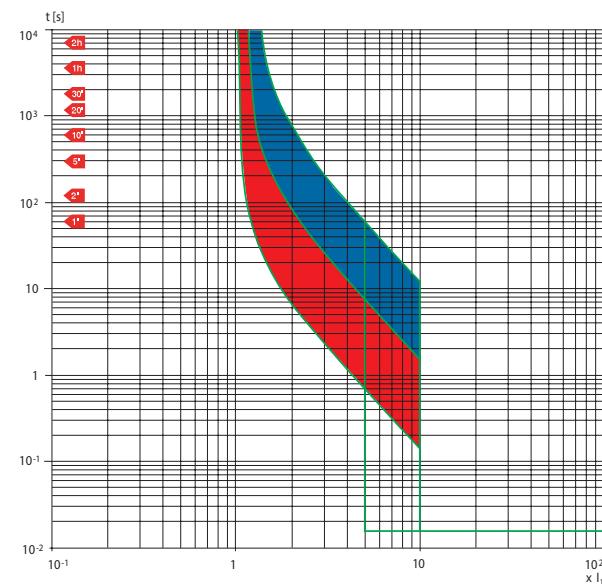


Characteristic curves

Trip curves with thermal magnetic trip unit


XT2 160 TMA In=100A

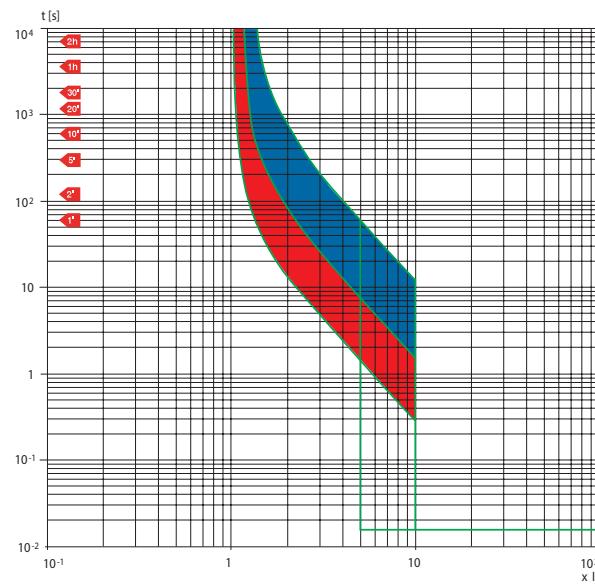


XT3 250 TMD In=63...250A


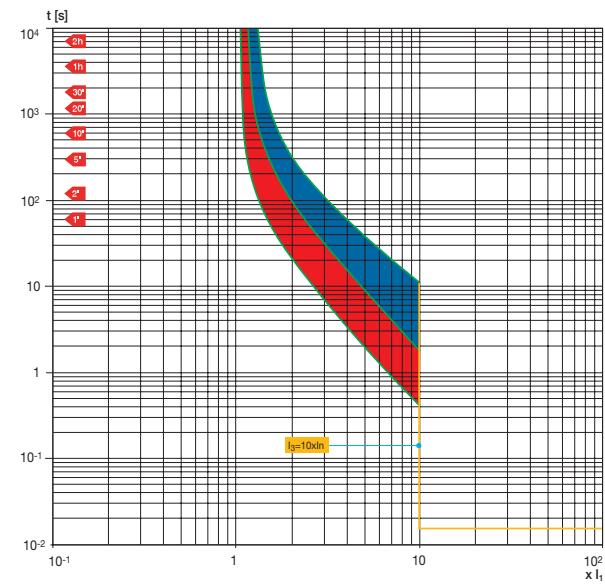


XT4 250 TMA In=16...250A

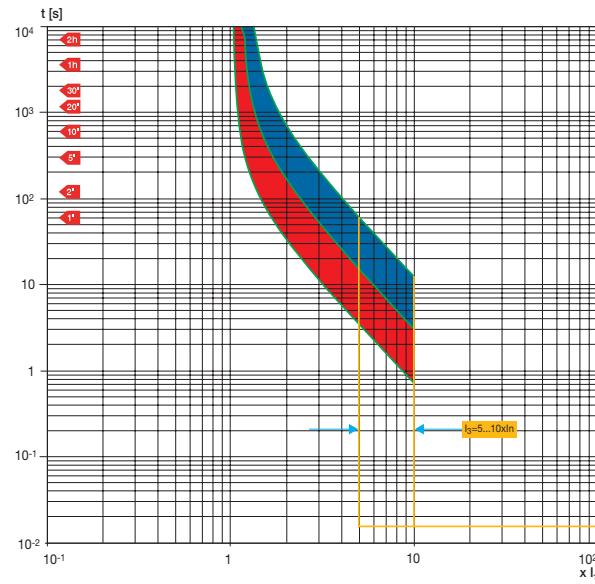

XT5 400-630 TMA In=320...630A

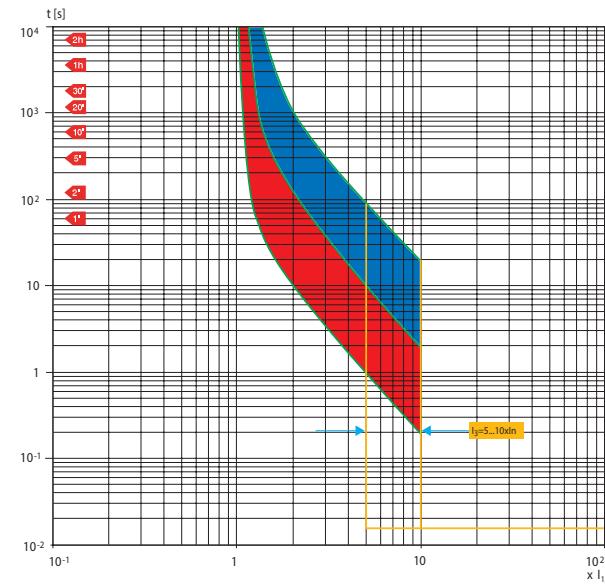

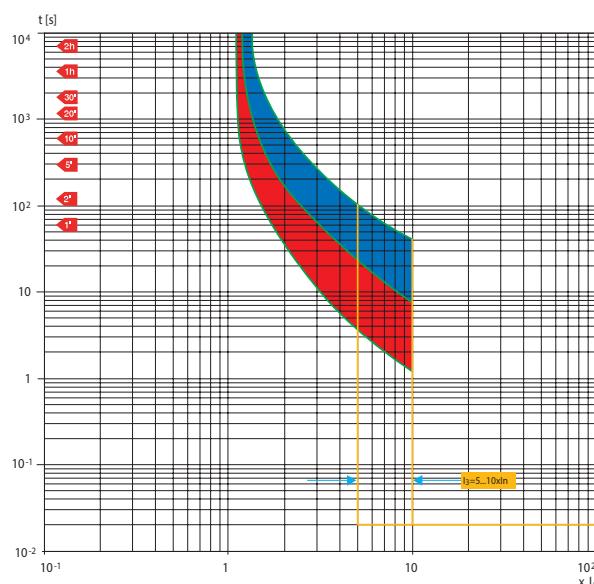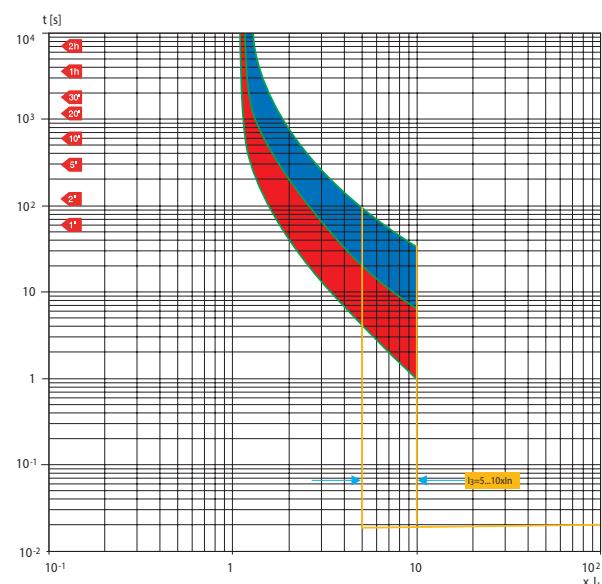
XT6 800 TMA In=630A**XT6 800 TMA In=800A**

Characteristic curves


Trip curves with thermal magnetic trip unit

Trip curves for motor protection


XT2 160 MF/MA In=1...160A

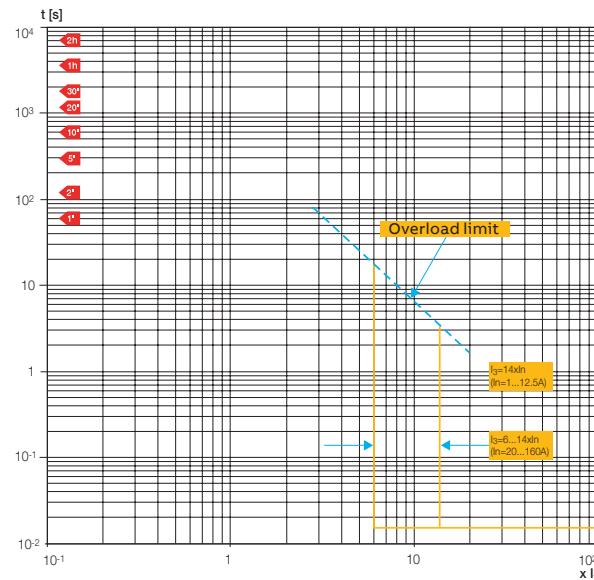


XT3 250 MA In=100...250A

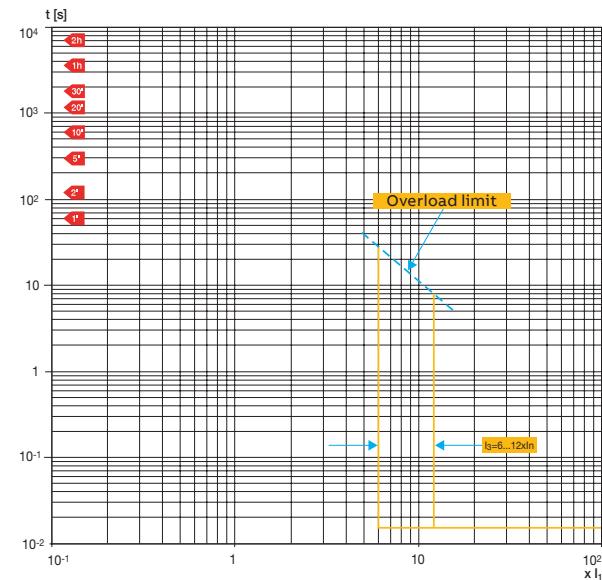

XT4 200 MA In=10...200A

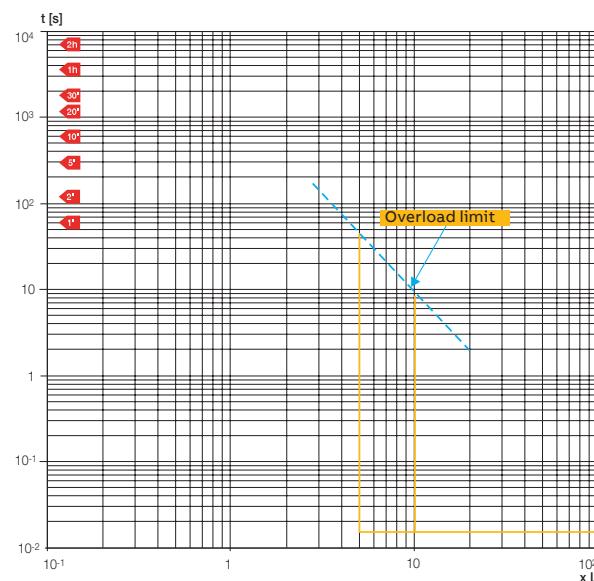


XT5 400-630 MA In=320...500A

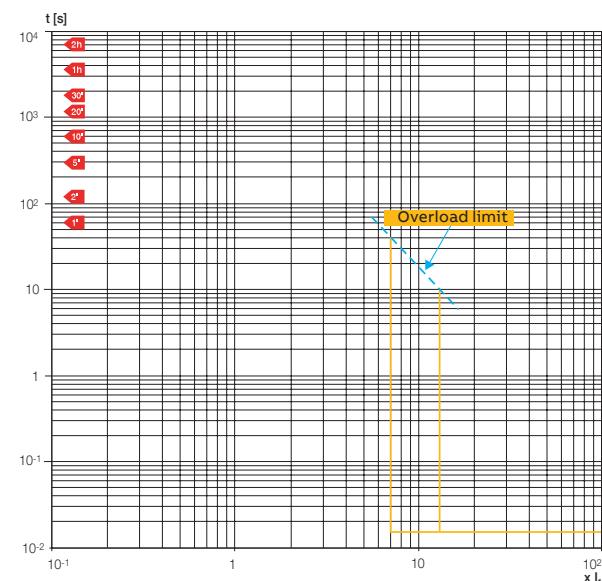


Trip curves for generator protection


XT2 160 TMG In=16...160A

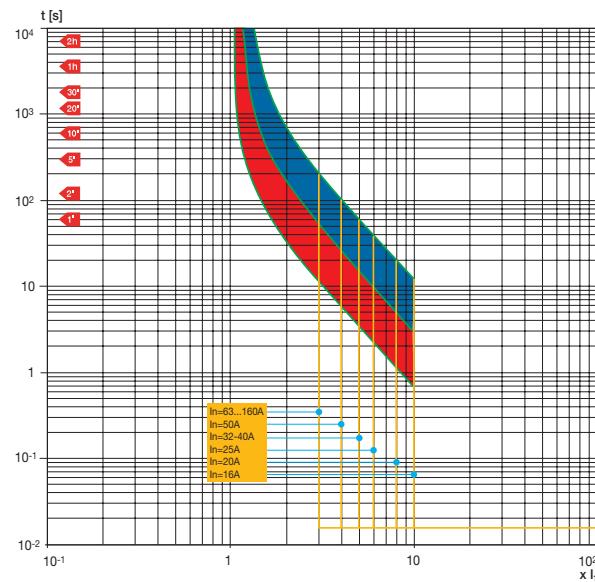

XT3 250 TMG In=63...250A

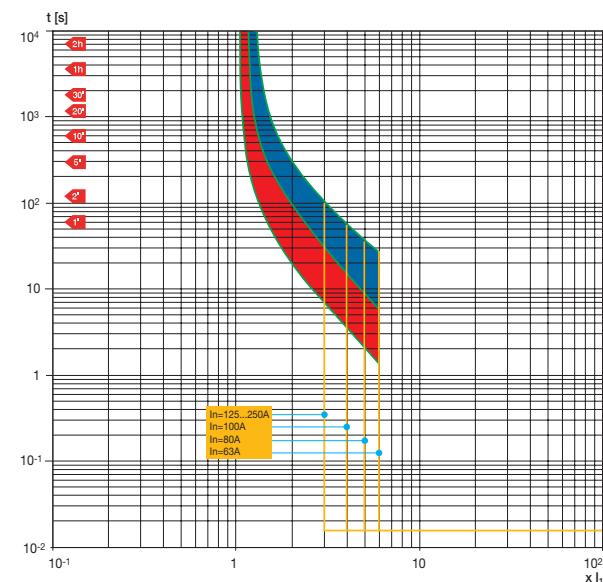

XT5 400-630 TMG In=320...630A

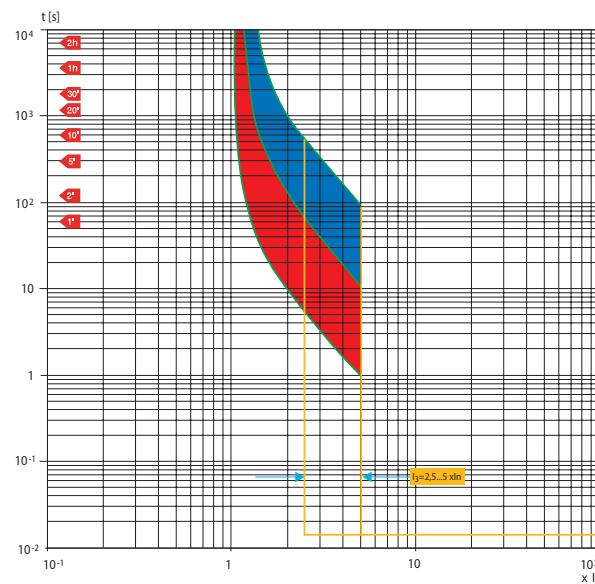


Characteristic curves


Trip curves with electronic trip unit Ekip Dip

Trip curves for distribution


**XT2 Ekip Dip LS/I
L-I functions**

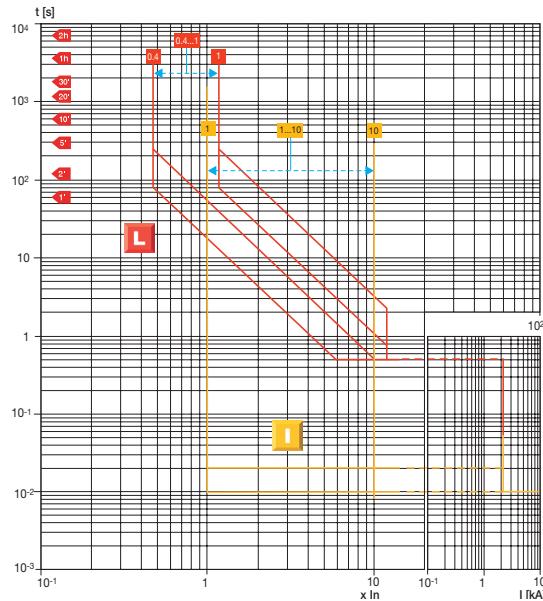


**XT2 Ekip Dip LS/I
L-S functions**

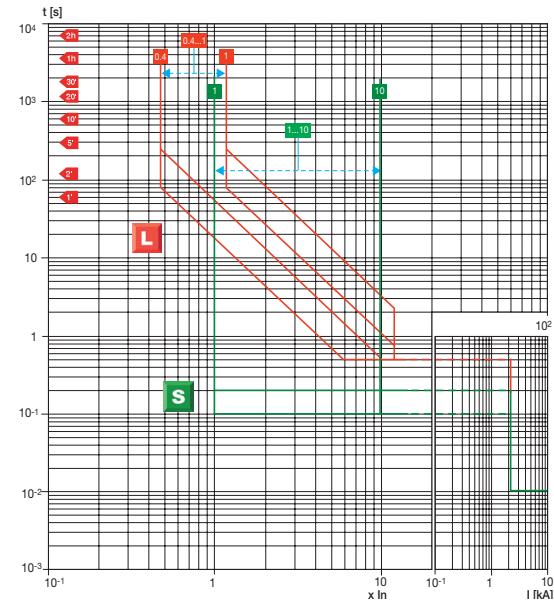


**XT2 Ekip Dip LIG
L-I functions**

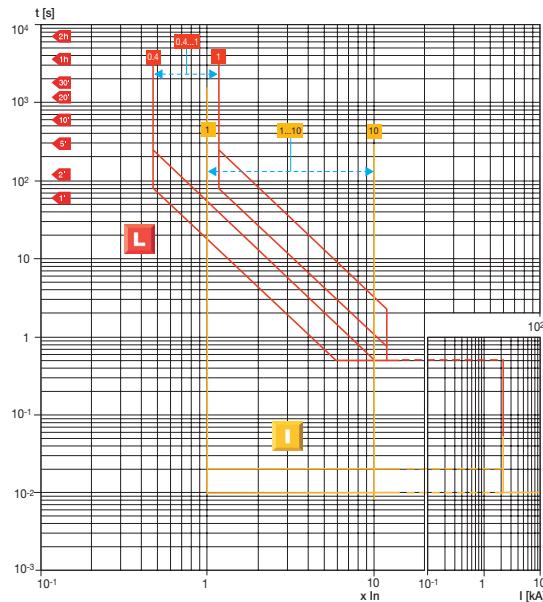


**XT2 Ekip Dip LIG
G function**

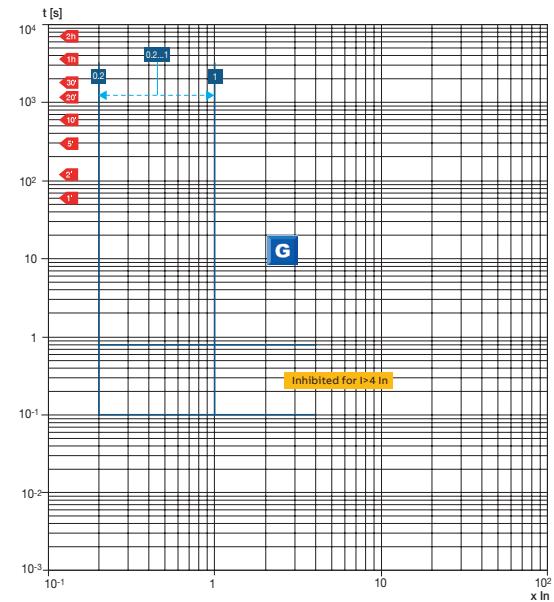


XT2 Ekip Dip LSI and Ekip C Dip LSI L-S-I functions

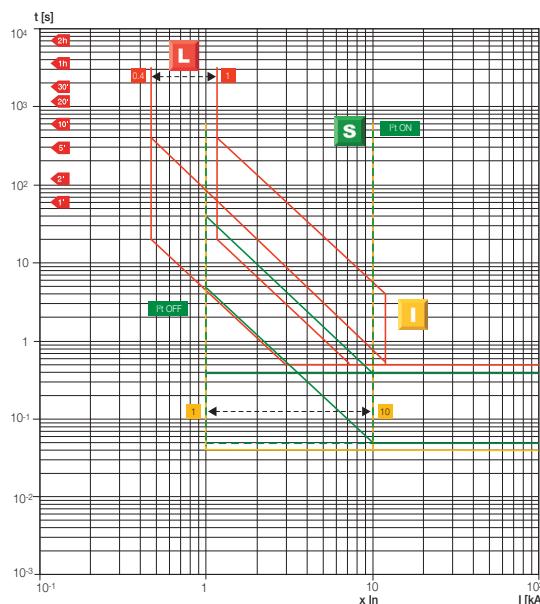


XT2 Ekip Dip LSIG and Ekip C Dip LSIG L-S-I functions

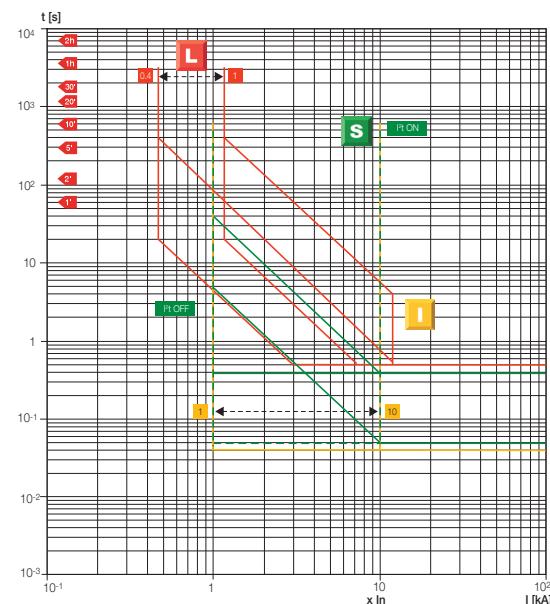

XT2 Ekip Dip LSIG and Ekip C Dip LSIG G function

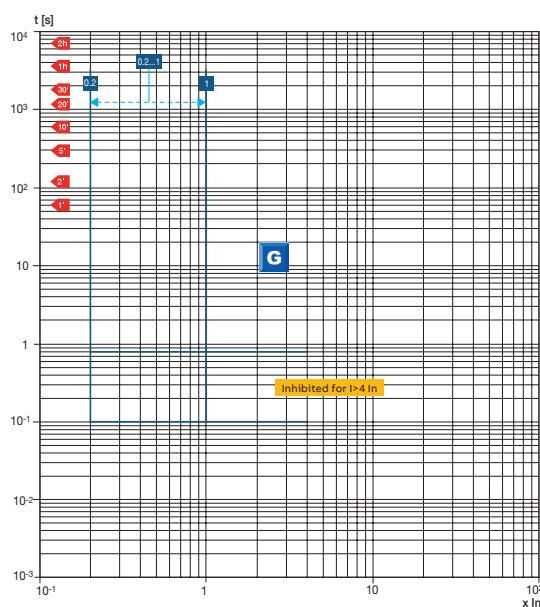

XT4 Ekip Dip LS/I L-I functions

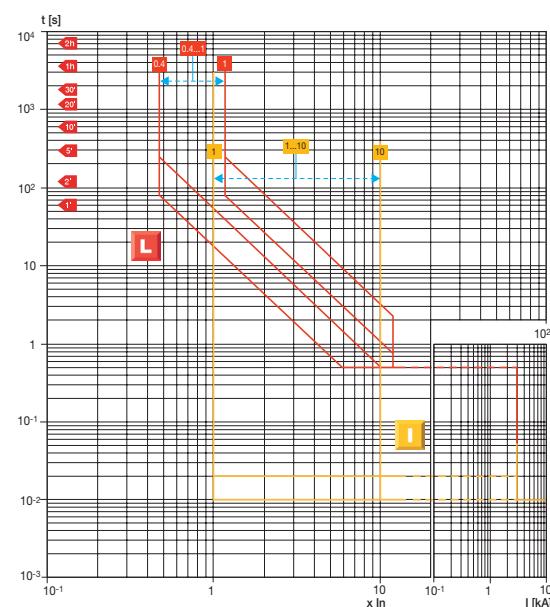


Characteristic curves

Trip curves with electronic trip unit Ekip Dip


XT4 Ekip Dip LS/I

L-S functions

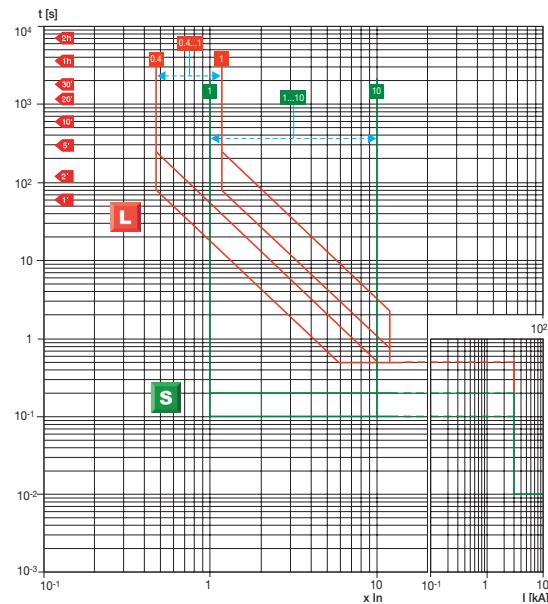


XT4 Ekip Dip LIG

G function

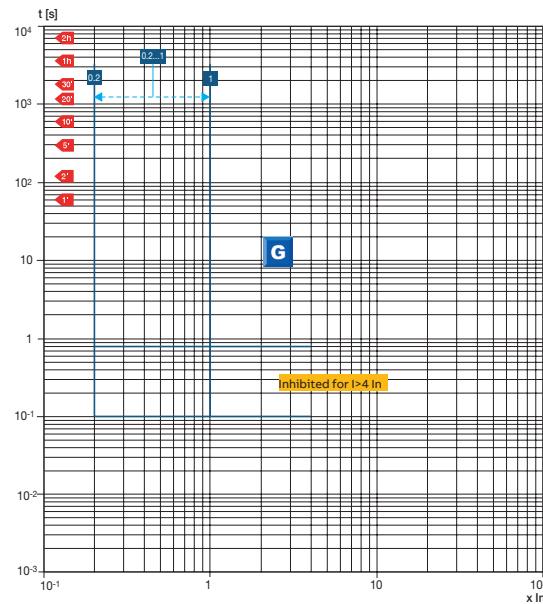


XT4 Ekip Dip LIG

L-I functions

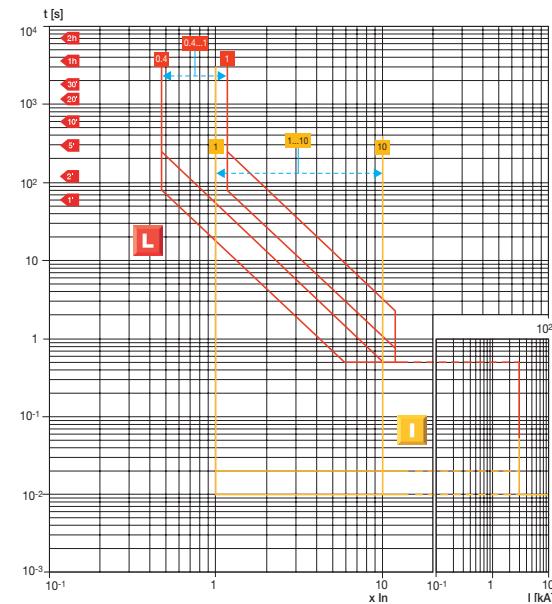


XT4 Ekip Dip LSI, Ekip C Dip LSI and


Ekip Dip Measuring LSI - L-S-I functions

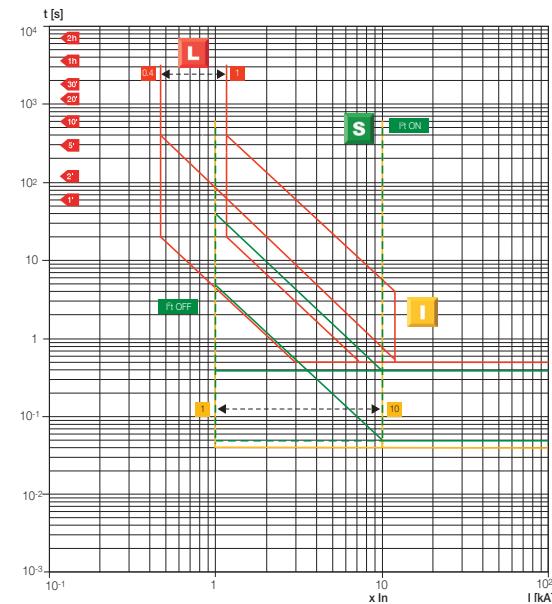


XT4 Ekip Dip LSIG, Ekip C Dip LSIG and Ekip Dip Measuring LSIG - L-S-I functions

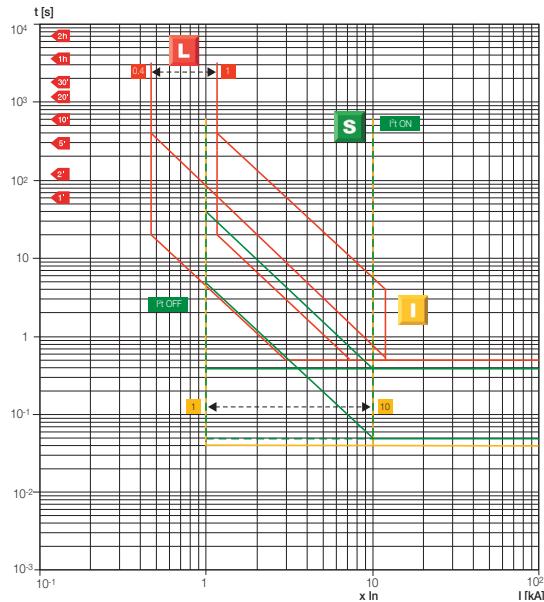


XT4 Ekip Dip LSIG, Ekip C Dip LSIG and Ekip Dip Measuring LSIG - G function

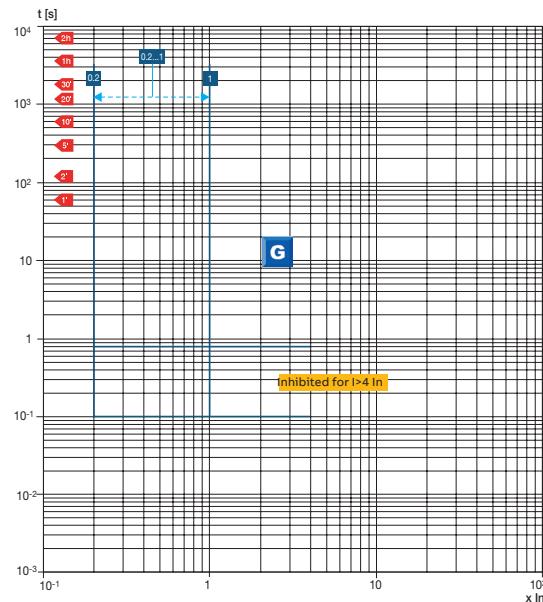

XT5 Ekip Dip LS/I L-S-I functions

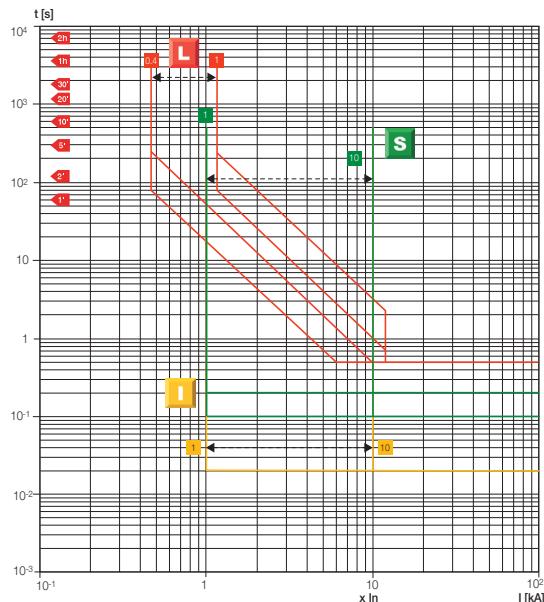

XT6 Ekip Dip LS/I L-S-I functions

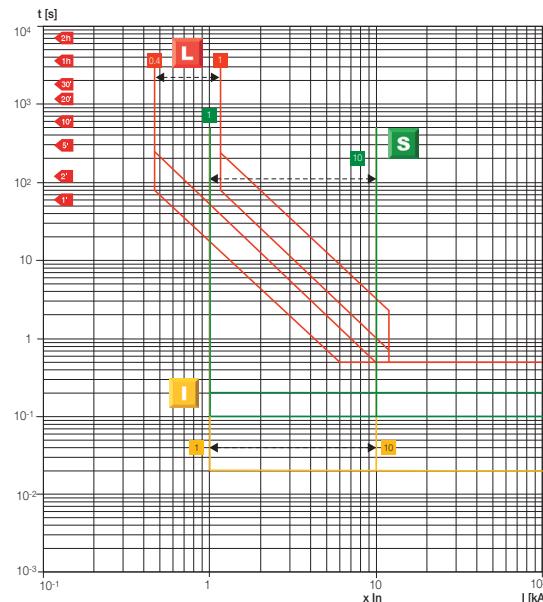


Characteristic curves

Trip curves with electronic trip unit Ekip Dip


XT5 400 Ekip Dip LIG

L-I functions

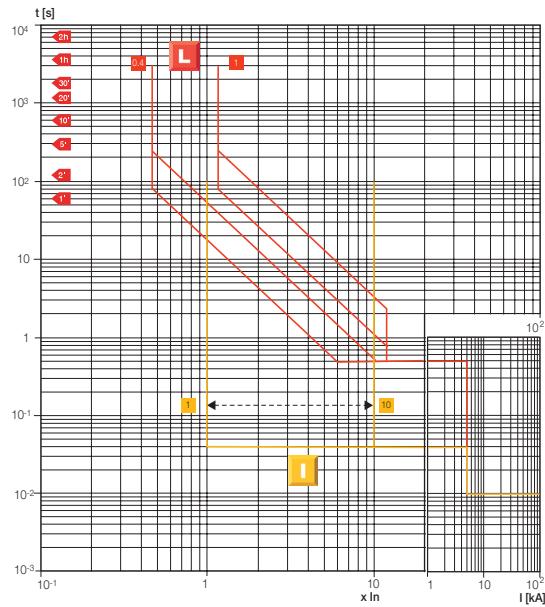


XT5 630 Ekip Dip LIG

L-I functions

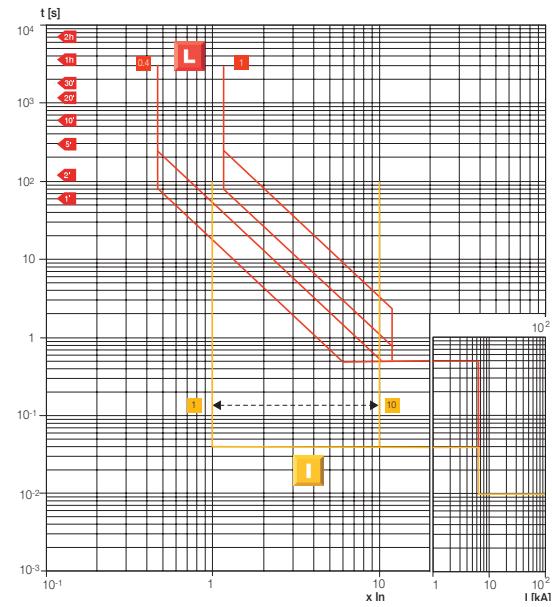


XT6 Ekip Dip LIG

L-I functions

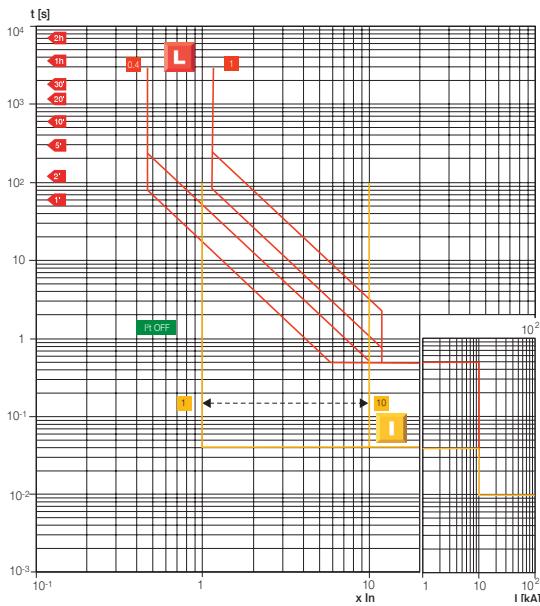


XT5-XT6 Ekip Dip LIG


G functions

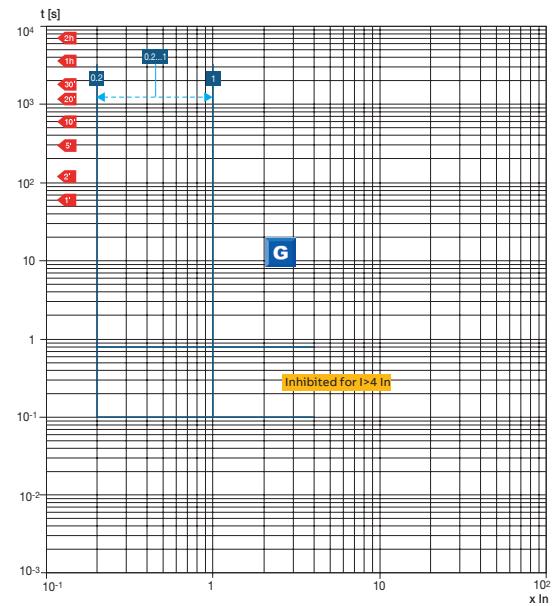


XT5 Ekip Dip LSI L-S-I functions

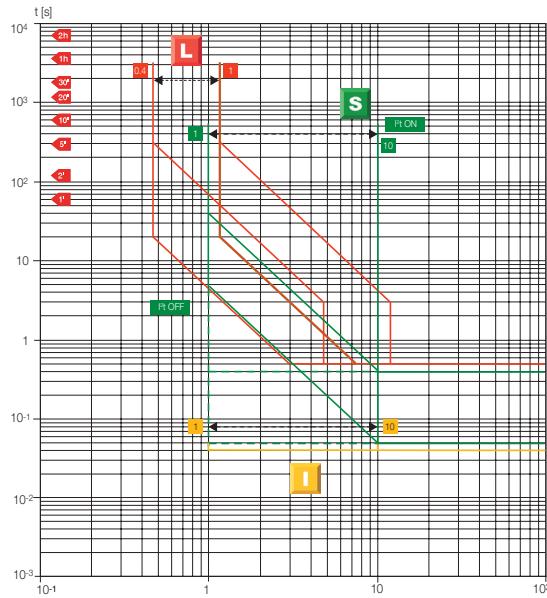


XT6 Ekip Dip LSI L-S-I functions

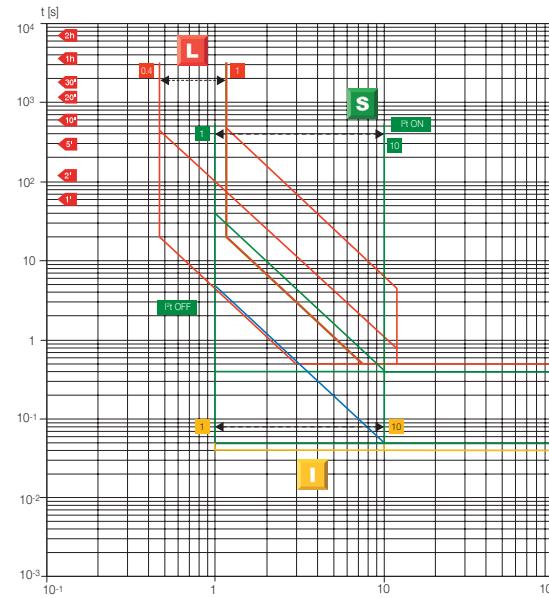

XT5-XT6 Ekip Dip LSIG G function

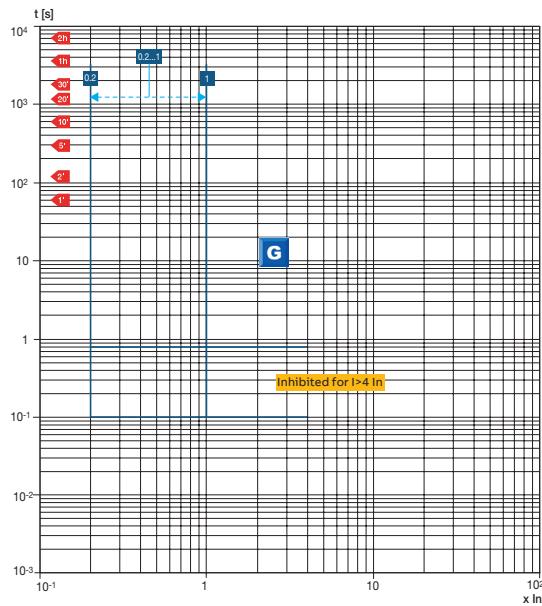

XT7 - XT7 M Ekip Dip LS/I L-I functions

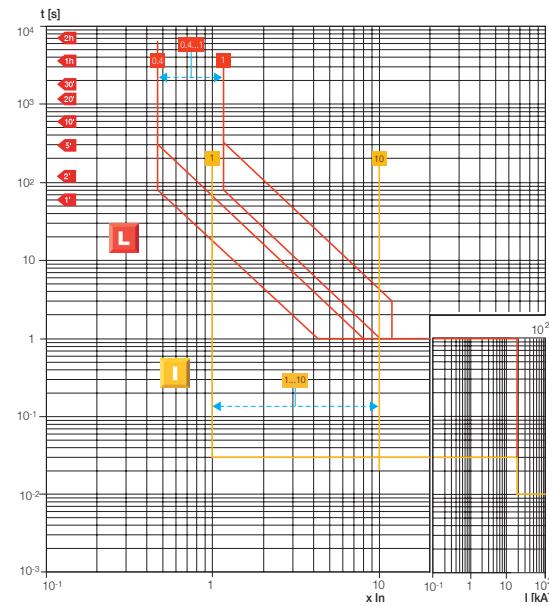


Characteristic curves

Trip curves with electronic trip unit Ekip Dip


XT7 - XT7 M Ekip Dip LS/I

L-S functions

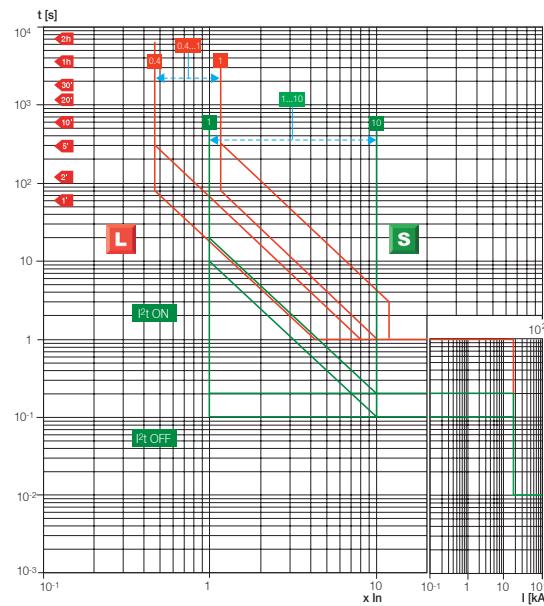


XT7 - XT7 M Ekip Dip LIG

L-I functions

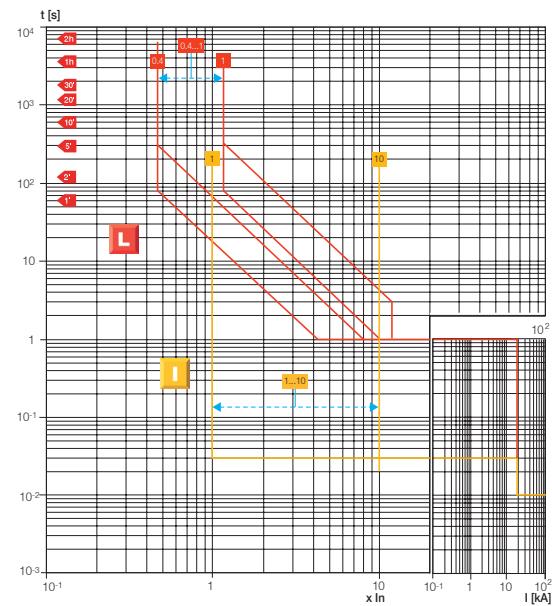


XT7 - XT7 M Ekip Dip LIG





G function

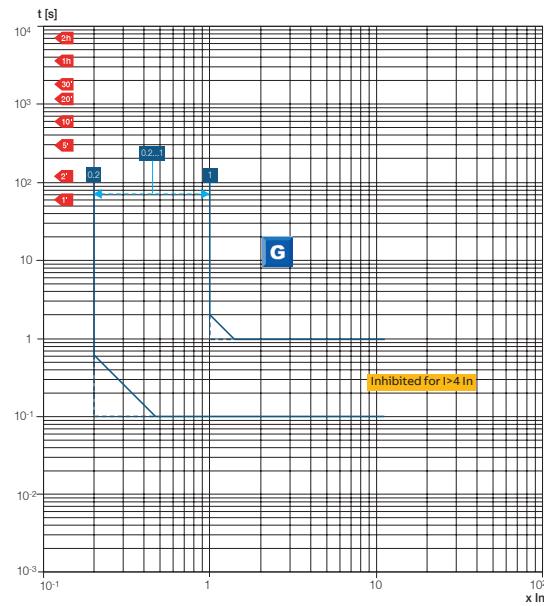

XT7 - XT7 M Ekip Dip LSI

L-S-I functions

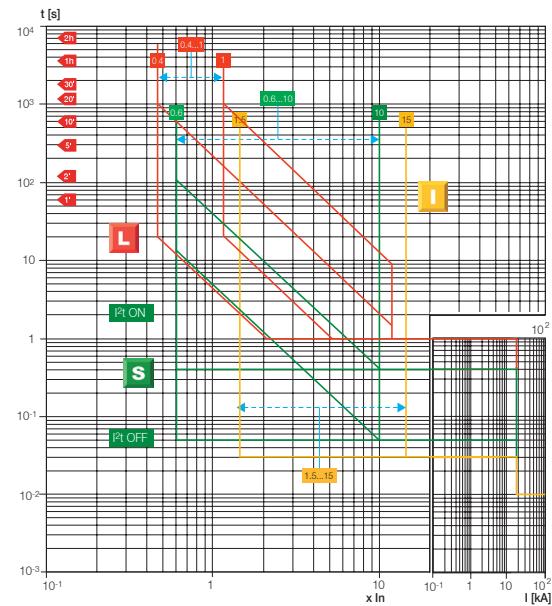

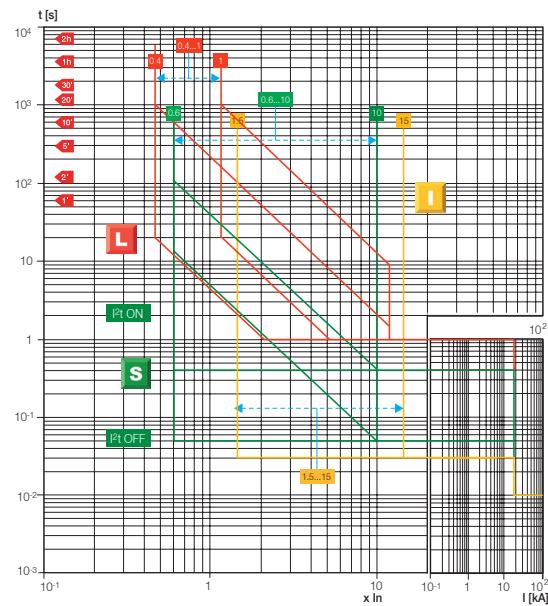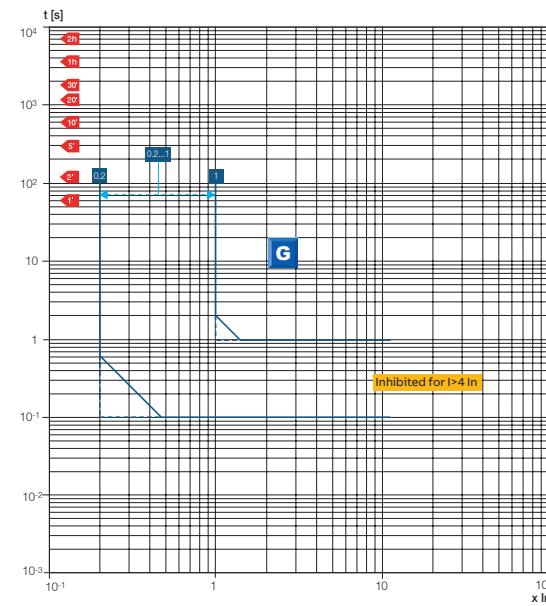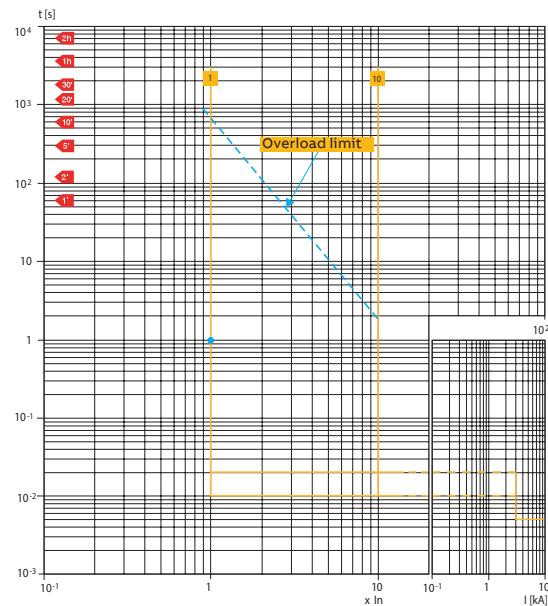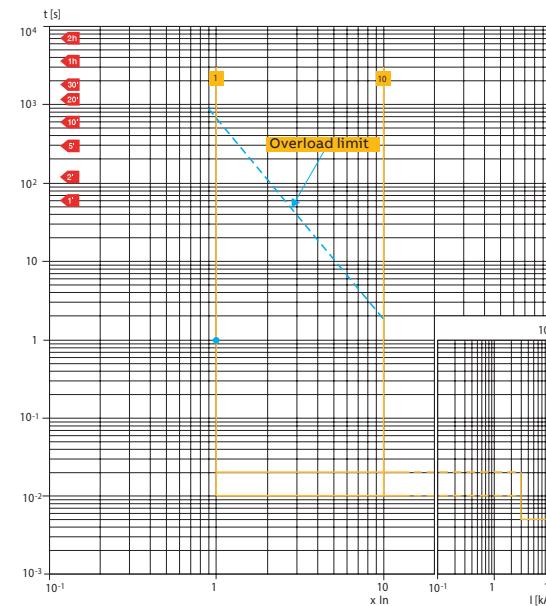
XT7 - XT7 M Ekip Dip LSIG**L-S-I functions****XT7 - XT7 M Ekip Dip LSIG****G function****Trip curves for motor protection****XT2 Ekip M Dip I****I function****XT4 Ekip M Dip I****I function**

Characteristic curves

Trip curves with electronic trip unit Ekip Dip


XT2 - XT4 Ekip M-LIU

L function (cold trip)

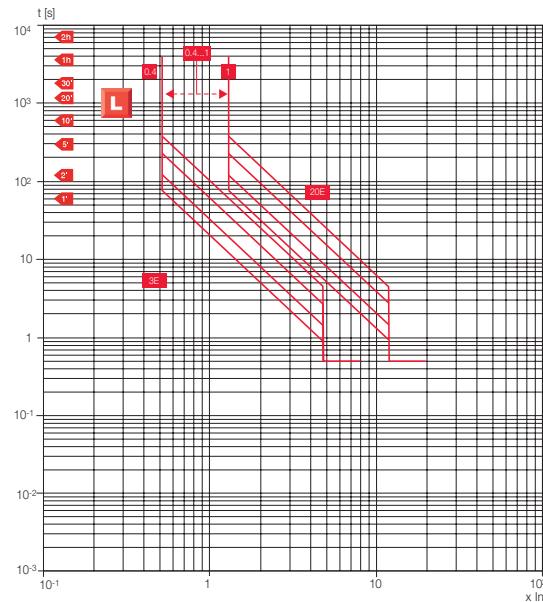


XT2 - XT4 Ekip M-LIU

(hot trip)

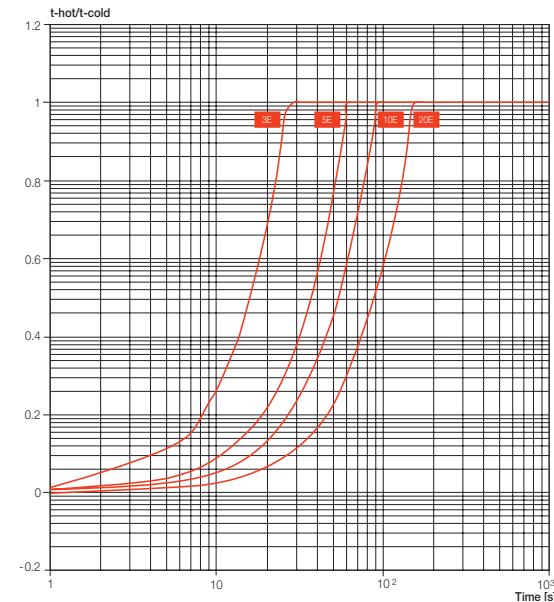


XT2 - XT4 Ekip M-LIU





I function

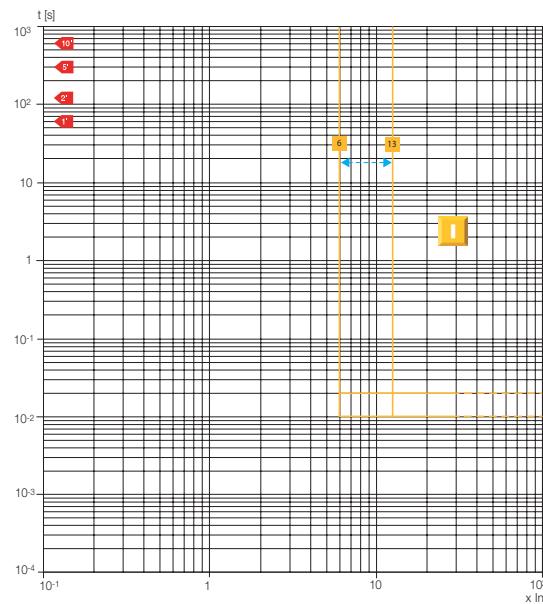

XT2 - XT4 Ekip M-LIU

U function

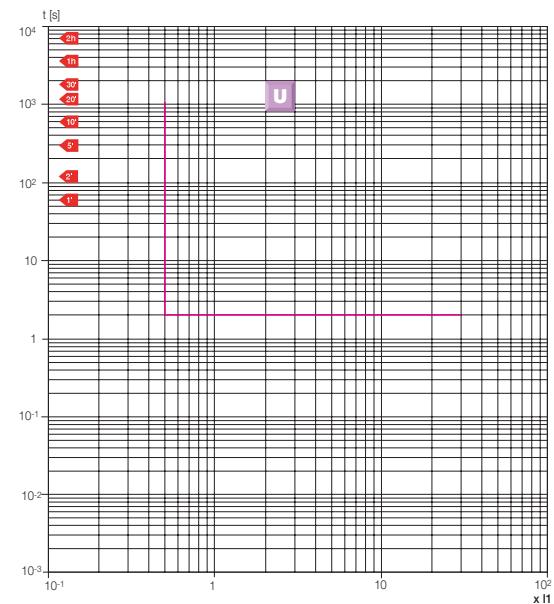

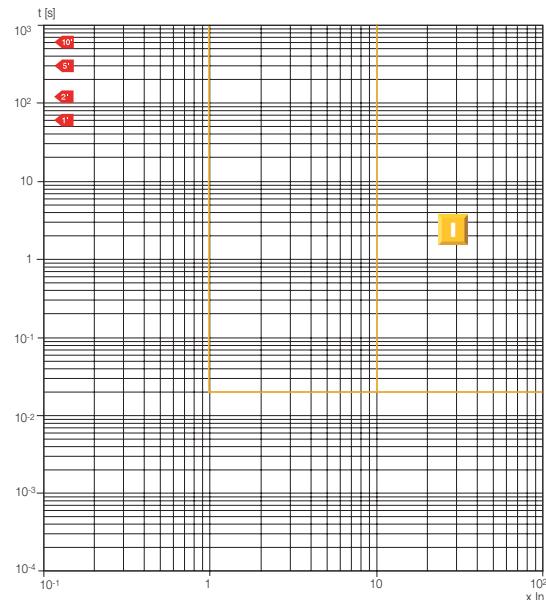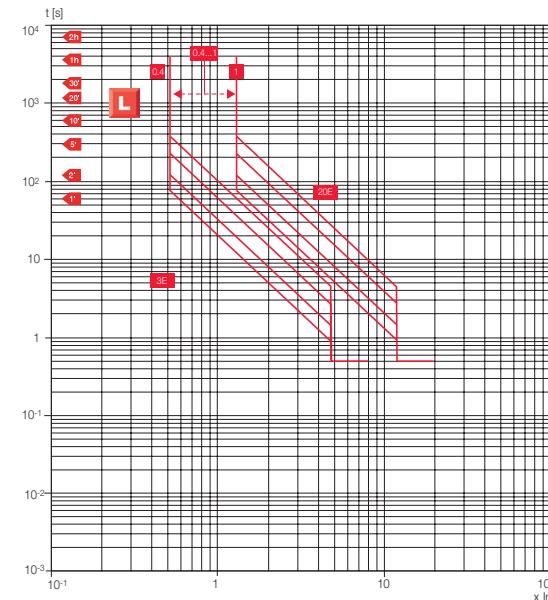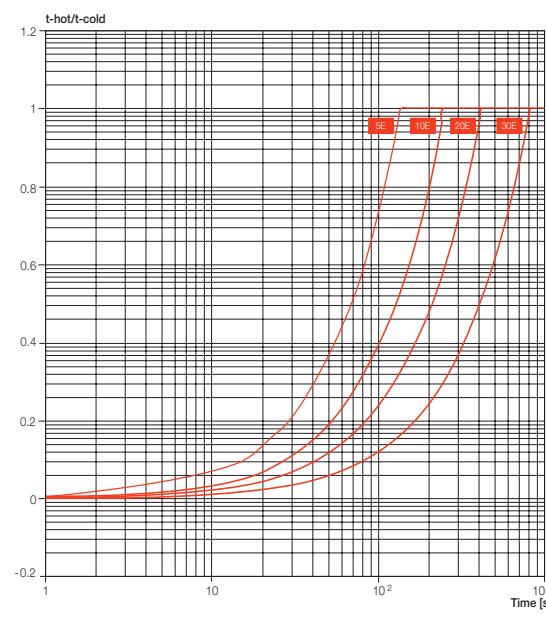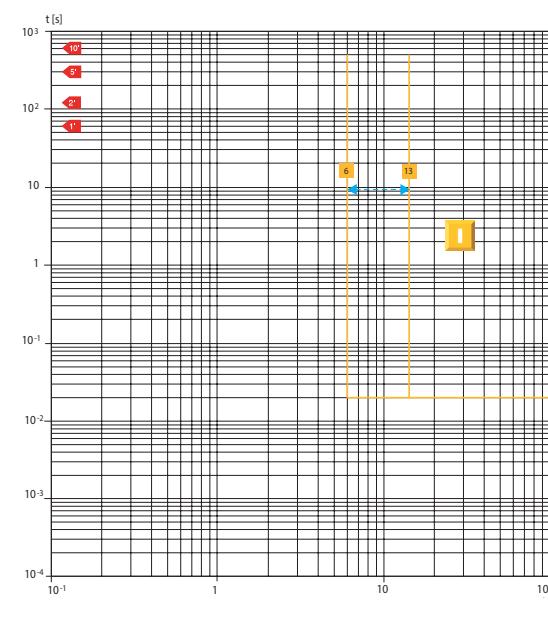
XT5-XT6 Ekip M Dip I**I function****XT5-XT6 Ekip M Dip LIU****L function (cold trip)****XT5-XT6 Ekip M Dip LIU****(hot trip)****XT5-XT6 Ekip M Dip LIU****I function**

Characteristic curves

Trip curves with electronic trip unit Ekip Dip


XT5-XT6 Ekip M Dip LIU

U function

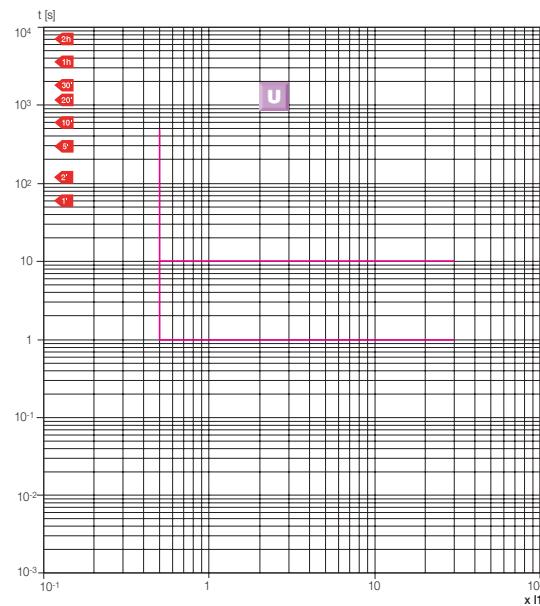


XT7 - XT7 M Ekip M Dip I

I function

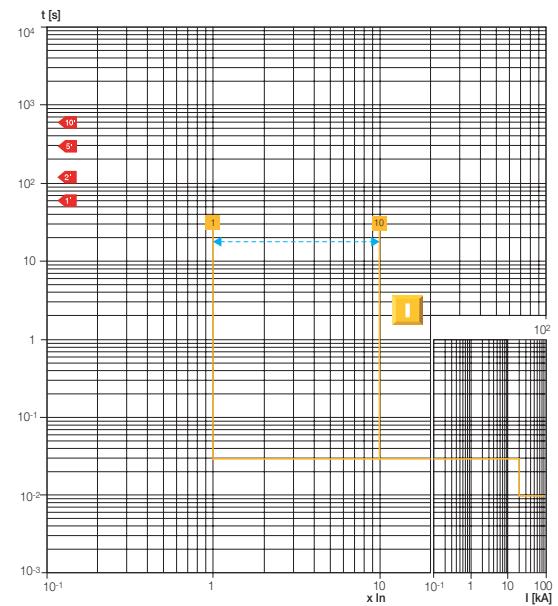


Trip curves for generator protection


XT2 Ekip G-LS/I L-I functions

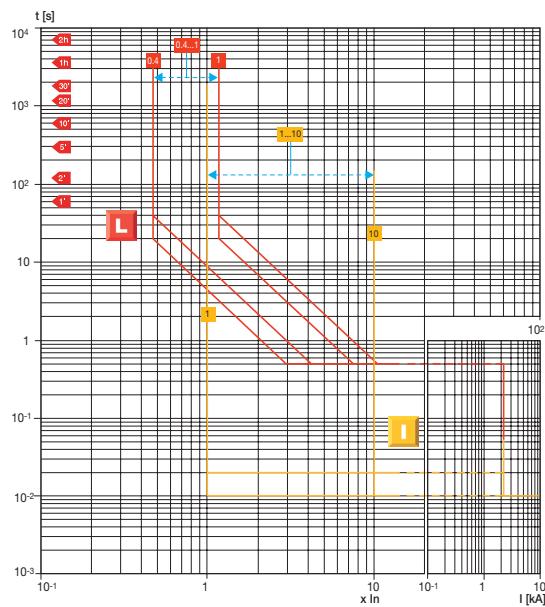


XT2 Ekip G-LS/I L-S functions

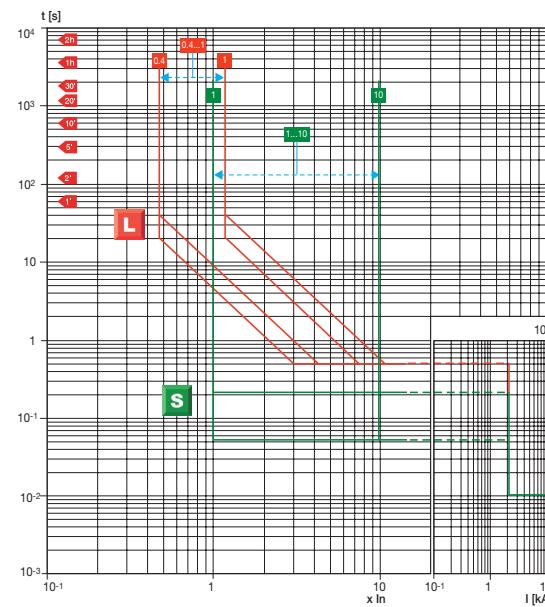

XT4 Ekip G-LS/I L-I functions

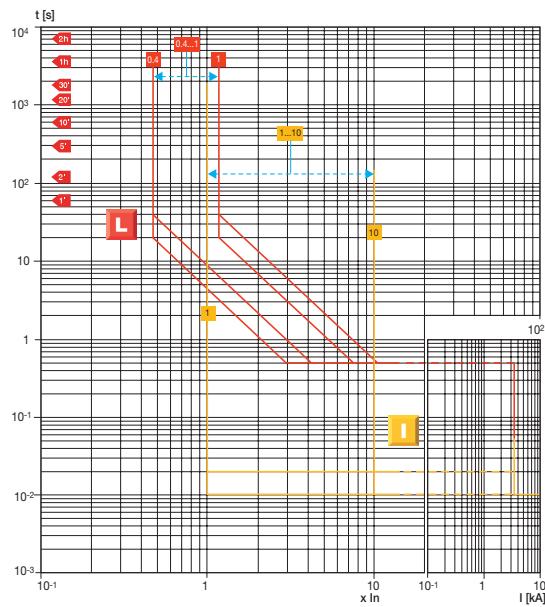

XT4 Ekip G-LS/I L-S functions

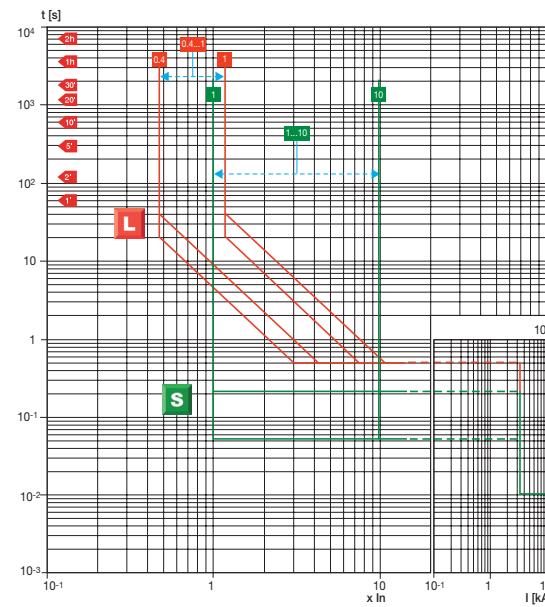


Characteristic curves

Trip curves with electronic trip unit Ekip Dip


XT5-XT6 Ekip G Dip LS/I

L-S-I functions

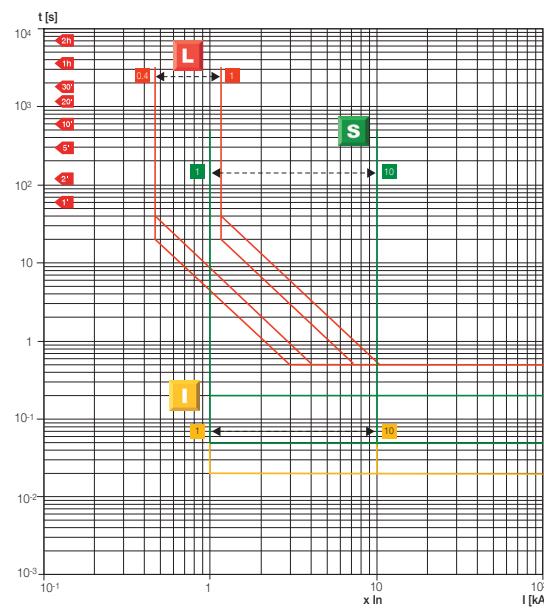


XT7 - XT7 M Ekip G Dip LS/I

L-I functions

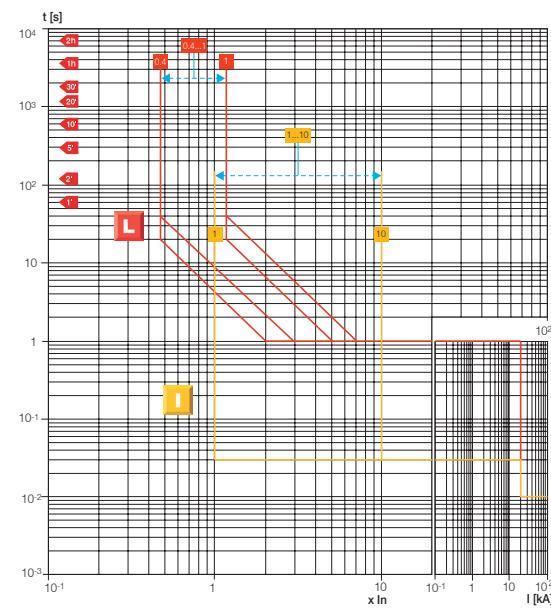

XT7 - XT7 M Ekip G Dip LS/I

L-S functions

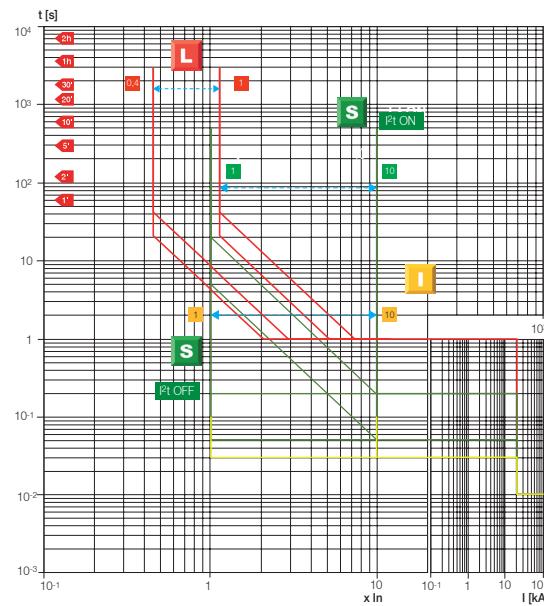


Characteristic curves

Trip curves with electronic trip unit Ekip Touch and Hi-Touch

Trip curves for distribution


XT2

Ekip Touch LSI • Ekip Touch LSIG • Ekip Touch Measuring LSI •
Ekip Touch Measuring LSIG • Ekip Hi-Touch LSI -
Ekip Hi-Touch LSIG • L-S-I function

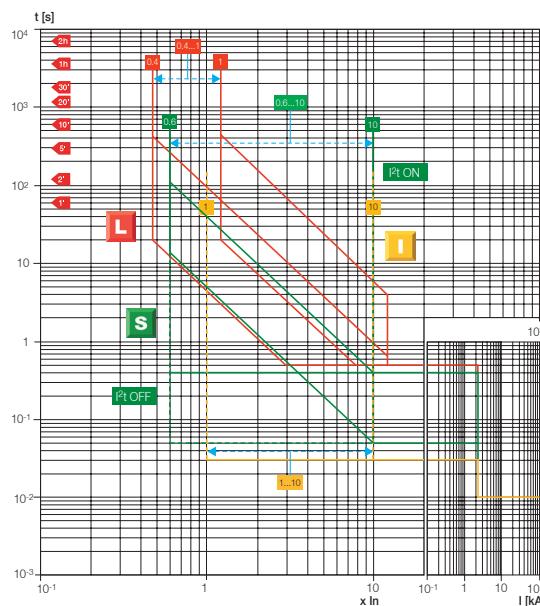


XT2

Ekip Touch LSIG • Ekip Touch Measuring LSIG •
Ekip Hi-Touch LSIG • G function

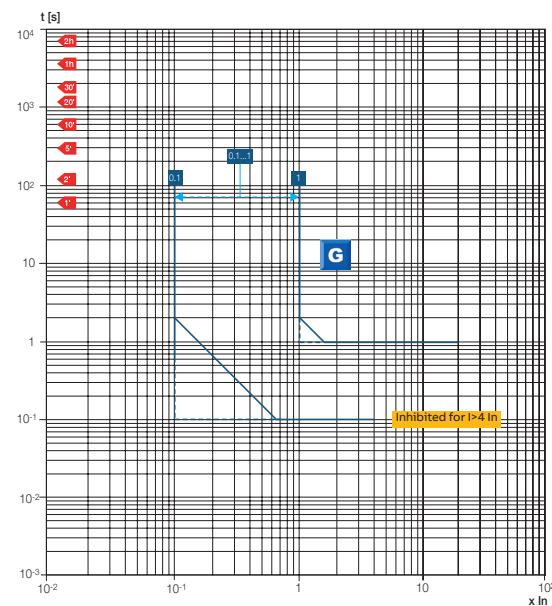


XT4

Ekip Touch LSI • Ekip Touch LSIG • Ekip Touch Measuring LSI •
Ekip Touch Measuring LSIG • Ekip Hi-Touch LSI • Ekip Hi-Touch
LSIG • L-S-I function

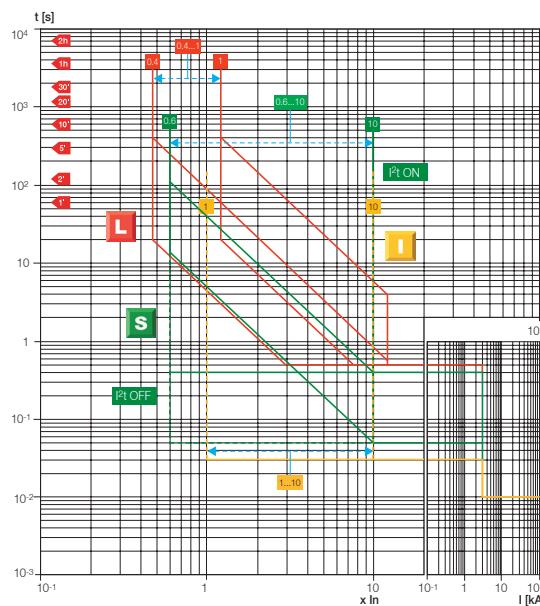

XT4

Ekip Touch LSIG • Ekip Touch Measuring LSIG •
Ekip Hi-Touch LSIG • G function

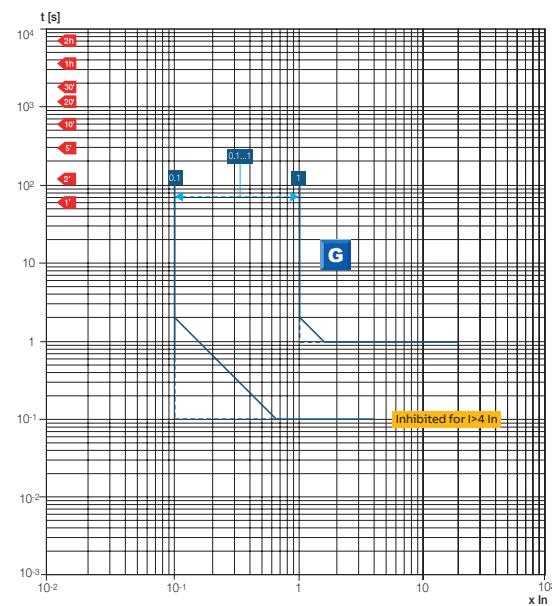


Characteristic curves

Trip curves with electronic trip unit Ekip Touch and Hi-Touch


XT5

Ekip Touch LSI • Ekip Touch LSIG • Ekip Touch Measuring LSI • Ekip Touch Measuring LSIG • Ekip Hi-Touch LSI • Ekip Hi-Touch LSIG • L – S – I function

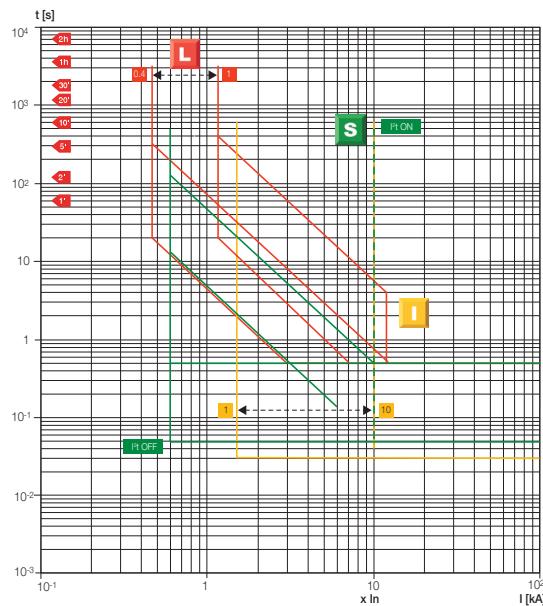


XT5

Ekip Touch LSIG • Ekip Touch Measuring LSIG • Ekip Hi-Touch LSIG • G function

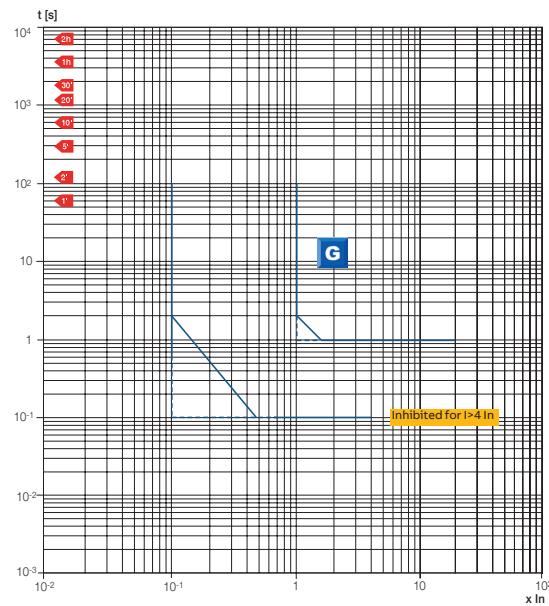


XT7 – XT7 M

Ekip Touch LSI • Ekip Touch LSIG • Ekip Touch Measuring LSI • Ekip Touch Measuring LSIG • Ekip Hi-Touch LSI • Ekip Hi-Touch LSIG • L – S – I function

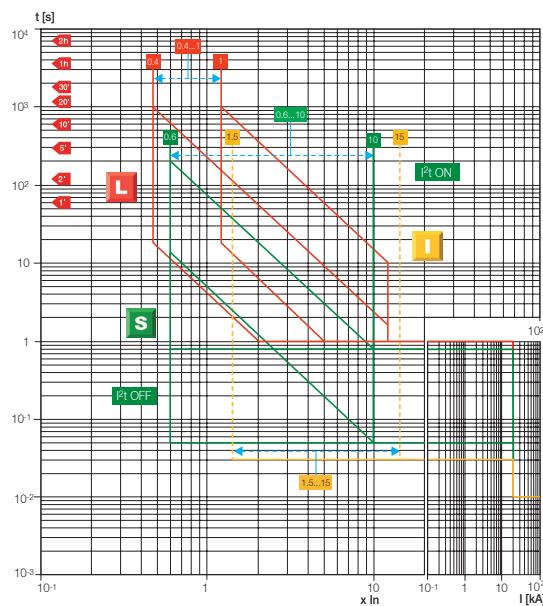

XT7 – XT7 M


Ekip Touch LSIG • Ekip Touch Measuring LSIG • Ekip Hi-Touch LSIG • G function

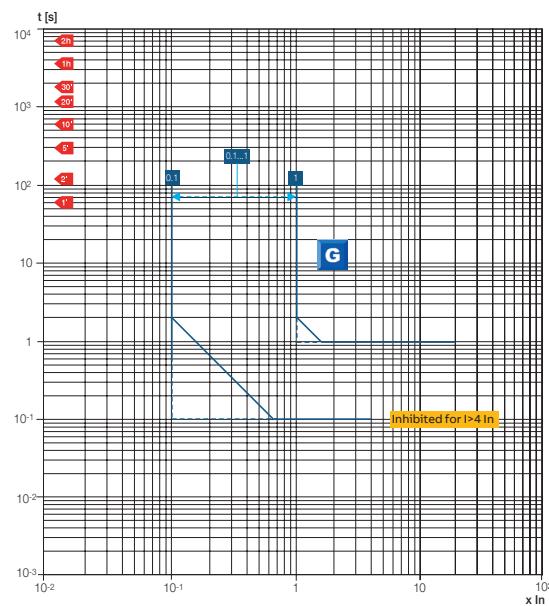

Trip curves for distribution


XT2

Ekip Touch LSI • Ekip Touch LSIG • Ekip Touch Measuring LSI • Ekip Touch Measuring LSIG • Ekip Hi-Touch LSI • Ekip Hi-Touch LSIG • 2I function

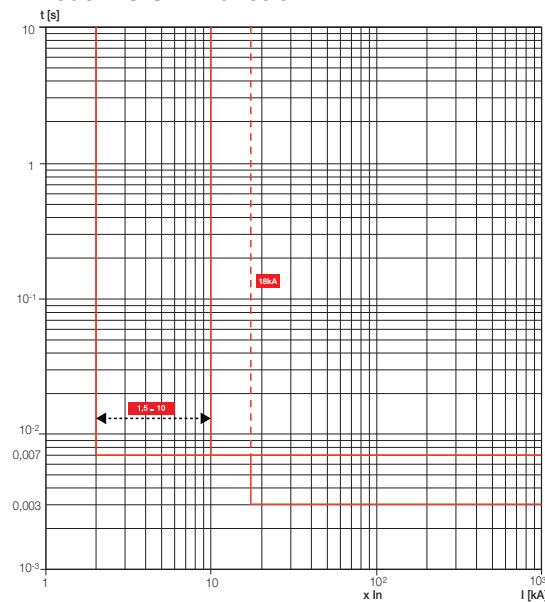


XT4

Ekip Touch LSI • Ekip Touch LSIG • Ekip Touch Measuring LSI • Ekip Touch Measuring LSIG • Ekip Hi-Touch LSI • Ekip Hi-Touch LSIG • 2I function

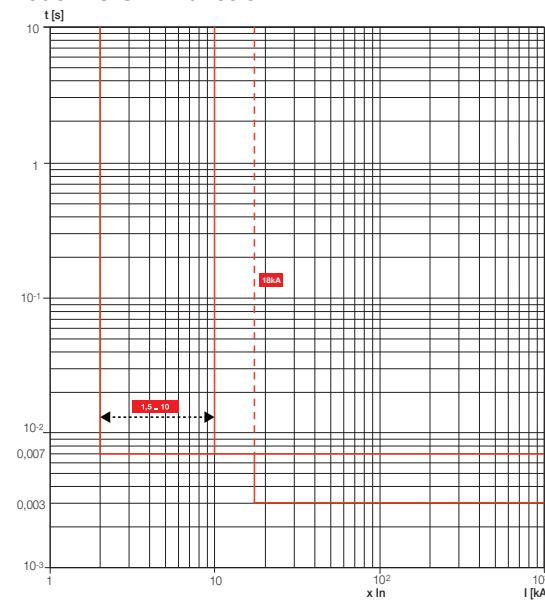


XT5

Ekip Touch LSI • Ekip Touch LSIG • Ekip Touch Measuring LSI • Ekip Touch Measuring LSIG • Ekip Hi-Touch LSI • Ekip Hi-Touch LSIG • 2I function

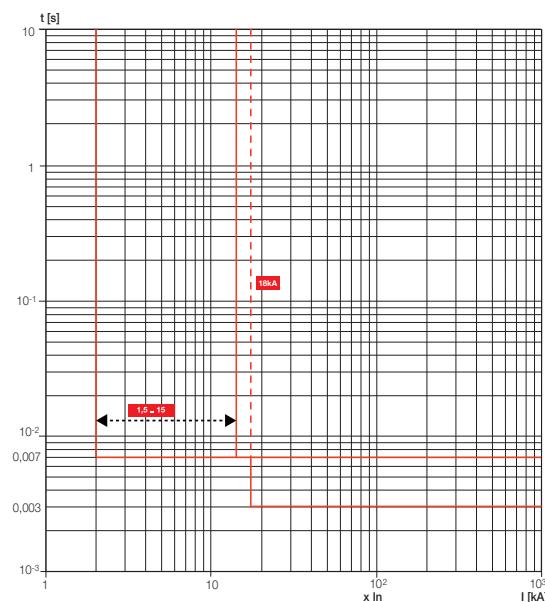

XT7 – XT7 M

Ekip Touch LSI • Ekip Touch LSIG • Ekip Touch Measuring LSI • Ekip Touch Measuring LSIG • Ekip Hi-Touch LSI • Ekip Hi-Touch LSIG • 2I function

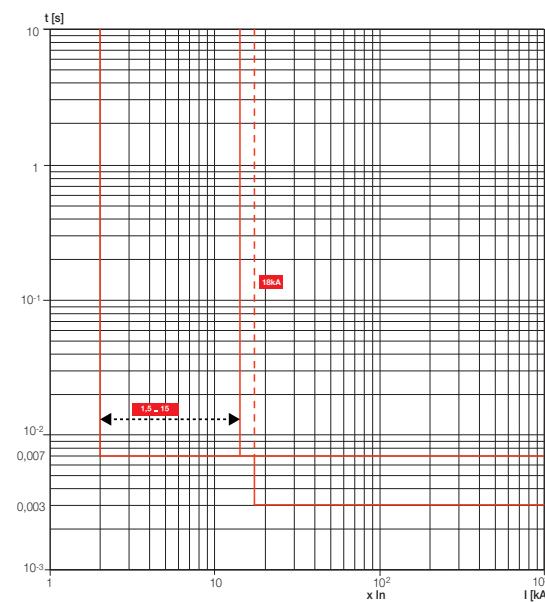


Characteristic curves


Trip curves with electronic trip unit Ekip Touch and Hi-Touch

Trip curves for motor protection


**XT2 Ekip M Touch LRIU
L function (cold trip)**

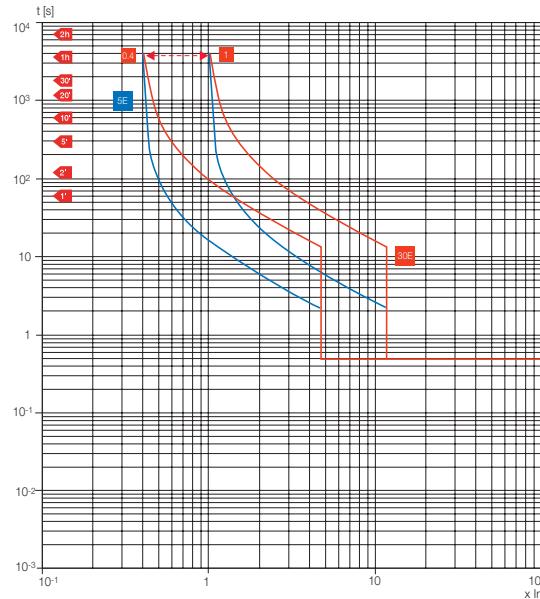


**XT2 Ekip M Touch LRIU
(hot trip)**




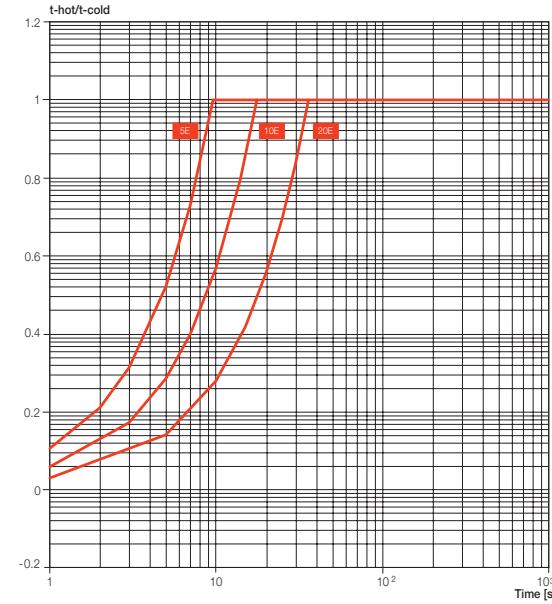


**XT2 Ekip M Touch LRIU
R function - JAM**

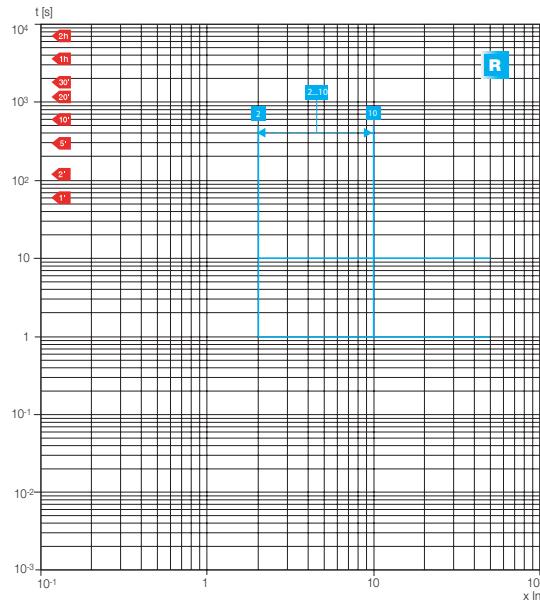

**XT2 Ekip M Touch LRIU
R function - STALL**

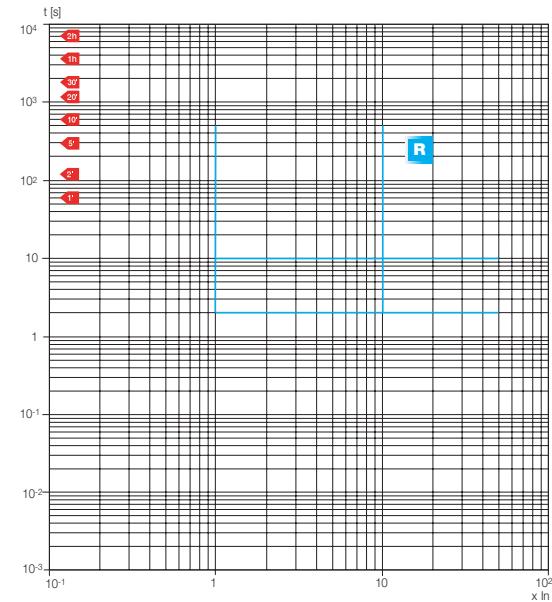

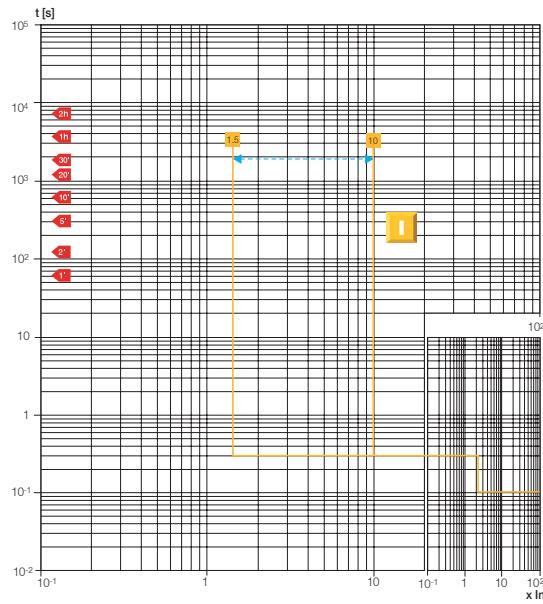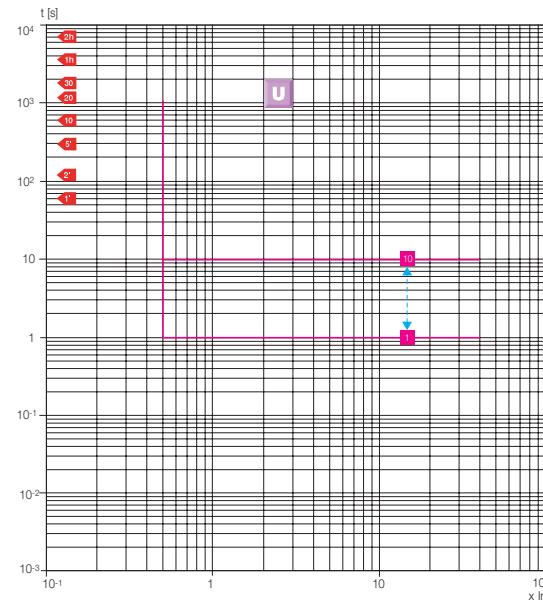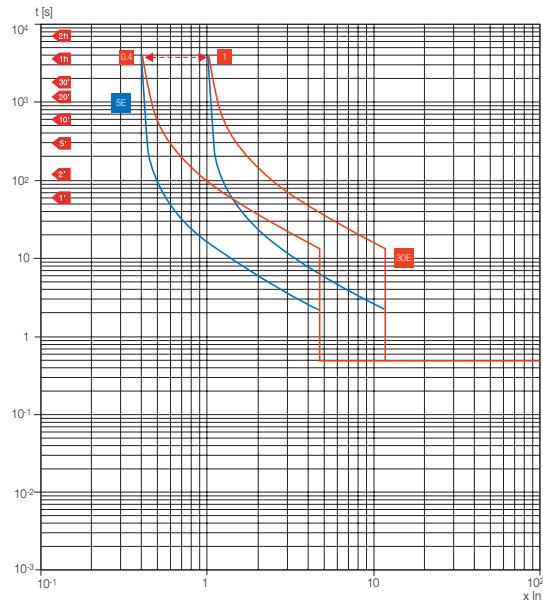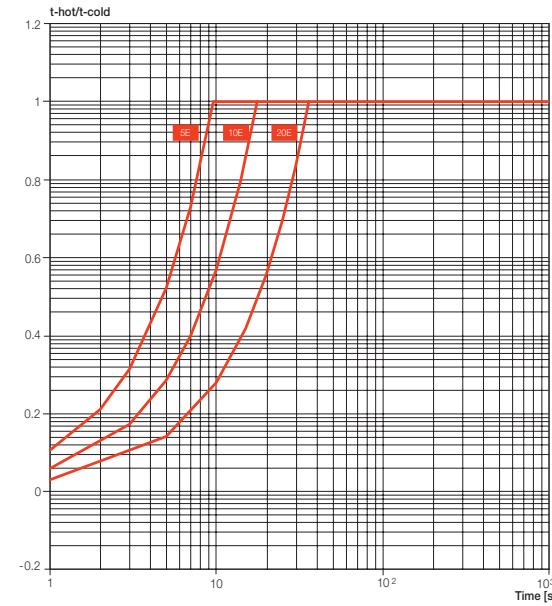
XT2 Ekip M Touch LRIU**I function****XT2 Ekip M Touch LRIU****U function****XT4 Ekip M Touch LRIU****L function (cold trip)****XT4 Ekip M Touch LRIU****(hot trip)**

Characteristic curves

Trip curves with electronic trip unit Ekip Touch and Hi-Touch


XT4 Ekip M Touch LRIU

R function - JAM

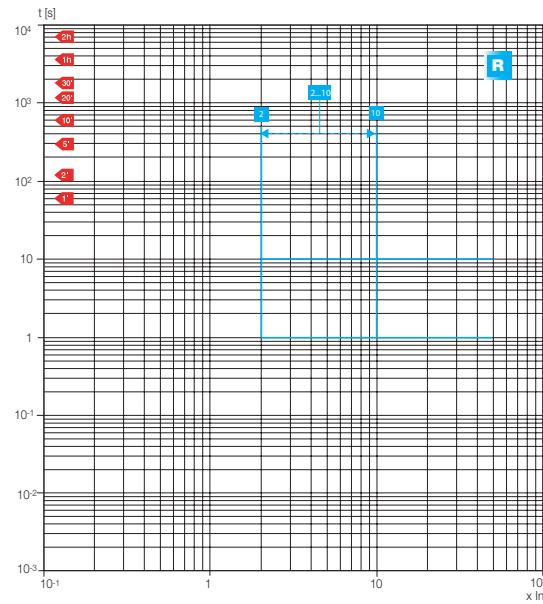


XT4 Ekip M Touch LRIU

R function - STALL

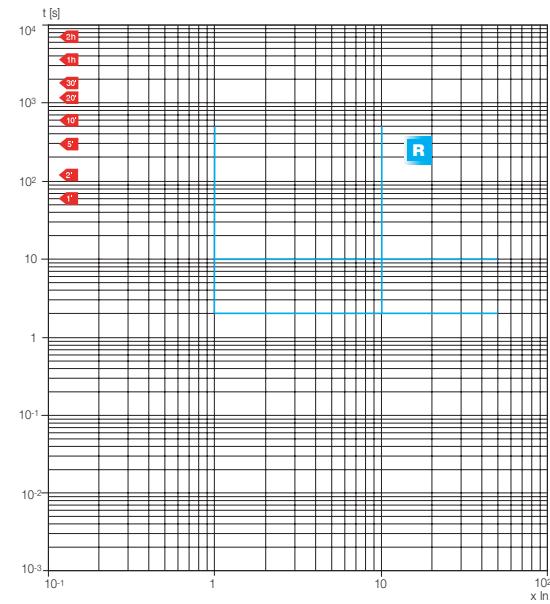


XT4 Ekip M Touch LRIU

I function

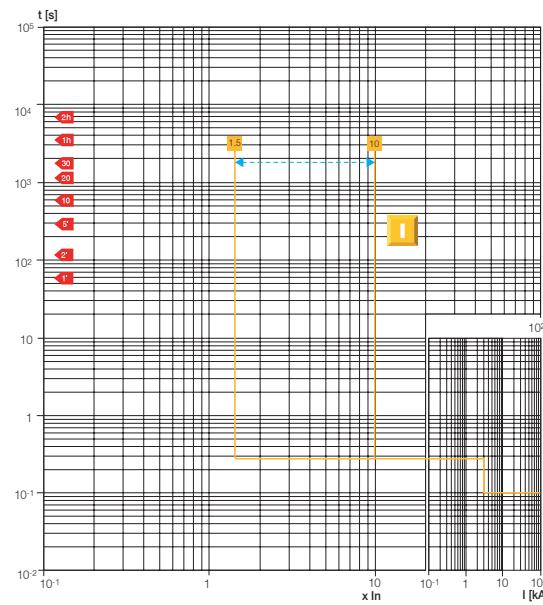


XT4 Ekip M Touch LRIU


U function

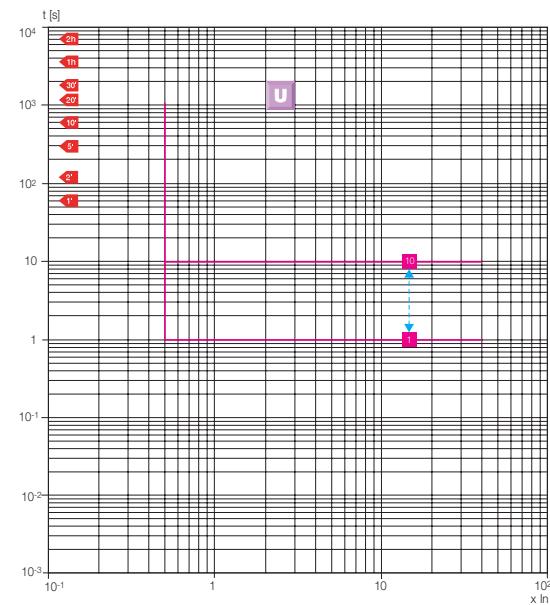


XT5 Ekip M Touch LRIU
L function (cold trip)

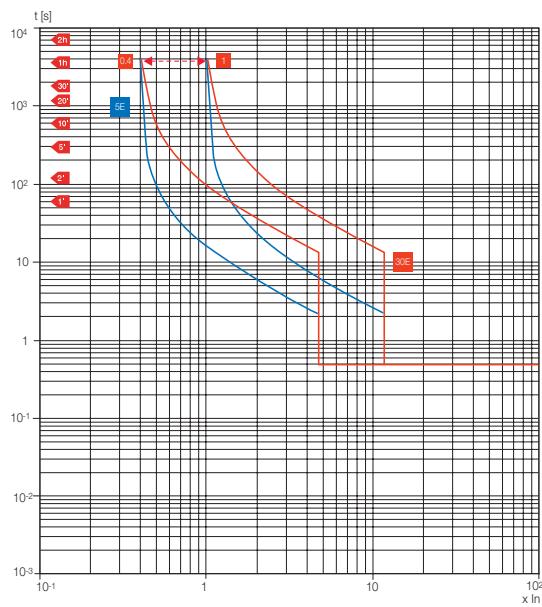


XT5 Ekip M Touch LRIU
(hot trip)

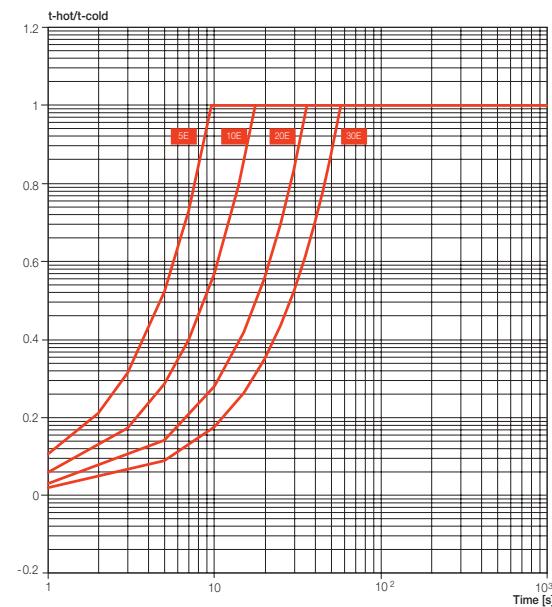

XT5 Ekip M Touch LRIU
R function - JAM

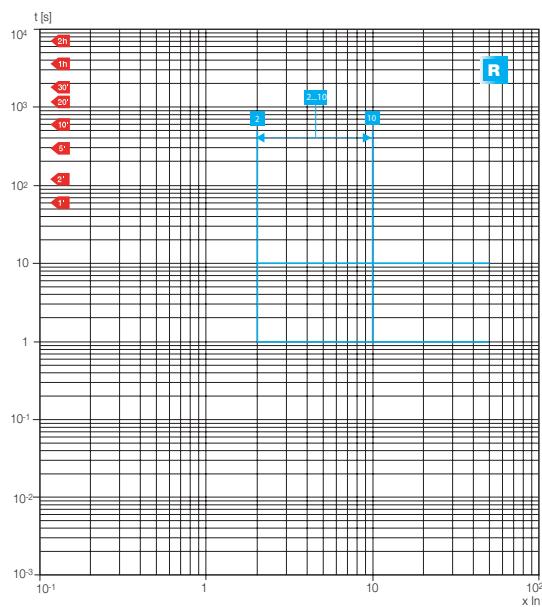

XT5 Ekip M Touch LRIU
R function - STALL

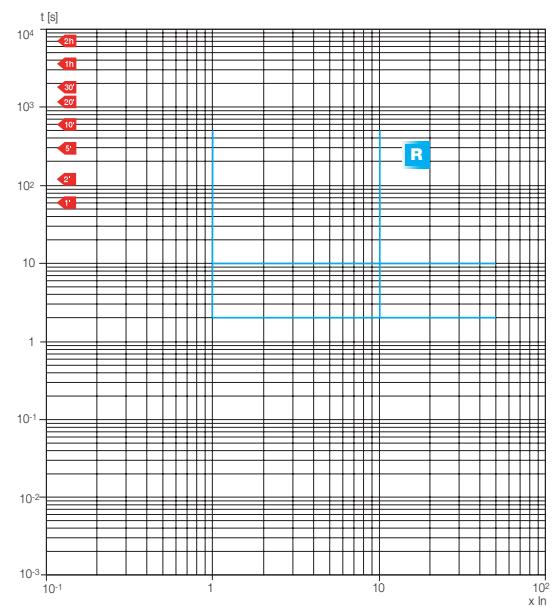


Characteristic curves

Trip curves with electronic trip unit Ekip Touch and Hi-Touch


XT5 400 Ekip M Touch LRIU

I function

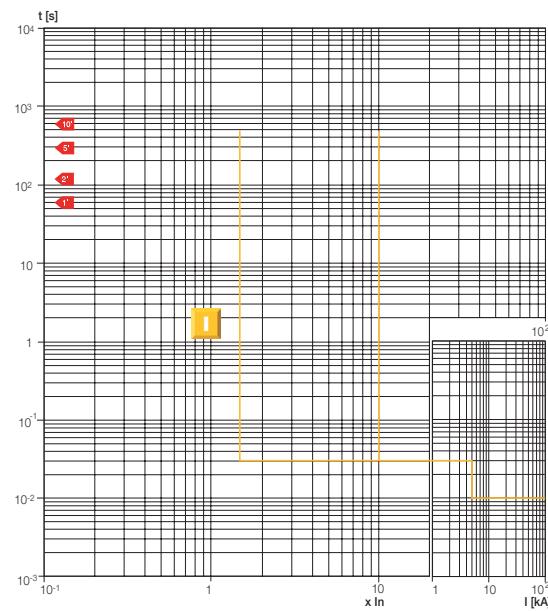


XT5 630 Ekip M Touch LRIU

I function

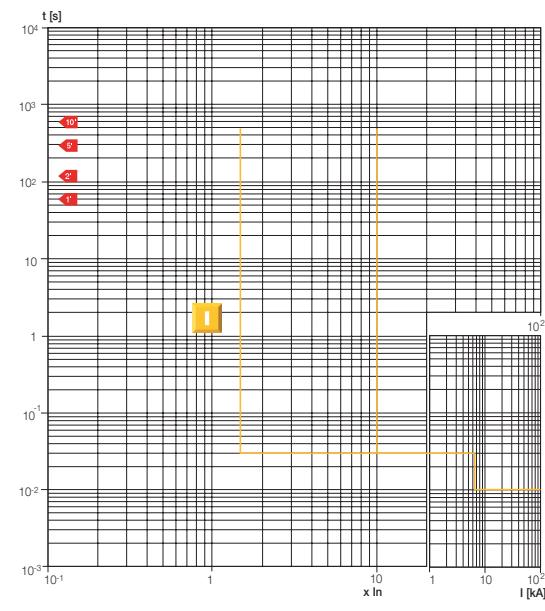


XT5 Ekip M Touch LRIU

U function

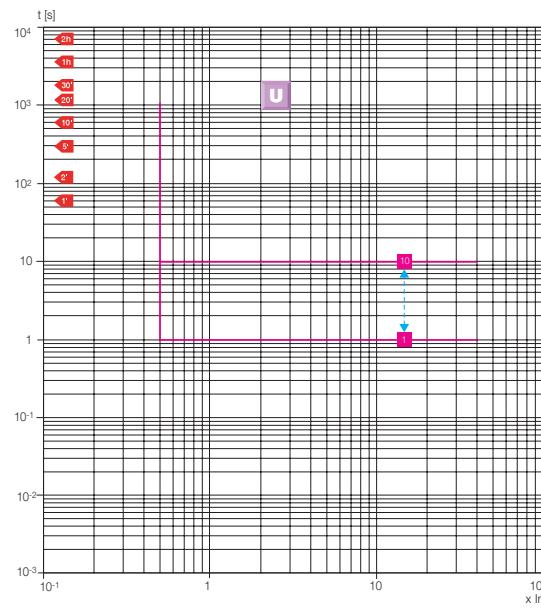


XT7 – XT7 M Ekip M Touch LRIU


L function (cold trip)

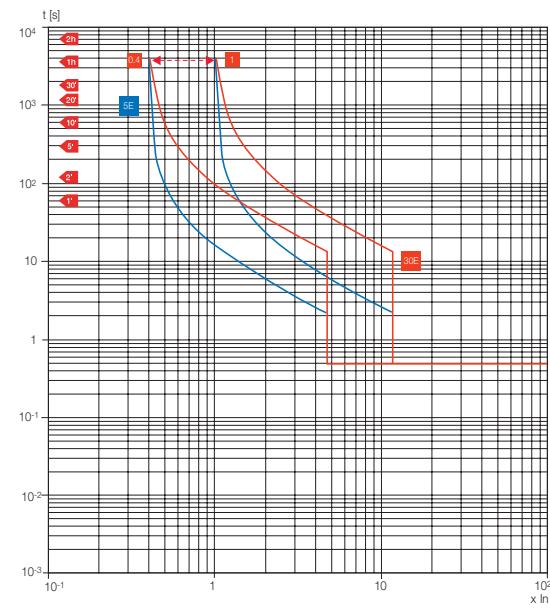


**XT7-XT7M Ekip M Touch LRIU
(hot trip)**

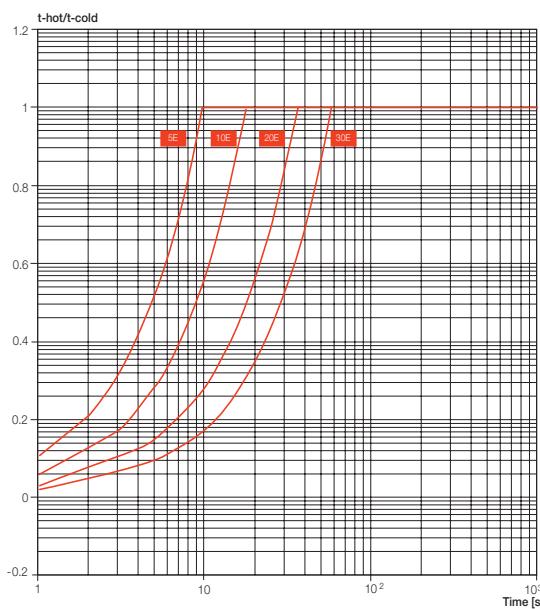


**XT7 – XT7 M Ekip M Touch LRIU
R function - JAM**

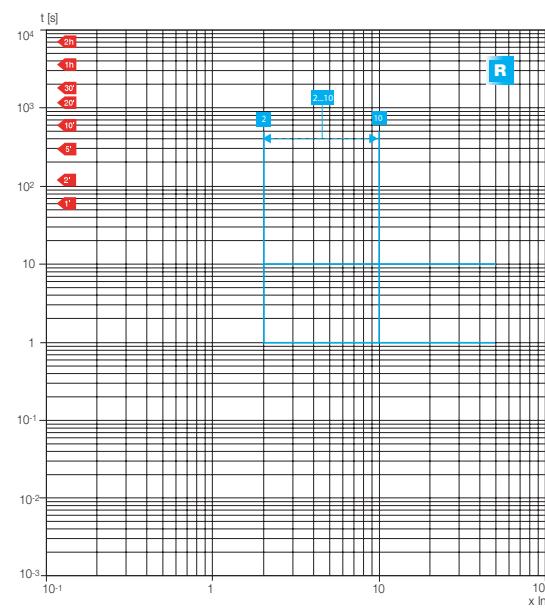

**XT7-XT7 M Ekip M Touch LRIU
R function - STALL**

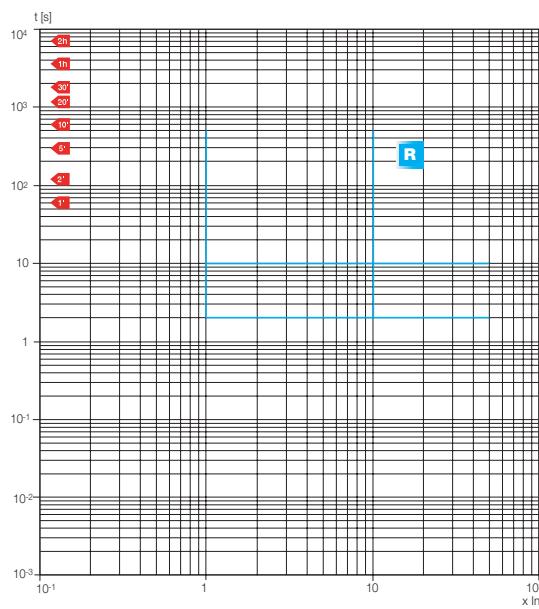

**XT7 – XT7 M Ekip M Touch LRIU
I function**

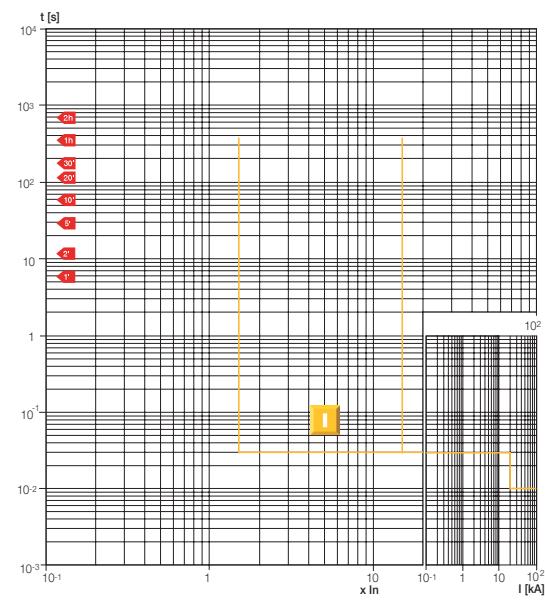


Characteristic curves

Trip curves with electronic trip unit Ekip Touch and Hi-Touch


XT7 – XT7 M Ekip M Touch LRIU

U function

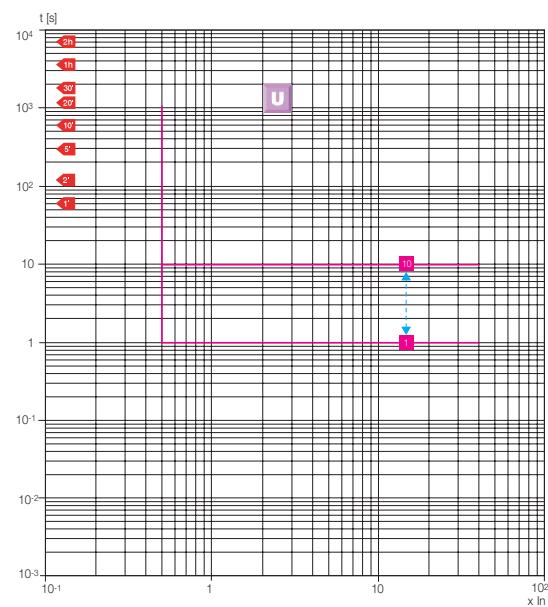


Trip curves for generator protection


XT5 Ekip G Touch LSIG • Ekip G Hi-Touch LSIG L-S-I functions

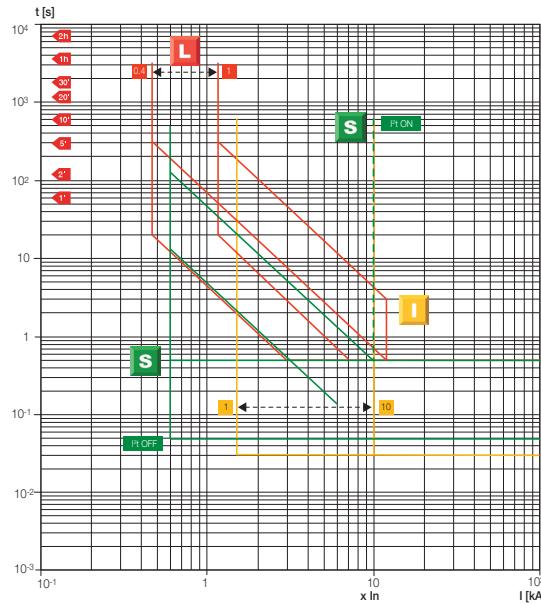


XT5 Ekip G Touch LSIG • Ekip G Hi-Touch LSIG G function

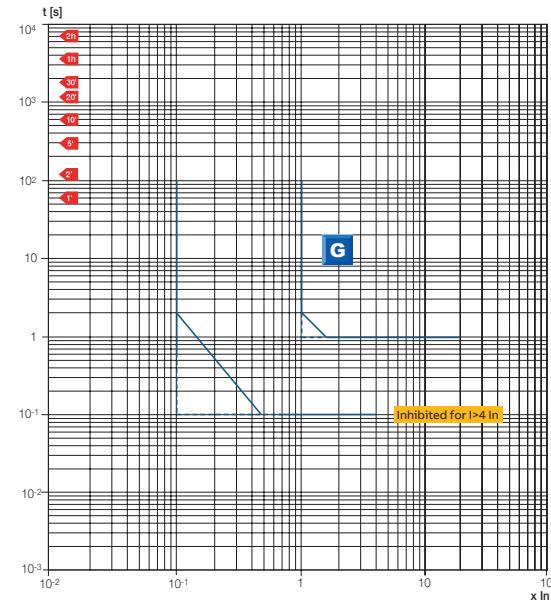

XT7 – XT7 M Ekip G Touch LSIG • Ekip G Hi-Touch LSIG L-S-I functions

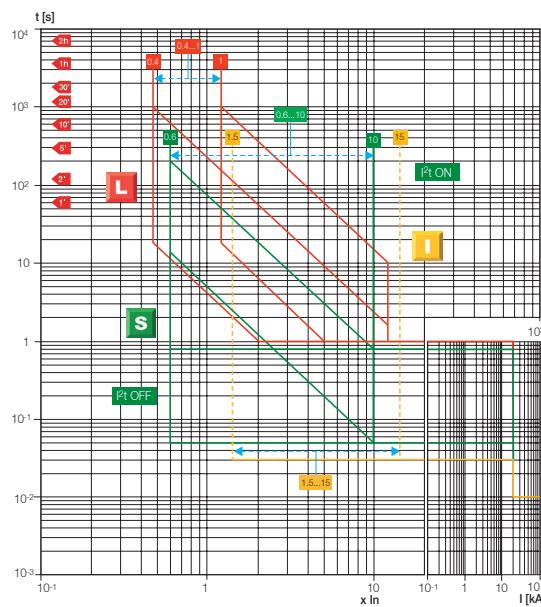

XT7 – XT7 M Ekip G Touch LSIG • Ekip G Hi-Touch LSIG G function

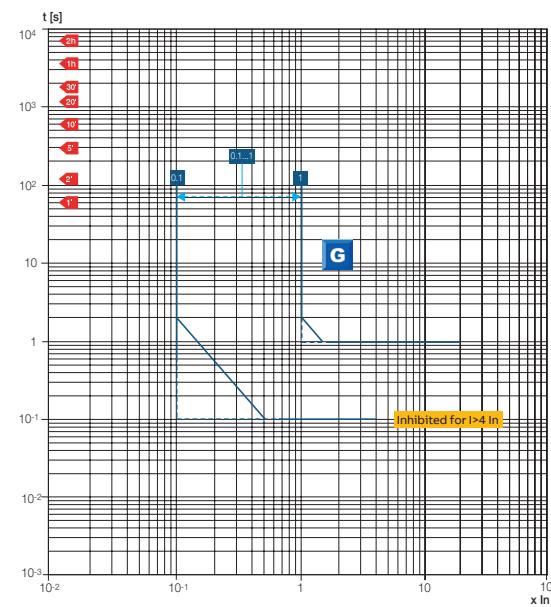


Characteristic curves


Specific let-through energy curves

240V


XT1
240V

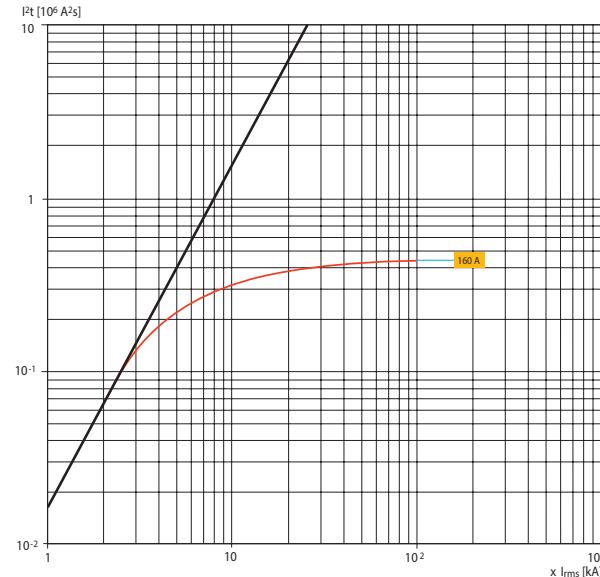


XT2
240V

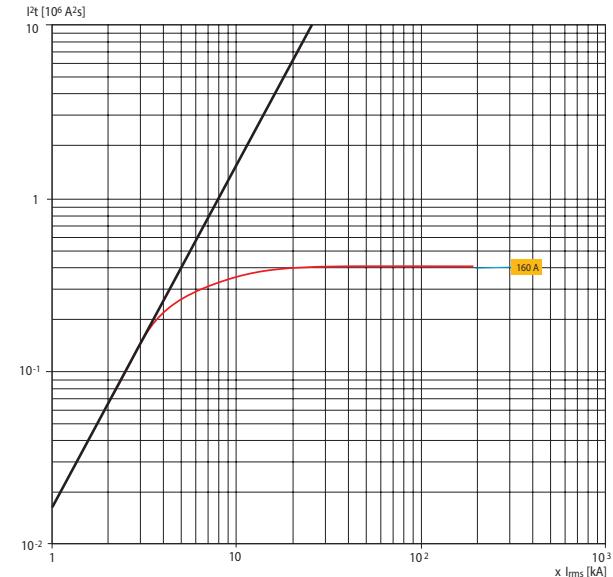




XT3
240V

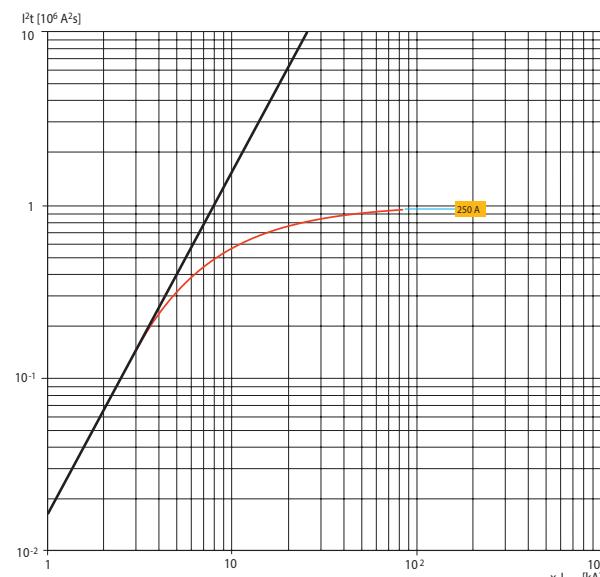

XT4
240V

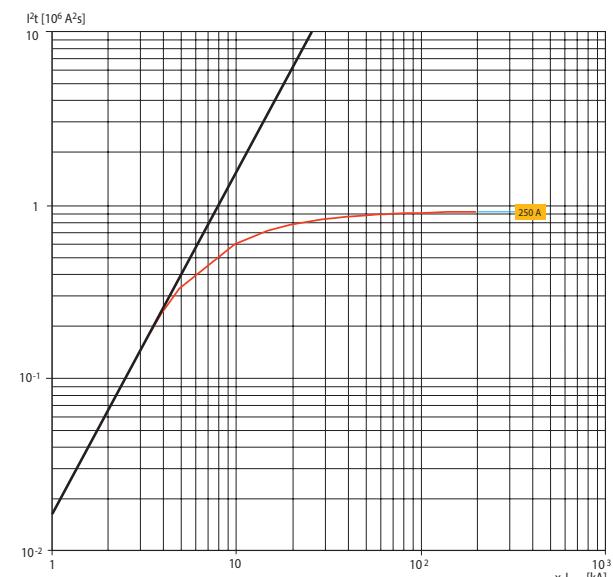

240V

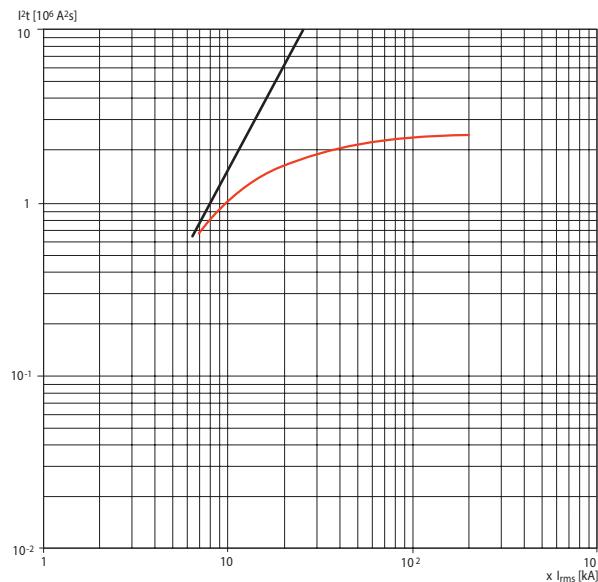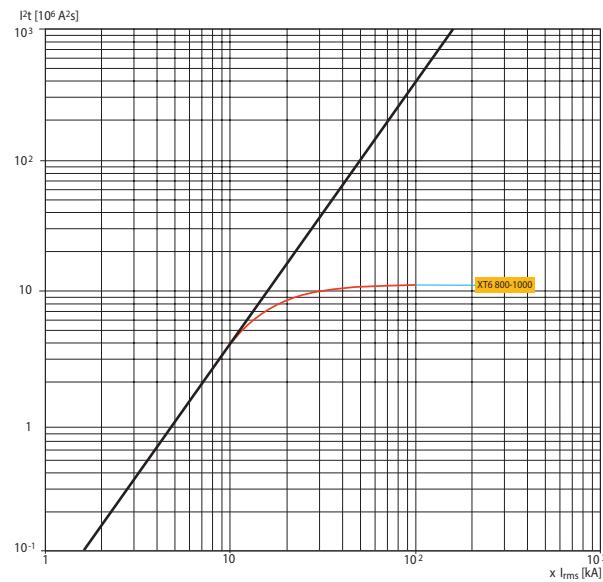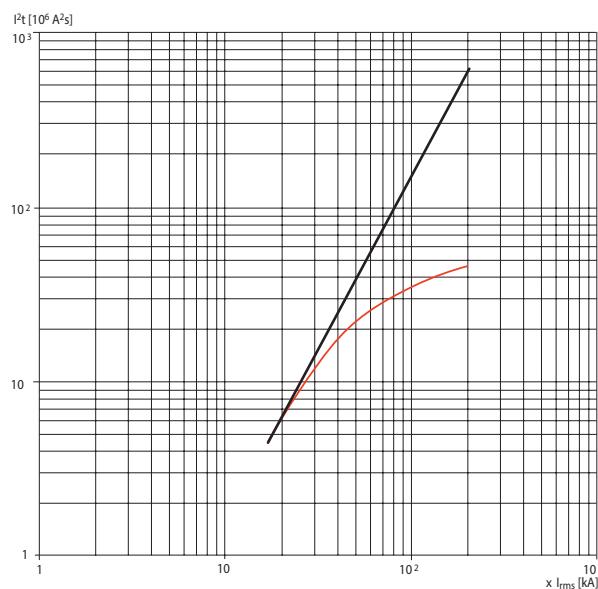
XT5
240V**XT6**
240V**XT7 - XT7 M S-H-L**
240V

Characteristic curves


Specific let-through energy curves

415V


XT1
415V

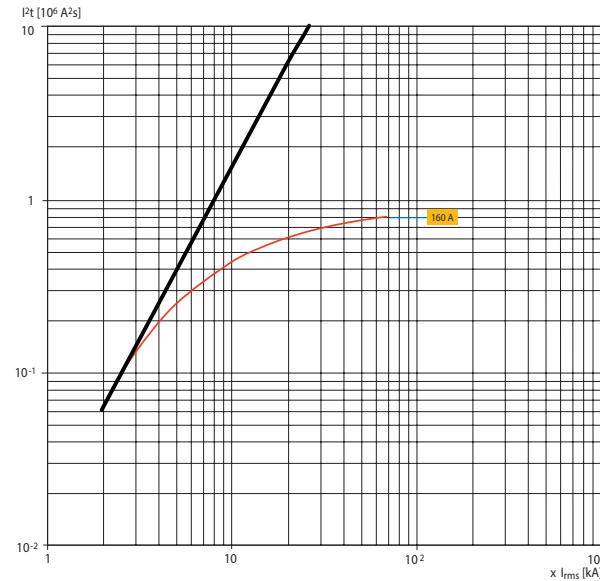


XT2
415V

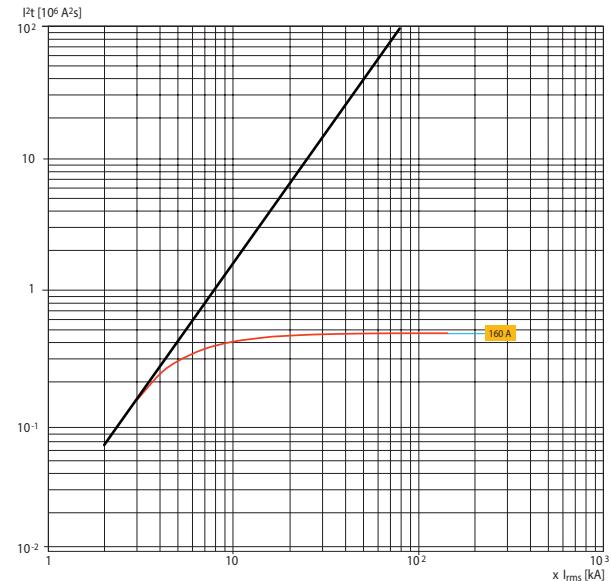





XT3
415V

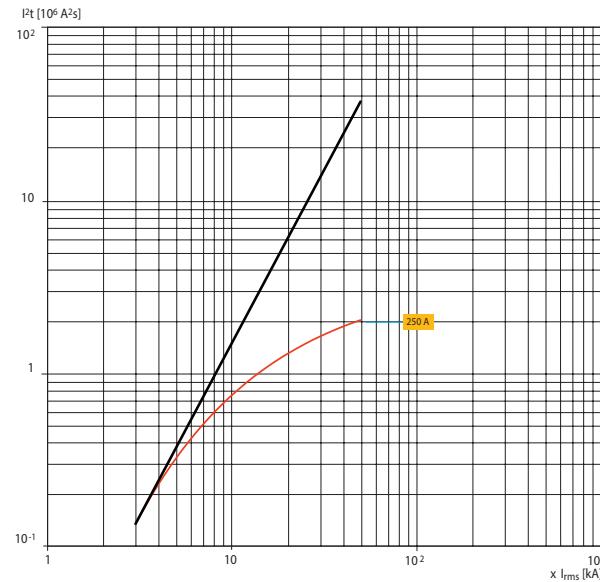

XT4 N-S-H-L
415V

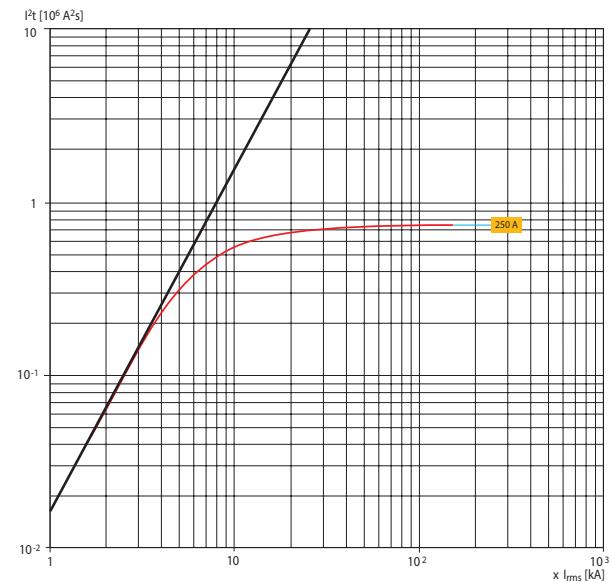

415V

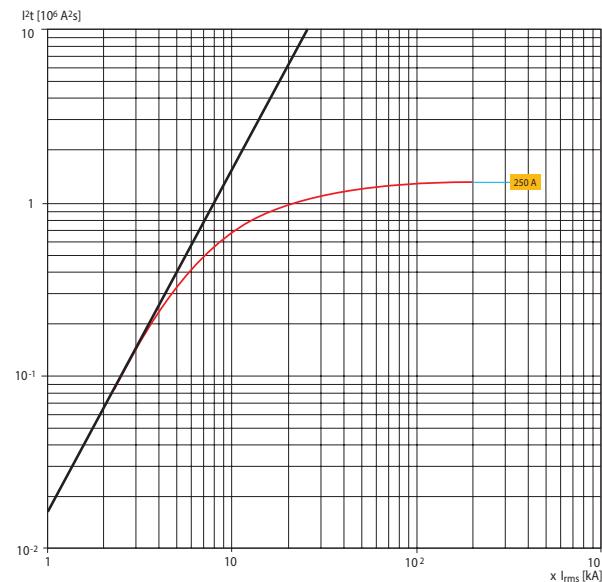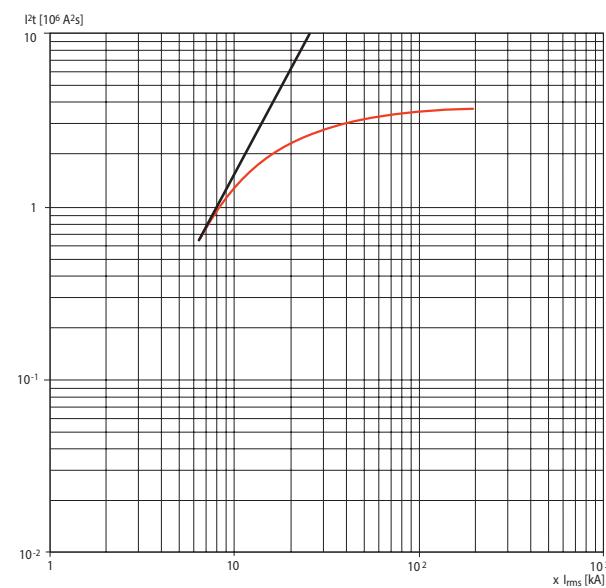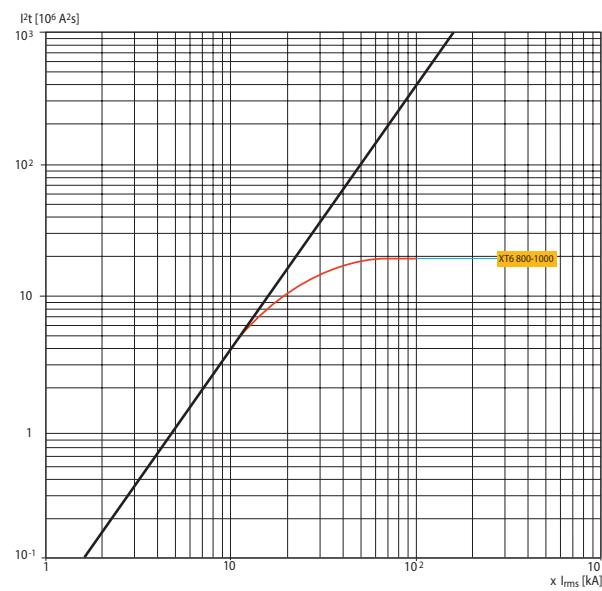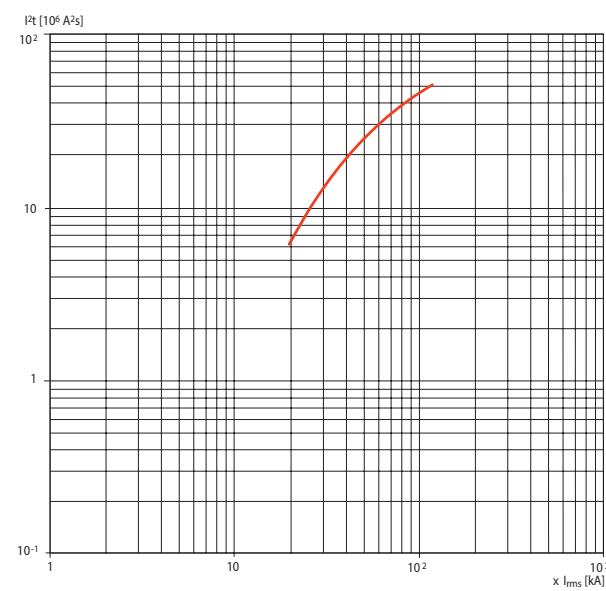
**XT4 V-X
415V****XT5
415V****XT6
415V****XT7 - XT7 M S-H-L
415V**

Characteristic curves


Specific let-through energy curves

440V


XT1
440V

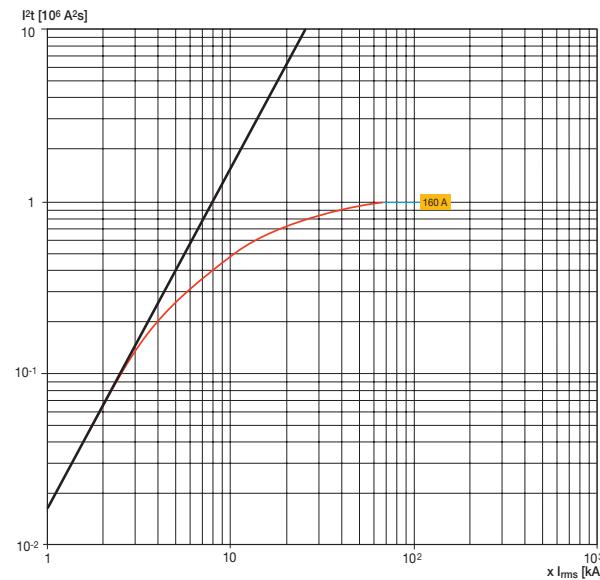


XT2
440V

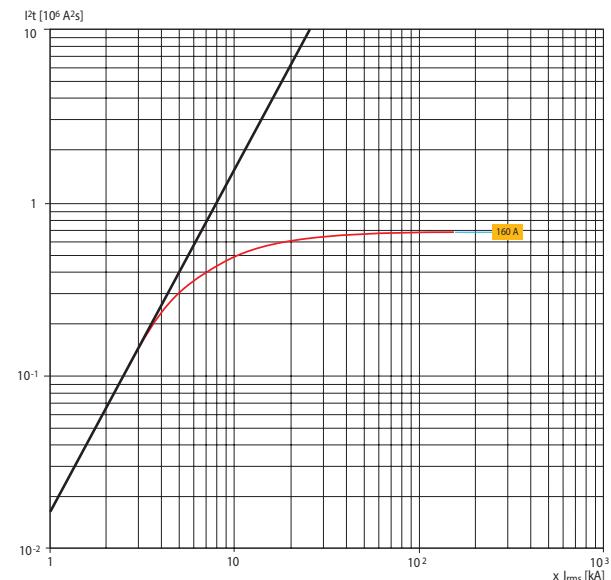





XT3
440V

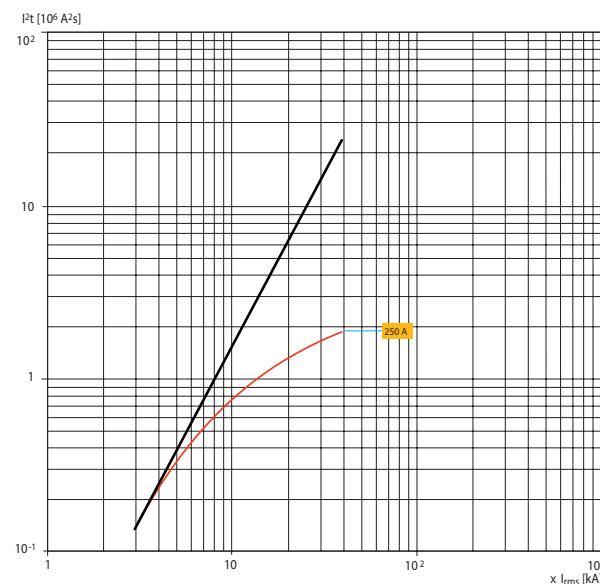

XT4 N-S-H-L
440V

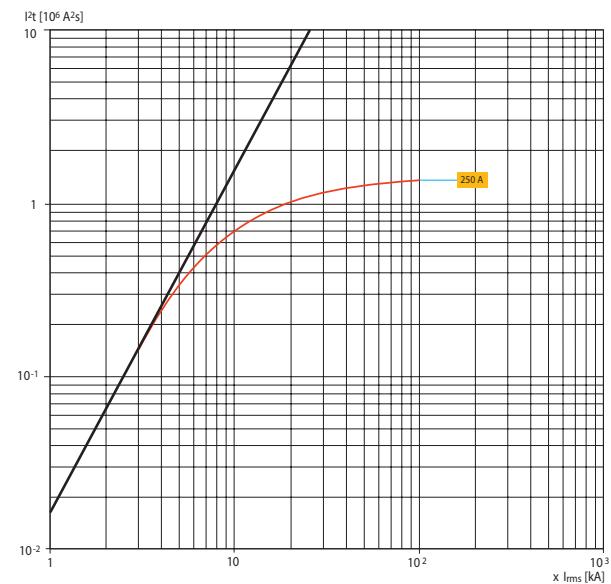

440V

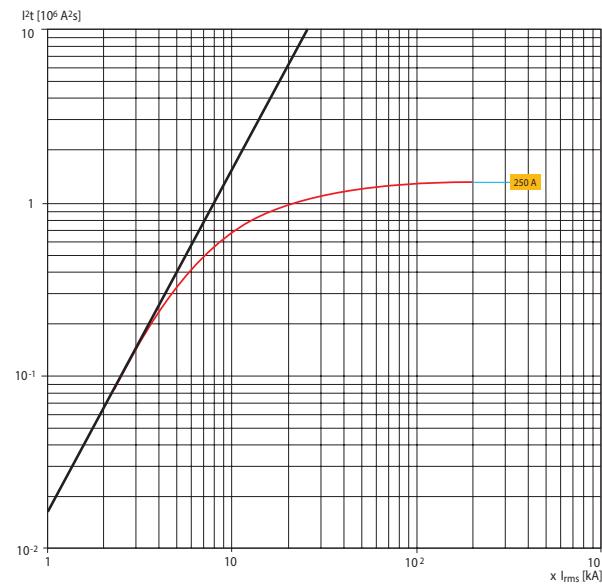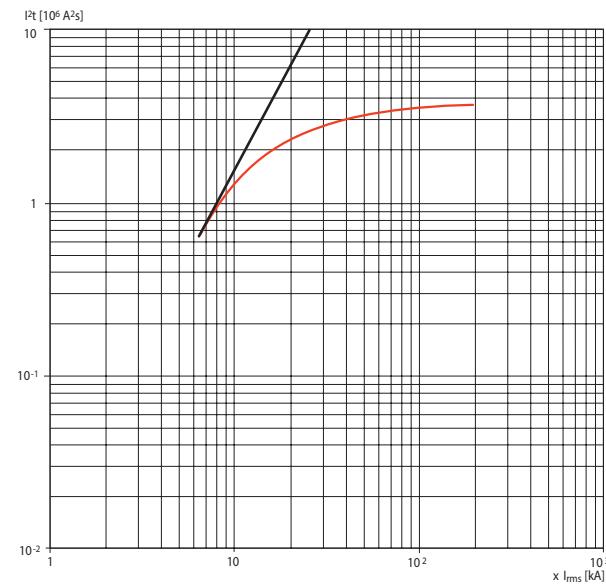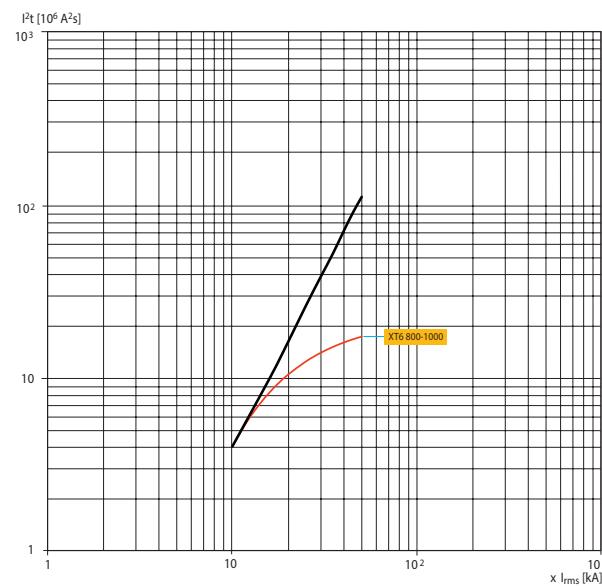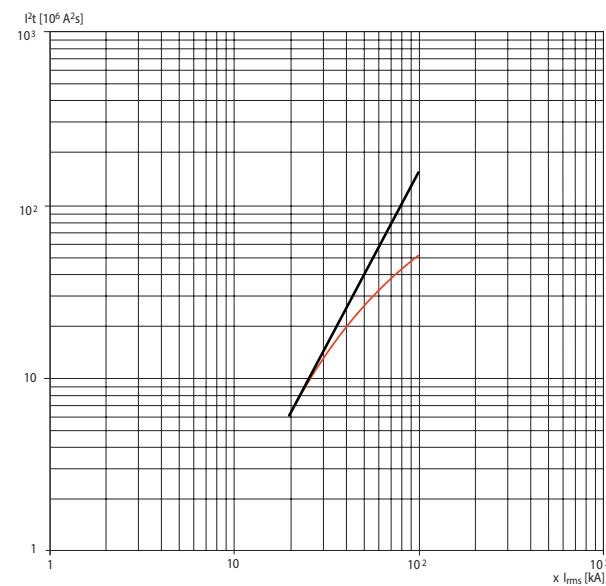
**XT4 V-X
440V**Note: XT4X starting from $I_n=32A$ **XT5
440V****XT6
440V****XT7 - XT7 M S-H-L
440V**

Characteristic curves


Specific let-through energy curves

500V


XT1
500V

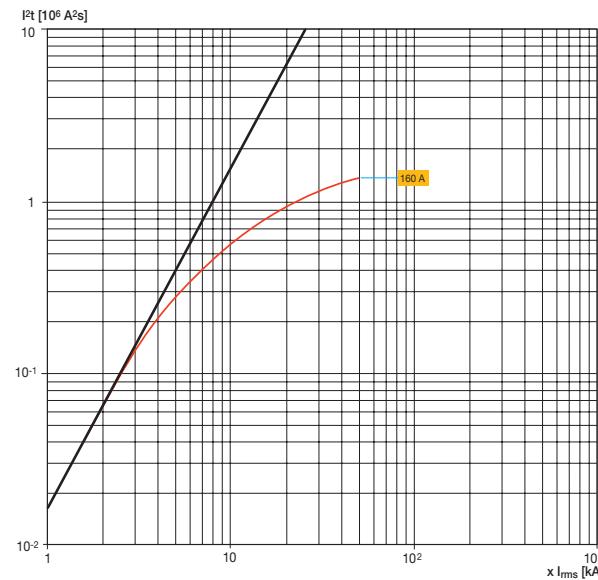


XT2
500V

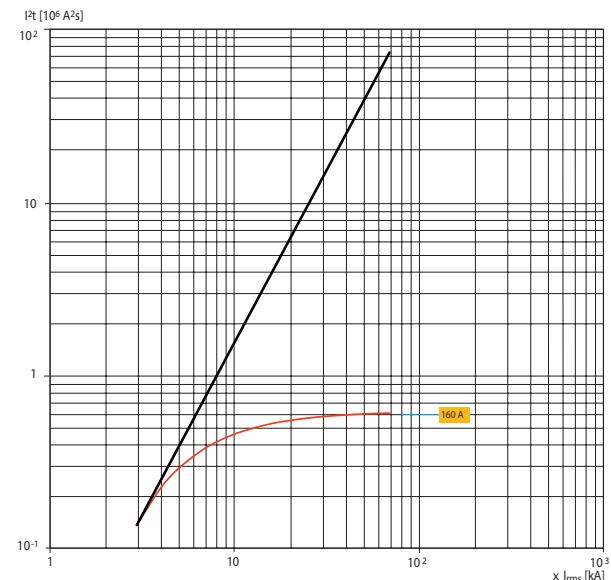





XT3
500V

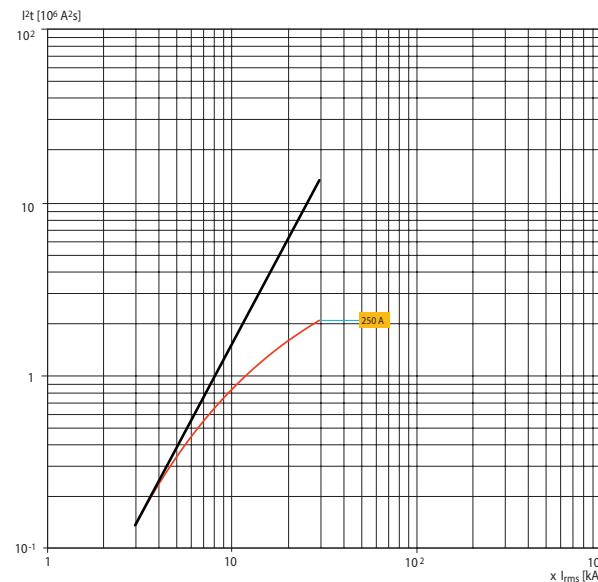

XT4 N-S-H-L
500V

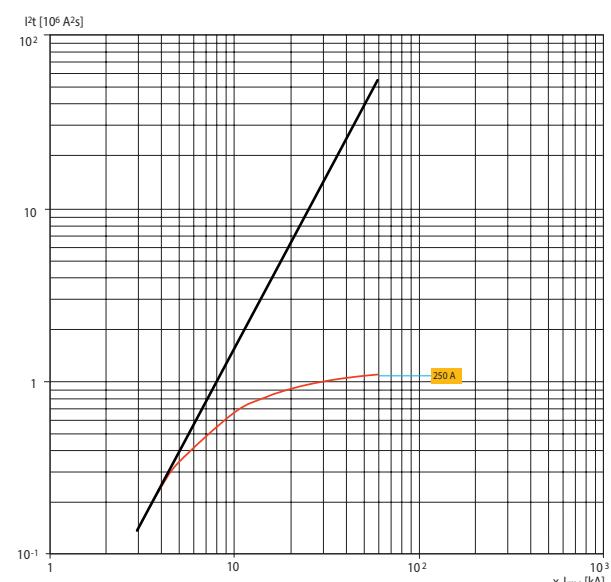

500V

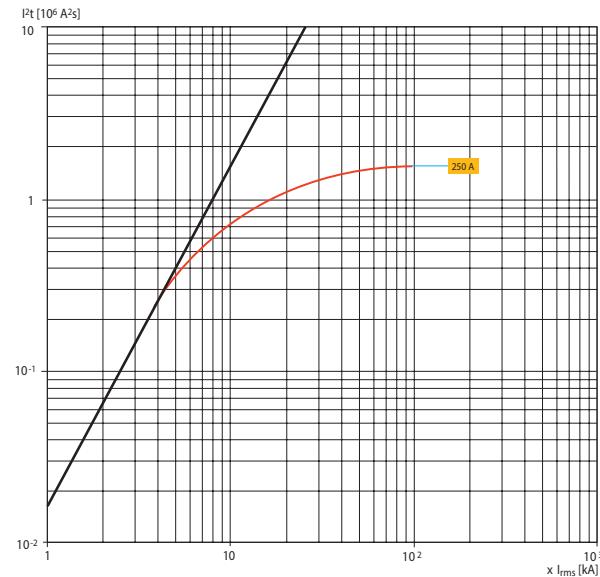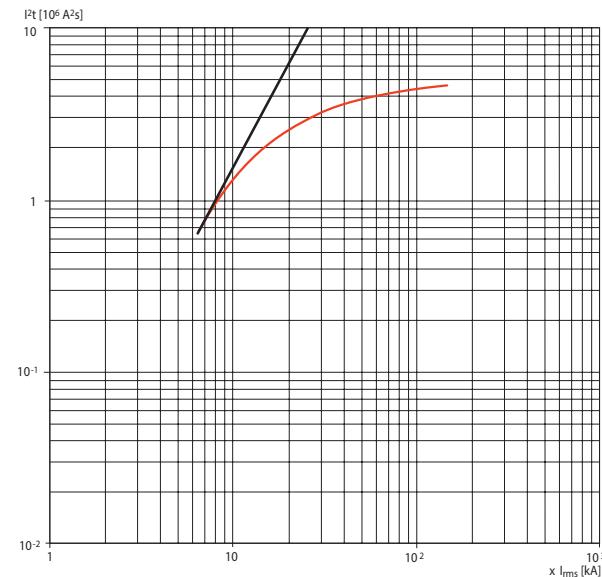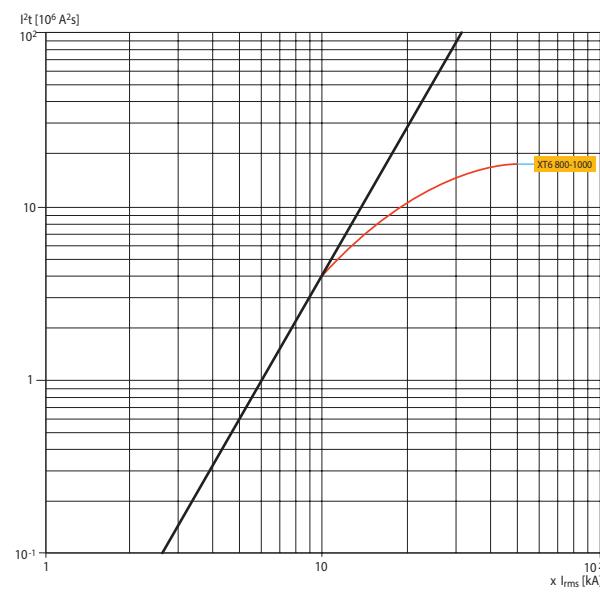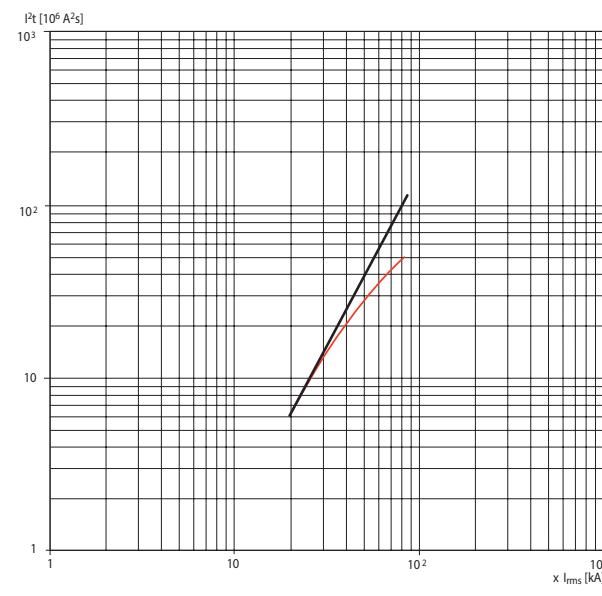
**XT4 V-X
500V**Note: XT4X starting from $I_n=32A$ **XT5
500V****XT6
500V****XT7 - XT7 M S-H-L
500V**

Characteristic curves


Specific let-through energy curves

690V


XT1
690V

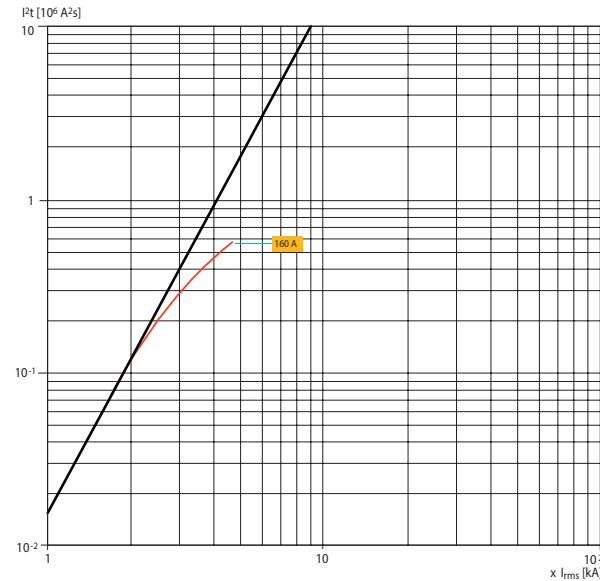


XT2
690V

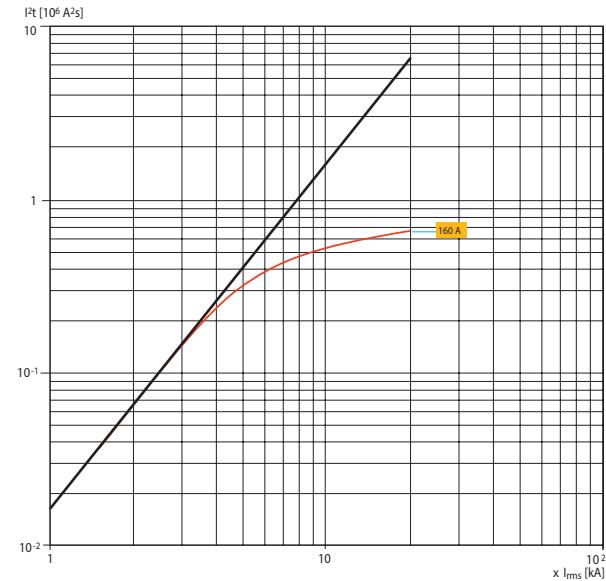





XT3
690V

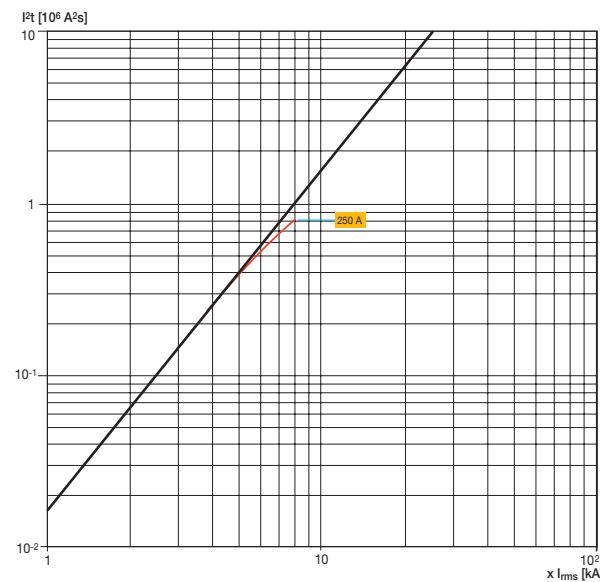

XT4 N-S-H-L
690V

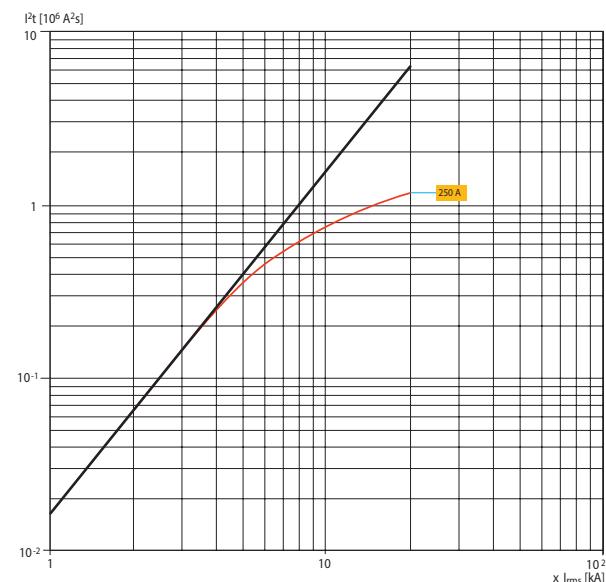

690V

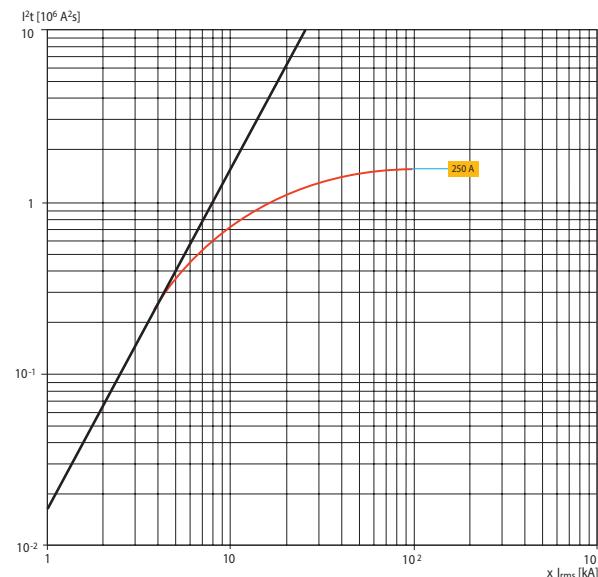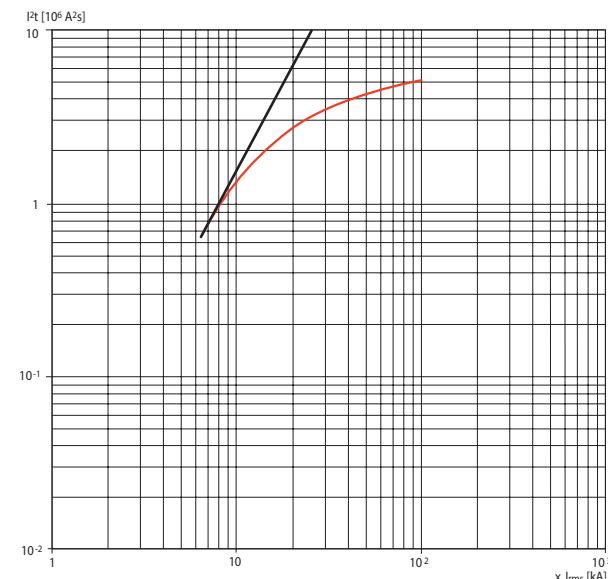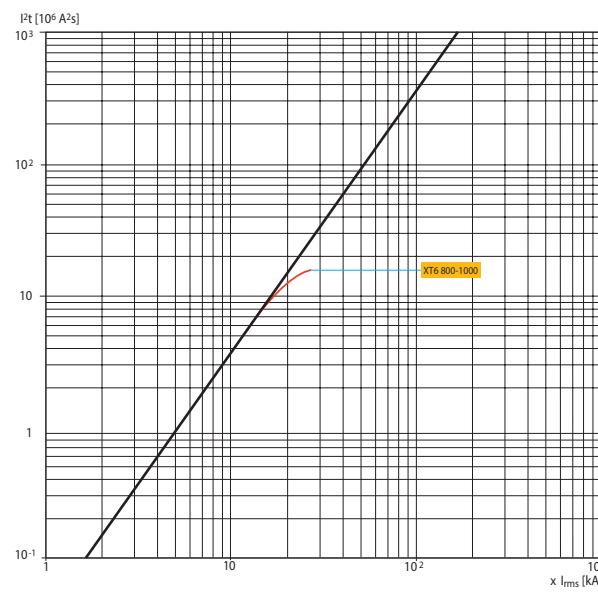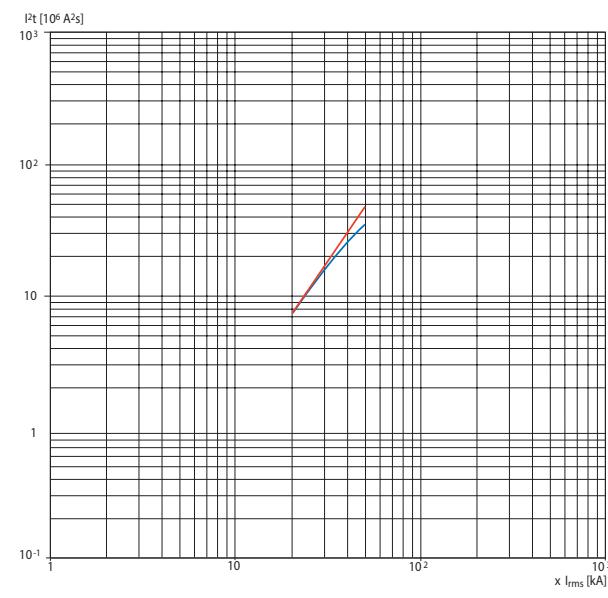
**XT4 V-X
690V****XT5
690V****XT6 800/1000
690V****XT7 - XT7 M S-H-L
690V**

Characteristic curves


Limiting curves

240V


XT1
240V

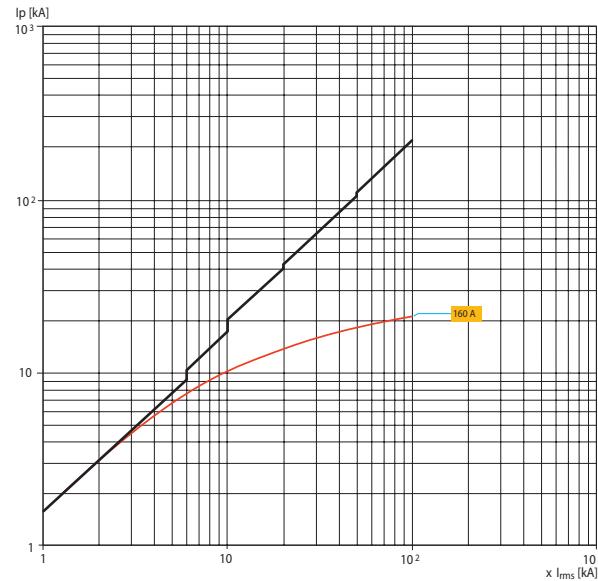


XT2
240V

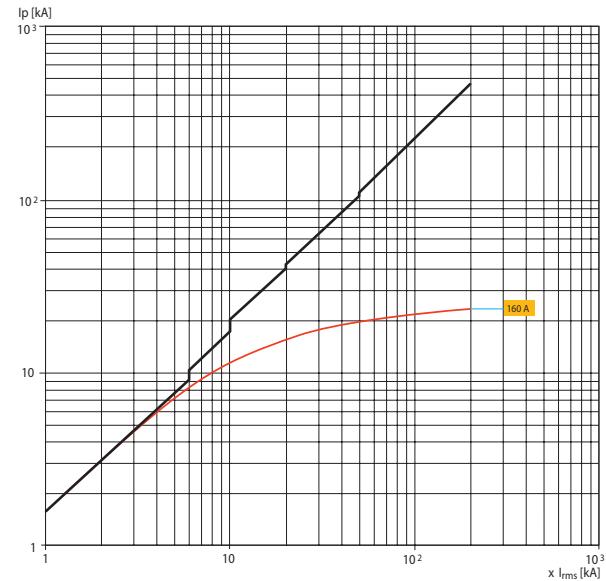

XT3
240V

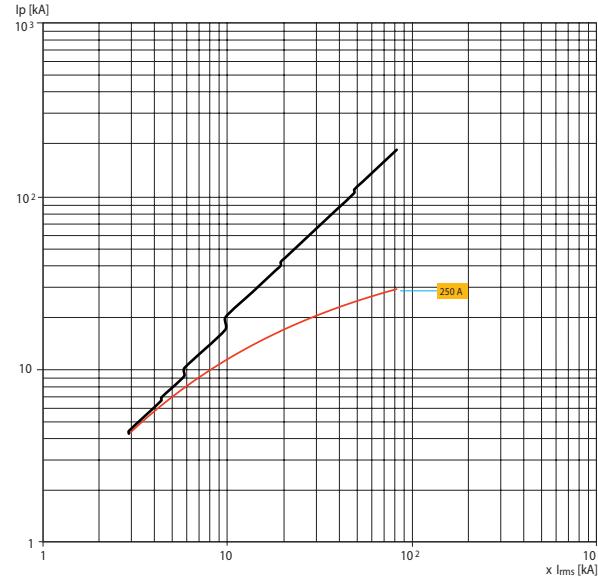


XT4
240V

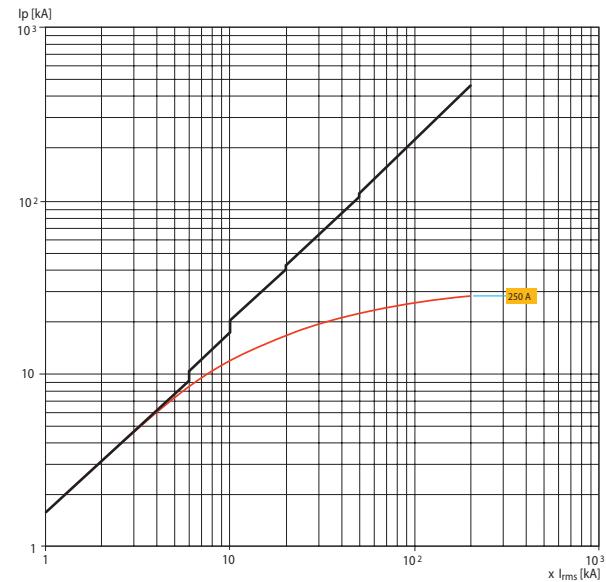


240V


**XT5
240V**

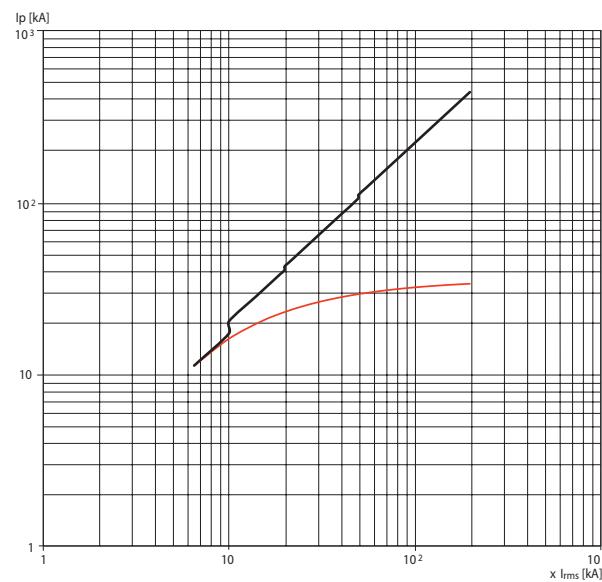

**XT6
240V**

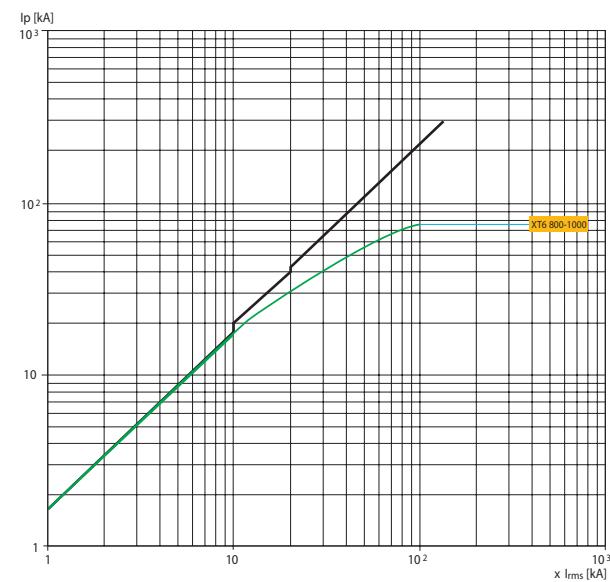

**XT7 - XT7 M S-H-L
240V**

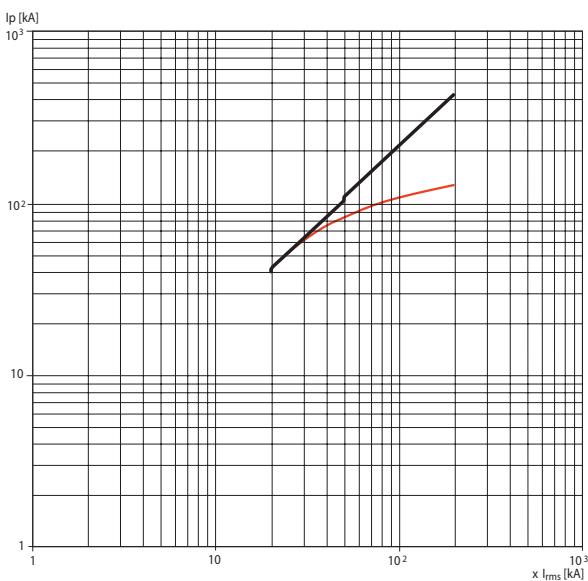


Characteristic curves


Limiting curves

415V


XT1
415V

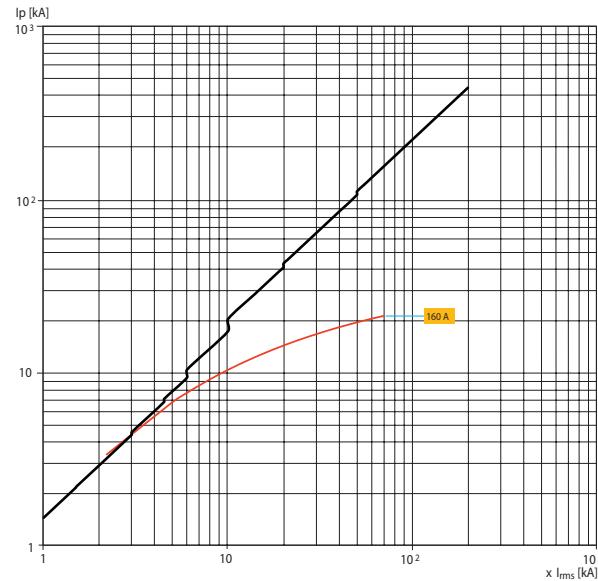


XT2
415V

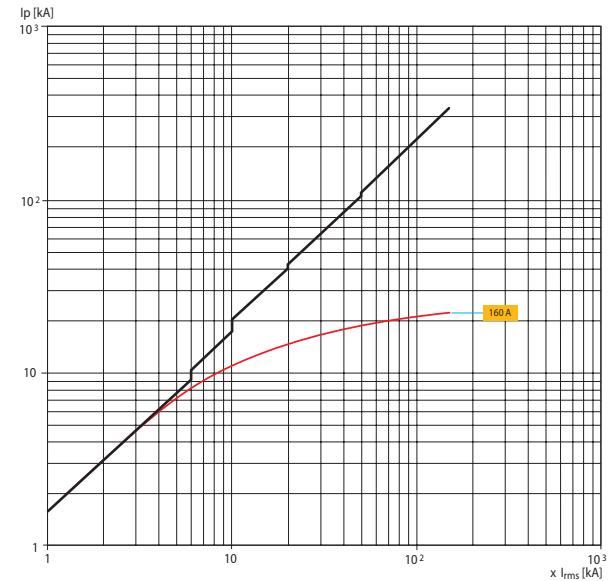





XT3
415V

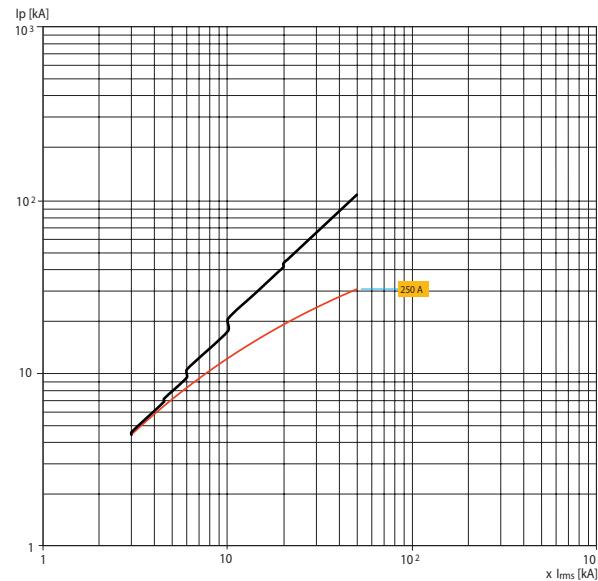

XT4 N-S-H-L
415V

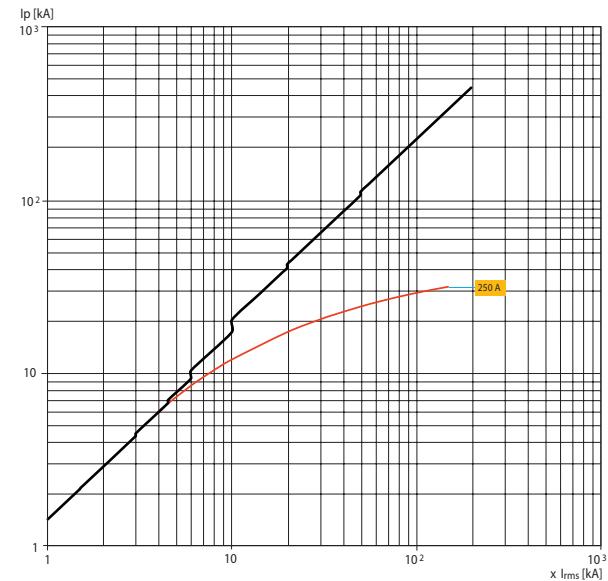

415V

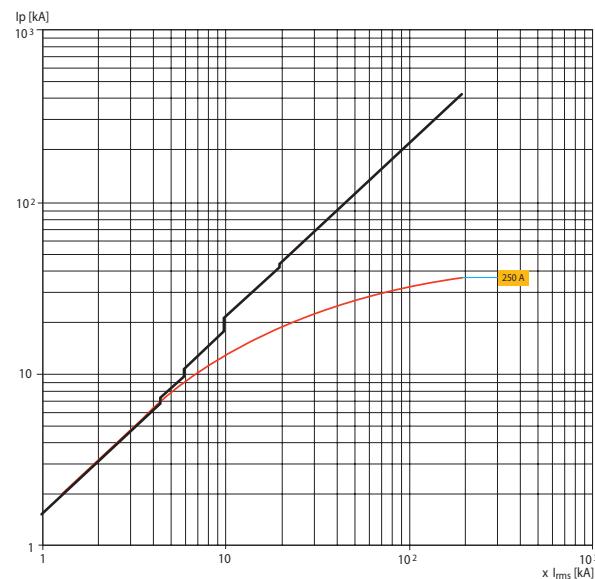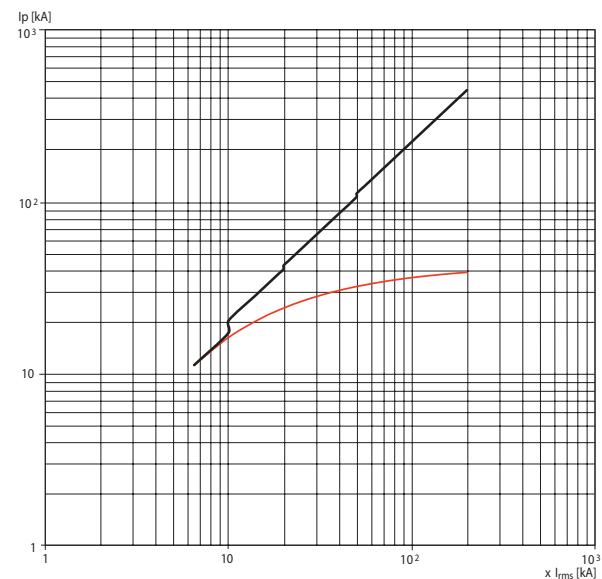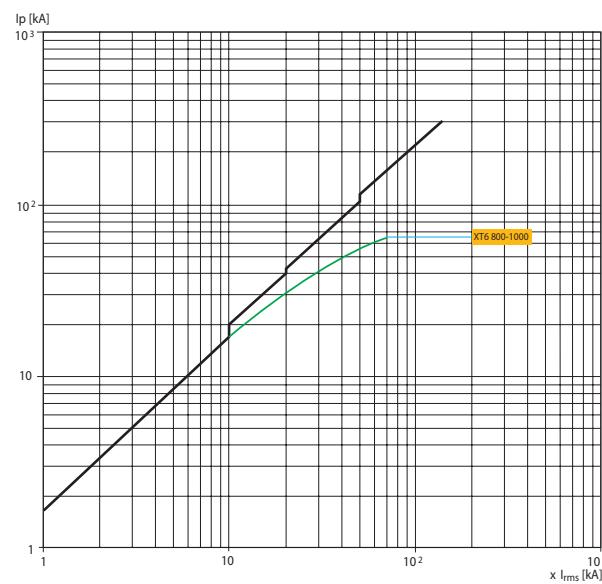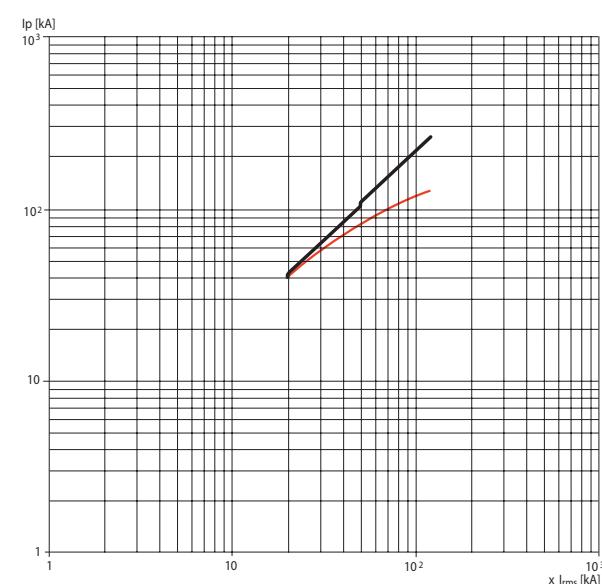
**XT4 V-X
415V**Note: XT4X starting from $I_n=32$ A**XT5
415V****XT6
415V****XT7 - XT7 M S-H-L
415V**

Characteristic curves


Limiting curves

440V


XT1
440V

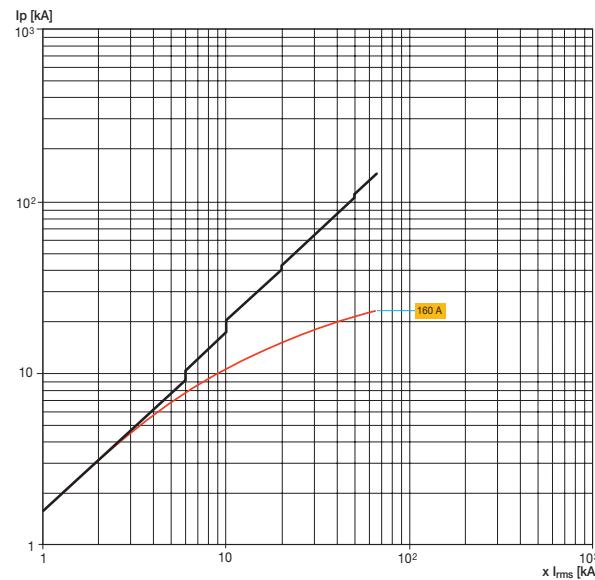


XT2
440V

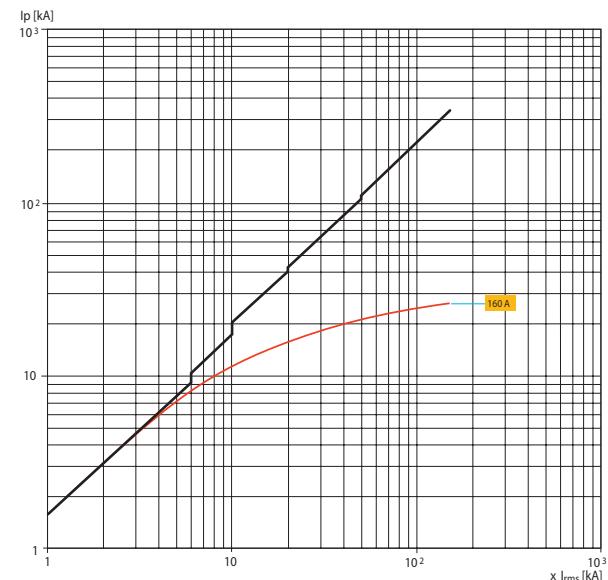





XT3
440V

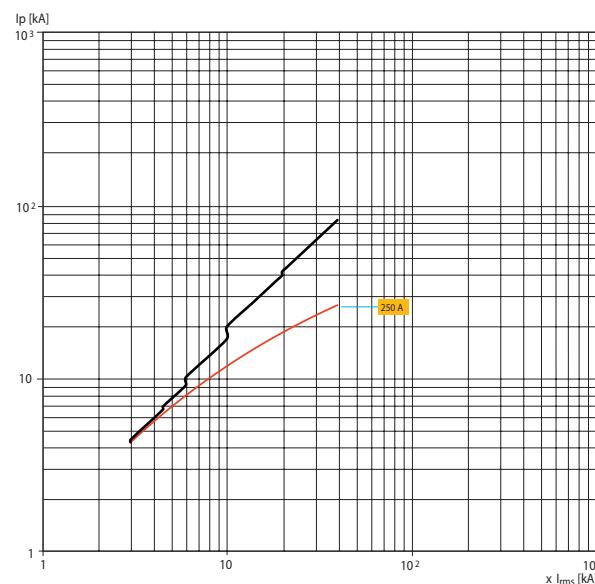

XT4 N-S-H-L
440V

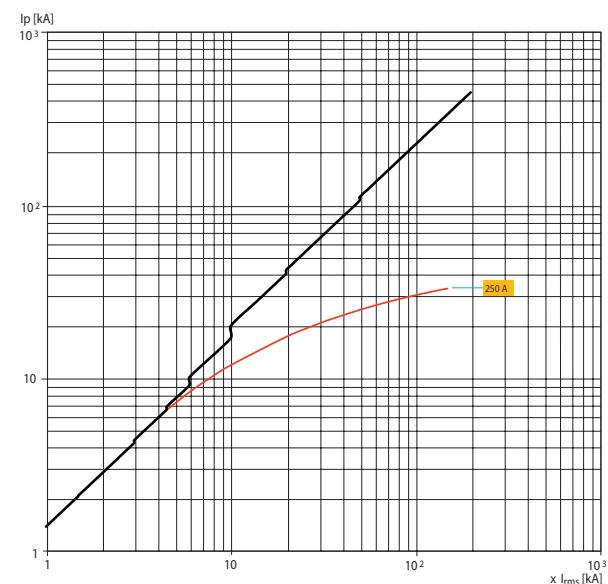

440V

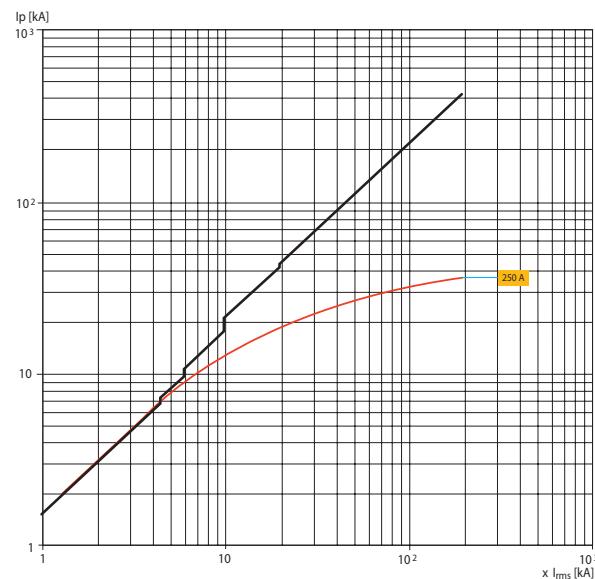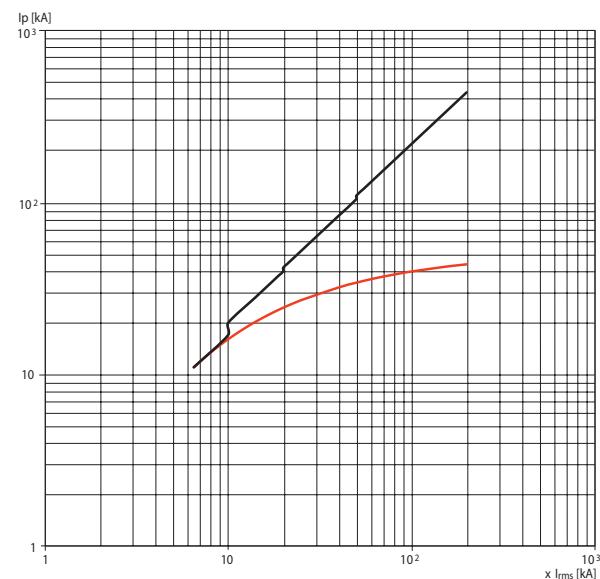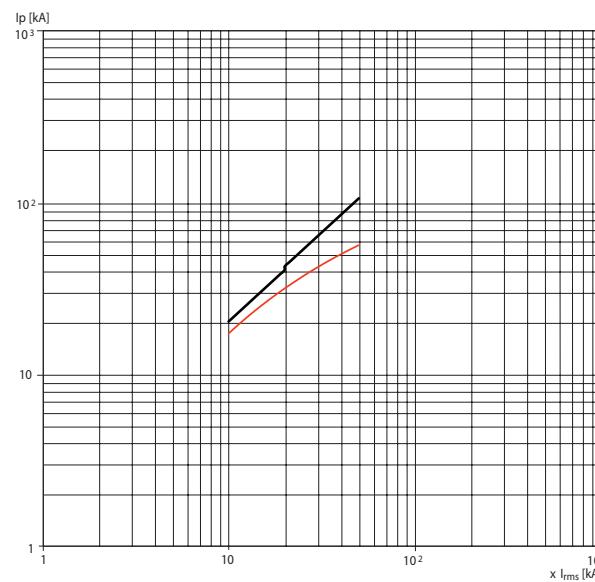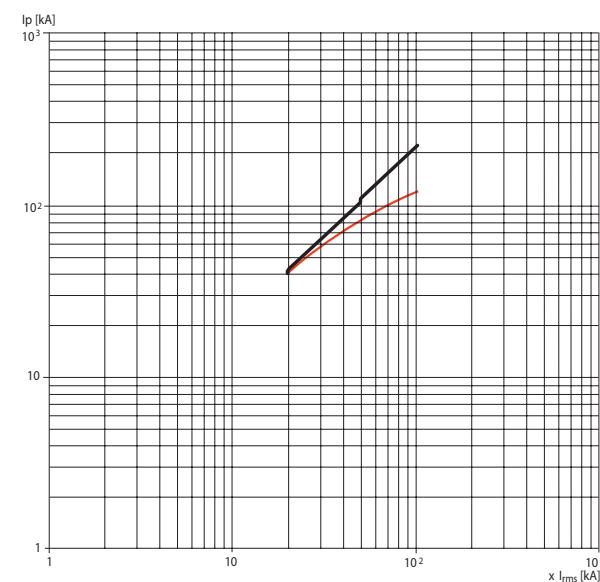
**XT4 V-X
440V**Note: XT4X starting from $I_n=32$ A**XT5
440V****XT6
440V****XT7 - XT7 M S-H-L
440V**

Characteristic curves


Limiting curves

500V


XT1
500V

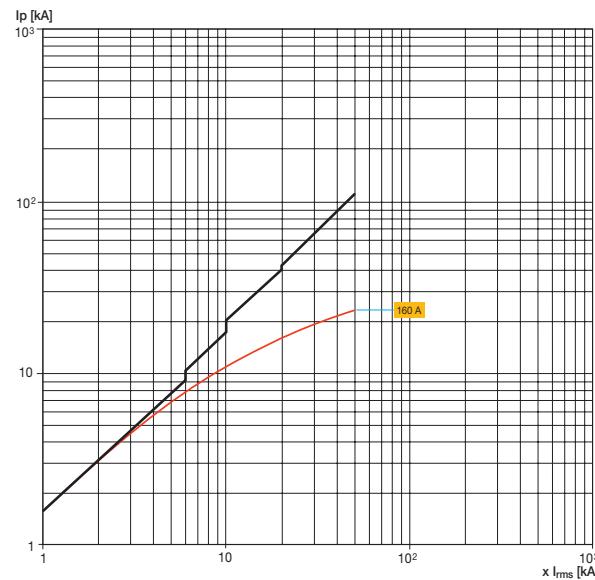


XT2
500V

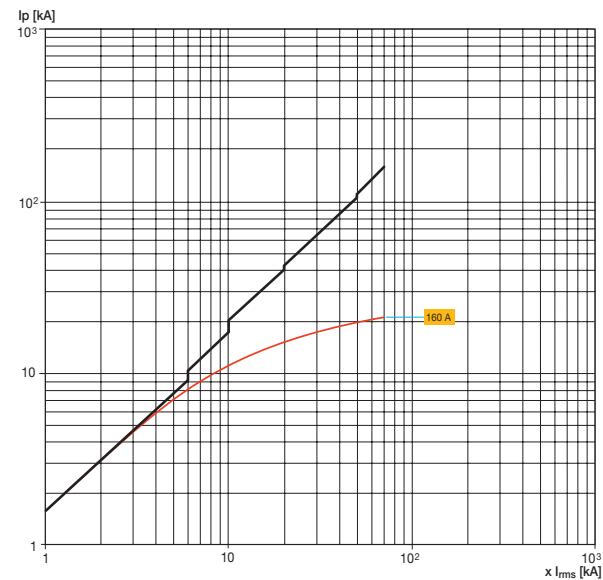





XT3
500V

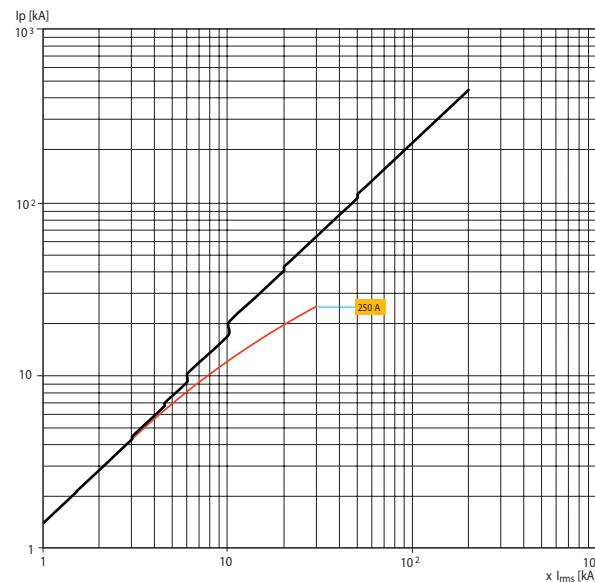

XT4 N-S-H-L
500V

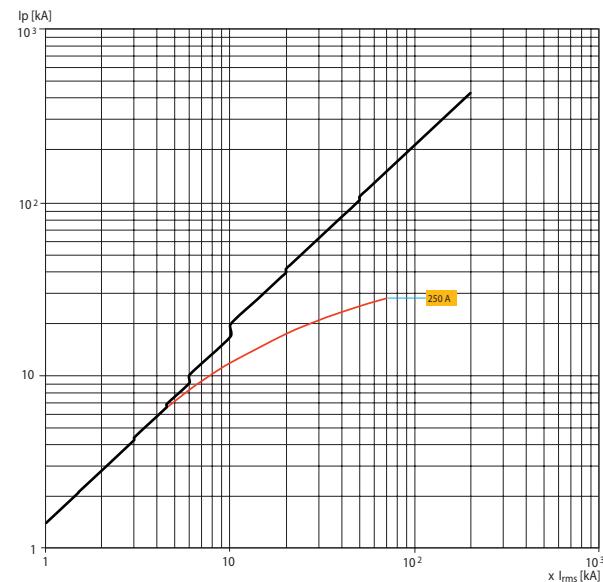

500V

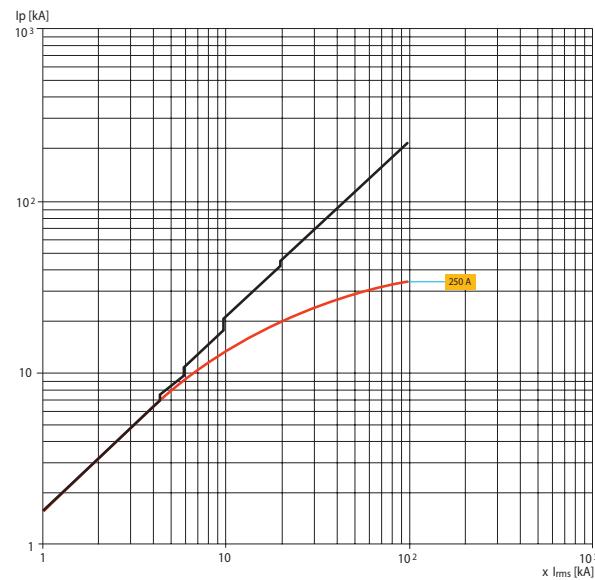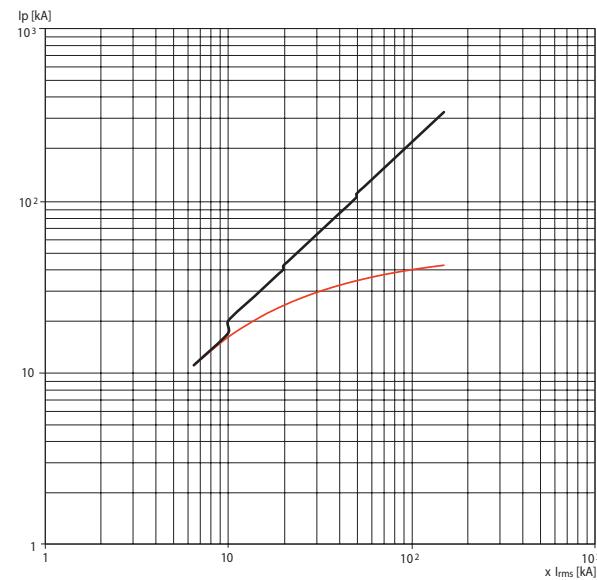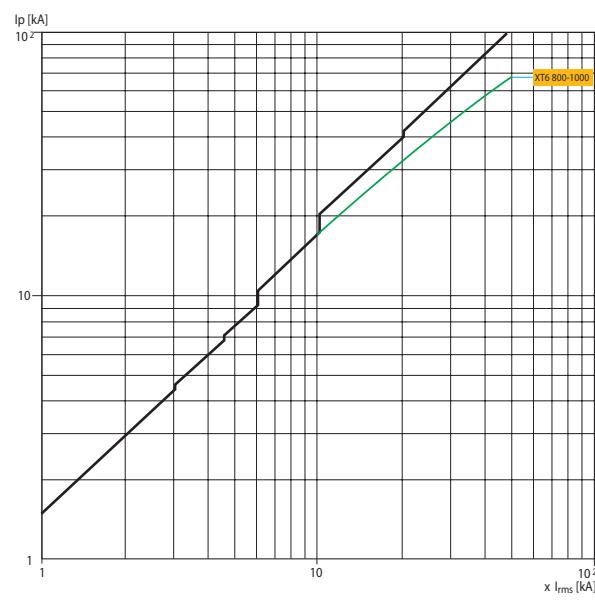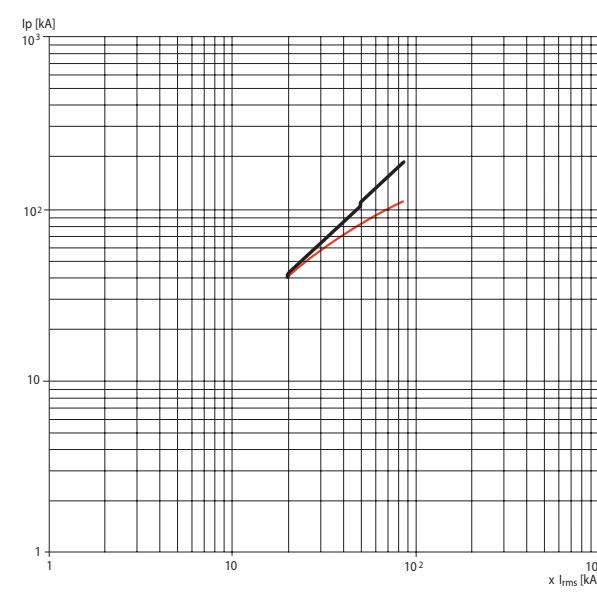
**XT4 V-X
500V**Note: XT4X starting from $I_n=32A$ **XT5
500V****XT6
500V****XT7 - XT7 M S-H-L
500V**

Characteristic curves


Limiting curves

690V


XT1
690V

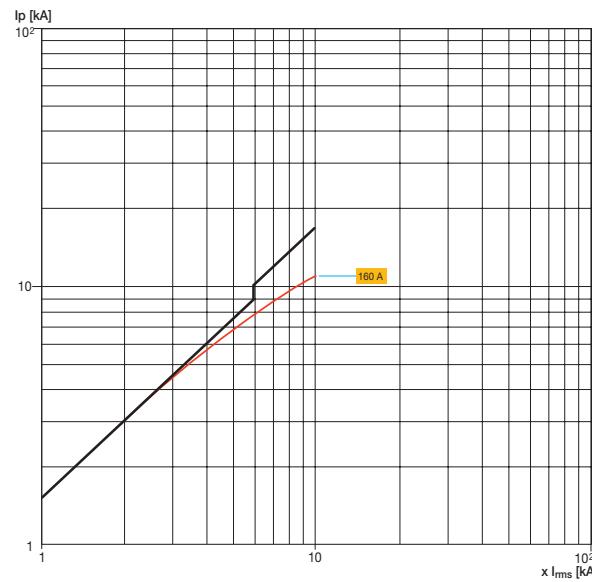


XT2
690V

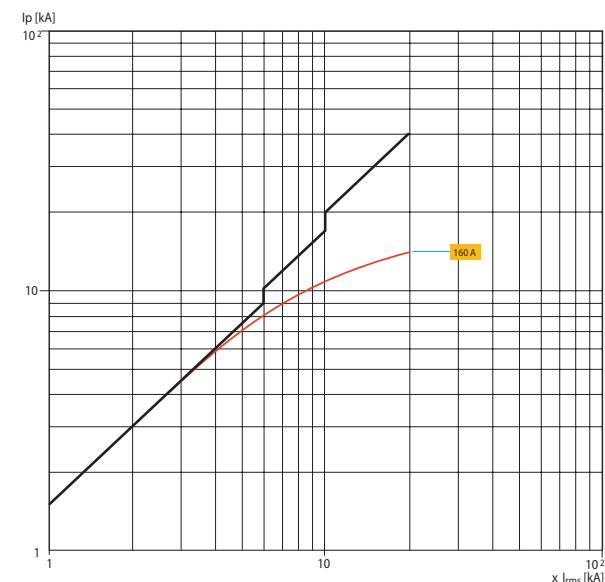





XT3
690V

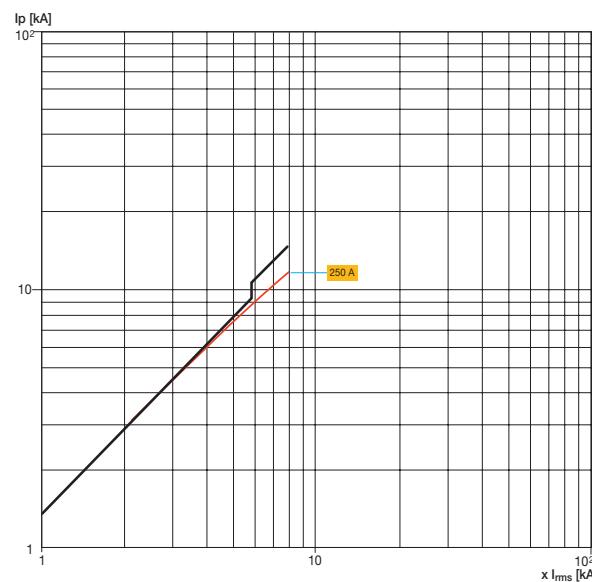

XT4 N-S-H-L
690V

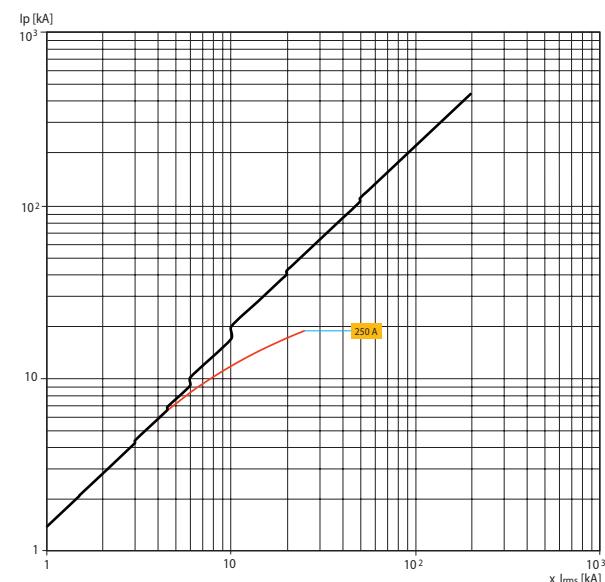

690V

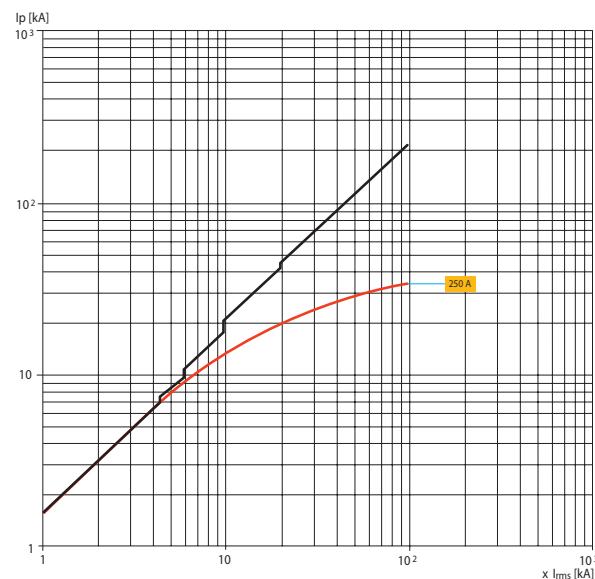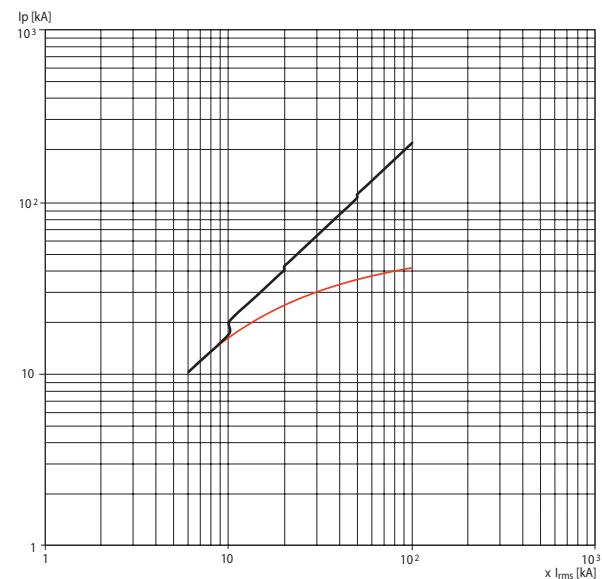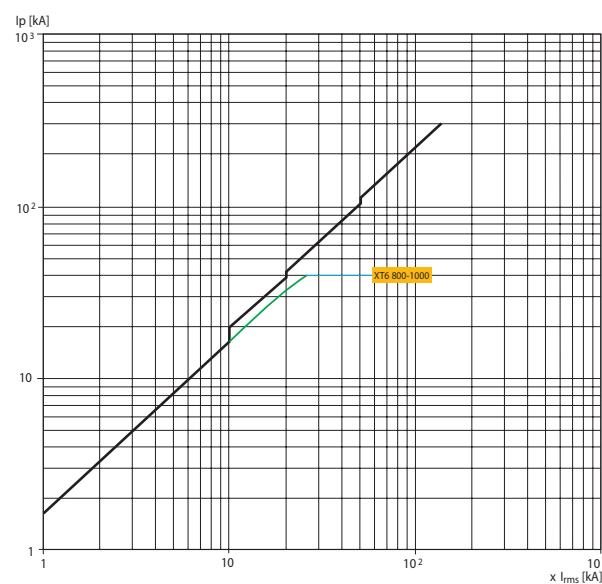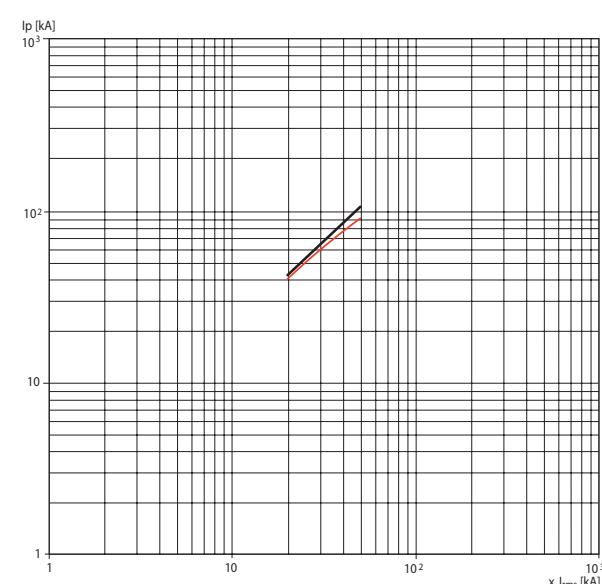**XT4 V-X
690V**Note: XT4X starting from $I_n=32\text{A}$ **XT5
690V****XT6
690V****XT7 - XT7 M S-H-L
690V**

Overall dimensions

Tmax XT1 – Installation

- 2/3** Installation for fixed circuit breaker
- 2/6** Terminals for fixed circuit-breaker
- 2/9** Accessories for fixed circuit-breaker
- 2/17** Installation for plug-in circuit breaker
- 2/20** Terminals for plug-in circuit-breaker
- 2/23** Accessories for plug-in circuit-breaker

Tmax XT2 – Installation

- 2/24** Installation for fixed circuit breaker
- 2/27** Terminals for fixed circuit-breaker
- 2/31** Accessories for fixed circuit-breaker
- 2/36** Installation for plug-in circuit breaker
- 2/40** Terminals for plug-in circuit-breaker
- 2/44** Accessories for plug-in circuit-breaker
- 2/47** Installation for withdrawable circuit breaker
- 2/51** Terminals for withdrawable circuit-breaker
- 2/56** Accessories for withdrawable circuit-breaker

Tmax XT3 – Installation

- 2/61** Installation for fixed circuit breaker
- 2/64** Terminals for fixed circuit-breaker
- 2/68** Accessories for fixed circuit-breaker
- 2/74** Installation for plug-in circuit breaker
- 2/77** Terminals for plug-in circuit-breaker
- 2/81** Accessories for plug-in circuit-breaker

Tmax XT4 – Installation

- 2/82** Installation for fixed circuit breaker
- 2/85** Terminals for fixed circuit-breaker
- 2/90** Accessories for fixed circuit-breaker
- 2/95** Installation for plug-in circuit breaker
- 2/99** Terminals for plug-in circuit-breaker
- 2/103** Accessories for plug-in circuit-breaker
- 2/106** Installation for withdrawable circuit breaker
- 2/110** Terminals for withdrawable circuit-breaker
- 2/115** Accessories for withdrawable circuit-breaker

Tmax XT5

- 2/120** Installation for fixed circuit-breaker
- 2/122** Terminals for fixed circuit-breaker
- 2/128** Accessories for fixed circuit-breaker
- 2/138** Installation for plug-in circuit-breaker 400A
- 2/140** Terminals for plug-in circuit-breaker 400A
- 2/143** Accessories for plug-in circuit-breaker 400A
- 2/153** Installation for plug-in circuit-breaker 630A
- 2/155** Terminals for plug-in circuit-breaker 630A
- 2/158** Accessories for plug-in circuit-breaker 630A

- 2/168** Installation for withdrawable circuit-breaker 400A
2/170 Terminals for withdrawable circuit-breaker 400A
2/175 Accessories for withdrawable circuit-breaker 400A
2/181 Installation for withdrawable circuit-breaker 630A
2/183 Terminals for withdrawable circuit-breaker 630A
2/188 Accessories for withdrawable circuit-breaker 630A

Tmax XT6 – Installation

- 2/194** Installation for fixed circuit-breaker
2/196 Terminals for fixed circuit-breaker
2/202 Accessories for fixed circuit-breaker
2/209 Installation for withdrawable circuit-breaker
2/211 Terminals for withdrawable circuit-breaker
2/212 Accessories for withdrawable circuit-breaker

Tmax XT7 – Installation


- 2/217** Installation for fixed circuit-breaker
2/218 Terminals for fixed circuit-breaker
2/222 Accessories for fixed circuit-breaker
2/224 Installation for withdrawable circuit-breaker
2/225 Terminals for withdrawable circuit-breaker
2/228 Accessories for withdrawable circuit-breaker

Tmax XT7 M – Installation

- 2/230** Installation for fixed circuit-breaker
2/231 Terminals for fixed circuit-breaker
2/235 Installation for withdrawable circuit-breaker
2/236 Terminals for withdrawable circuit-breaker

Tmax XT – Common accessories

- 2/237** Horizontal interlock XT series
2/241 Vertical interlock XT series





To access the full set of drawings in ABB Library scan the QR code or enter through the following link:
to.abb/WPBfA07x

Tmax XT1 – Installation

Installation for fixed circuit-breaker

Fixing on support sheet



- Key
 1 Overall dimensions of optional wiring ducts
 2 Phase separators 25mm

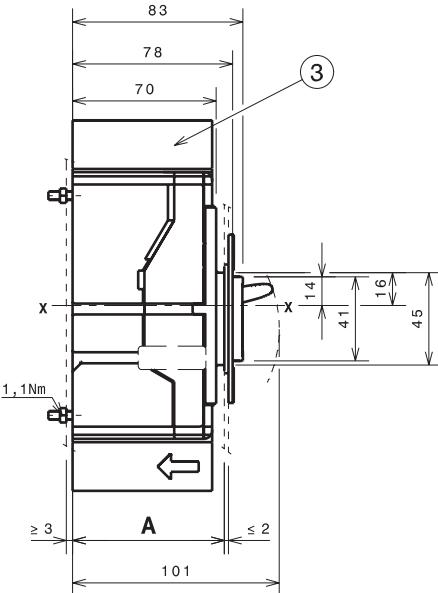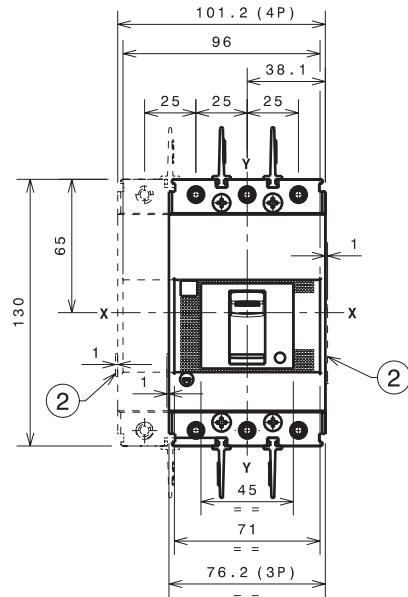

| | A |
|----------------------|------------|
| With standard flange | 3p - 4p 74 |
| Without flange | 3p - 4p 71 |
| | 3p - 4p 79 |

Fixing on DIN 50022 rail


- Key
 1 Bracket for fixing
 2 Overall dimensions of wiring ducts
 3 Phase separators 25mm
 4 Optional front cover for DIN rail

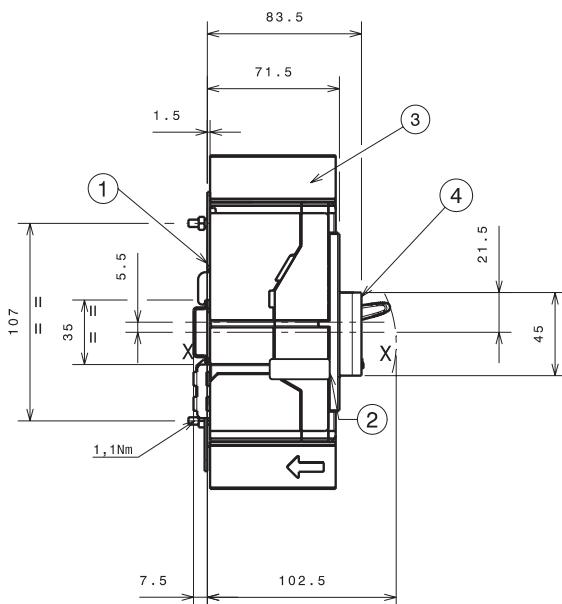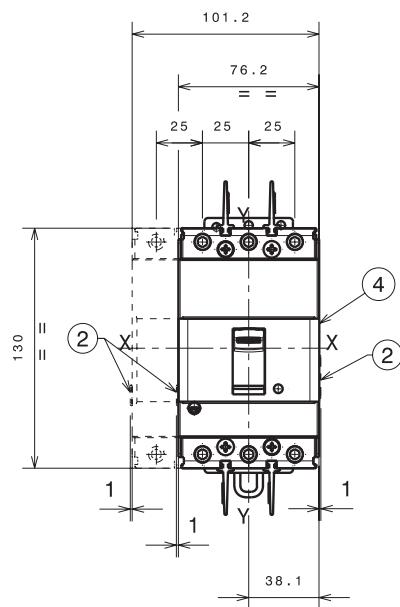


Tmax XT1 – Installation

Installation for fixed circuit-breaker

Drilling templates for circuit-breaker fixing

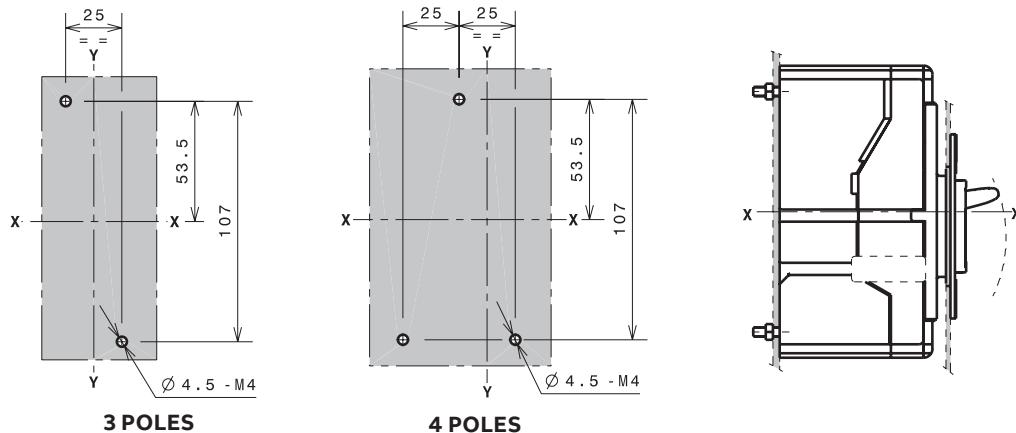


Flanges

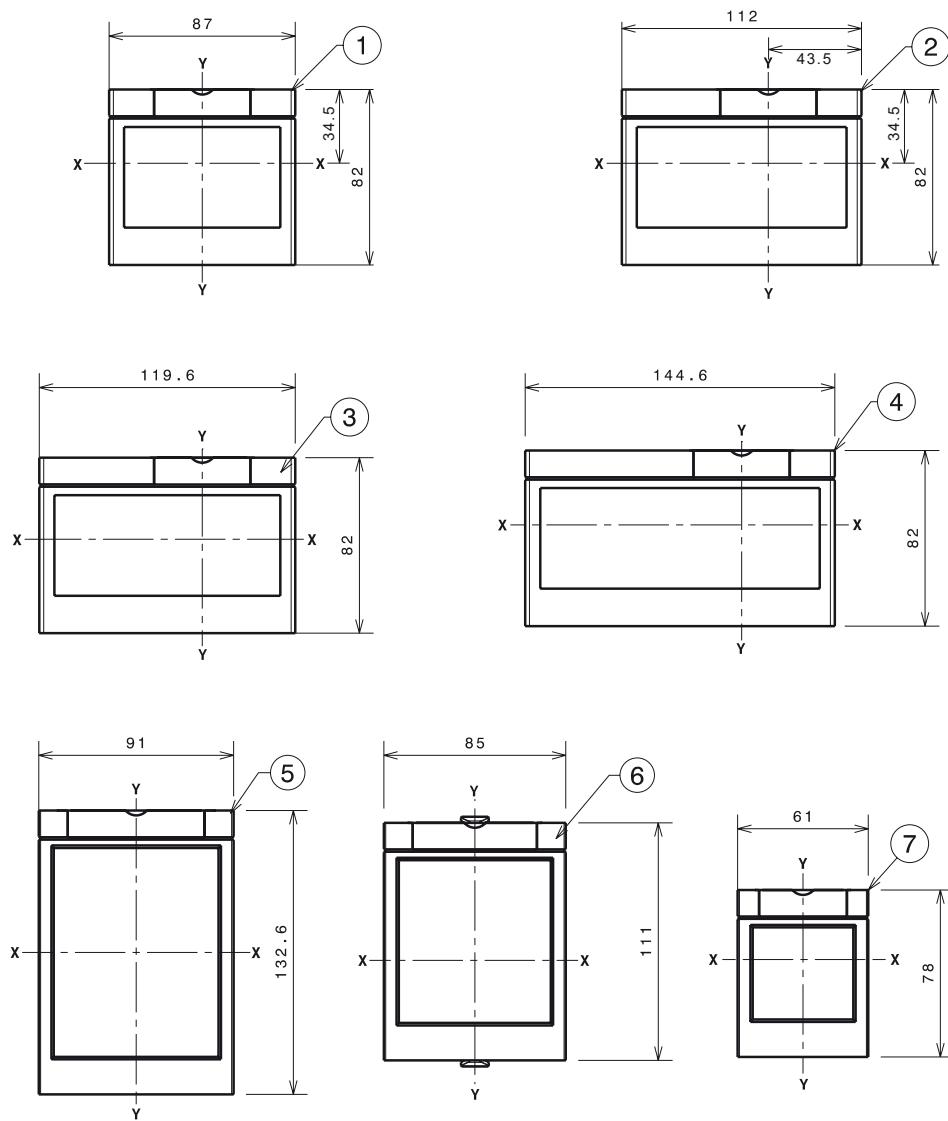


Compartment door drilling templates


With standard flange

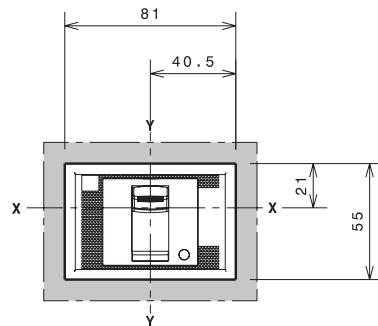


A=74
3 POLES

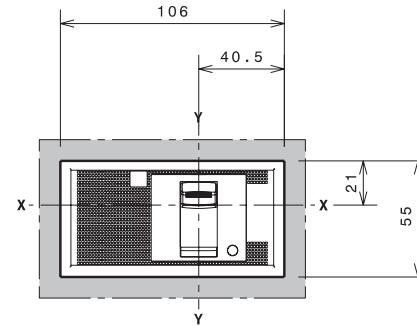


A=74
4 POLES

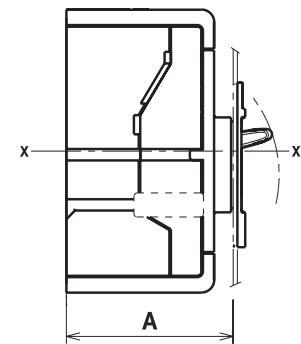


Without flange

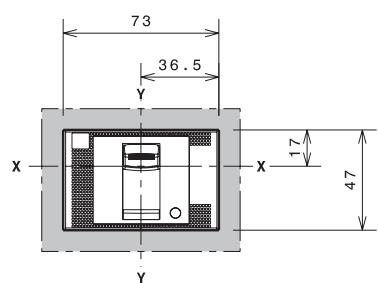

A=71
3 POLES

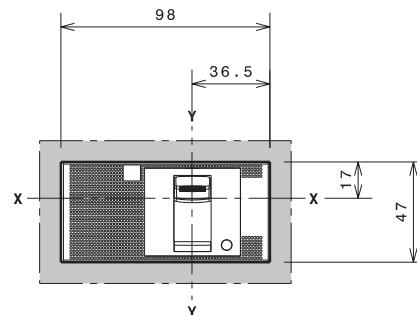


A=71
4 POLES

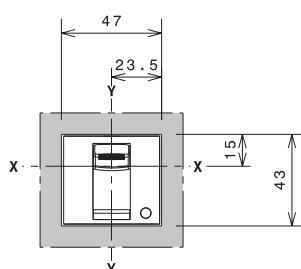


A=79
3-4 POLES

With optional flange

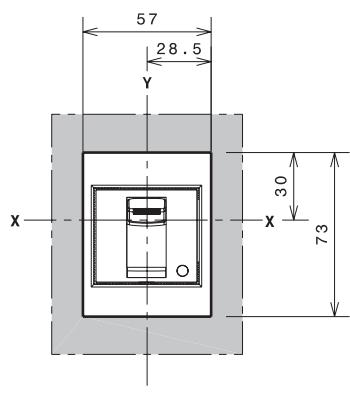

A=79
3-4 POLES

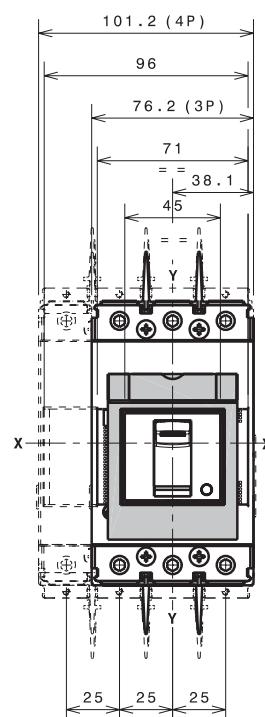


Tmax XT1 – Installation

Terminals for fixed circuit-breaker


Terminals F

- Key
1 Front terminals for busbars connection
7 Phase separators 25mm

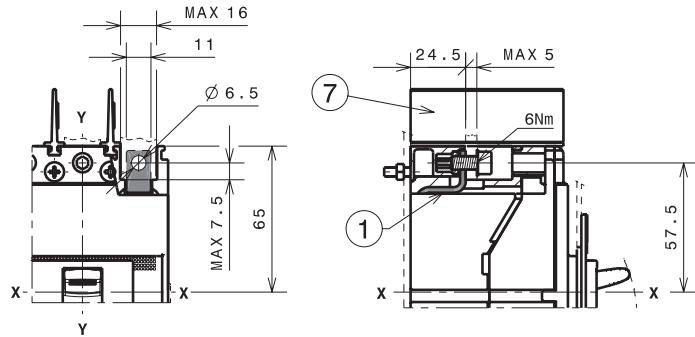


Terminals EF

- Key
2 Front extended terminals
3 High terminal covers with degree of protection IP40
5 Phase separators 100mm
9 Internal insulating plate

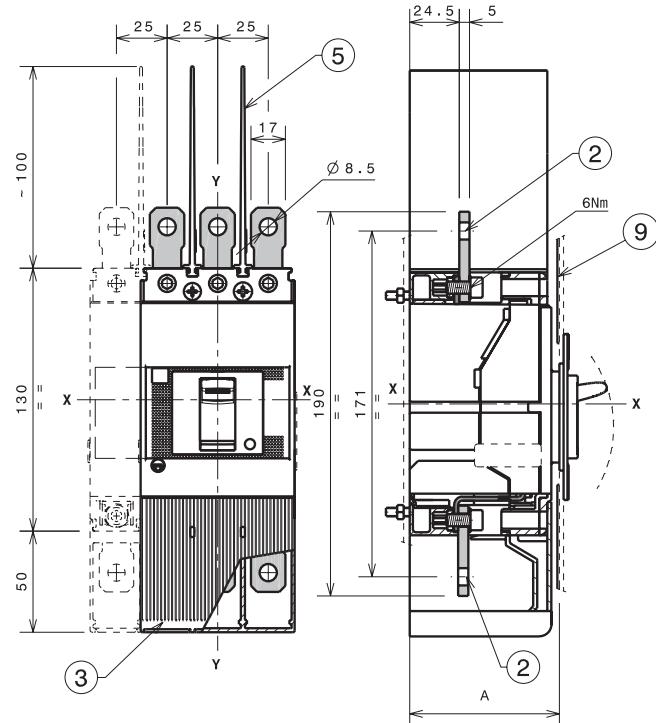



Terminals ES

- Key
4 Front extended spread terminals for busbar connection
6 Phase separators 200mm


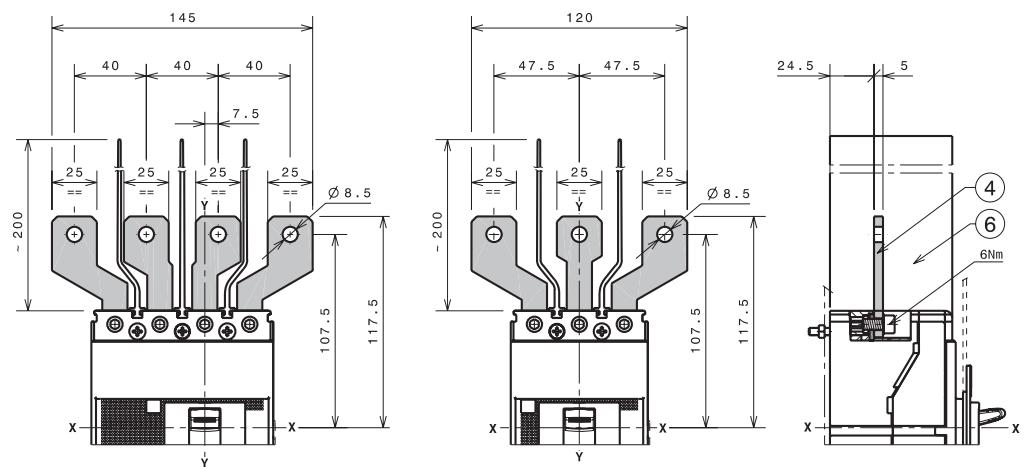


1x1.5...50mm² terminals FCCuAl

—
Key
1 1x1.5...50mm² front terminal FCCuAl
3 Phase separators 25mm

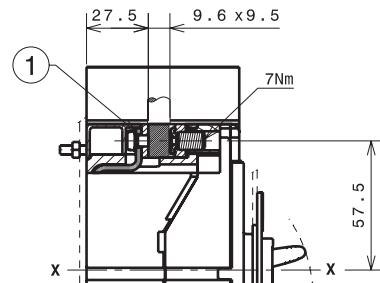
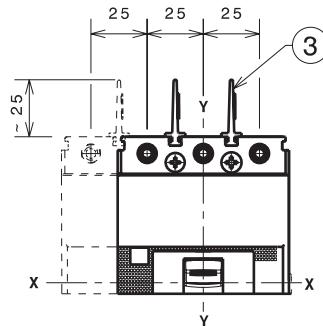
1x35...95mm² terminals FCCuAl

—
Key
1 External terminal FCCuAl
2 High terminal covers with degree of protection IP40

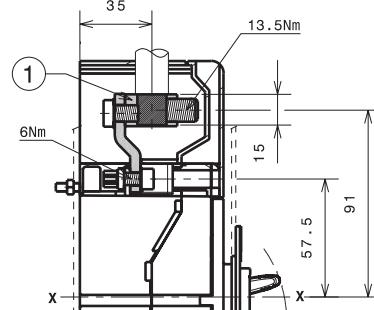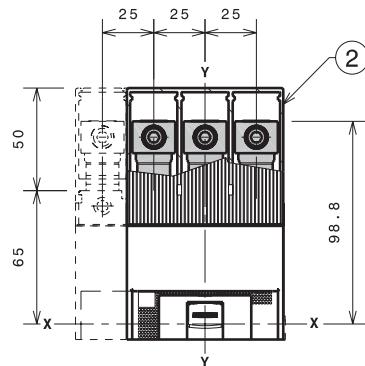



Terminals FCCu

—
Key
2 Front terminal FCCu

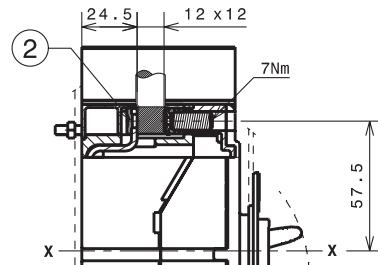

Terminals MC


—
Key
4 Terminal covers with degree of protection IP40
5 Front terminal for multicable connection

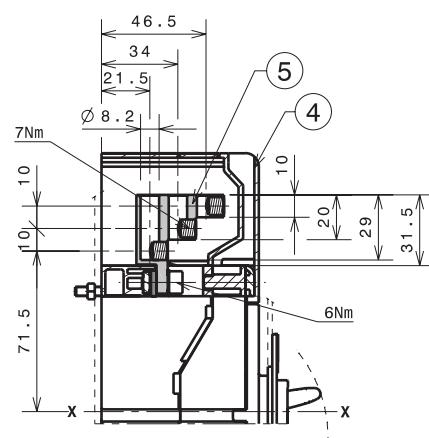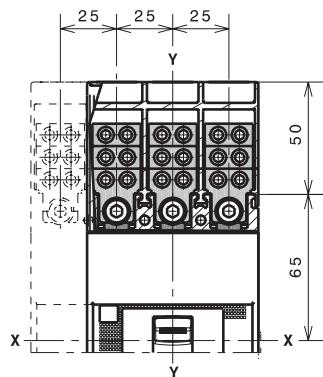

Tmax XT1 – Installation

Terminals for fixed circuit-breaker


Terminals R

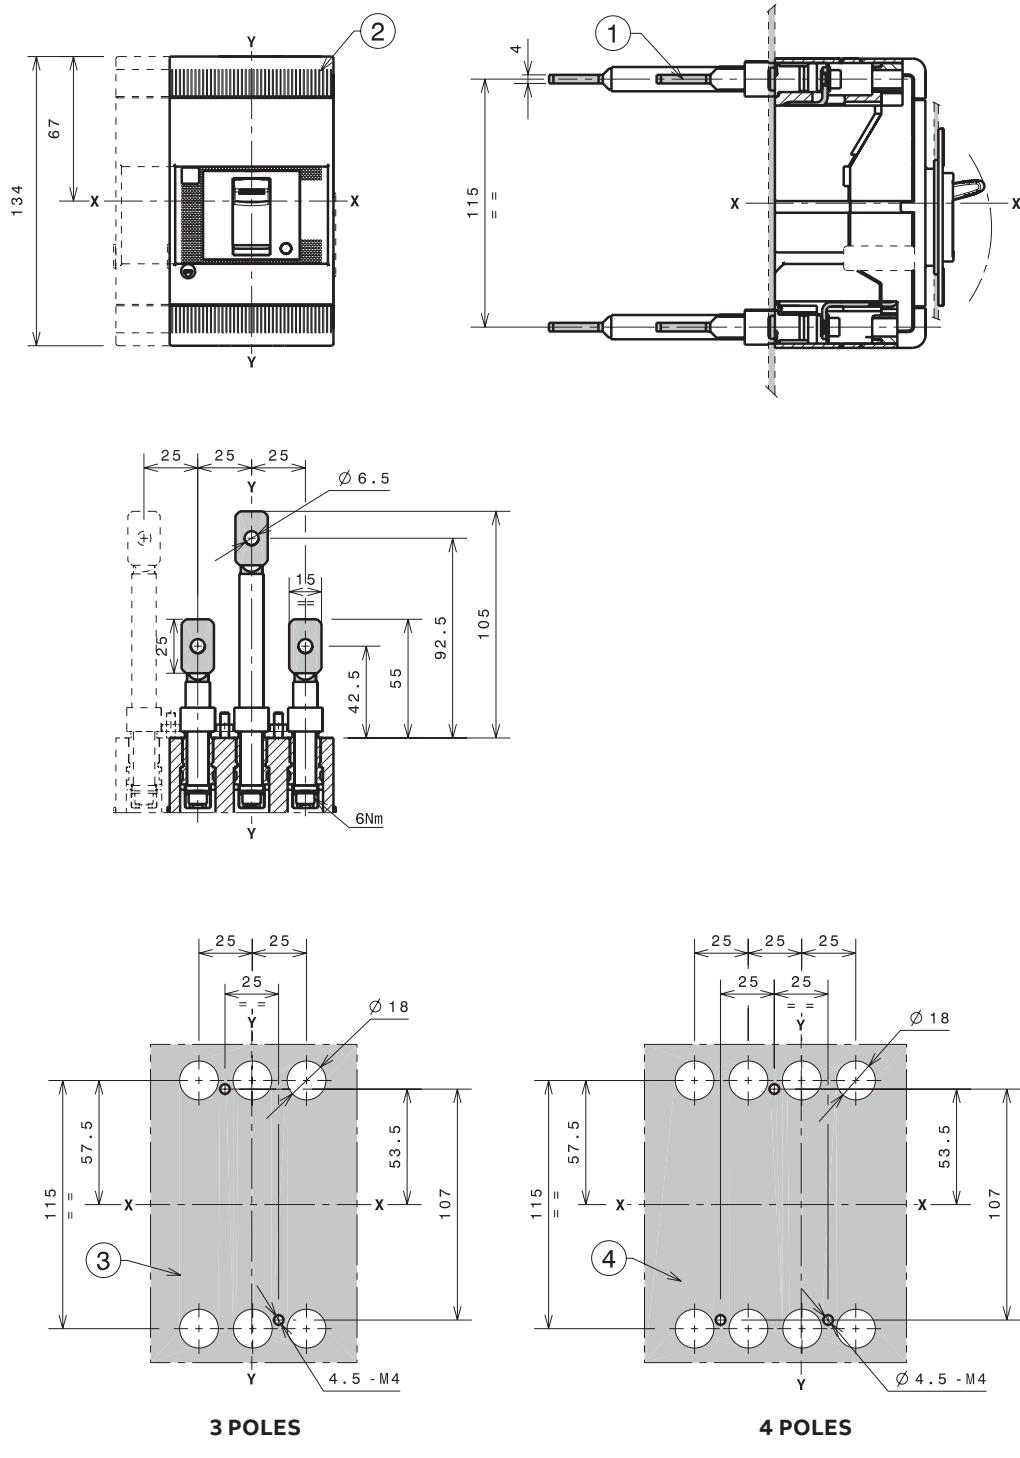

Tmax XT1 – Installation

Accessories for fixed circuit-breaker

Rotary handle operating mechanism on circuit-breakers (RHD)

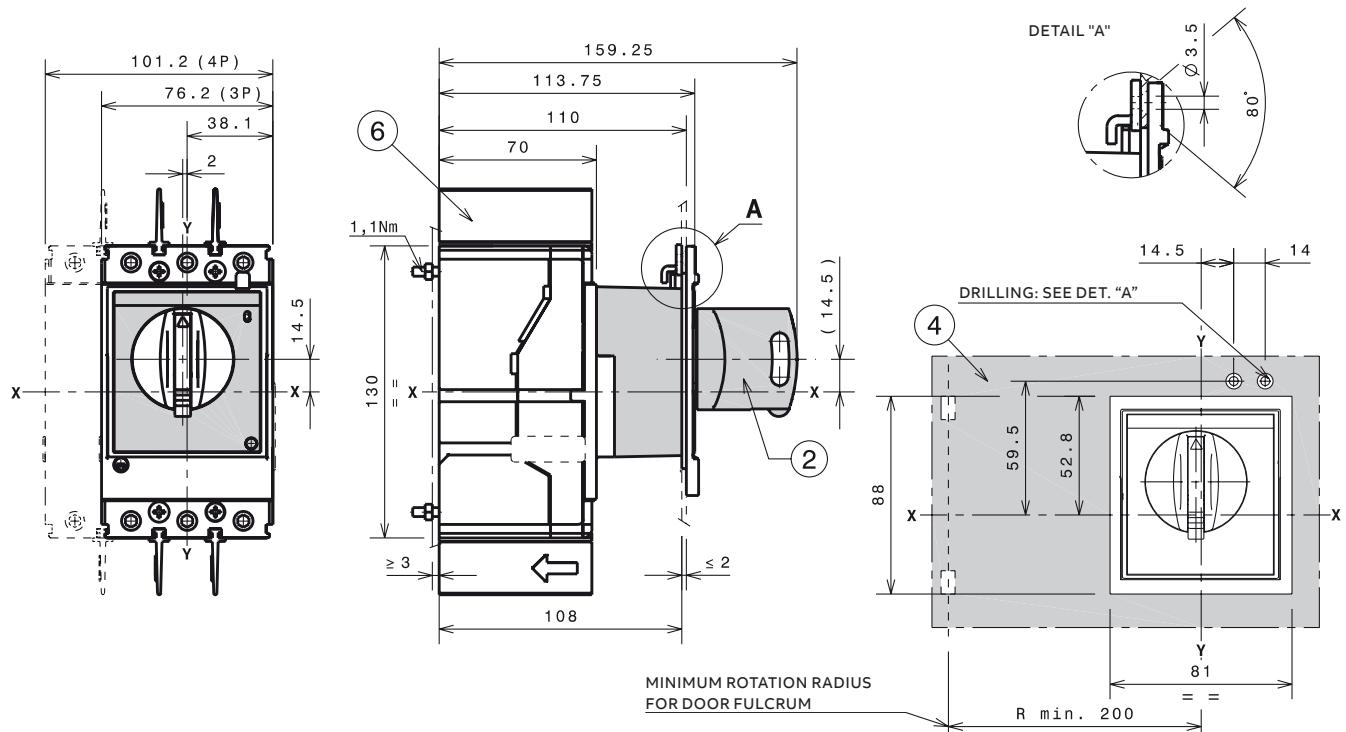


Key

- 2 Rotary handle operating mechanism on circuit-breaker RHD
- 4 Door drilling template with direct rotary handle
- 6 Phase separators 25mm

Tmax XT1 – Installation

Accessories for fixed circuit-breaker



Rotary handle operating mechanism on the compartment door (RHE)

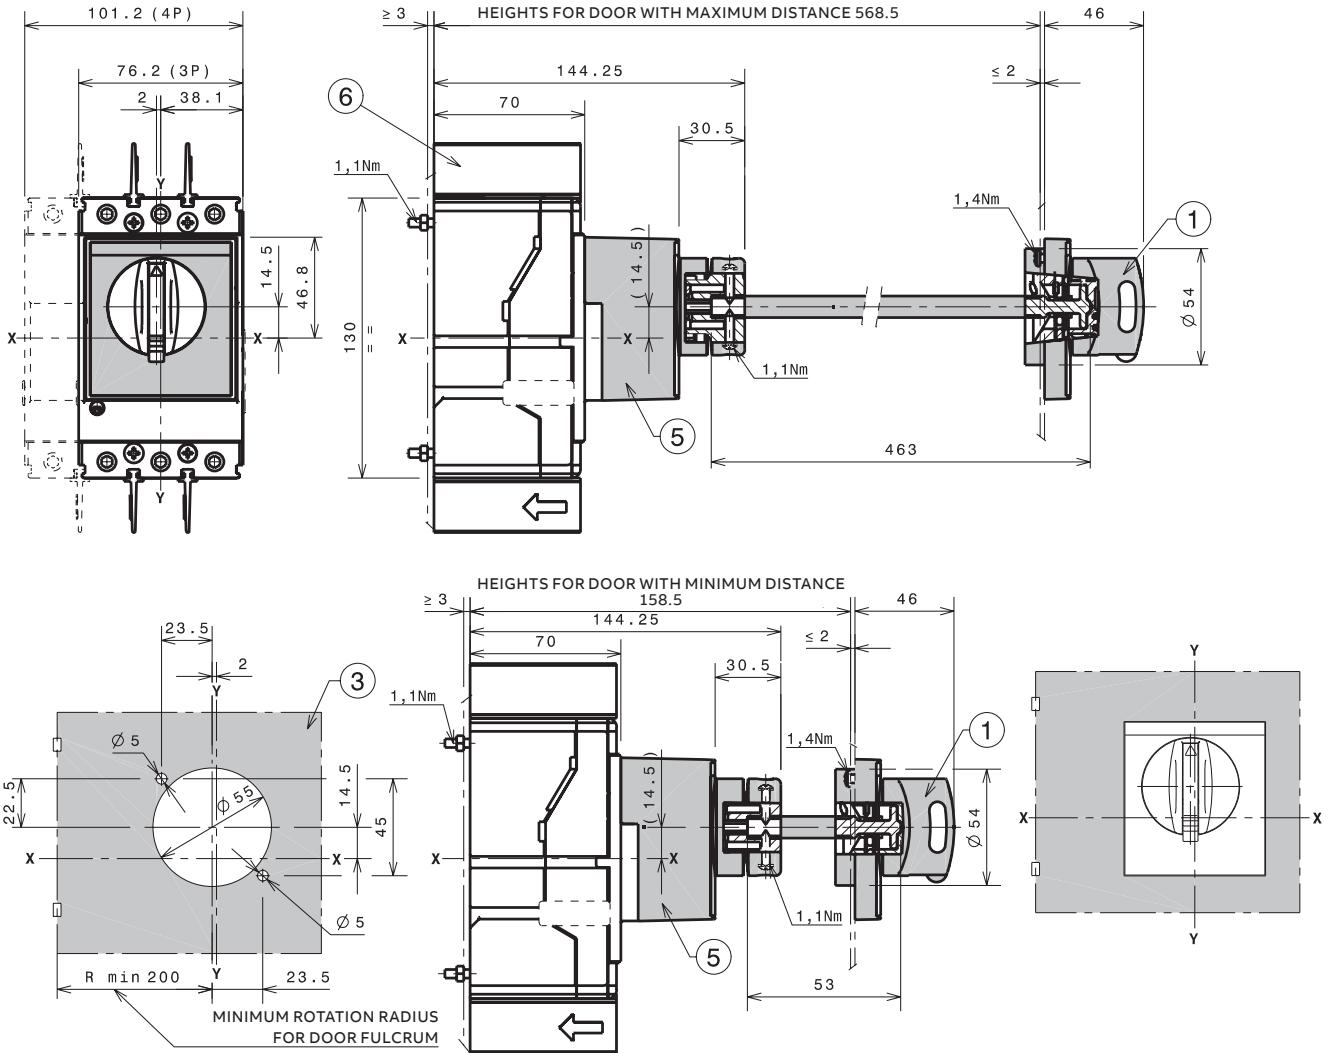

Key

- 1 Transmitted rotary handle
- 3 Door drilling template with transmitted rotary mandrel
- 5 Transmission unit
- 6 Phase separators 25mm

Large rotary handle operating mechanism on the compartment door (RHE-LH)

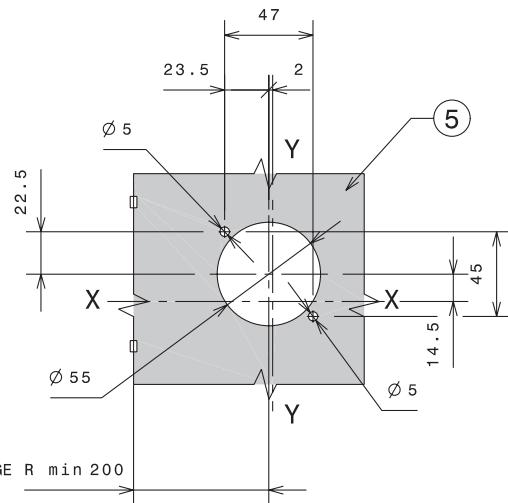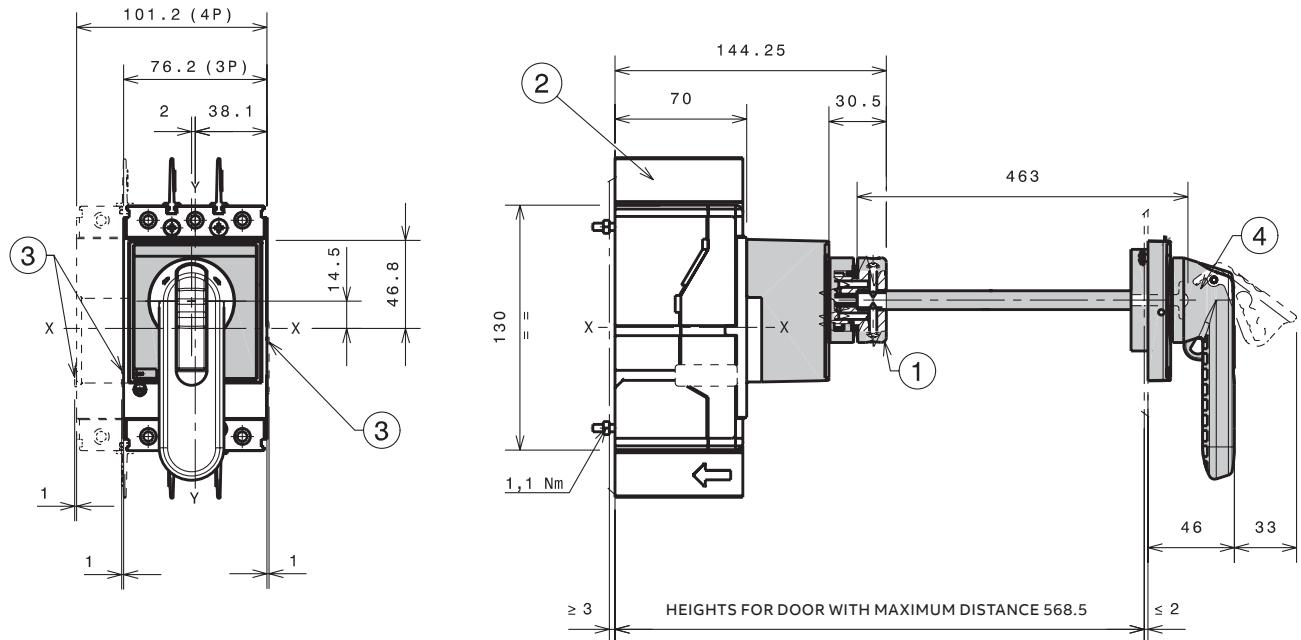


- Key
- 1 Transmission unit
 - 2 Phase separators
25mm
 - 3 Optional wiring ducts
 - 4 Wide type rotary handle
 - 5 Door drilling template with transmitted rotary handle

Tmax XT1 – Installation

Accessories for fixed circuit-breaker


Large rotary handle operating mechanism on the compartment door
(RHE-LH)

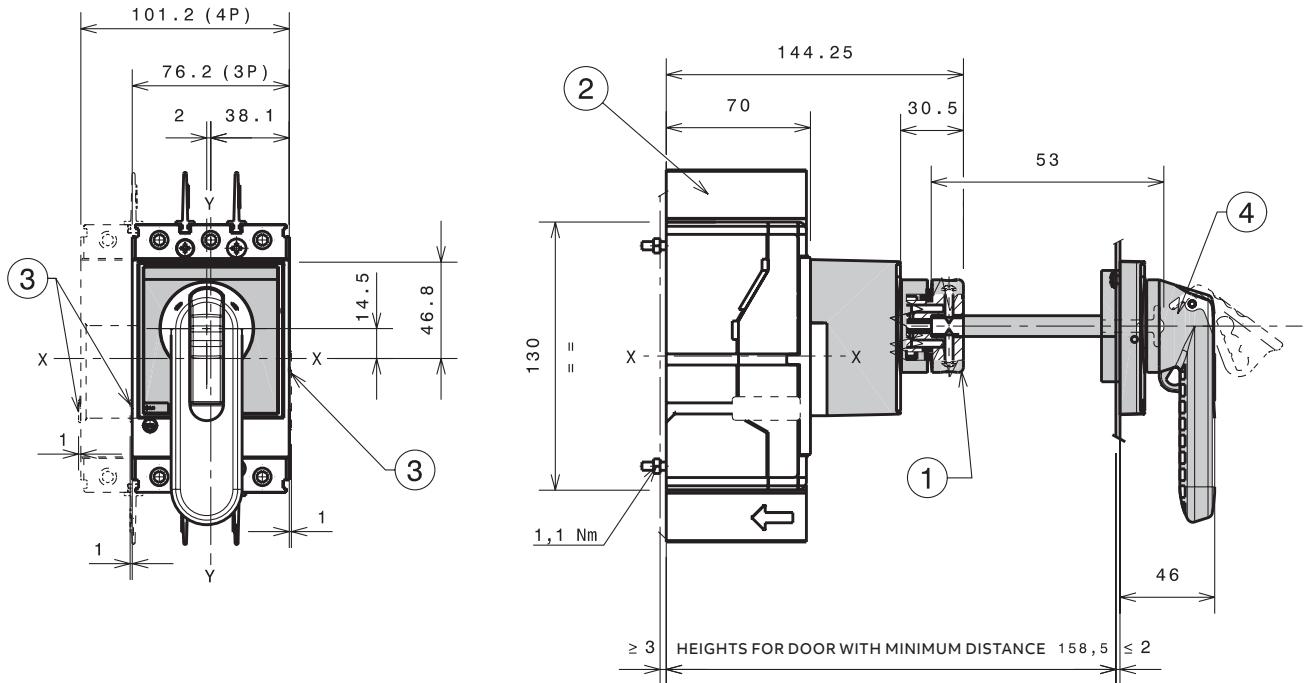

Key

- 1 Transmission unit
- 2 Phase separators
25mm
- 3 Optional wiring ducts
- 4 Wide type rotary
handle
- 5 Door drilling
template with
transmitted rotary
handle

Direct motor operator (MOD)

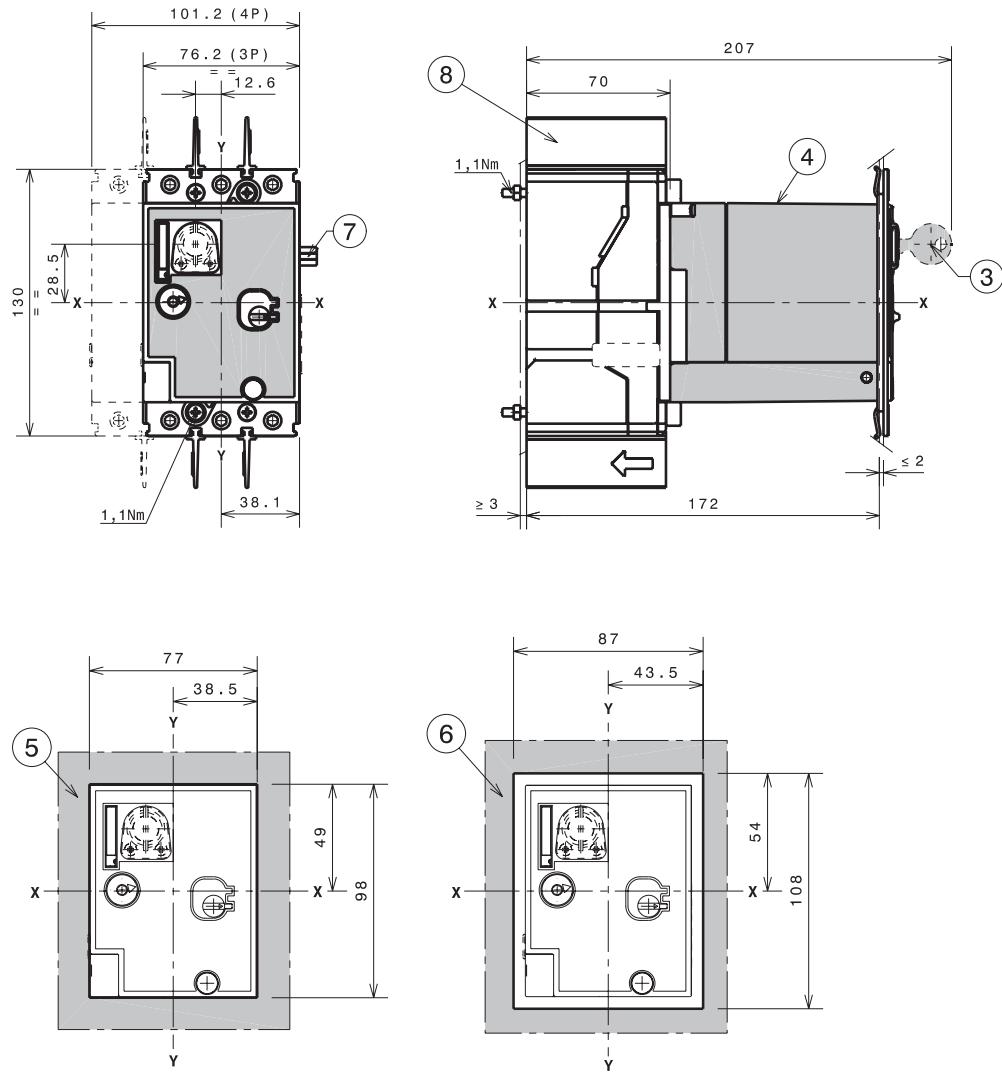


Key

- 3 Key lock
- 4 Direct motor operator (MOD)
- 5 Drilling template of door with MOD without flange
- 6 Drilling template of door with MOD with flange
- 7 Cables connection
- 8 Phase separators 25mm


Tmax XT1 – Installation

Accessories for fixed circuit-breaker

RC Inst and RC Sel residual current release for 3 poles circuit-breaker

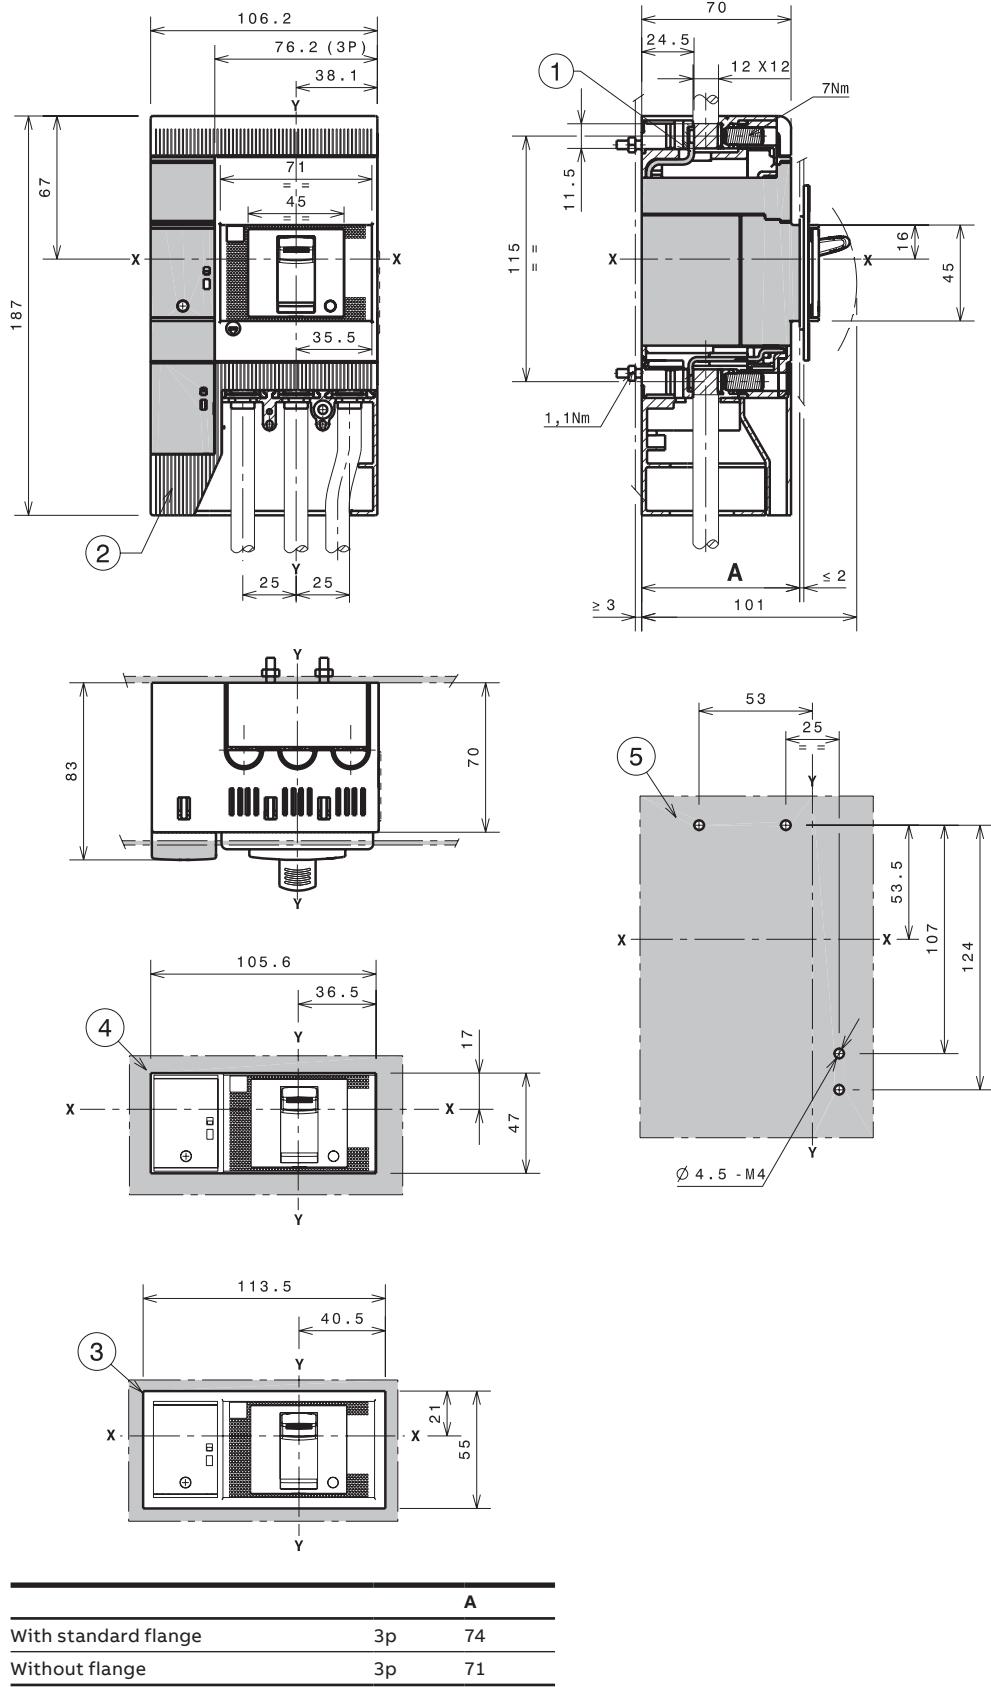


RC Inst and RC Sel residual current release for 4 poles circuit-breaker

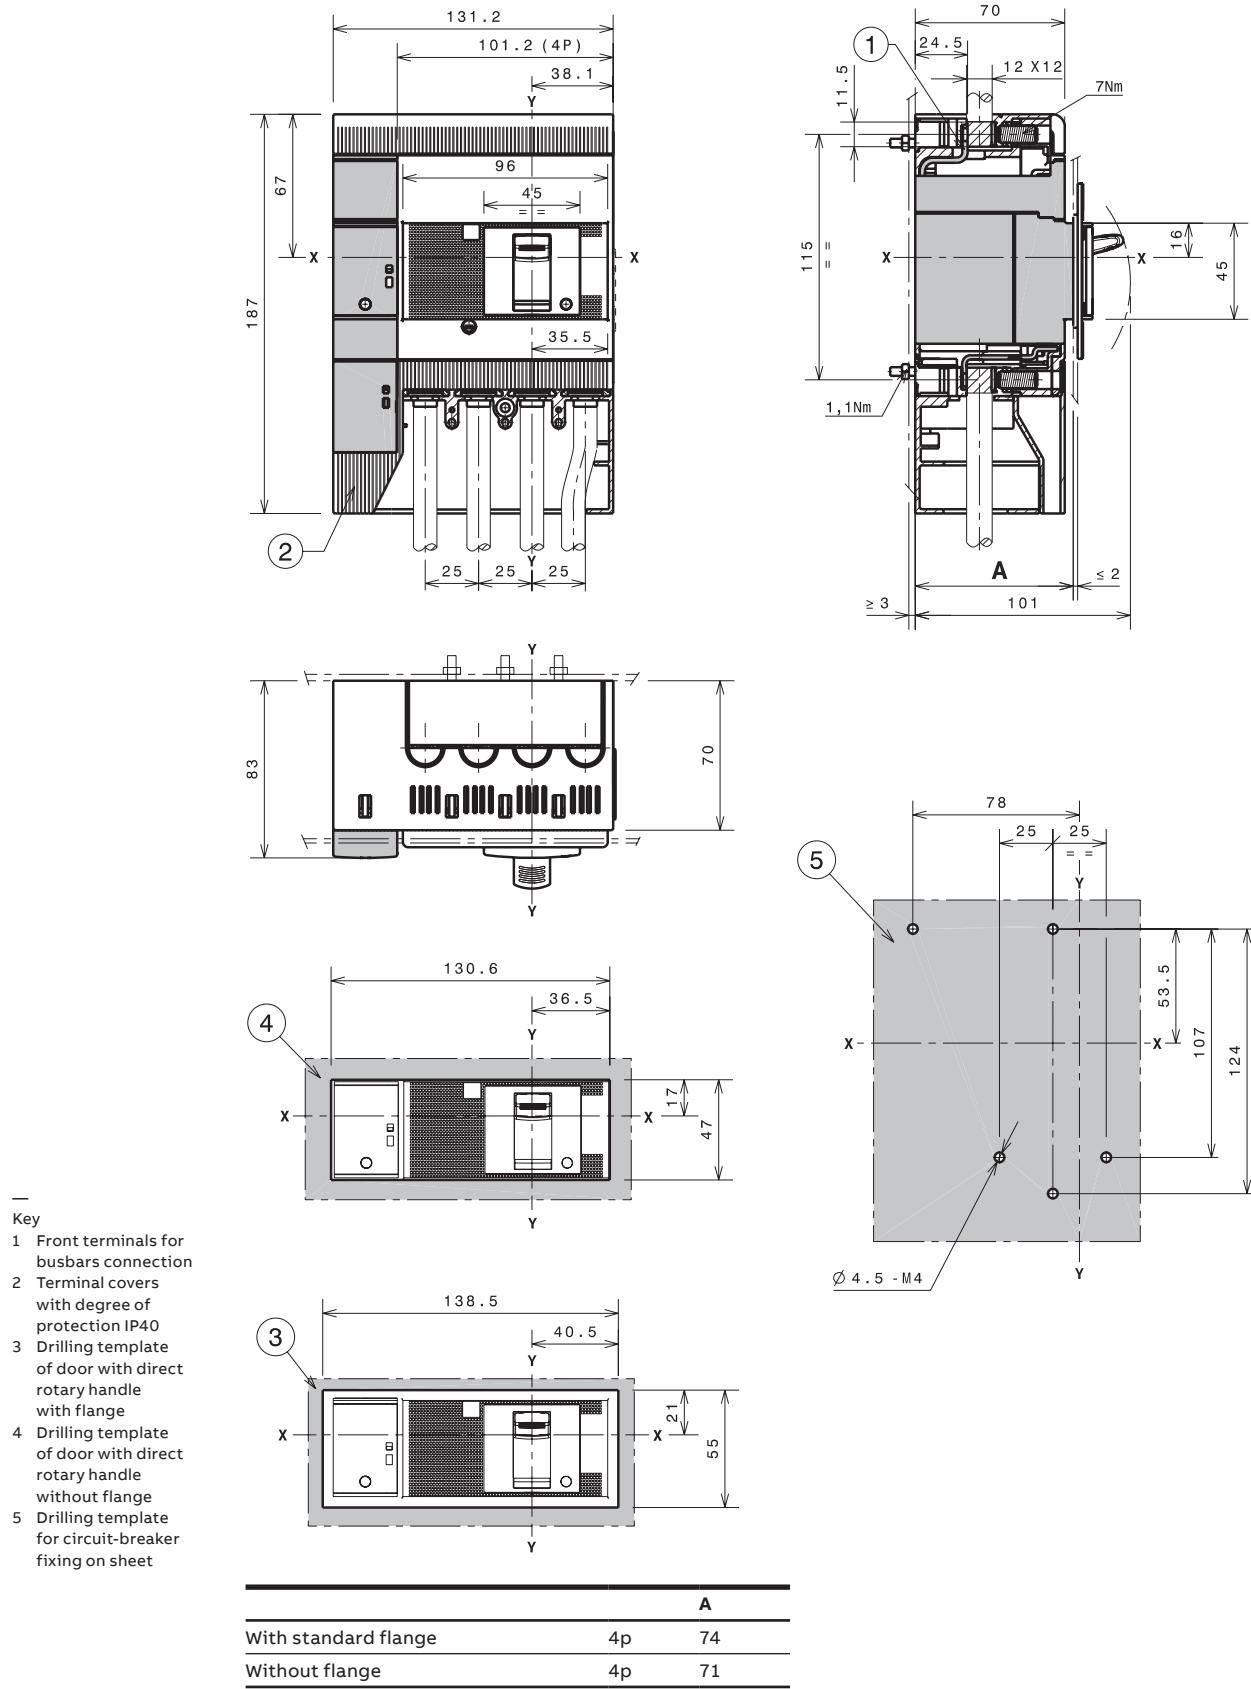

Tmax XT1 – Installation

Accessories for fixed circuit-breaker

RC Sel 200 4 poles residual current release

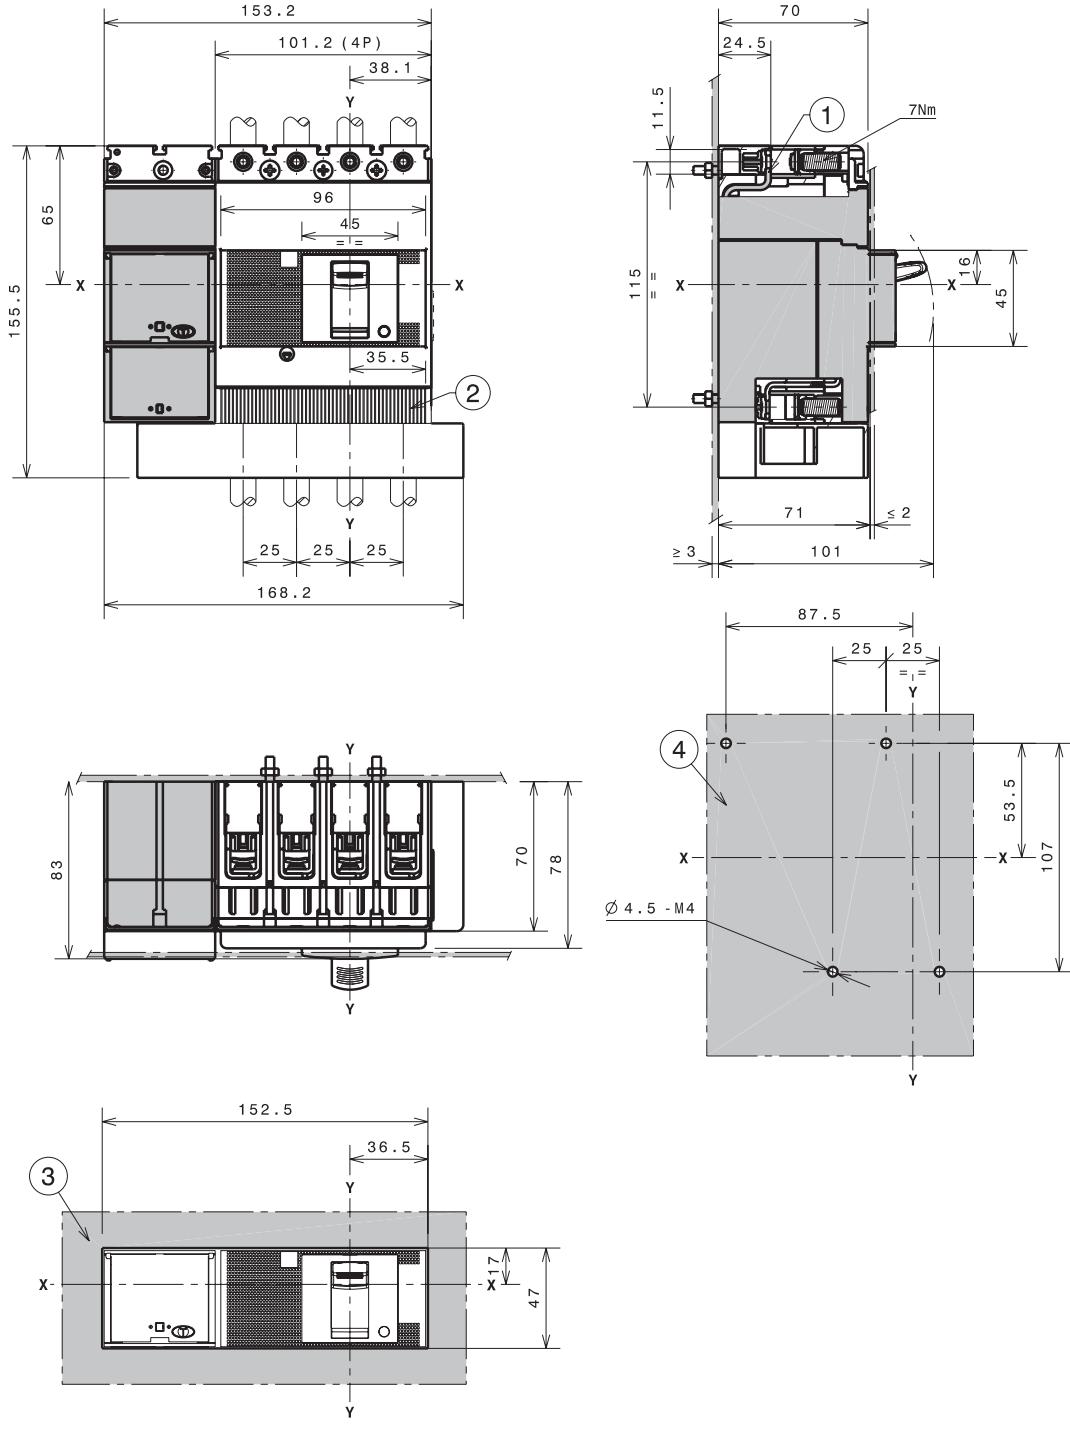


Tmax XT1 – Installation


Installation for plug-in circuit-breaker

Fixing on support sheet

| Key | |
|--------------------------------|-------------|
| 1 | Fixed part |
| 2 | Moving part |
| A | |
| With standard 3p-4p 124 flange | |
| Without flange | 3p-4p 121 |
| | 3p-4p 129 |
| A | |
| With standard 3p-4p 144 flange | |
| Without flange | 3p-4p 141 |
| | 3p-4p 149 |

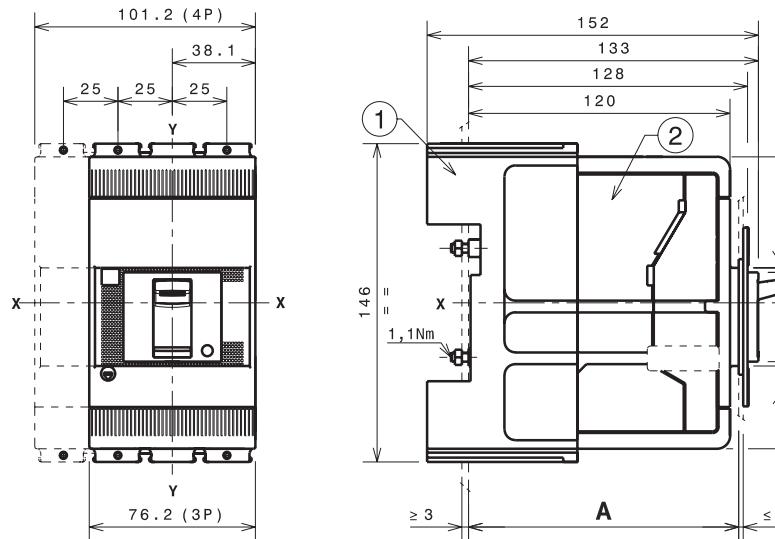






Drilling templates for fixing circuit-breaker

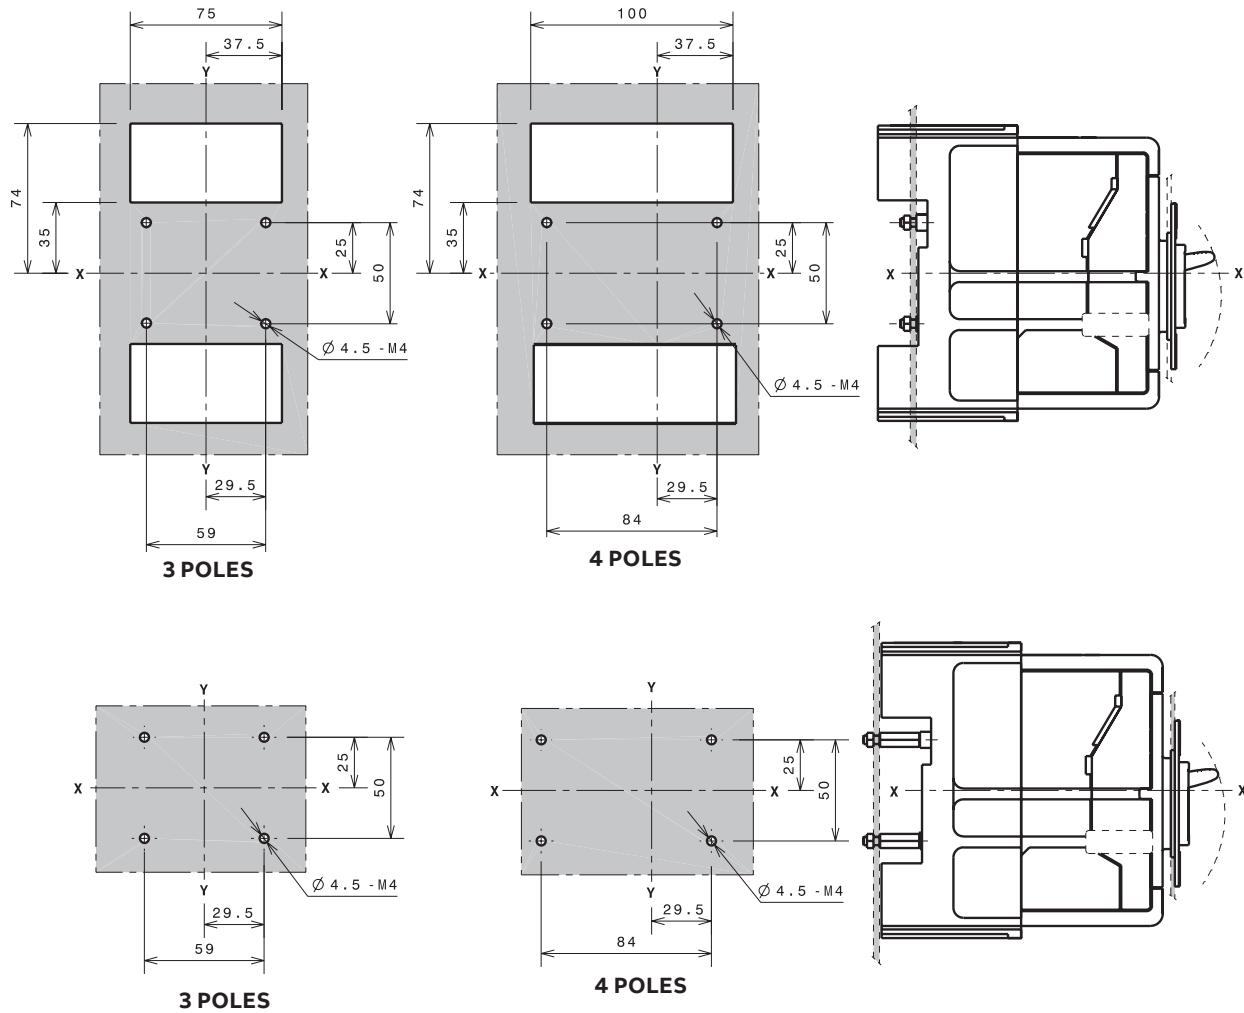

Tmax XT1 – Installation

Installation for plug-in circuit-breaker

Flanges

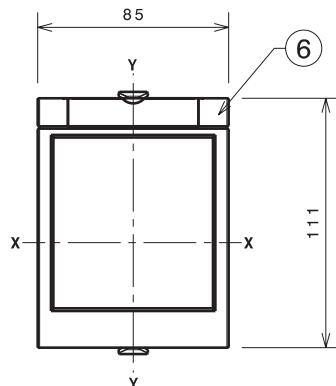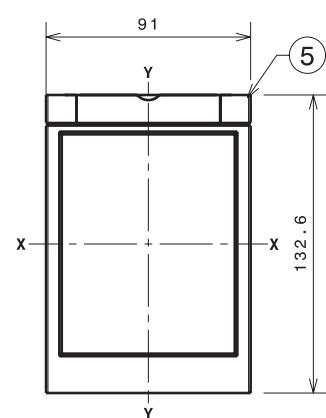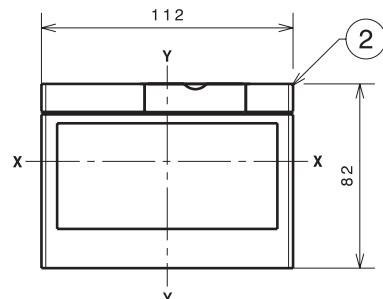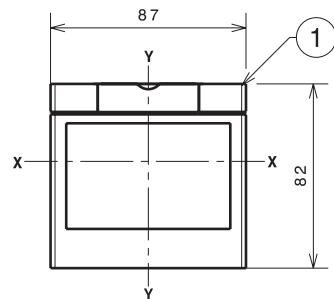


—

Key


- 1 Flange for plug-in circuit-breaker 3p
- 2 Flange for circuit-breaker 4p
- 5 Flange for plug-in circuit-breaker 3p-4p with direct motor operator (MOD)
- 6 Flange for plug-in circuit-breaker 3p-4p with direct rotary handle RHD
- 7 Optional flange

Compartment door drilling templates



With standard flange

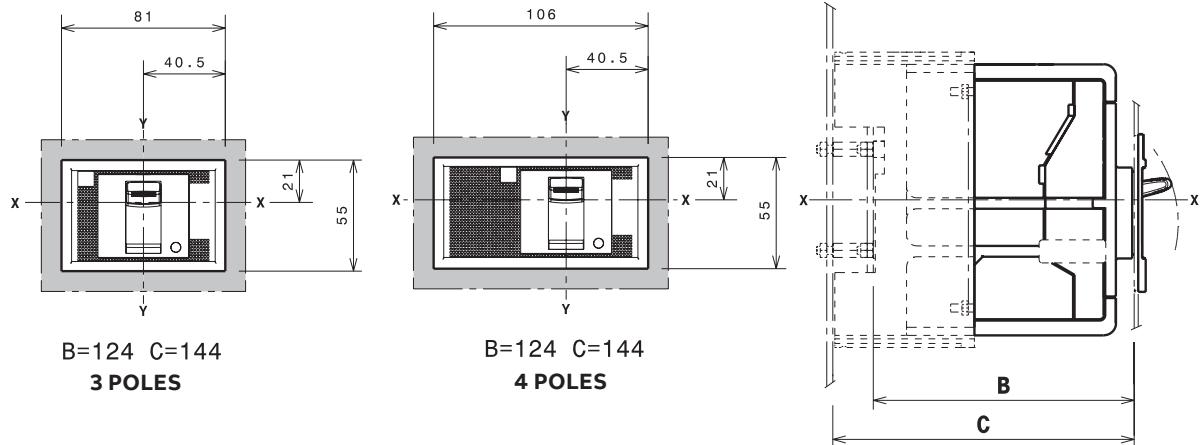

Without flange

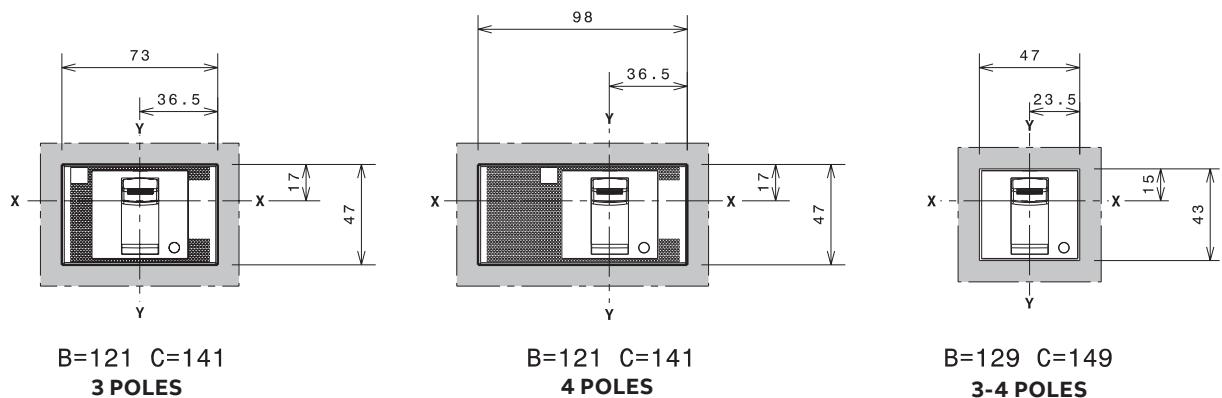




With optional flange

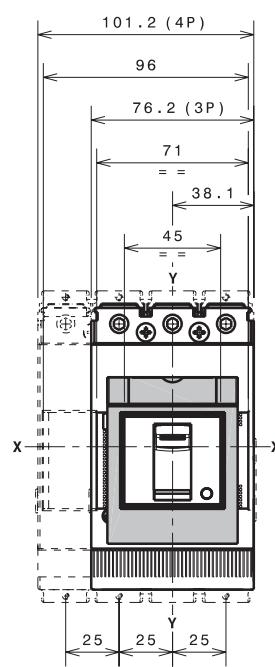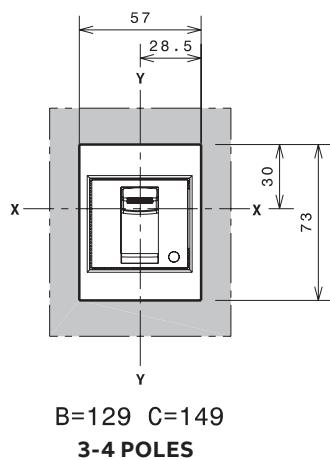

Tmax XT1 – Installation




Terminals for plug-in circuit-breaker

Terminals EF

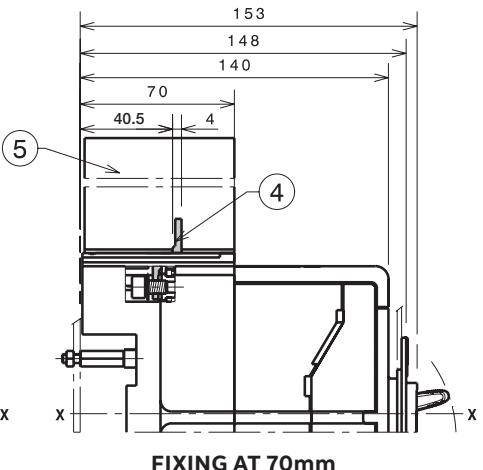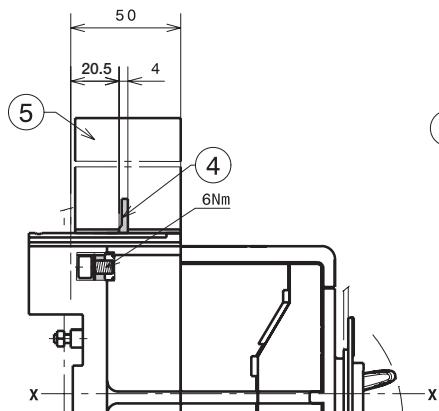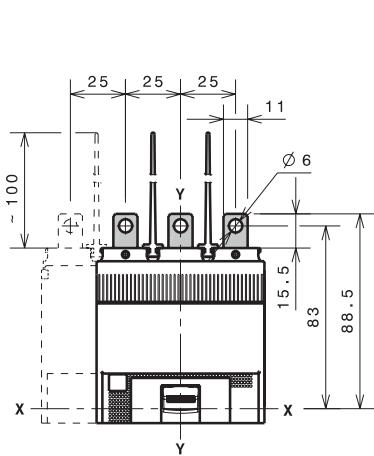

Key
 4 Front extended terminals
 5 Phase separators 100mm



Terminals ES

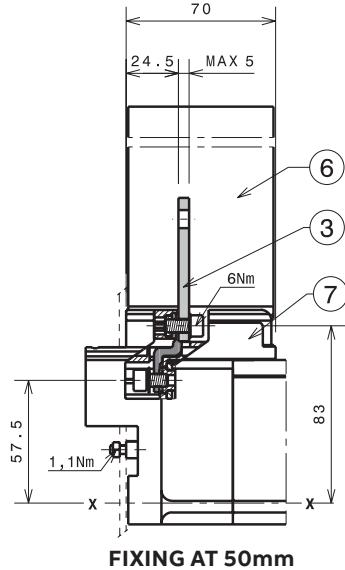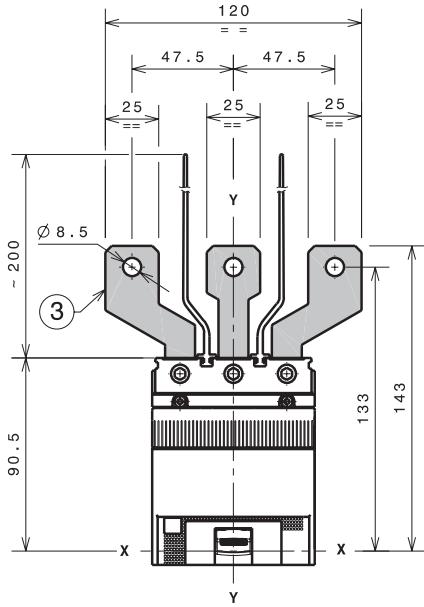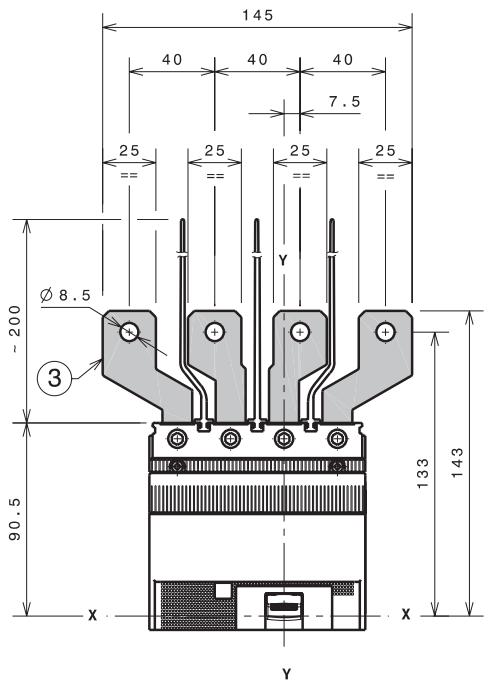

Key
 3 Front extended spread terminals
 6 Phase separators 200mm
 7 Adaptor

1x1.5...50mm² terminals FCCuAl



—
Key
1 1x1.5...50mm² front terminal FCCuAl
5 Adaptor
6 Phase separators 25mm

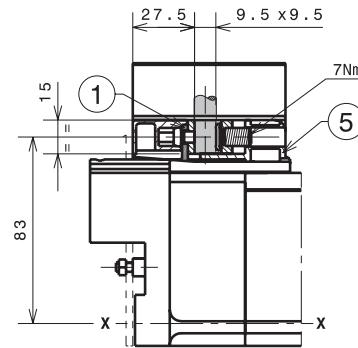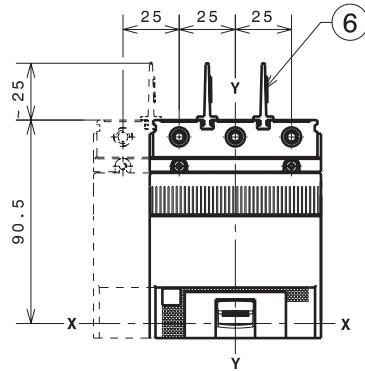

FIXING AT 50mm



1x35...95mm² terminals FCCuAl

—
Key
1 External terminal FCCuAl
2 High terminal covers with degree of protection IP40

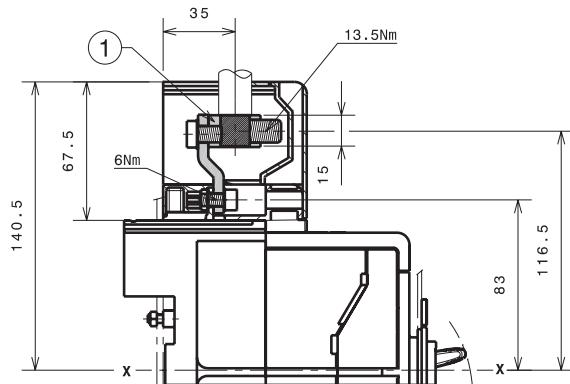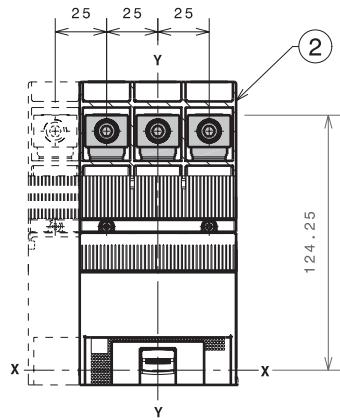

Terminals FCCu

—
Key
4 Terminals FCCu
5 Adaptor
6 Phase separators 25mm

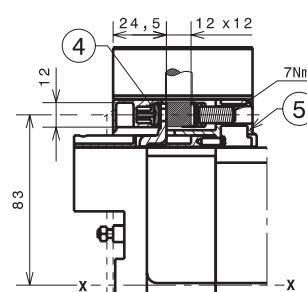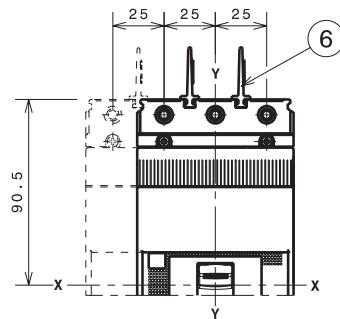



FIXING AT 50mm

Tmax XT1 – Installation

Terminals for plug-in circuit-breaker




Terminals MC

Key
 2 Terminal covers
 with degree of
 protection IP40
 3 Front terminal
 for multicable
 connection
 5 Adaptor

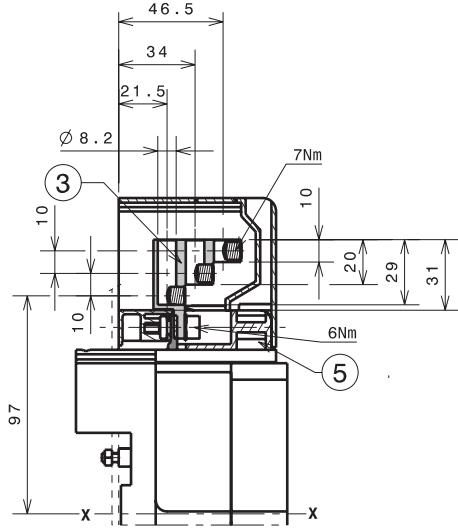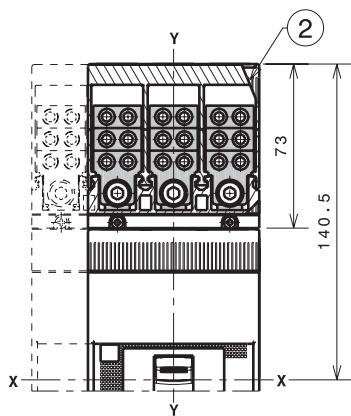



FIXING AT 50mm

Terminals HR/VR

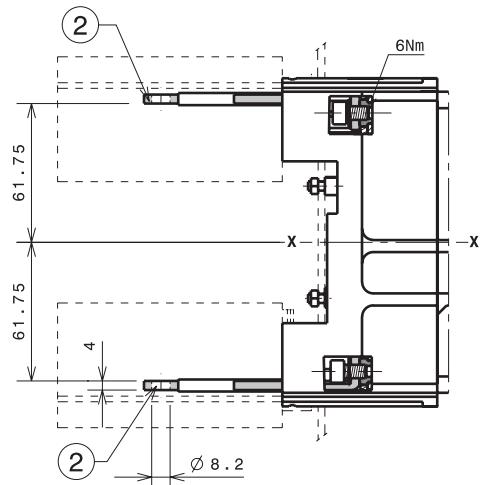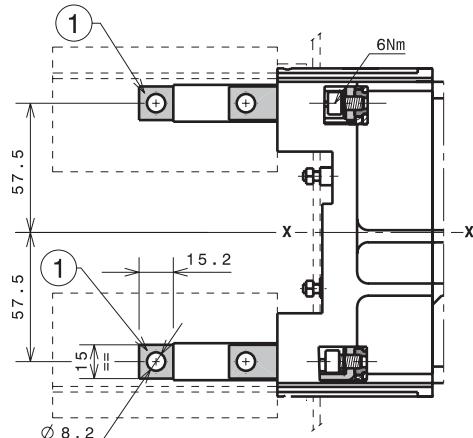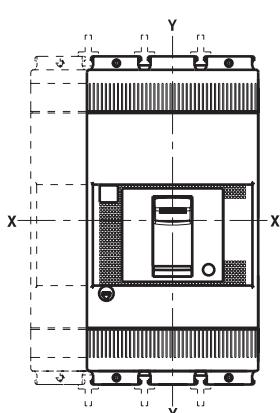

FIXING AT 50mm



Key
 1 Rear vertical
 terminals
 2 Rear horizontal
 terminals
 3 Rear phase
 separators 90mm

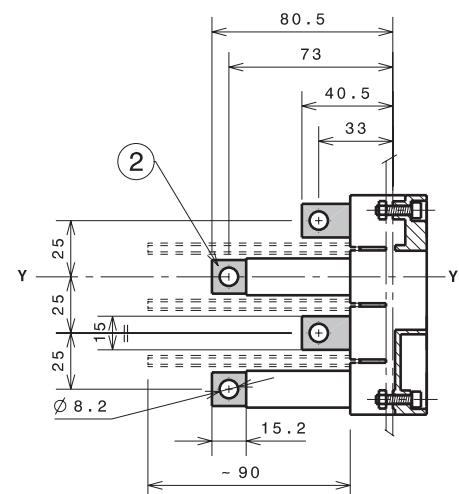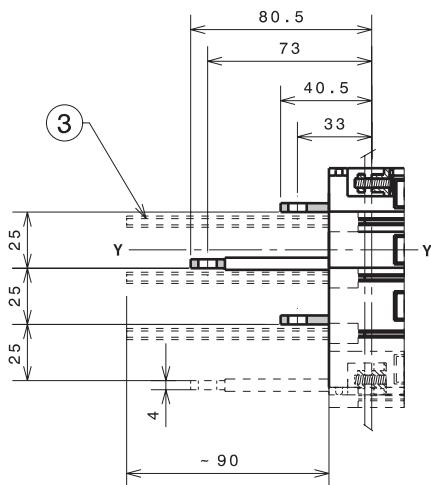

Tmax XT1 – Installation

Accessories for plug-in circuit-breaker

Direct motor operator (MOD)

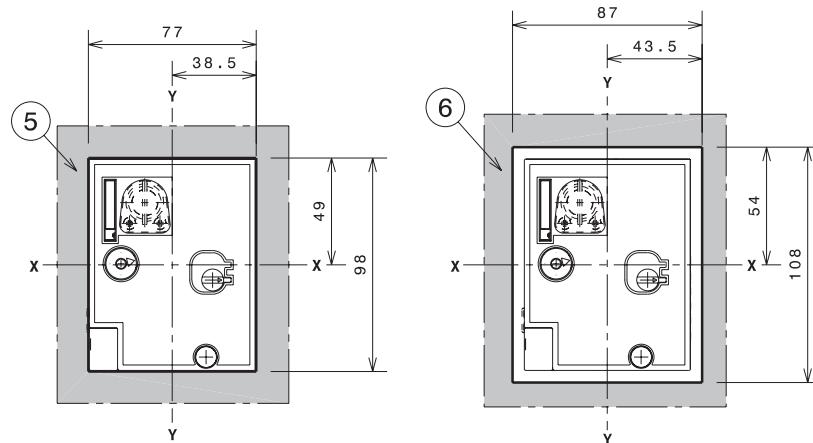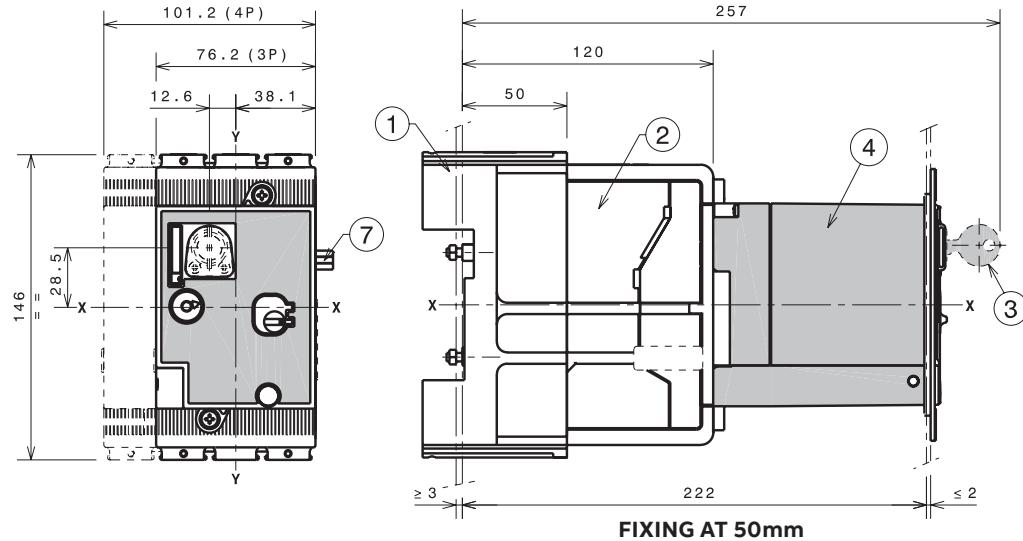

Key

- 1 Fixed part
- 2 Moving part
- 3 Key lock
- 4 Direct motor operator (MOD)
- 5 Drilling template of door with MOD without flange
- 6 Drilling template of door with MOD with flange
- 7 Cable connection


Tmax XT2 – Installation

Installation for fixed circuit-breaker

Fixed circuit-breaker fixing on sheet


Key
 2 Optional wiring ducts
 3 Phase separators
 25mm

A
 With standard 3p-4p 86 flange
 Without flange 3p-4p 83.5
 3p-4p 91.5

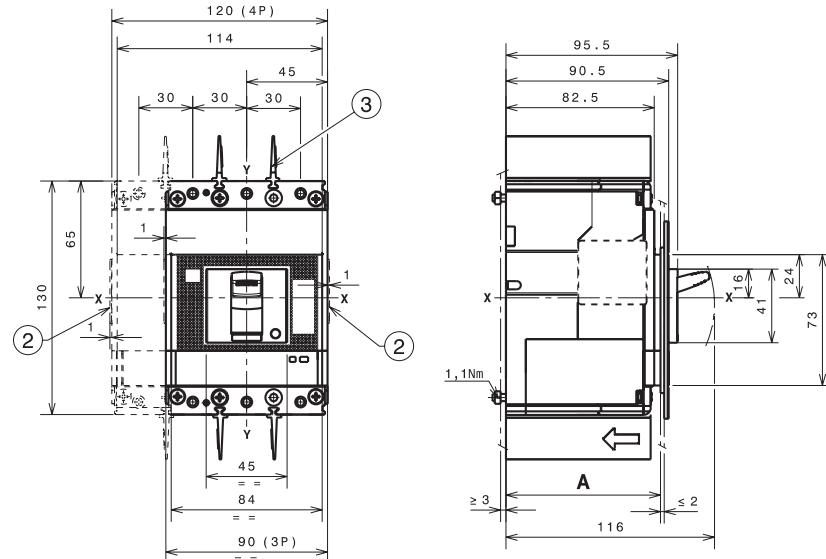


With side connector for Ekip Touch trip units

Key
 1 Front terminals
 2 Flange for 4p circuit-breaker
 3 Flange for 3p circuit-breaker
 7 Tightening torque 1,1 Nm - 10 In.Lbs
 8 Tightening torque 6 Nm - 53 In.Lbs
 9 Optional wiring duct
 10 Phase separators 25mm
 11 Rear plate insulating 3p (UL version only)
 12 Rear plate insulating 4p (UL version only)
 15 Connection kit F/P IntBus/ExtNeut/Sel

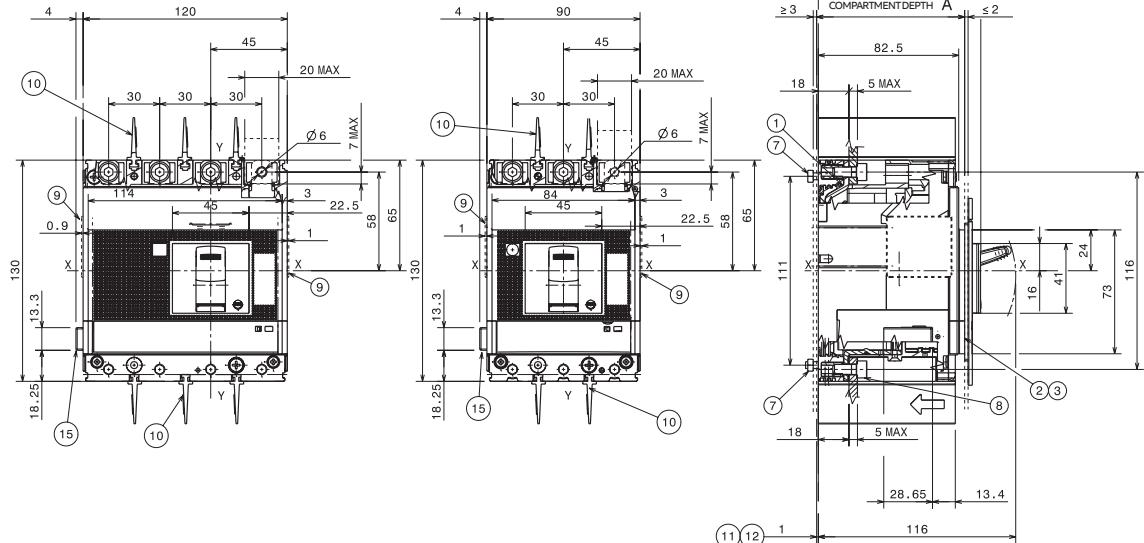


Key
 1 Bracket for fixing
 3 Phase separators 25mm


Fixed circuit-breaker fixing on DIN EN 50022 rail

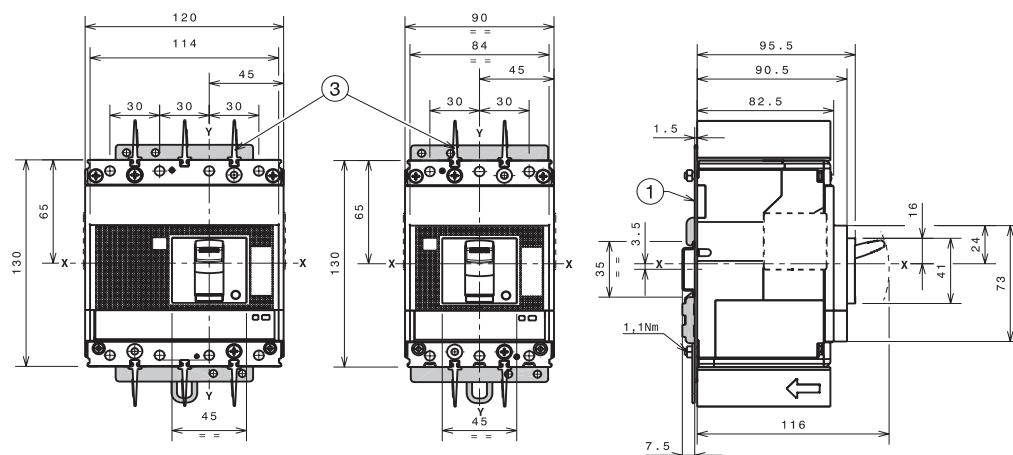


Drilling templates and support sheet

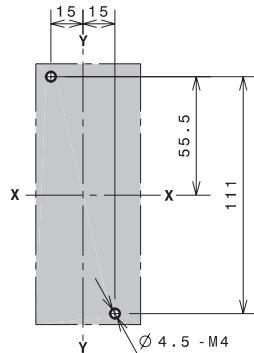







3 POLES

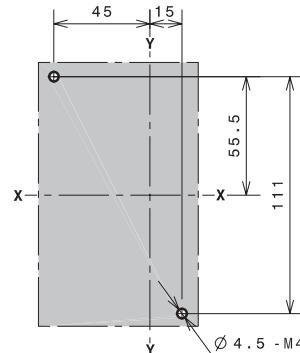

4 POLES

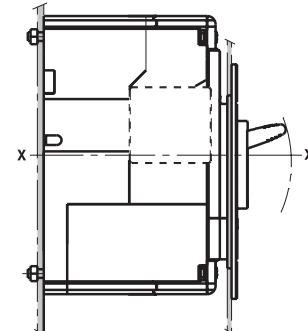

Flanges

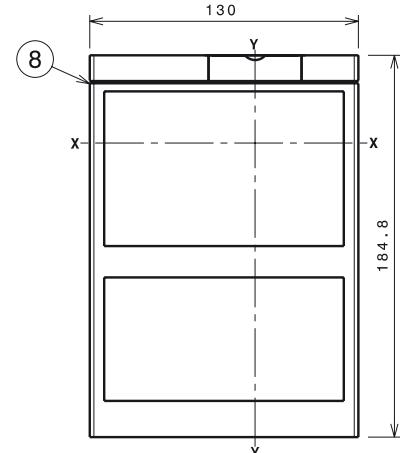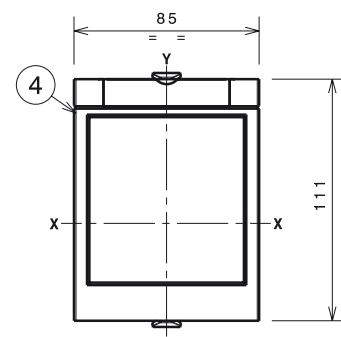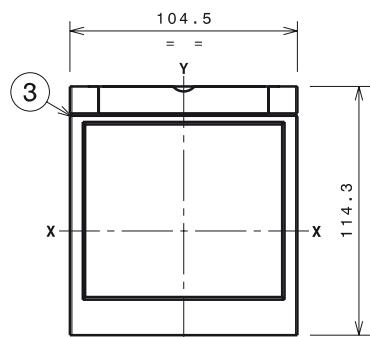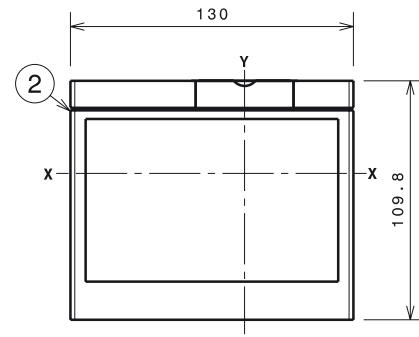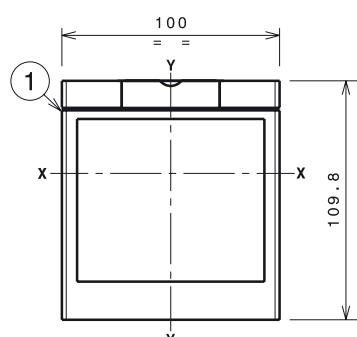

Key


- 1 Flange for fixed circuit-breaker 3p
- 2 Flange for fixed circuit-breaker 4p
- 3 Flange for fixed circuit-breaker 3p-4p with MOE and FLD
- 4 Flange for circuit-breaker 3p-4p with direct rotary handle RHD
- 8 Flange for circuit-breaker 4p with fixed residual current and front terminals
- 9 Optional flange

Tmax XT2 – Installation


Installation for fixed circuit-breaker

Compartment door drilling templates

With standard flange

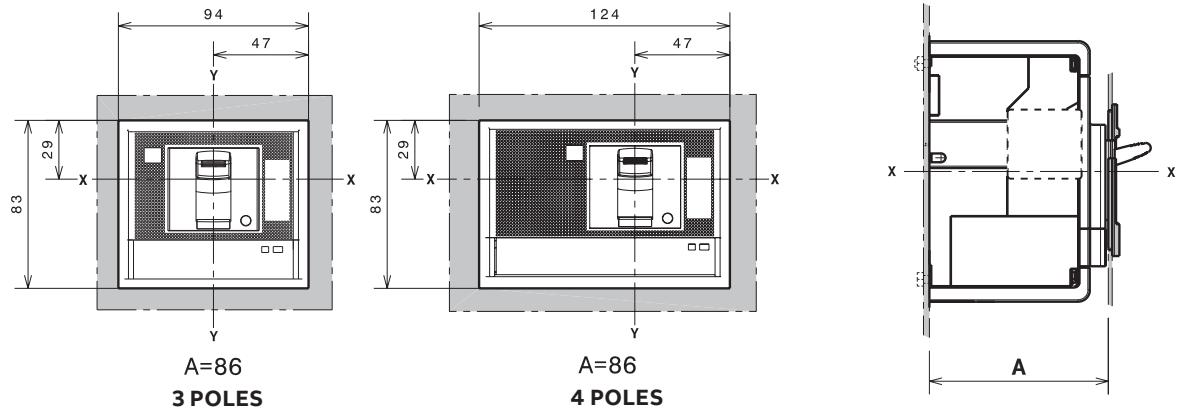


Without flange

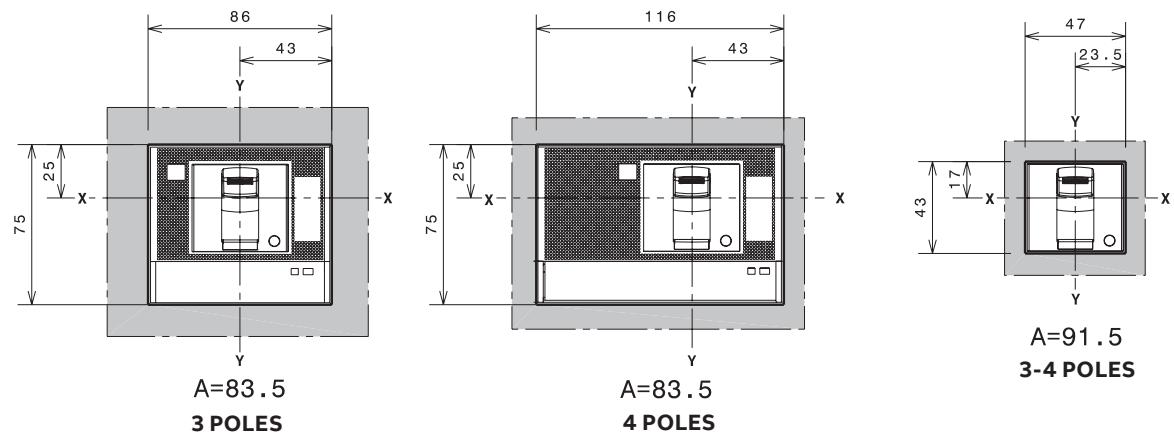


With optional flange

Key
1 Optional flange

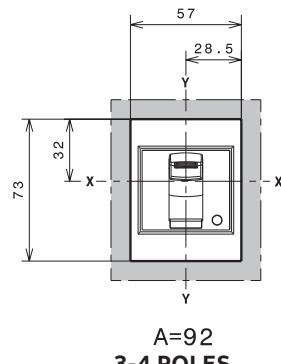

| | Execution | A | B | C |
|----------------------|-------------------------|-----|-----------|---|
| With fixed flange | fixed | 92 | 3-4 poles | |
| With optional flange | plug-in, fixing at 50mm | 142 | 3-4 poles | |
| With optional flange | plug-in, fixing at 70mm | 162 | 3-4 poles | |

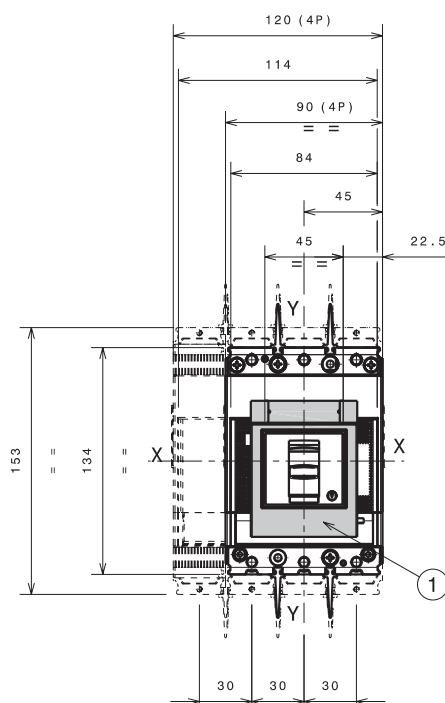


Tmax XT2 – Installation

Terminals for fixed circuit-breaker


Terminals F

- Key
1 Phase separators
25mm
2 Front terminals for
busbars connection

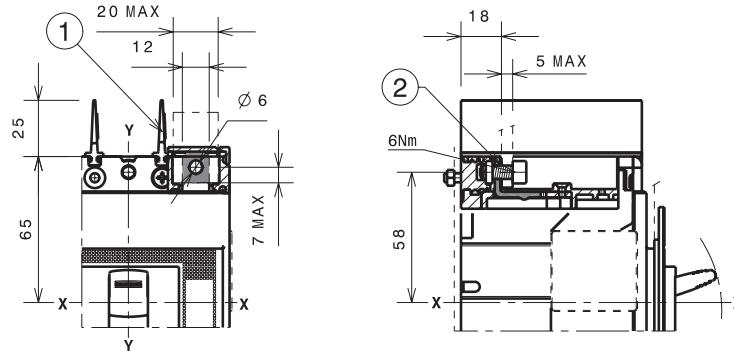

Terminals EF



- Key
3 Front extended
terminals
4 Terminal covers
with degree of
protection IP40
5 Phase separators
100mm
6 Insulated plate
7 Drilling template for
3p circuit-breaker
Ue>440V
8 Drilling template
for 4p circuit-
breaker Ue>440V

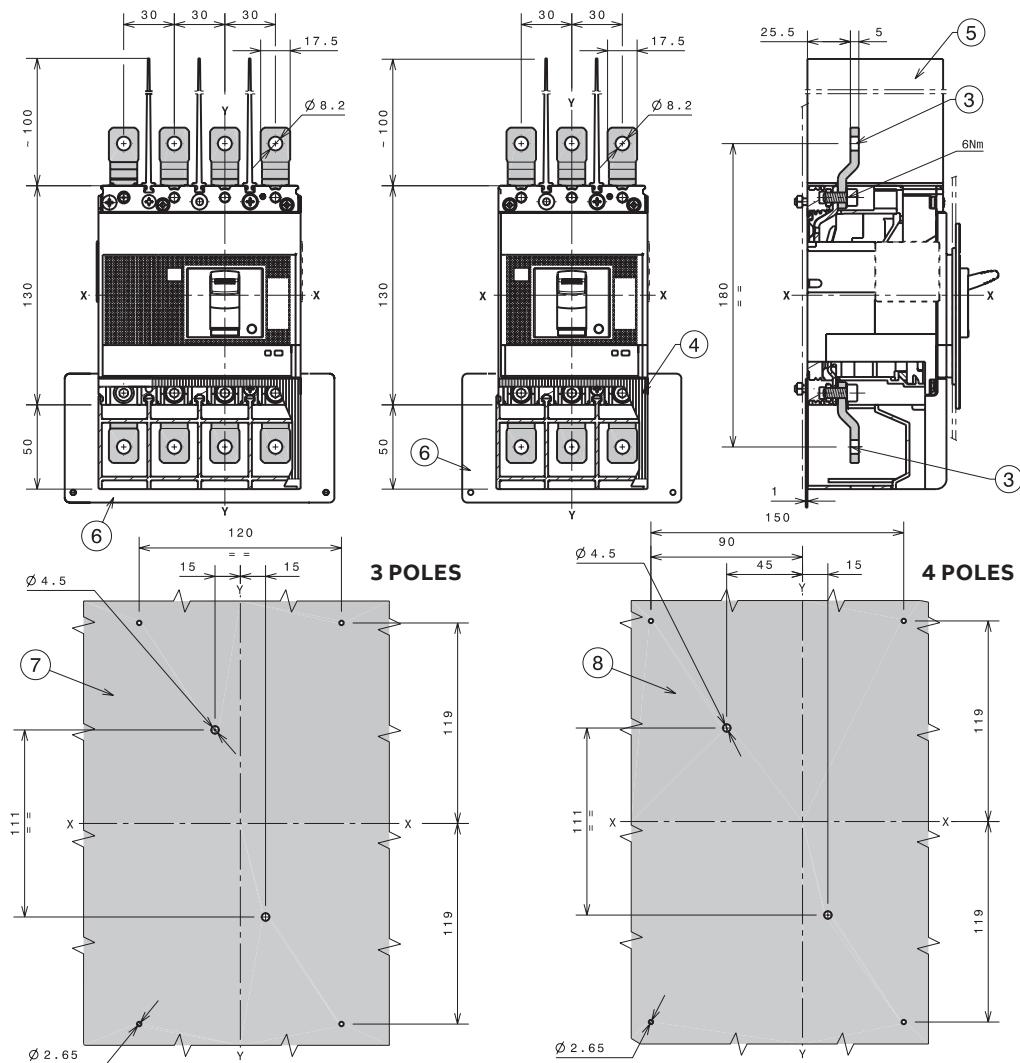

Tmax XT2 – Installation



Terminals for fixed circuit-breaker

Terminals ES


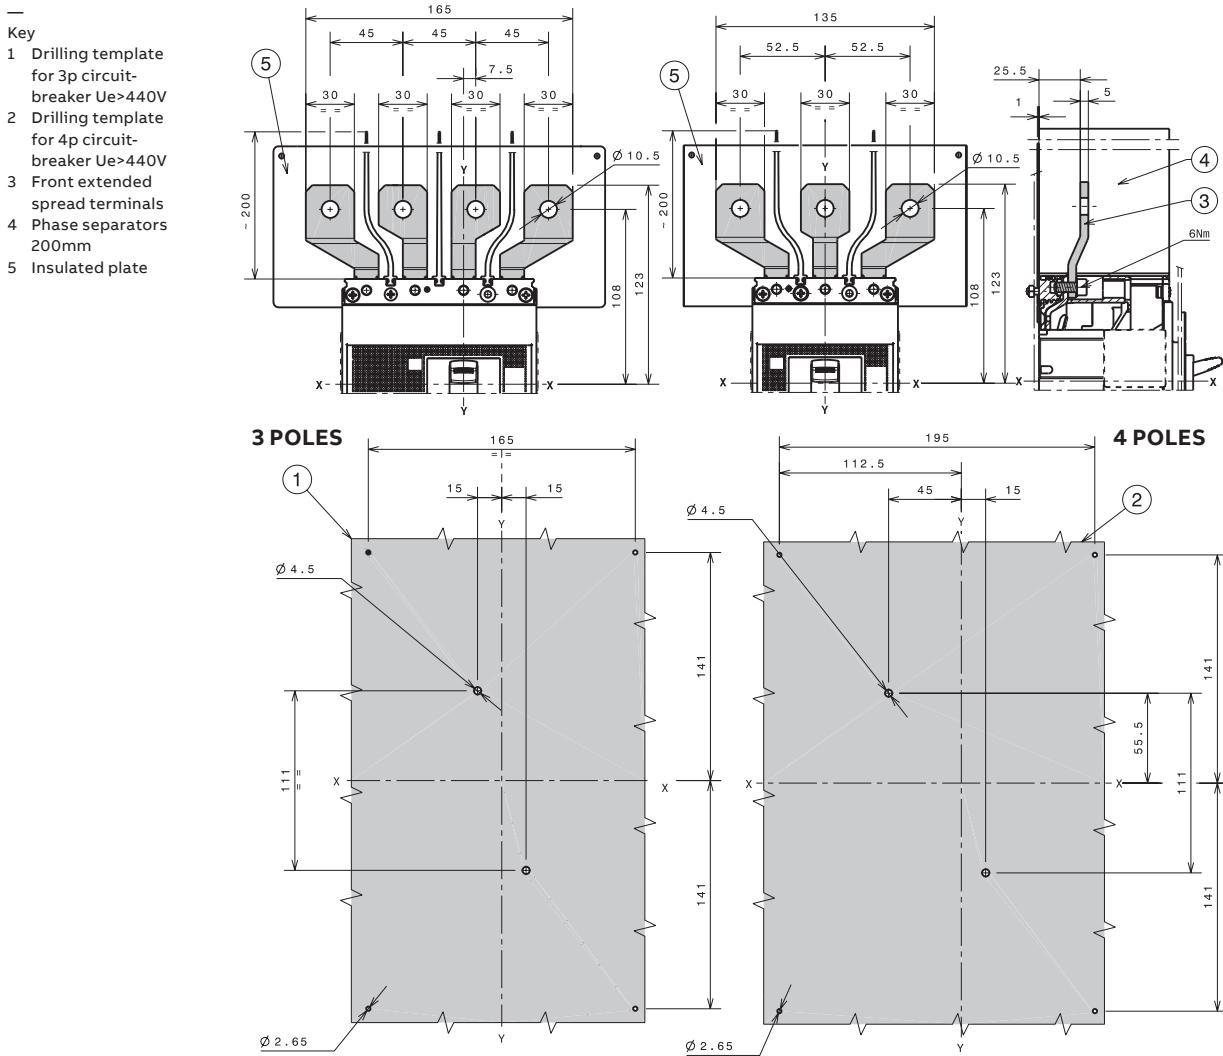
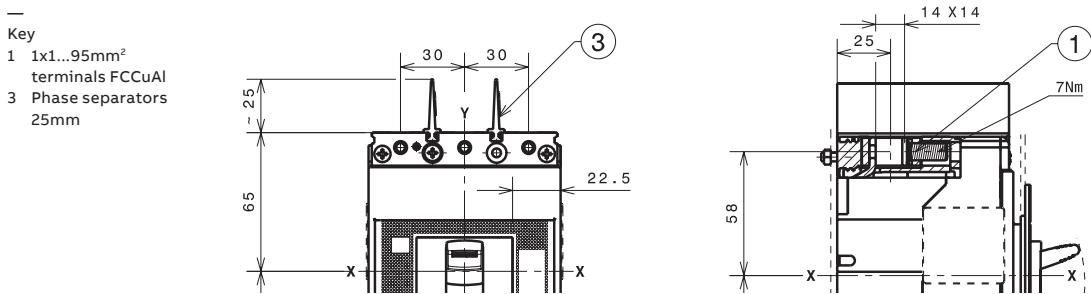
1x1...95mm² terminals FCCuAl

1x70...185mm² terminals FCCuAl

- Key
 1 External terminal FCCuAl
 2 High terminal covers with degree of protection IP40

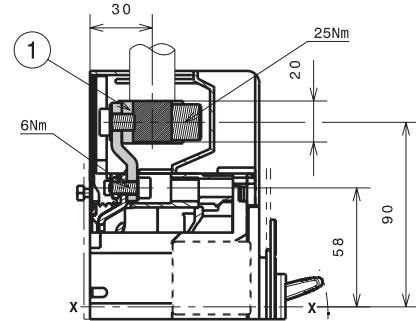
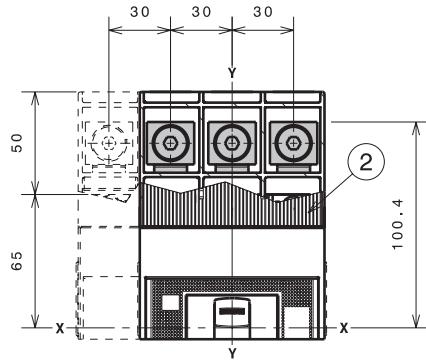
2x35...70mm² terminals FCCuAl

- Key
 2 2x35...70mm² terminals FCCuAl
 4 Terminal covers with degree of protection IP40

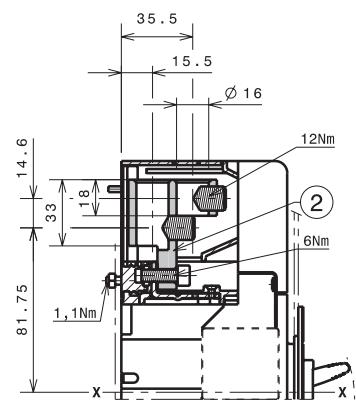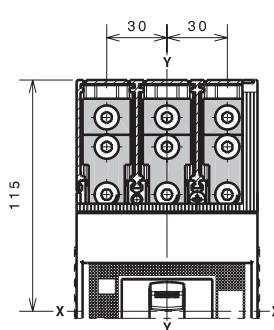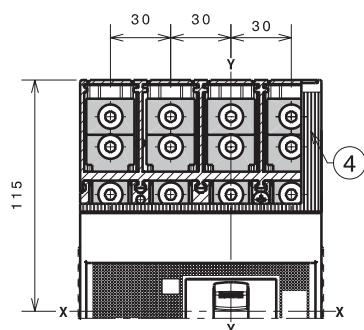

Terminals FCCu



- Key
 3 Phase separators 25mm
 6 Terminals FCCu

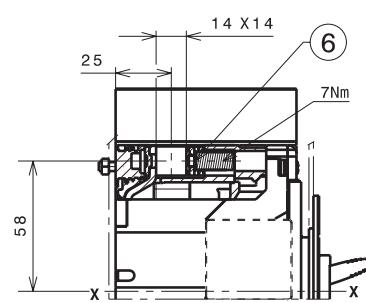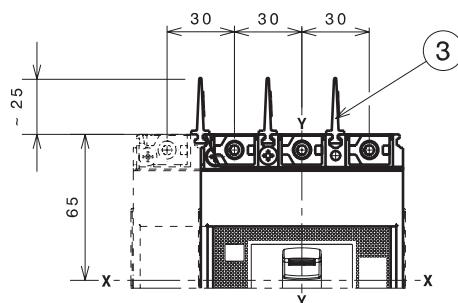






Tmax XT2 – Installation

Terminals for fixed circuit-breaker

Terminals MC

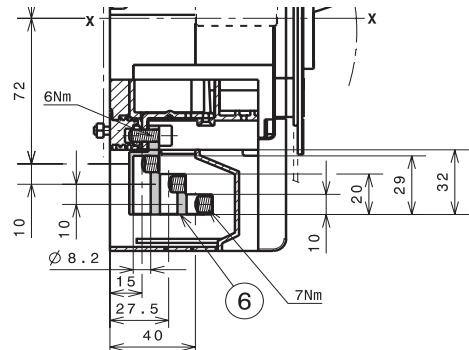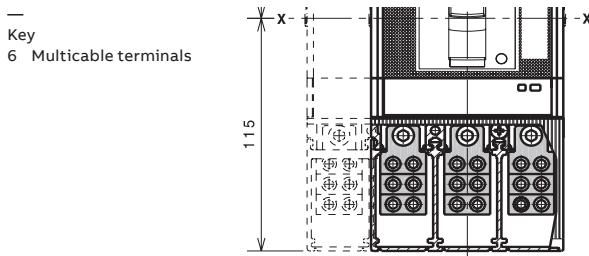


Terminals R

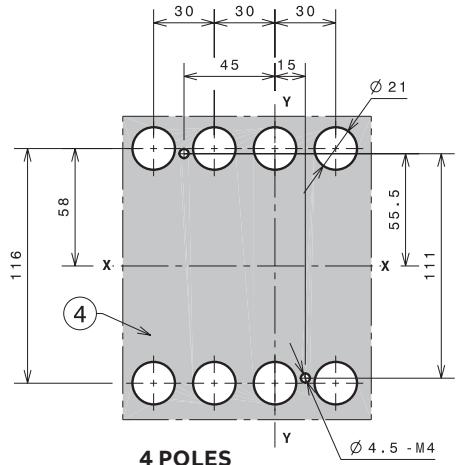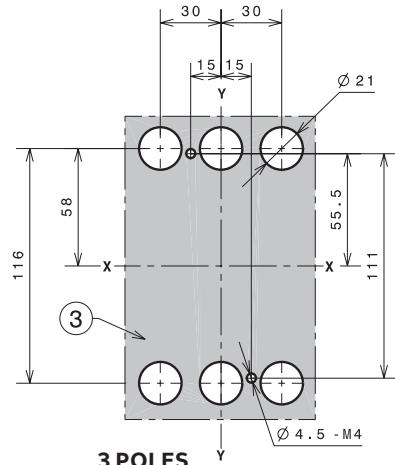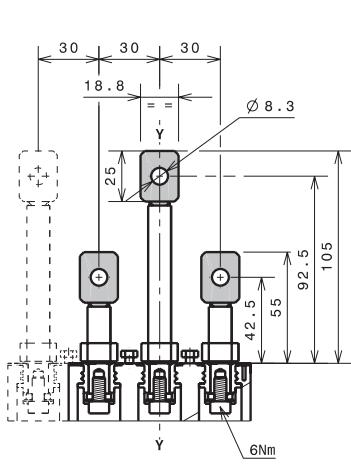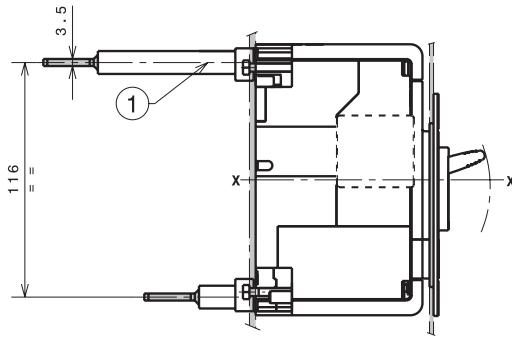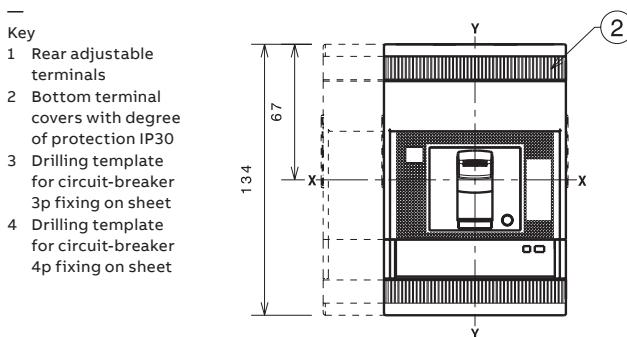

Tmax XT2 – Installation

Accessories for fixed circuit-breaker

Rotary handle operating mechanism on circuit-breaker (RHD)

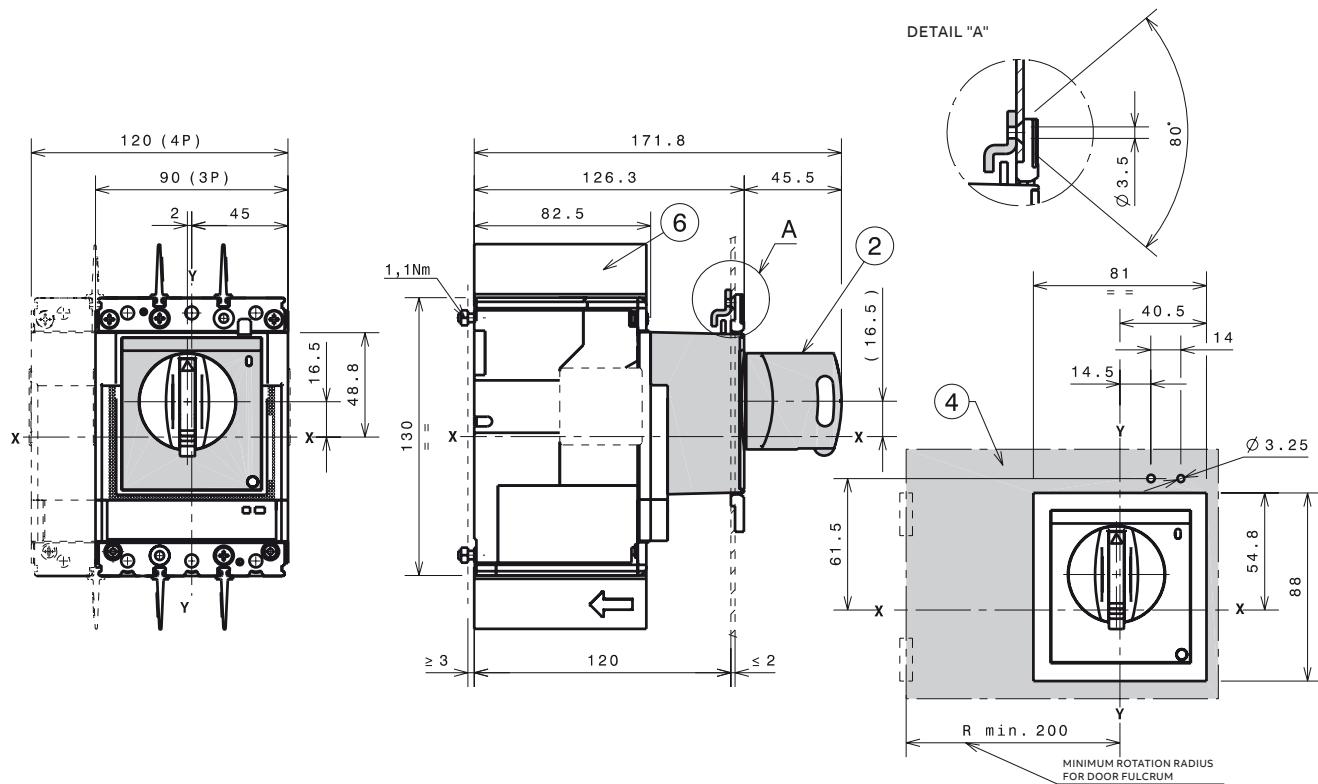

—
Key


- Key

 - 2 Rotary handle
operating mechanism
on circuit-breaker
 - 4 Drilling template
of door with direct
rotary handle
 - 6 Phase separators
25mm

Tmax XT2 – Installation

Accessories for fixed circuit-breaker


Rotary handle operating mechanism on the compartment door (RHE)

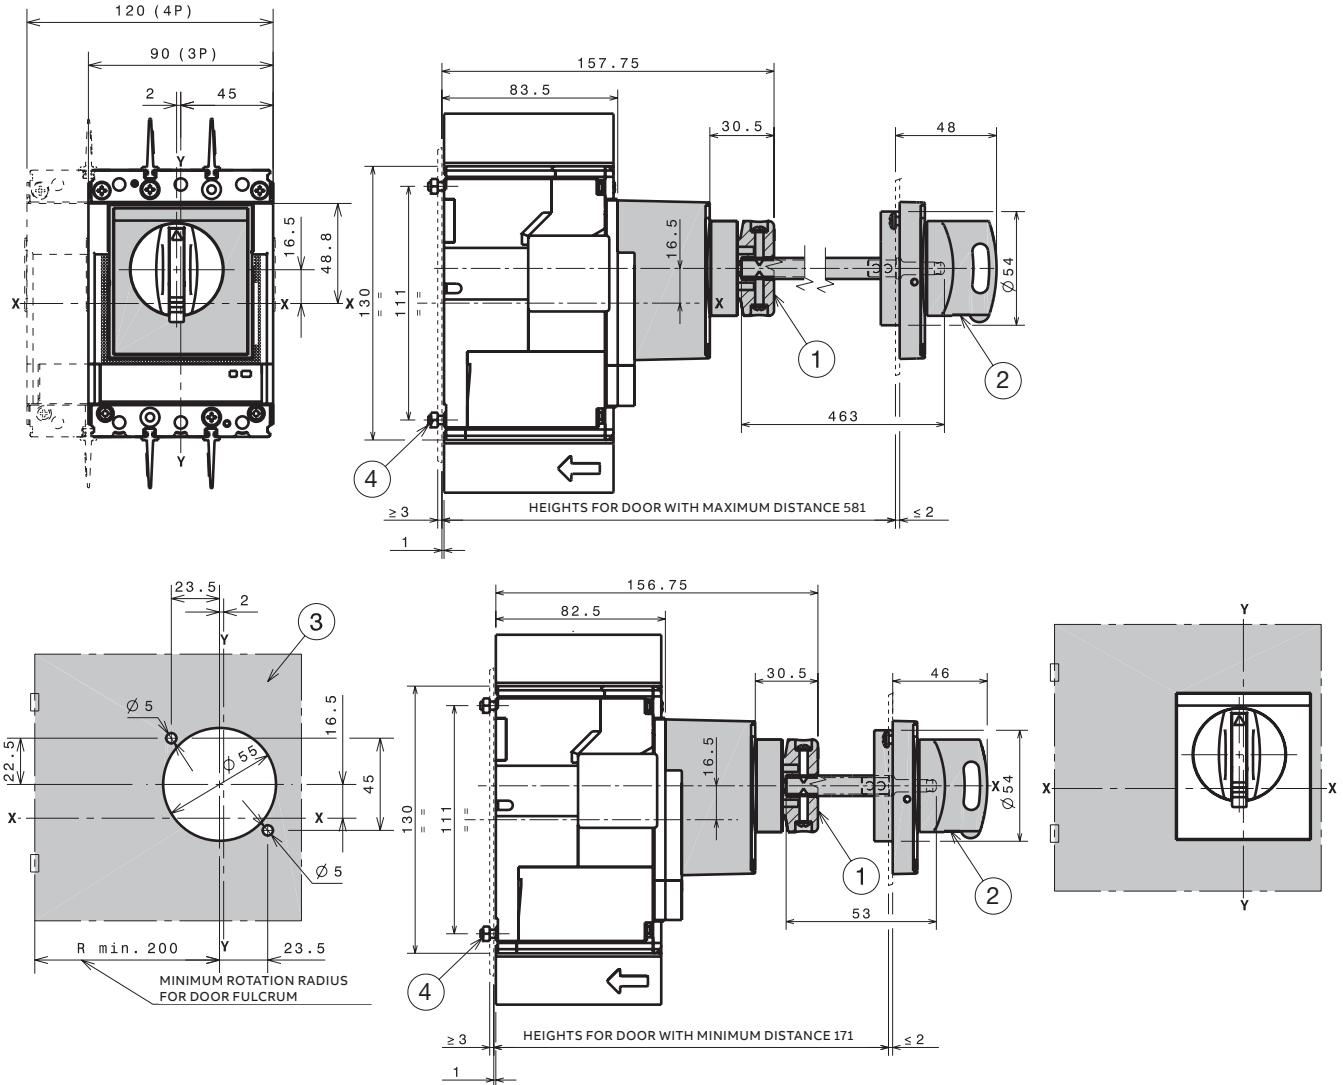

Key


- 1 Transmission mechanism
- 2 Rotary handle operating mechanism for compartment door
- 3 Compartment door drilling template
- 4 Tightening torque 1.1Nm

Stored energy motor operator (MOE)

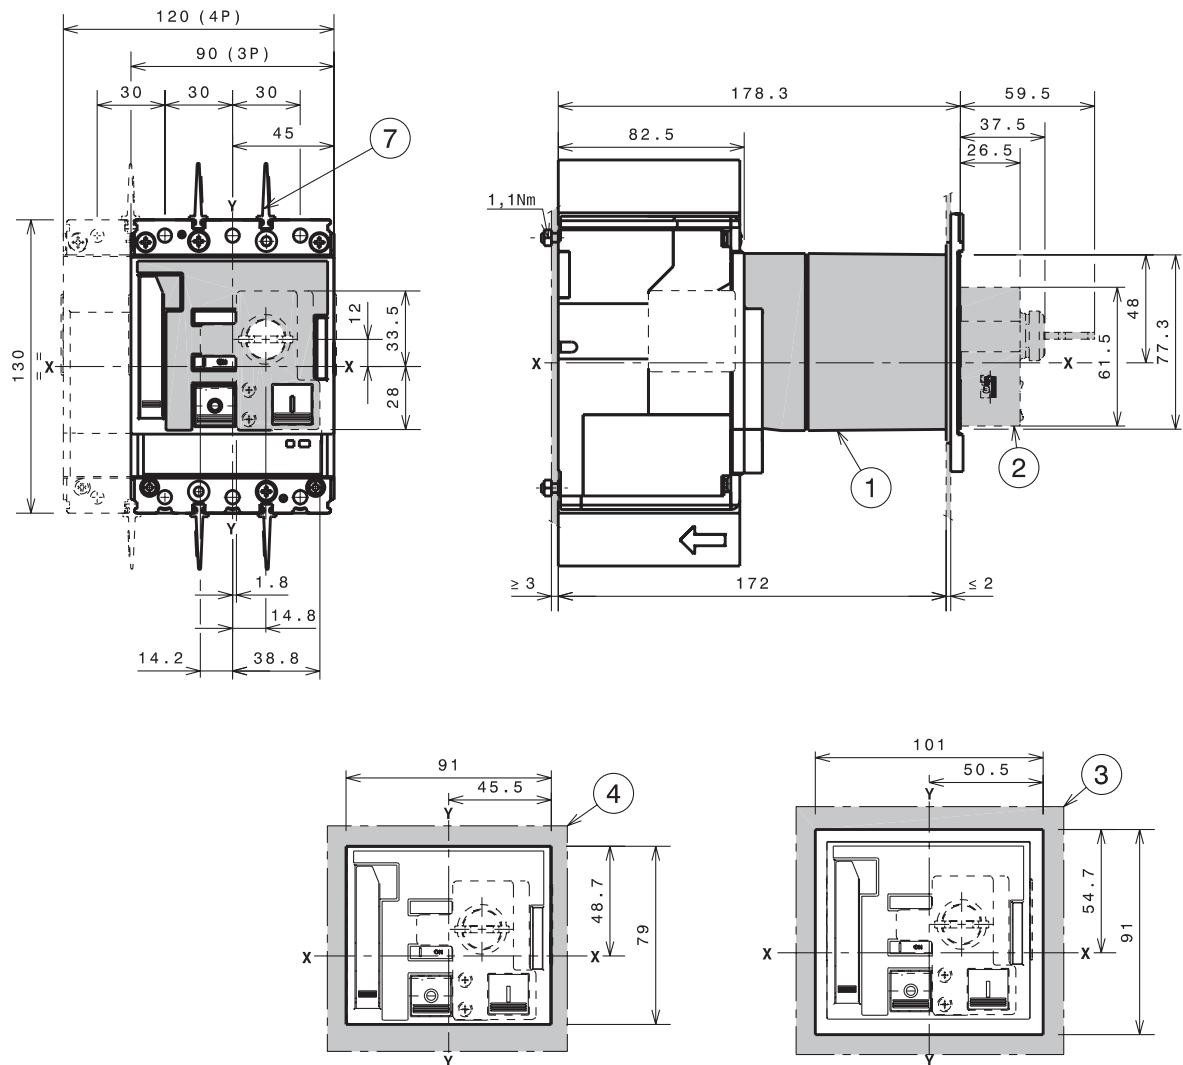


- Key
- 1 Stored energy motor operator (MOE)
 - 2 Key lock
 - 3 Drilling template of door with MOE with flange
 - 4 Door drilling template with MOE without flange
 - 5 Drilling template for circuit-breaker 3p fixing on sheet
 - 6 Drilling template for circuit-breaker 4p fixing on sheet
 - 7 Phase separators 25mm

3 POLES

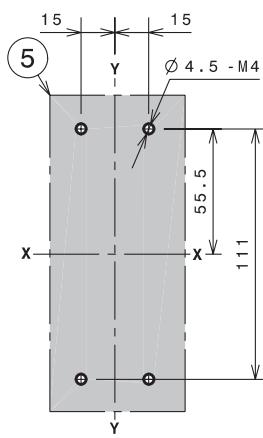


4 POLES

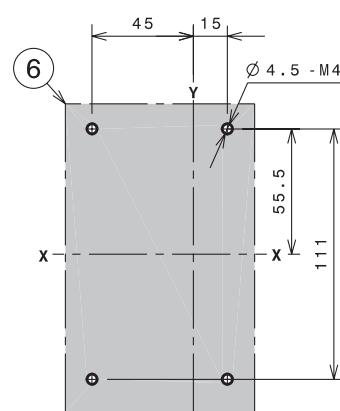

Tmax XT2 – Installation

Accessories for fixed circuit-breaker


Front for lever operating mechanism (FLD)

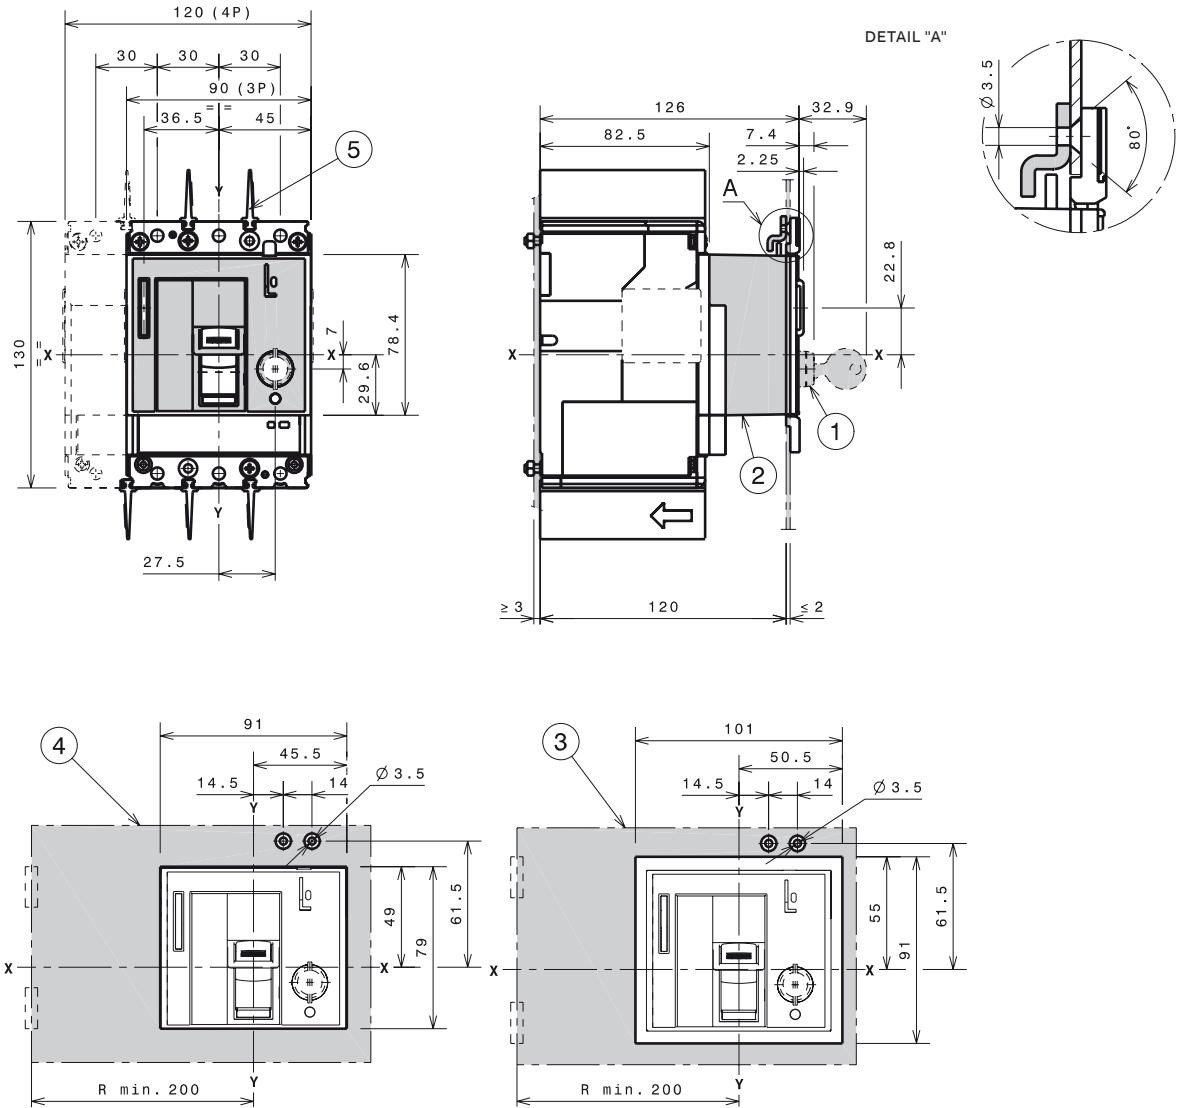

Key

- 1 Key lock
- 2 Front for lever operating mechanism (FLD)
- 3 Drilling template of door with FLD with flange
- 4 Drilling template of door with FLD without flange
- 5 Phase separators 25mm

Residual current RC Sel

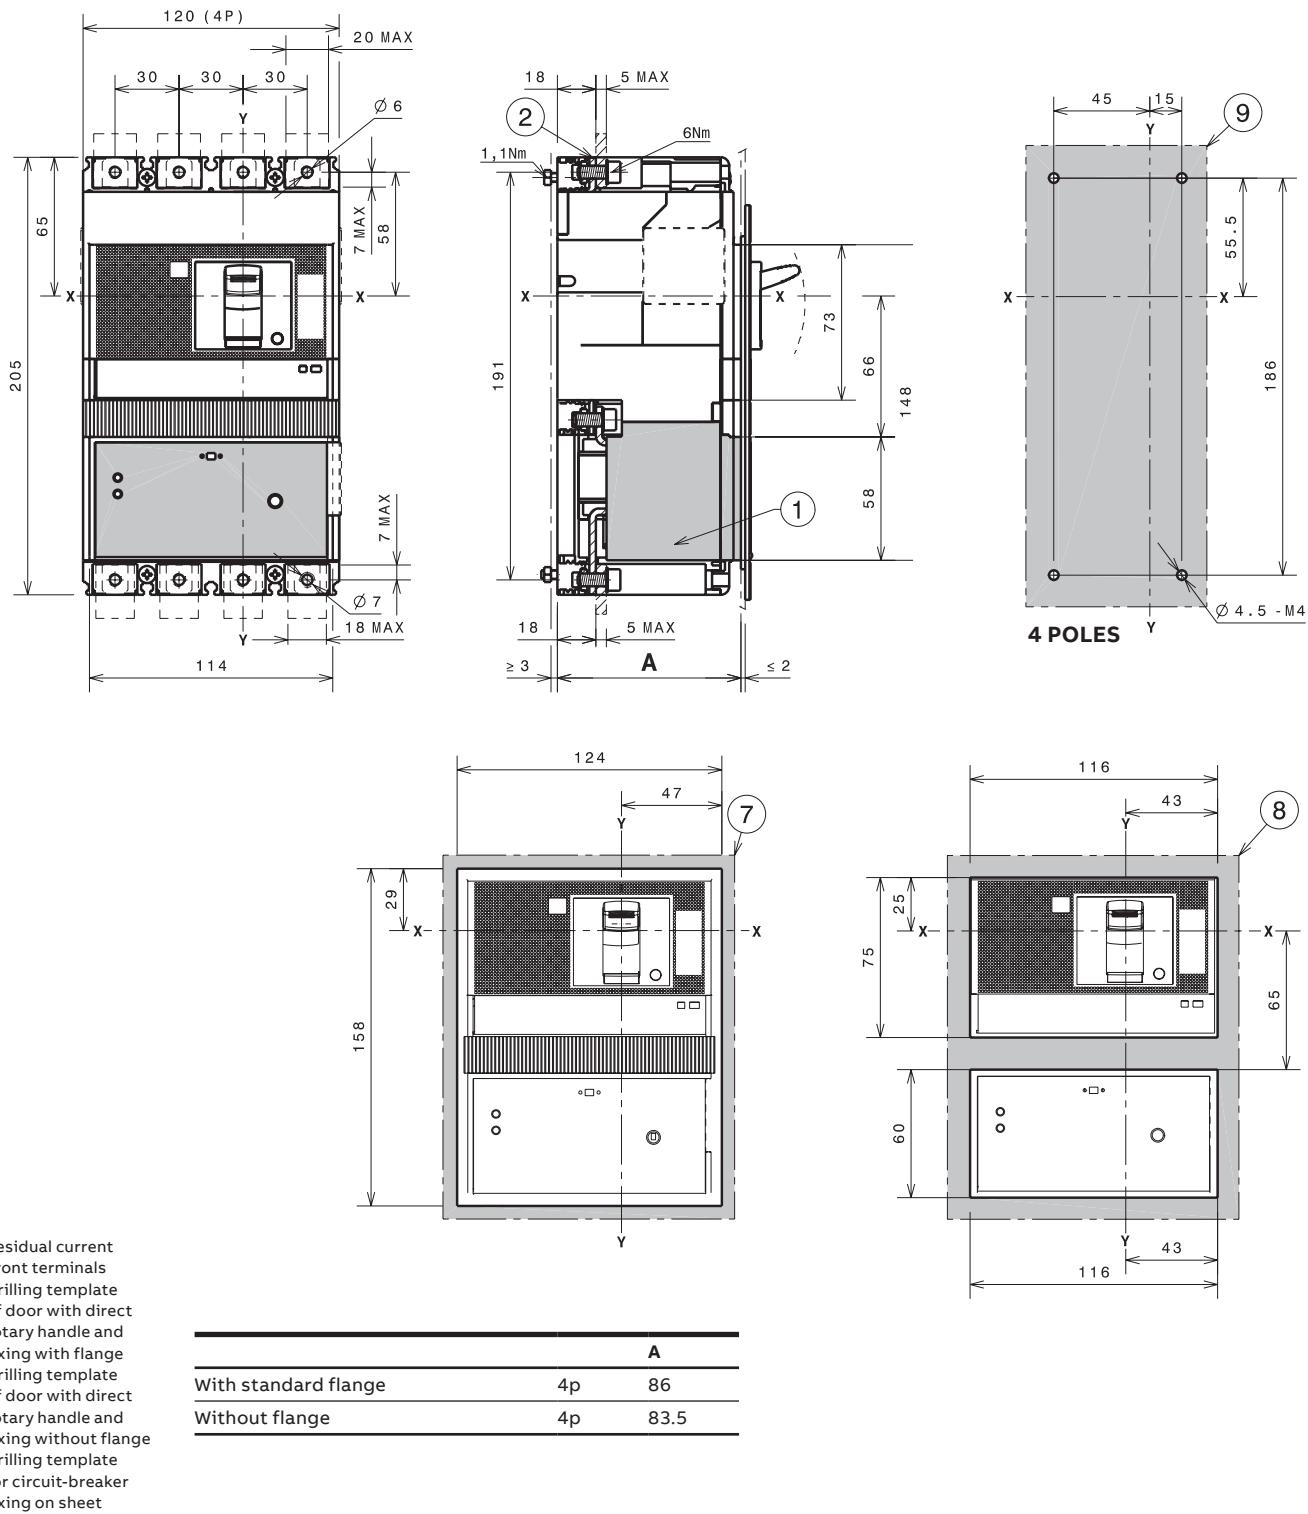

Tmax XT2 – Installation

Installation for plug-in circuit-breaker



Plug-in circuit-breaker fixing on sheet

—
Key
1 Fixed part
2 Moving part

Fixing at 50mm A

With standard 3p-4p 136 flange

Without flange 3p-4p 133.5
3p-4p 141.5


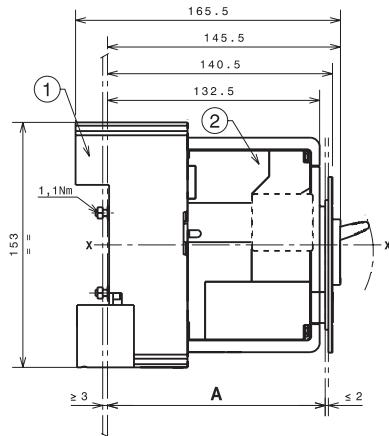
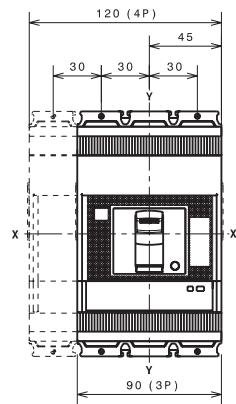


Fixing at 70mm for extended A front terminals

With standard 3p-4p 156 flange

Without flange 3p-4p 153.5
3p-4p 161.5

With side connector for Ekip Touch trip units

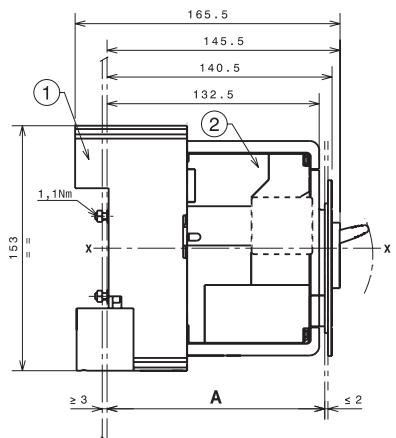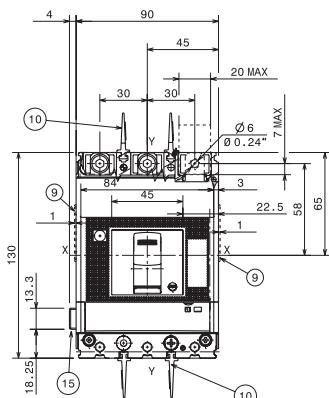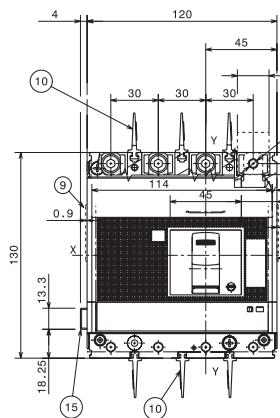


—
Key
9 Optional wiring duct
10 Phase separators 25mm
15 Connection kit F/P IntBus/ExtNeut/Sel

Tmax XT2 – Installation

Installation for plug-in circuit-breaker


Drilling templates for support sheet

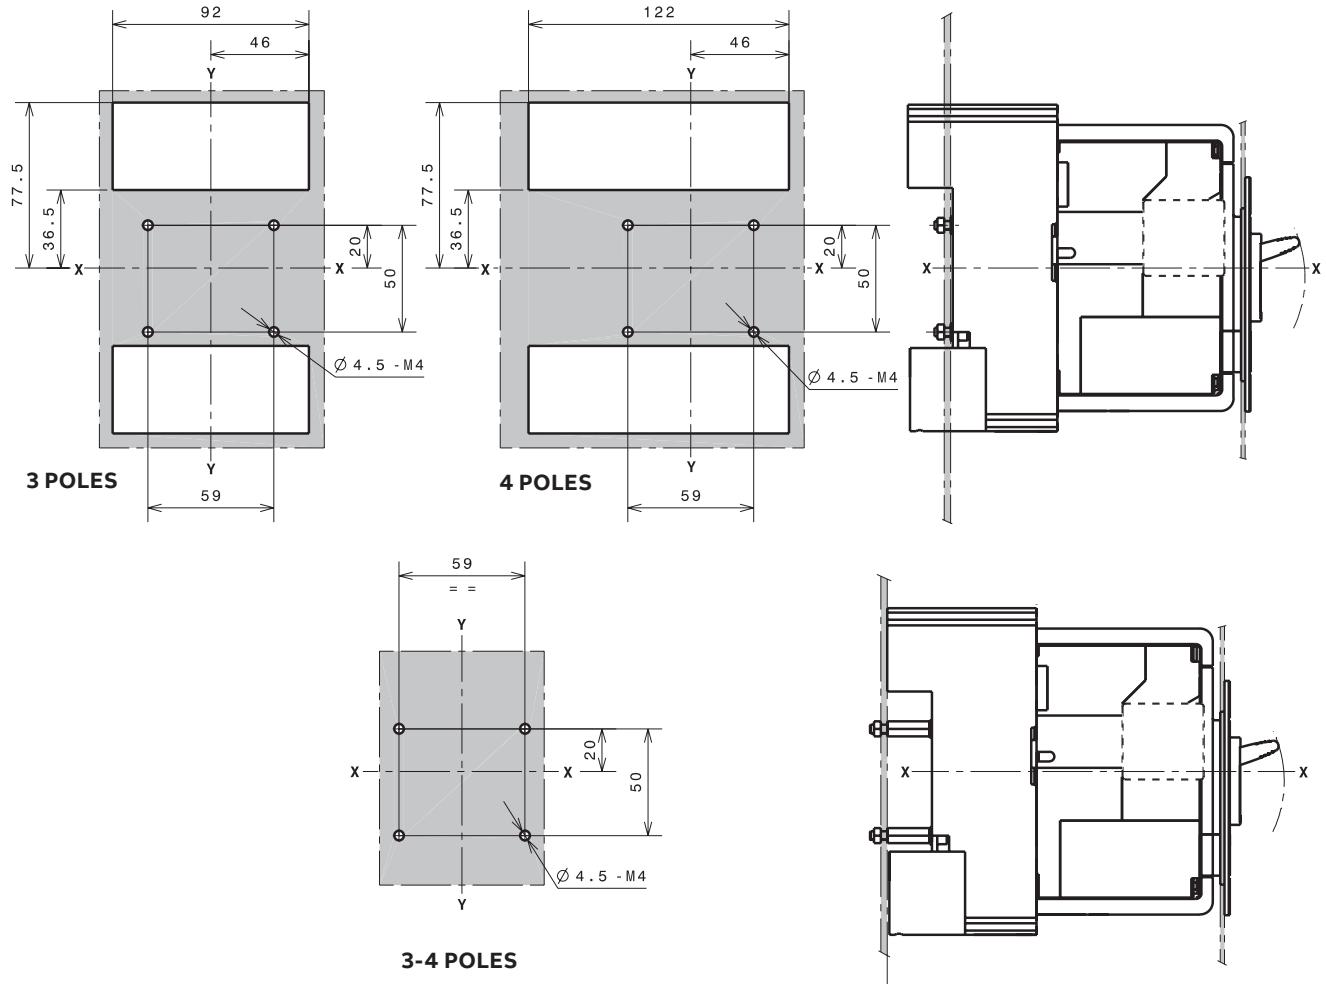

Tmax XT2 – Installation

Installation for plug-in circuit-breaker

Flanges

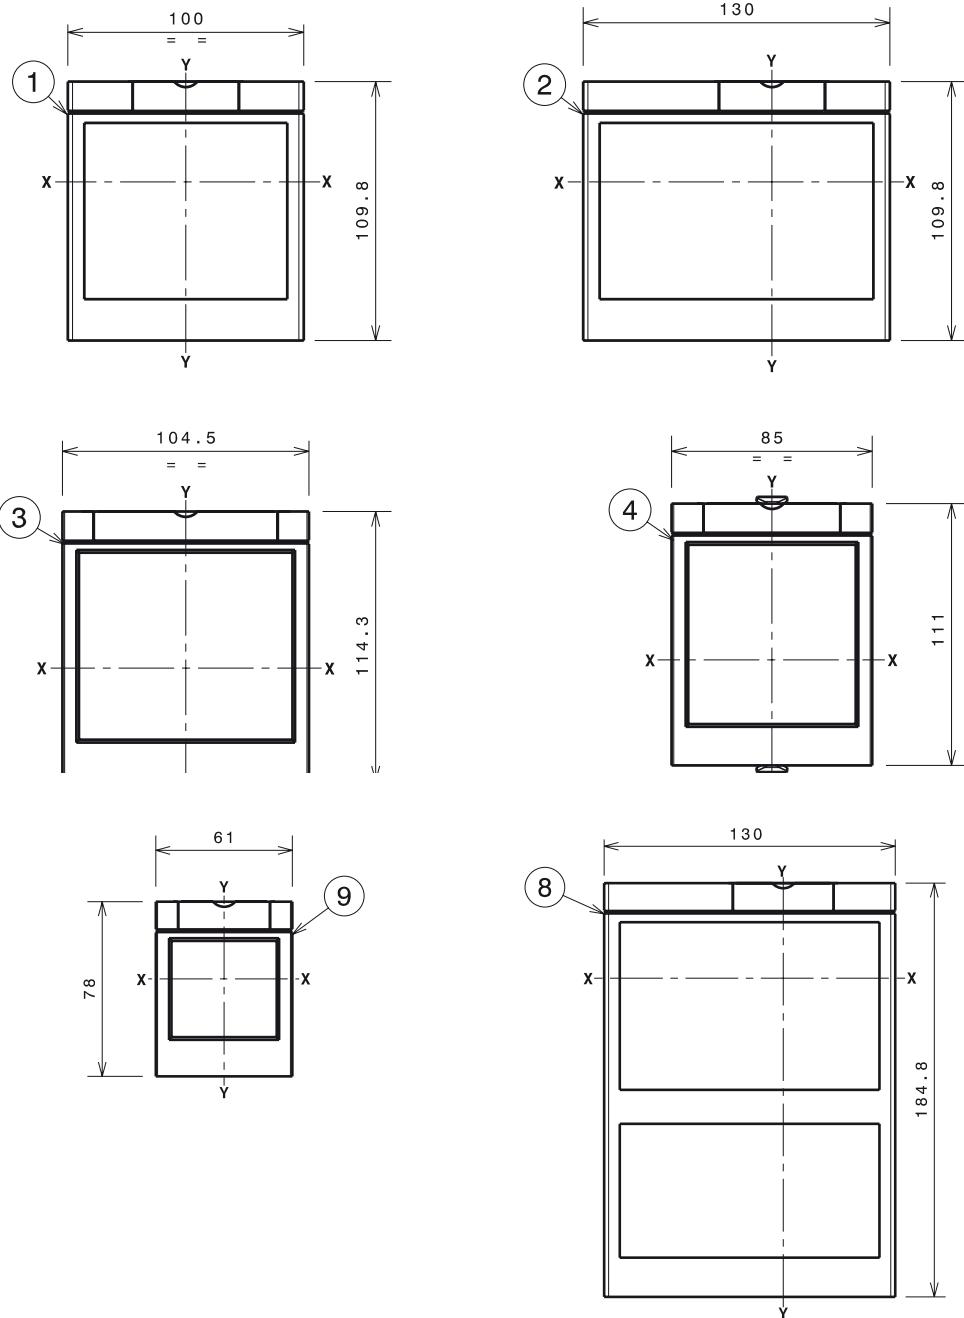


Key


- 1 Flange for removable circuit-breaker 3p
- 2 Flange for circuit-breaker 4p
- 3 Flange for plug-in circuit-breaker 3p-4p with MOE and FLD
- 4 Flange for circuit-breaker 3p-4p with direct rotary handle (RHD)
- 8 Flange for circuit-breaker 4p with residual current and plug-in with front terminals
- 9 Optional flange

Compartment door drilling templates


With standard flange

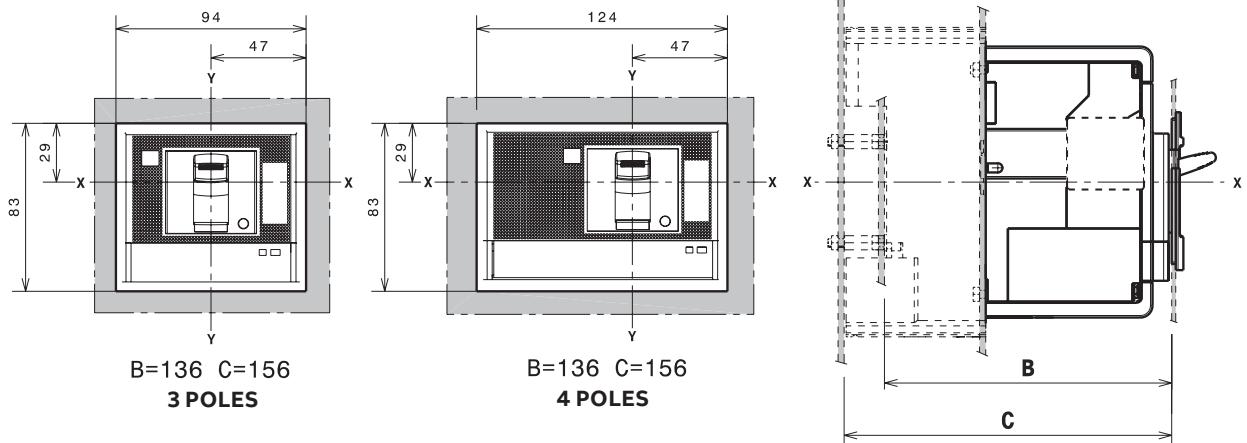

Without flange

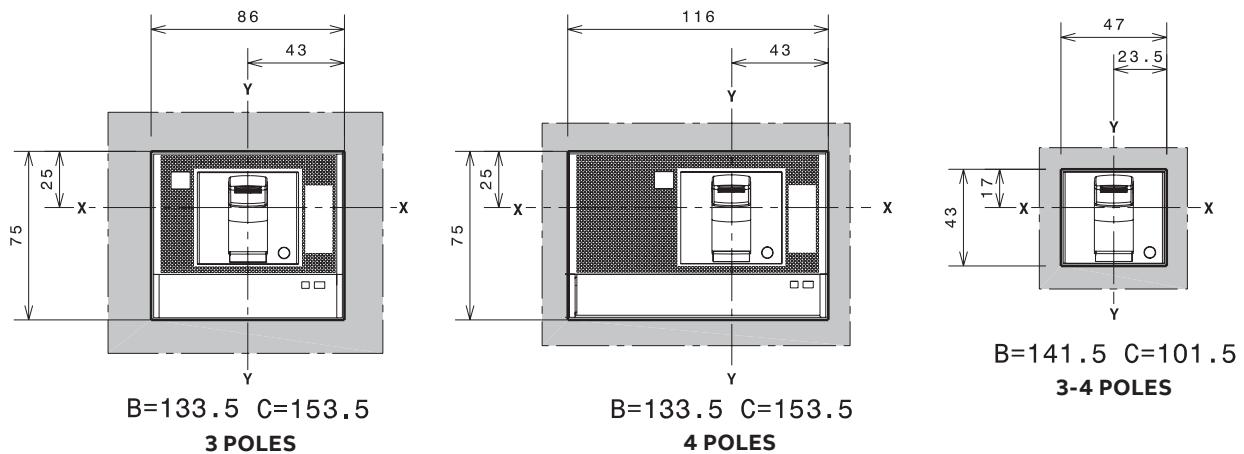

With optional flange

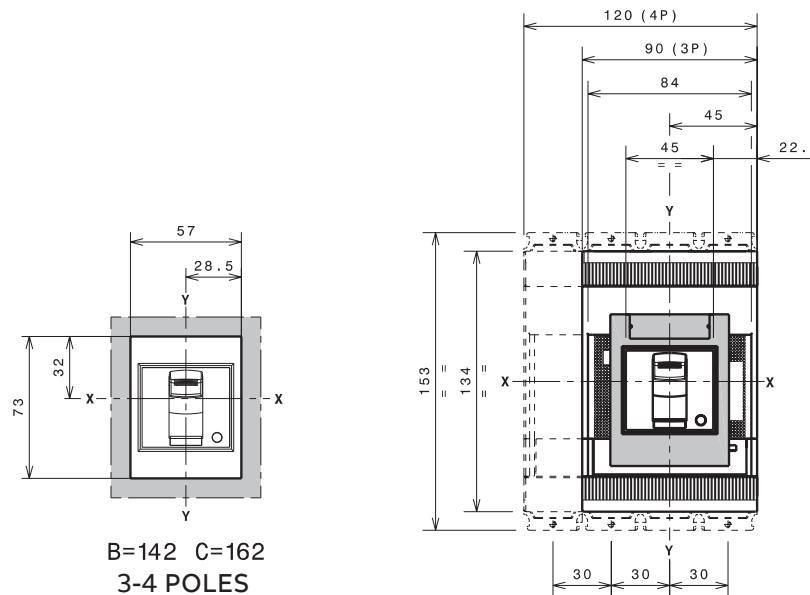


Tmax XT2 – Installation

Terminals for plug-in circuit-breaker



Terminals EF

—
Key
4 Front extended terminals
5 Phase separators 100mm

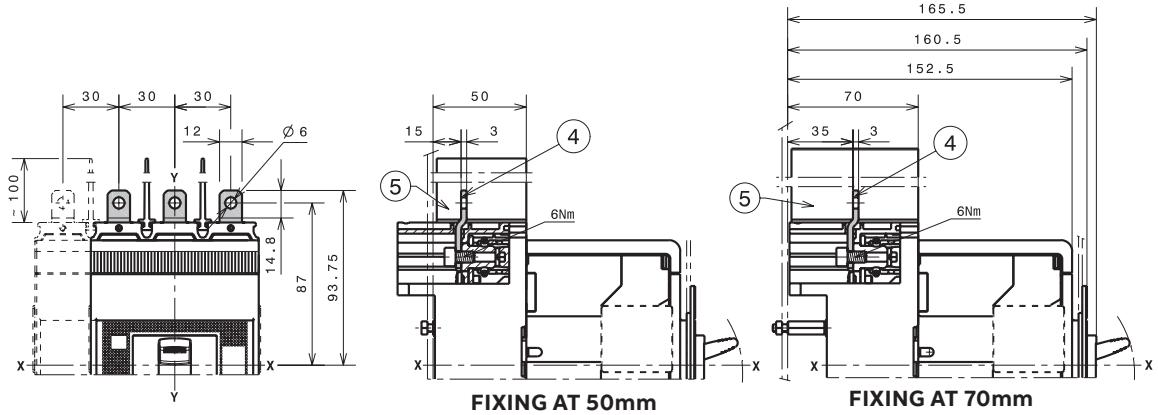



Terminals ES

—
Key
1 Front extended spread terminals
2 Phase separators 200mm
3 Insulated plate
4 Drilling template for 3p circuit-breaker Ue>440V
5 Drilling template for 4p circuit-breaker Ue>440V

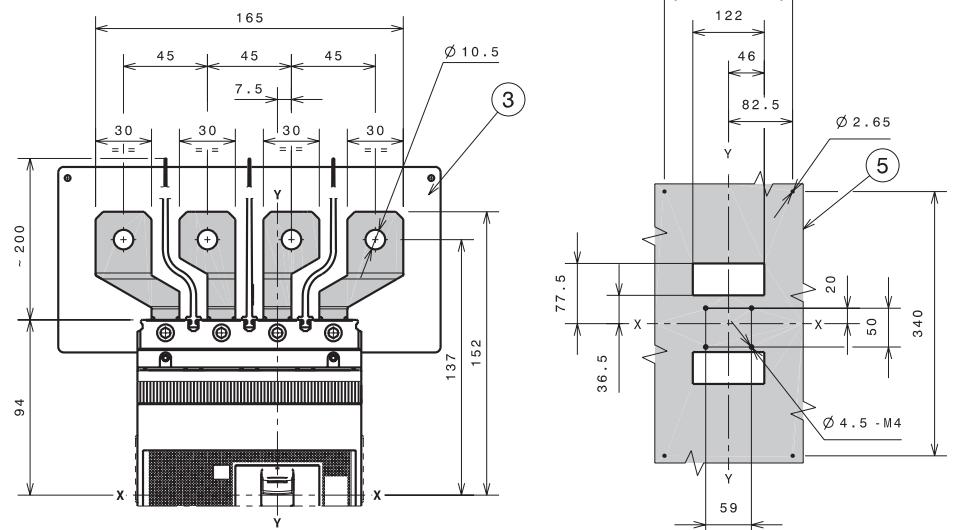
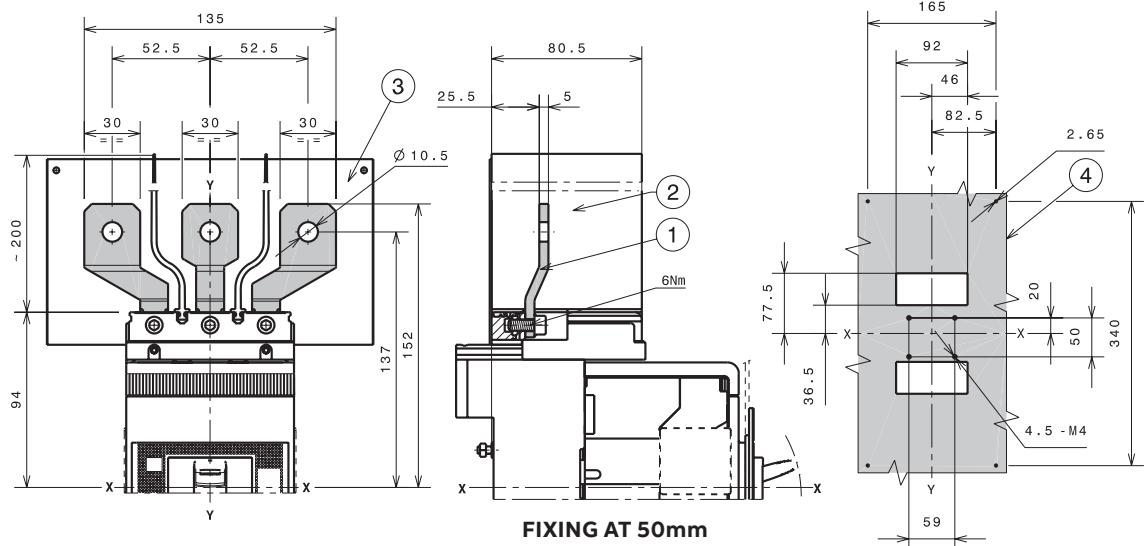


1x1...95mm² terminals FCCuAl



—
Key
1 1x1...95mm² front terminal FCCuAl
2 Phase separators 25mm
6 Adaptor

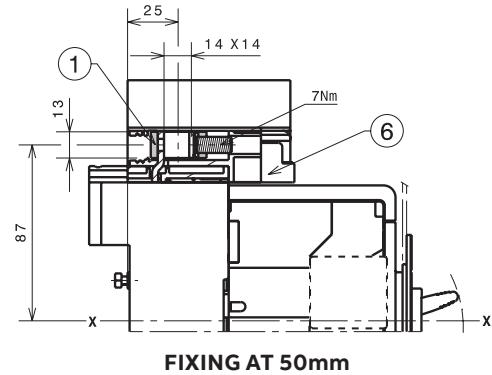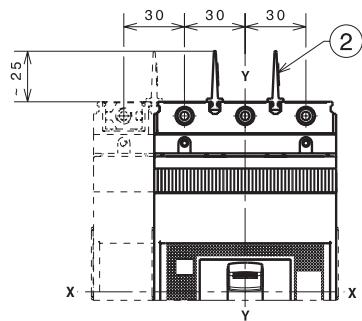1x70...185mm² terminals FCCuAl

—
Key
1 External terminal FCCuAl
2 High terminal covers with degree of protection IP40

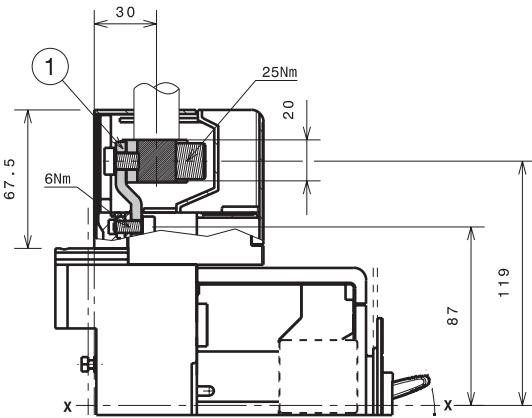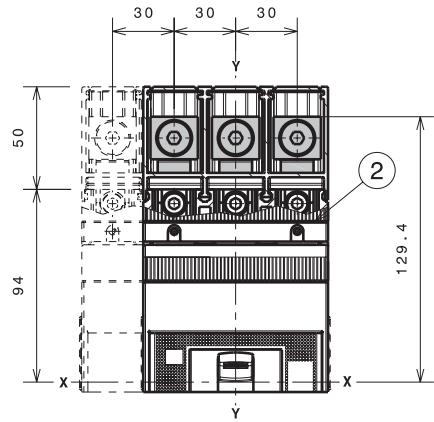2x35...70mm² terminals FCCuAl

—
Key
1 External terminal FCCuAl
2 High terminal covers with degree of protection IP40

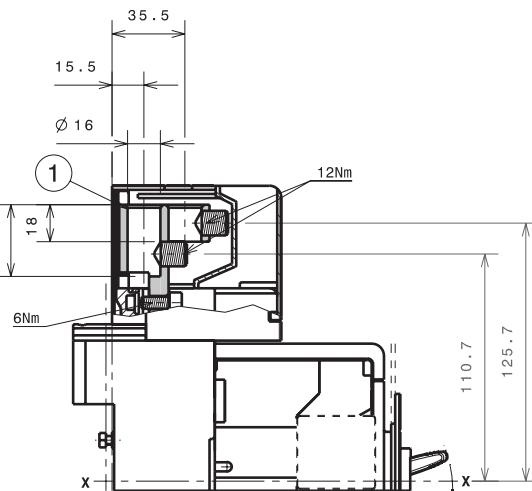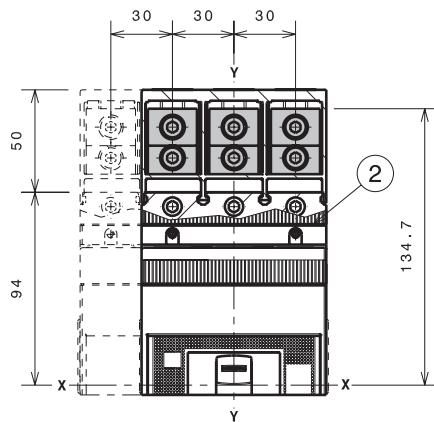



Tmax XT2 – Installation

Terminals for plug-in circuit-breaker



Terminals FCCu

Key
 3 Terminals FCCu
 4 Adaptor

Note:
 Phase separators 25mm

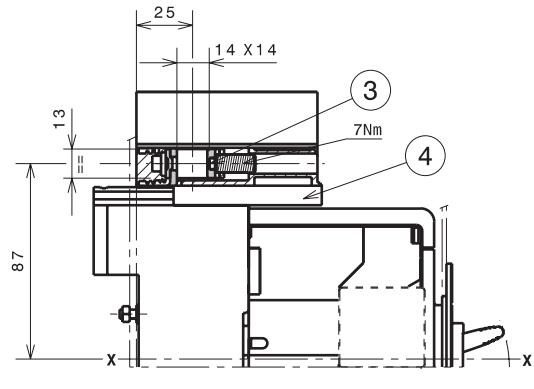
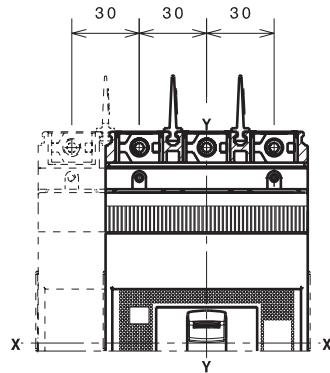


Terminals MC

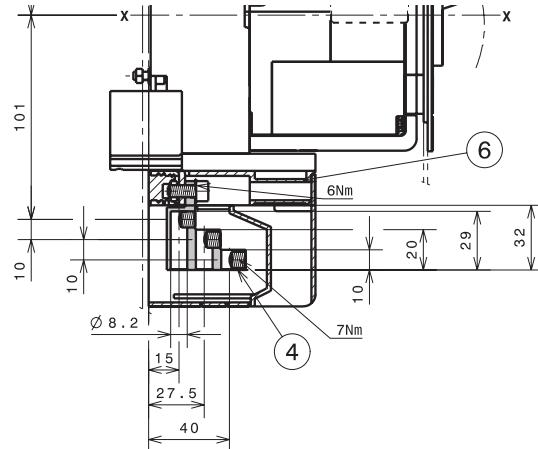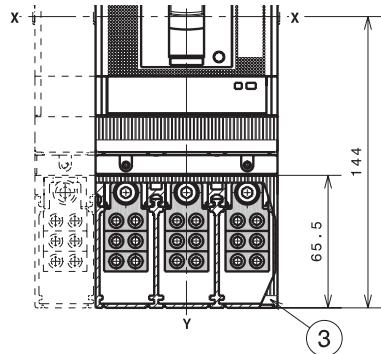


Key
 3 High terminal covers
 with degree of
 protection IP40
 4 Multicable terminals
 6 Adaptor



Terminals HR/VR

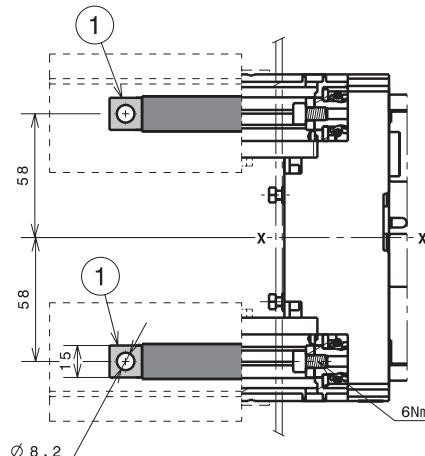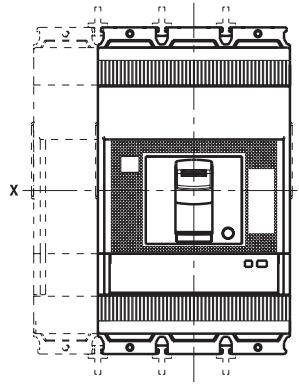

FIXING AT 50mm

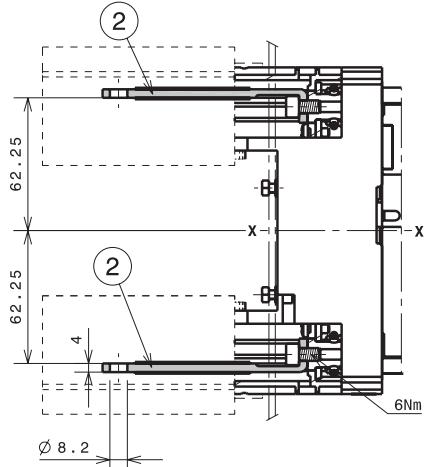

FIXING AT 50mm

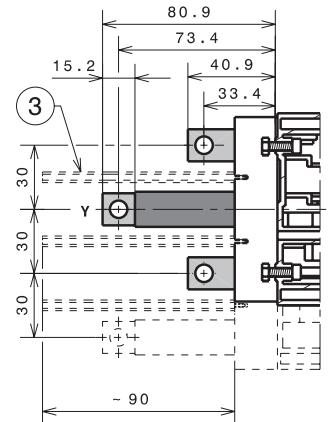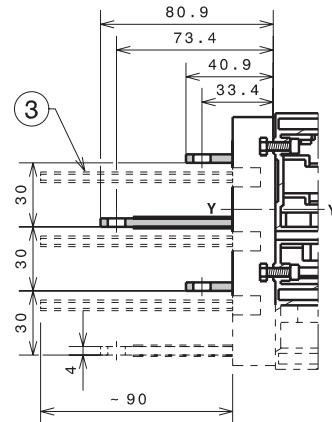


Key

- 1 Rear vertical terminals
- 2 Rear horizontal terminals
- 3 Rear phase separators 90mm

Tmax XT2 – Installation


Accessories for plug-in circuit-breaker

Stored energy motor operator (MOE)

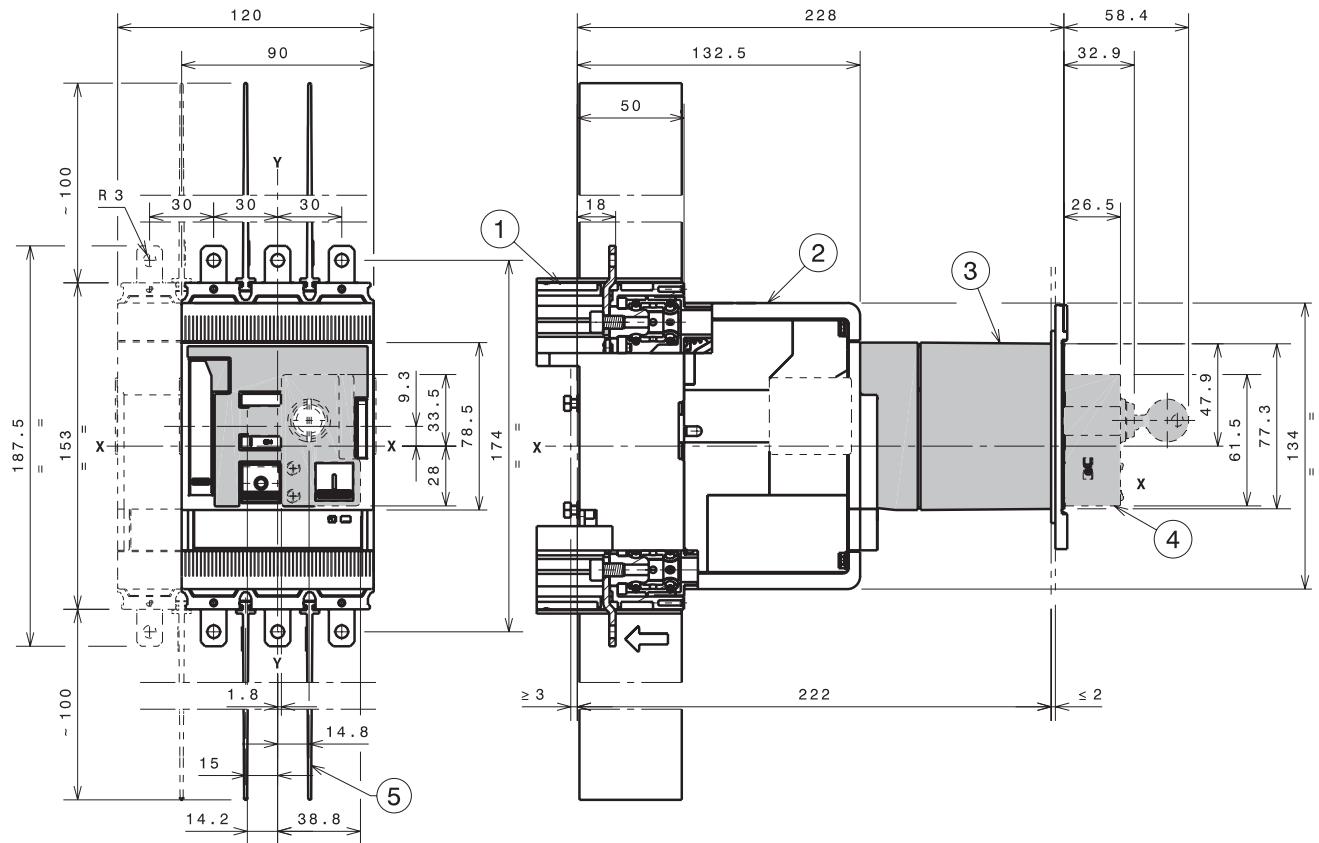


- **Key**
 - 1 Fixed part
 - 2 Moving part
 - 3 MOE
 - 4 Key lock
 - 5 Phase separators
100mm
 - 6 Drilling template
of door with direc
rotary handle
with flange
 - 7 Drilling template
of door with direc
rotary handle
without flange

Front for lever operating mechanism (FLD)

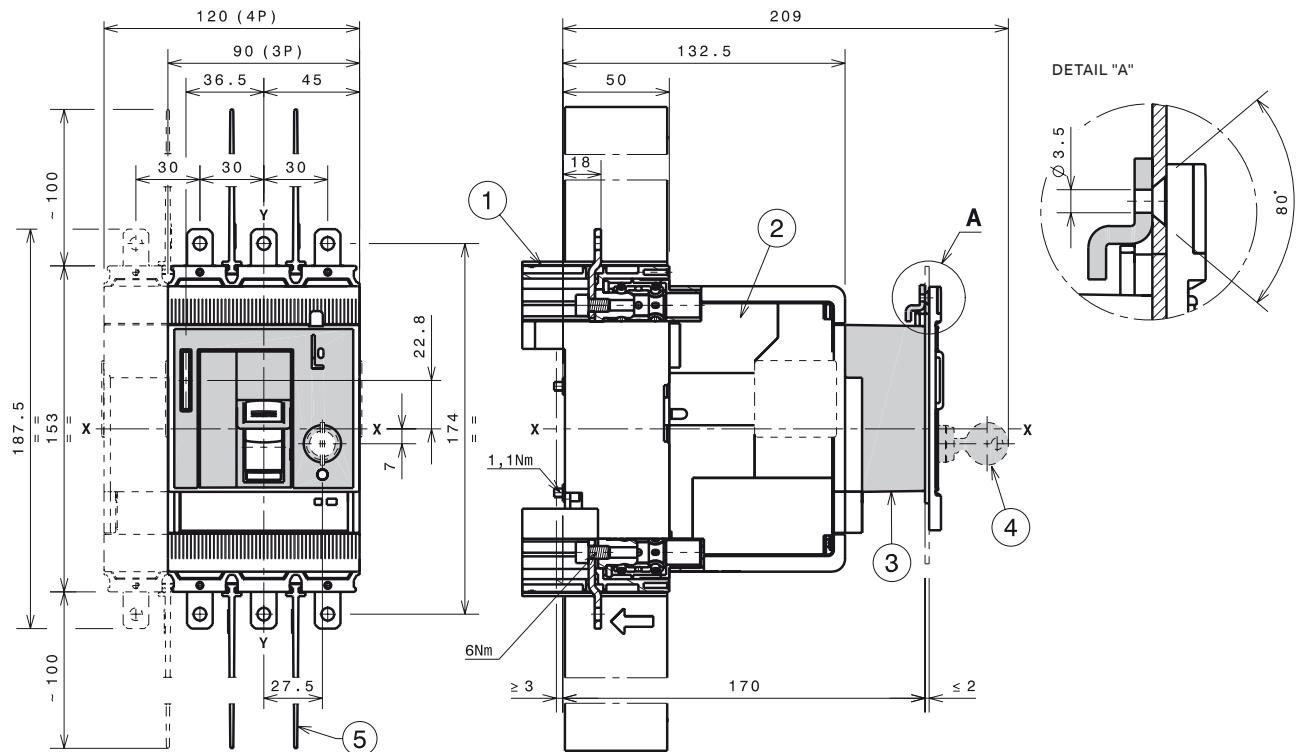


- Key**
- 1 Fixed part
 - 2 Moving part
 - 3 Front for lever operating mechanism (FLD)
 - 4 Key lock
 - 5 Phase separators 100mm
 - 6 Drilling template of door with direct rotary handle with flange
 - 7 Drilling template of door with direct rotary handle without flange

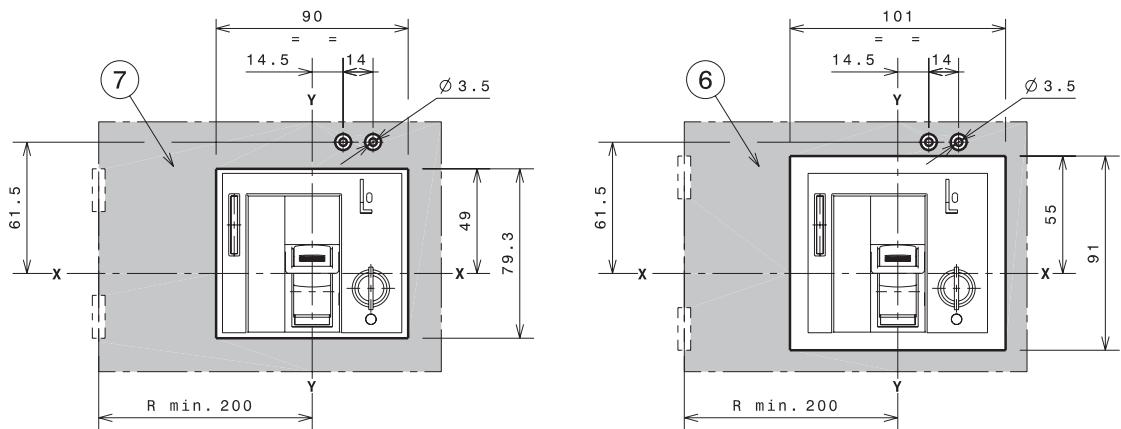


Tmax XT2 – Installation

Accessories for plug-in circuit-breaker

Residual current RC Sel

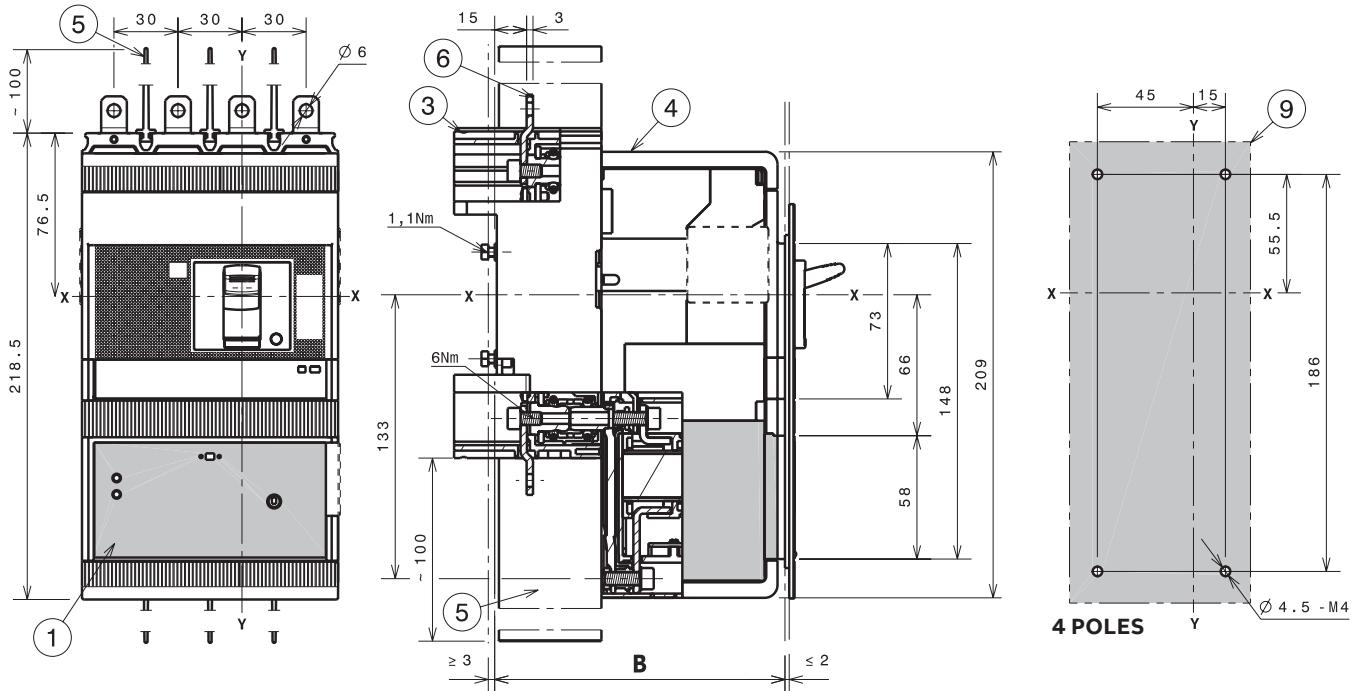

- Key**
- 1 Residual current
 - 3 Fixed part
 - 4 Moving part
 - 5 Phase separators
100mm
 - 6 Extended terminals
 - 7 Drilling template
of door with direct
rotary handle and
fixing with flange
 - 8 Drilling template
of door with direct
rotary handle and
fixing without flange
 - 9 Drilling template
for circuit-breaker
fixing on sheet


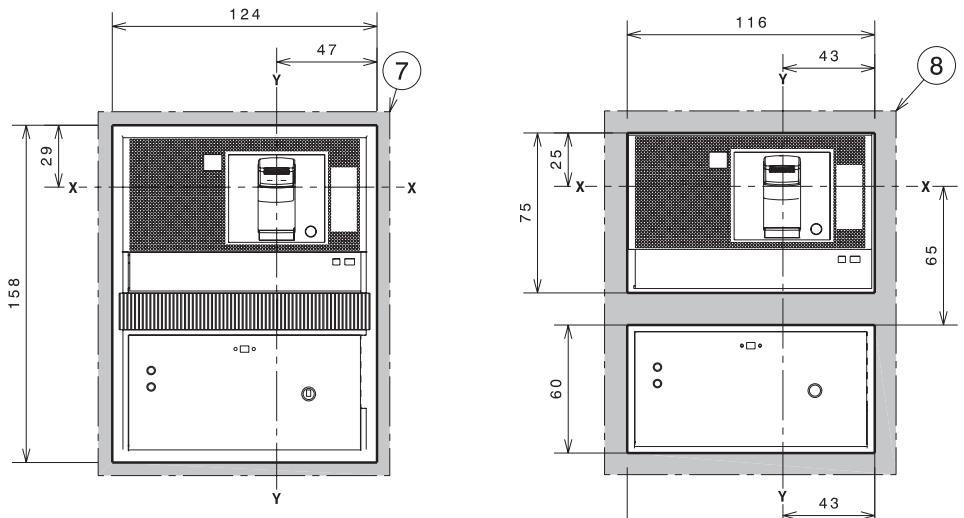


| | A | |
|----------------------|----------|-------|
| With standard flange | 4p | 136 |
| Without flange | 4p | 133.5 |

Tmax XT2 – Installation

Installation for withdrawable circuit-breaker

Fixing on sheet

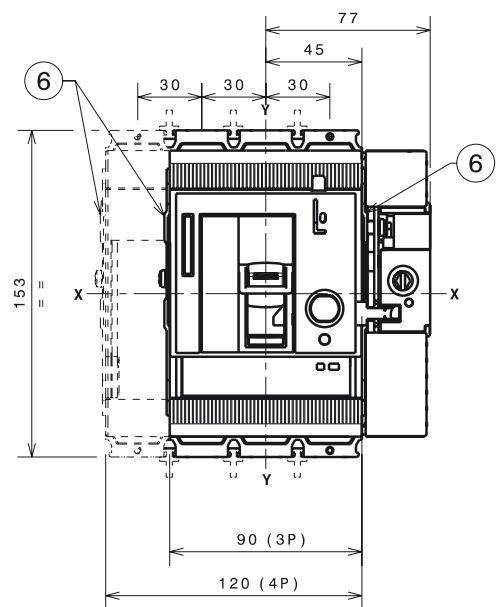
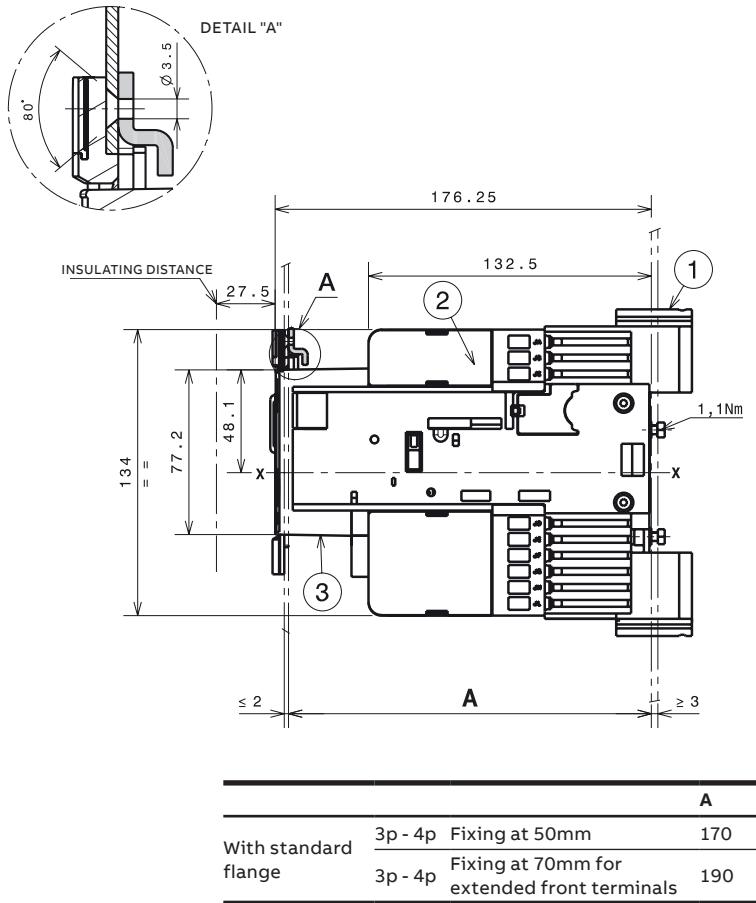


- Key
- 1 Fixed part
 - 2 Moving part
 - 3 FLD (FLD o RHD
o RHE o MOE)
mandatory for
withdrawable version
 - 6 Optional wiring ducts

Tmax XT2 – Installation

Installation for withdrawable circuit-breaker

With side connector for Ekip Touch trip units

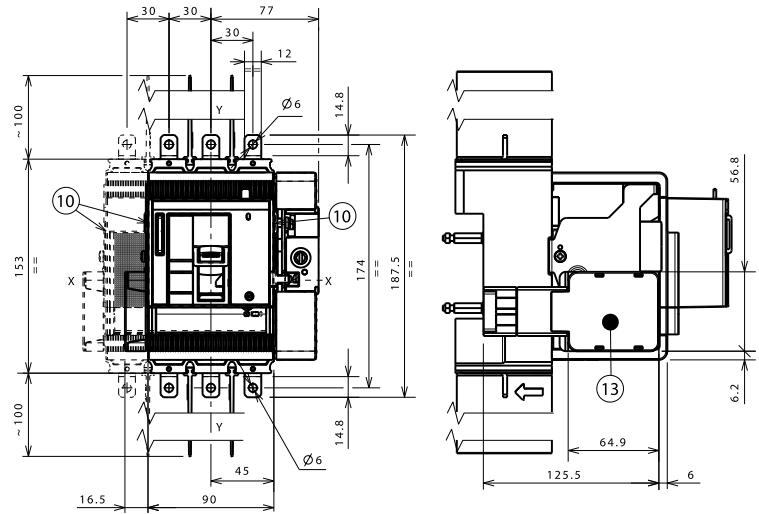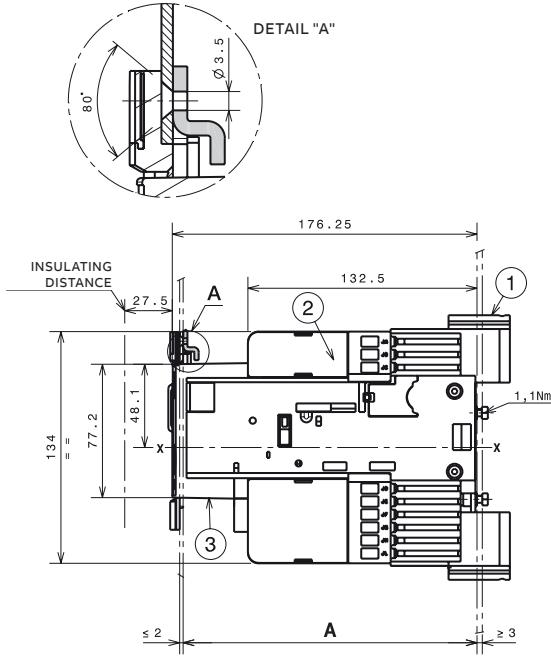


| | A | |
|----------------------|---------|---|
| With standard flange | 3p - 4p | Fixing at 50mm 170 |
| | 3p - 4p | Fixing at 70mm for extended front terminals 190 |


Key

- 1 Fixed part
- 2 Moving part
- 3 FLD (FLD o RHD
o RHE o MOE)
mandatory for withdrawable version
- 10 Optional Wiring Duct
- 13 Connection Kit W IntBus/ExtNeut/Sel

Drilling templates for support sheet

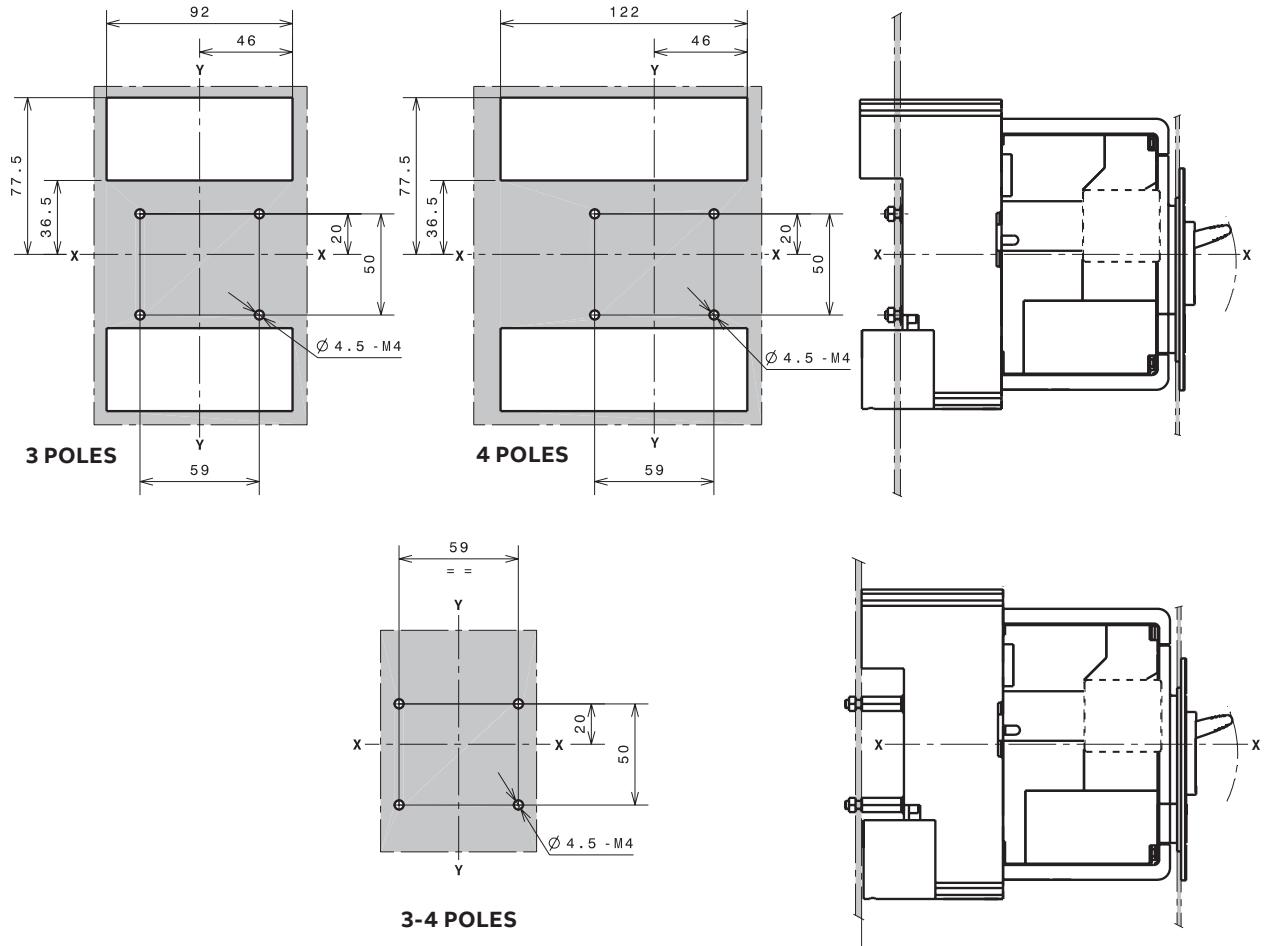

Flanges

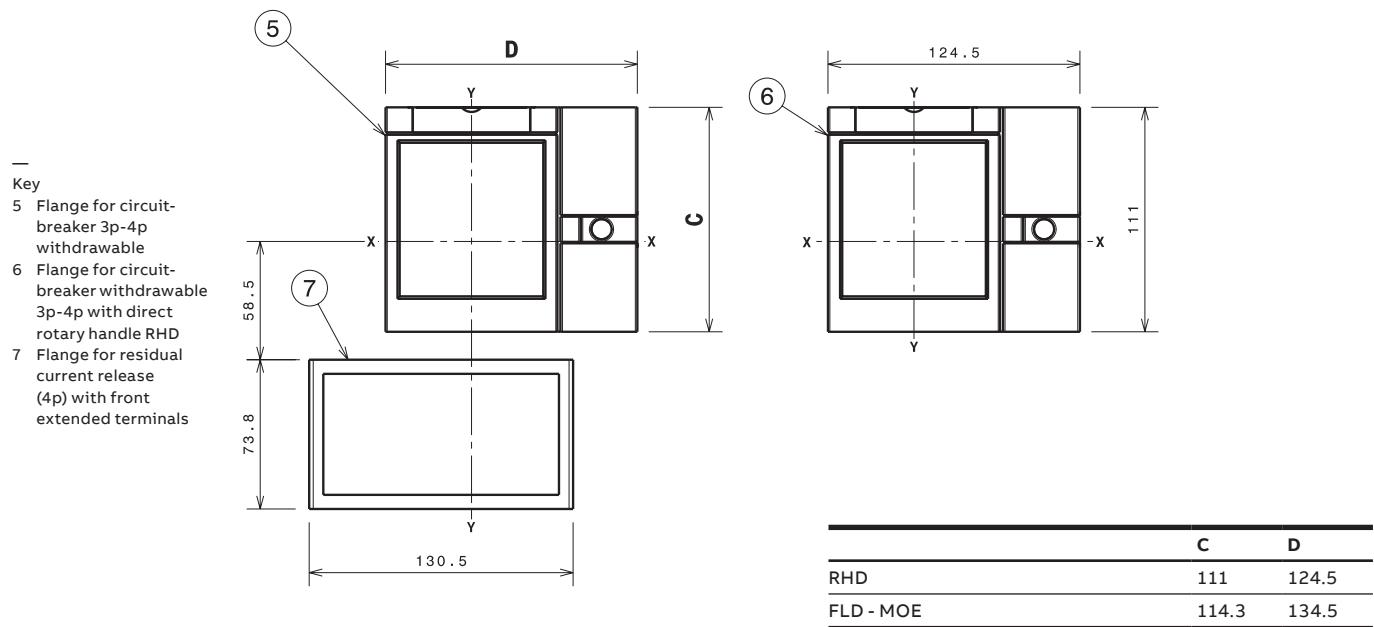


Tmax XT2 – Installation


Installation for withdrawable circuit-breaker

Compartment door drilling templates


With standard flange

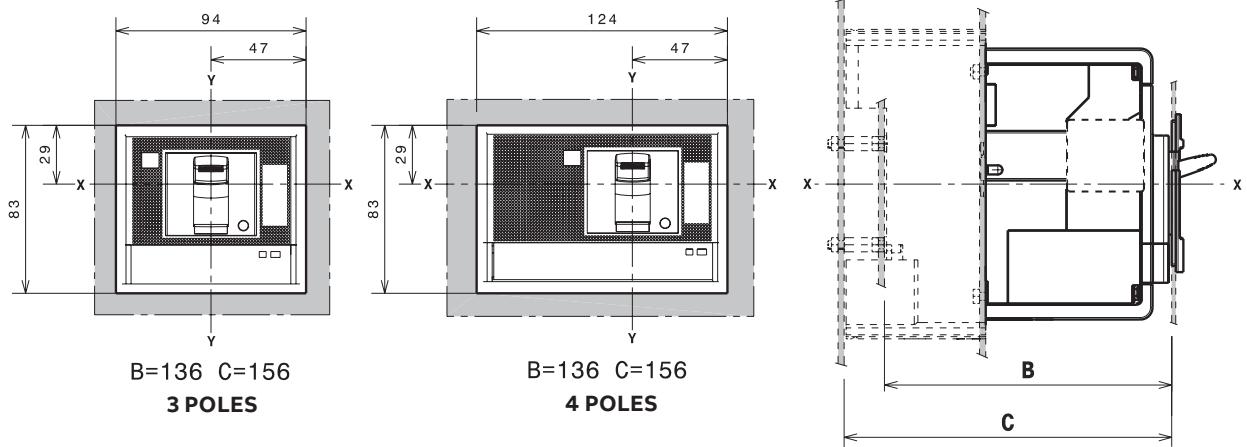

Without flange

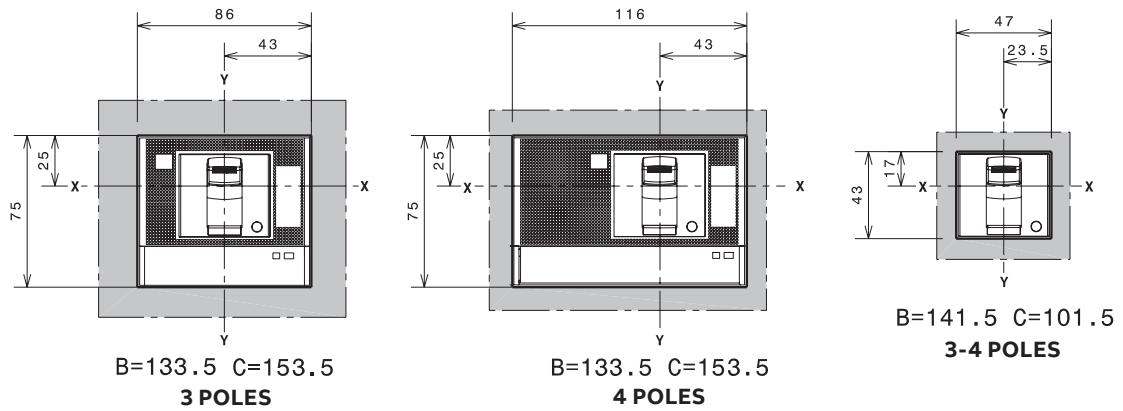


With standard flange

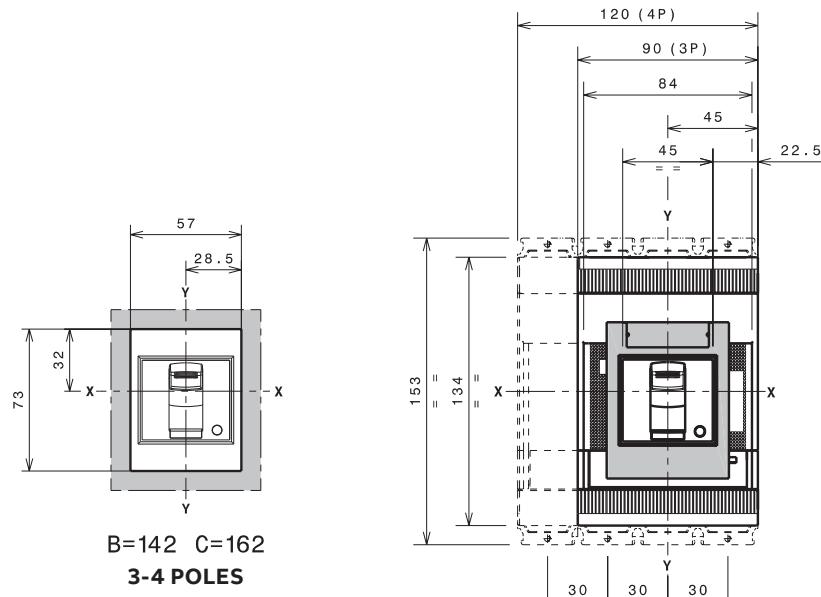

Tmax XT2 – Installation

Terminals for withdrawable circuit-breaker

Terminals EF

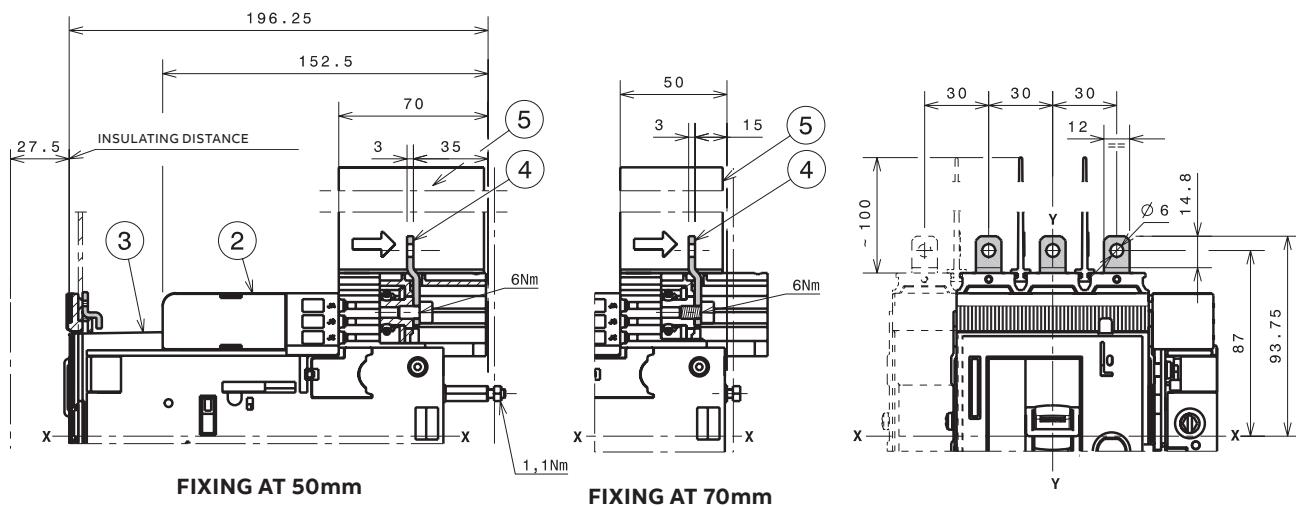

—
Key


- 2 Moving part
- 3 FLD (FLD or RHD or RHE or MOE) mandatory for withdrawable version
- 4 Front extended terminals
- 5 Phase separators 100mm

—
Note:
insulated plate

Tmax XT2 – Installation

Terminals for withdrawable circuit-breaker

Terminals ES


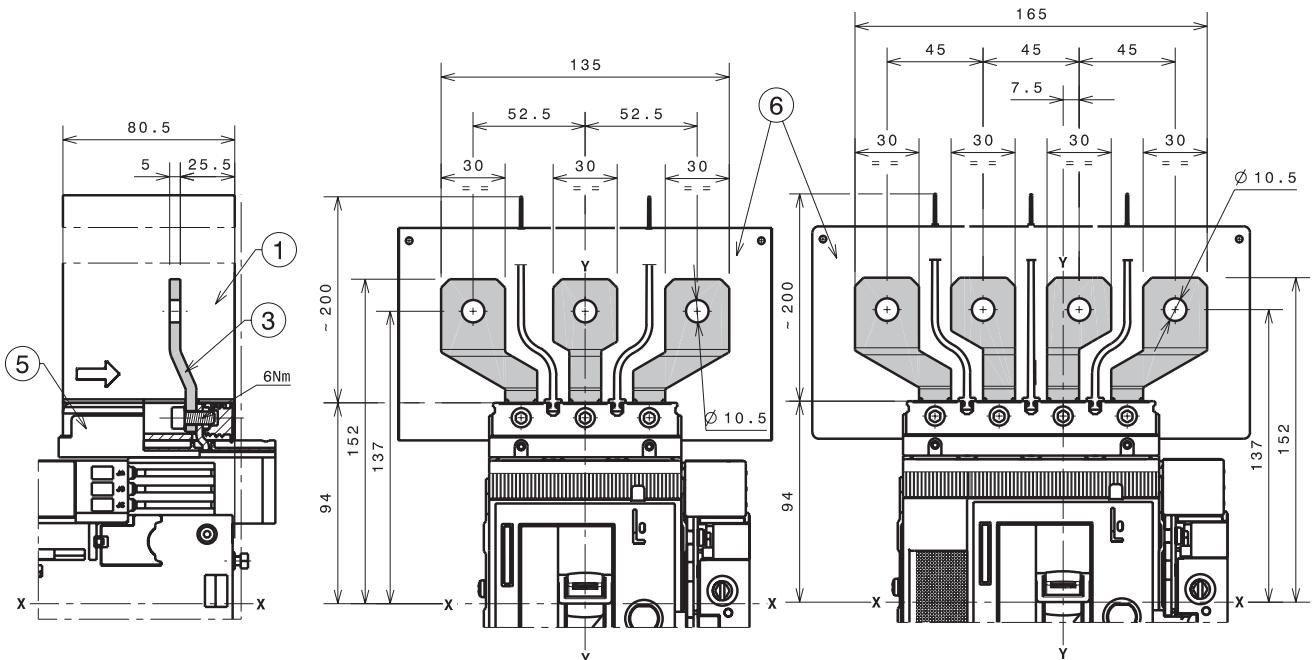


FIXING AT 50mm

- Key
- 1 Phase separators
200mm
 - 3 Front extended
spread terminals
 - 5 Adaptor
 - 6 Insulated plate
 - 7 Drilling template
for 3p circuit-
breaker Ue>440V
 - 8 Drilling template
for 4p circuit-
breaker Ue>440V

1x1...95mm² terminals FCCuAl



—
Key
2 Phase separators
25mm
4 1x1...95mm² front terminals FCCuAl
5 Adaptor

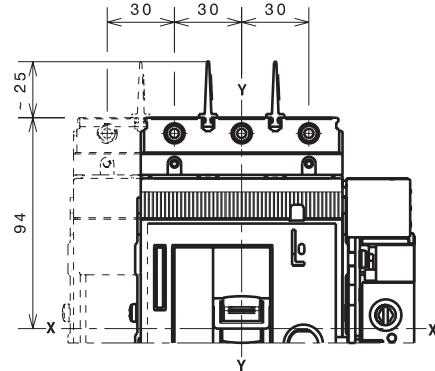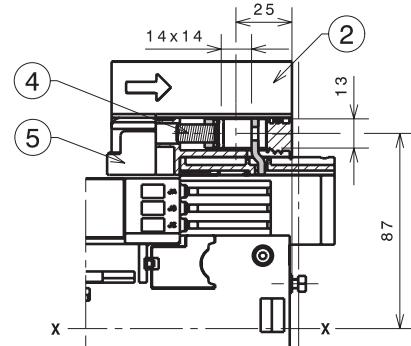



FIXING AT 50mm

1x70...185mm² terminals FCCuAl

—
Key
1 External terminal FCCuAl
2 High terminal covers with degree of protection IP40

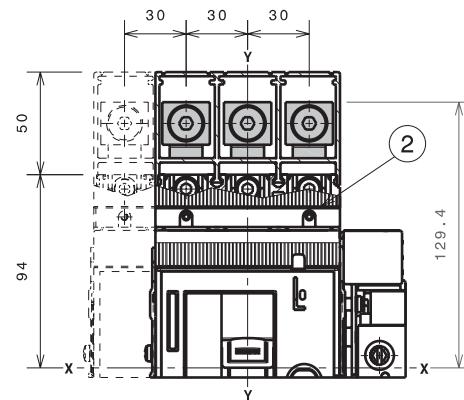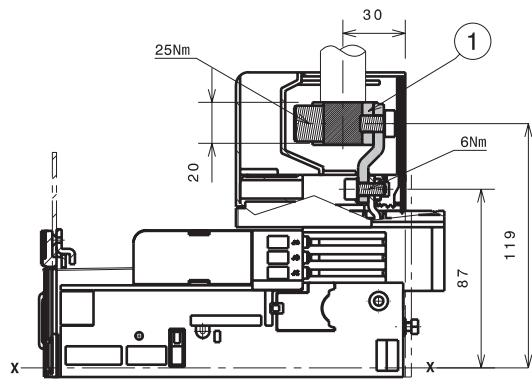2x35...70mm² terminals FCCuAl

—
Key
1 External terminal FCCuAl 2x70mm²
2 High terminal covers with degree of protection IP40

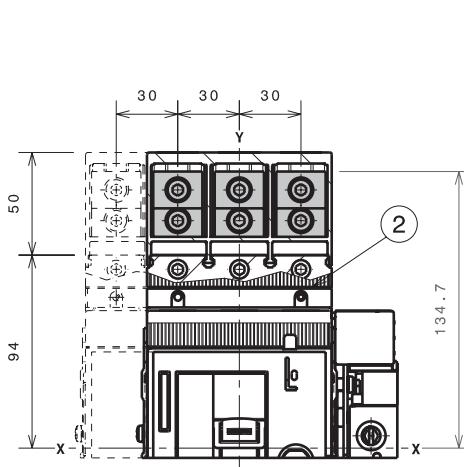
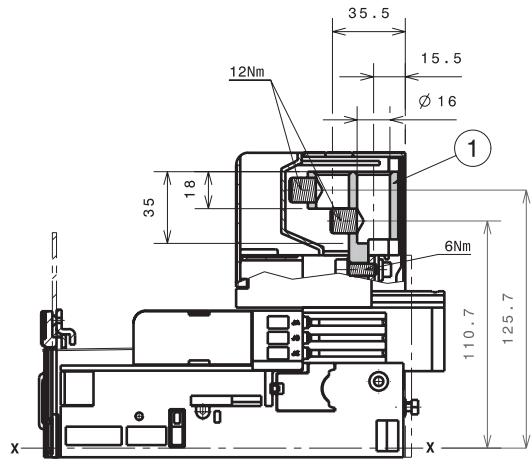


Tmax XT2 – Installation

Terminals for withdrawable circuit-breaker



Terminals FCCu

Key
 2 Terminals FCCu
 4 Adaptor
 5 Phase separators
 25mm

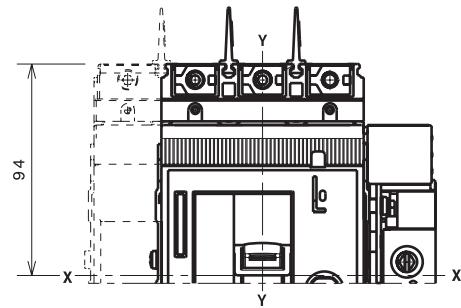
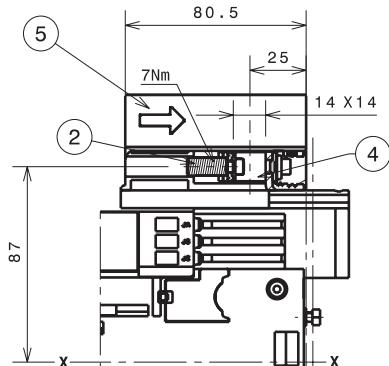


Terminals MC

Key
 1 Multicable terminals
 3 High terminal covers
 with degree of
 protection IP40
 4 Adaptor

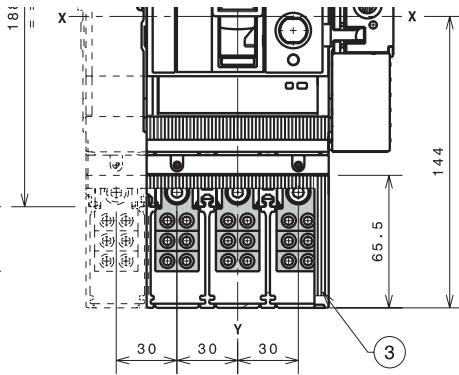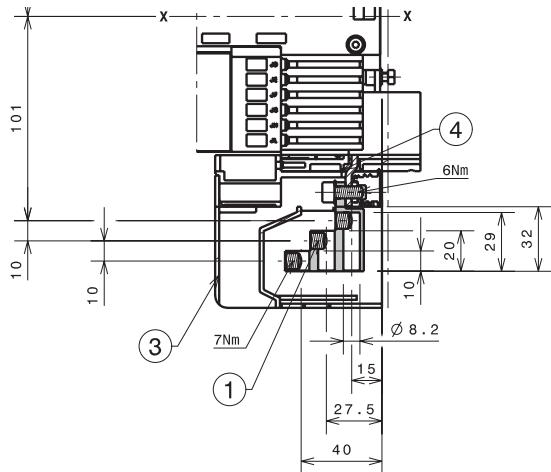

Terminals HR/VR

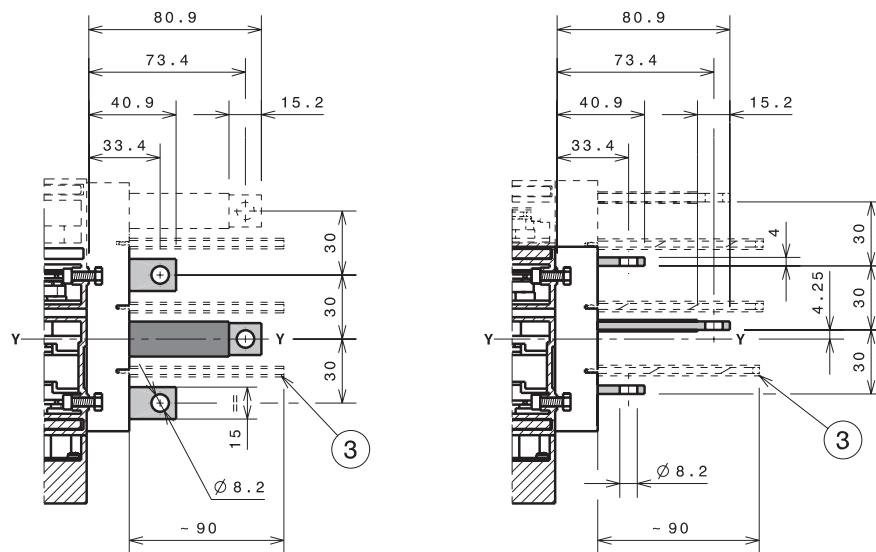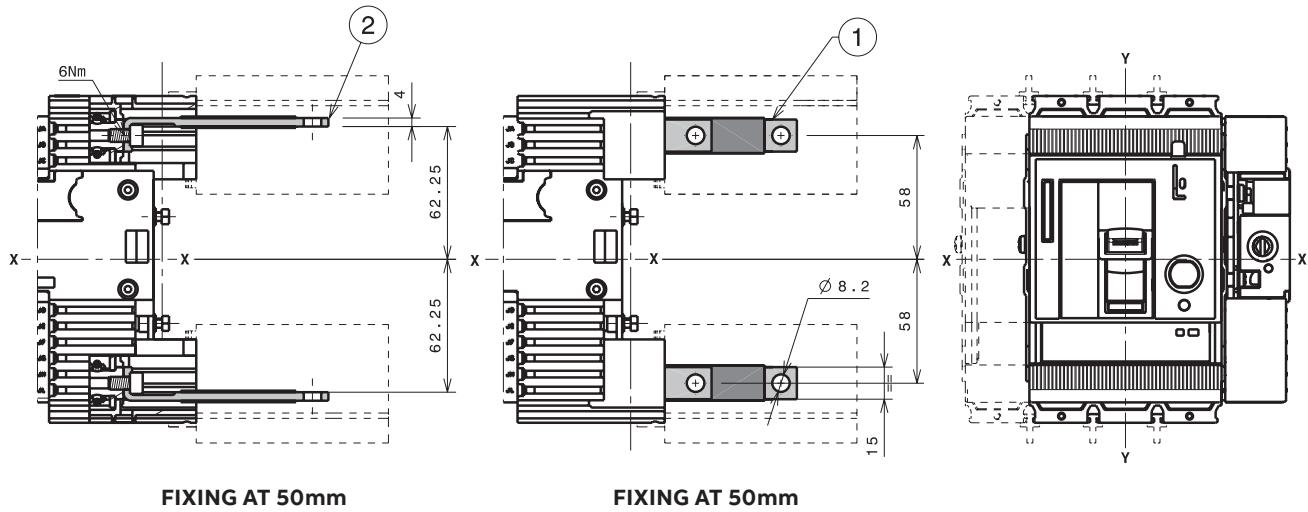


- Key
- 1 Rear vertical terminals
 - 2 Rear horizontal terminals
 - 3 Rear phase separators 90mm


Tmax XT2 – Installation

Accessories for withdrawable circuit-breaker

Rotary handle operating mechanism on circuit-breakers (RHD)

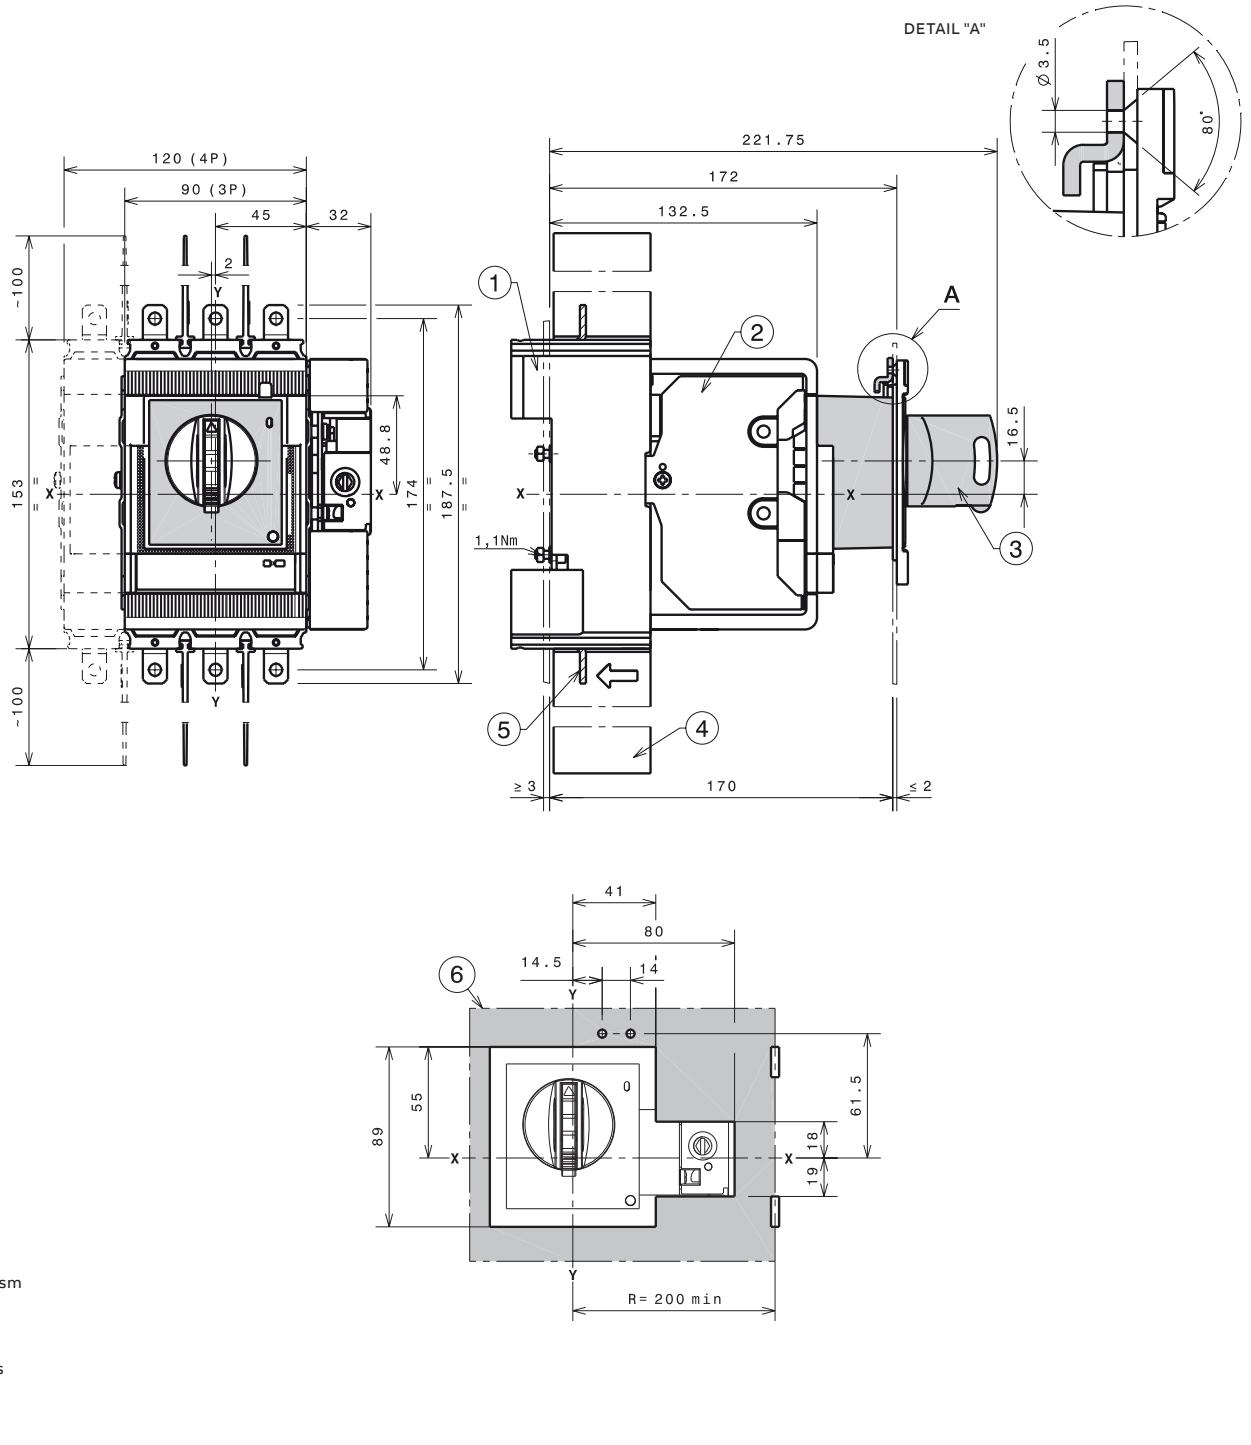


Rotary handle operating mechanism on the compartment door (RHE)

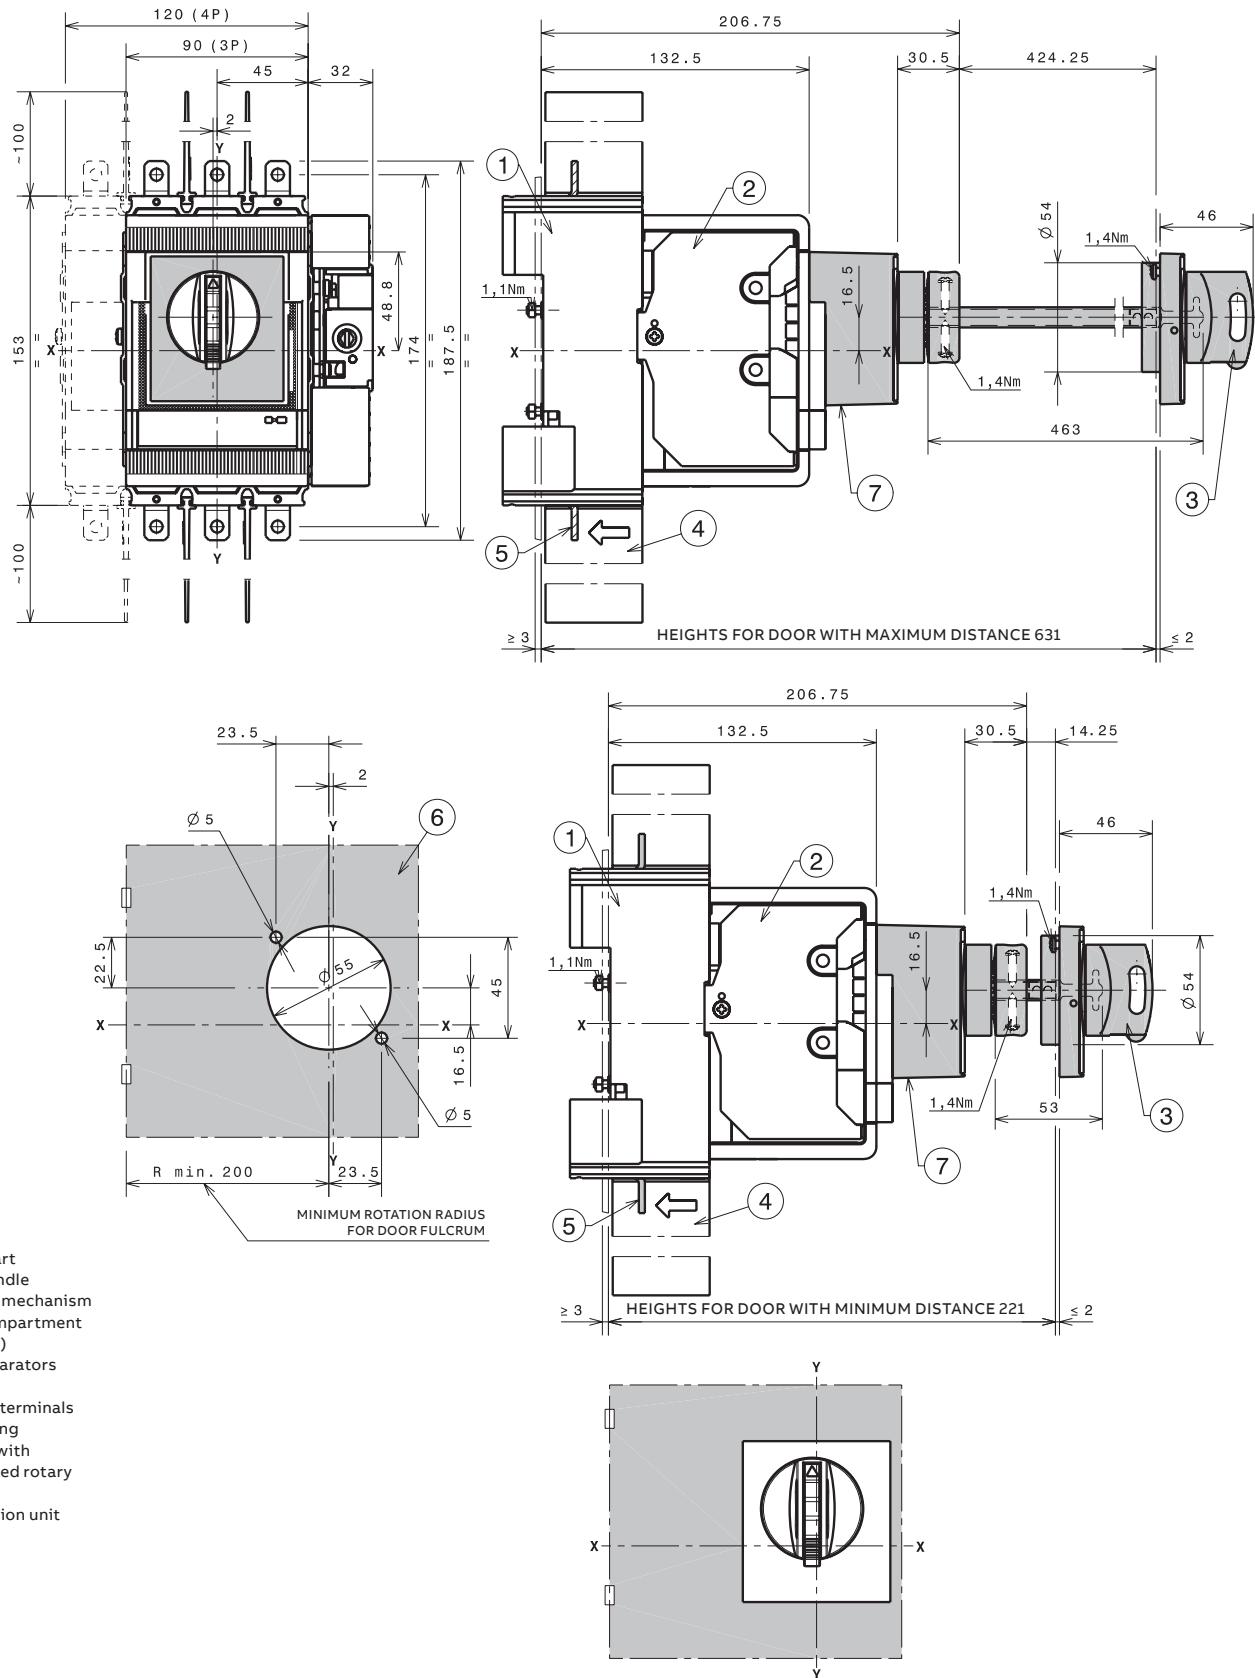



Tmax XT2 – Installation

Accessories for withdrawable circuit-breaker

Stored energy motor operator (MOE)

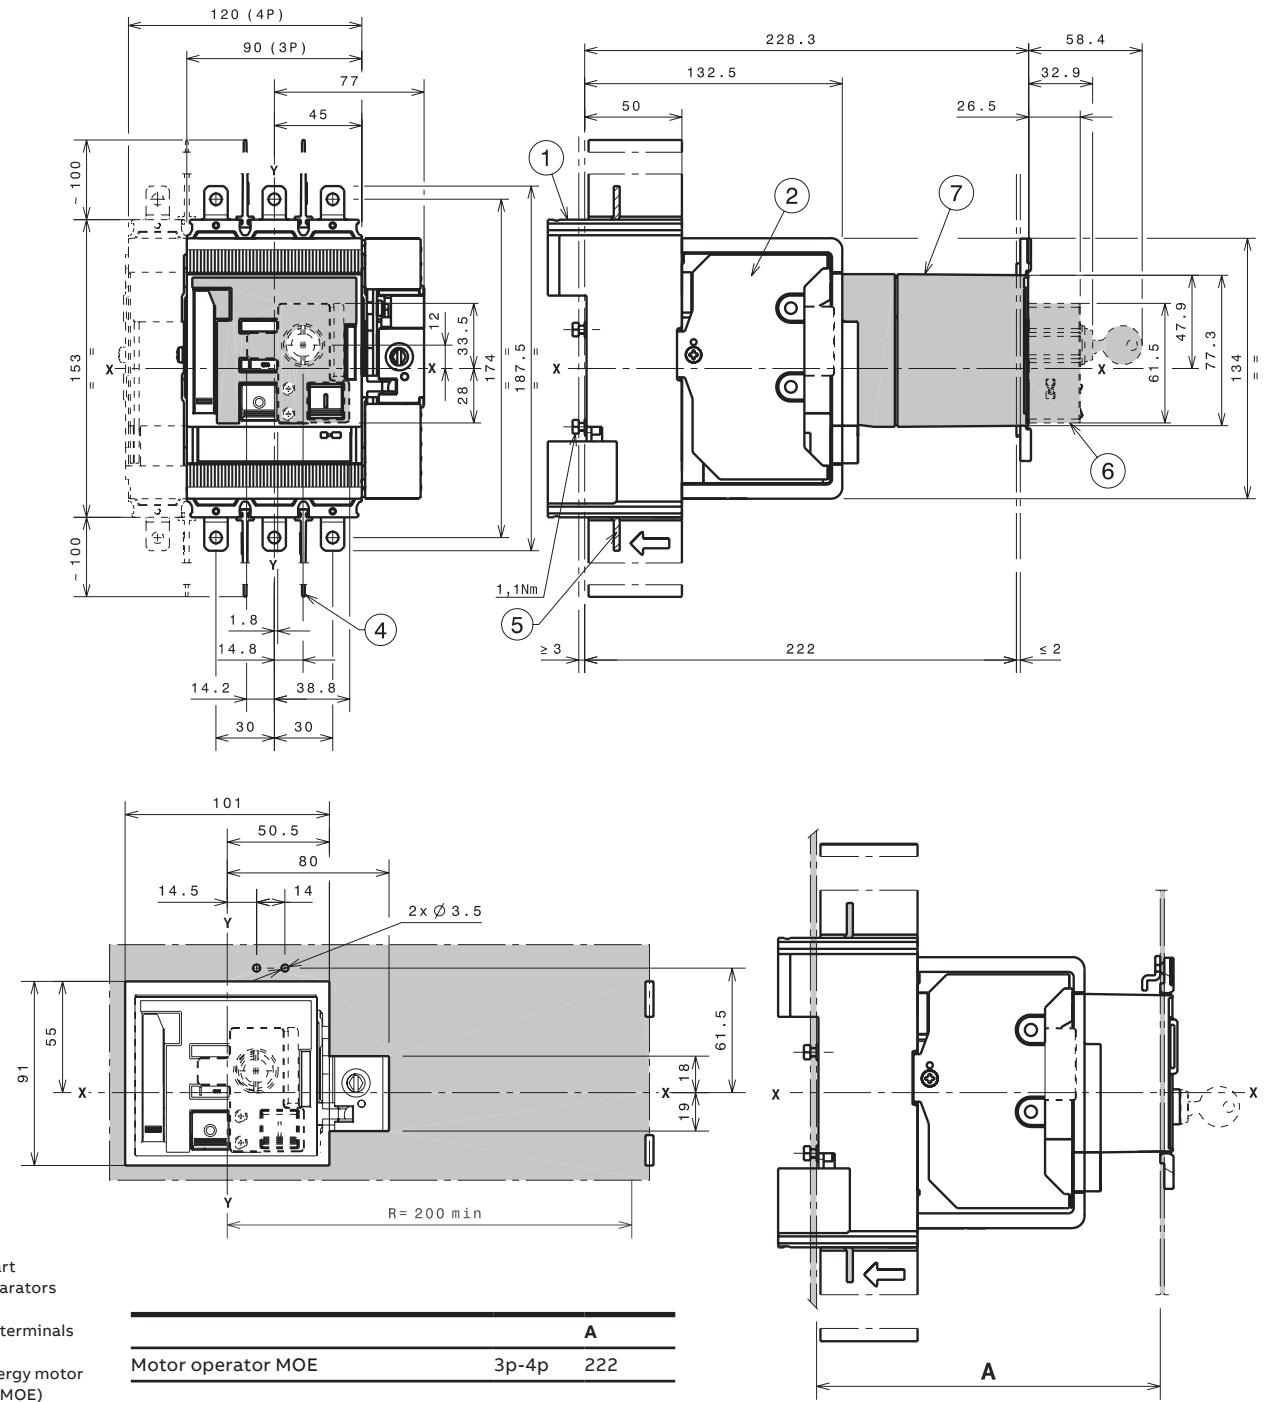

Front for lever operating (FLD)

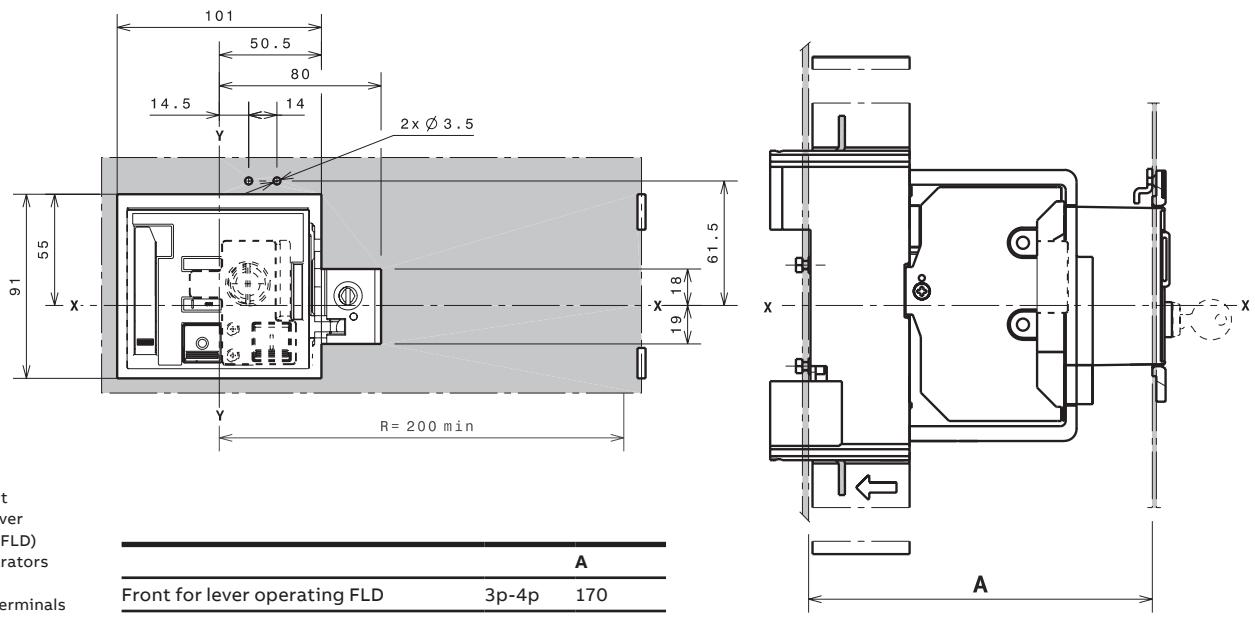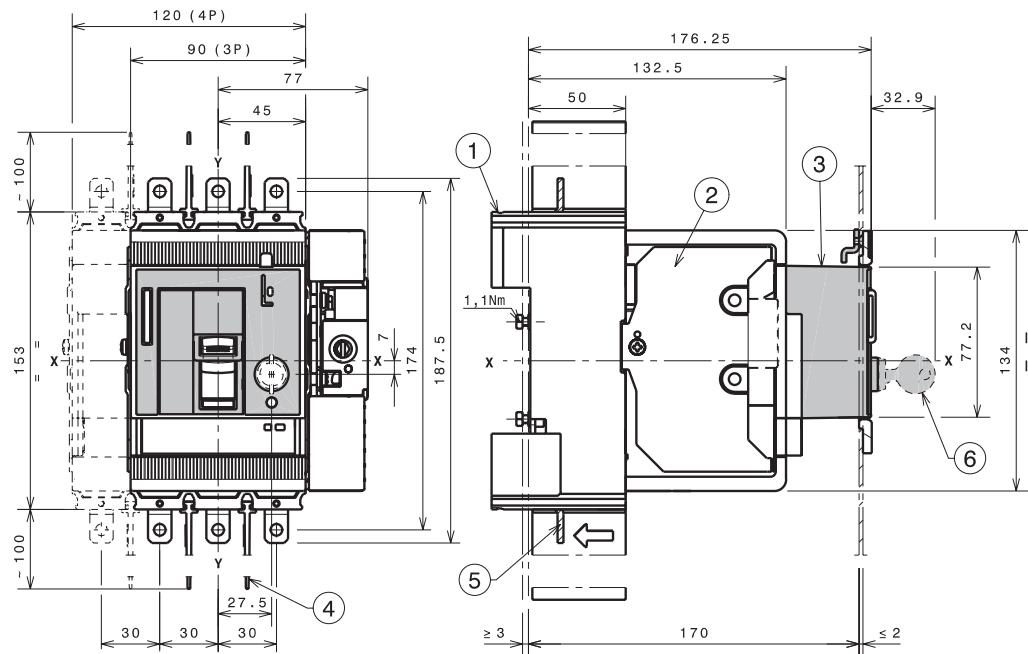

Key


- 1 Fixed part
- 2 Moving part
- 3 Front for lever operating (FLD)
- 4 Phase separators 100mm
- 5 Extended terminals
- 6 Key lock

A
Front for lever operating FLD 3p-4p 170

Tmax XT2 – Installation

Accessories for withdrawable circuit-breaker

Residual current RC Sel 4 poles

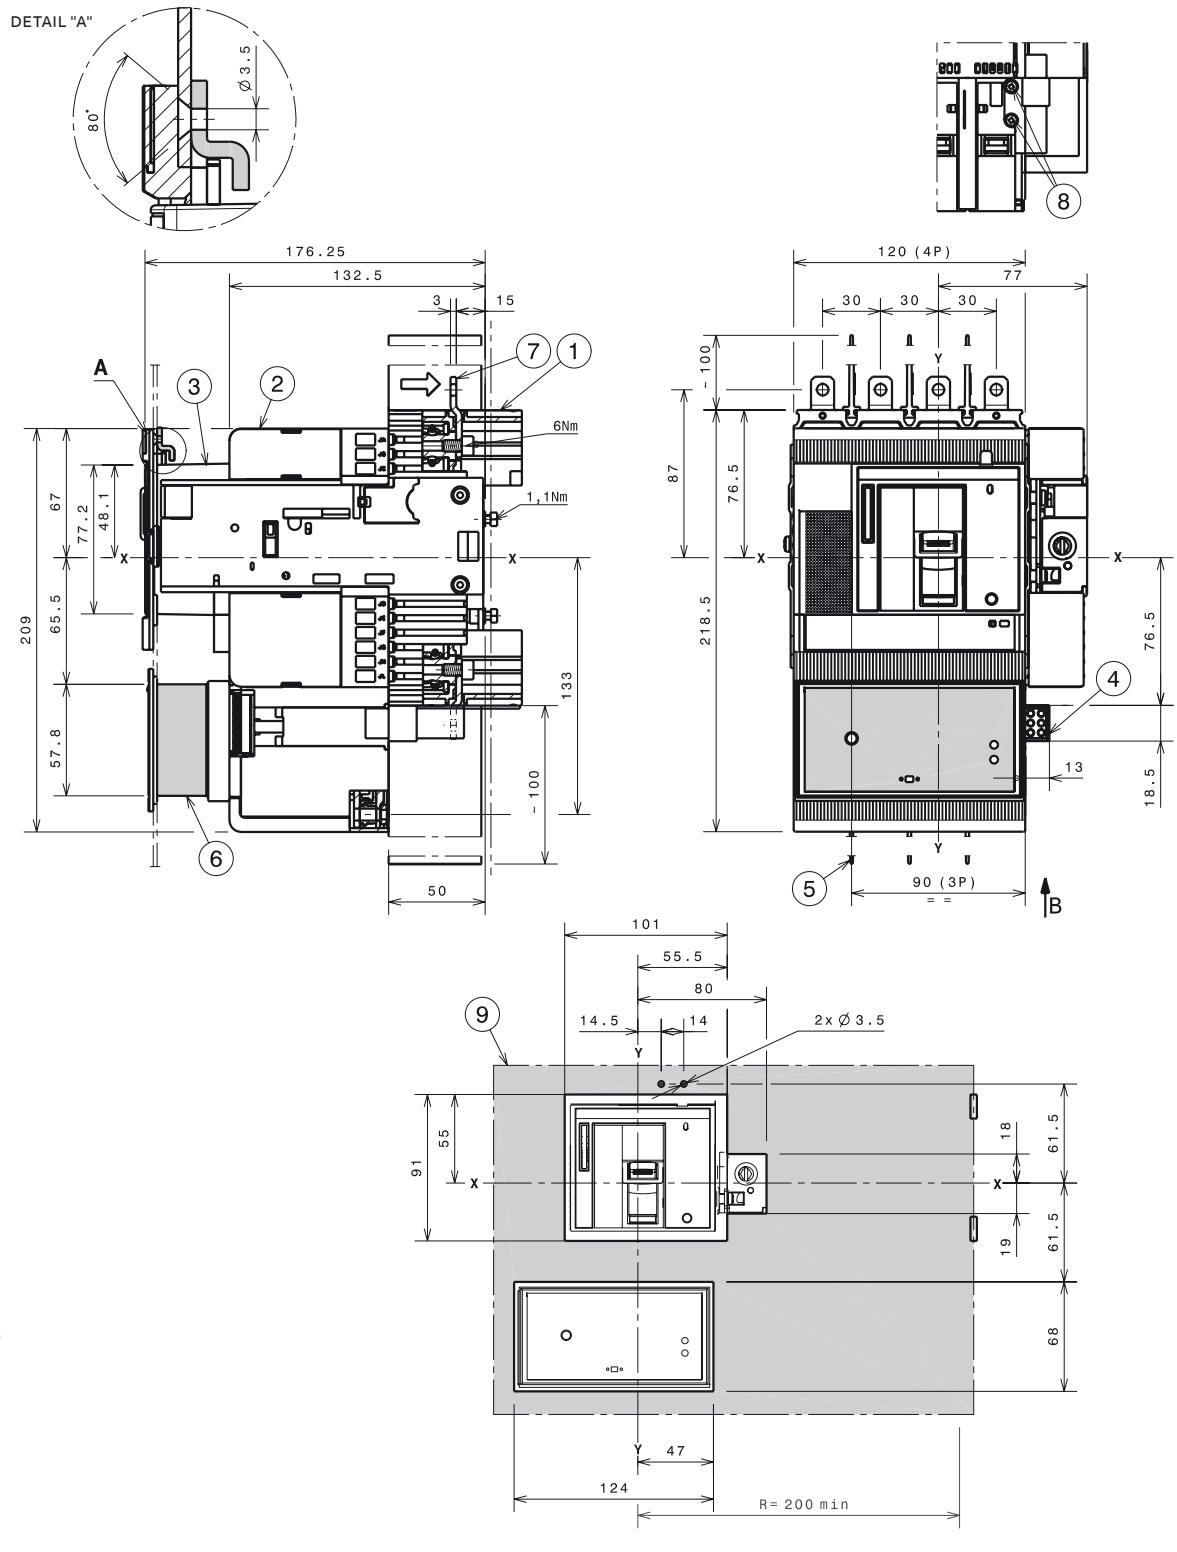


Tmax XT3 – Installation

Installation for fixed circuit-breaker


Fixing on sheet

- Key
2 Overall dimensions of optional wiring ducts
3 Phase separators 25mm

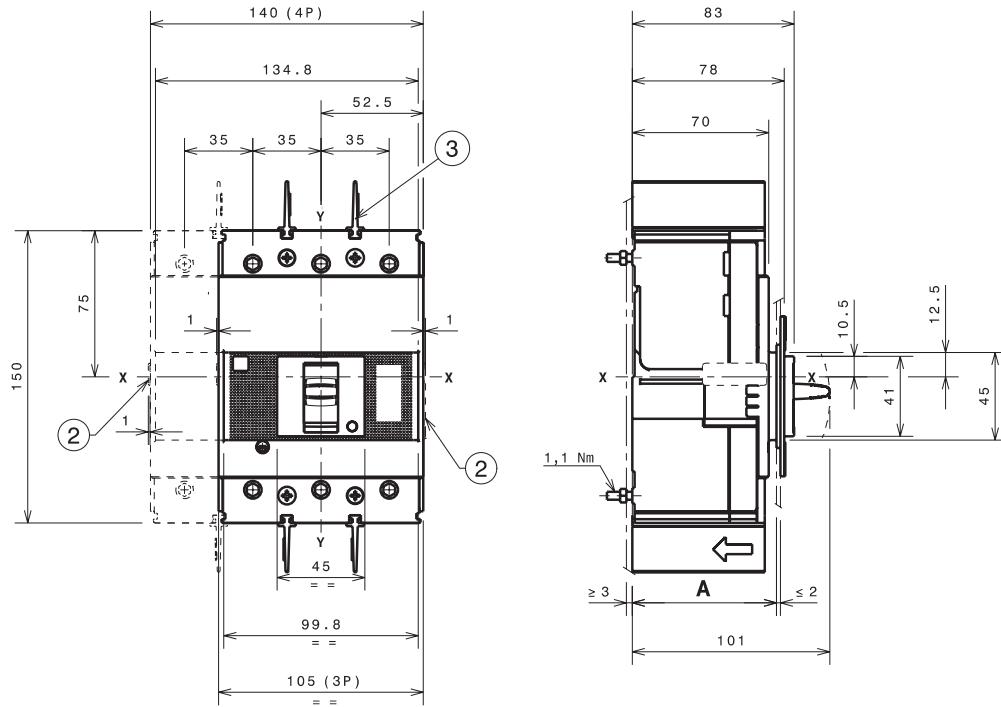

Fixing on DIN EN 50022 rail



- Key
1 Bracket for fixing
2 Optional wiring ducts
3 Optional front cover for DIN rail
4 Phase separators 25mm

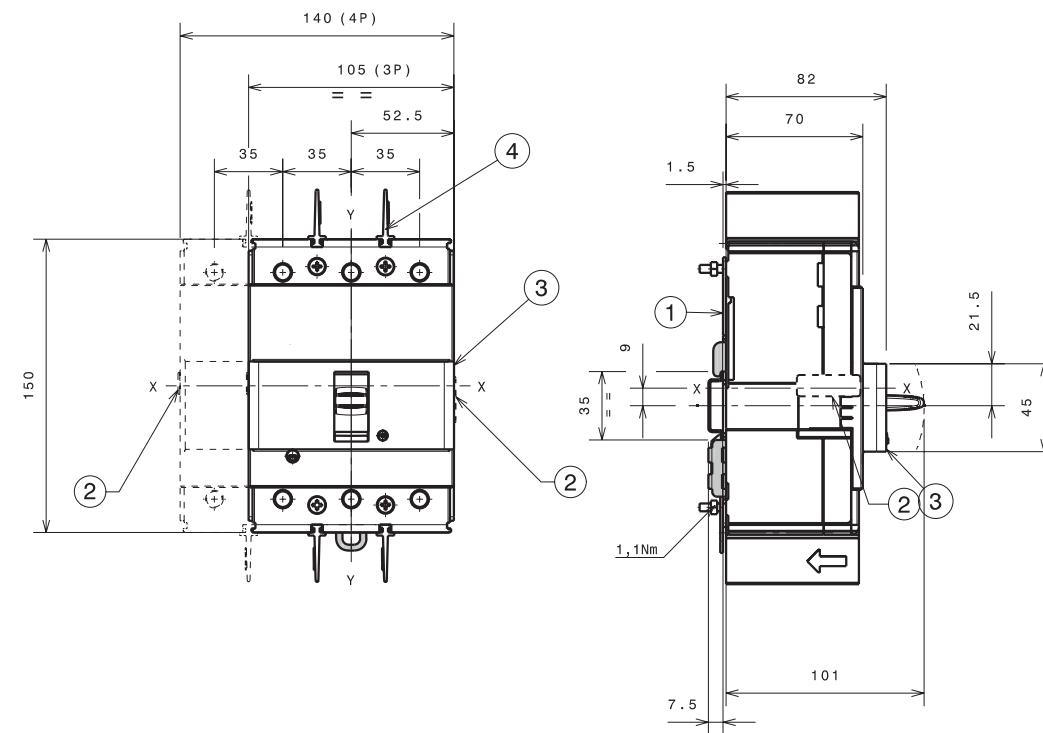

Tmax XT3 – Installation

Installation for fixed circuit-breaker








Drilling templates for circuit-breaker fixing

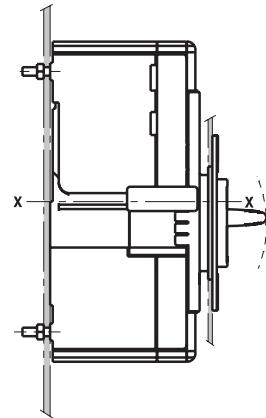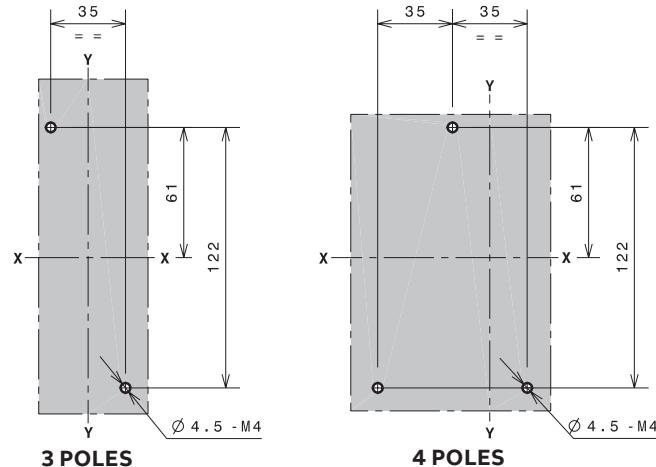

Flanges


Key

- 1 Flange for fixed circuit-breaker 3p
- 2 Flange for fixed circuit-breaker 4p
- 3 Flange for circuit-breaker with direct motor operator MOD
- 4 Flange for circuit-breaker with direct rotary handle (RHD)
- 5 Flange for circuit-breaker 3p with residual current
- 6 Flange for circuit-breaker 4p with residual current
- 7 Optional flange

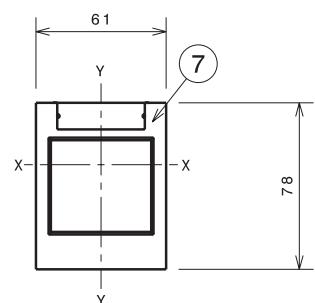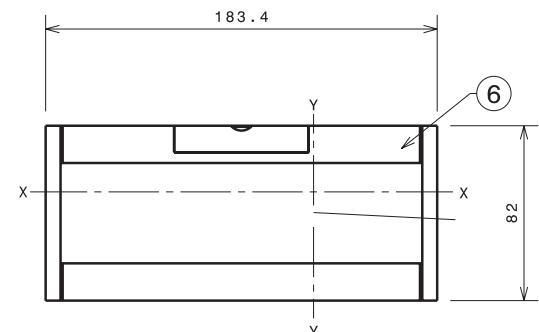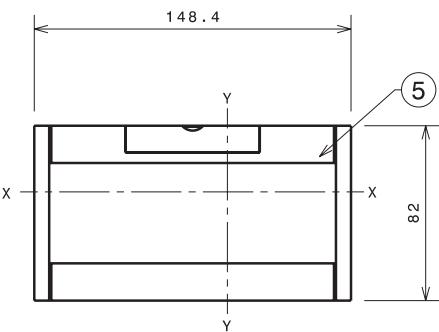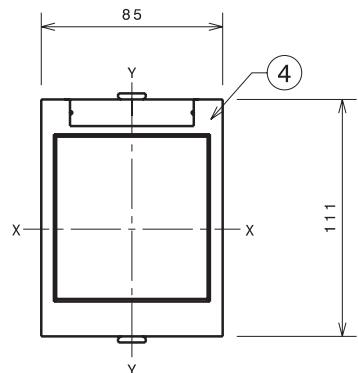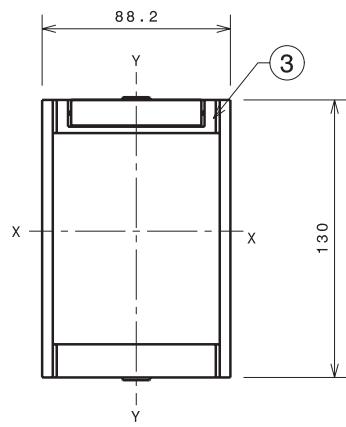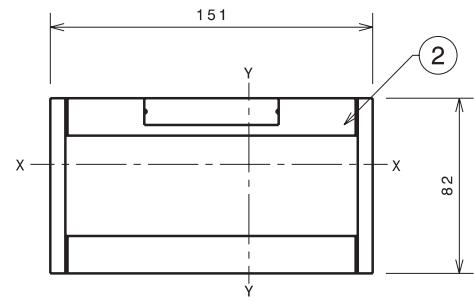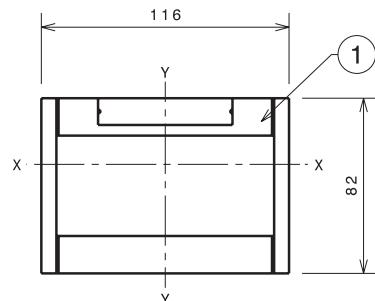


Compartment door drilling templates


With standard flange

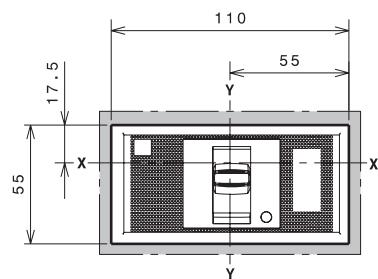


A=74
3 POLES

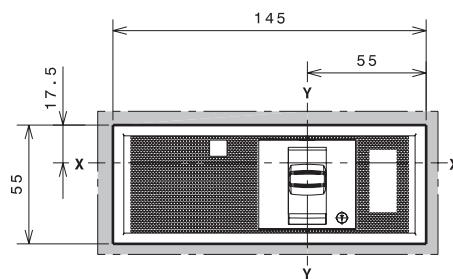


A=74
4 POLES

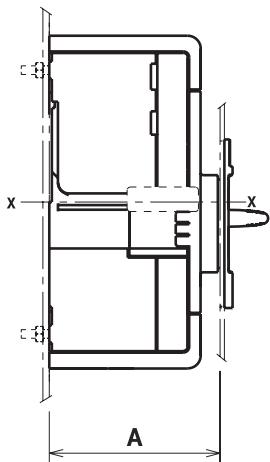


Without flange

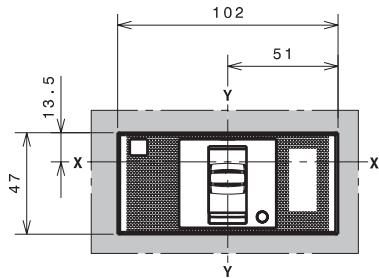

A=71
3 POLES

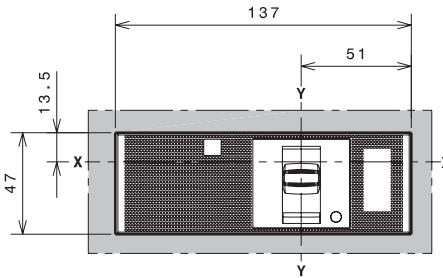


A=71
4 POLES

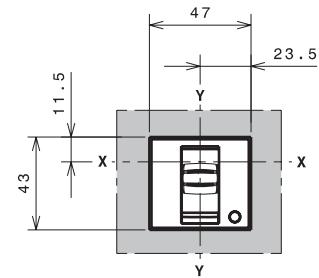


A=79
3-4 POLES

With optional flange

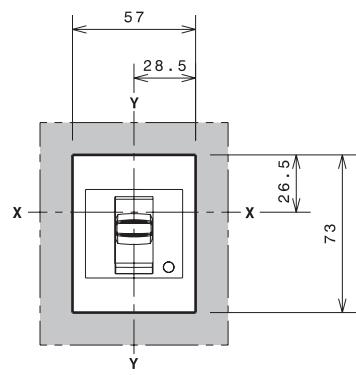

A=79
3-4 POLES

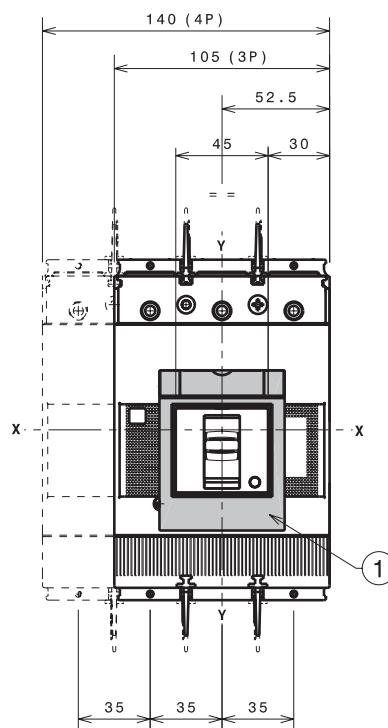



Key
1 Optional flange

Tmax XT3 – Installation

Terminals for fixed circuit-breaker



Terminals F

—
Key
1 Front terminals for busbars connection
7 Phase separators 25mm

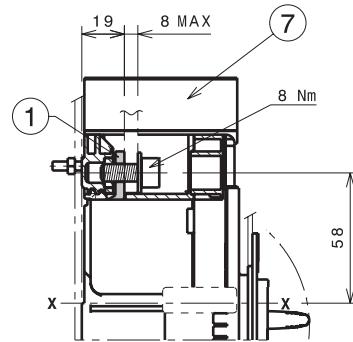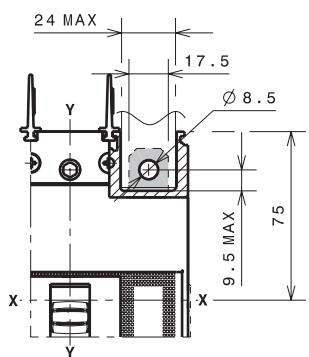




Terminals EF

—
Key
2 Front extended terminals
3 Terminal covers with degree of protection IP40 (optional) not provided
5 Phase separators 100mm

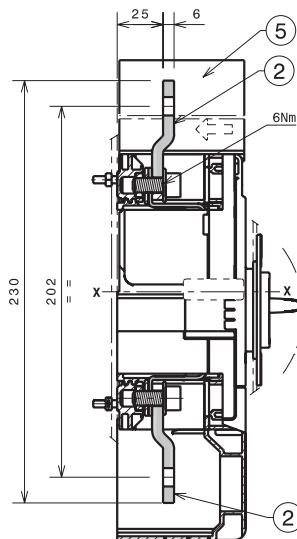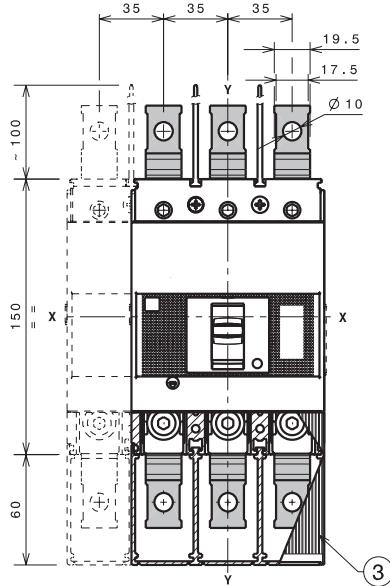



Terminals ES

—
Key
4 Front extended spread terminals for busbars connection
6 Phase separators 200mm

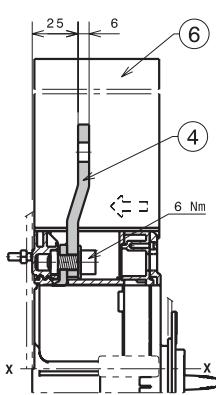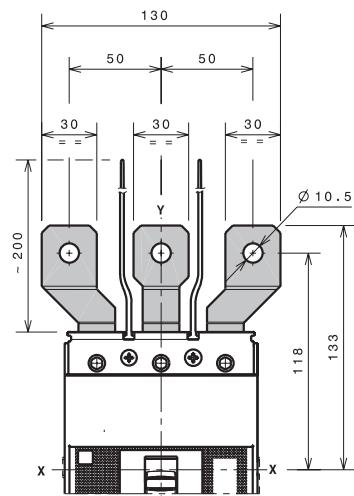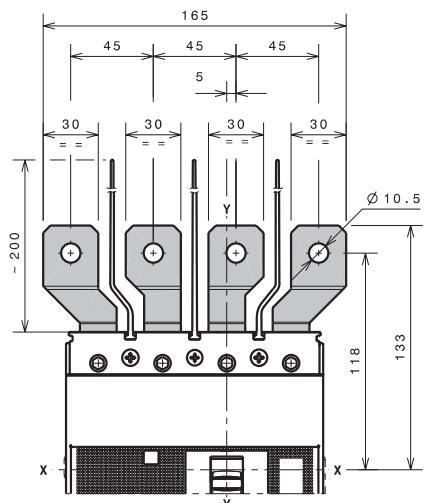


1x95...185mm² terminals FCCuAl

Key
 1 1x95...185mm²
 terminals FCCuAl
 9 Phase separators
 25mm

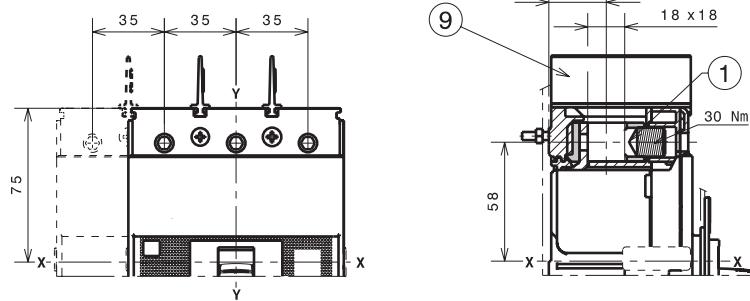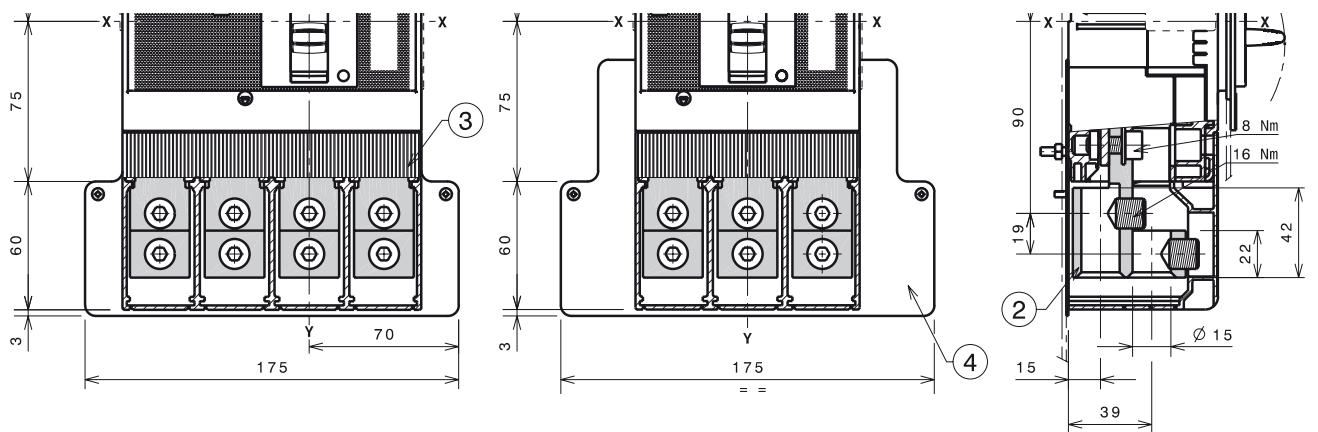2x35...120mm² terminals FCCuAl

Key
 2 2x35...120mm²
 terminals FCCuAl
 3 Terminal covers
 with degree of
 protection IP40
 4 Rear insulated plate
 7 Drilling template for
 circuit-breaker fixing
 on sheet 3p with
 rear insulated plate
 8 Drilling template for
 circuit-breaker fixing
 on sheet 4p with
 rear insulated plate


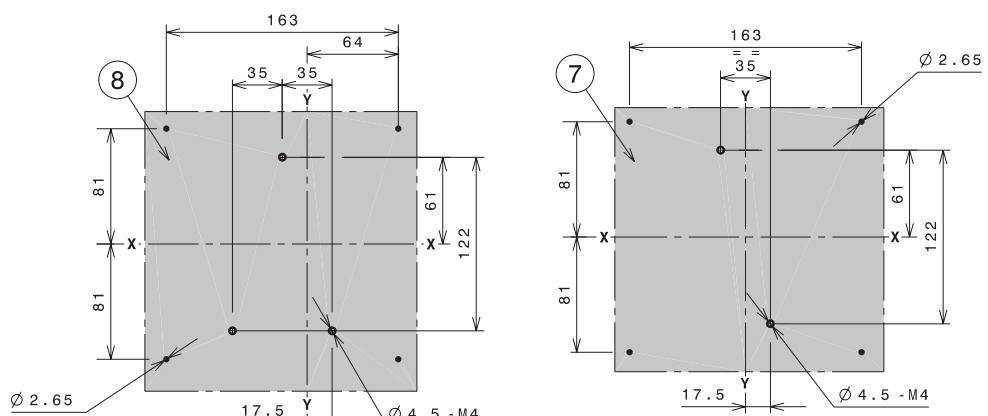


Tmax XT3 – Installation

Terminals for fixed circuit-breaker


30...150mm² terminals FCCuAl

- Key
1 30...150mm²
terminals FCCuAl
2 Phase separators
25mm

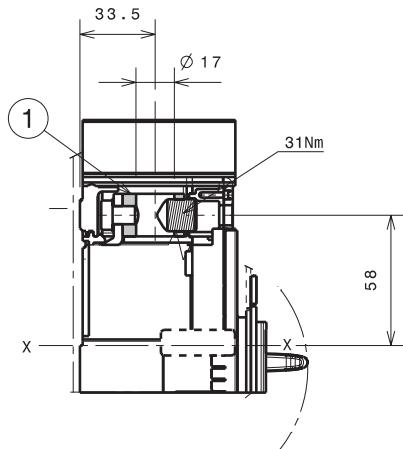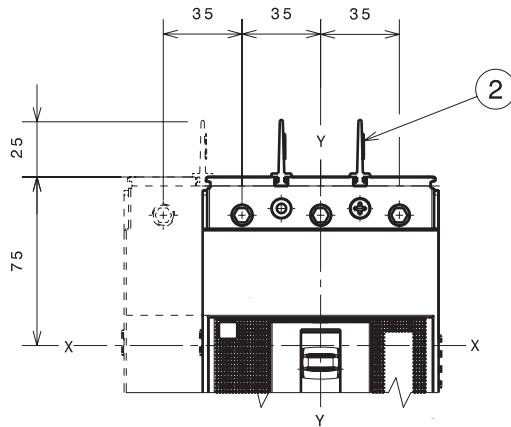



Terminals FCCu

- Key
6 Front terminals FCCu
9 Phase separators
25mm

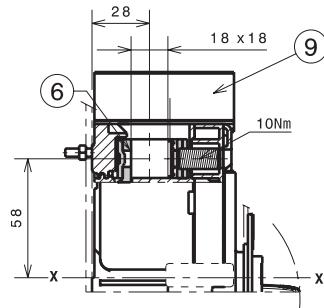


Terminals MC

- Key
3 Terminal covers
with degree of
protection IP40
5 Front terminal
for multicable
connection

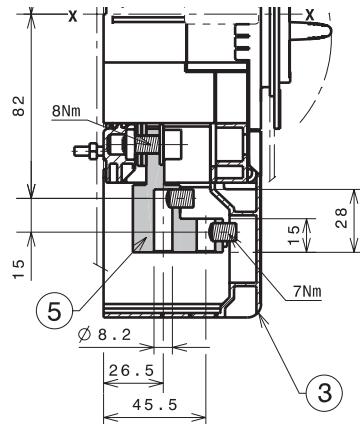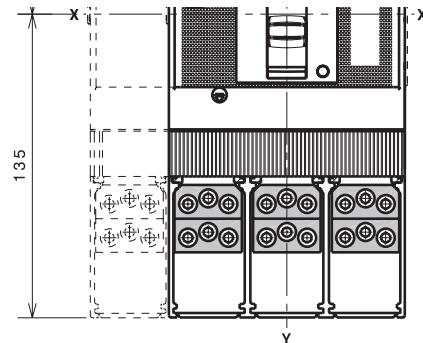

Terminals R

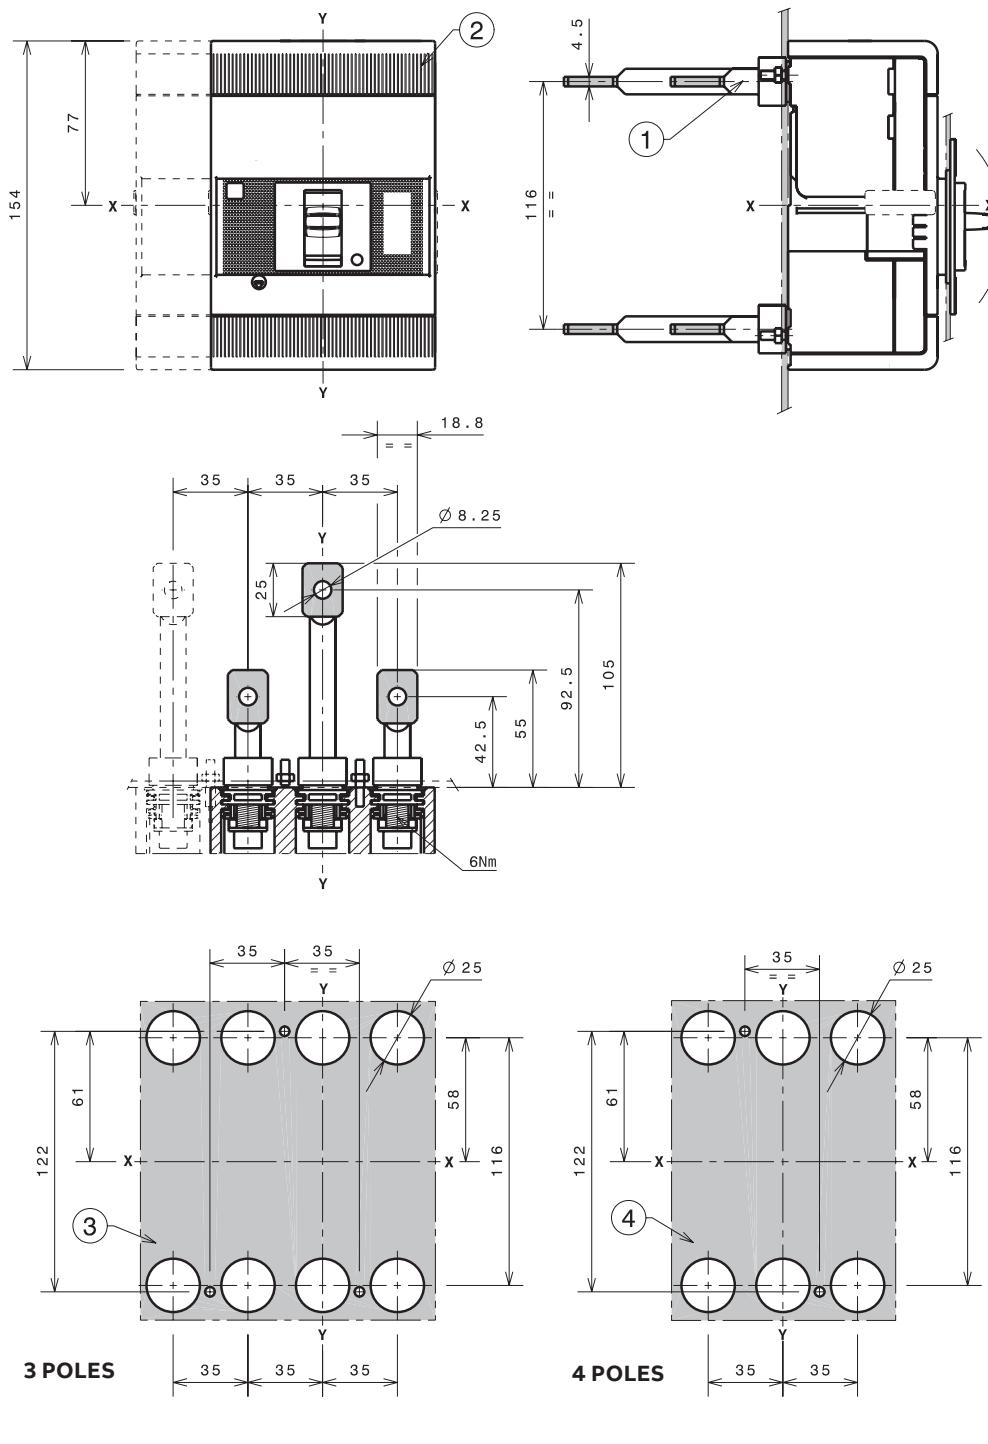



Key

- 1 Adjustable rear terminals
- 2 Bottom terminal covers with degree of protection IP30
- 3 Drilling template for circuit-breaker 4p fixing on sheet
- 4 Drilling template for circuit-breaker 3p fixing on sheet

Tmax XT3 – Installation

Accessories for fixed circuit-breaker

Rotary handle operating mechanism on circuit-breaker (RHD)

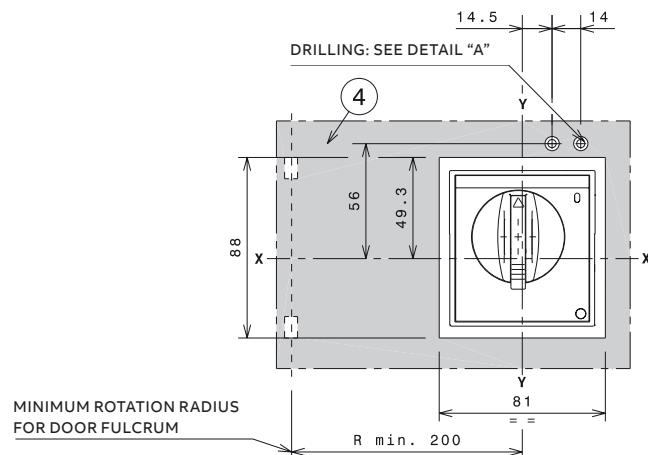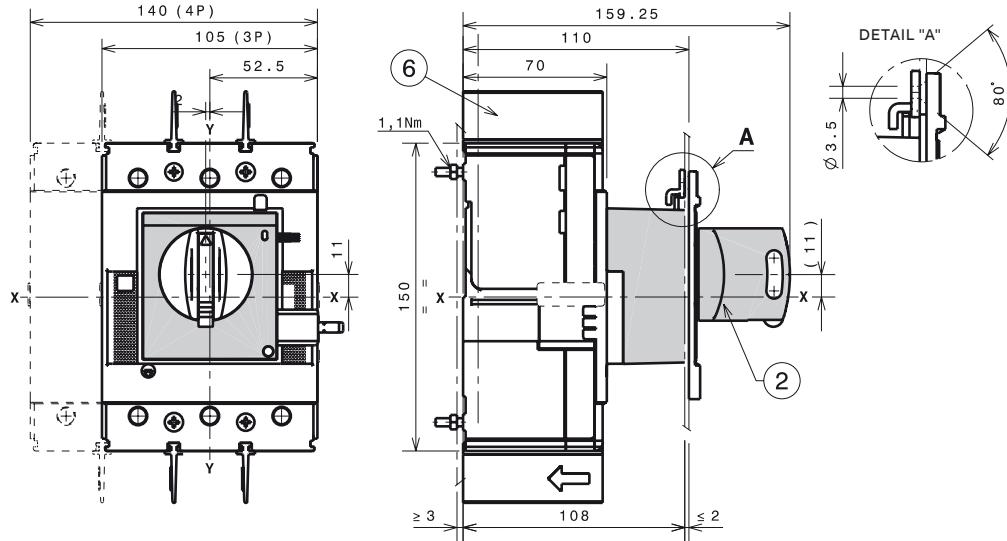


—

Key

- 2 Rotary handle operating mechanism on circuit-breaker RHD
- 4 Drilling template of door with direct rotary handle
- 6 Phase separators 25mm

Rotary handle operating mechanism on the compartment door (RHE)

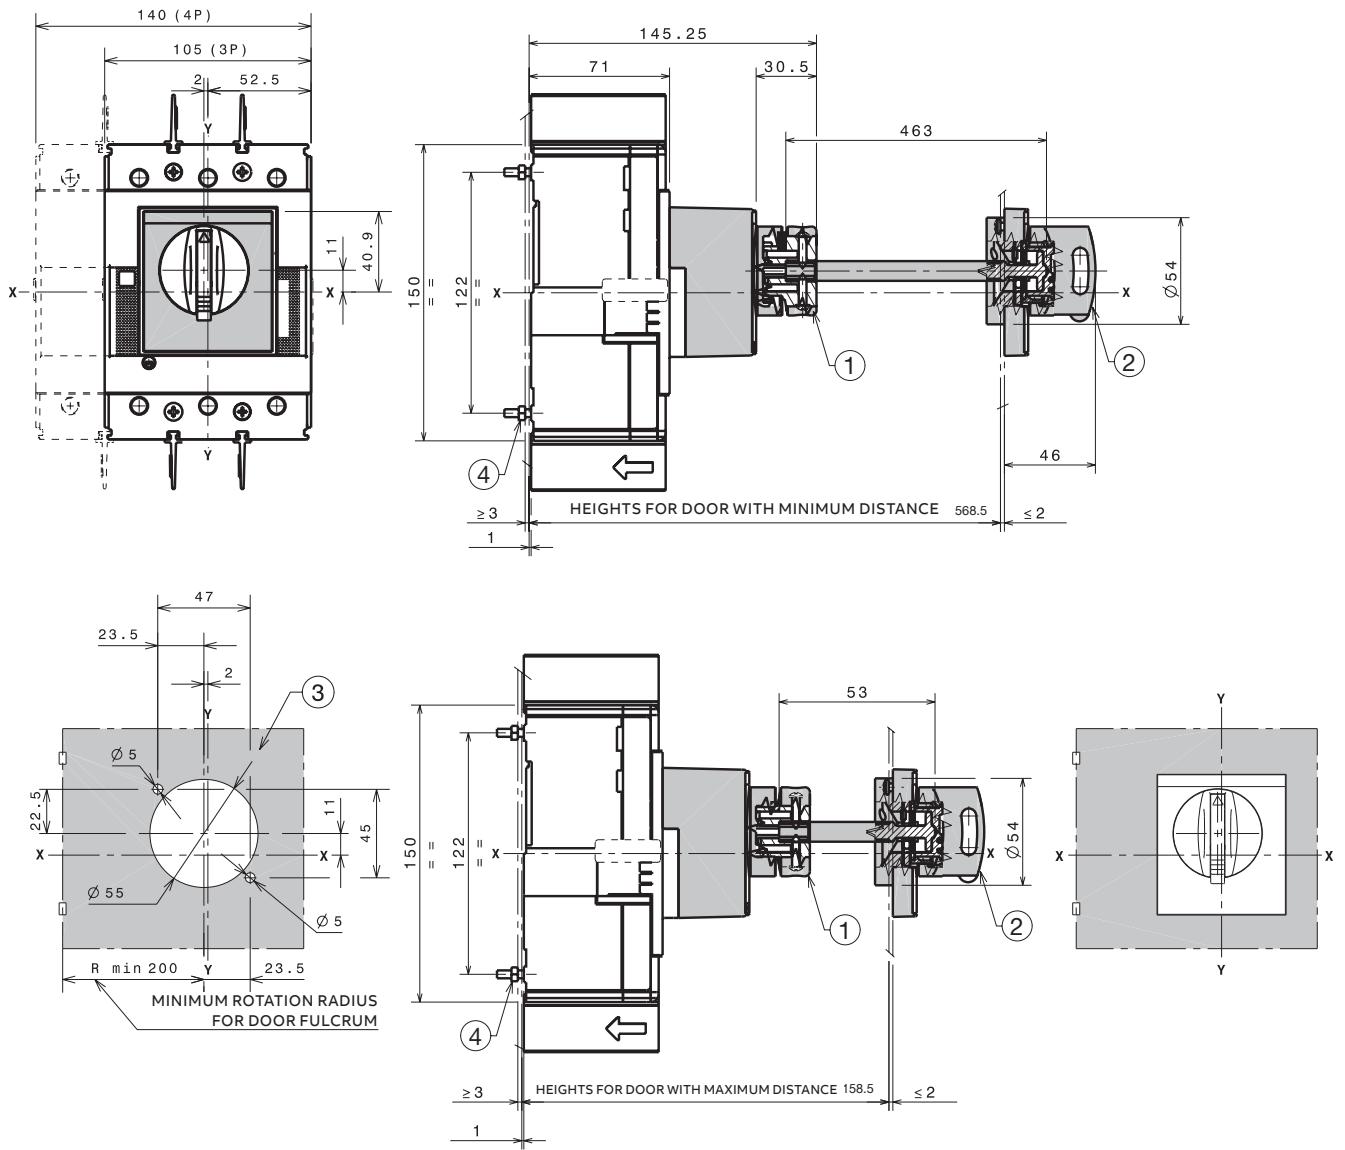


Key

- 1 Transmission mechanism
- 2 Rotary handle operating mechanism for compartment door (RHE)
- 3 Compartment door drilling template
- 4 Tightening torque 1.1Nm

Tmax XT3 – Installation


Accessories for fixed circuit-breaker

Large rotary handle operating mechanism on the compartment door (RHE-LH)

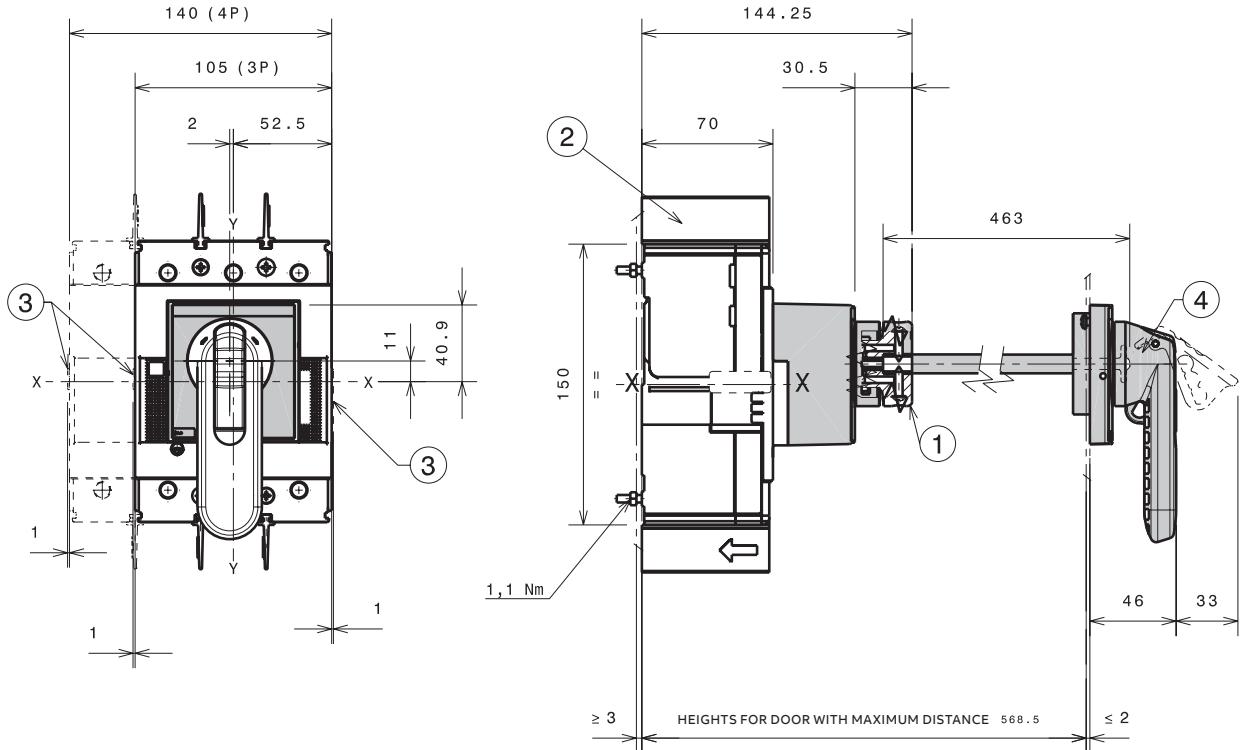


- Key**
- 1 Transmission unit
 - 2 Phase separators
25mm
 - 3 Optional wiring ducts
 - 4 Large transmitted
rotary handle
 - 5 Drilling template of
door with large
transmitted
rotary handle

MINIMUM DISTANCE FROM DOOR HINGE min 200

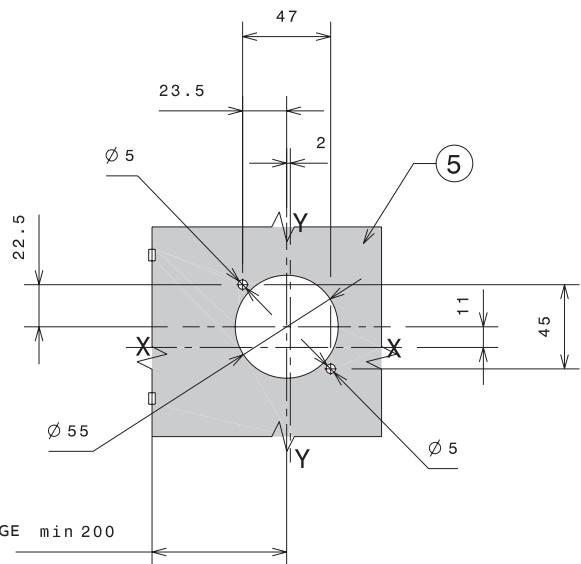

Direct motor operator (MOD)

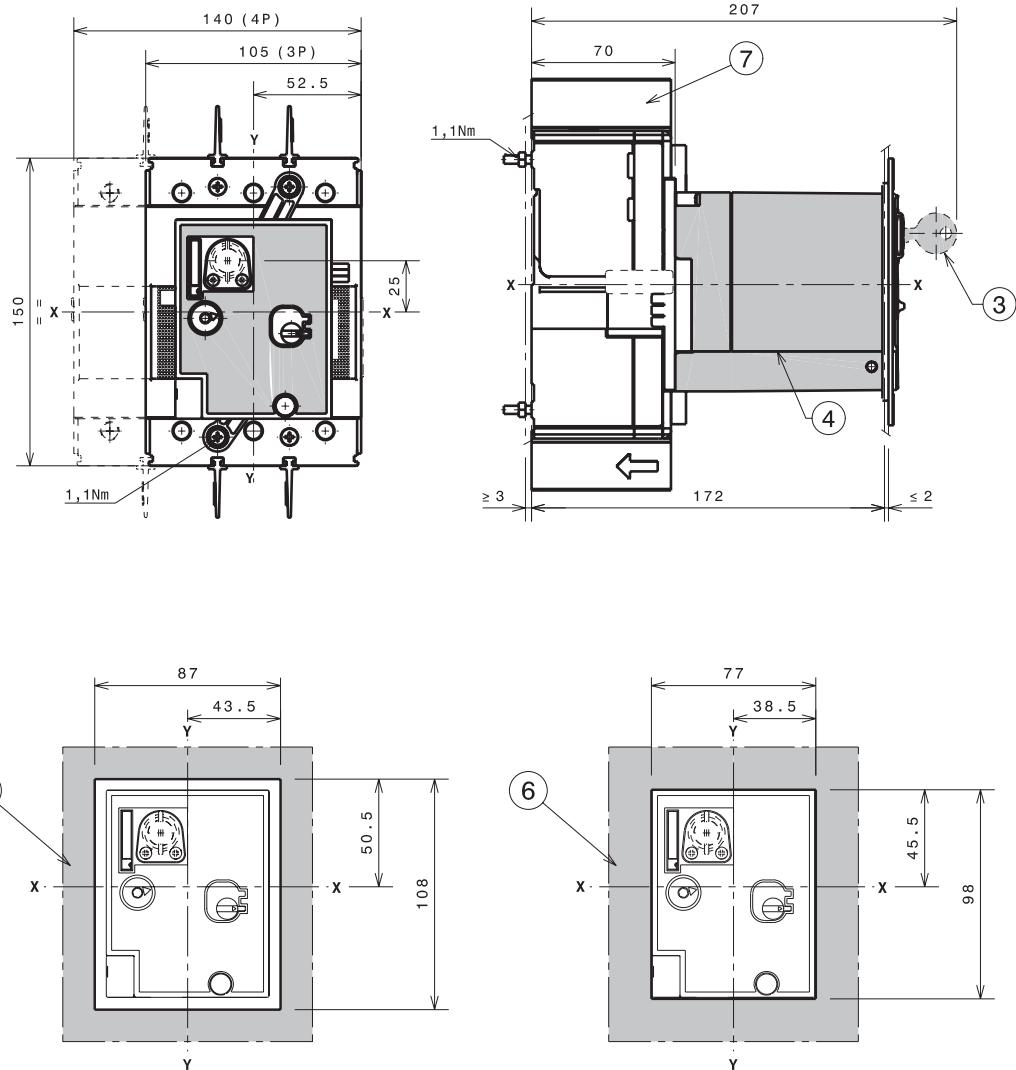


Key

- 3 Key lock
- 4 Direct motor operator MOD
- 5 Drilling template of door with MOD with flange
- 6 Drilling template of door with MOD without flange
- 7 Phase separators 25mm


Tmax XT3 – Installation

Accessories for fixed circuit-breaker

RC Inst and RC Sel residual current release for 3 poles circuit-breaker

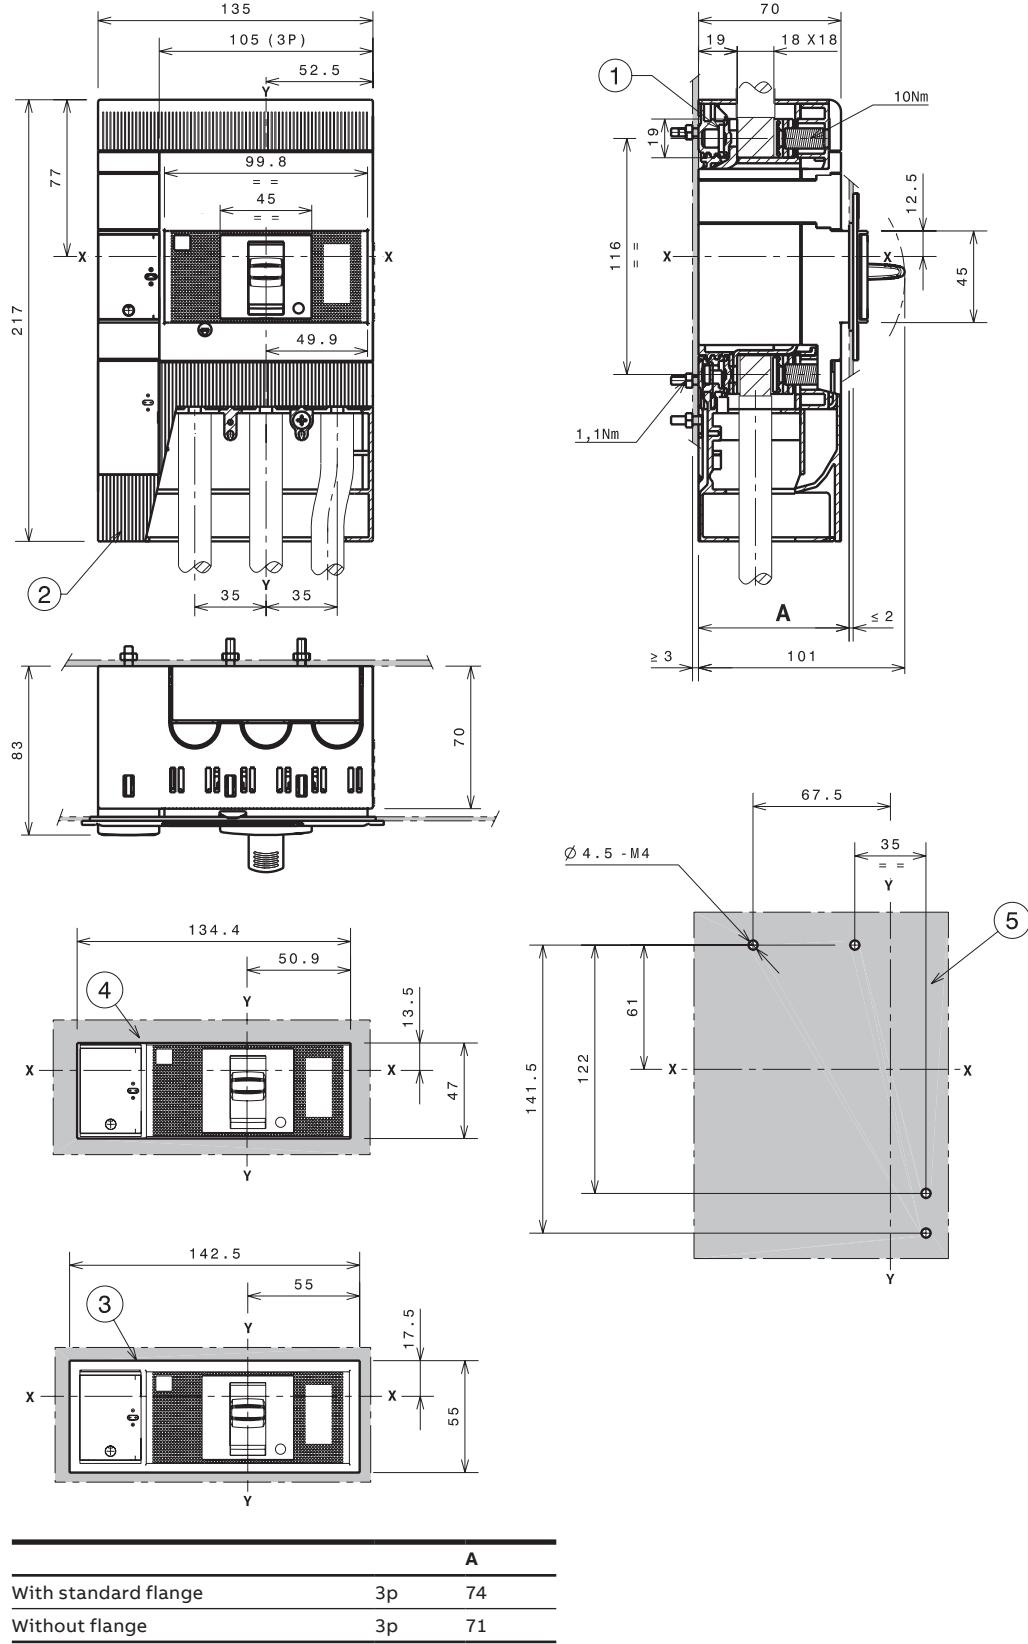


RC Inst and RC Sel residual current release for 4 poles circuit-breaker

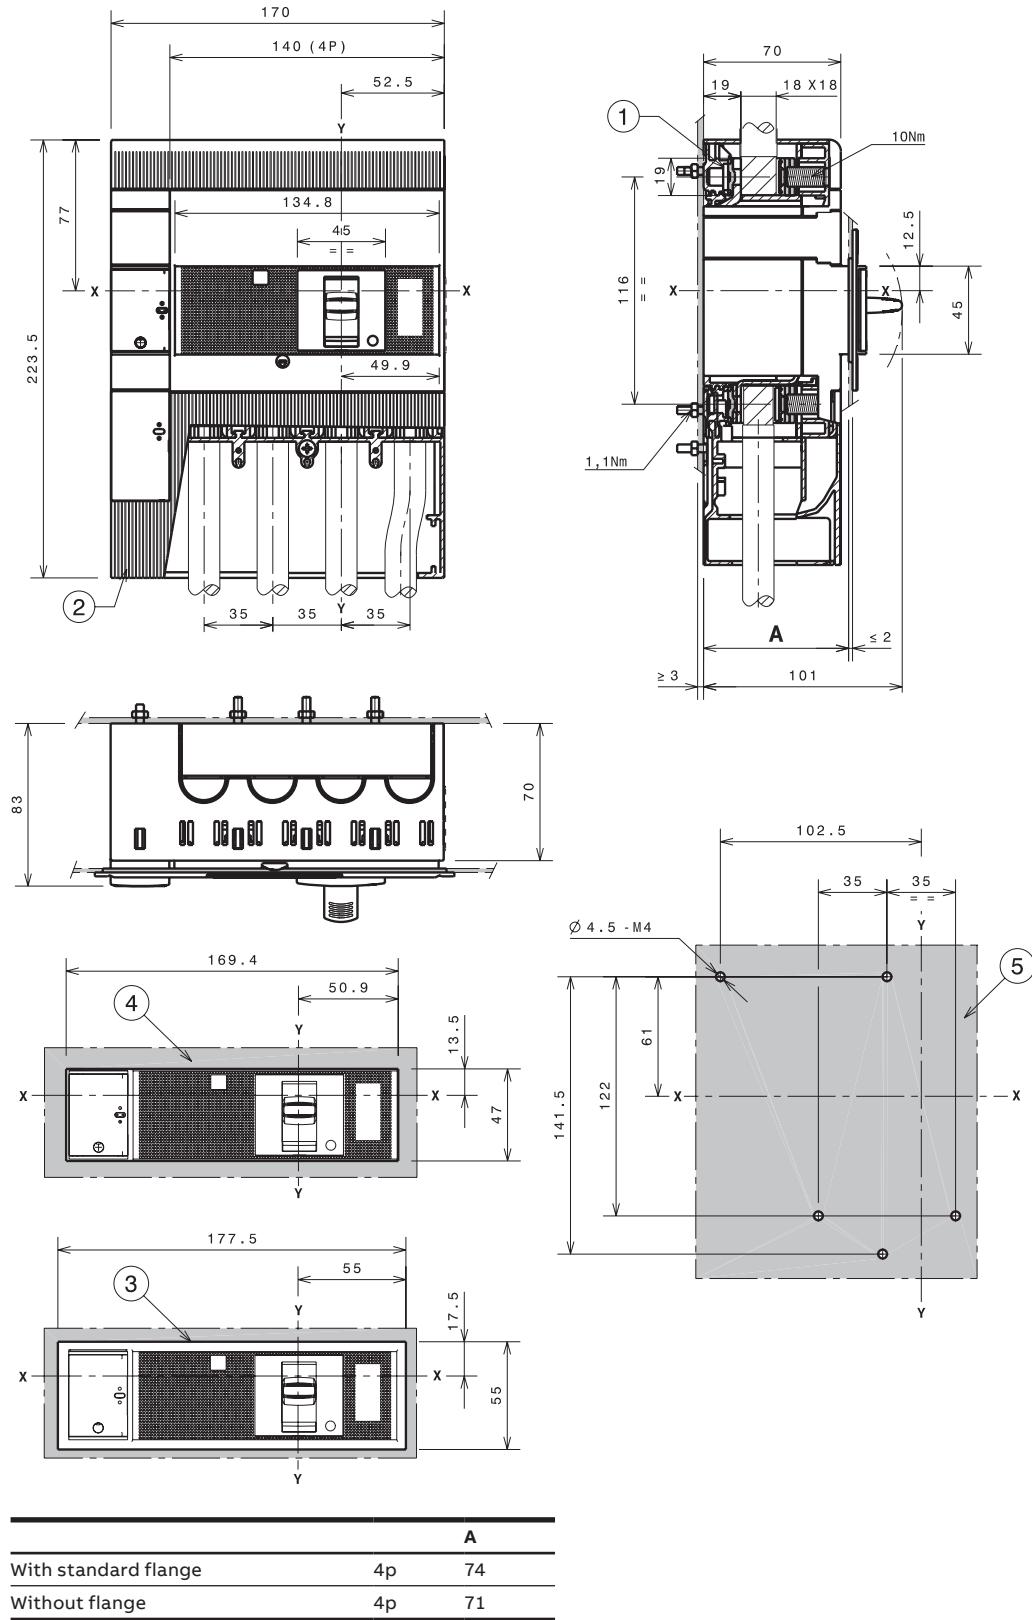

Tmax XT3 – Installation

Installation for plug-in circuit-breaker

Fixing on support sheet

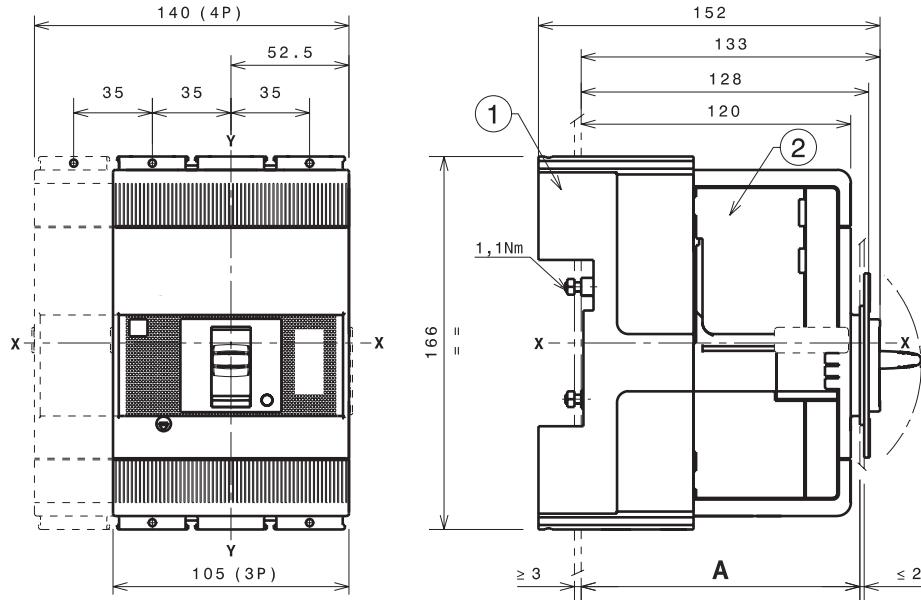


| Fixing at 50mm | A |
|-----------------------|-----------|
| With standard flange | 3p-4p 124 |
| Without flange | 3p-4p 121 |
| | 3p-4p 129 |

| Fixing at 70mm for extended front terminals | A |
|--|-----------|
| With standard flange | 3p-4p 144 |
| Without flange | 3p-4p 141 |
| | 3p-4p 149 |

—
Key
1 Fixed part
2 Moving part


Drilling templates for support sheet

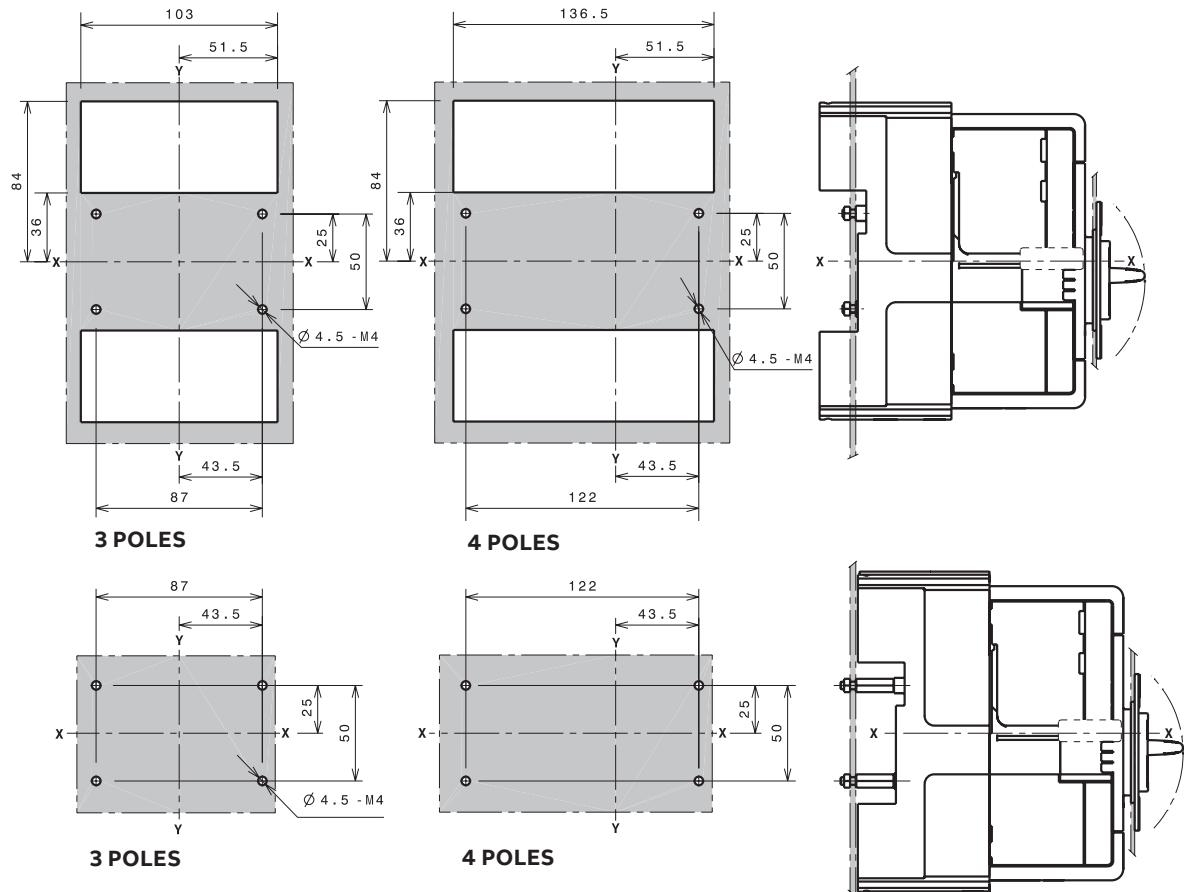

Flanges

Key

- 1 Flange for plug-in circuit-breaker 3p
- 2 Flange for plug-in circuit-breaker 4p
- 3 Flange for plug-in circuit-breaker with direct motor operator MOD
- 7 Optional flange

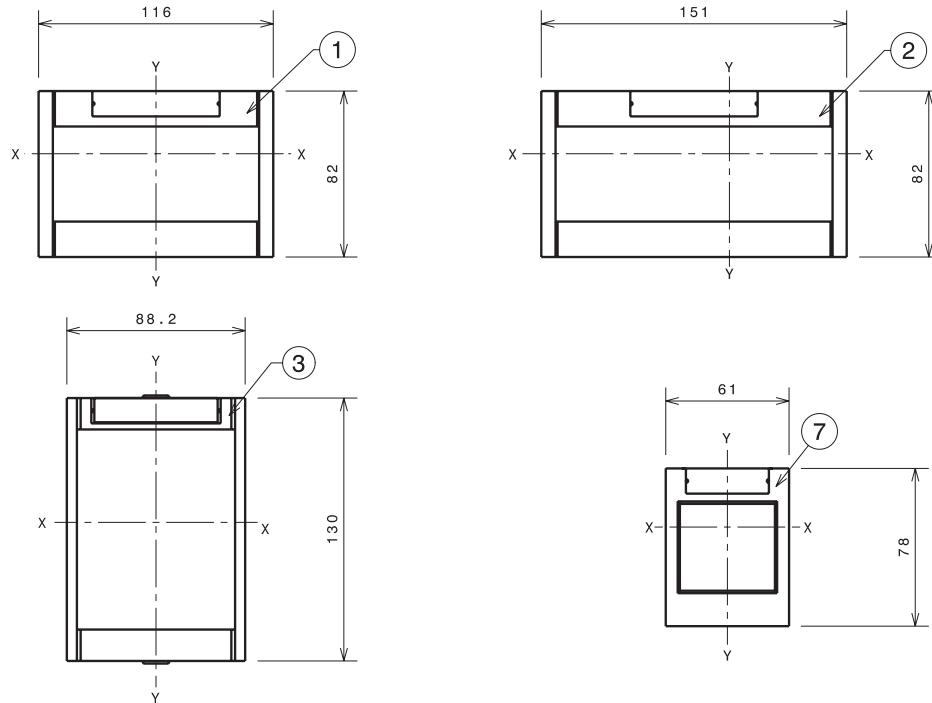


Tmax XT3 – Installation


Installation for plug-in circuit-breaker

Compartment door drilling templates


With standard flange

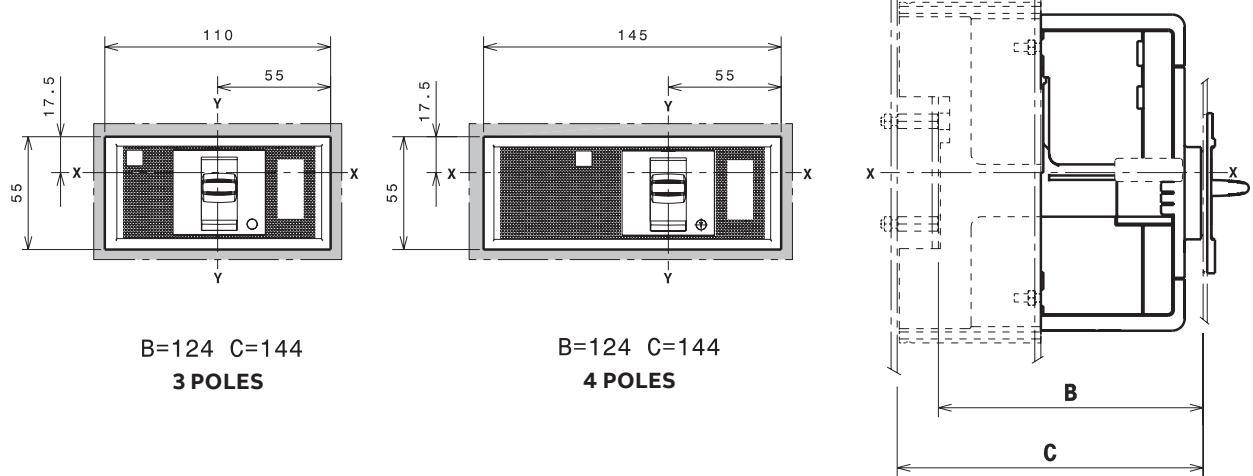

Without flange

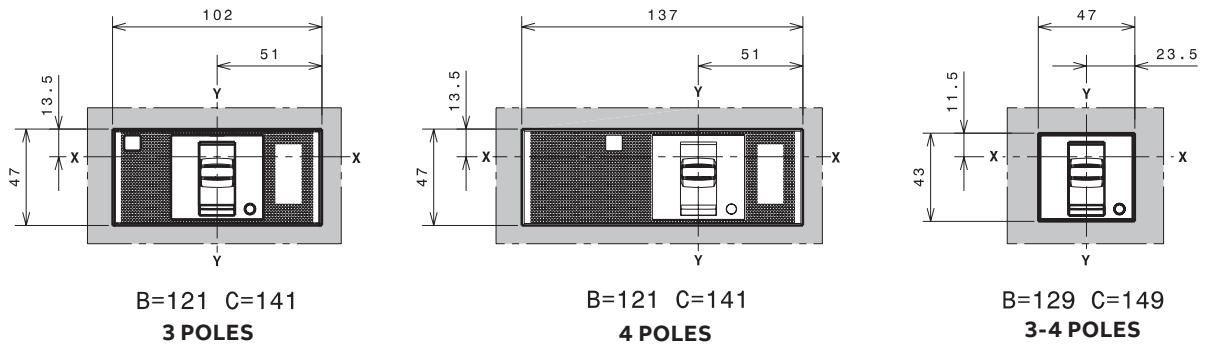


With optional flange

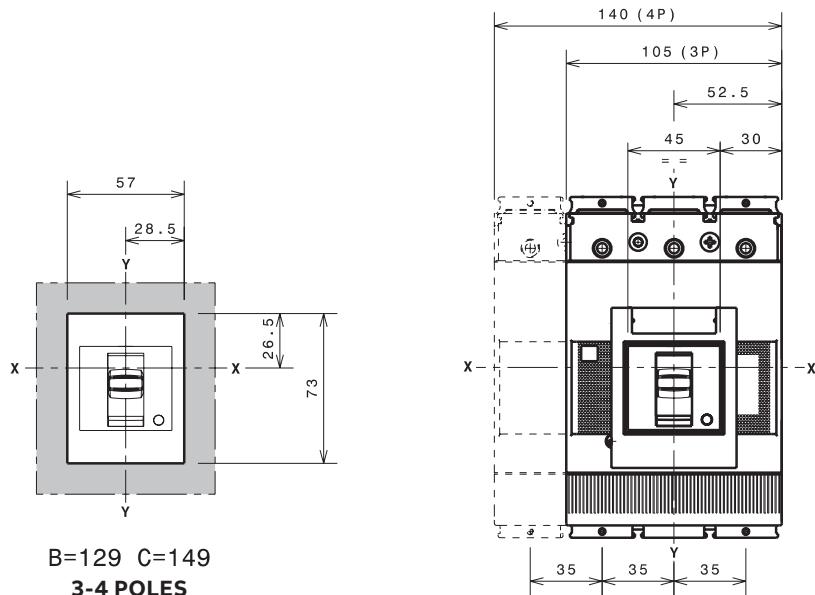

Tmax XT3 – Installation


Terminals for plug-in circuit-breaker

Terminals EF

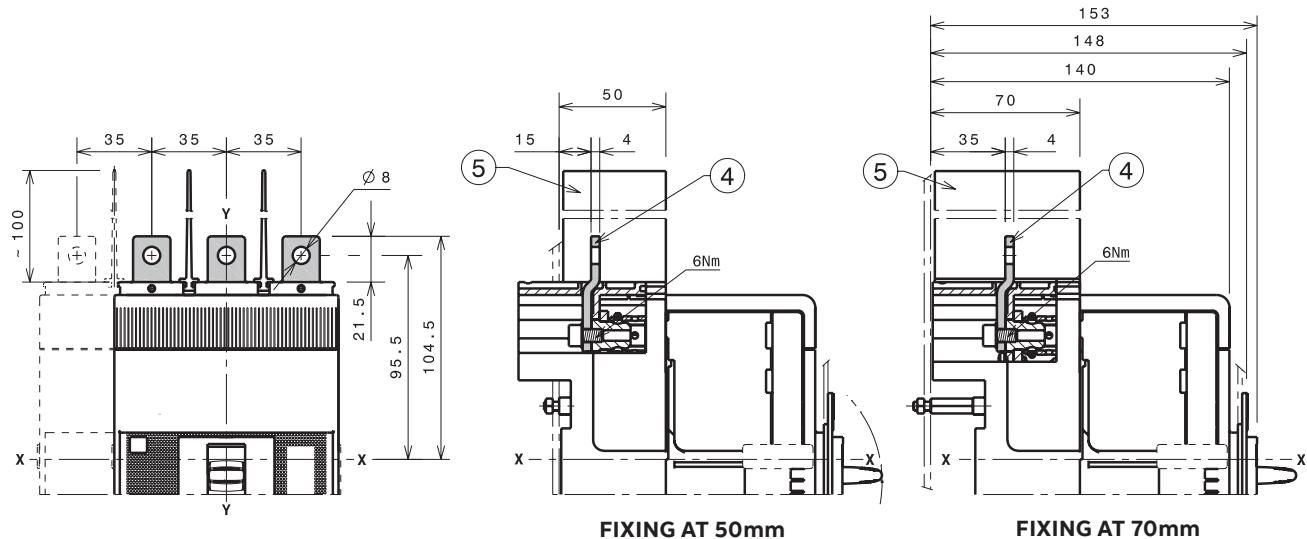

Key
 4 Front extended terminals
 5 Phase separators
 100mm

Terminals ES

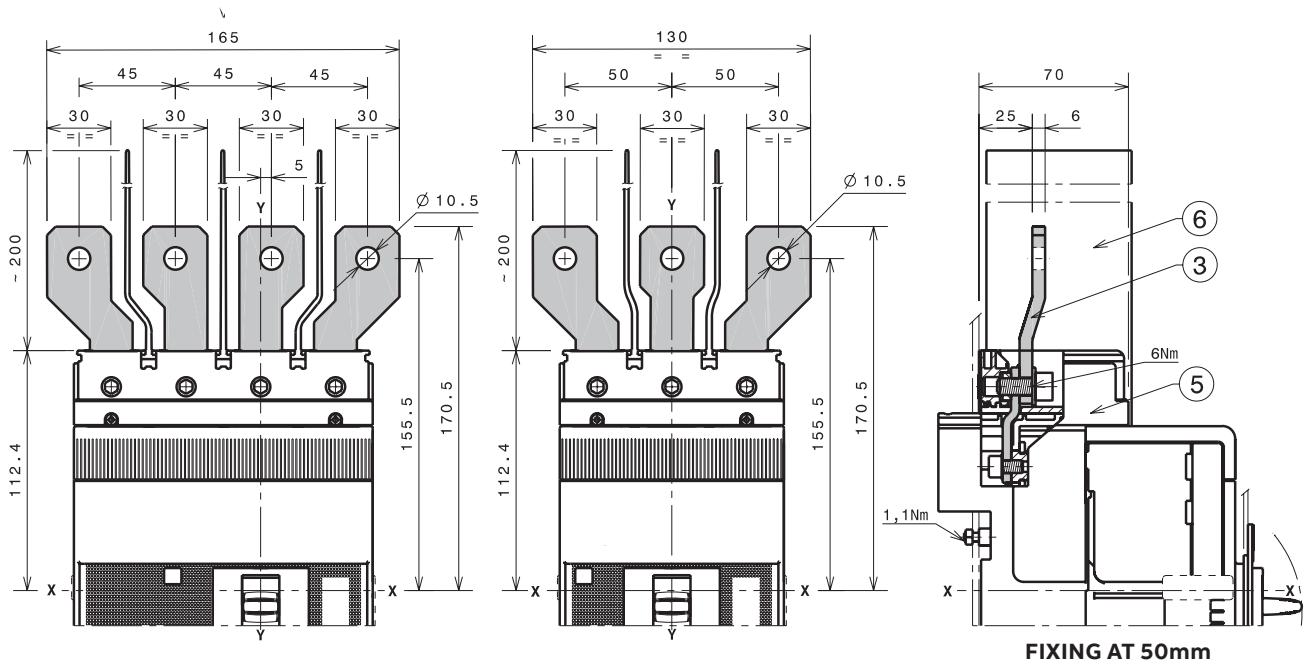



Key
 3 Front extended spread terminals for busbars connection
 5 Adapter for fixed part (compulsory) not provided
 6 Phase separators 200mm

Tmax XT3 – Installation

Terminals for plug-in circuit-breaker


1x95...185mm² terminals FCCuAl

—
Key
1 1x95...185mm² front terminal FCCuAl
5 Adapter for fixed part
6 Phase separators 25mm

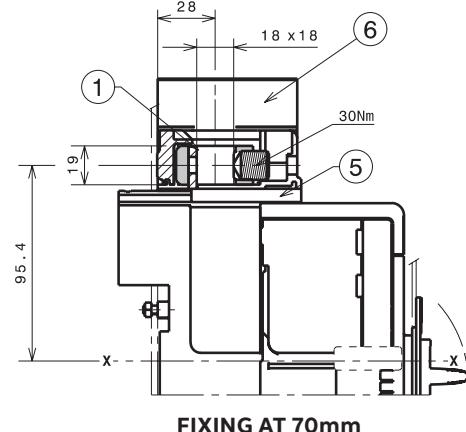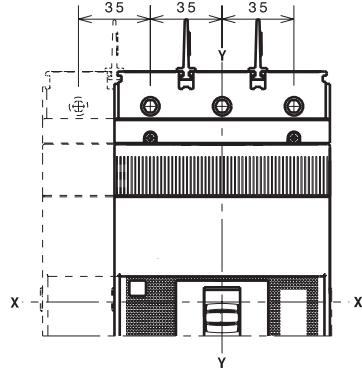



2x35...120mm² terminals FCCuAl

—
Key
1 2x35...120 mm² external terminal FCCuAl
2 High terminal covers with degree of protection IP40
3 Rear insulated plate
4 Drilling template for fixing circuit-breaker 3p with rear insulated plate
5 Drilling template for fixing circuit-breaker 4p with rear insulated plate

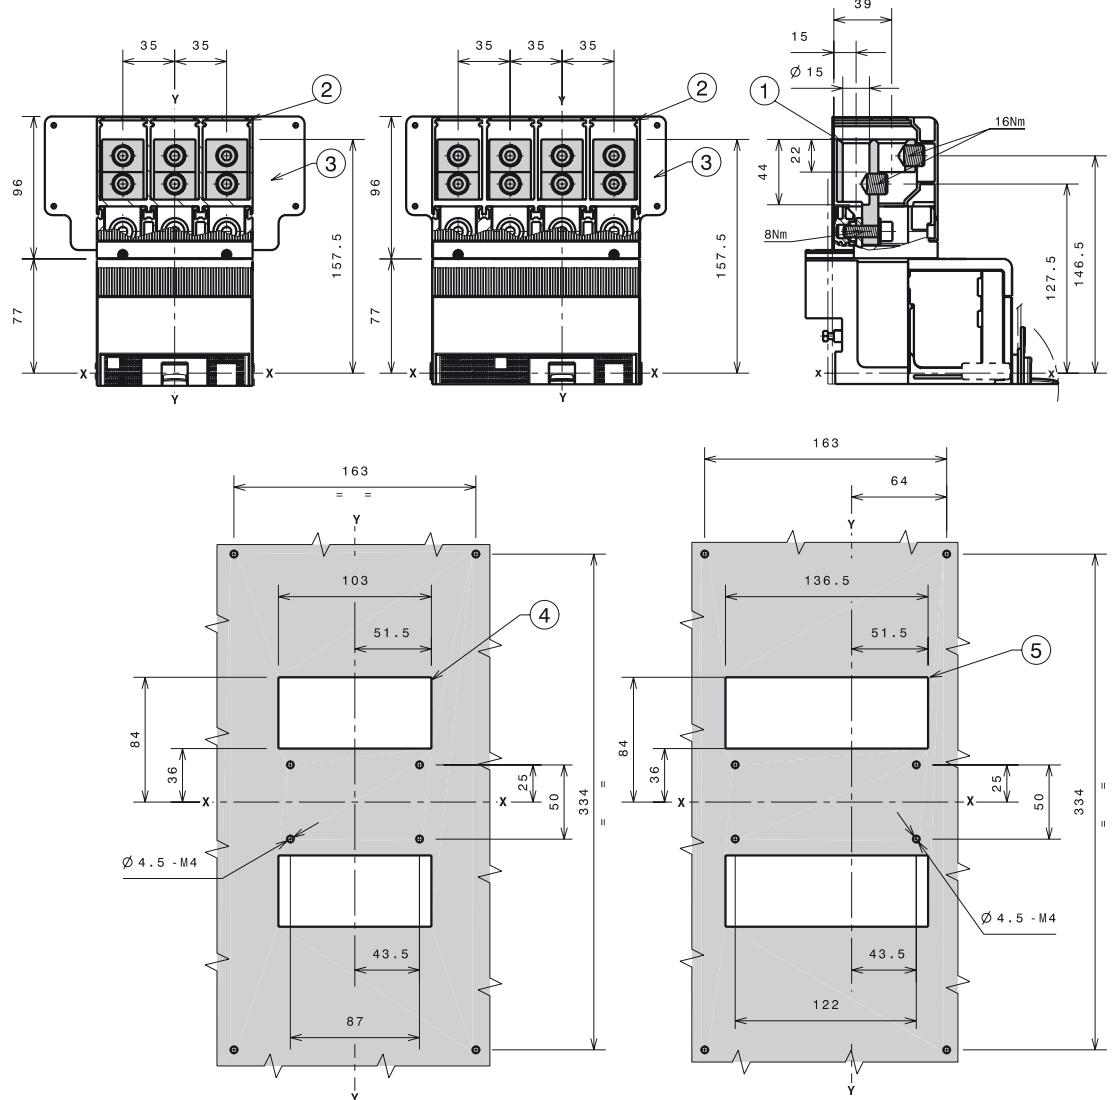



30...150mm² terminals FCCuAl

—
Key
 1 30...150mm²
 terminals FCCuAl
 2 Phase separators
 25mm
 3 Adapter for fixed part

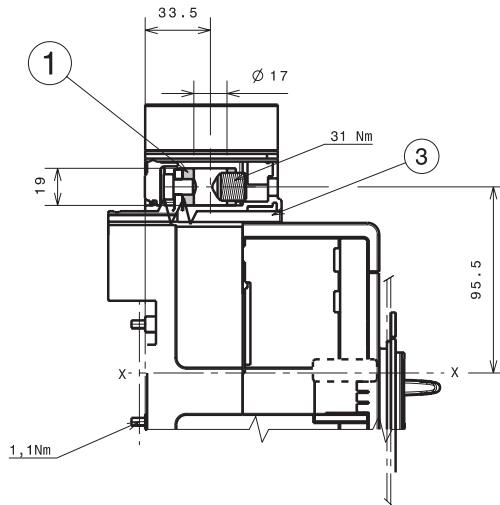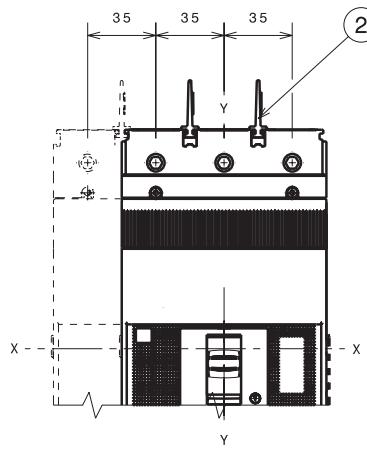

Terminals FCCu



—
Key
 4 Front terminals FCCu
 5 Adapter for fixed part
 6 Phase separators
 25mm

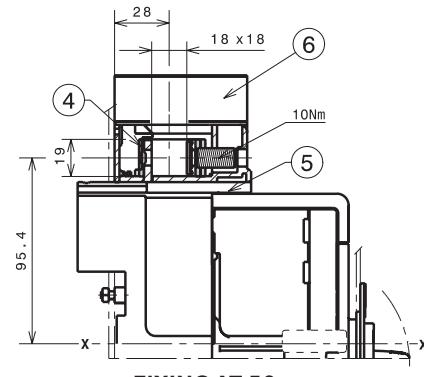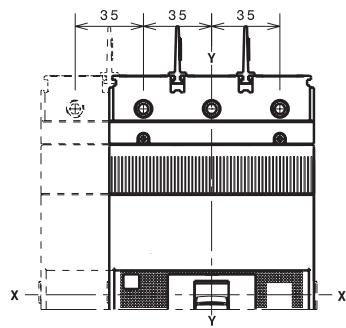

FIXING AT 50mm

Terminals MC

—
Key
 2 High terminal covers
 with degree of
 protection IP40
 3 Front terminal
 for multicable
 connection
 5 Adapter for fixed part

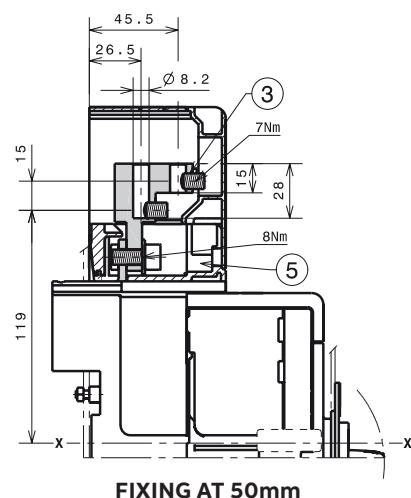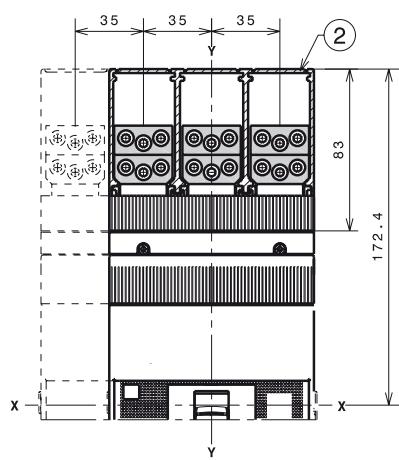


FIXING AT 50mm

Tmax XT3 – Installation

Terminals for plug-in circuit-breaker

Terminals HR/VR

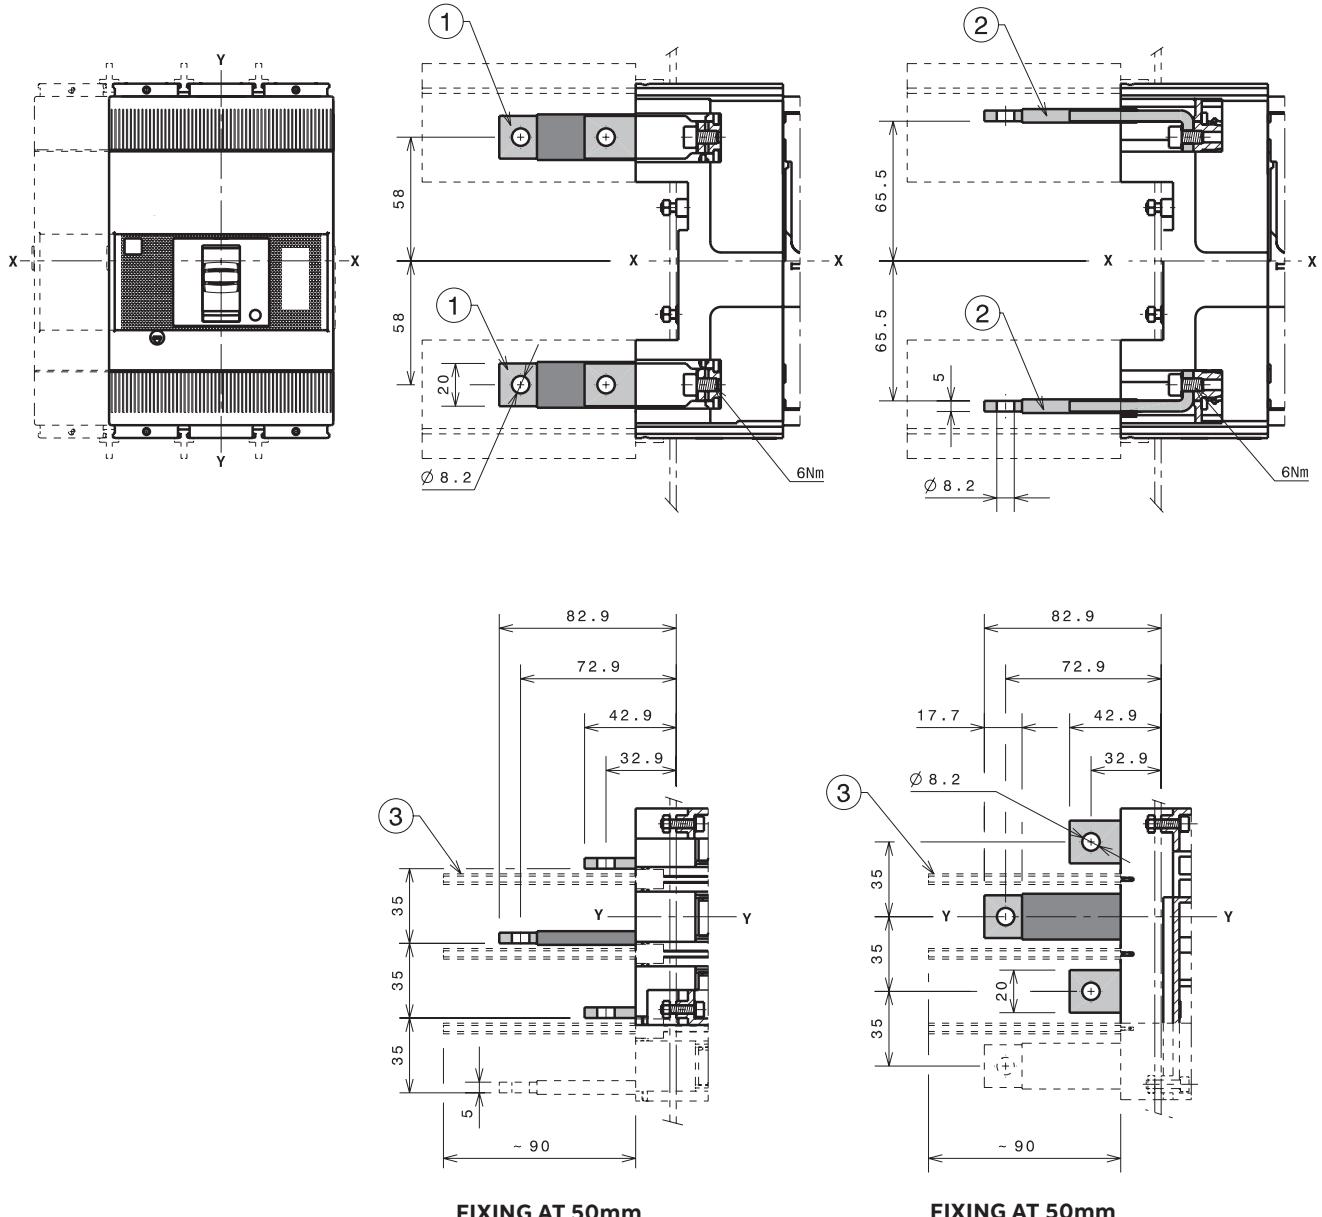

Key
 1 Rear vertical terminals
 2 Rear horizontal terminals
 3 Rear phase separators 90mm



FIXING AT 50mm

FIXING AT 50mm



Tmax XT3 – Installation

Accessories for plug-in circuit-breaker

Direct motor operator (MOD)

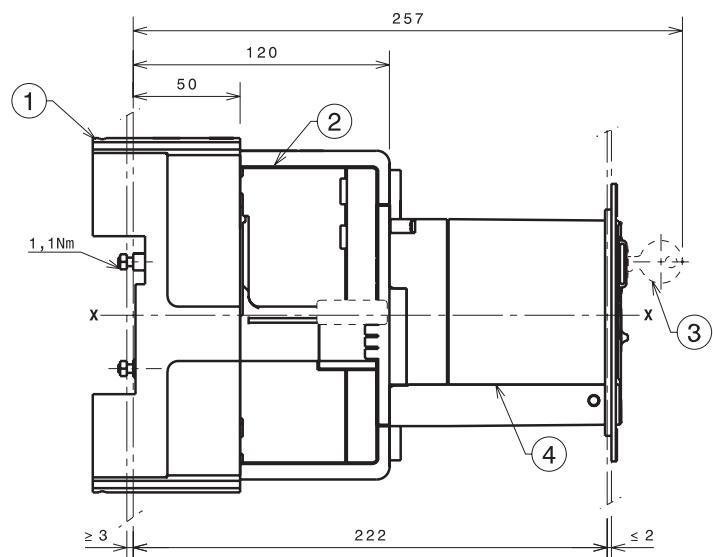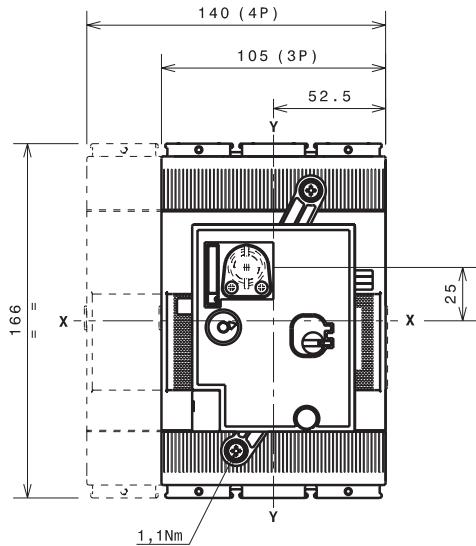

FIXING AT 50mm

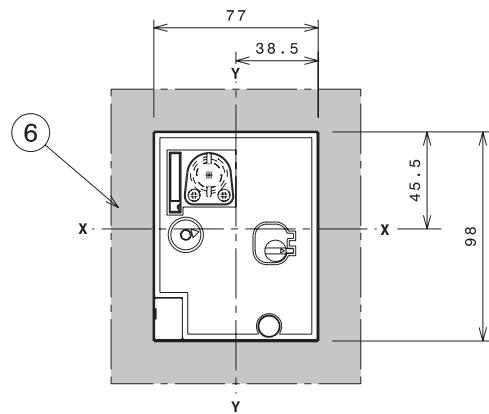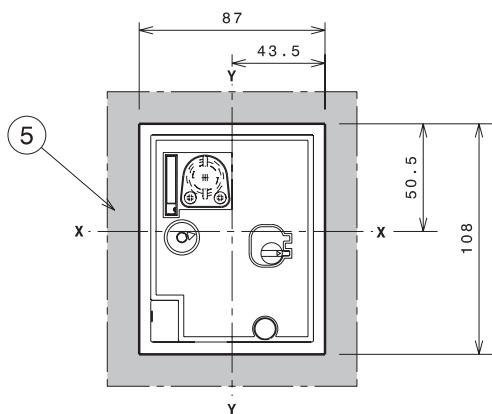

Key

- 1 Fixed part
- 2 Moving part
- 3 Key lock
- 4 Direct motor operator MOD
- 5 Drilling template of door with MOD with flange
- 6 Drilling template of door with MOD without flange


Tmax XT4 – Installation

Installation for fixed circuit-breaker

Fixing on sheet


—
Key
2 Overall dimensions of optional wiring ducts
3 Phase separators 25mm

A
With standard 3p-4p 86 flange
Without 3p-4p 83.5 flange 3p-4p 91.5

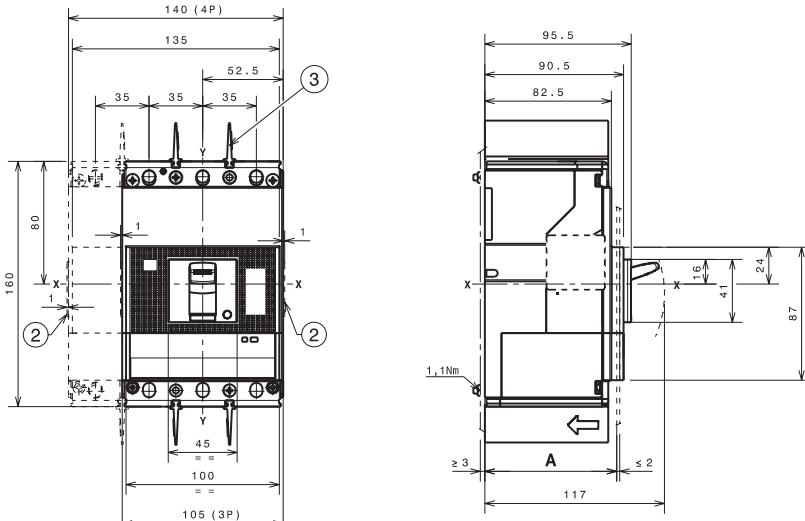


With side connector for Ekip Touch trip units

—
Key
1 Front terminals
2 Flange for 4p circuit-breaker
3 Flange for 3p circuit-breaker
7 Tightening torque 1,1 Nm - 10 In.Lbs
8 Tightening torque 8 Nm - 70.3 In.Lbs
9 Optional wiring duct
10 Phase separators 25mm
11 Rear plate insulating 3p (only ul version)
12 Rear plate insulating 4p (only ul version)
15 Connection kit F/P IntBus/ExtNeut/Sel

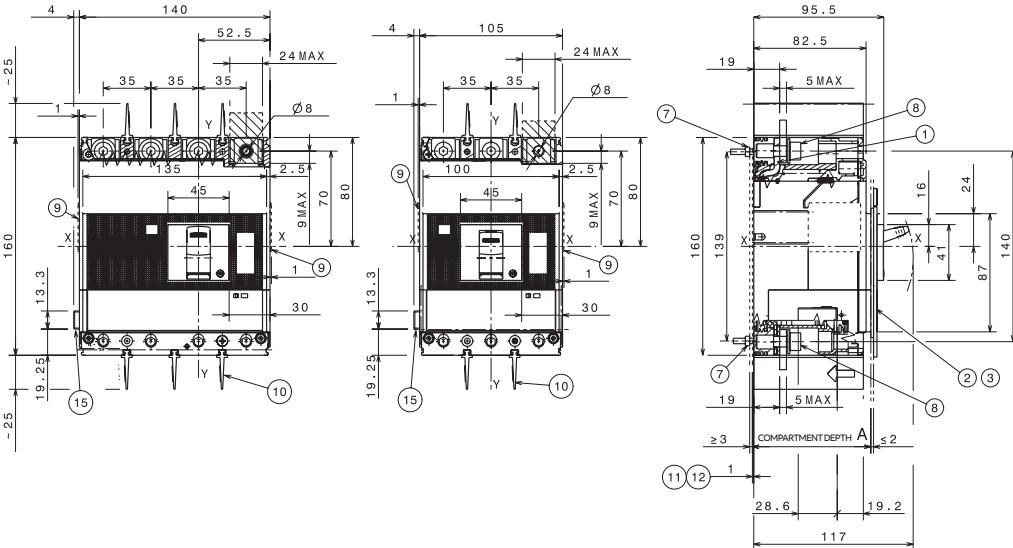


Fixing on DIN 50022 rail


—
Key
1 Bracket for fixing
3 Phase separators 25mm

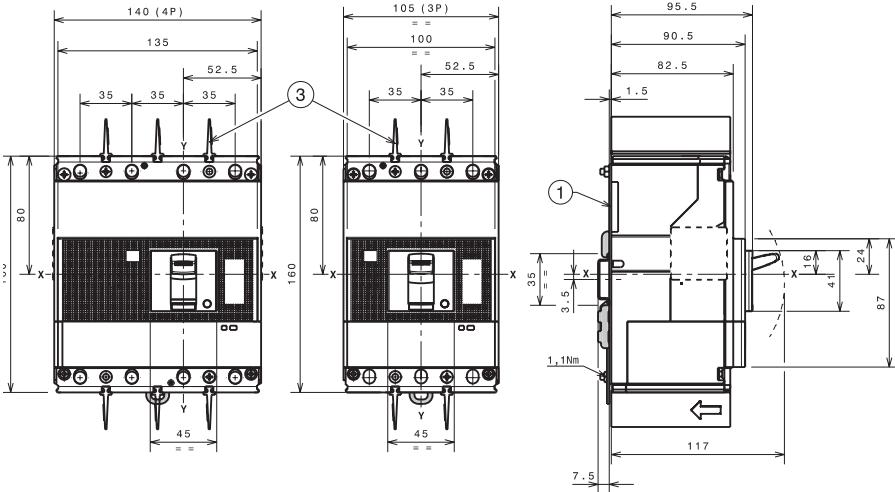

Drilling templates for support sheet

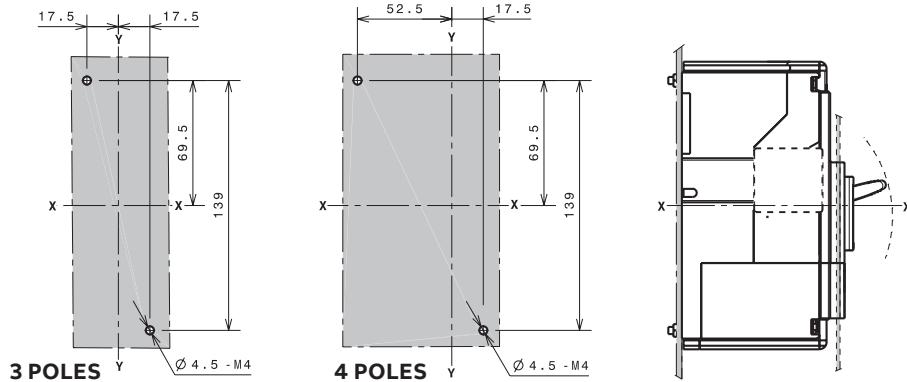


Flanges

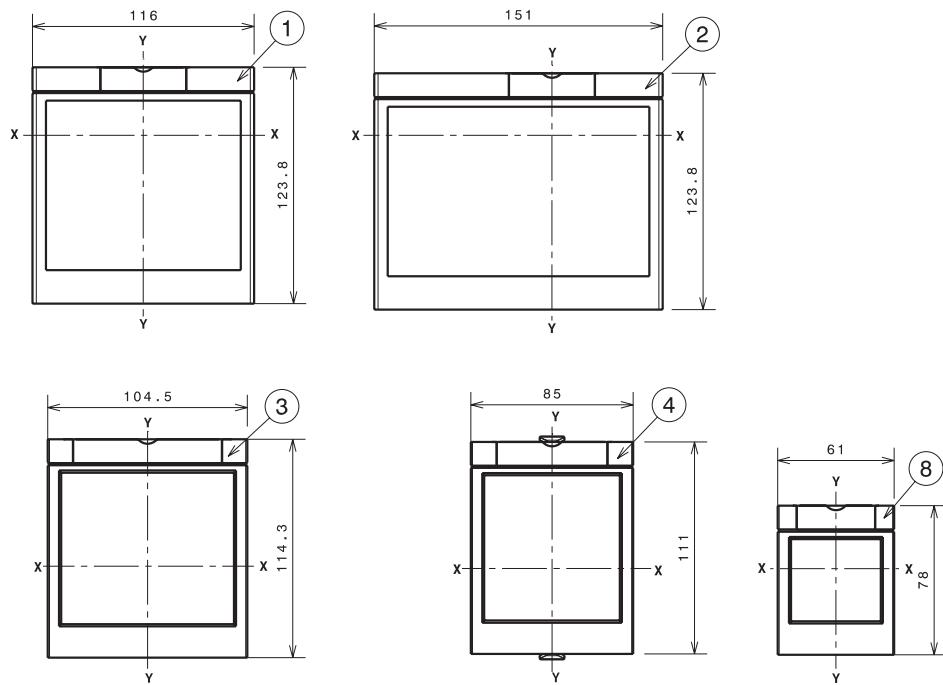

Key

- 1 Flange for fixed circuit-breaker 3p
- 2 Flange for fixed circuit-breaker 4p
- 3 Flange for fixed circuit-breaker 3p-4p with MOE and FLD
- 4 Flange for circuit-breaker 3p-4p with direct rotary handle RHD
- 7 Flange for fixed circuit-breaker 4p with front extended terminals and residual current
- 8 Optional flange

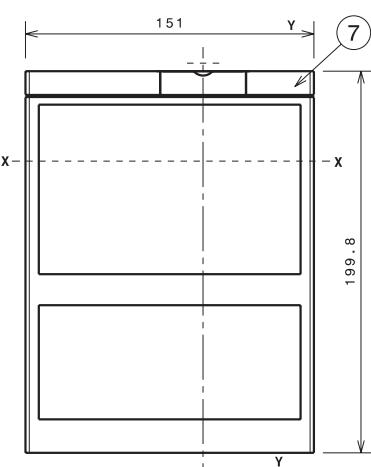


Tmax XT4 – Installation


Installation for fixed circuit-breaker

Compartment door drilling templates


With standard flange

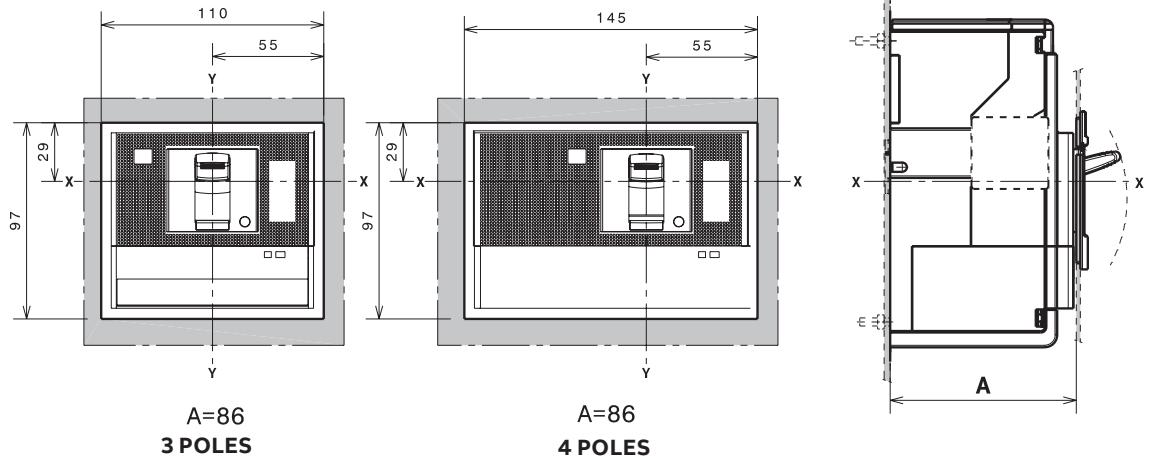

Without flange

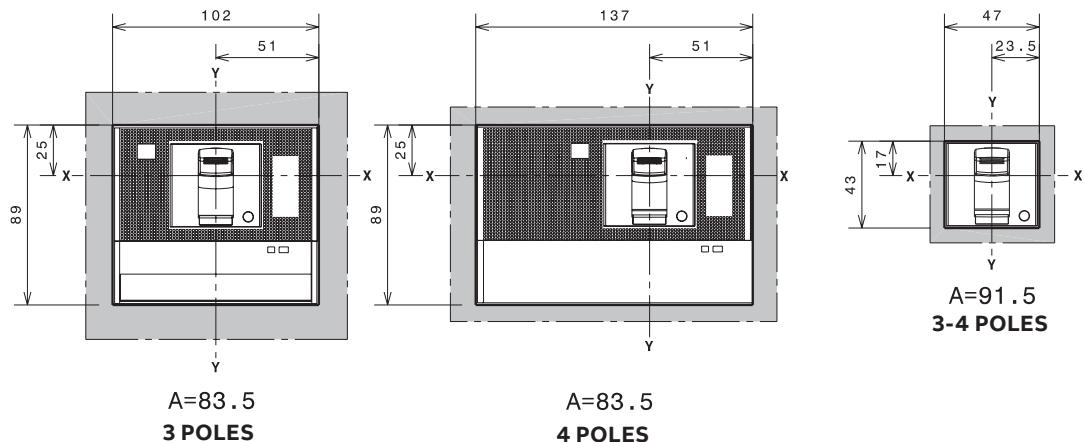

With optional flange

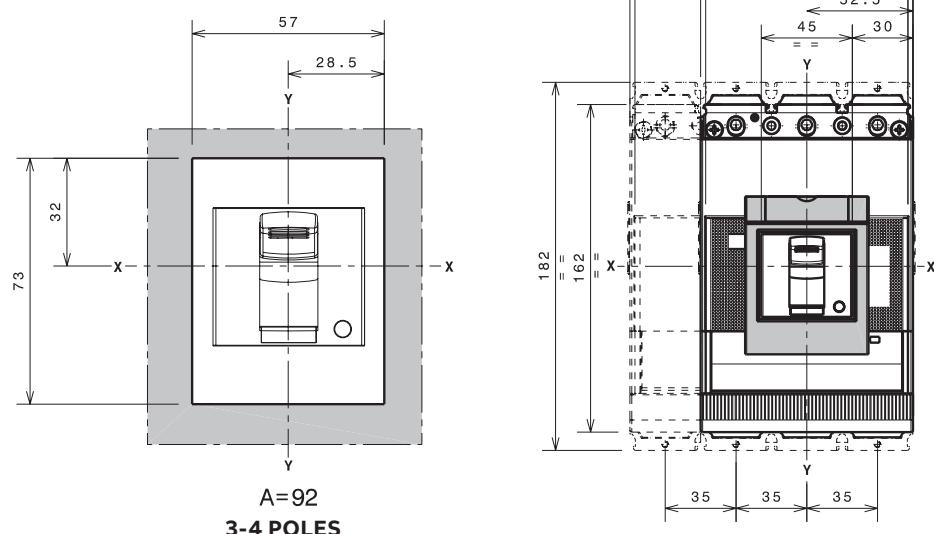


Tmax XT4 – Installation

Terminals for fixed circuit-breaker


Terminals F

- Key
1 Phase separators
25mm
2 Top terminal covers with degree of protection IP30

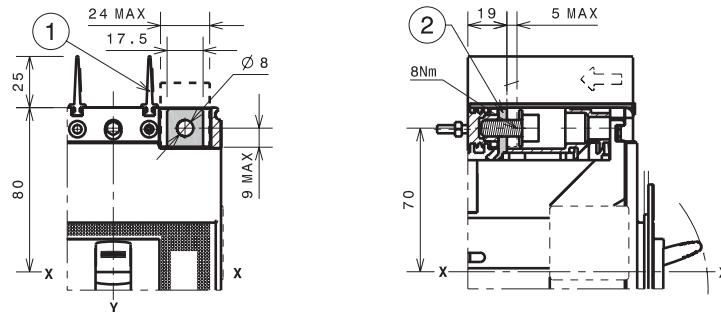

Terminals EF

- Key
3 Front extended terminals
4 Terminal covers with degree of protection IP40
5 Phase separators
100mm
6 Insulated plate
7 Drilling template for 3p circuit-breaker
8 Drilling template for 4p circuit-breaker

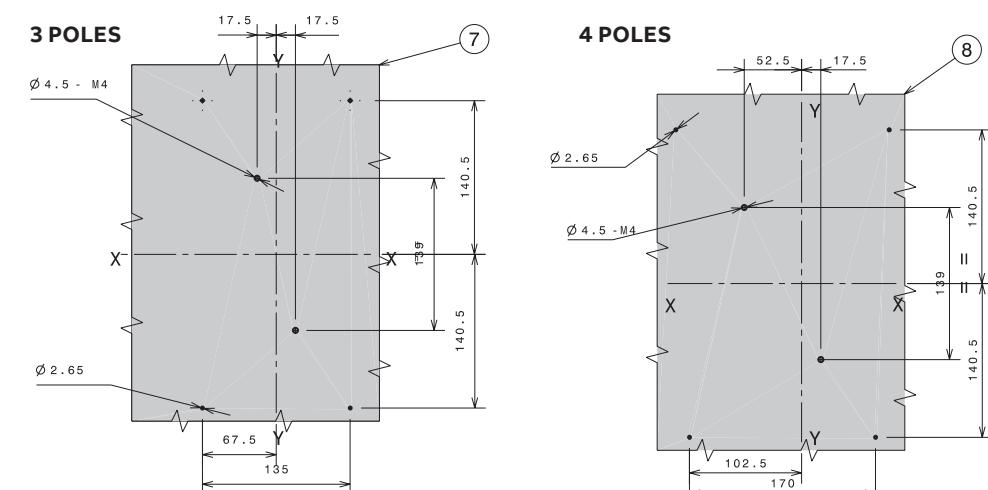


Tmax XT4 – Installation

Terminals for fixed circuit-breaker


Terminals ES


- Key
 1 Drilling template for 3p circuit-breaker
 2 Drilling template for 4p circuit-breaker
 3 Front extended spread terminals
 4 Phase separators 200mm
 5 Insulating plate

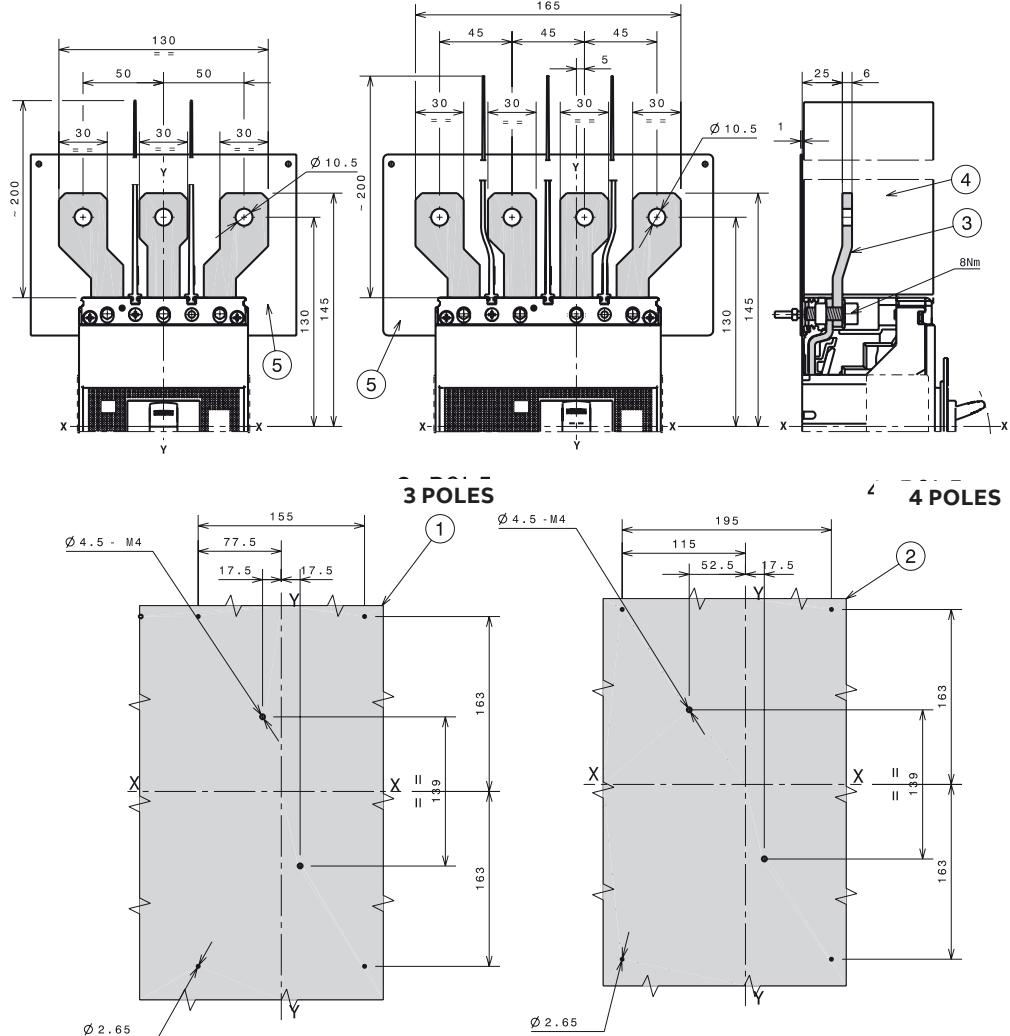

1x1...185mm² terminals FCCuAl

- Key
 1 1x1...185mm² terminals FCCuAl
 3 Phase separators 25mm

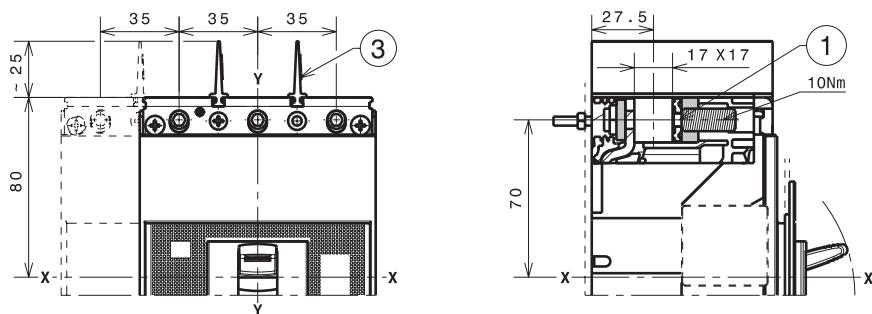

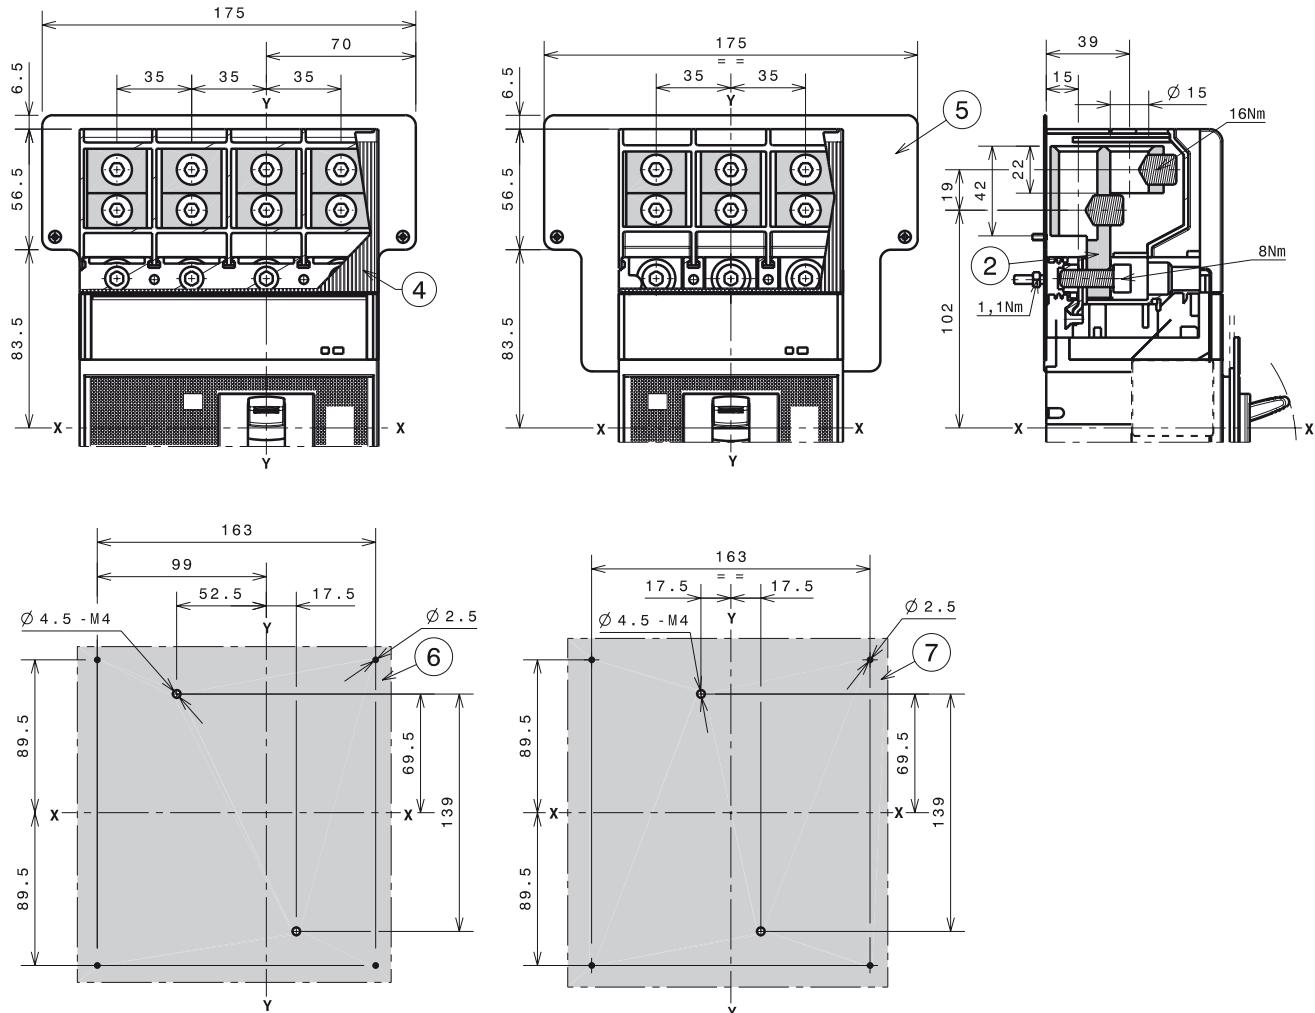2x35...120mm² terminals FCCuAl

Key



- 2 2x35...120mm² terminals FCCuAl
- 4 Terminal covers with degree of protection IP40
- 5 Rear insulated plate
- 6 Drilling template for circuit-breaker 4p fixing with insulating plate
- 7 Drilling template for circuit-breaker 3p fixing with insulating plate

Tmax XT4 – Installation

Terminals for fixed circuit-breaker



Terminals FCCu

—
Key
1 Terminals FCCu
4 Phase separators
25mm
25mm

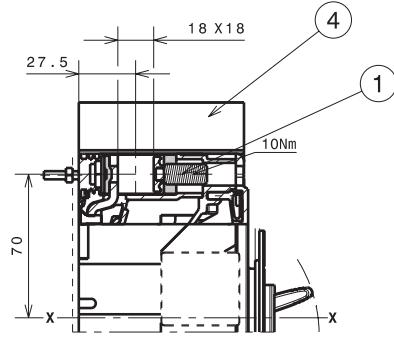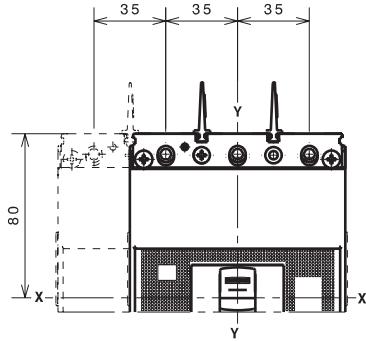


Terminals MC

—
Key
2 Multicable terminals
3 Terminal covers
with degree of
protection IP40

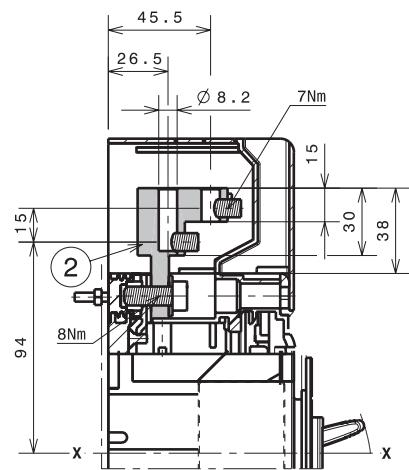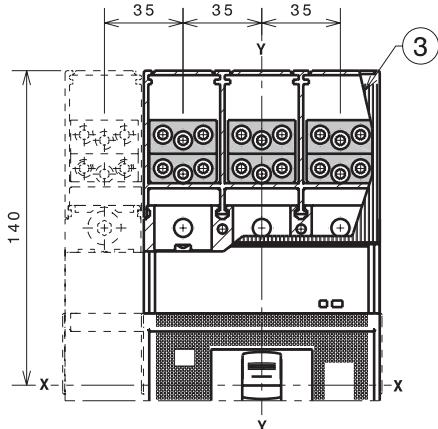


Terminals R

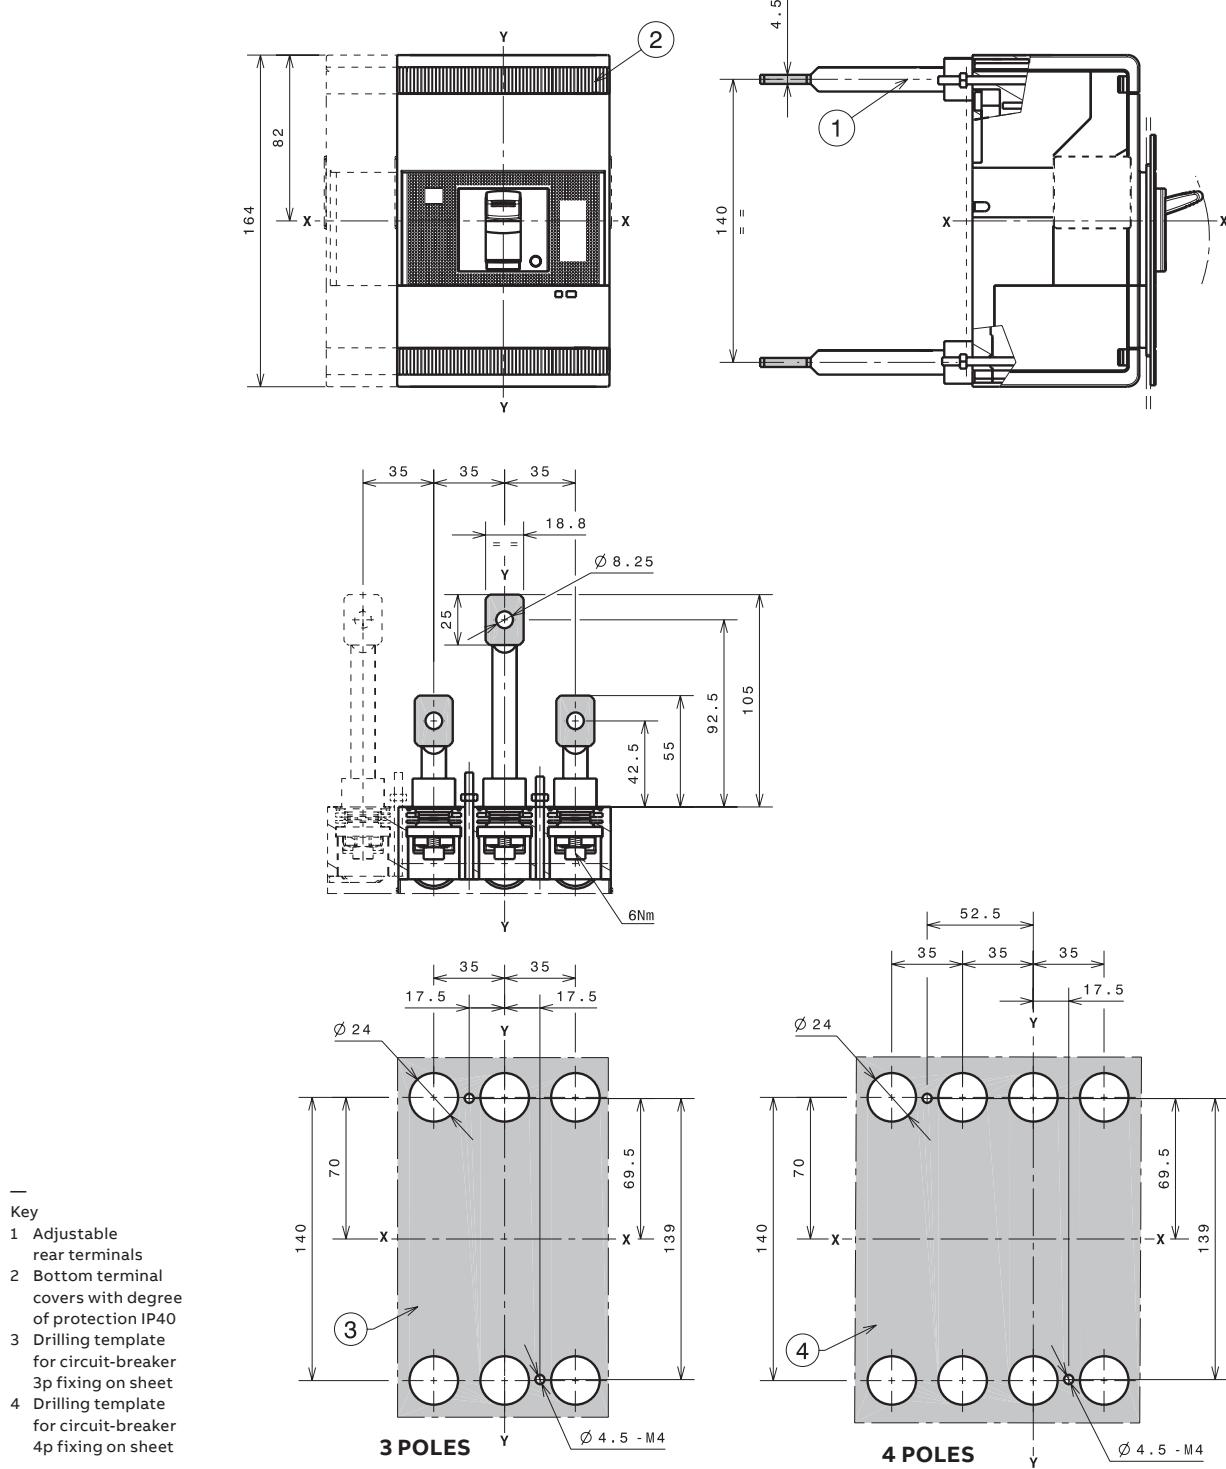

Tmax XT4 – Installation

Accessories for fixed circuit-breaker


Rotary handle operating mechanism on circuit-breaker (RHD)

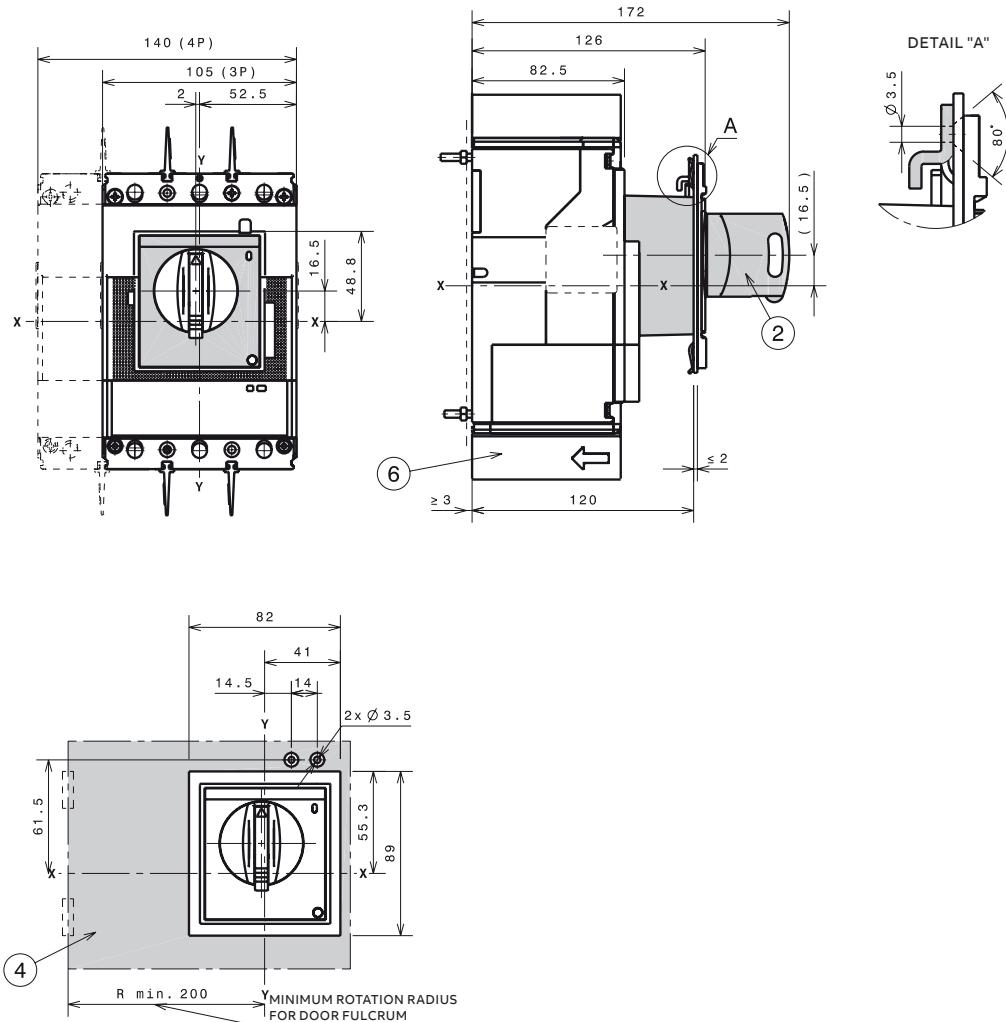

Key

- 2 Rotary handle operating mechanism on circuit-breaker
- 4 Drilling template of door with direct rotary handle
- 6 Phase separators 25mm

Rotary handle operating mechanism of the compartment door (RHE)

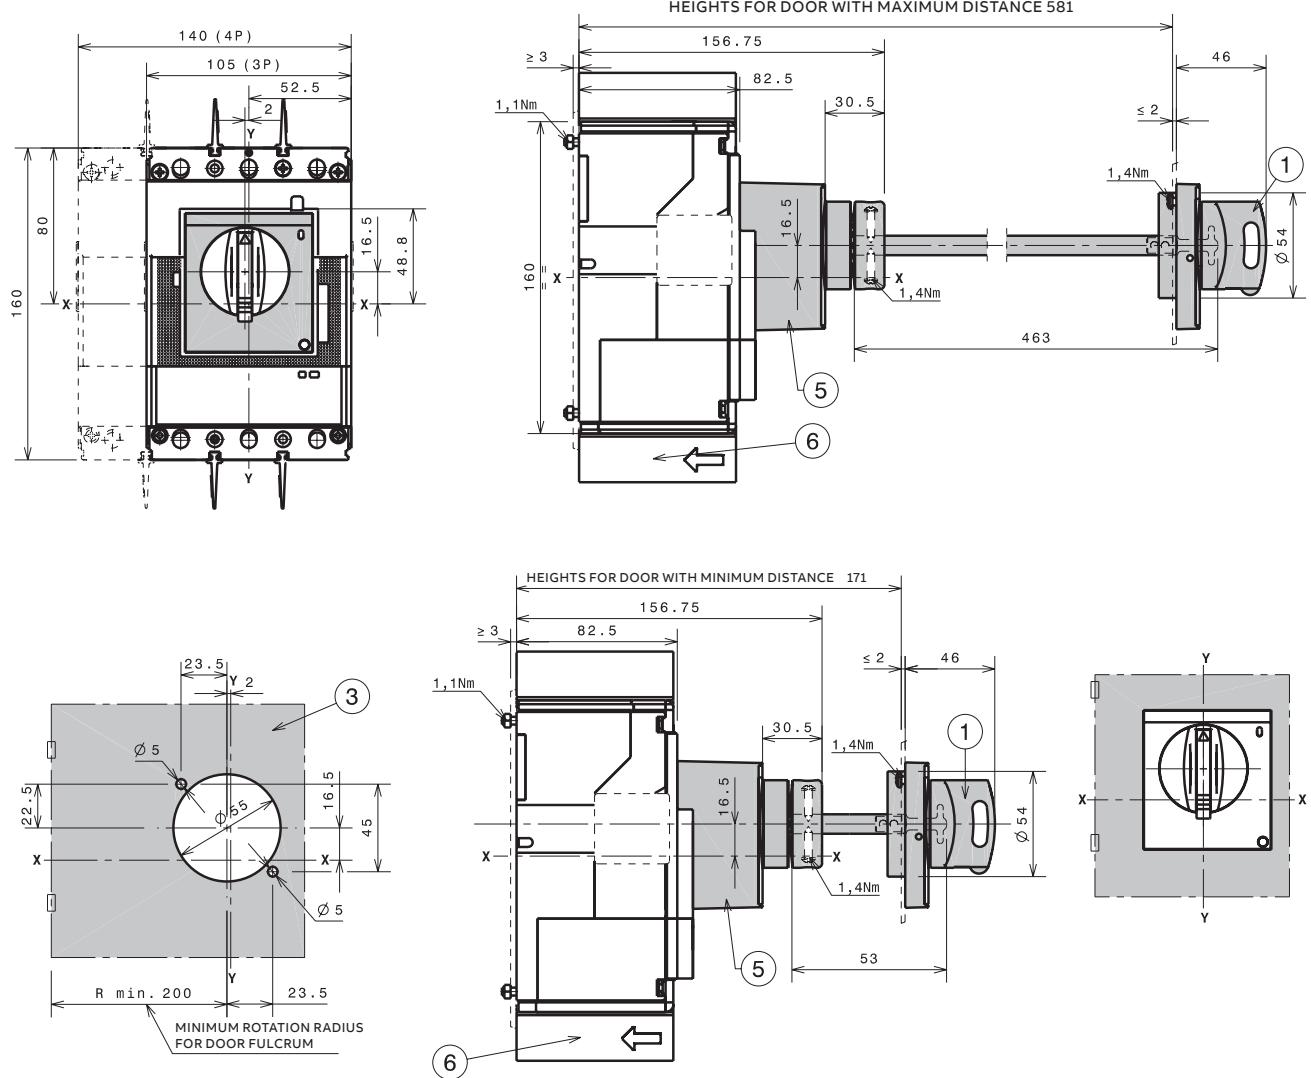


Key

- 1 Rotary handle operating mechanism of the compartment door
- 3 Drilling template for RHE
- 5 Transmission unit
- 6 Phase separators 25mm


Tmax XT4 – Installation

Accessories for fixed circuit-breaker

Stored energy motor operator (MOE)

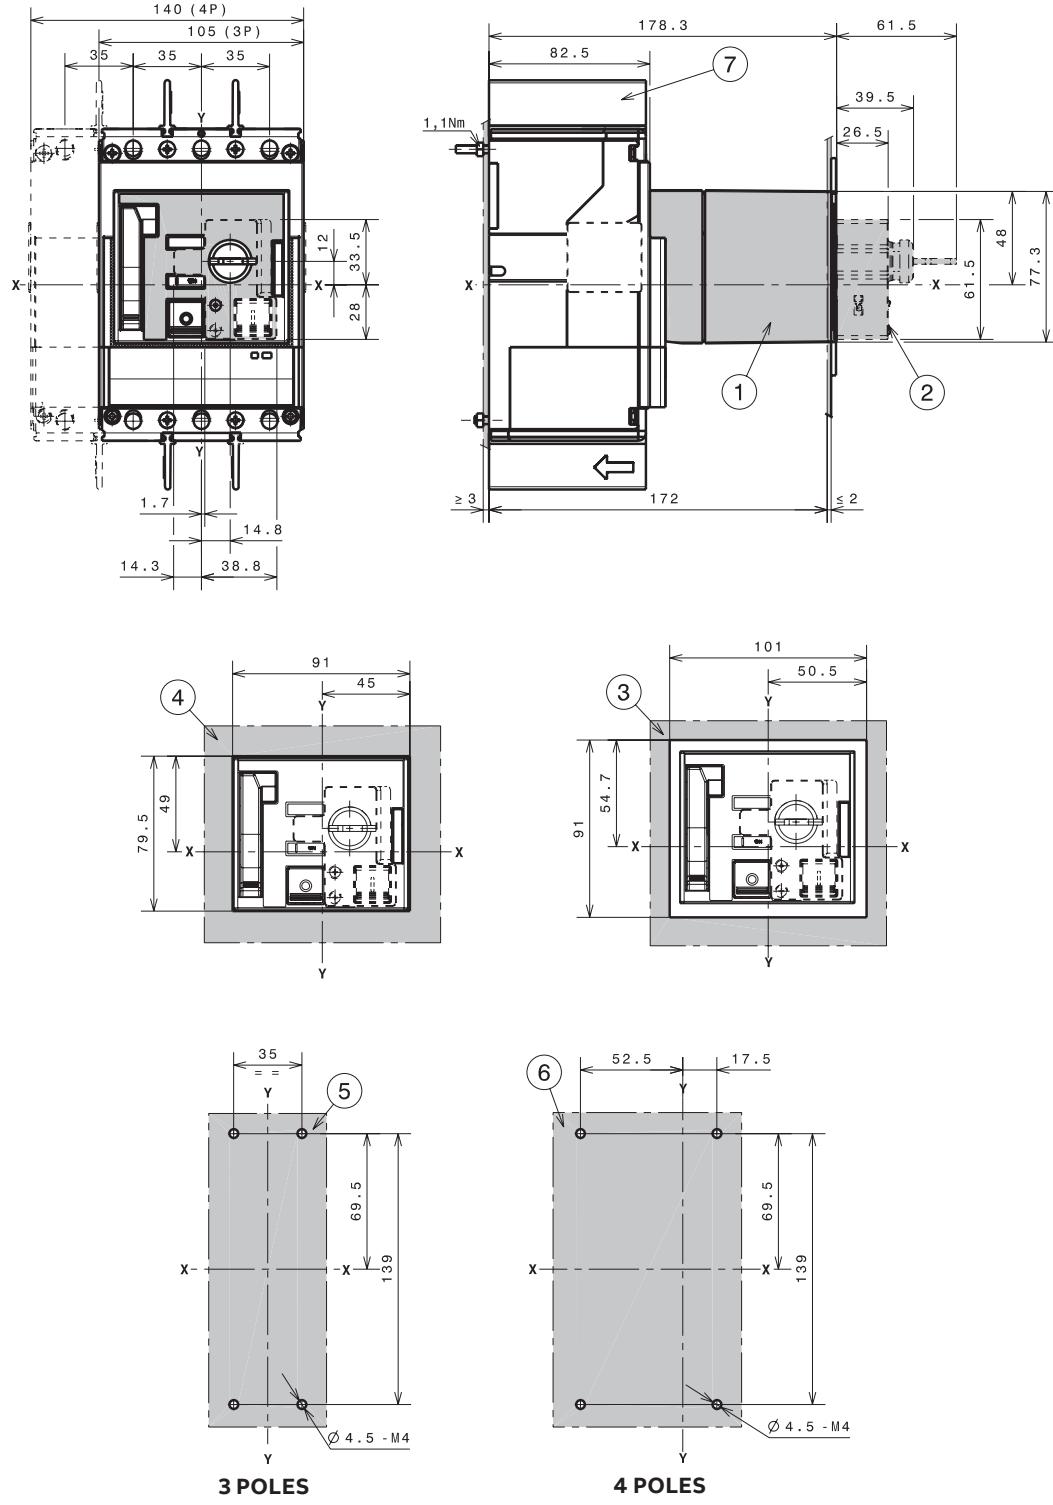

Front for lever operating mechanism (FLD)

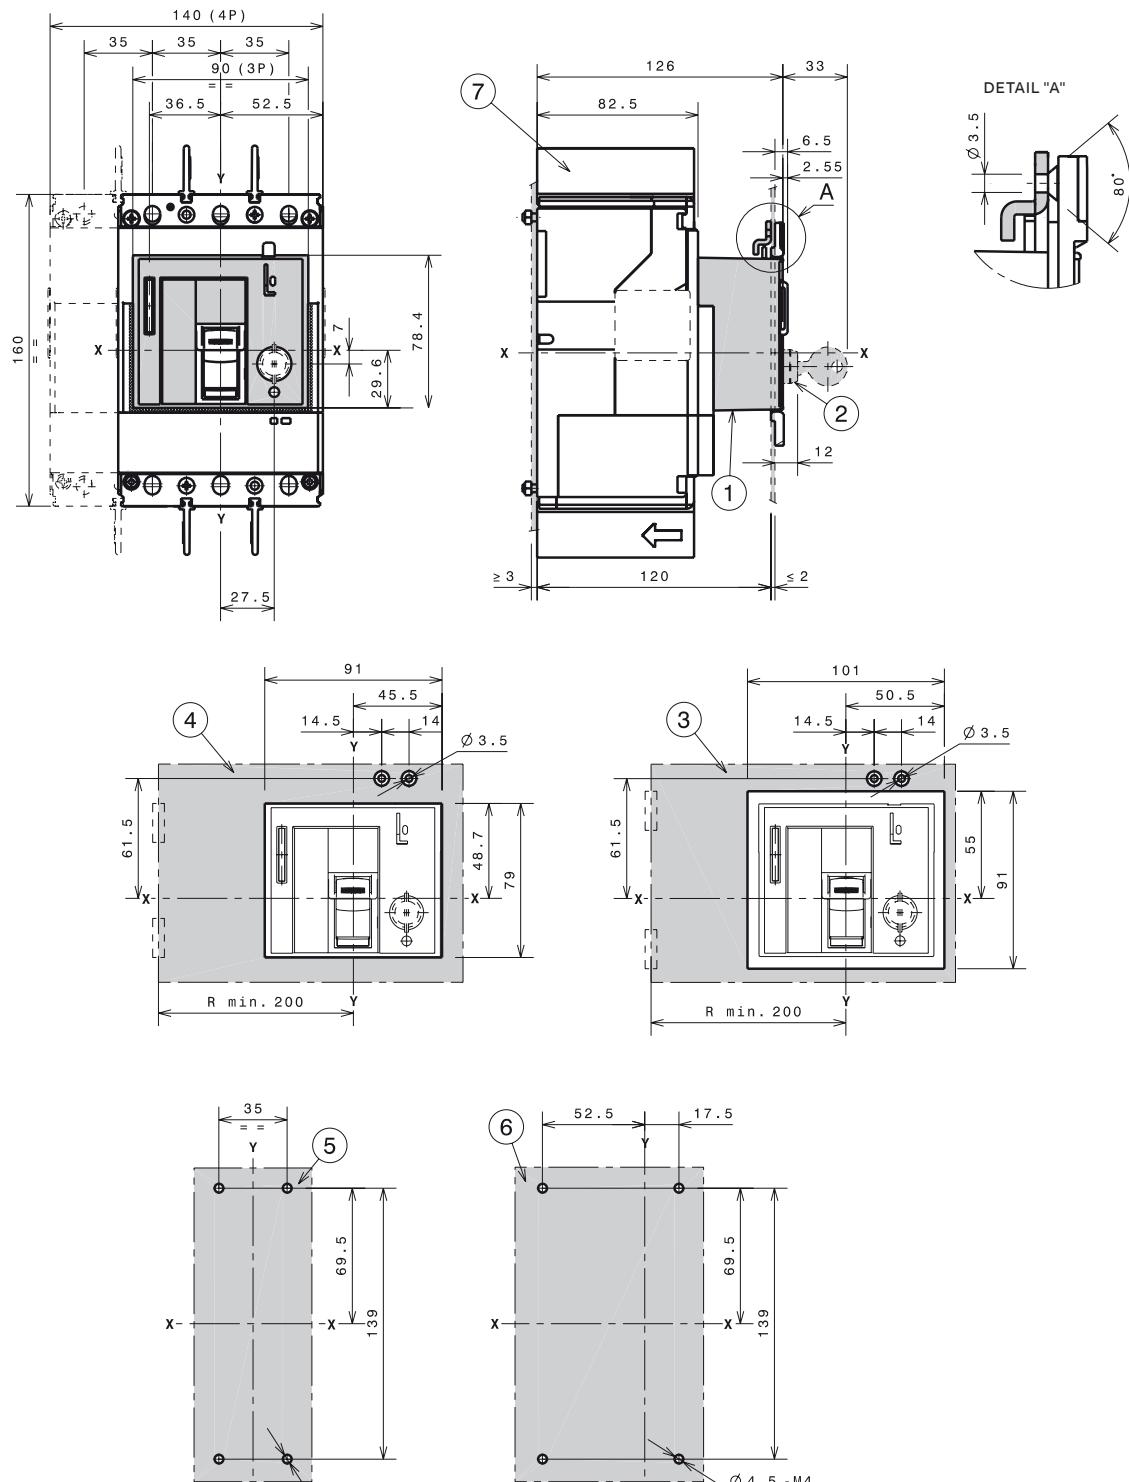


Key

- 1 Front for lever operating mechanism (FLD)
- 2 Key lock
- 3 Drilling template of door with flange (FLD)
- 4 Drilling template of door without flange (FLD)
- 5 Drilling template for circuit-breaker 3p fixing on sheet
- 6 Drilling template for circuit-breaker 4p fixing on sheet
- 7 Phase separators 25mm

Tmax XT4 – Installation

Accessories for fixed circuit-breaker

Residual current RC Sel


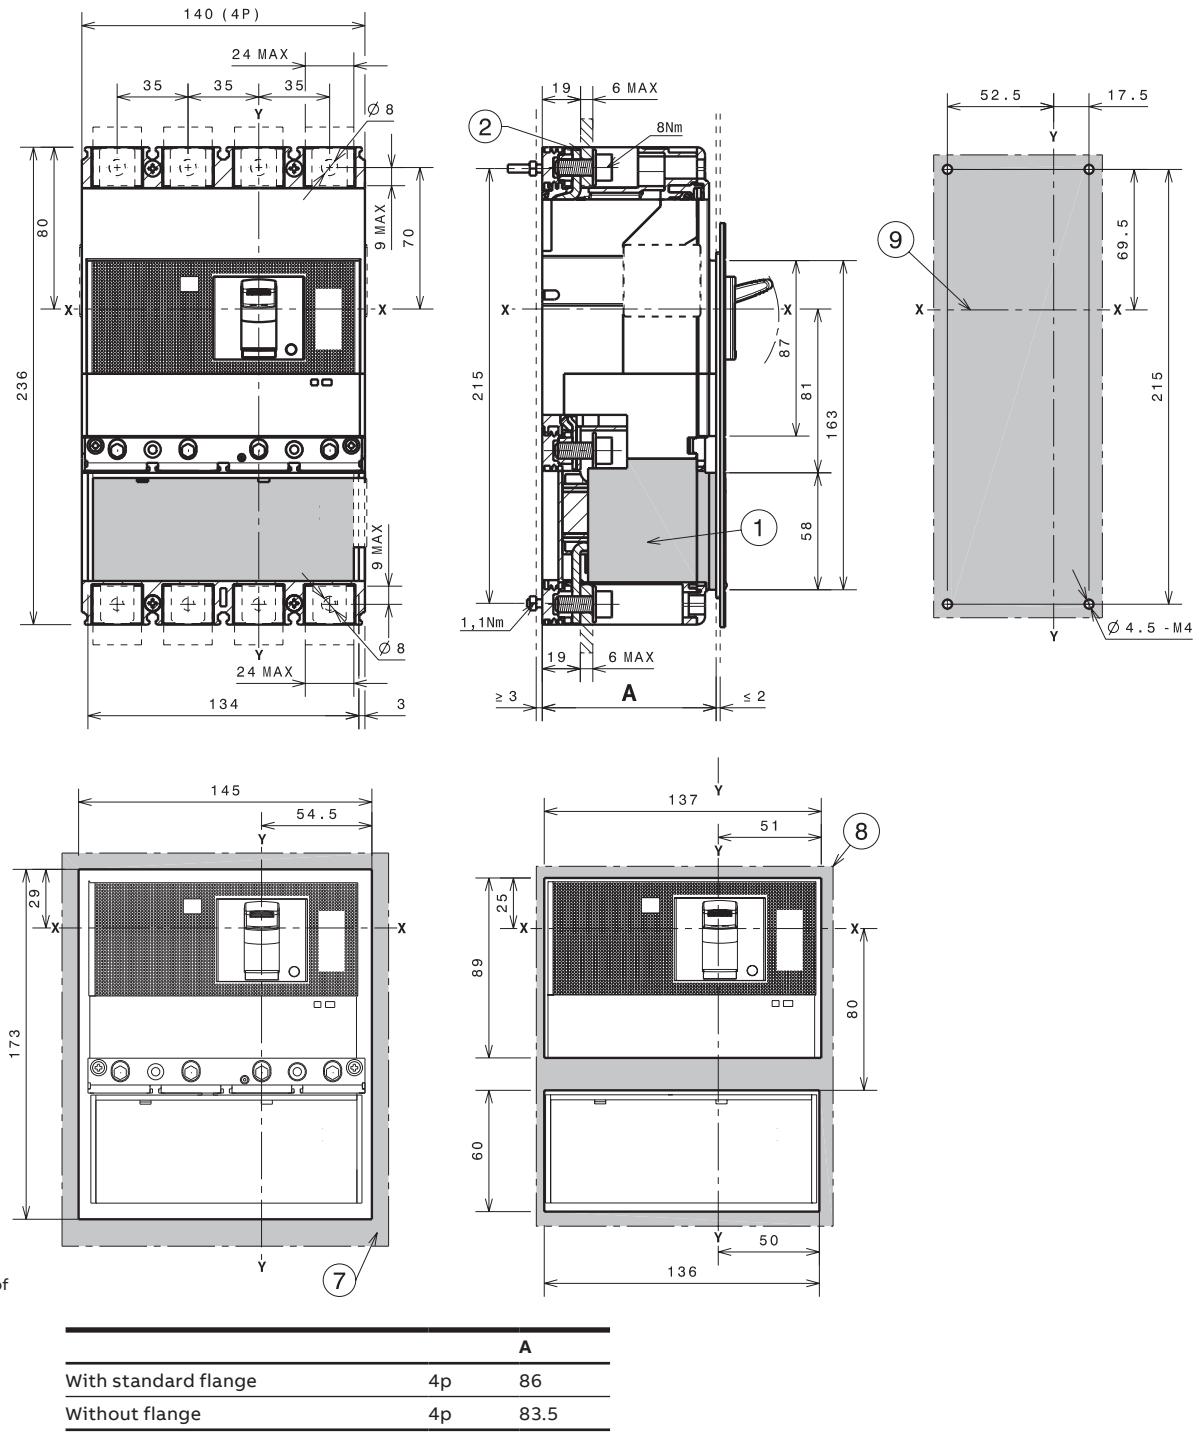


Tmax XT4 – Installation

Installation for plug-in circuit-breaker

Fixing on sheet

—
Key
1 Fixed part
2 Moving part

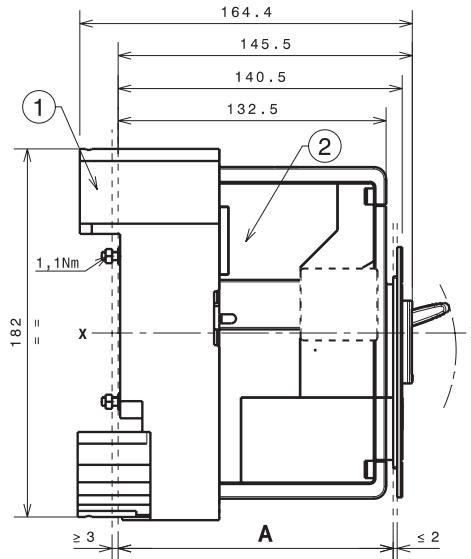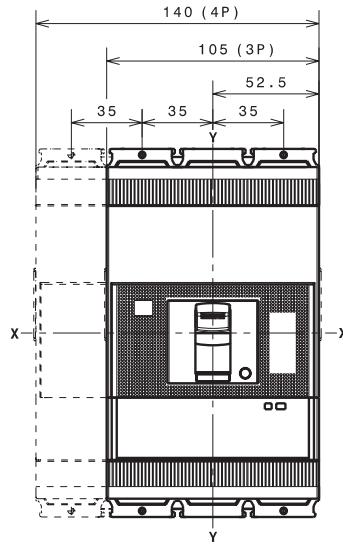

Fixing at 50mm




| | A |
|----------------------|-------------|
| With standard flange | 3p-4p 136 |
| | 3p-4p 133.5 |
| Without flange | 3p-4p 141.5 |

Fixing at 70mm for extended front terminals

| | A |
|----------------------|-------------|
| With standard flange | 3p-4p 156 |
| | 3p-4p 153.5 |
| Without flange | 3p-4p 161.5 |

With side connector for Ekip Touch trip units


—
Key
1 Front terminals
2 Flange for 4p circuit-breaker
9 Optional wiring duct
10 Phase separators 25mm
15 Connection kit F/P IntBus/ExtNeut/Sel

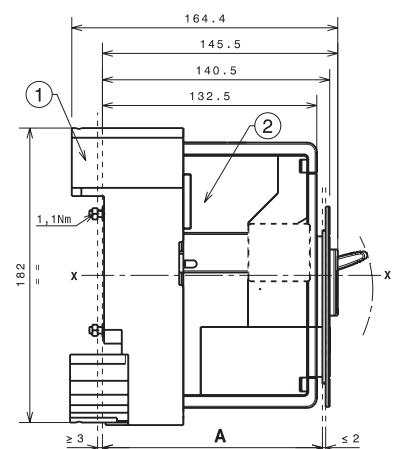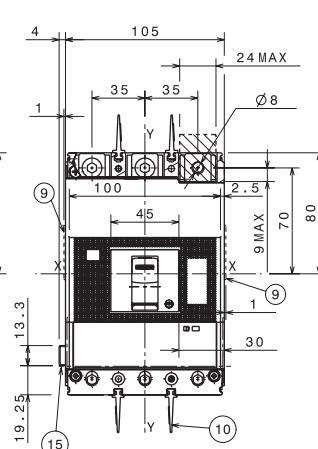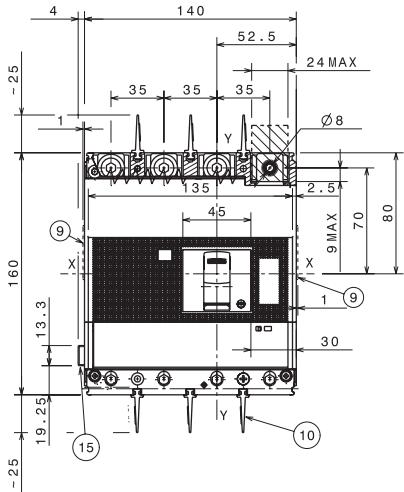


Tmax XT4 – Installation

Installation for plug-in circuit-breaker

Drilling templates for support sheet

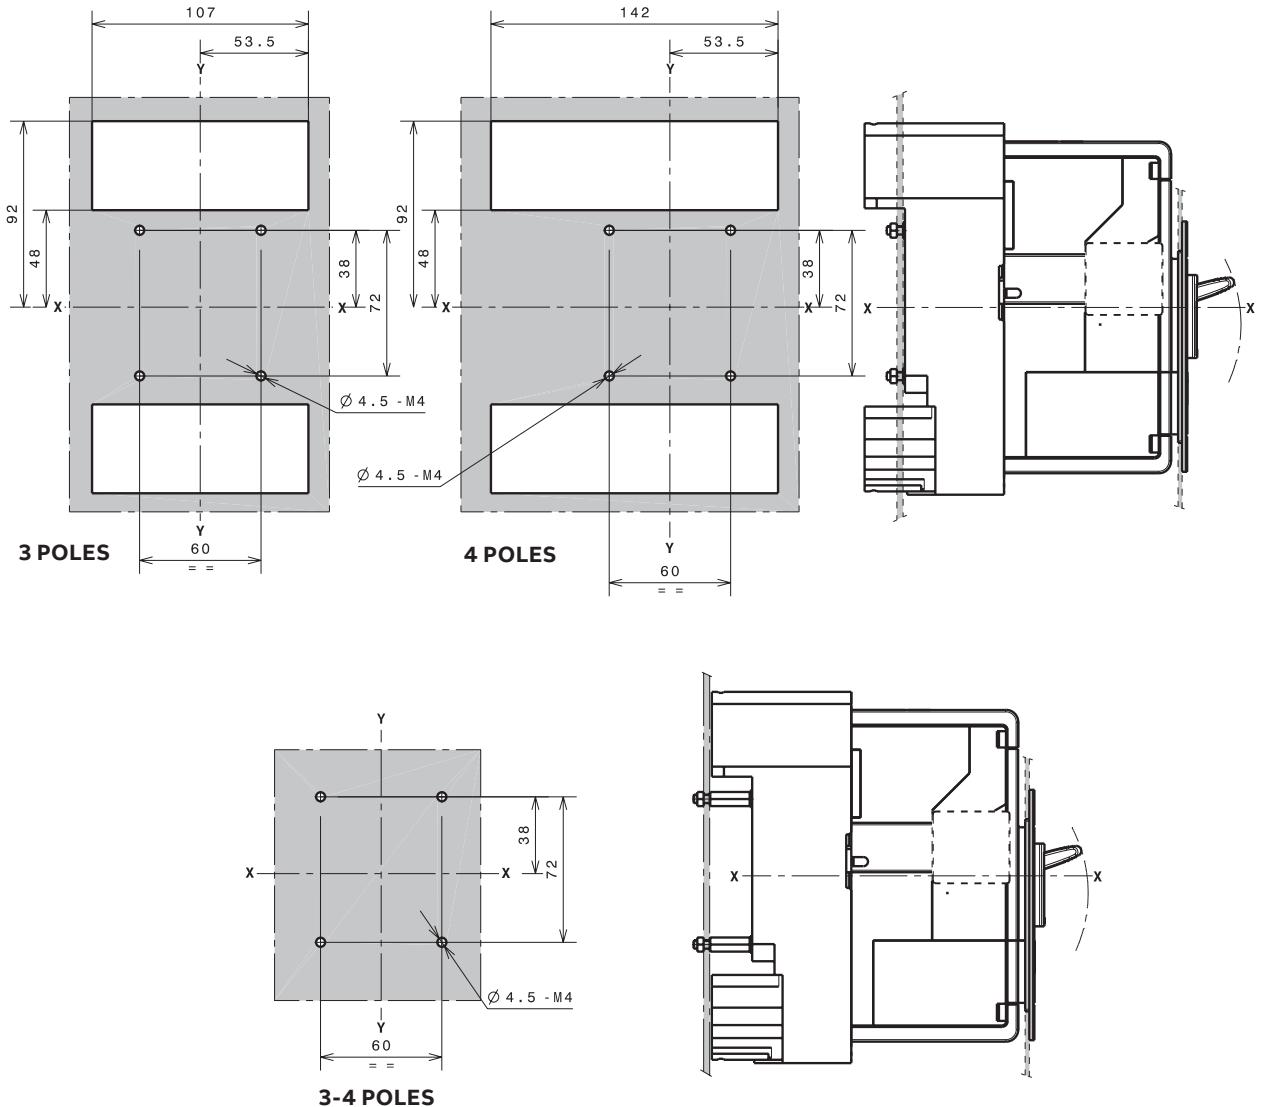

Flanges

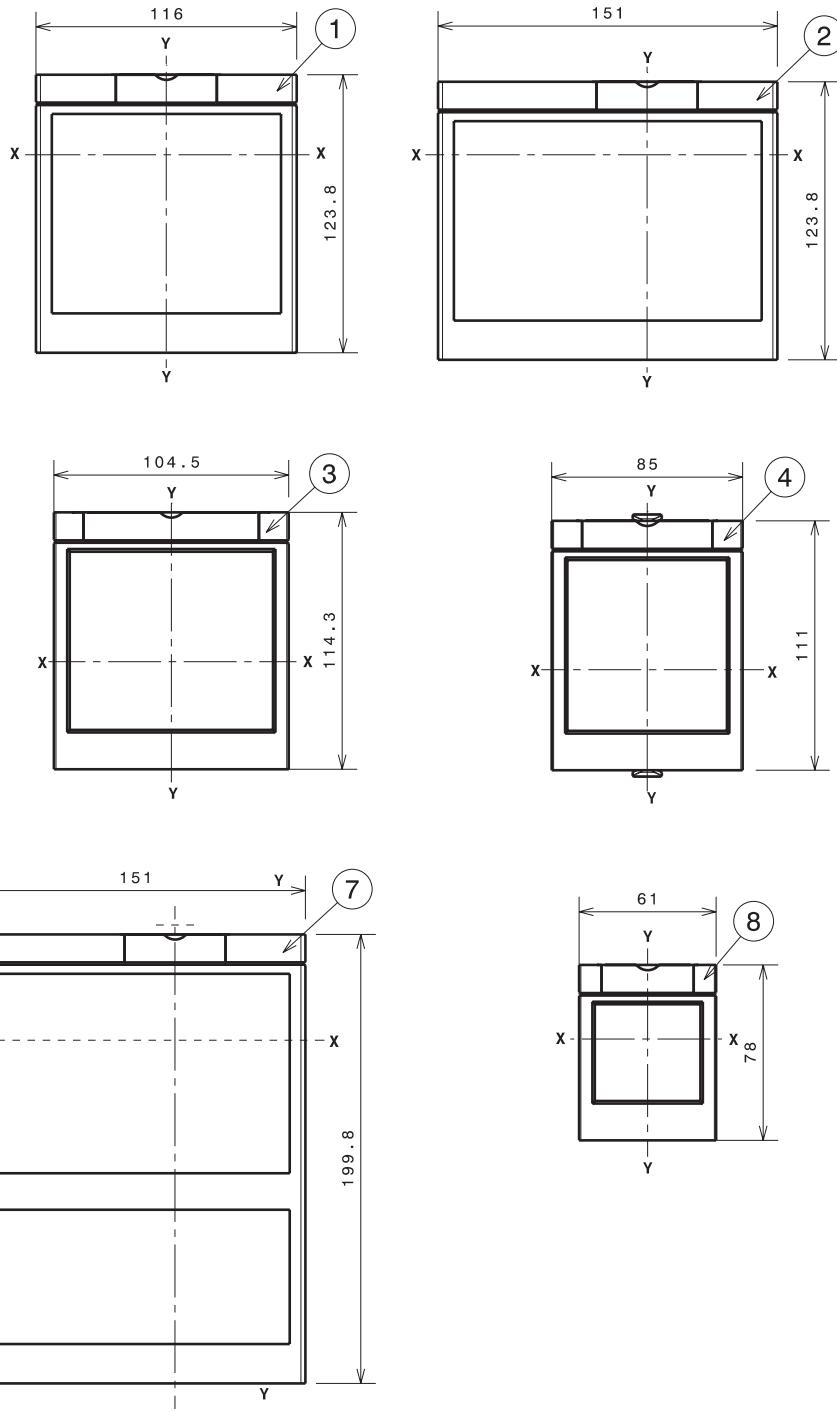

Key


- 1 Flange for plug-in circuit-breaker 3p
- 2 Flange for plug-in circuit-breaker 4p
- 3 Flange for plug-in circuit-breaker 3p-4p with MOE and FLD
- 4 Flange for circuit-breaker 3p-4p with direct rotary handle
- 7 Flange for plug-in circuit-breaker 4p with front extended terminals and residual current
- 8 Optional flange

Tmax XT4 – Installation


Installation for plug-in circuit-breaker

Compartment door drilling templates


With standard flange

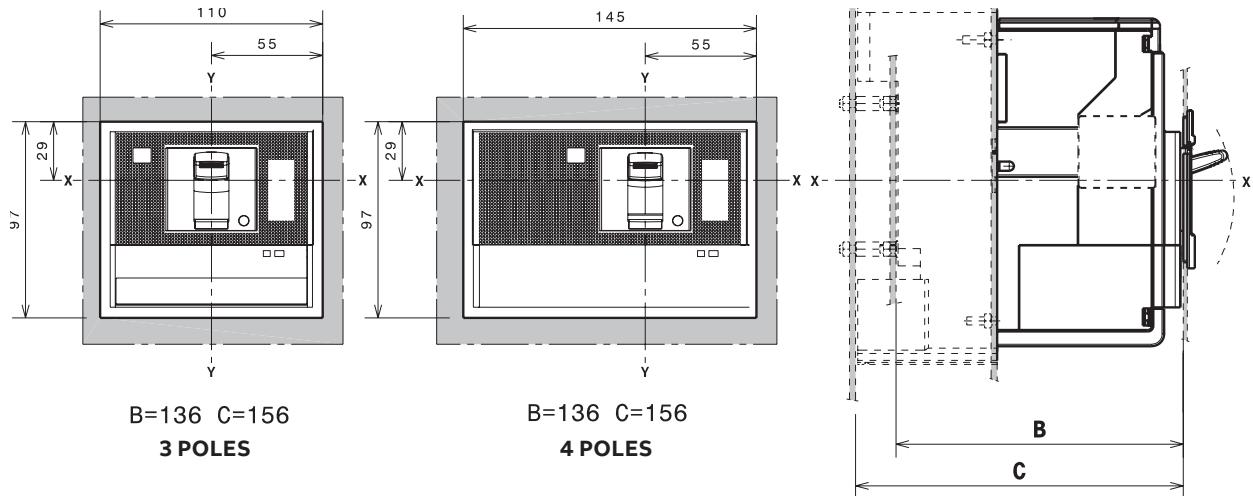

Without flange

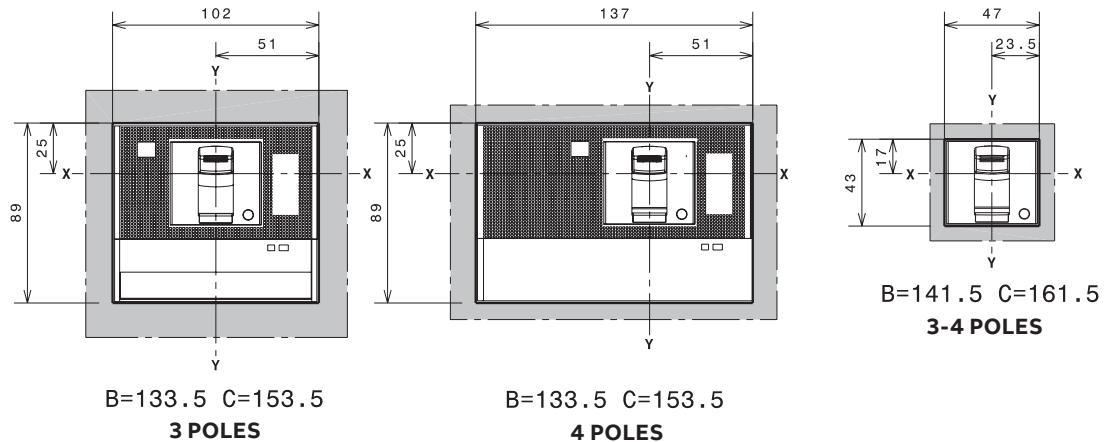


With optional flange

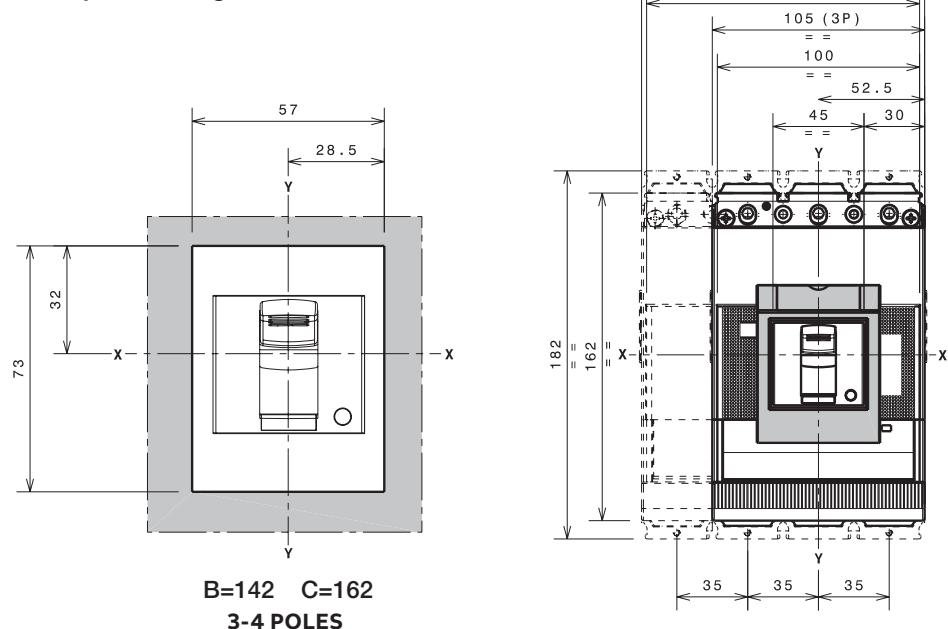

Tmax XT4 – Installation

Terminals for plug-in circuit-breaker

Terminals EF

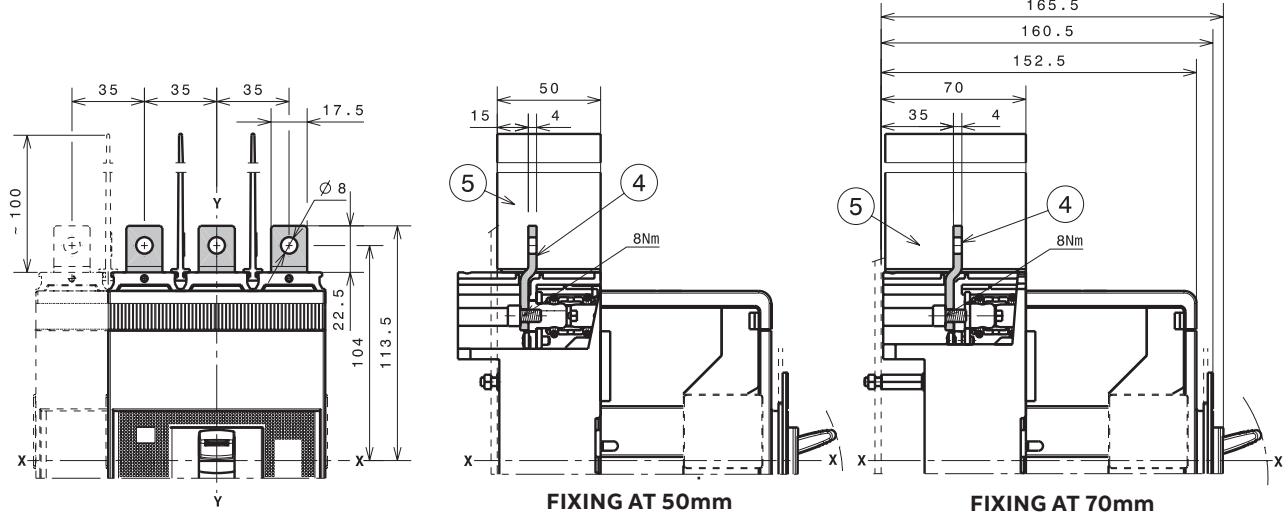


—
Key
4 Front extended
terminals
5 Phase separators
100mm

—
Note:
insulated plate

Tmax XT4 – Installation



Terminals for plug-in circuit-breaker

Terminals ES

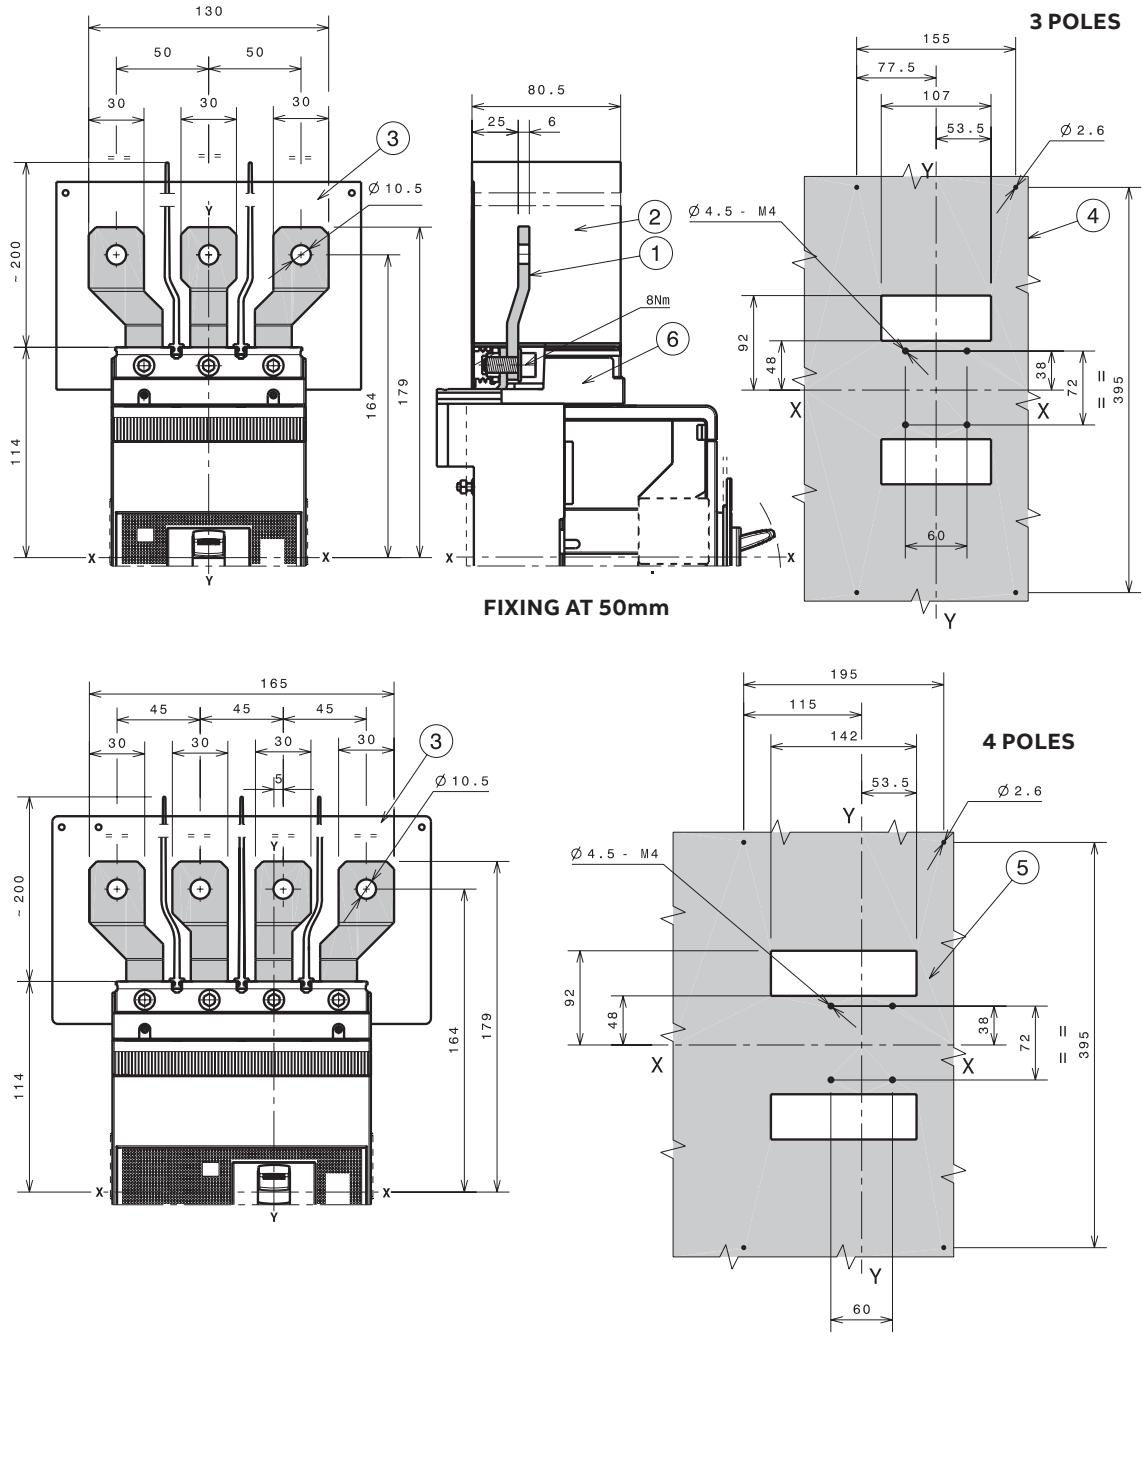

1x1...185mm² terminals FCCuAl



—
Key
 1 1x1...185mm² front terminals FCCuAl
 2 Phase separators 25mm
 6 Adaptor

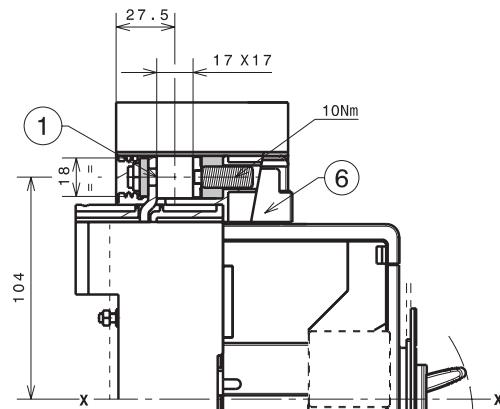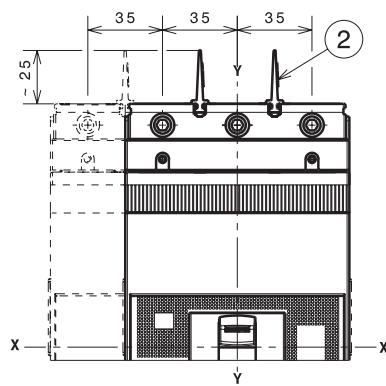

FIXING AT 50mm



2x35...120mm² terminals FCCuAl

—
Key
 1 2x120mm² external terminal FCCuAl
 2 High terminal covers with degree of protection IP40

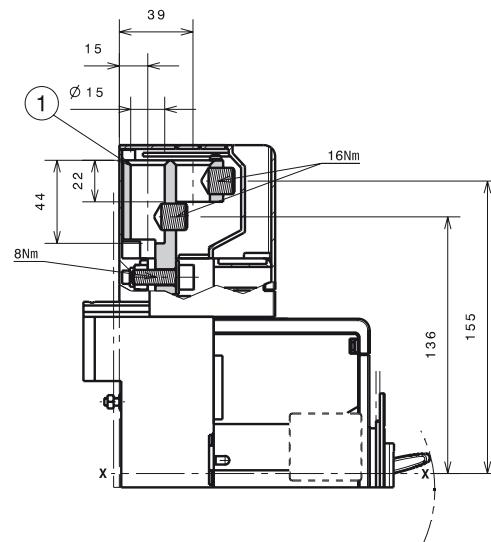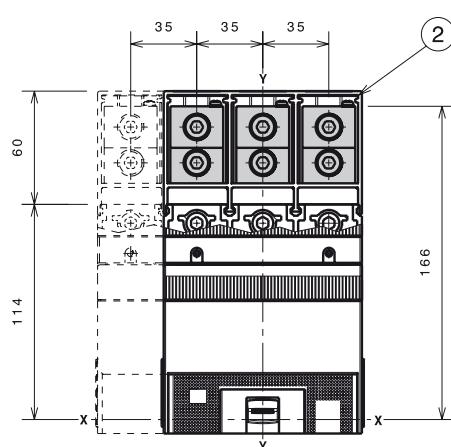

Terminals FCCu

—
Key
 2 Phase separators 25mm
 5 Terminals FCCu
 6 Adaptor

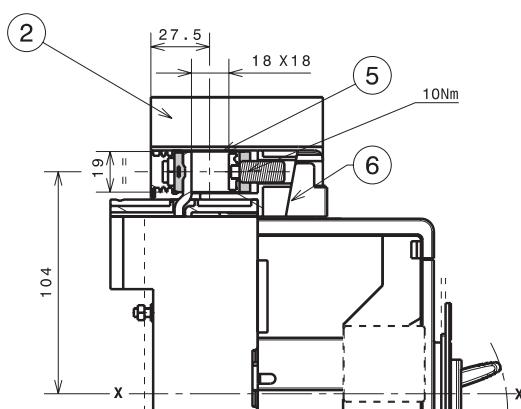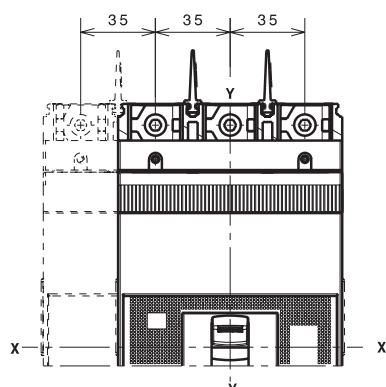



FIXING AT 50mm

Tmax XT4 – Installation

Terminals for plug-in circuit-breaker



Terminals MC

Key
 3 High terminal covers with degree of protection IP40
 4 Multicable terminals
 6 Adaptor

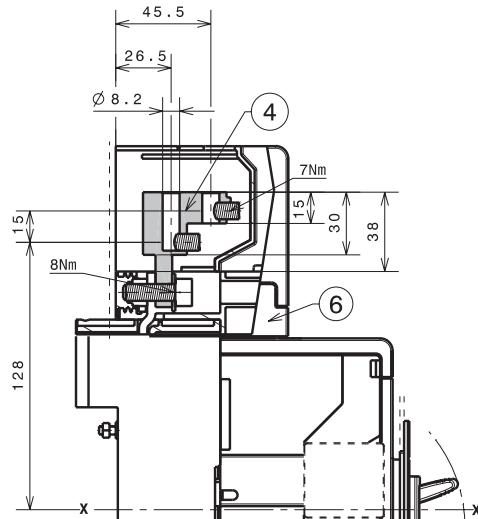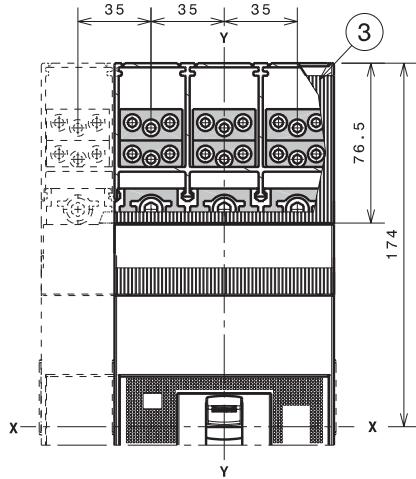

FIXING AT 50mm



Terminals HR/VR

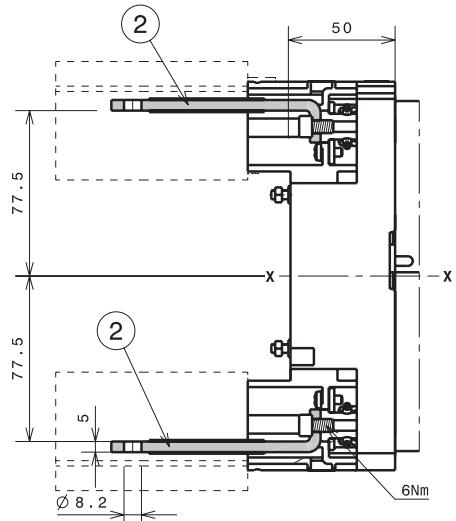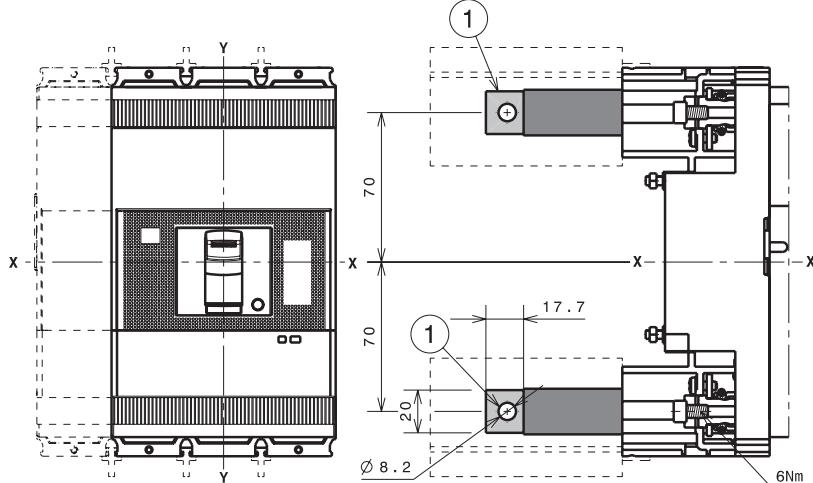

FIXING AT 50mm

FIXING AT 50mm


Key
 1 Rear vertical terminals
 2 Rear horizontal terminals
 3 Rear phase separators 90mm

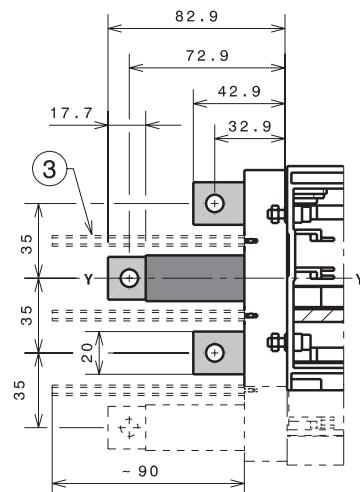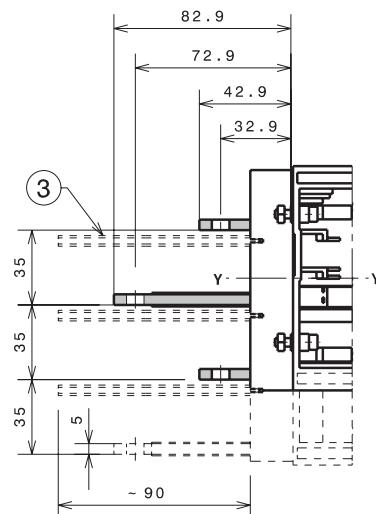

Tmax XT4 – Installation

Accessories for plug-in circuit-breaker


Stored energy motor operator (MOE)

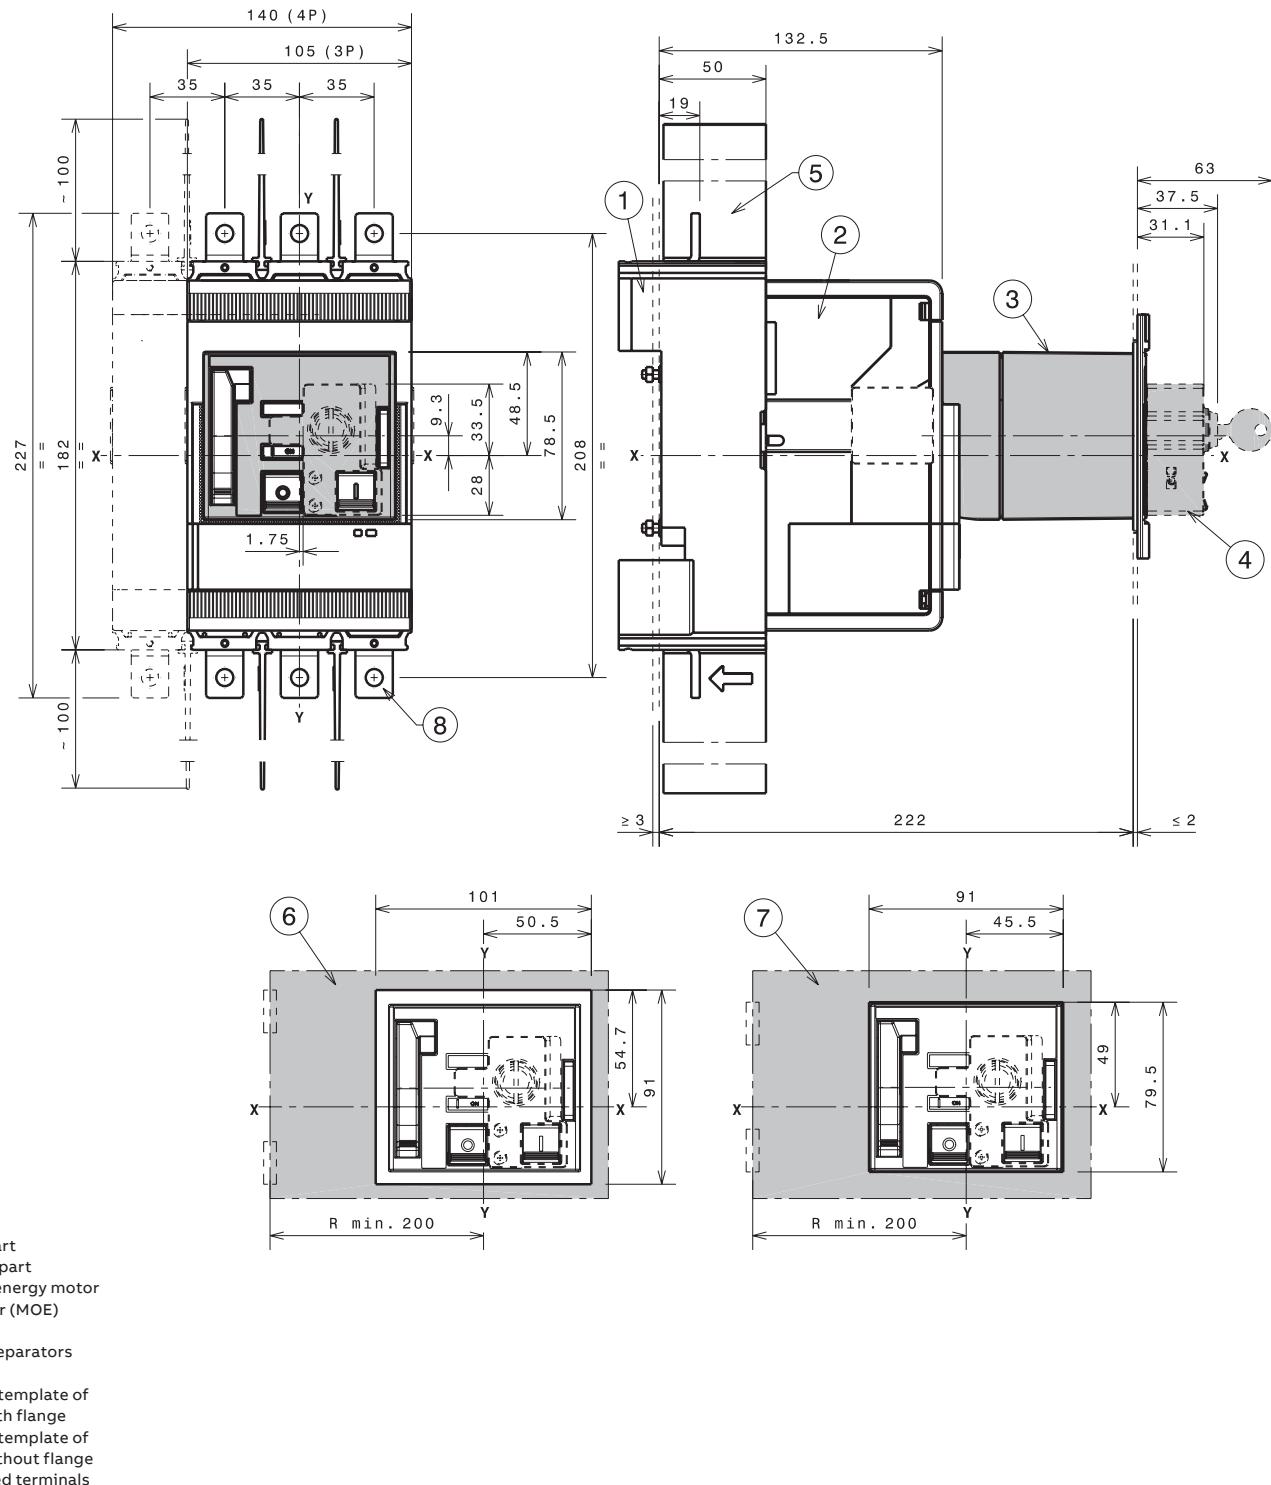


Tmax XT4 – Installation

Accessories for plug-in circuit-breaker

Front for lever operating mechanism (FLD)

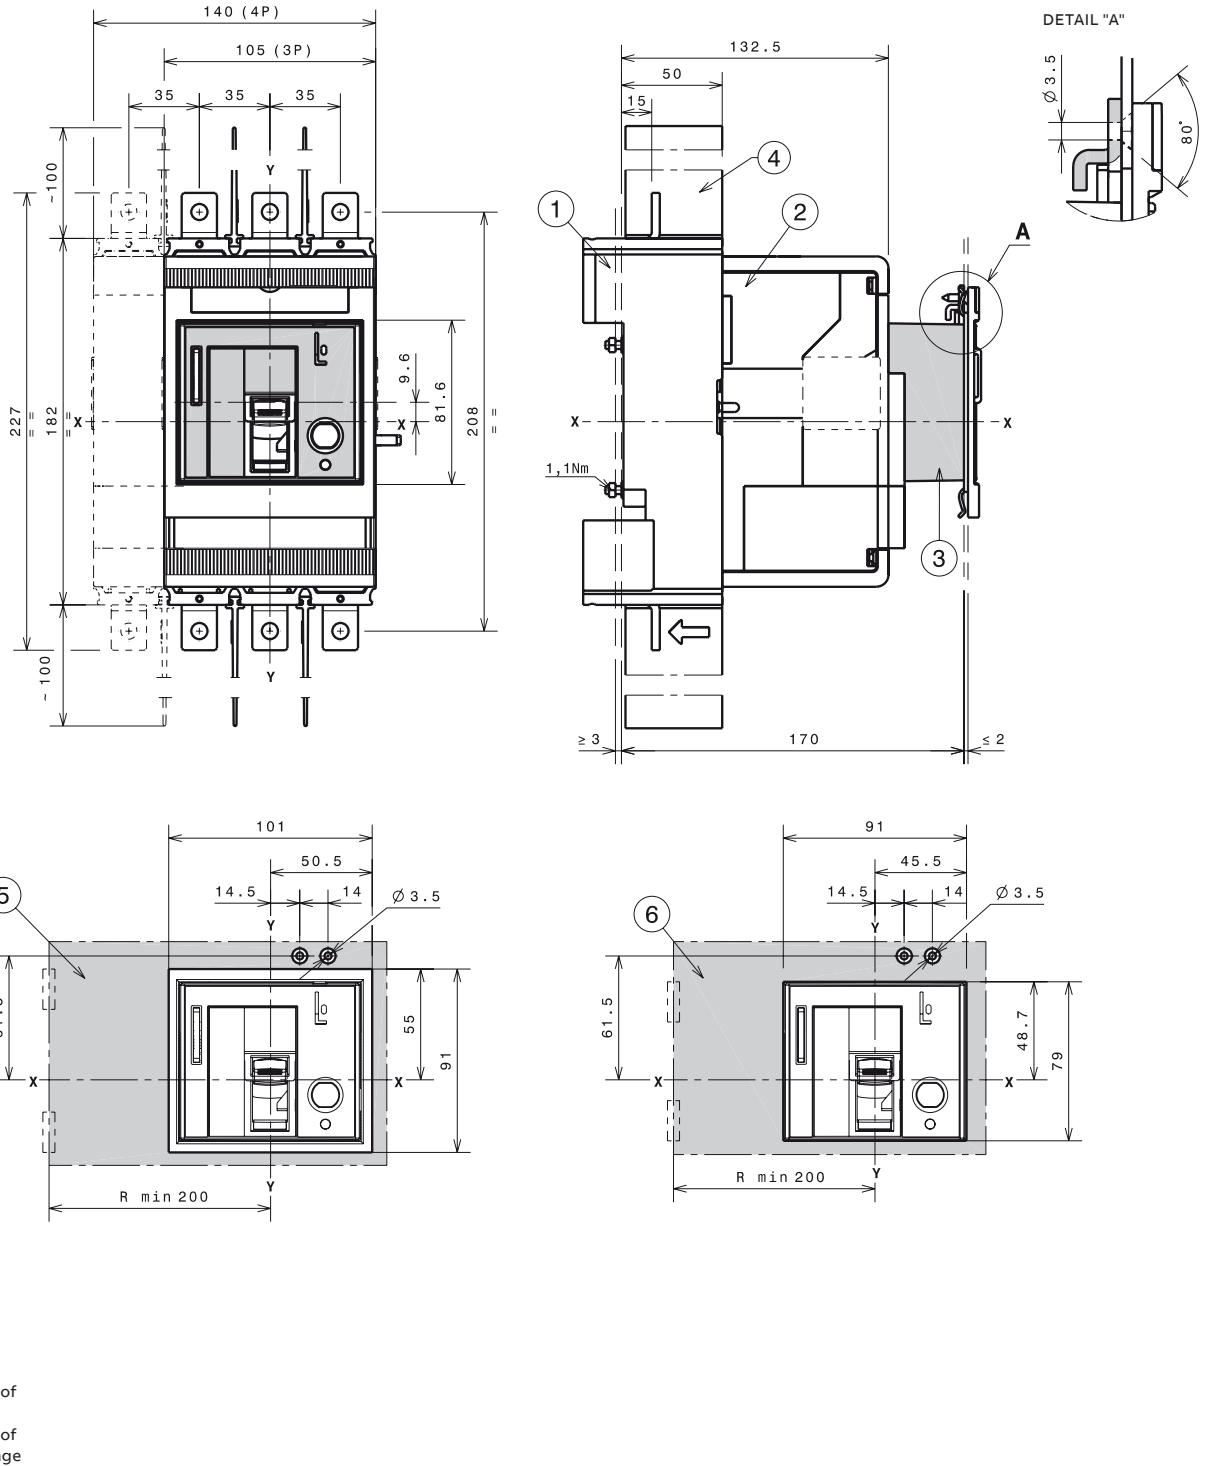


Residual current RC Sel

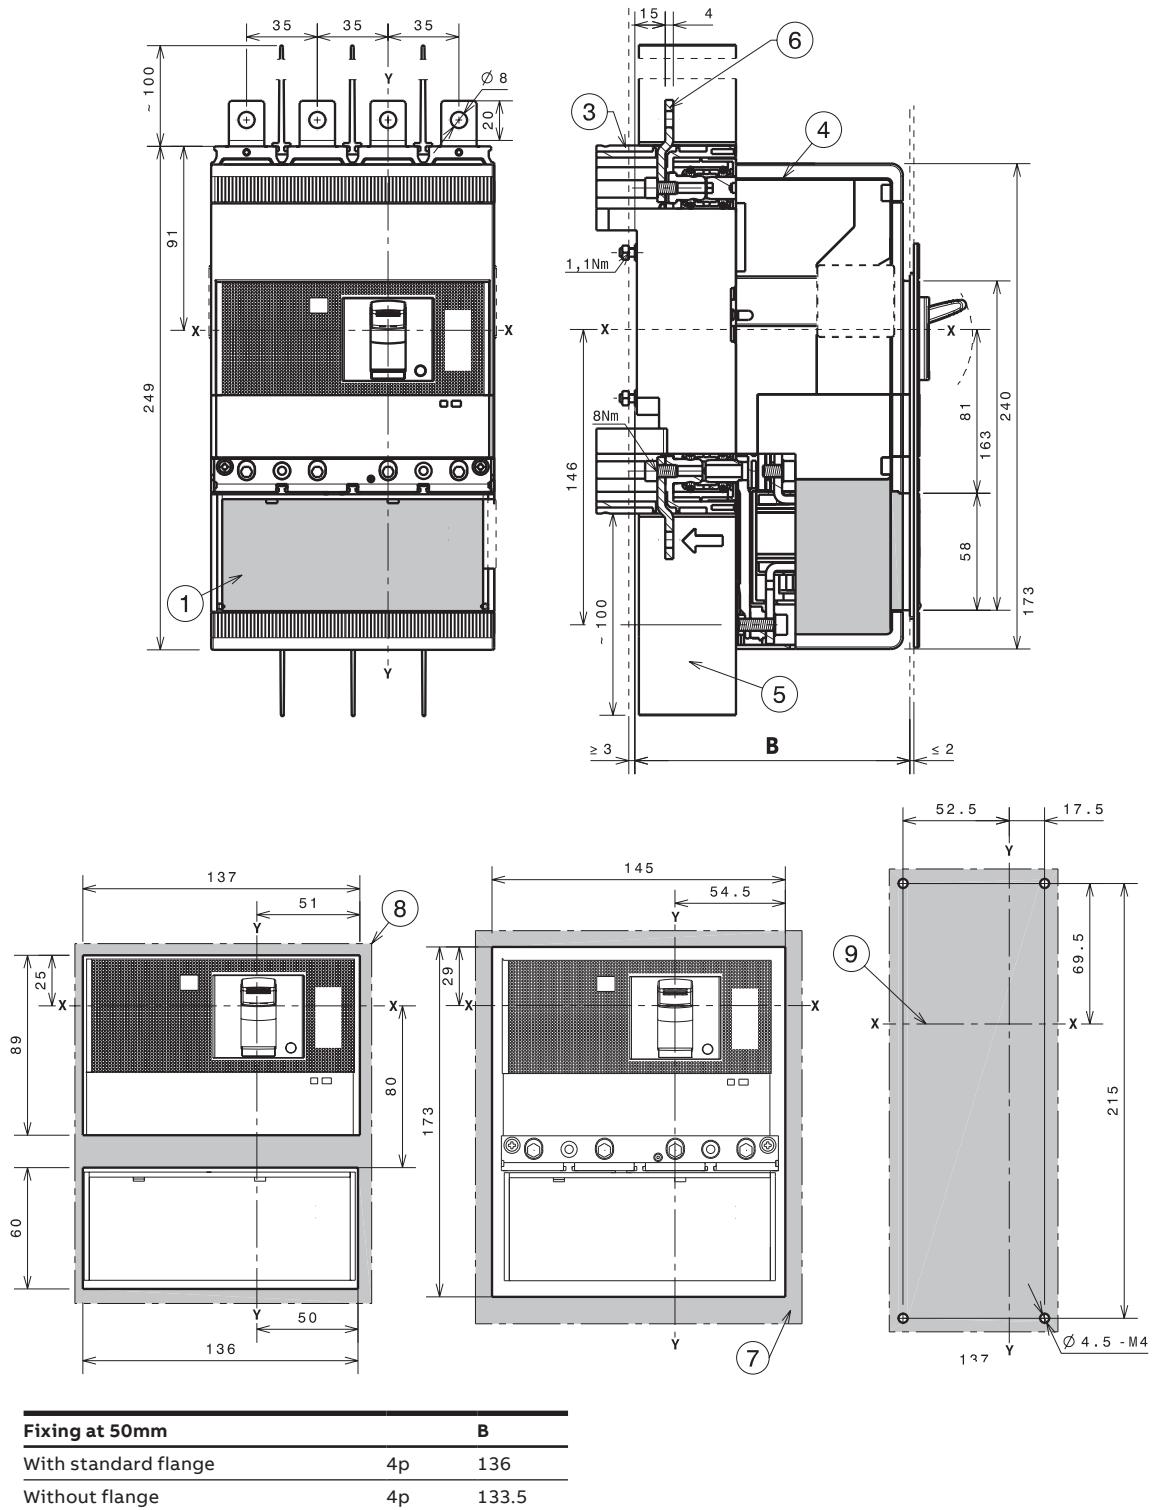

Tmax XT4 – Installation

Installation for withdrawable circuit-breaker

Fixing on sheet

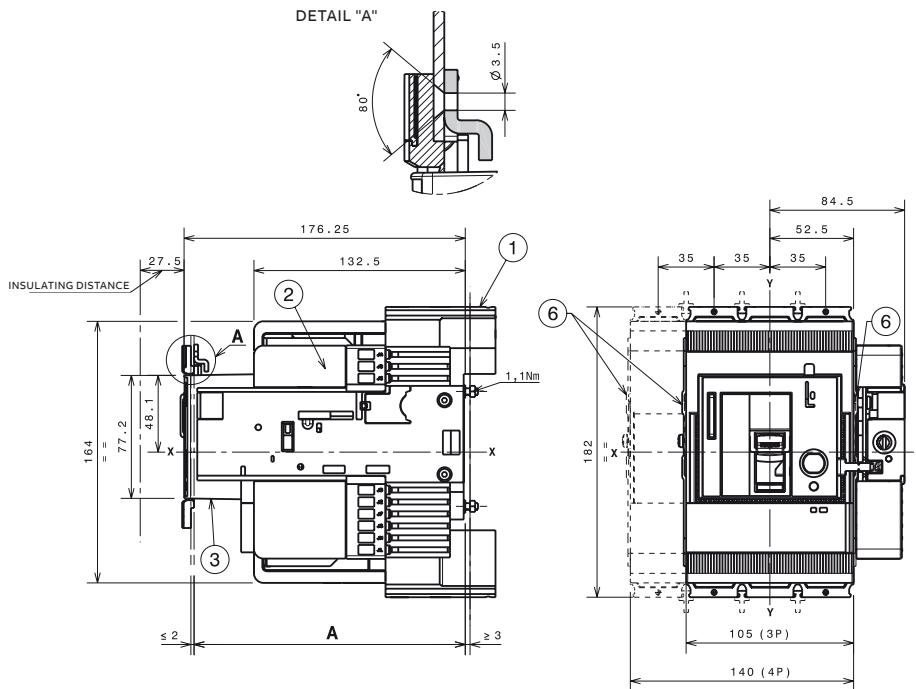


| | A | | |
|----------------------|---------|--|-----|
| | 3p - 4p | Fixing at 50mm | 170 |
| With standard flange | | Fixing at 70mm for front extended terminals | 190 |
| | 3p - 4p | | |

Key

- 1 Fixed part
- 2 Moving part
- 3 FLD (FLD or RHD or RHE or MOE) mandatory with withdrawable version
- 6 Optional wiring ducts

With side connector for Ekip Touch trip units

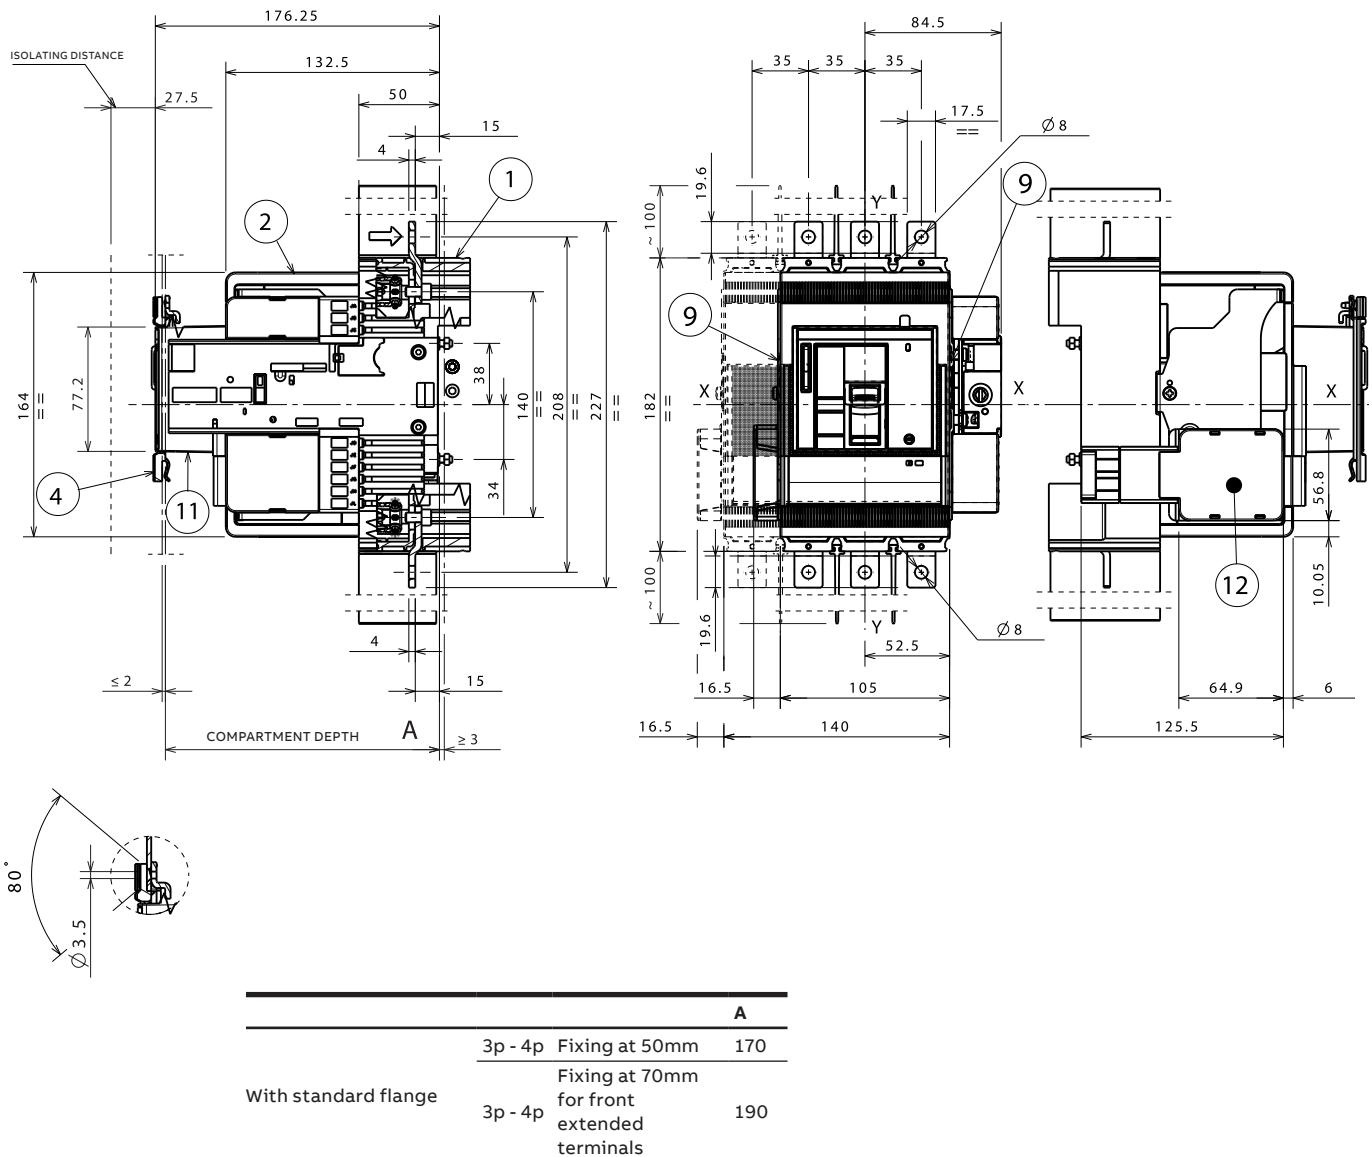


—
Key

- 1 Fixed part
 - 2 Moving part
 - 3 FLD (FLD or RHD
or RHE or MOE)
mandatory with
withdrawable version
 - 4 Flange
 - 9 Optional wiring ducts
 - 12 Connection kit W
IntBus/ExtNeut/Sel

Tmax XT4 – Installation


Installation for withdrawable circuit-breaker

Drilling templates for support sheet

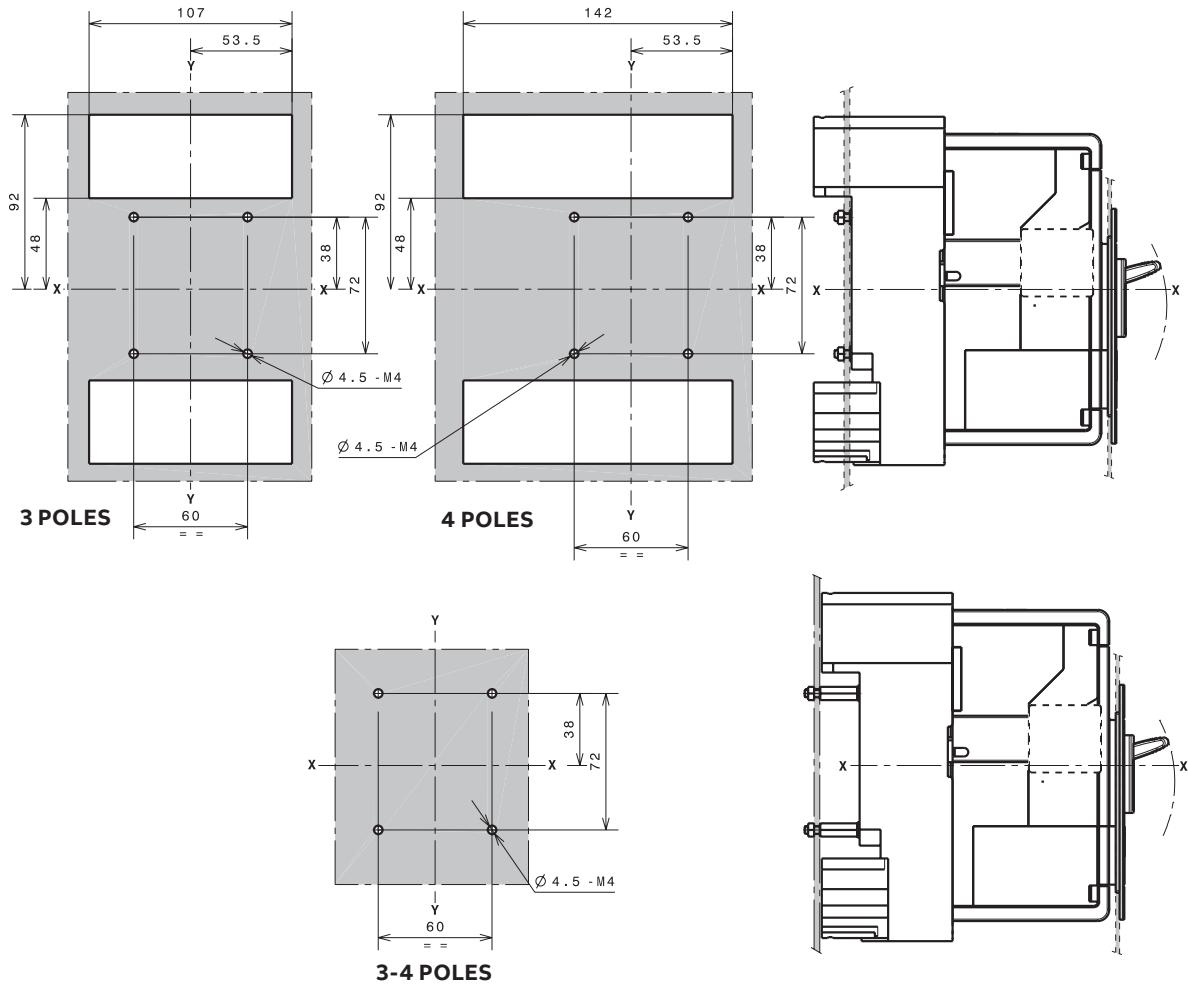

Flanges


- Key
- 5 Flange for withdrawable circuit-breaker 3p-4p
 - 6 Flange for residual current release (withdrawable 4p circuit-breaker) with front extended terminals

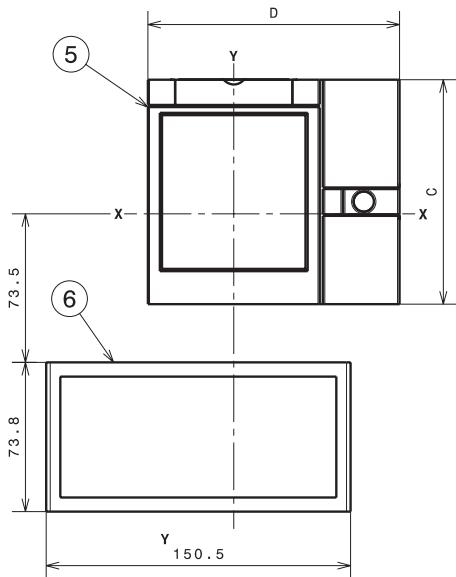


| | C | D |
|-----------|-------|-------|
| RHD | 111 | 124.5 |
| FLD - MOE | 114.3 | 134.5 |

Compartment door drilling templates


With standard flange

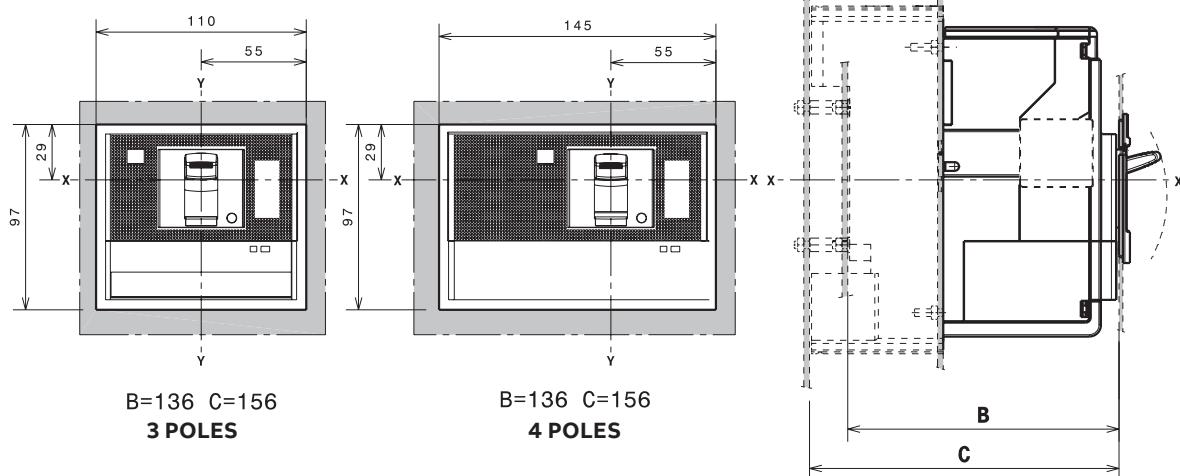

Without flange

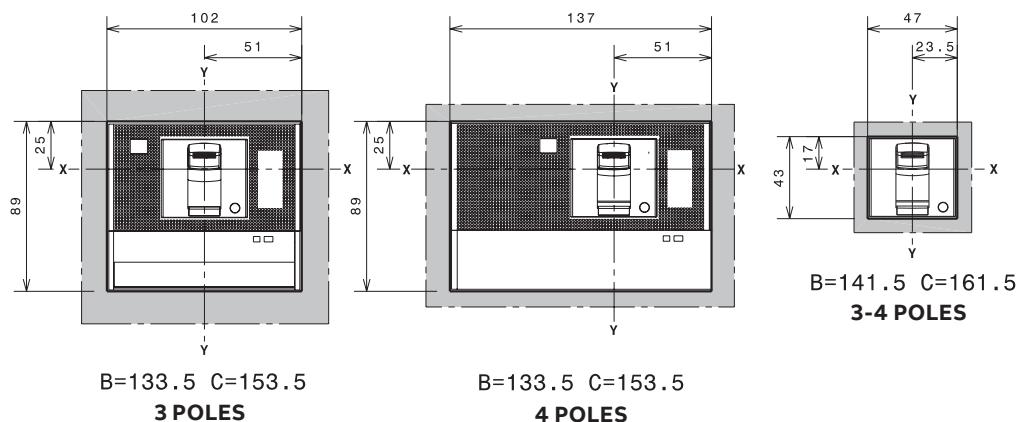


With optional flange

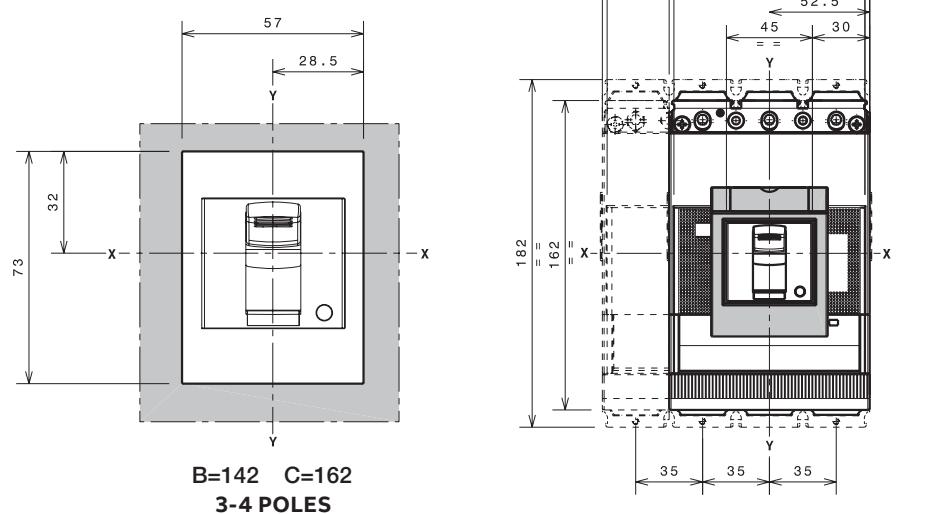

Tmax XT4 – Installation

Terminals for withdrawable circuit-breaker



Terminals EF

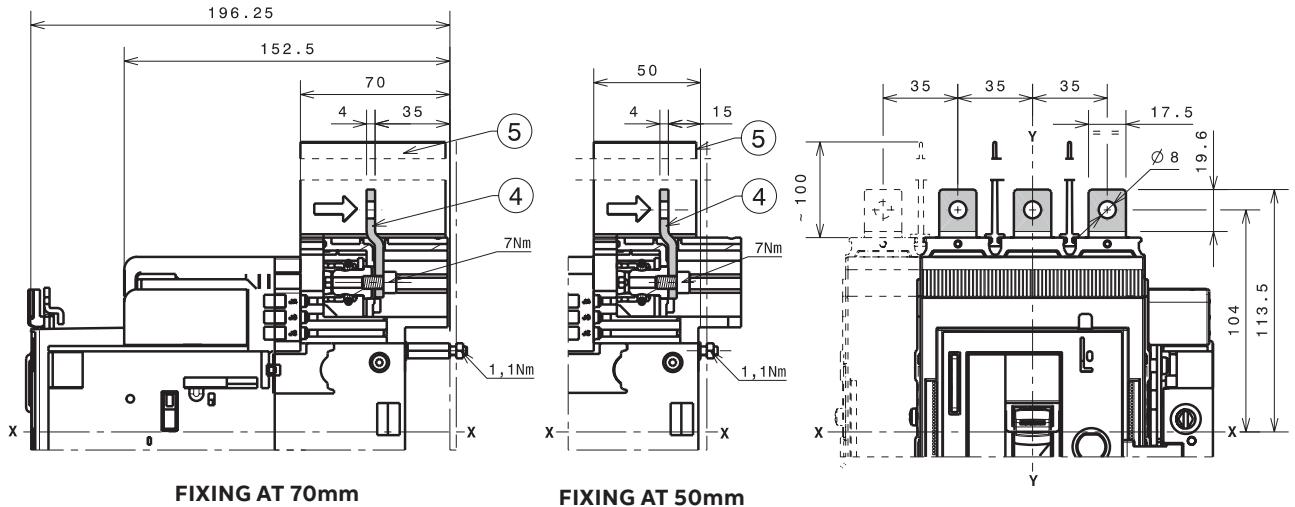

—
Key
4 Front extended terminals
5 Phase separators 100mm

—
Note:
insulated plate

Terminals ES

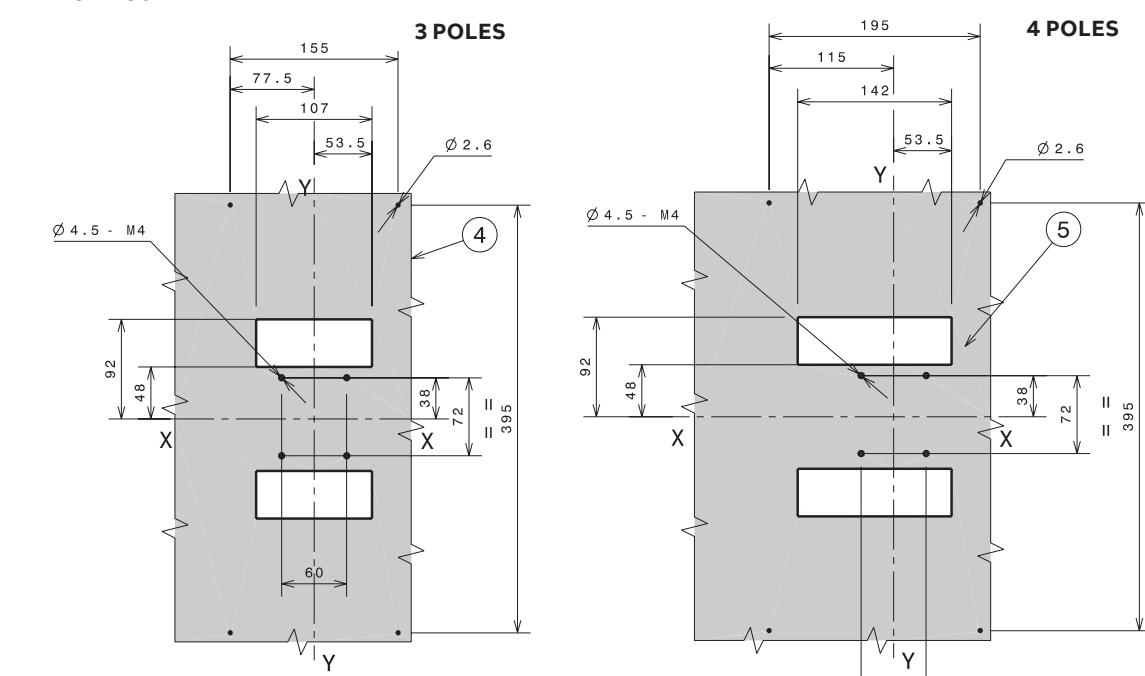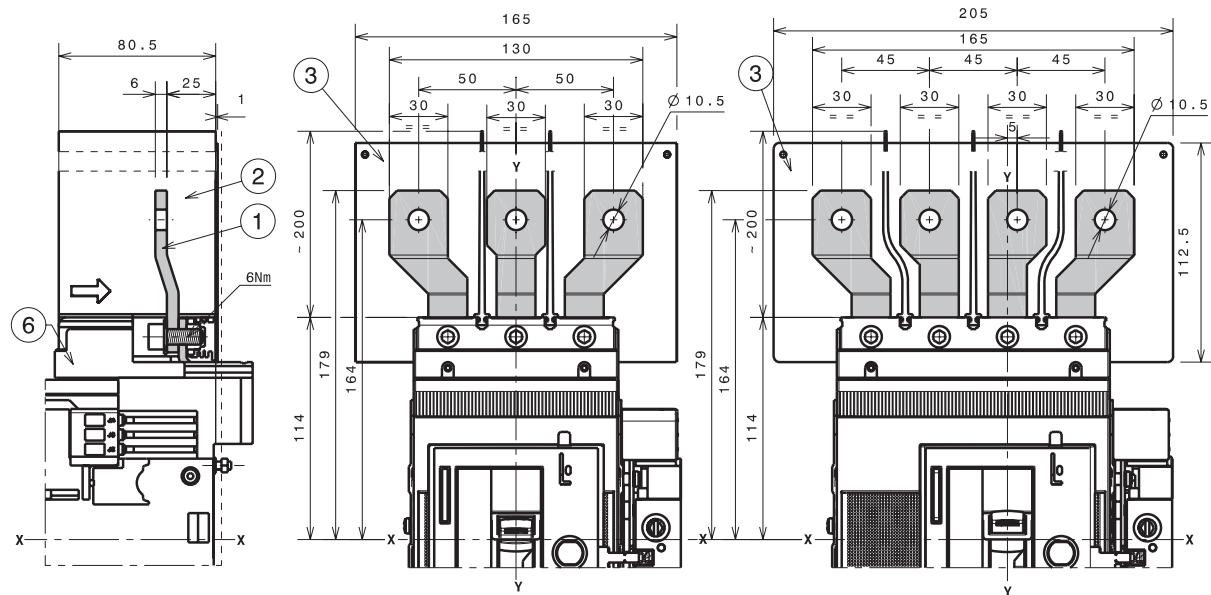


- Key
- 1 Front extended spread terminals
 - 2 Phase separators 200mm
 - 3 Insulated plate
 - 4 Drilling template for 3p circuit-breaker
 - 5 Drilling template for 4p circuit-breaker
 - 6 Adaptor

Tmax XT4 – Installation

Terminals for withdrawable circuit-breaker


1x1...185mm² terminals FCCuAl

- Key
2 Phase separators
25mm
4 Front terminals
FCCuAl
5 Adaptor

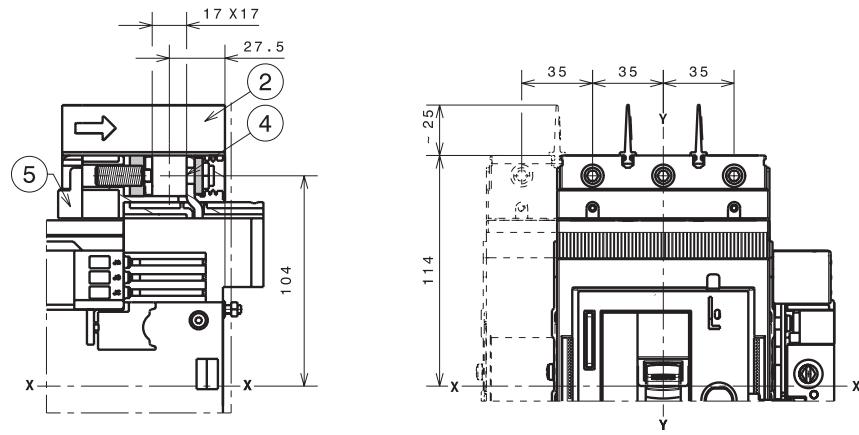



2x35...120mm² terminals FCCuAl

- Key
1 2x35...120mm²
terminals
FCCuAl
2 Terminal covers
with degree of
protection IP40
3 Rear insulated plate
4 Drilling template
for circuit-breaker
3p fixing with
insulating plate
5 Drilling template
for circuit-breaker
4p fixing with
insulating plate

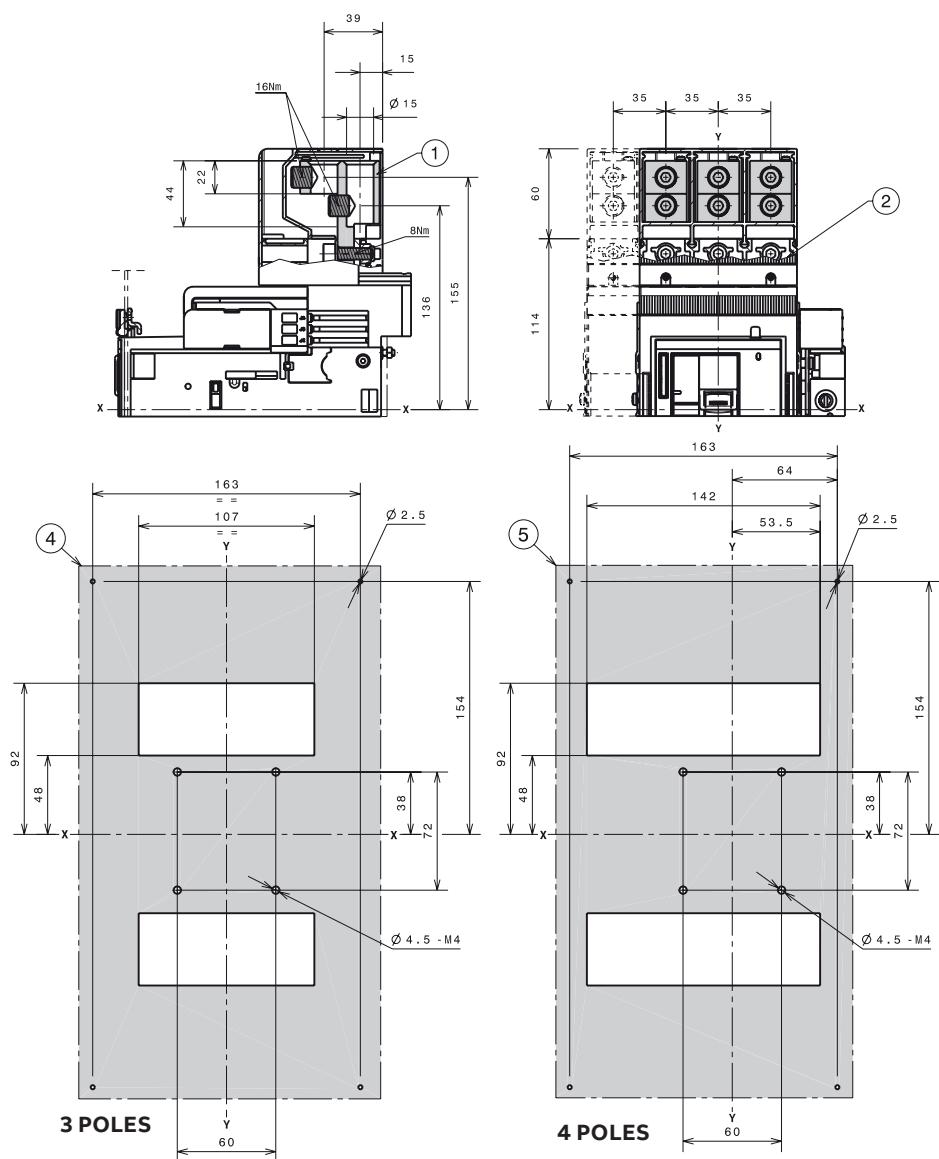



Terminals FCCu

—
Key
 1 Phase separators 25mm
 2 Terminals FCCu
 3 Adaptor

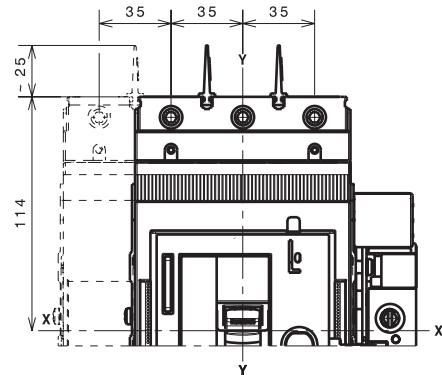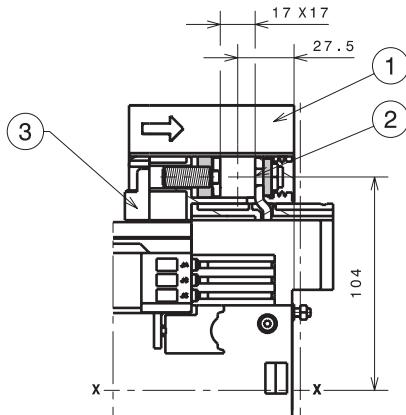**FIXING AT 50 mm**

Terminals MC


—
Key
 1 Multicable terminals
 3 High terminal covers with degree of protection IP40
 4 Adaptor

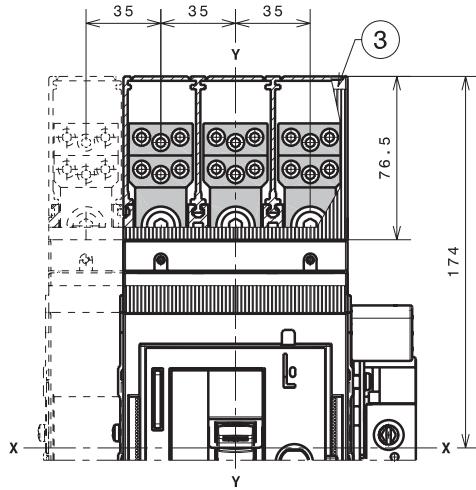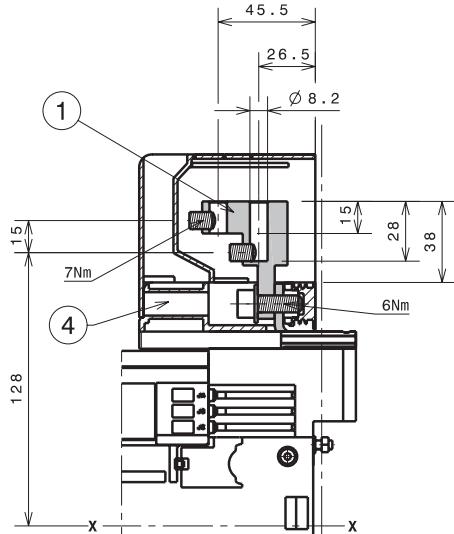**FIXING AT 50 mm**

Tmax XT4 – Installation

Terminals for withdrawable circuit-breaker

Terminals HR/VR

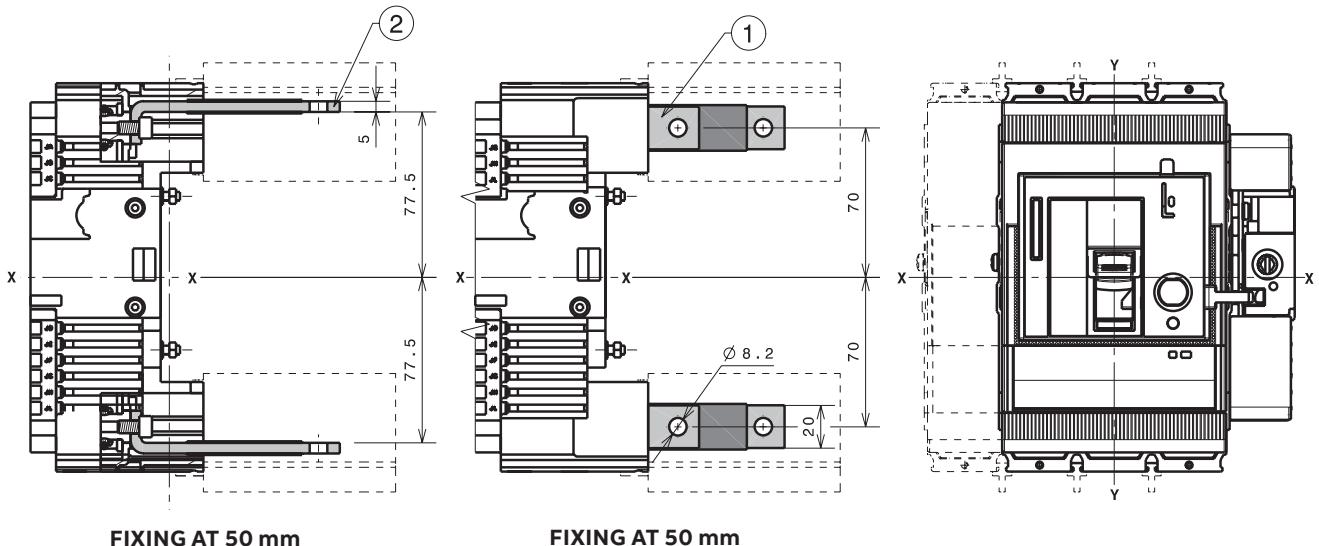

FIXING AT 50 mm


FIXING AT 50 mm

- Key
- 1 Rear vertical terminals
 - 2 Rear horizontal terminals
 - 3 Rear phase separators 90mm

Tmax XT4 – Installation

Accessories for withdrawable circuit-breaker


Front for lever operating mechanism (FLD)

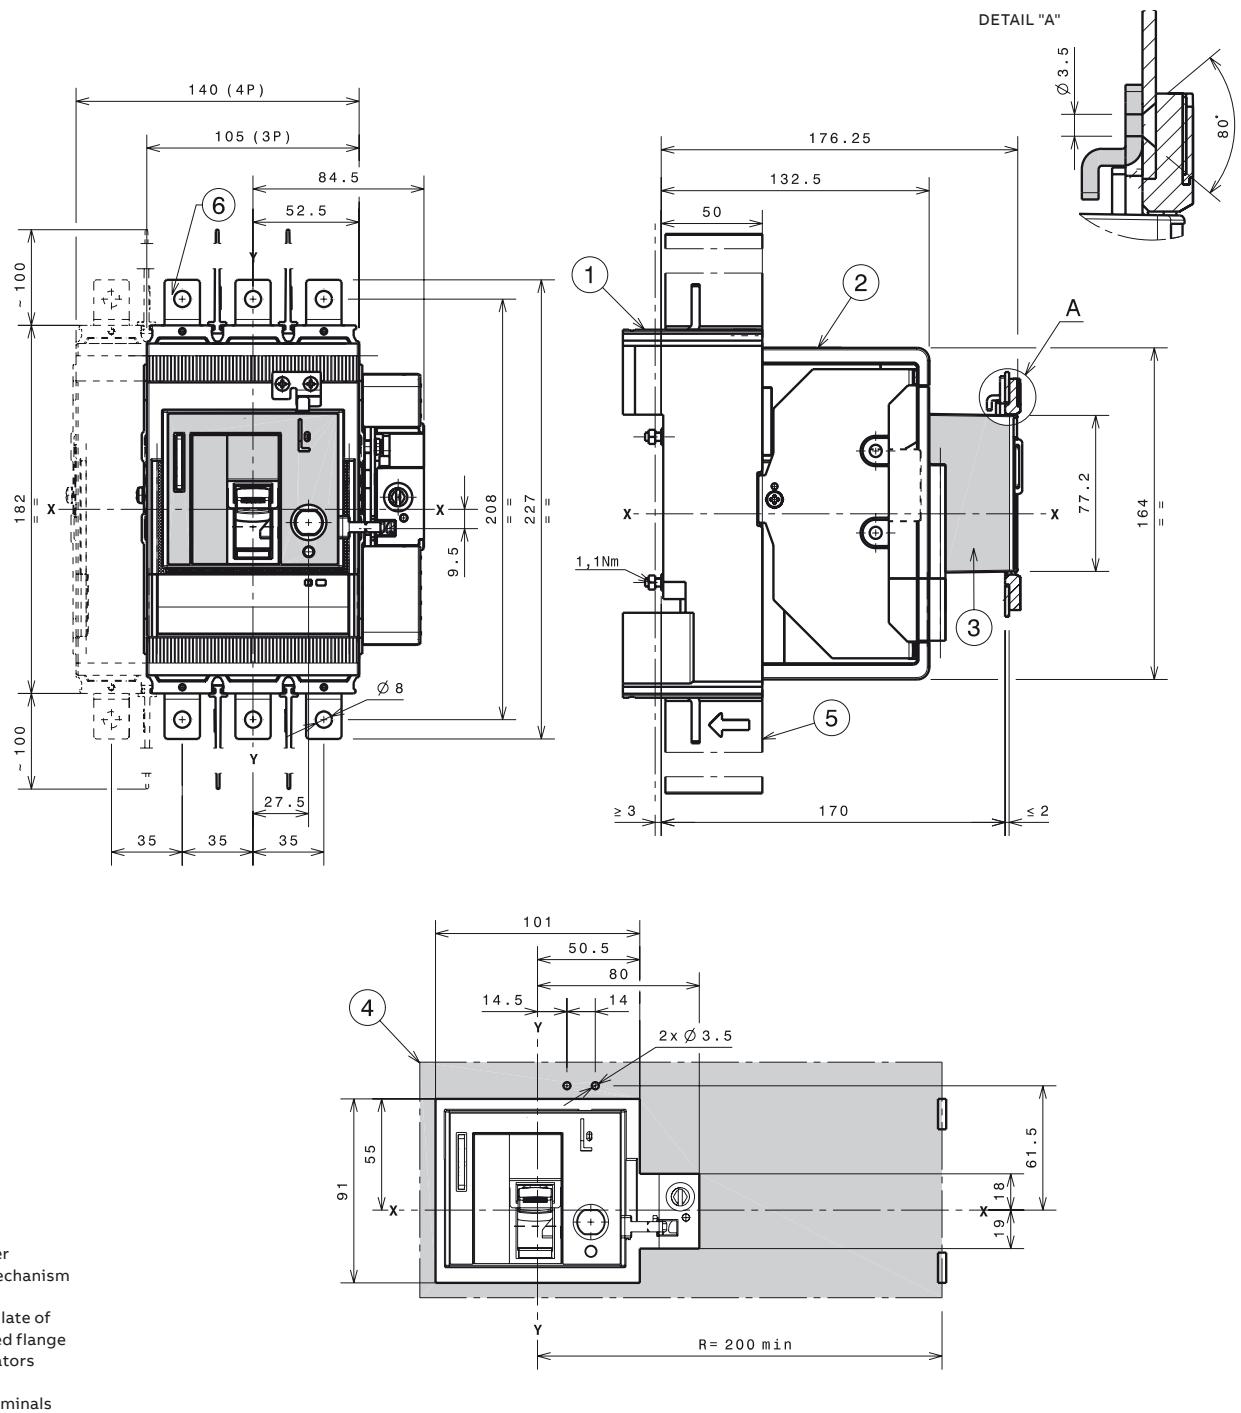


Tmax XT4 – Installation

Accessories for withdrawable circuit-breaker

Stored energy motor operator (MOE)

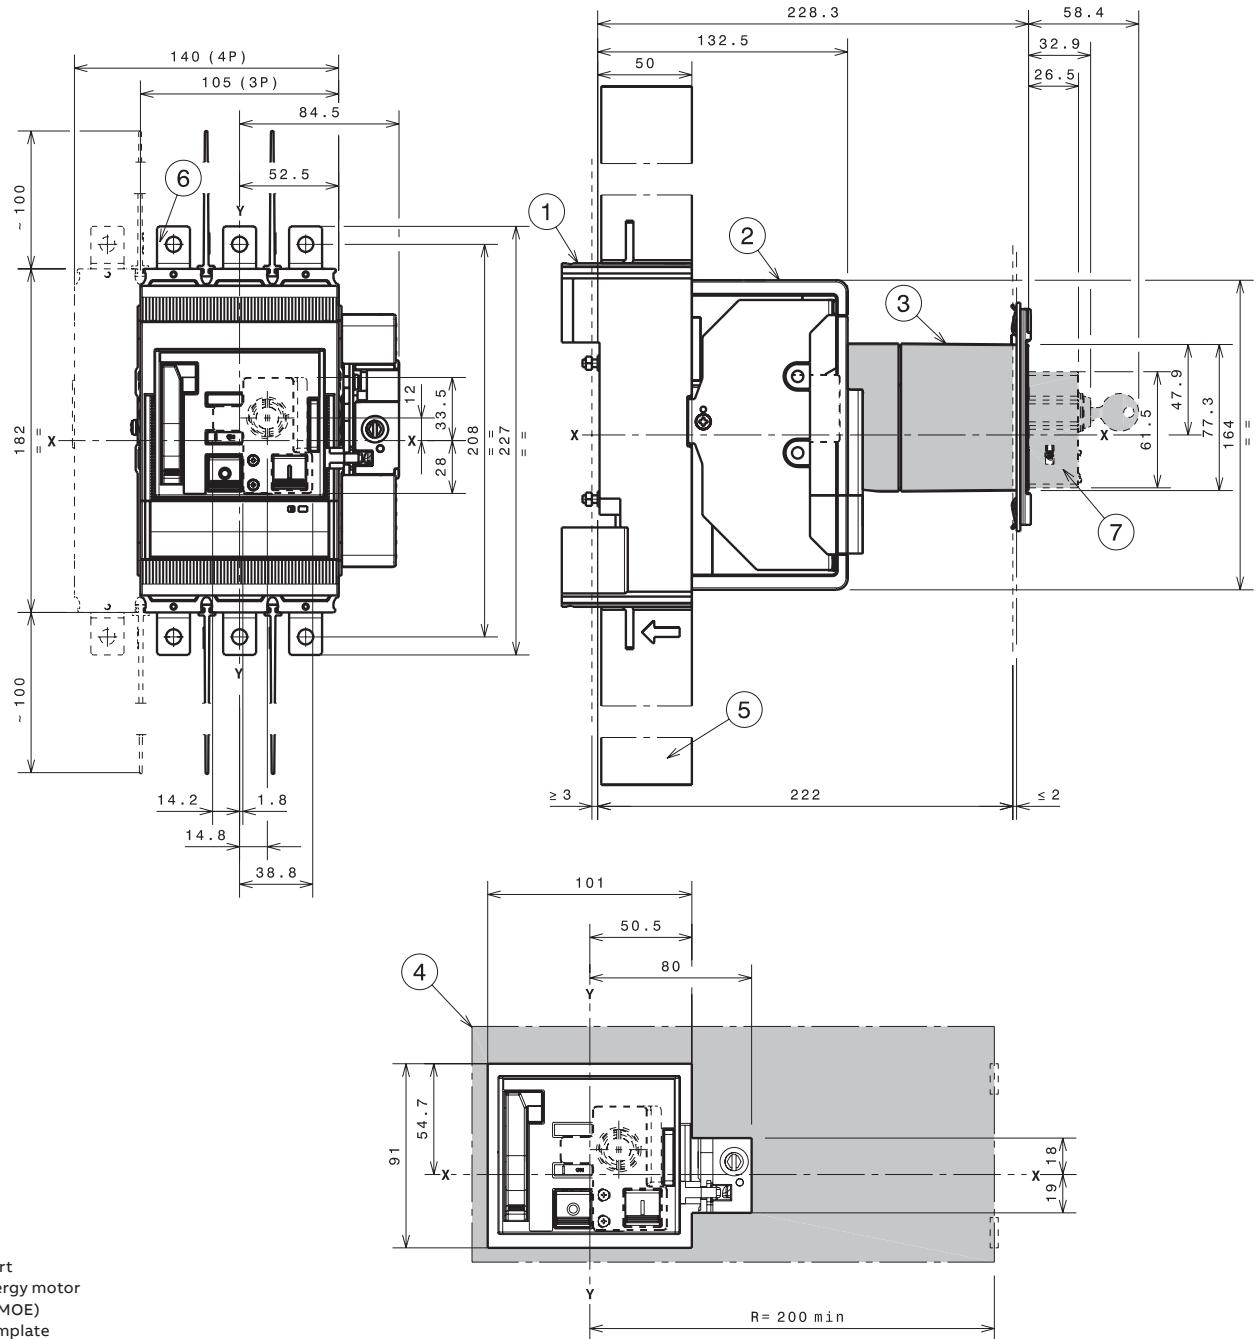

Rotary handle operating mechanism on circuit-breakers (RHD)

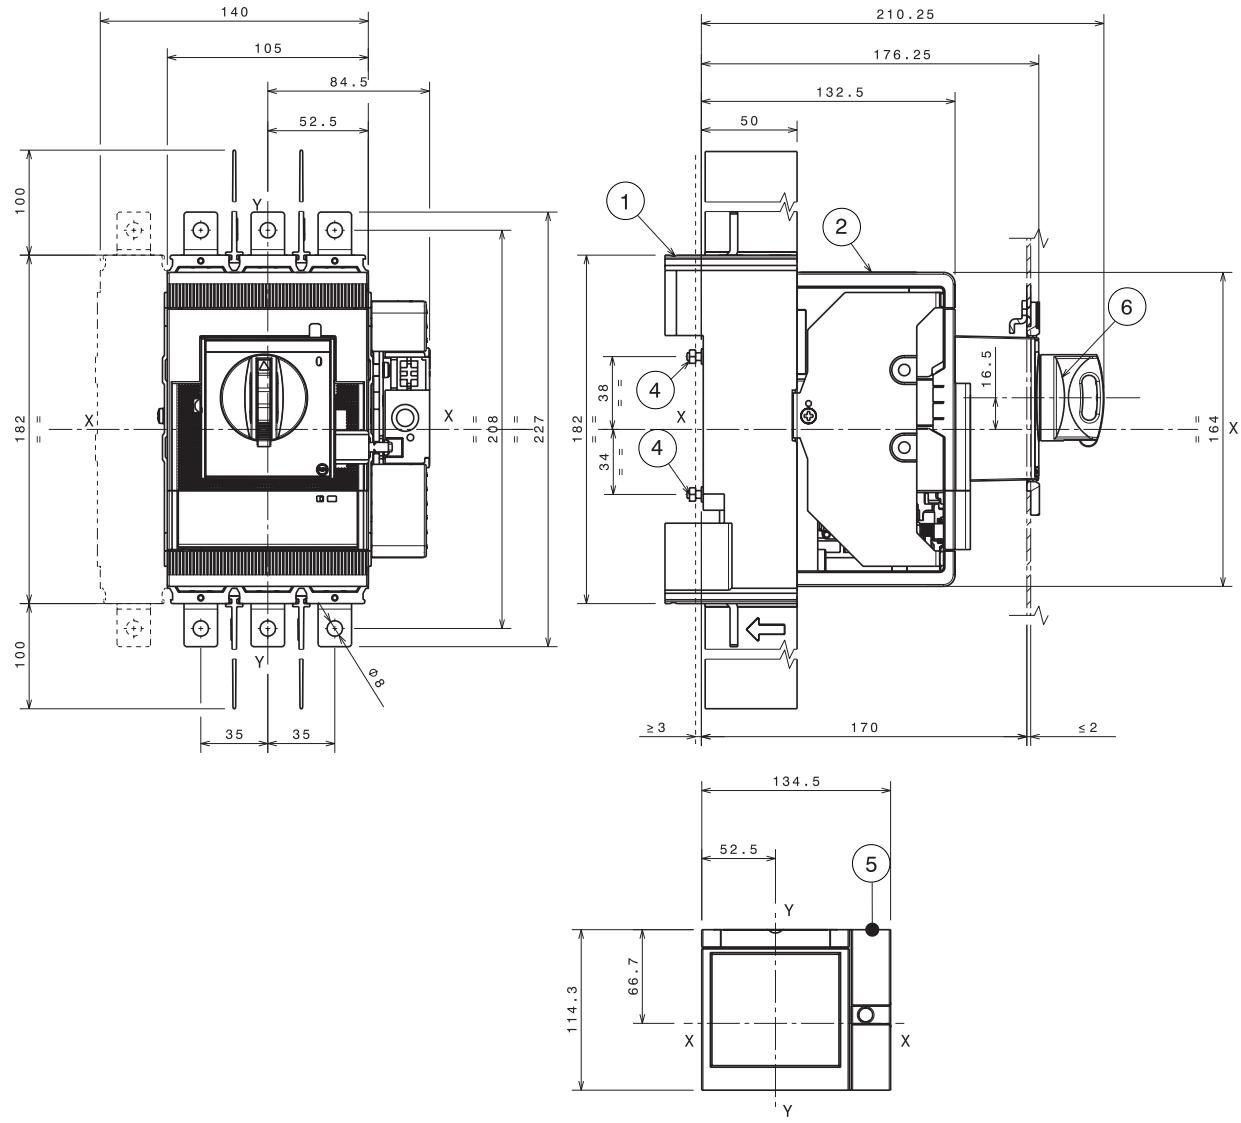


Key

- 1 Fixed part
- 2 Moving part
- 4 Tightening torque 1.1 Nm
- 5 Flange for the compartment door
- 6 Rotary handle operating mechanism for circuit-breaker

Tmax XT4 – Installation

Accessories for withdrawable circuit-breaker

Rotary handle operating mechanism on the compartment door (RHE)

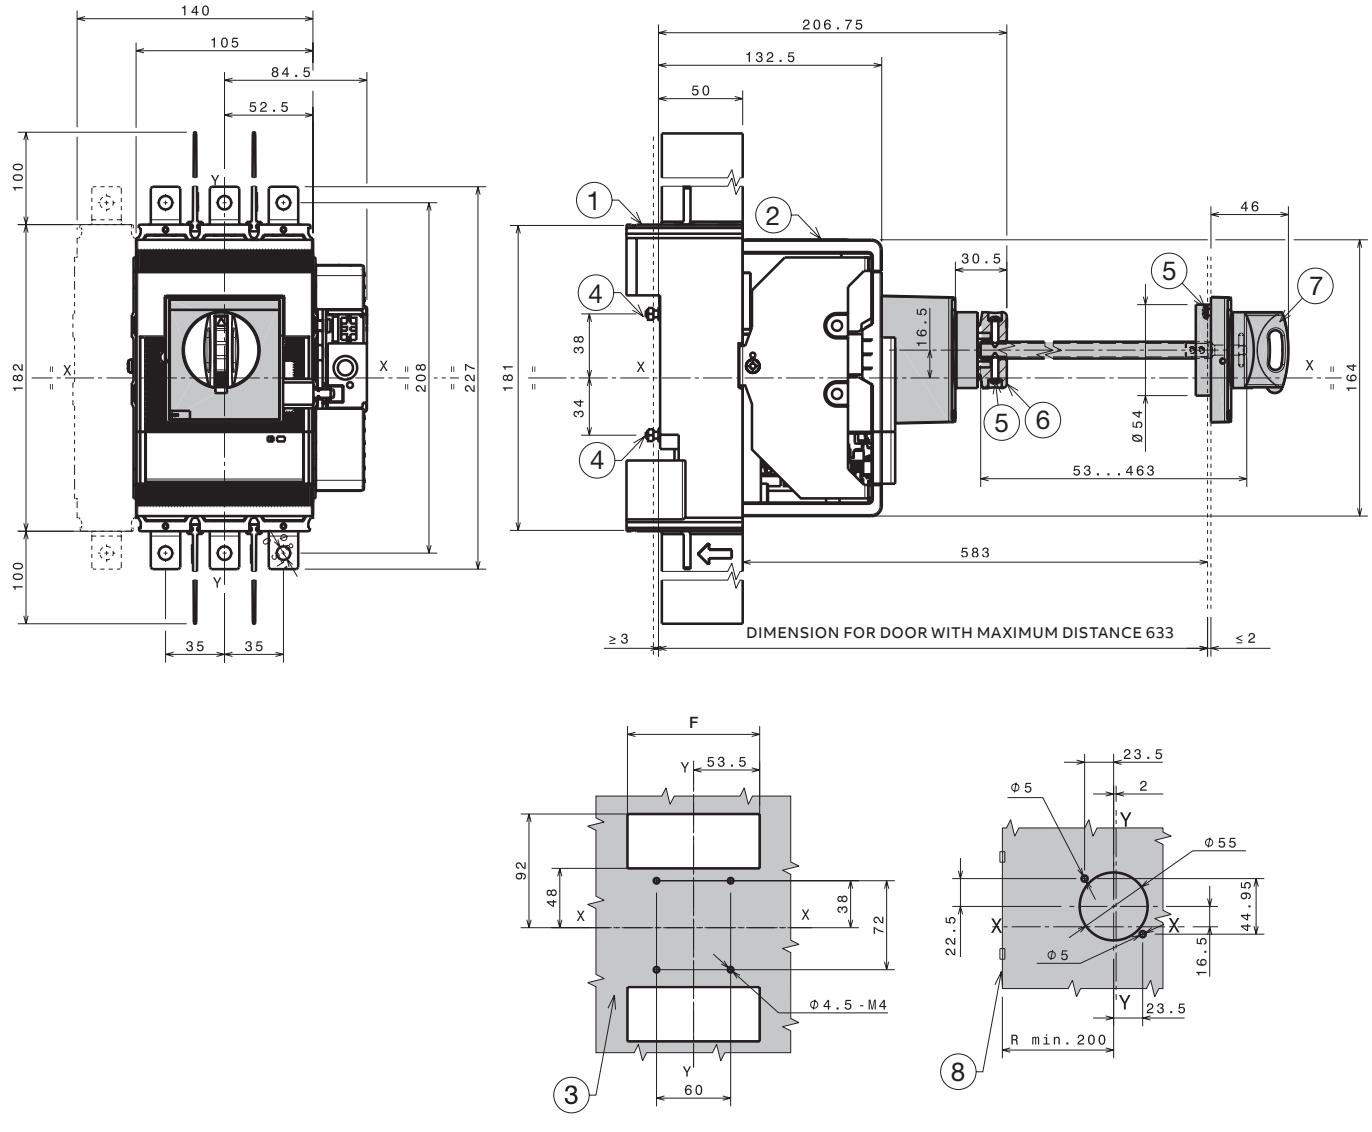


Key

- 1 Fixed part
- 2 Moving part
- 3 Compartment door drilling template- for fixed part
- 4 Tightening torque 1.1 Nm
- 5 Tightening torque 1.4 Nm
- 6 Transmission mechanism
- 7 Rotary handle operating mechanism for compartment door
- 8 Compartment door drilling template

| | F |
|----------------|-----|
| Fixing 3 poles | 107 |
| Fixing 4 poles | 142 |


Residual current RC Sel 4 poles

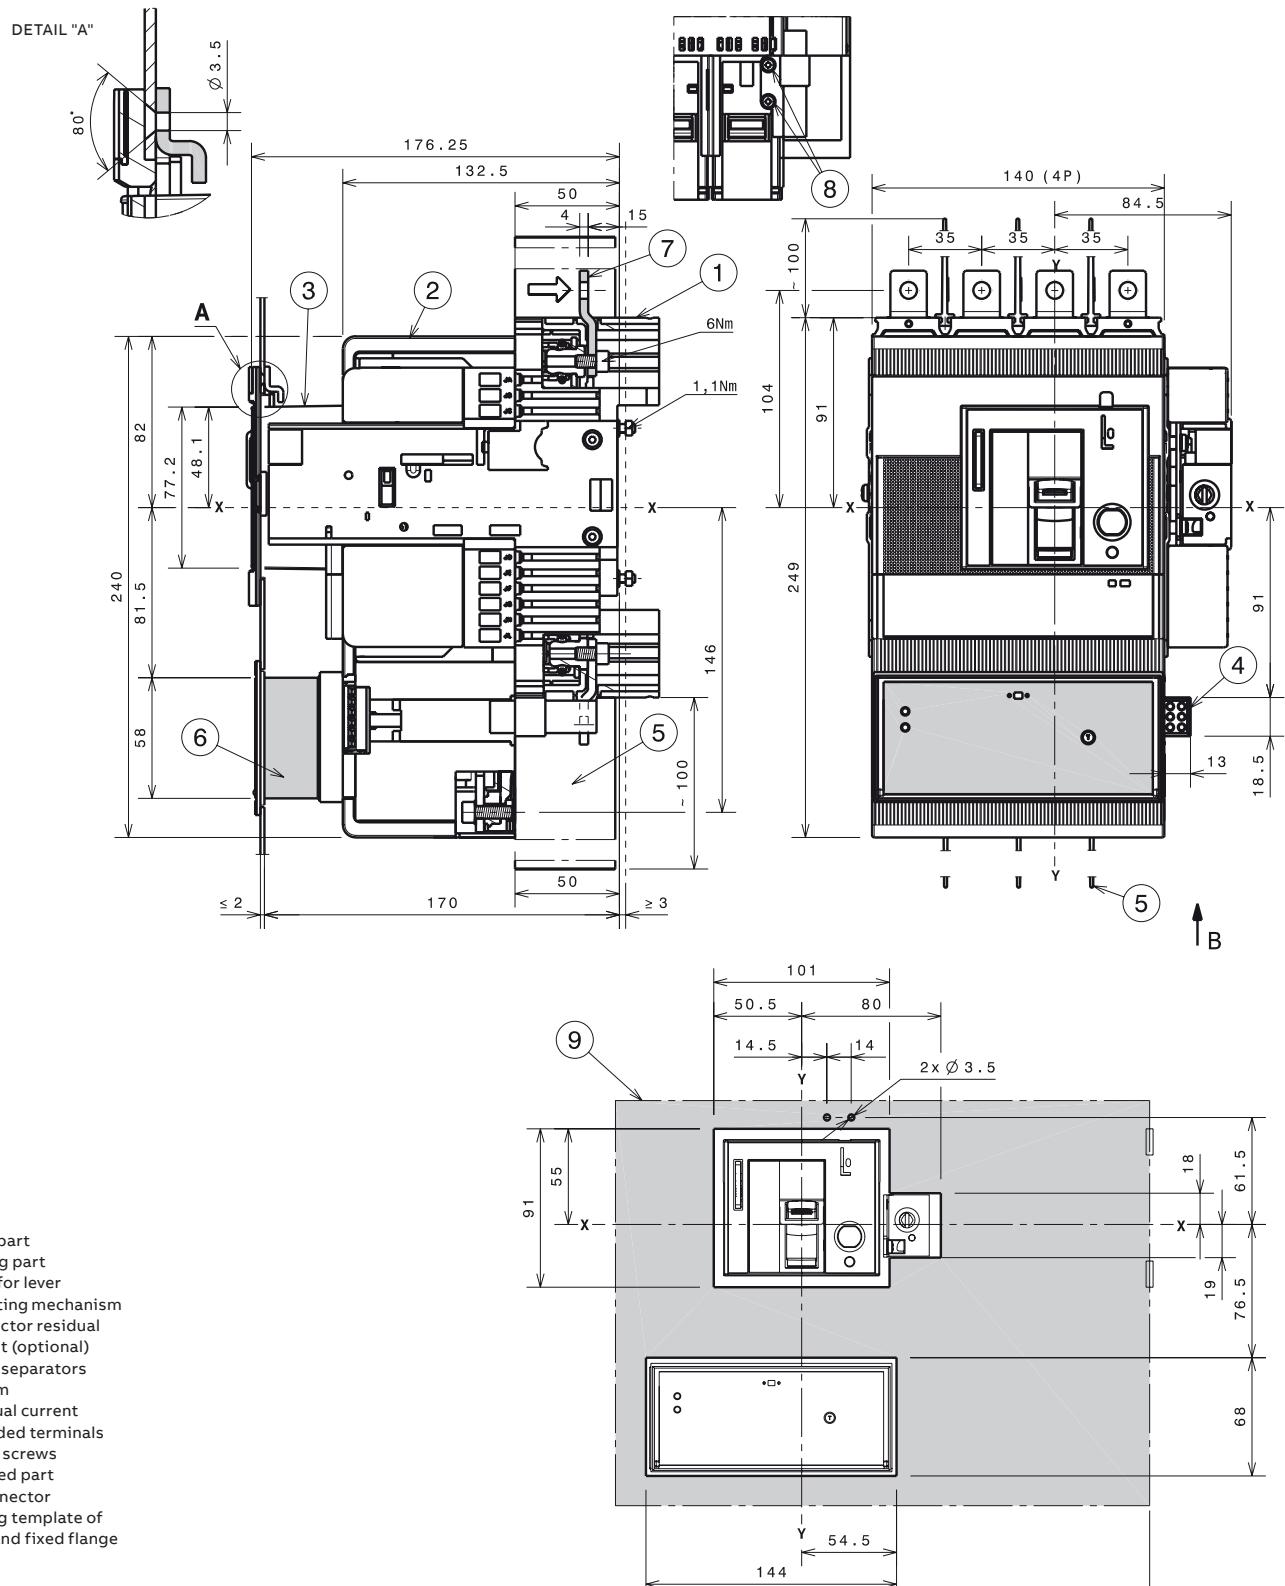

Tmax XT5 – Installation


Installation for fixed circuit-breaker

Fixing on sheet

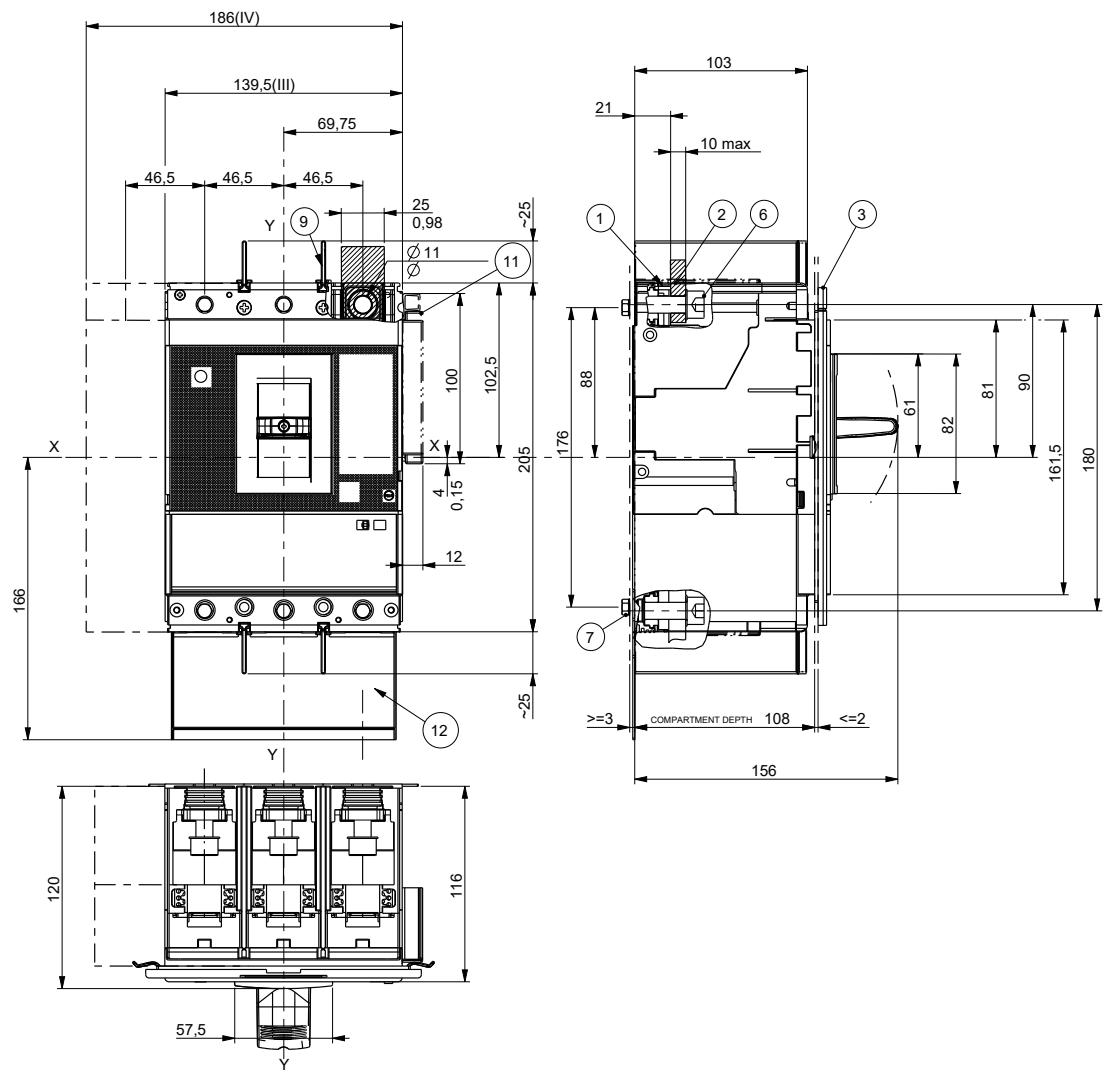


Drilling templates for support sheet

| Key | |
|-----|--|
| 1 | Front terminals for flat connection |
| 2 | Busbar |
| 3 | Flange without gasket for the compartment door |
| 4 | Drilling template 3p |
| 5 | Drilling template 4p |
| 6 | Tightening torque 36Nm |
| 7 | Tightening torque 2Nm |
| 9 | Phase separators 25mm |
| 11 | Cable rack |
| 12 | Rear insulating plate |

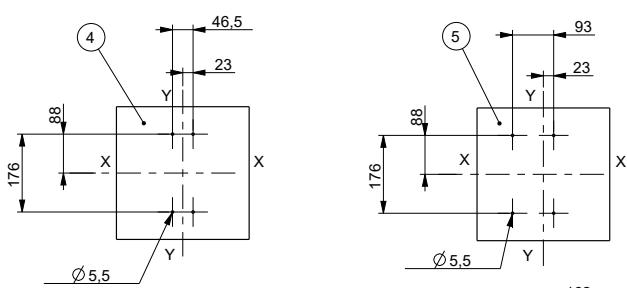


Flange

Key
3 Flange without gasket for the compartment door

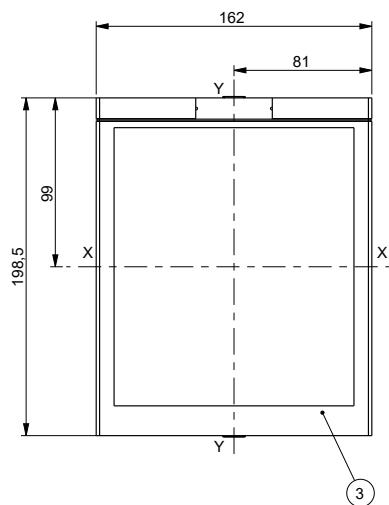

Drilling template compartment door

Key
8 Compartment door drilling template with/without flange

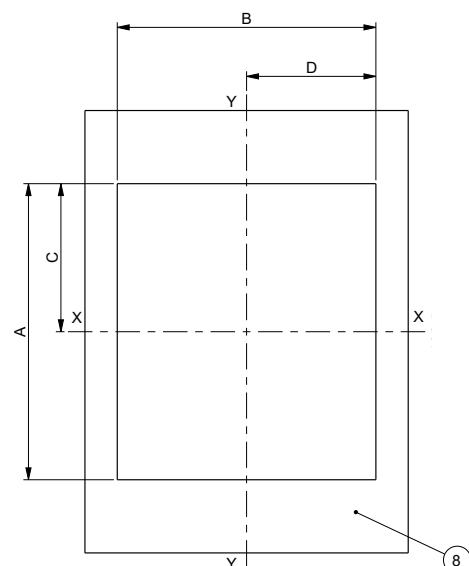


| | A [mm] | B [mm] | C [mm] | D [mm] |
|----------------|---------|--------|--------|--------|
| With flange | 3p - 4p | 174 | 152 | 87 |
| Without flange | 3p - 4p | 165 | 143 | 82.5 |

Tmax XT5 – Installation

Terminals for fixed circuit-breaker


Terminals EF

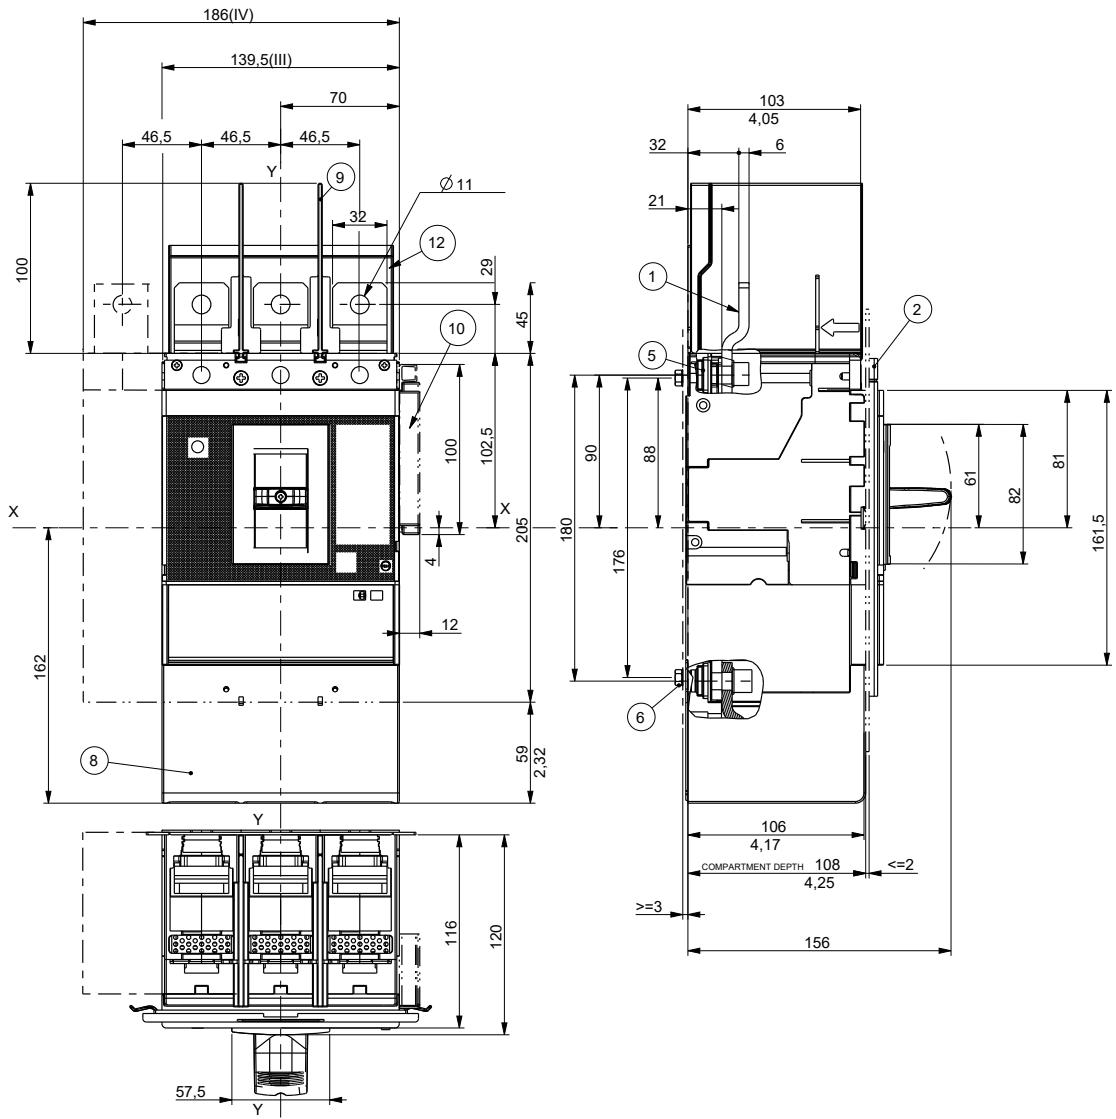

Key

- 1 Extended front terminals
- 2 Flange for the compartment door
- 5 Tightening torque 36Nm
- 6 Tightening torque 2Nm
- 8 High terminal cover
- 9 Phase separators 100mm
- 10 Cable rack
- 12 Rear insulating plate

Terminals ES

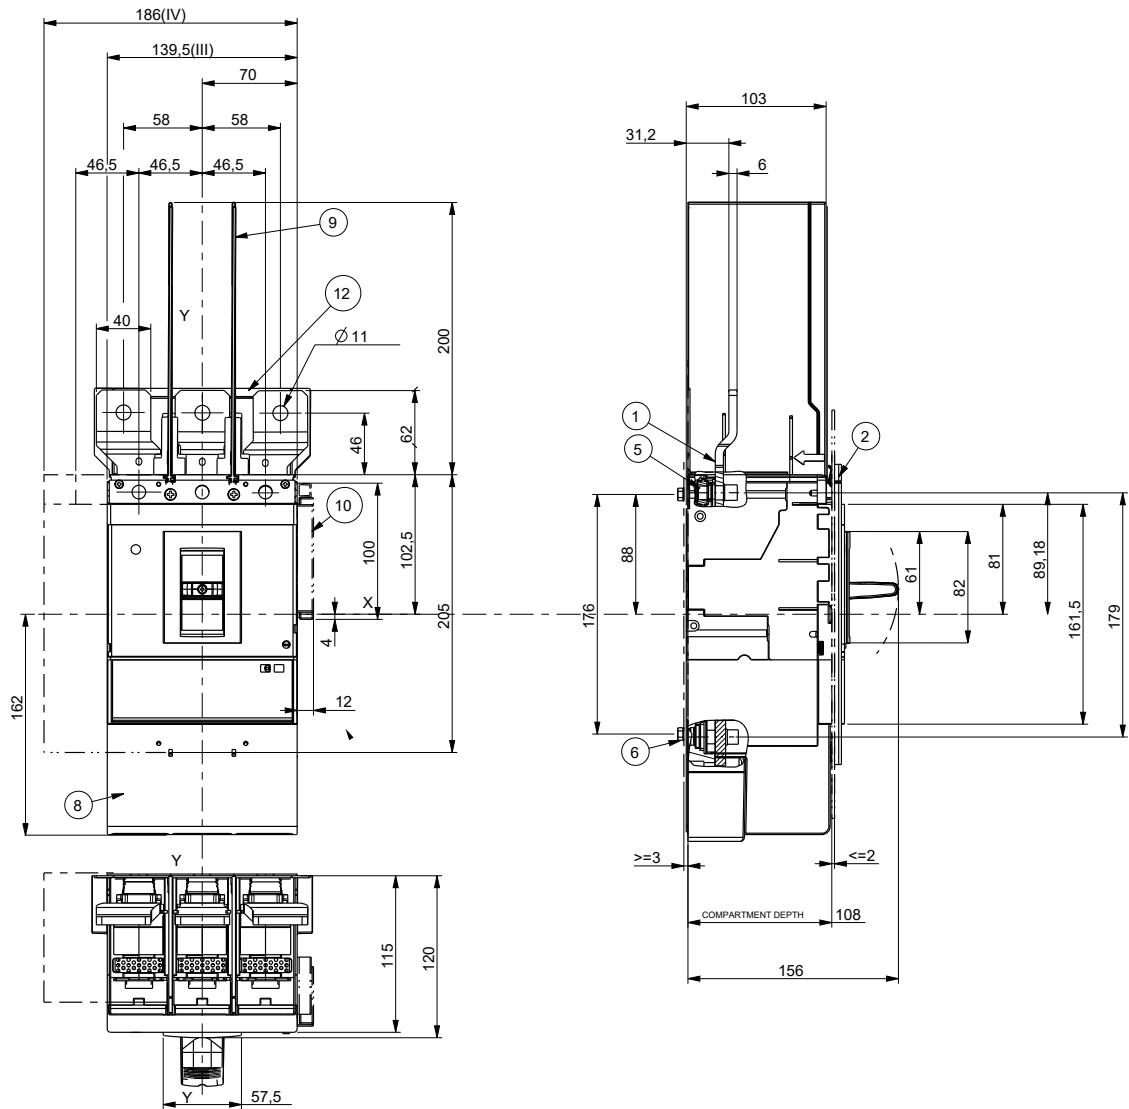


Key

- 1 Extended front terminals
- 2 Flange for the compartment door
- 5 Tightening torque 18Nm
- 6 Tightening torque 2Nm
- 8 Rear insulating plate
- 9 Phase separators 200mm
- 10 Cable rack
- 12 Rear insulating plate

Tmax XT5 – Installation

Terminals for fixed circuit-breaker

1 x 120...240mm² and 1 x 35...185mm² terminals FC CuAl

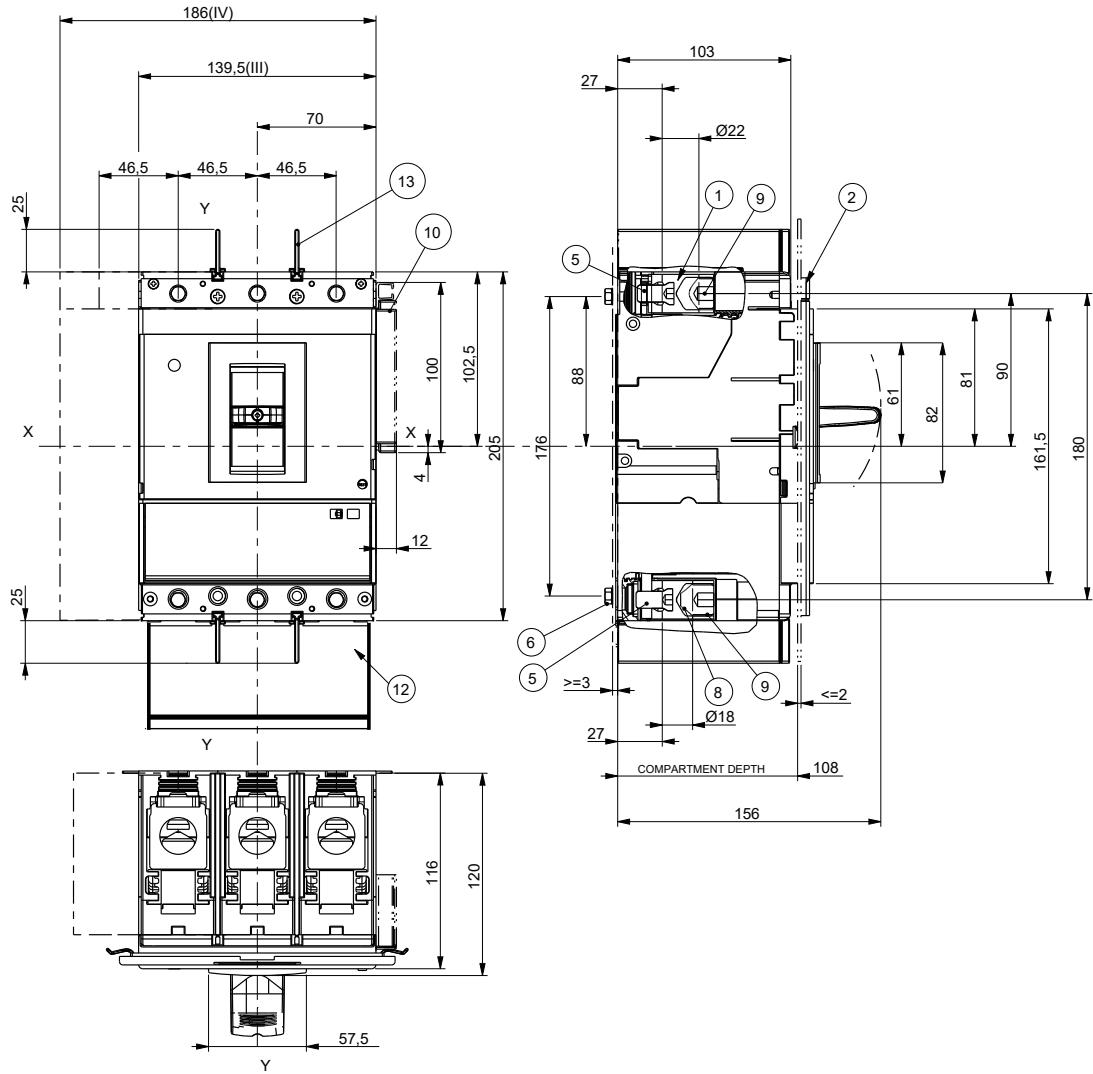


—

Key

- 1 Terminals FCCuAl
1x120...240mm²
- 2 Flange for the compartment door
- 5 Tightening torque
23Nm
- 6 Tightening
torque 2Nm
- 8 Terminals FCCuAl
1x35...185mm²
- 9 Tightening torque
23Nm
- 10 Cable rack
- 12 Rear insulating plate
- 13 Phase separators
25mm

2 x 70...240mm² terminals FC CuAl

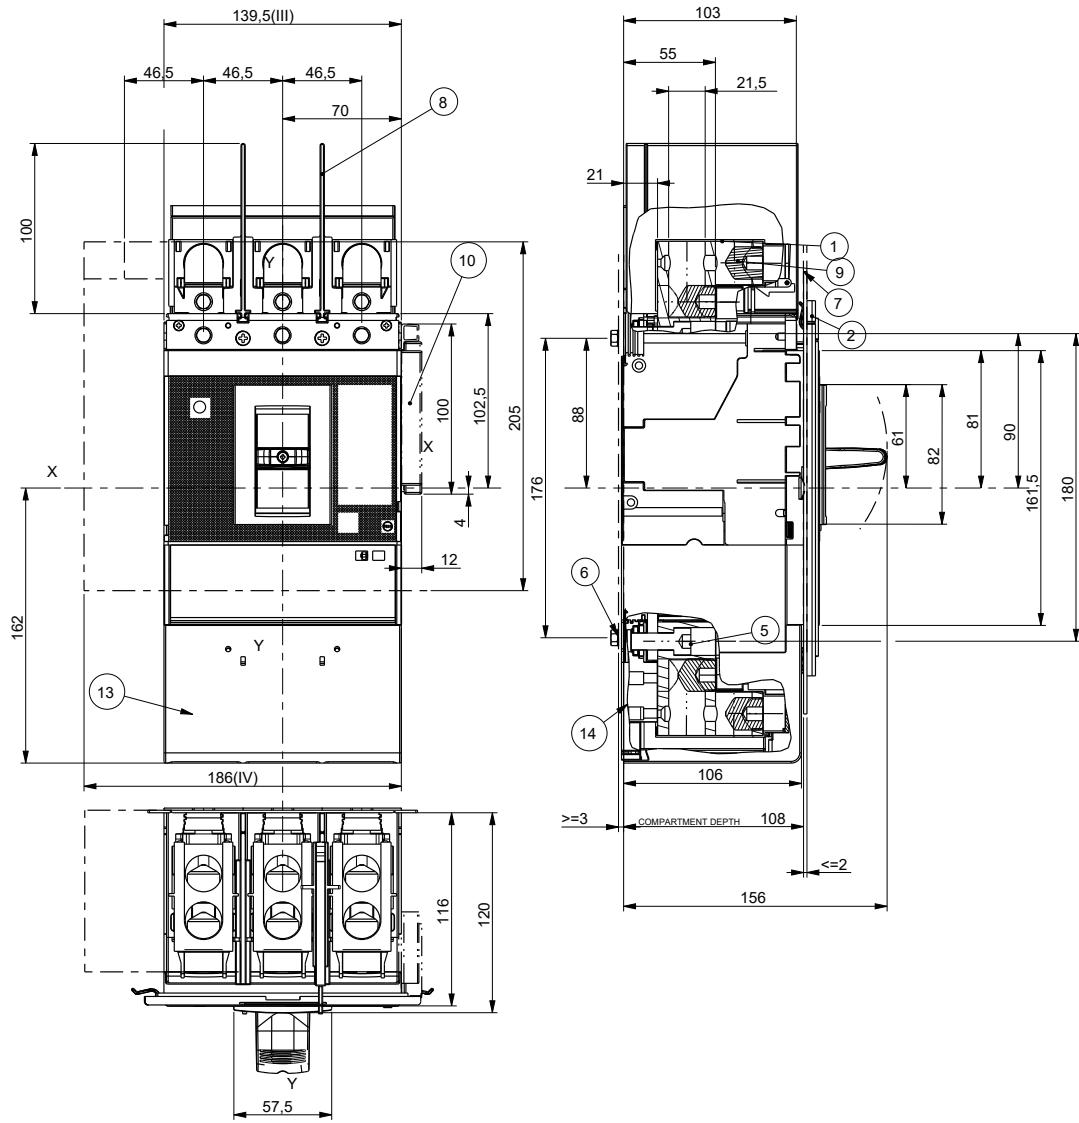

—


Key

- 1 Terminals FCCuAl
2x240mm
- 2 Flange for the
compartment door
- 5 Tightening
torque 36Nm
- 6 Tightening
torque 2Nm
- 7 Compartment door
drilling template for
flange without gasket
- 8 Phase separators
100mm
- 9 Tightening
torque 31Nm
- 10 Cable rack
- 13 High terminal cover
- 14 Segregation form
4 (optional)

Tmax XT5 – Installation

Terminals for fixed circuit-breaker

Terminals R

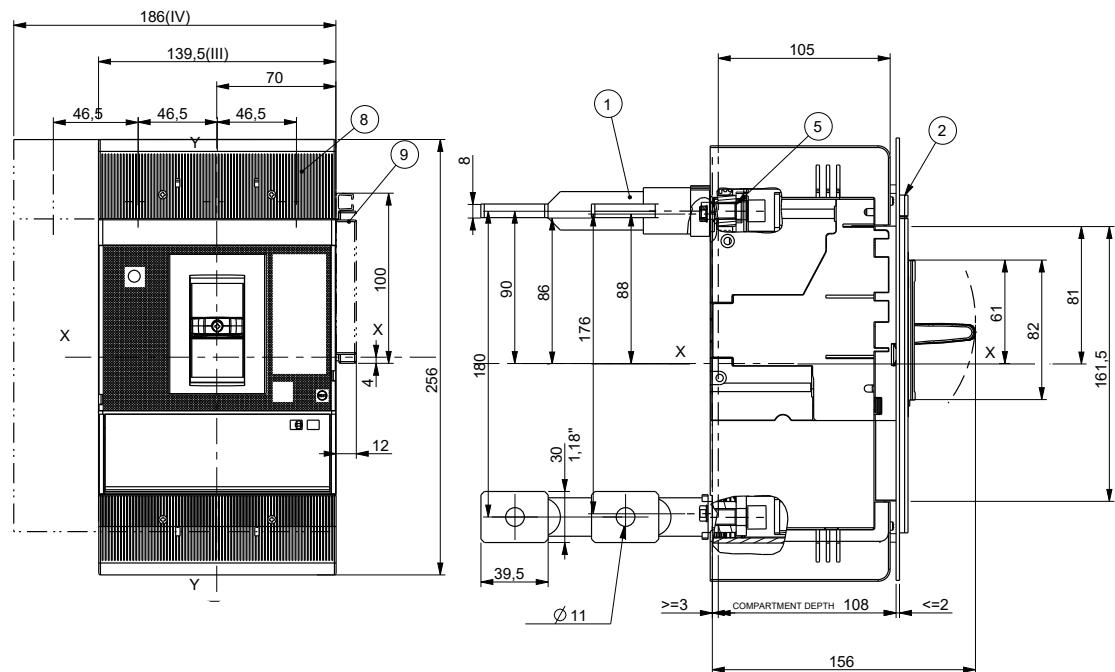


—
Key


- 1 Rear terminals (horizontal and vertical)
- 2 Flange without gasket for the compartment door
- 5 Tightening torque 18Nm
- 7 Compartment door drilling template with/without flange
- 8 Low terminal cover
- 9 Cable rack

Terminals HR upper


—
Key
6 Tightening torque 2Nm

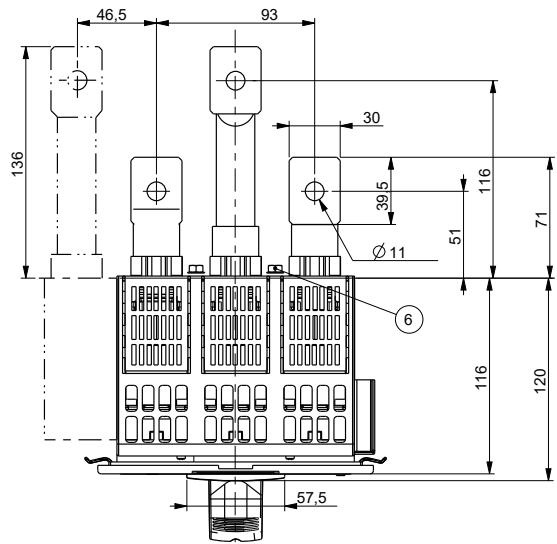

Terminals VR lower

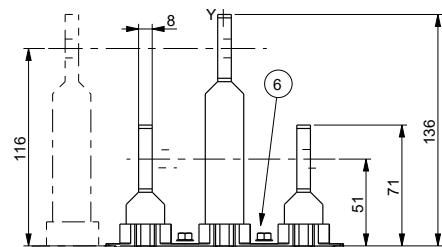


—
Key
3 Drilling template 3p
4 Fixing on sheet 4p

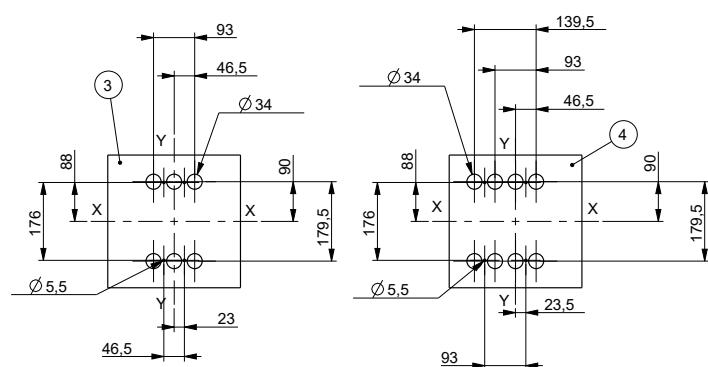


Tmax XT5 – Installation

Accessories for fixed circuit-breaker

Rotary handle operating mechanism on the circuit-breaker (RHD)

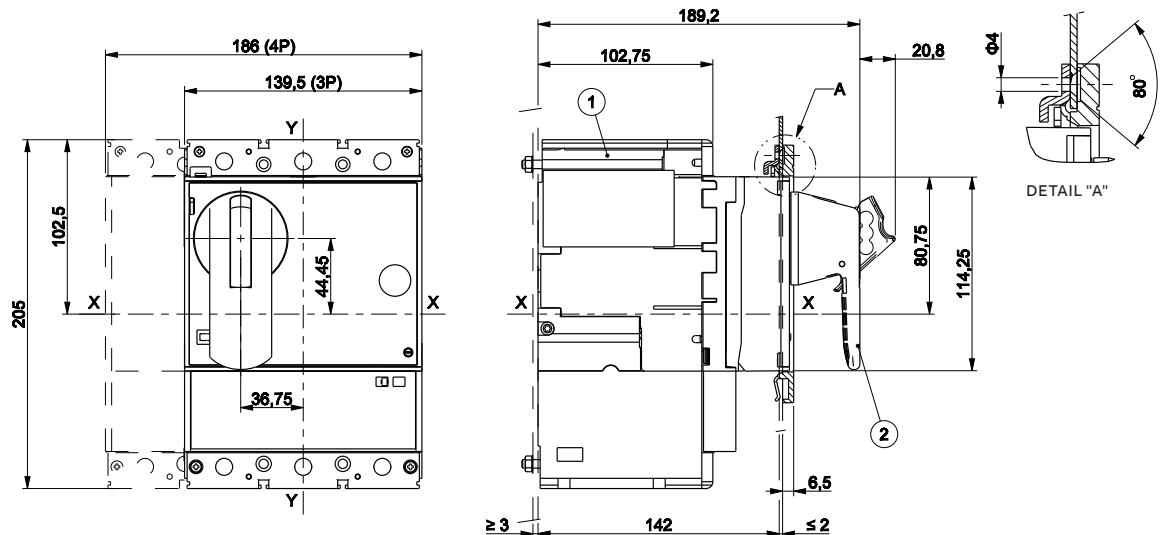


Drilling templates for support sheet

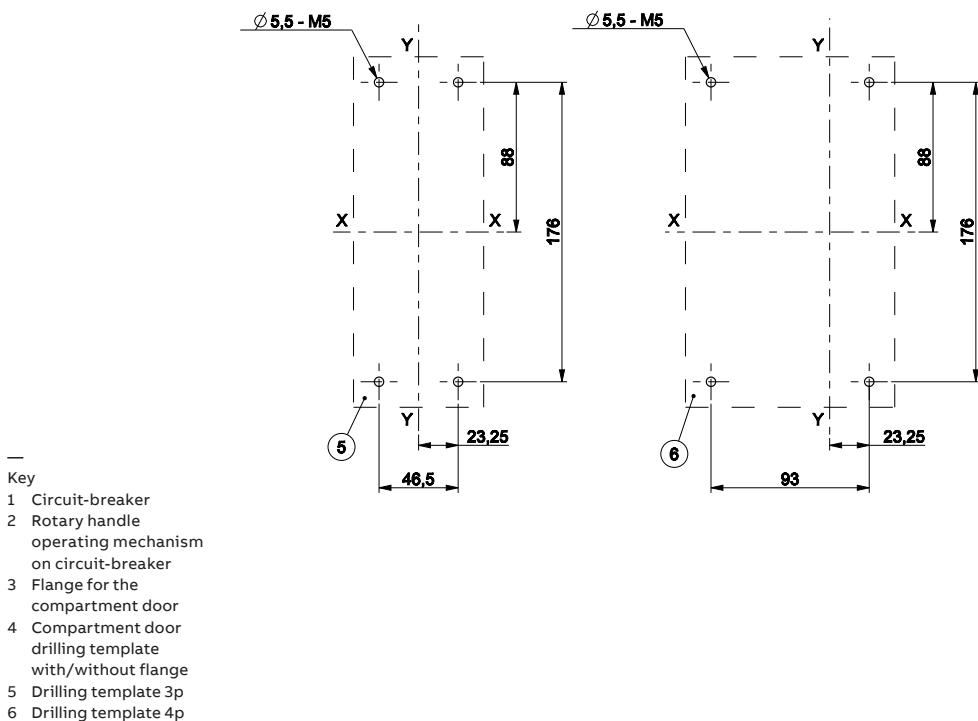


Flange

- Key
 3 Flange for the compartment door
 4 Compartment door drilling template with/without flange

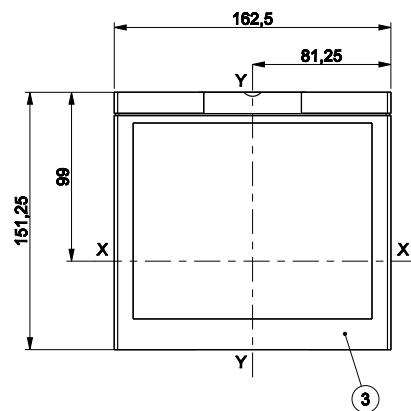


Drilling template compartment door

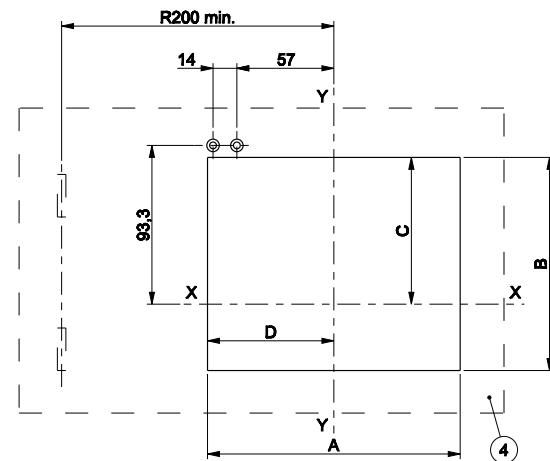


| | A [mm] | B [mm] | C [mm] | D [mm] |
|----------------|---------------|--------|--------|--------|
| With flange | 3p - 4p 147.5 | 124.3 | 85.8 | 73.75 |
| Without flange | 3p - 4p 140.5 | 115.3 | 81.3 | 70.25 |

Flange IP54

- Key
 7 IP54 flange for the compartment door
 8 Compartment door drilling template with IP54 flange

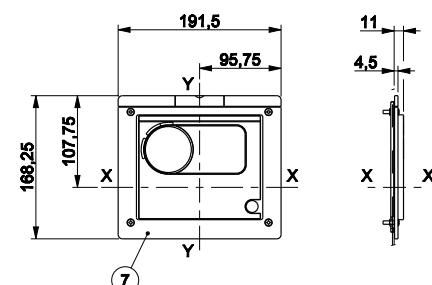




Drilling template compartment door with flange IP54

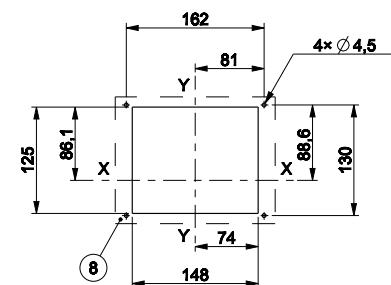

Tmax XT5 – Installation


Accessories for fixed circuit-breaker

Rotary handle operating mechanism on the compartment door (RHE)

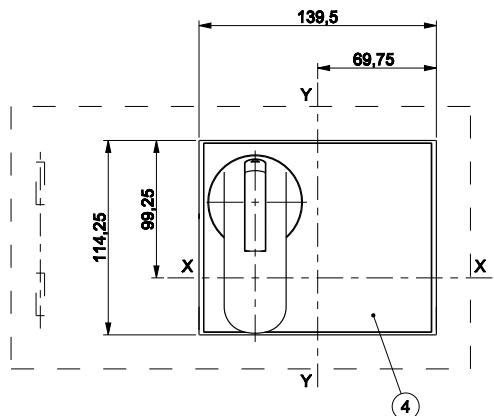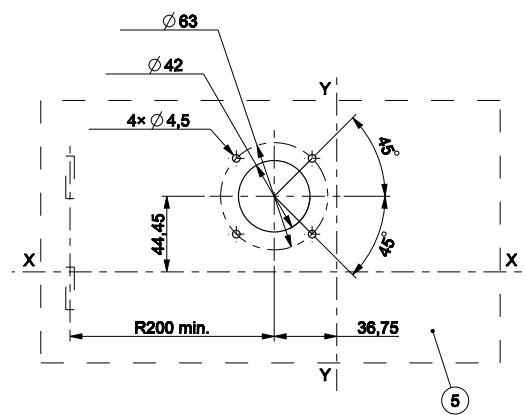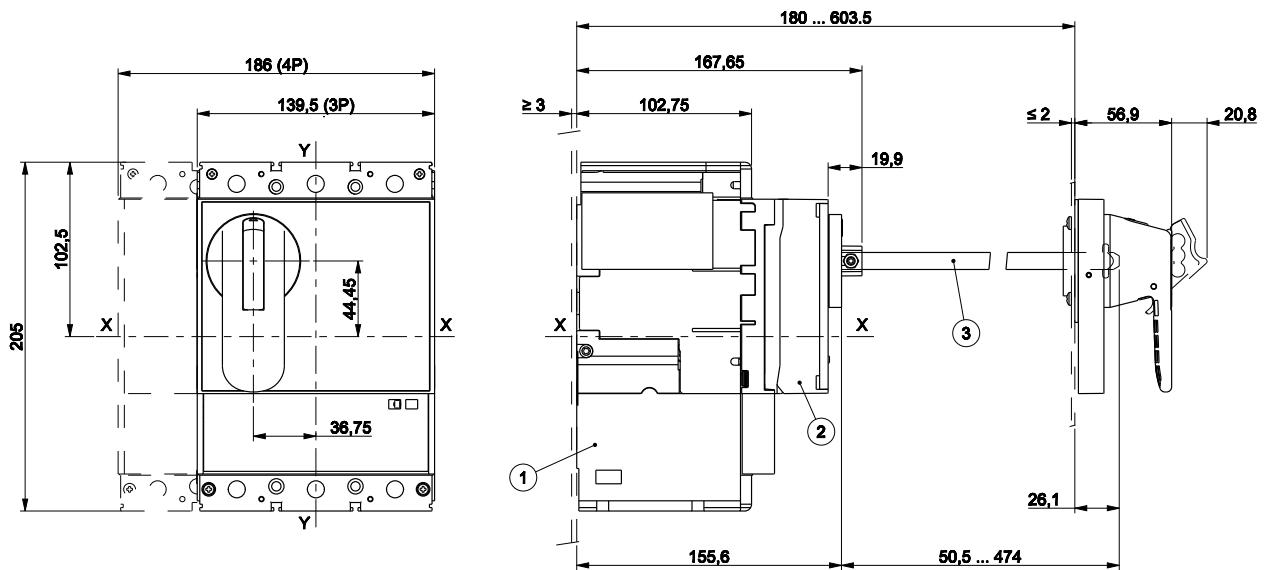


- Key
- 1 Circuit-breaker
 - 2 Base of rotary handle operating mechanism
 - 3 Connection rod
 - 4 Rotary handle operating mechanism of compartment door
 - 5 Compartment door drilling template
 - 6 Drilling template 3p
 - 7 Drilling template 4p

Stored energy motor operator (MOE)

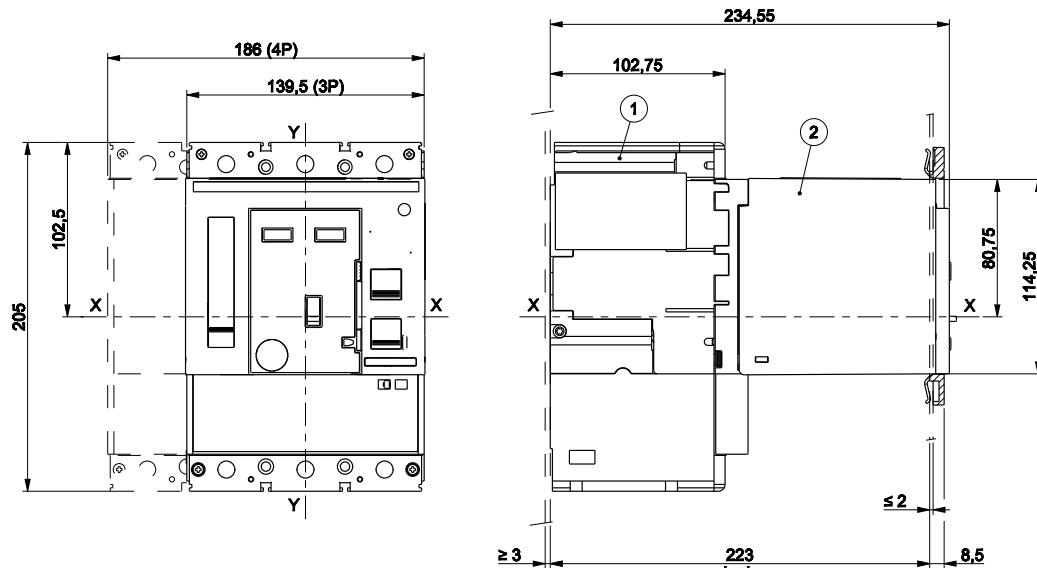


Drilling templates for support sheet

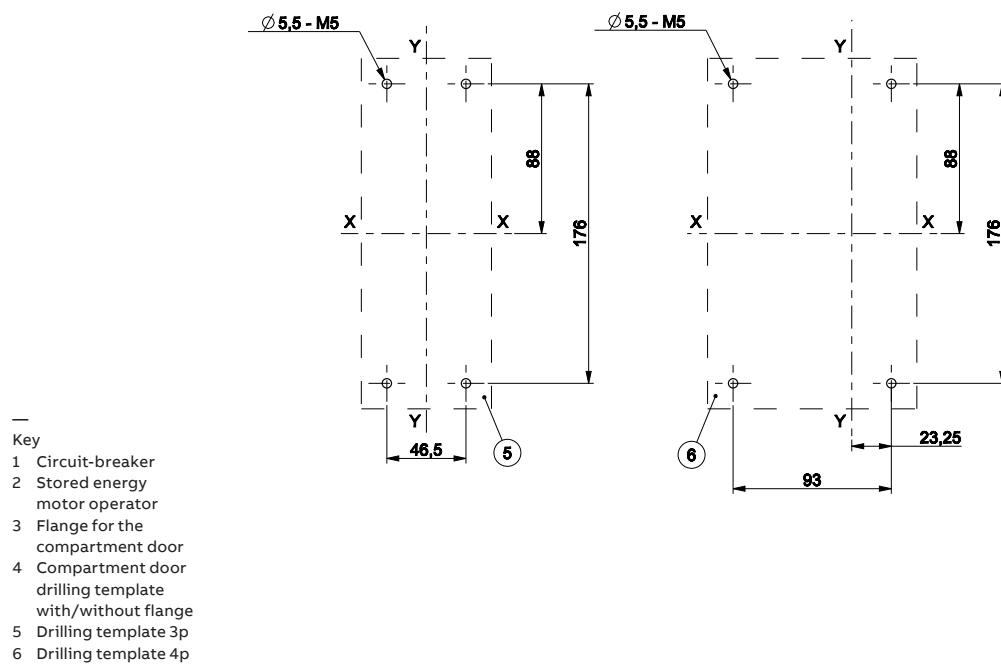


Tmax XT5 – Installation

Accessories for fixed circuit-breaker

Flange

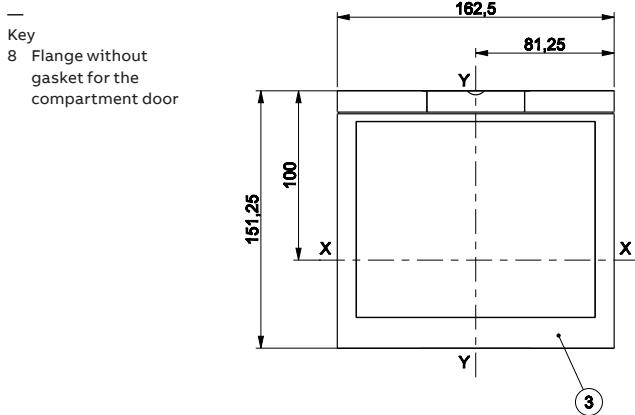


Drilling template compartment door

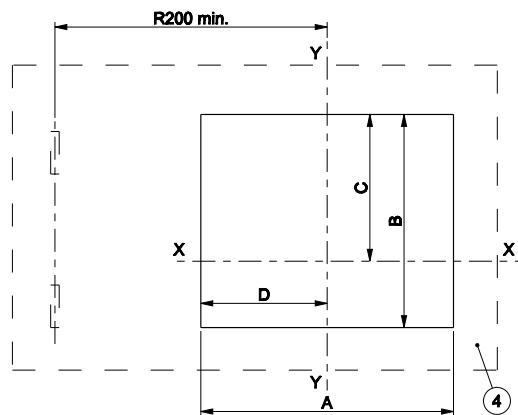


| | A [mm] | B [mm] | C [mm] | D [mm] |
|----------------|---------------|--------|--------|--------|
| With flange | 3p - 4p 147.5 | 124.3 | 85.8 | 73.75 |
| Without flange | 3p - 4p 140.5 | 115.3 | 81.3 | 70.25 |

Residual current RC

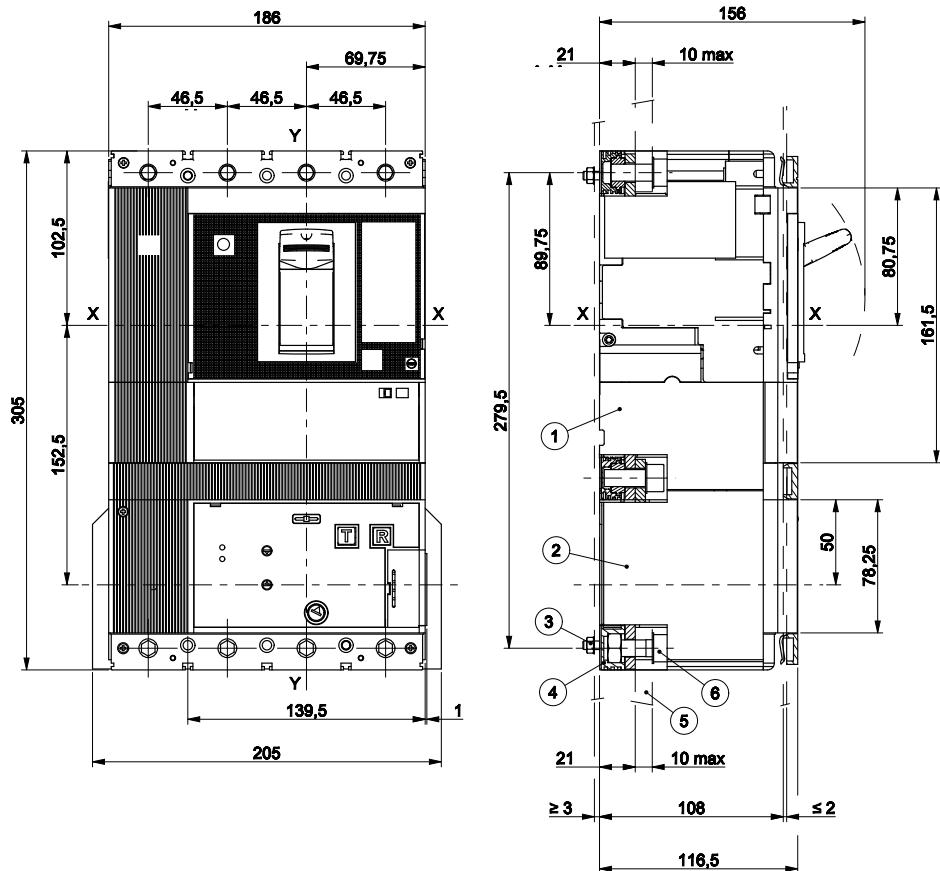


Drilling template for support sheet

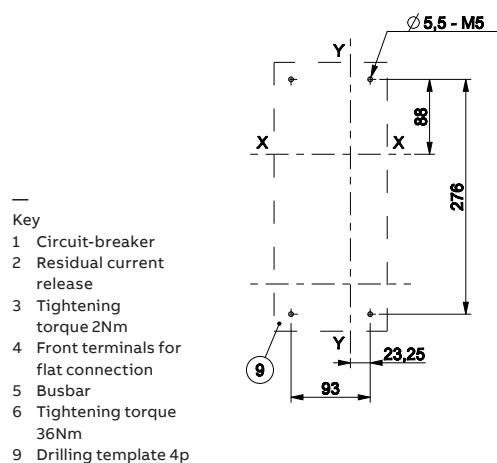


Tmax XT5 – Installation

Accessories for fixed circuit-breaker

Flange

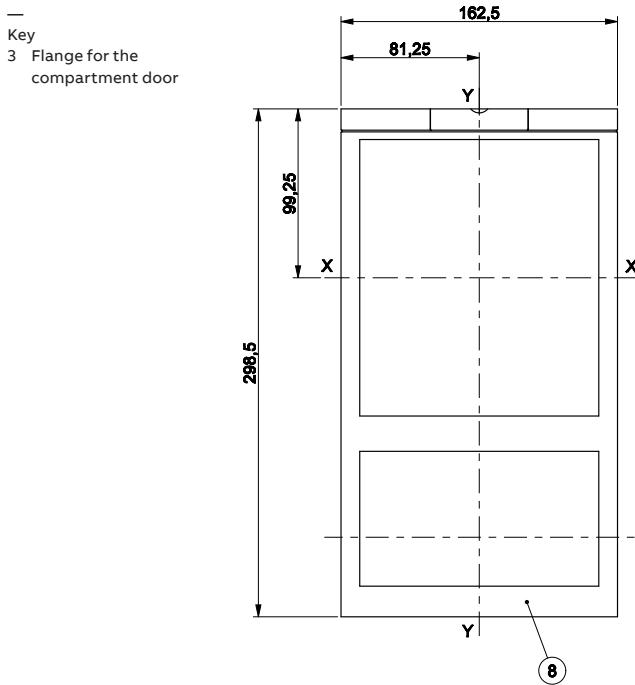


Drilling template compartment door

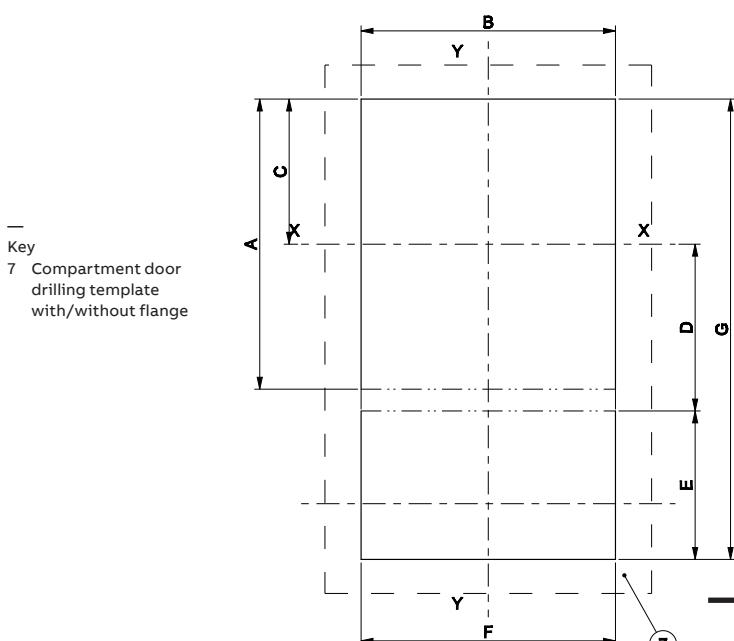


| | A [mm] | B [mm] | C [mm] | D [mm] | E [mm] | F [mm] | G [mm] | |
|----------------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-------|
| With flange | 3p - 4p | - | 147.5 | 84.8 | - | - | 147.5 | 269.5 |
| Without flange | 3p - 4p | 163.5 | 141.5 | 81.8 | 101.5 | 80.3 | 141.5 | - |

Front for lever operating mechanism (FLD)

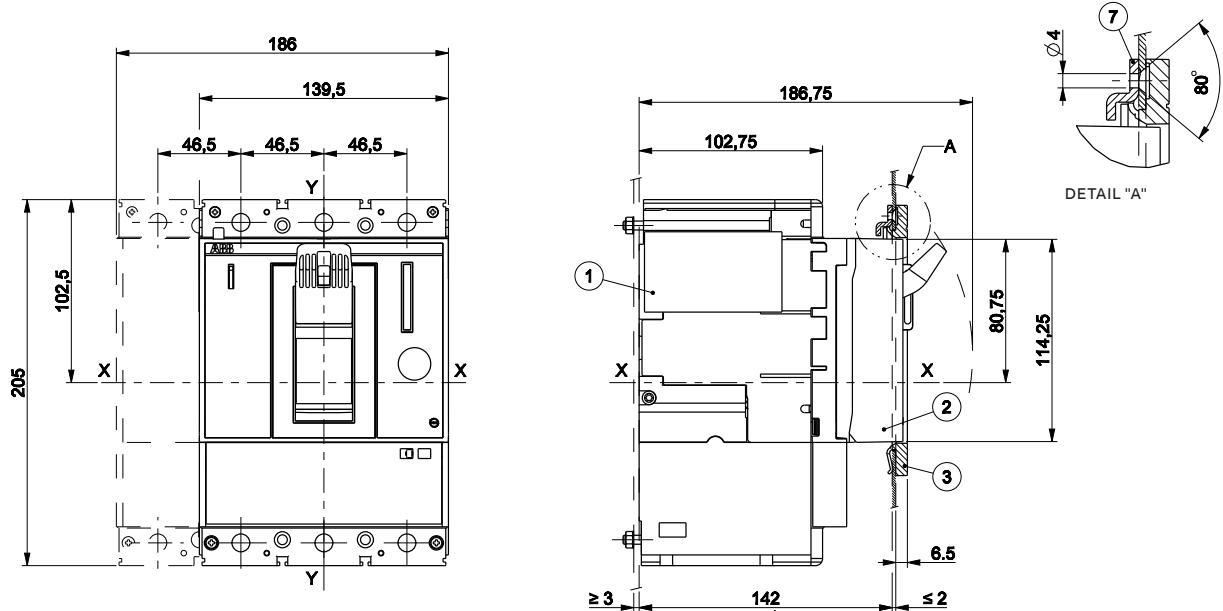

Drilling templates for support sheet

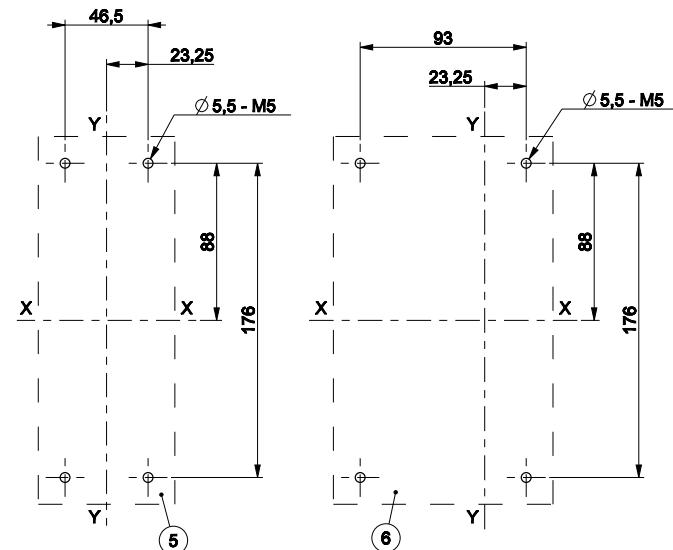


- Key
- 1 Circuit-breaker
 - 2 Front for lever operating system (FLD)
 - 3 Flange for the compartment door
 - 4 Compartment door drilling template with/without flange
 - 5 Drilling template 3p
 - 6 Drilling template 4p
 - 7 Door lock

Tmax XT5 – Installation


Accessories for fixed circuit-breaker

Flange

—
Key
3 Flange for the compartment door
4 Compartment door drilling template with/without flange

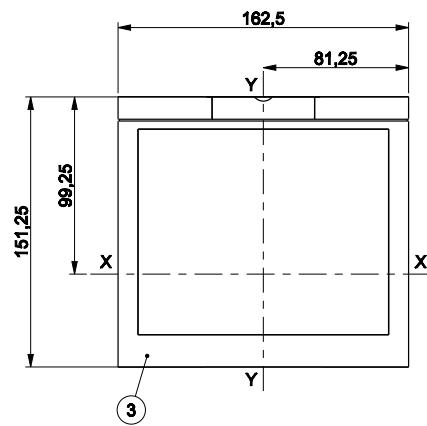


Drilling template compartment door

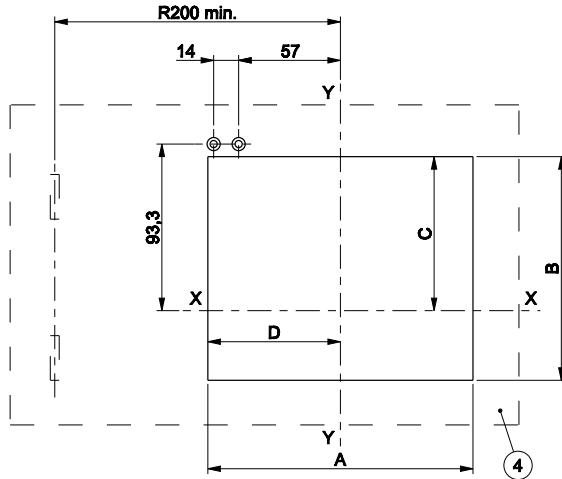

| | A | B | C | D |
|----------------|---------------|-------|------|-------|
| With flange | 3p - 4p 147.5 | 124.3 | 85.8 | 73.75 |
| Without flange | 3p - 4p 140.5 | 115.3 | 81.3 | 70.25 |


Lateral rotary handle operating mechanism on the compartment door (RHL)

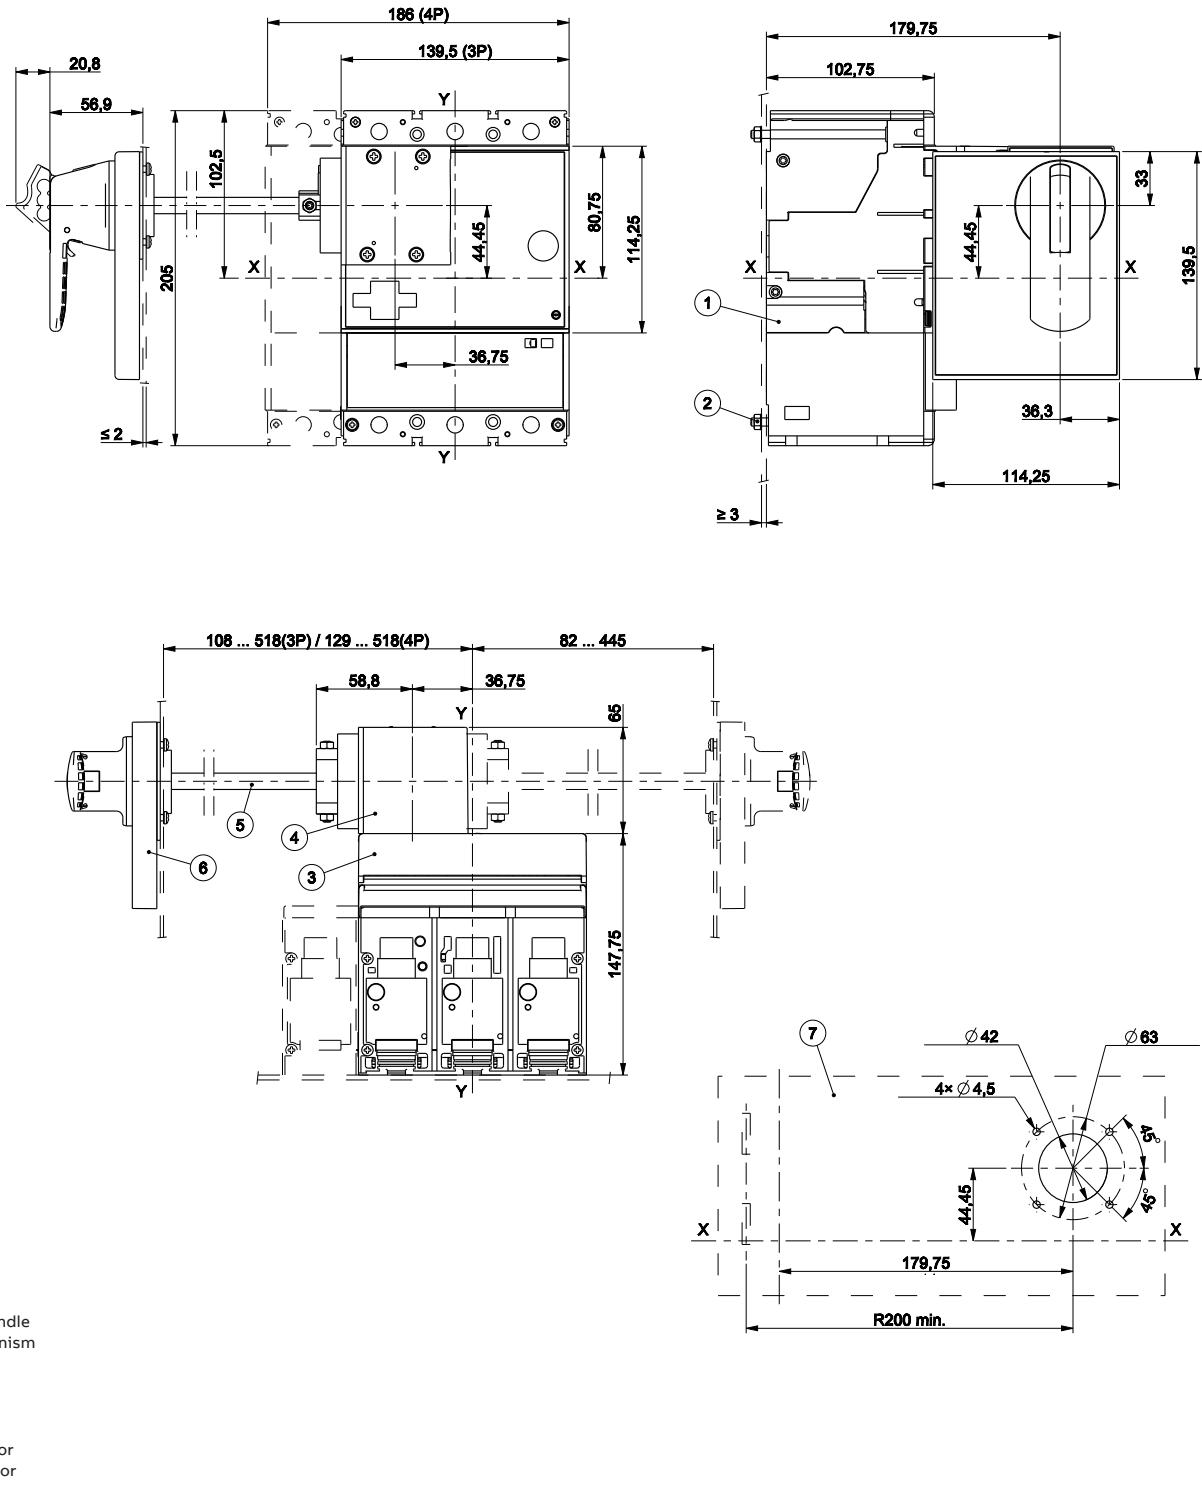


Tmax XT5 – Installation

Installation for plug-in circuit-breaker 400A

Fixing on sheet

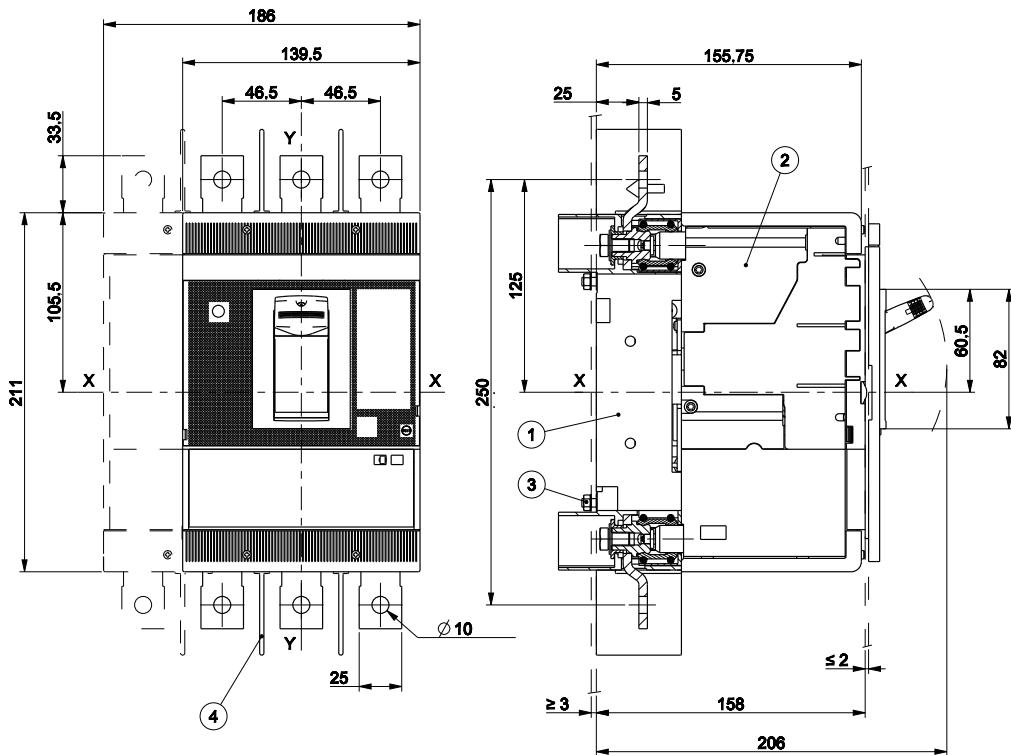


Drilling templates for support sheet

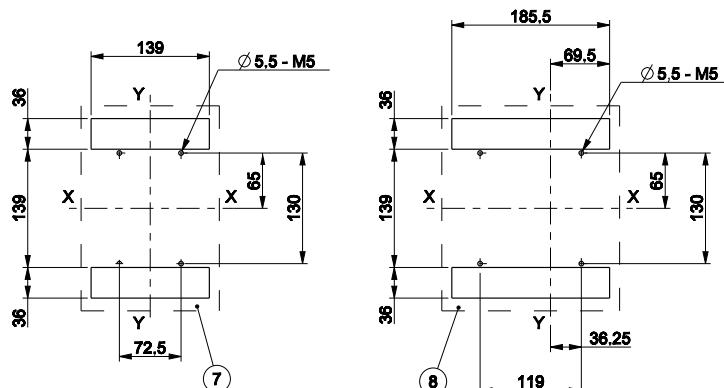

Key


- 1 Fixed part
- 2 Moving part
- 3 Tightening torque 2Nm
- 4 Phase separators 100mm
- 5 Compartment door drilling template with/without flange
- 6 Flange without gasket for the compartment door
- 7 Drilling template 3p
- 8 Drilling template 4p

Flange

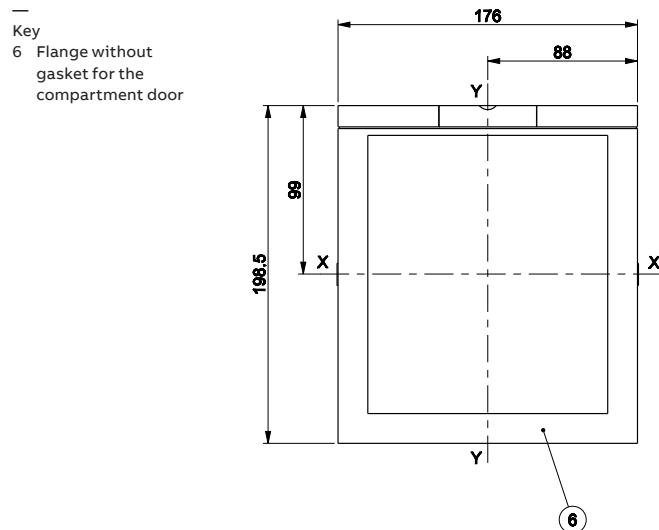

Drilling template compartment door

Key
5 Compartment door drilling template with/without flange

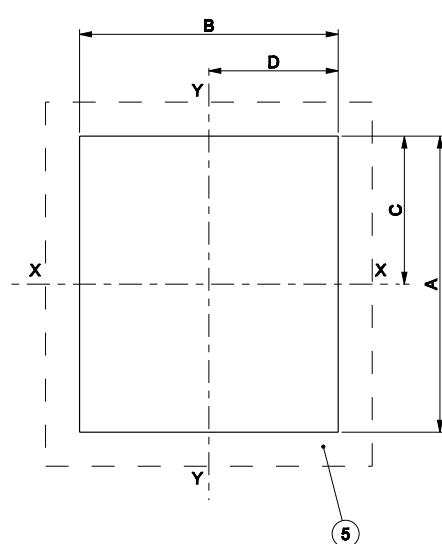


| | A [mm] | B [mm] | C [mm] | D [mm] |
|------------------------|--------|--------|--------|--------|
| With flange 3p - 4p | 174 | 152 | 87 | 76 |
| Without flange 3p - 4p | 165 | 143 | 82.5 | 71.5 |

Tmax XT5 – Installation

Terminals for plug-in circuit-breaker 400A


Terminals EF

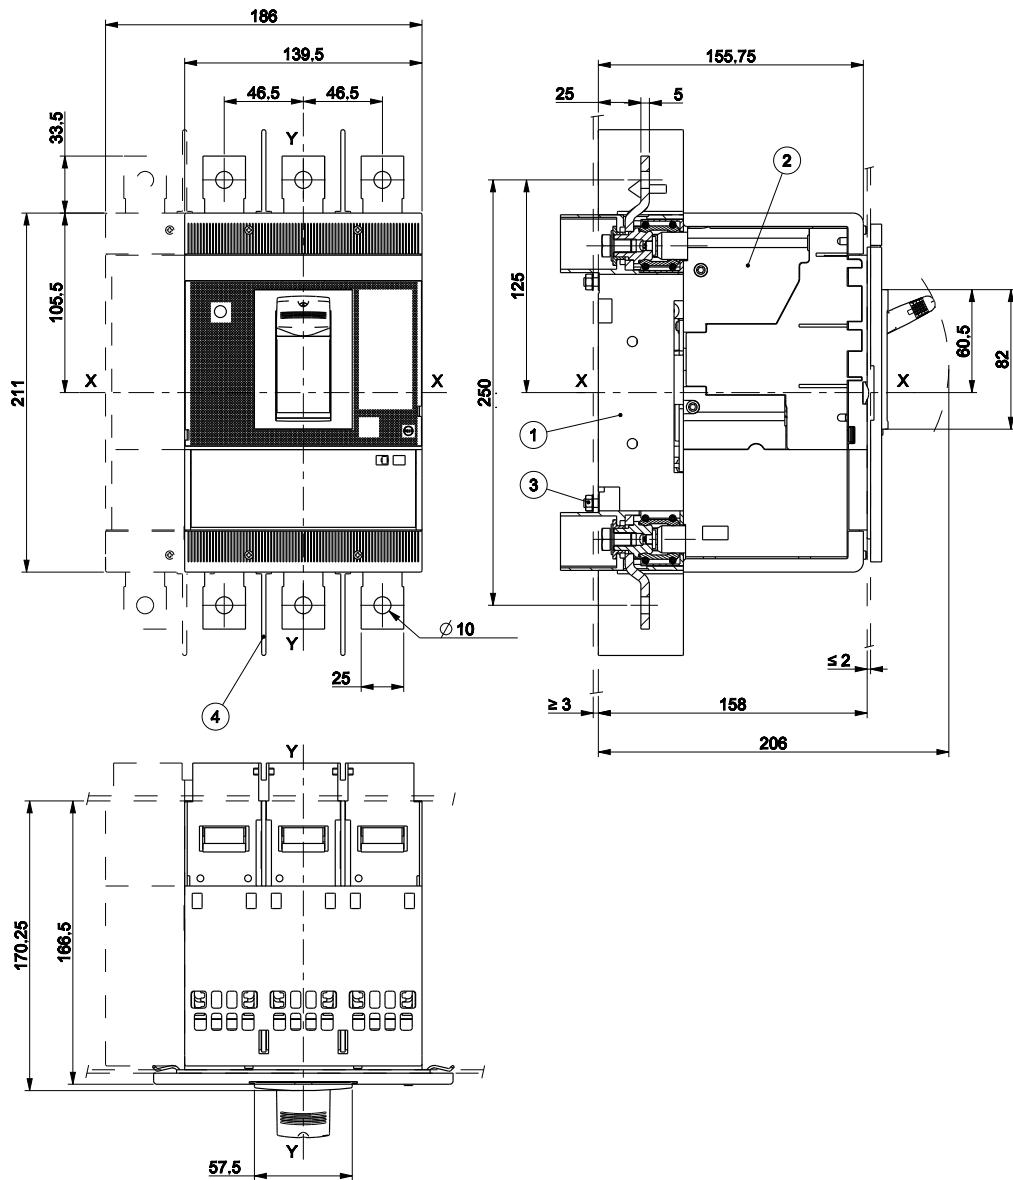

Key

- 1 Fixed part
- 2 Moving part
- 3 Tightening torque 2Nm
- 4 Phase separators 100mm

Terminals HR

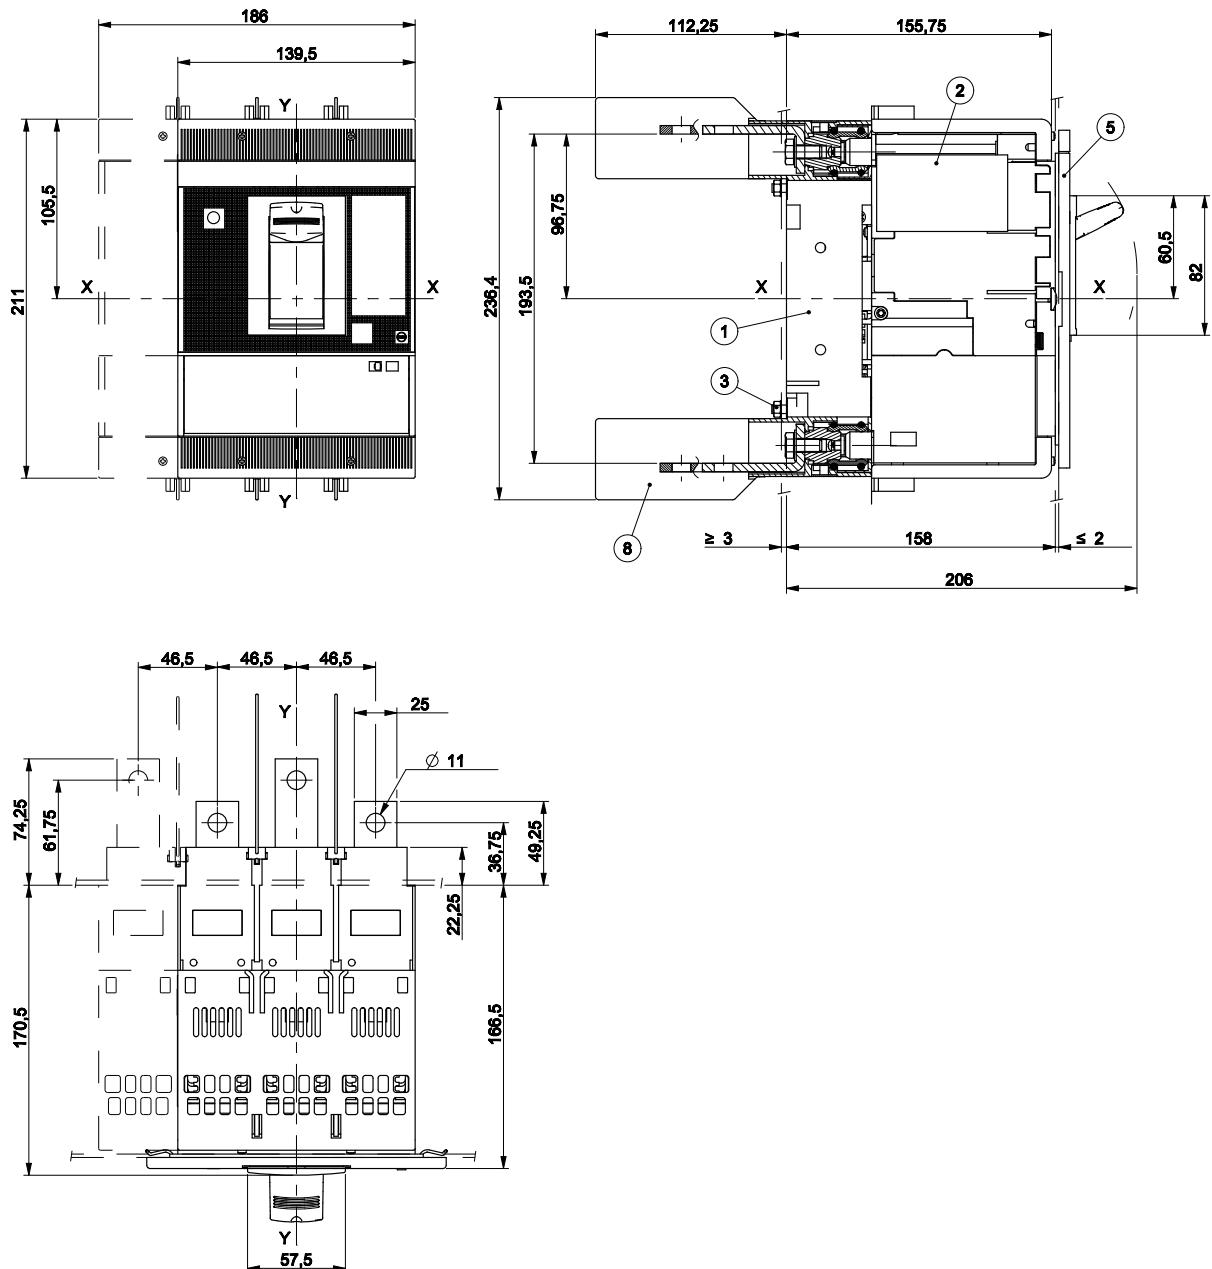



Key

- 1 Fixed part
- 2 Moving part
- 3 Tightening torque 2Nm
- 5 Flange without gasket for the compartment door
- 8 Rear insulating barriers (optional except same length terminals)

Tmax XT5 – Installation

Terminals for plug-in circuit-breaker 400A

Terminals VR

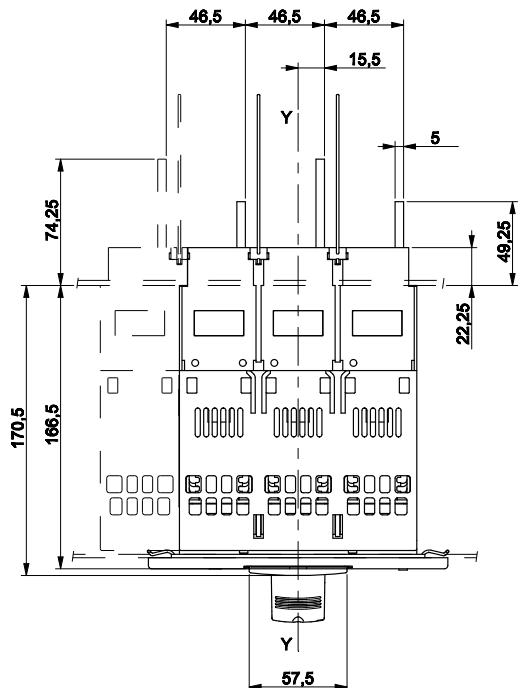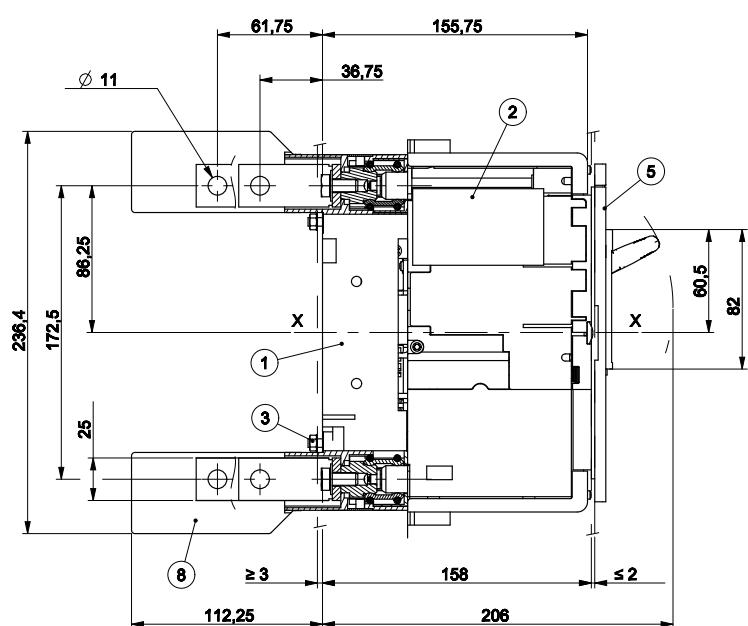


Key

- 1 Fixed part
- 2 Moving part
- 3 Tightening torque 2Nm
- 5 Flange without gasket for the compartment door
- 8 Rear insulating barriers (optional except same length terminals)


Tmax XT5 – Installation

Accessories for plug-in circuit-breaker 400A

Rotary handle operating mechanism on the circuit-breaker (RHD)

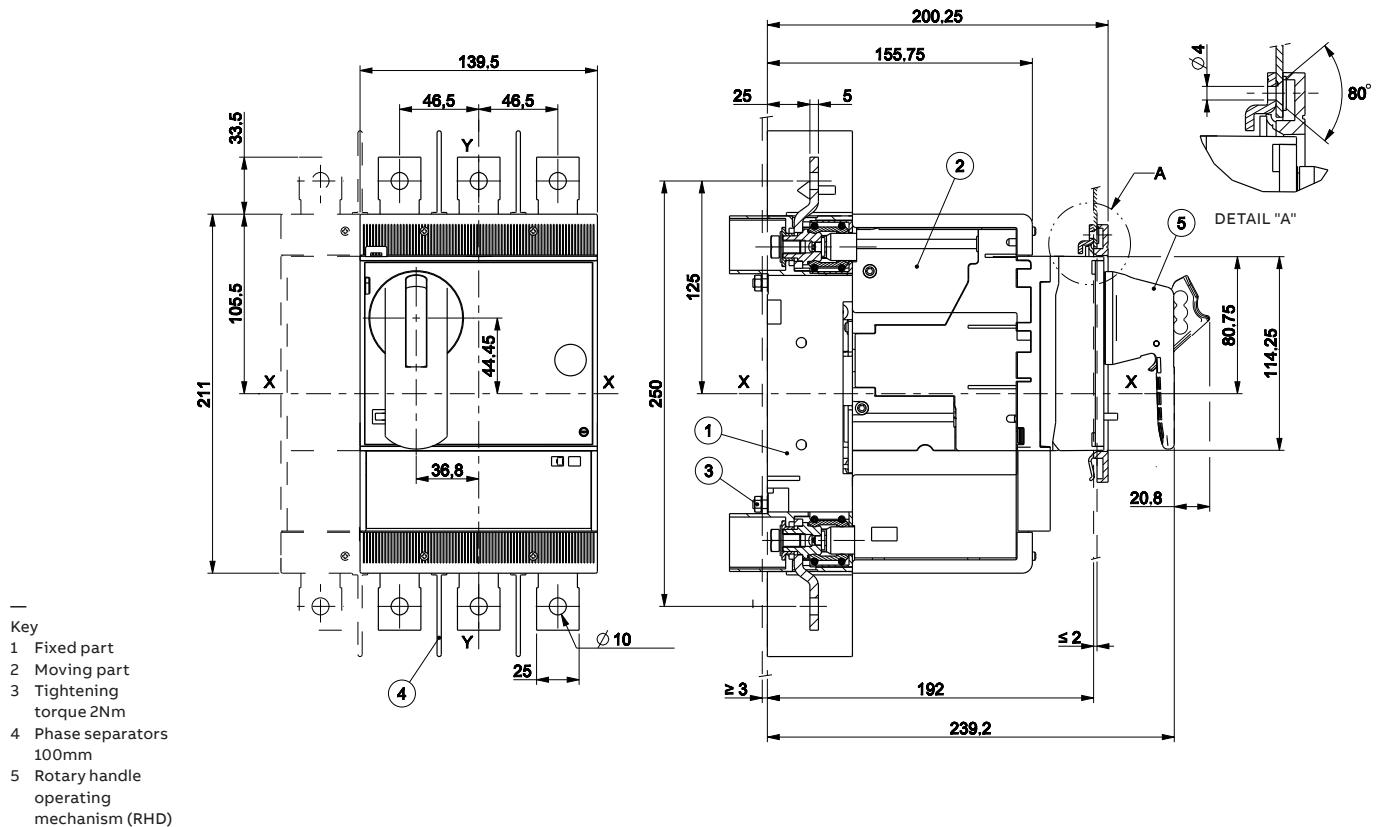

Drilling templates for support sheet

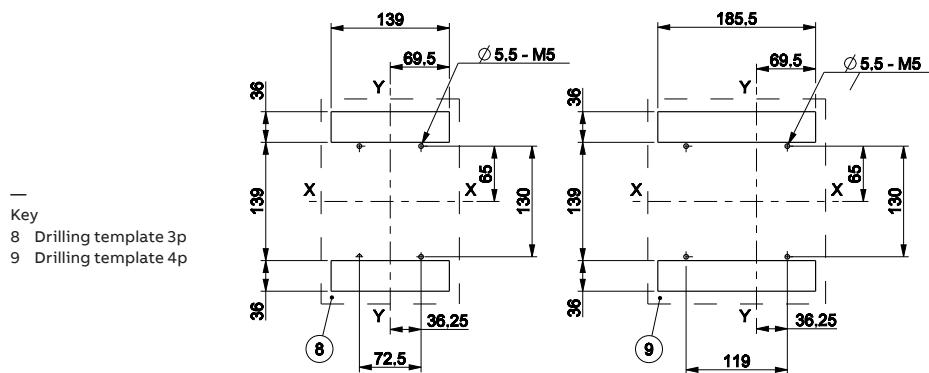


Tmax XT5 – Installation


Accessories for plug-in circuit-breaker 400A

Flange

- Key
 7 Flange for the compartment door
 8 Compartment door drilling template with/without flange

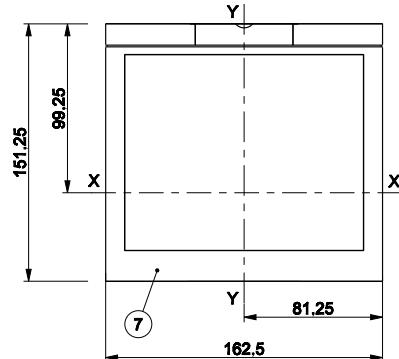


Drilling template compartment door

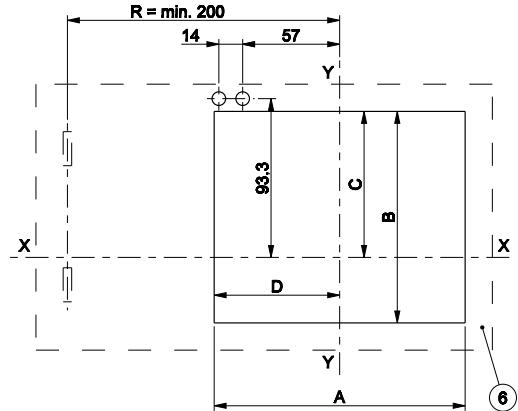


| | A [mm] | B [mm] | C [mm] | D [mm] |
|----------------|---------|--------|--------|--------|
| With flange | 3p - 4p | 147.5 | 124.3 | 85.8 |
| Without flange | 3p - 4p | 140.5 | 115.3 | 70.25 |

Flange IP54


- Key
 10 IP54 flange for the compartment door
 11 Compartment door drilling template with IP54 flange

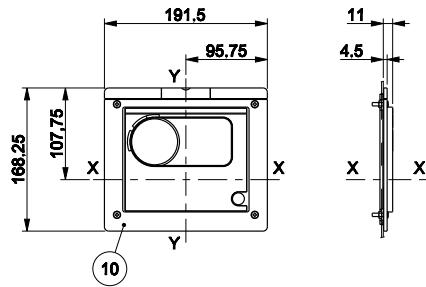

Compartment door drilling template with flange IP54

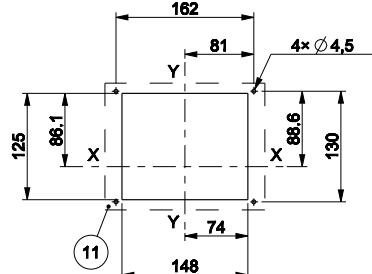


Lateral rotary handle operating mechanism on the compartment door (RHL)

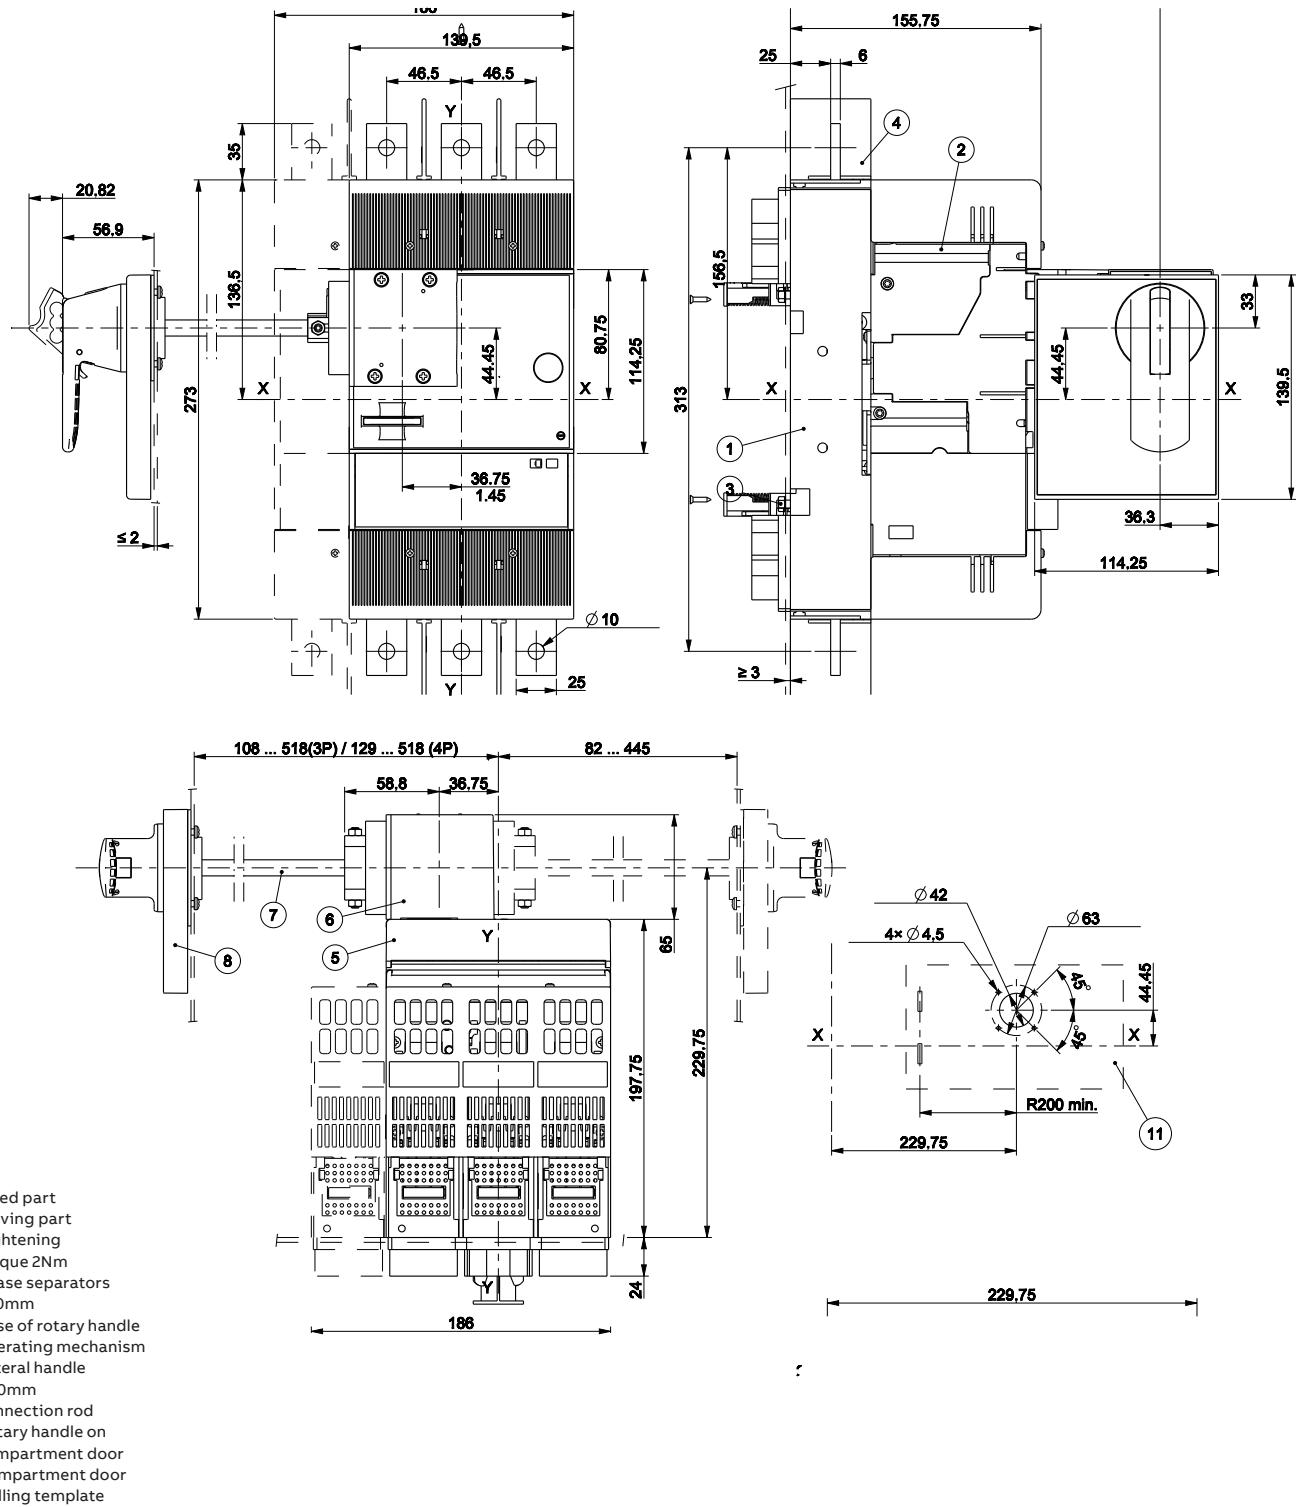

Tmax XT5 – Installation

Accessories for plug-in circuit-breaker 400A


Stored energy motor operator (MOE)

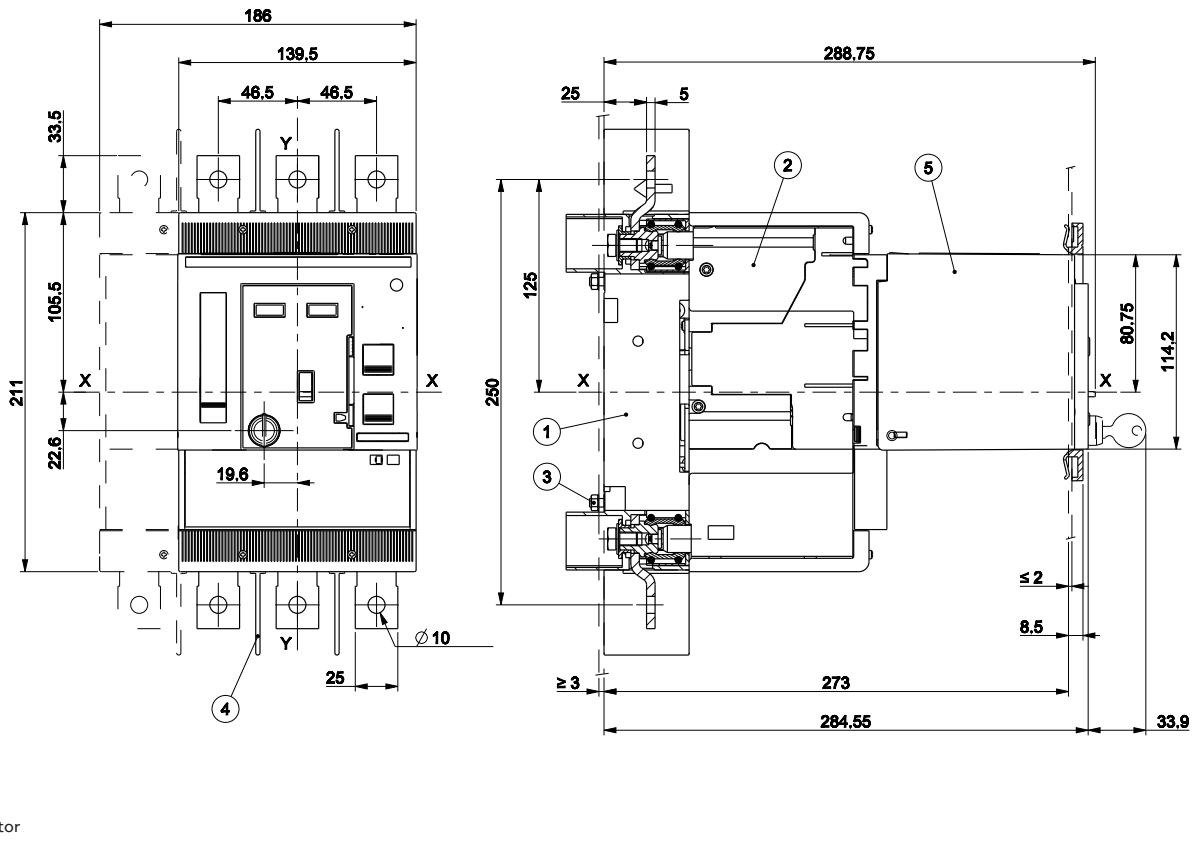

Drilling templates for support sheet


Key

- 8 Drilling template 3p
- 9 Drilling template 4p

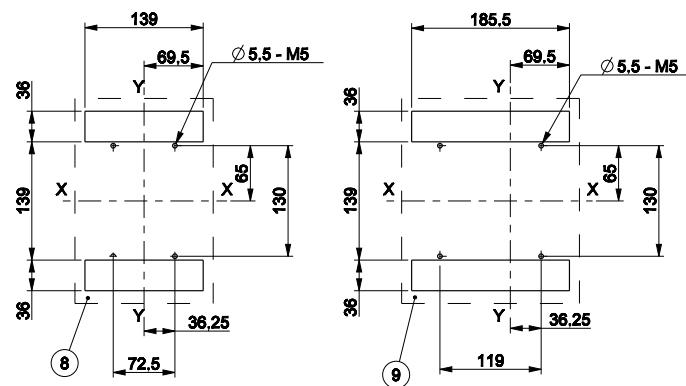


Flange

—
Key
7 Flange without gasket for the compartment door

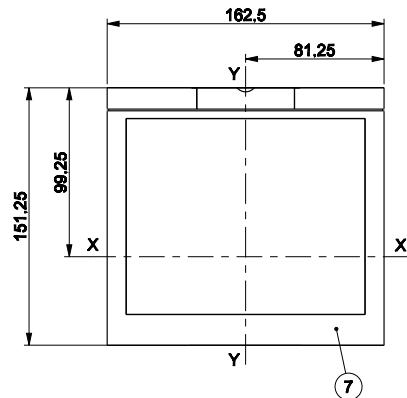

Drilling template compartment door

—
Key
6 Compartment door drilling template with/without flange

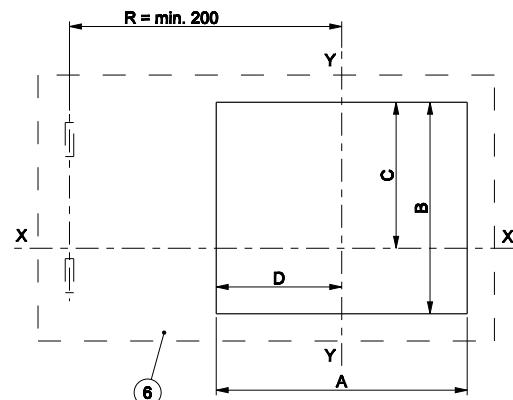


| | A [mm] | B [mm] | C [mm] | D [mm] |
|------------------------|--------|--------|--------|--------|
| With flange 3p - 4p | 147.5 | 124.3 | 85.8 | 73.75 |
| Without flange 3p - 4p | 140.5 | 115.3 | 81.3 | 70.25 |

Tmax XT5 – Installation


Accessories for plug-in circuit-breaker 400A

Front for lever operating mechanism (FLD)

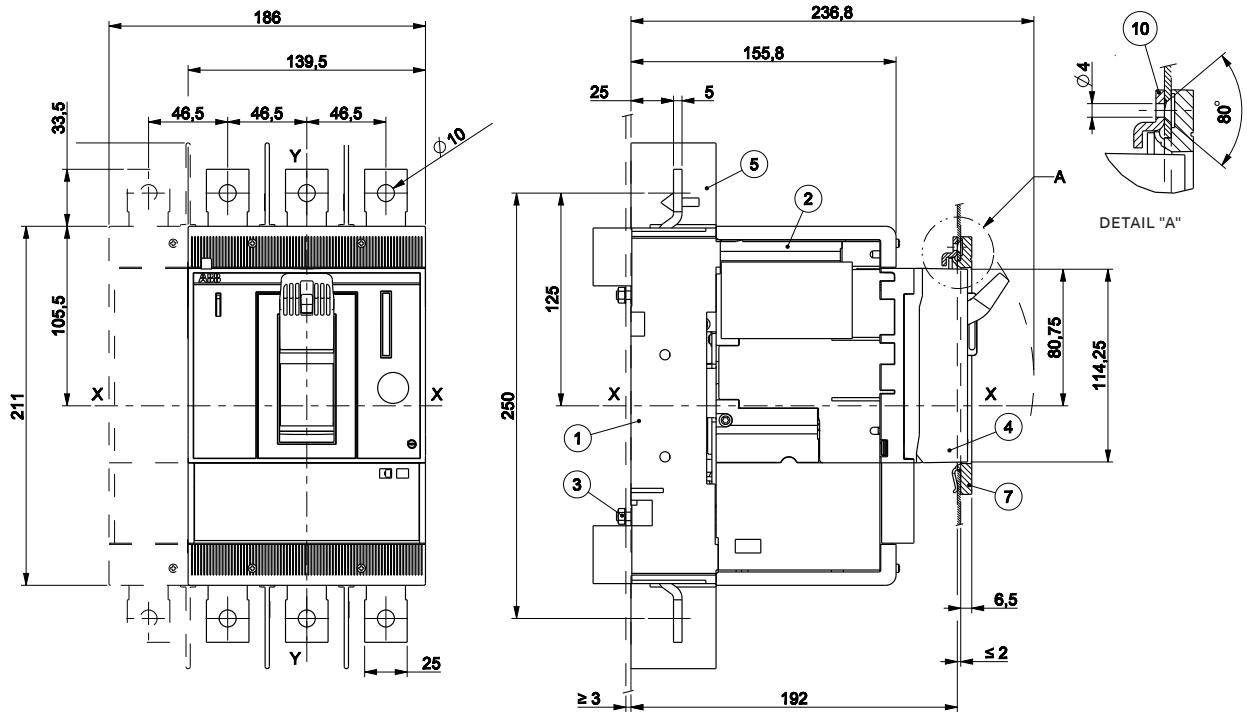


Drilling templates for support sheet

- Key
- 1 Fixed part
 - 2 Moving part
 - 3 Tightening torque 2Nm
 - 4 Front for lever operating system (FLD)
 - 5 Phase separators 100mm
 - 7 Flange without gasket for the compartment door
 - 10 Door lock

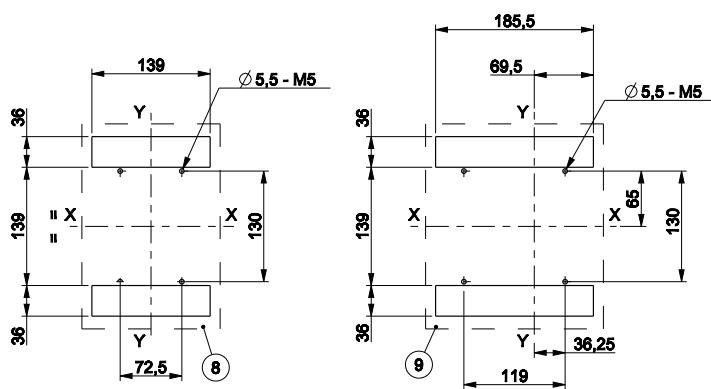


Flange

- Key
 6 Compartment door drilling template with/without flange
 7 Flange without gasket for the compartment door

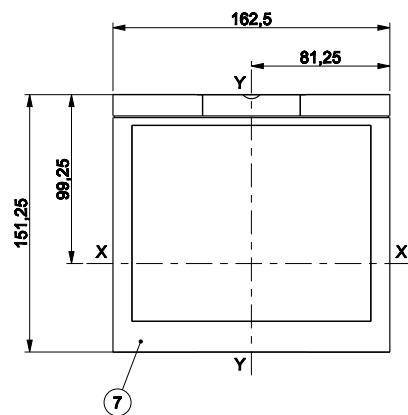

Drilling template compartment door

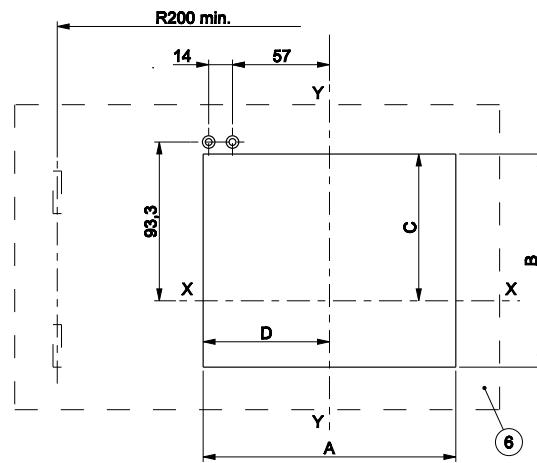


| | A [mm] | B [mm] | C [mm] | D [mm] |
|------------------------|--------|--------|--------|--------|
| With flange 3p - 4p | 147.5 | 124.3 | 85.8 | 73.75 |
| Without flange 3p - 4p | 140.5 | 115.3 | 81.3 | 70.25 |


Tmax XT5 – Installation

Accessories for plug-in circuit-breaker 400A

Rotary handle operating mechanism on the compartment door (RHE)

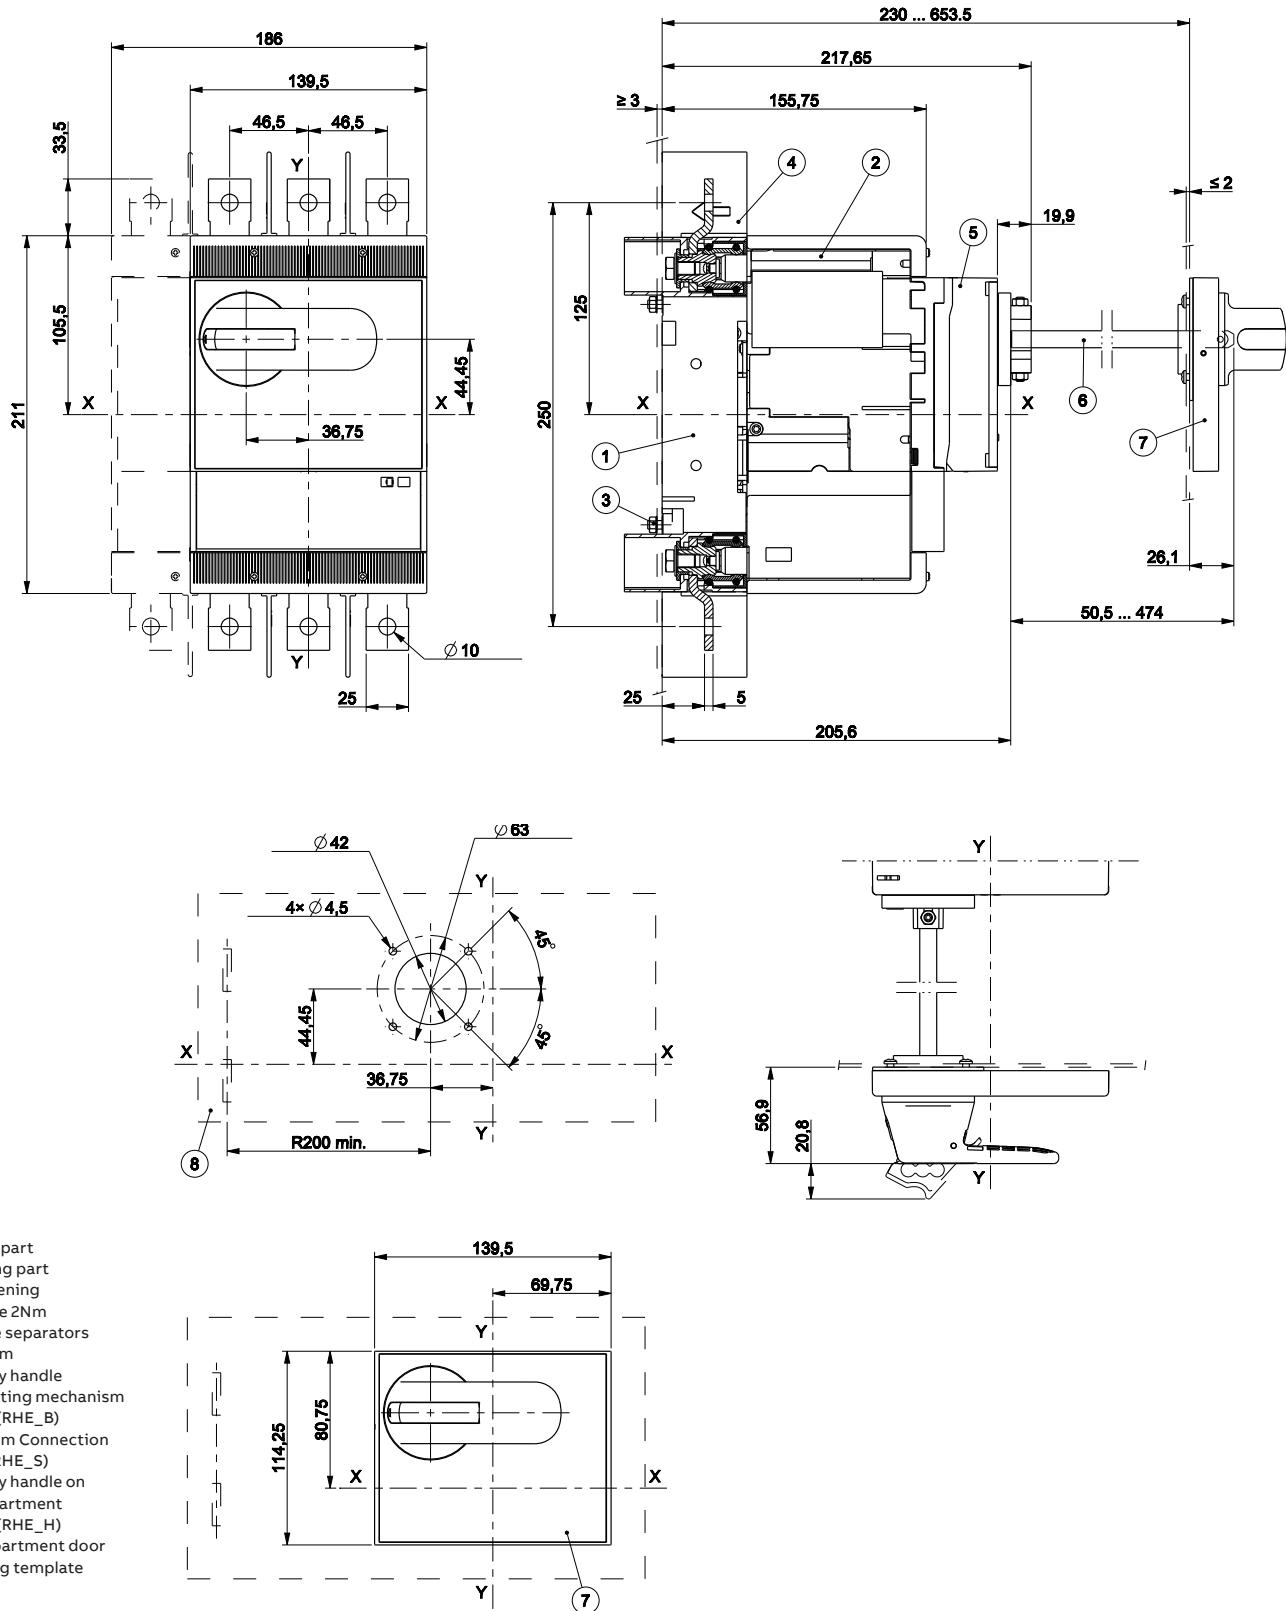


Residual current RC

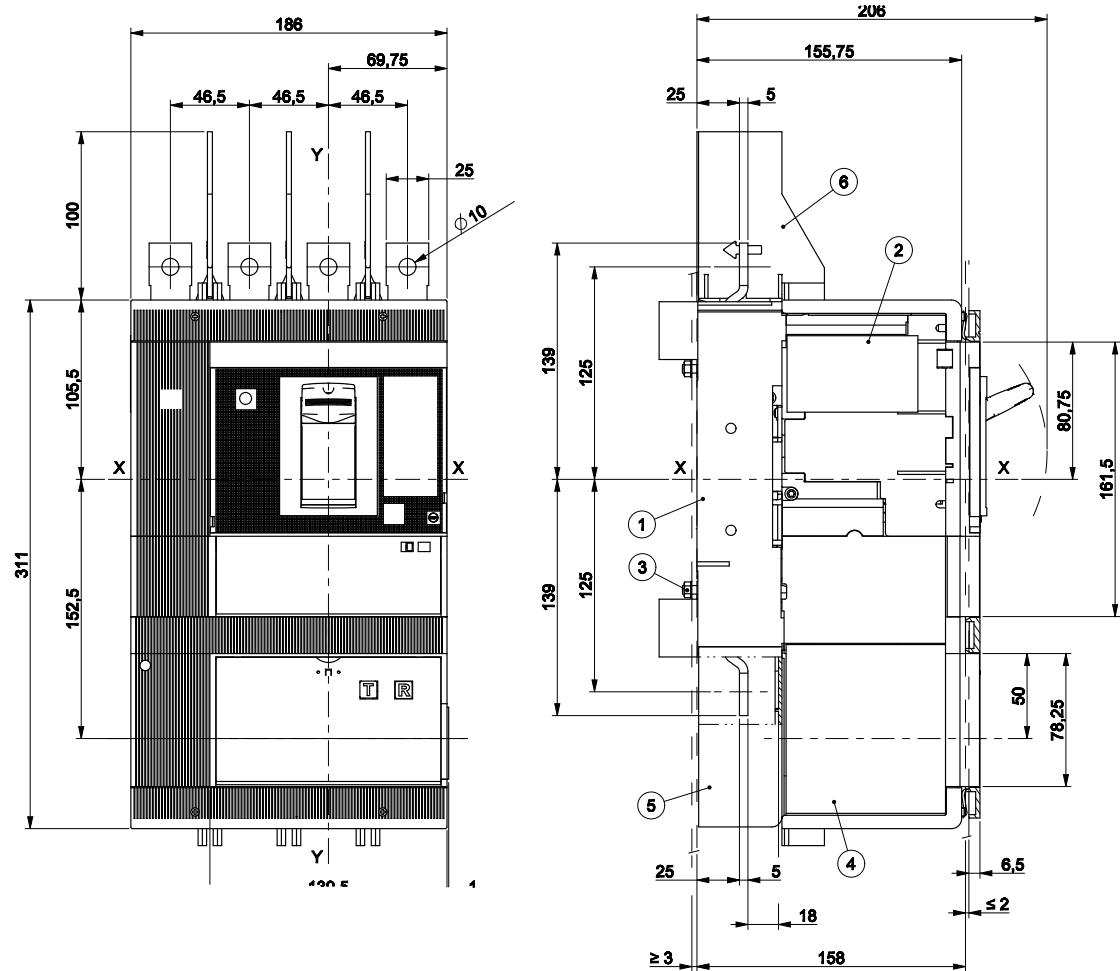

Drilling template for support sheet

- Key
- 1 Fixed part
 - 2 Moving part
 - 3 Tightening torque 2Nm
 - 4 Residual current release
 - 5 Terminal cover for residual current release
 - 8 Fixing on sheet steel

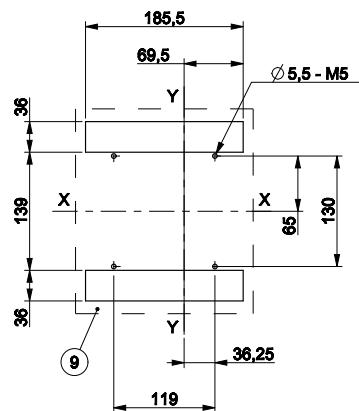


Tmax XT5 – Installation


Accessories for plug-in circuit-breaker 400A

Flange

- Key
 6 Flange for the compartment door
 7 Compartment door drilling template with/without flange

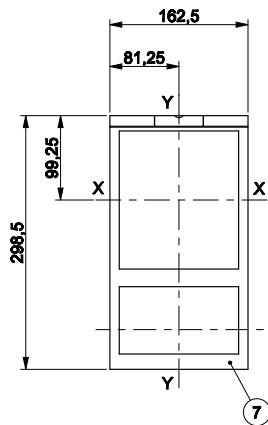

Drilling template compartment door

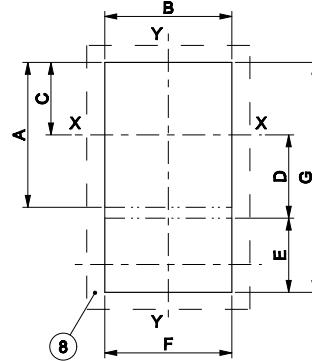


| | A [mm] | B [mm] | C [mm] | D [mm] | E [mm] | F [mm] | G [mm] |
|----------------|-----------|-----------|-----------|-----------|-----------|-----------|-------------|
| With flange | 3p - 4p | - | 147.5 | 84.8 | - | - | 147.5 269.5 |
| Without flange | 3p - 4p | 163.5 | 141.5 | 81.8 | 101.5 | 80.3 | 141.5 - |

Tmax XT5 – Installation

Installation for plug-in circuit-breaker 630A


Fixing on sheet

—
Key
 1 Fixed part
 2 Moving part
 3 Tightening torque 2Nm
 4 Phase separators 100mm

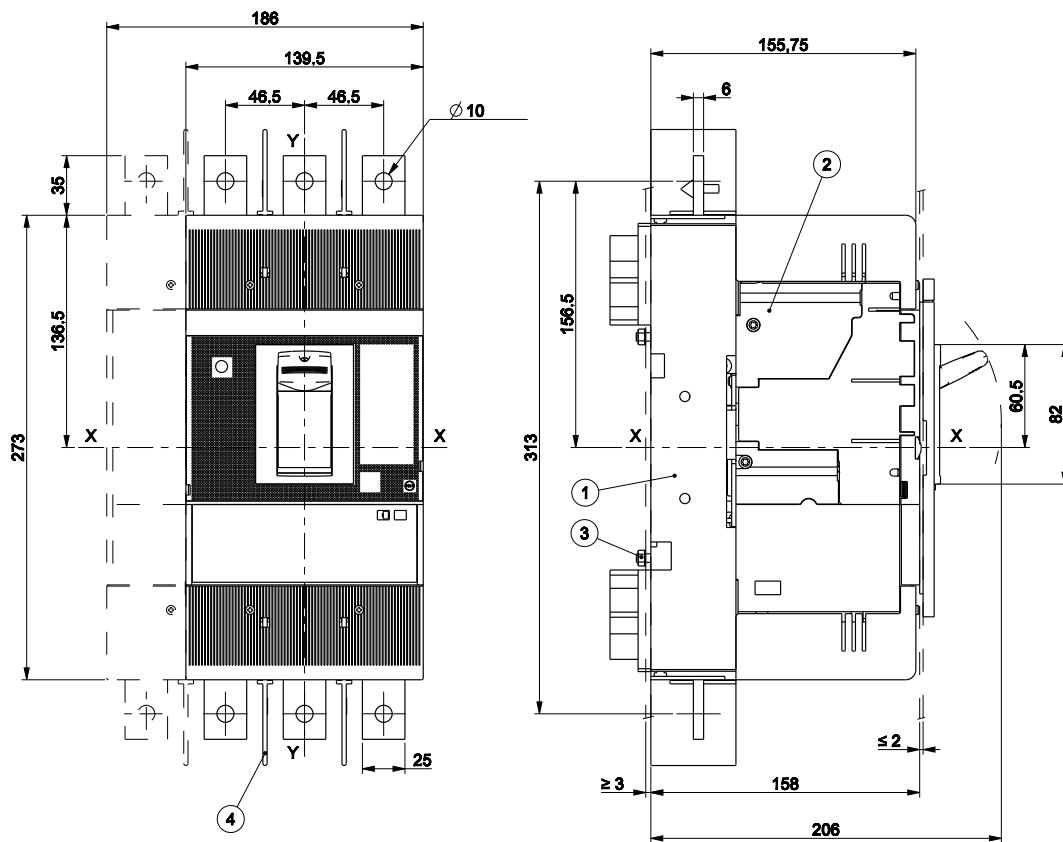

Drilling templates for support sheet

—
Key
 7 Drilling template 3p
 8 Drilling template 4p

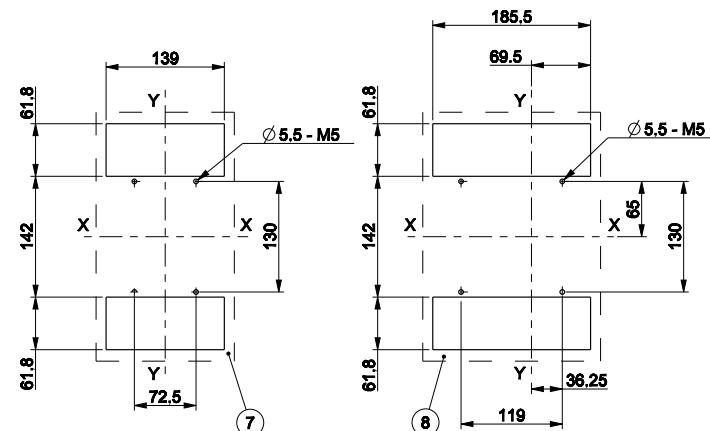


Tmax XT5 – Installation

Installation for plug-in circuit-breaker 630A


Flange

—
Key
6 Flange without gasket for the compartment door

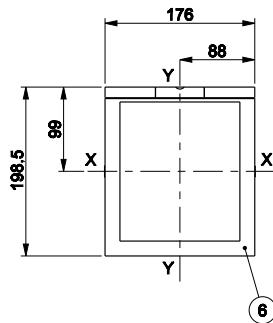

Drilling template compartment door

—
Key
5 Compartment door drilling template with/without flange

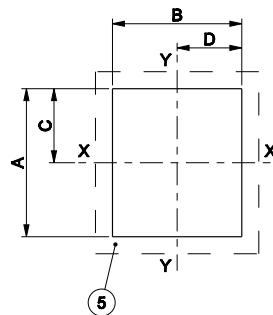


| | A [mm] | B [mm] | C [mm] | D [mm] |
|----------------|---------|--------|--------|--------|
| With flange | 3p - 4p | 174 | 152 | 87 |
| Without flange | 3p - 4p | 165 | 143 | 82.5 |
| | | | | 71.5 |

Tmax XT5 – Installation

Terminals for plug-in circuit-breaker 630A

Terminals EF

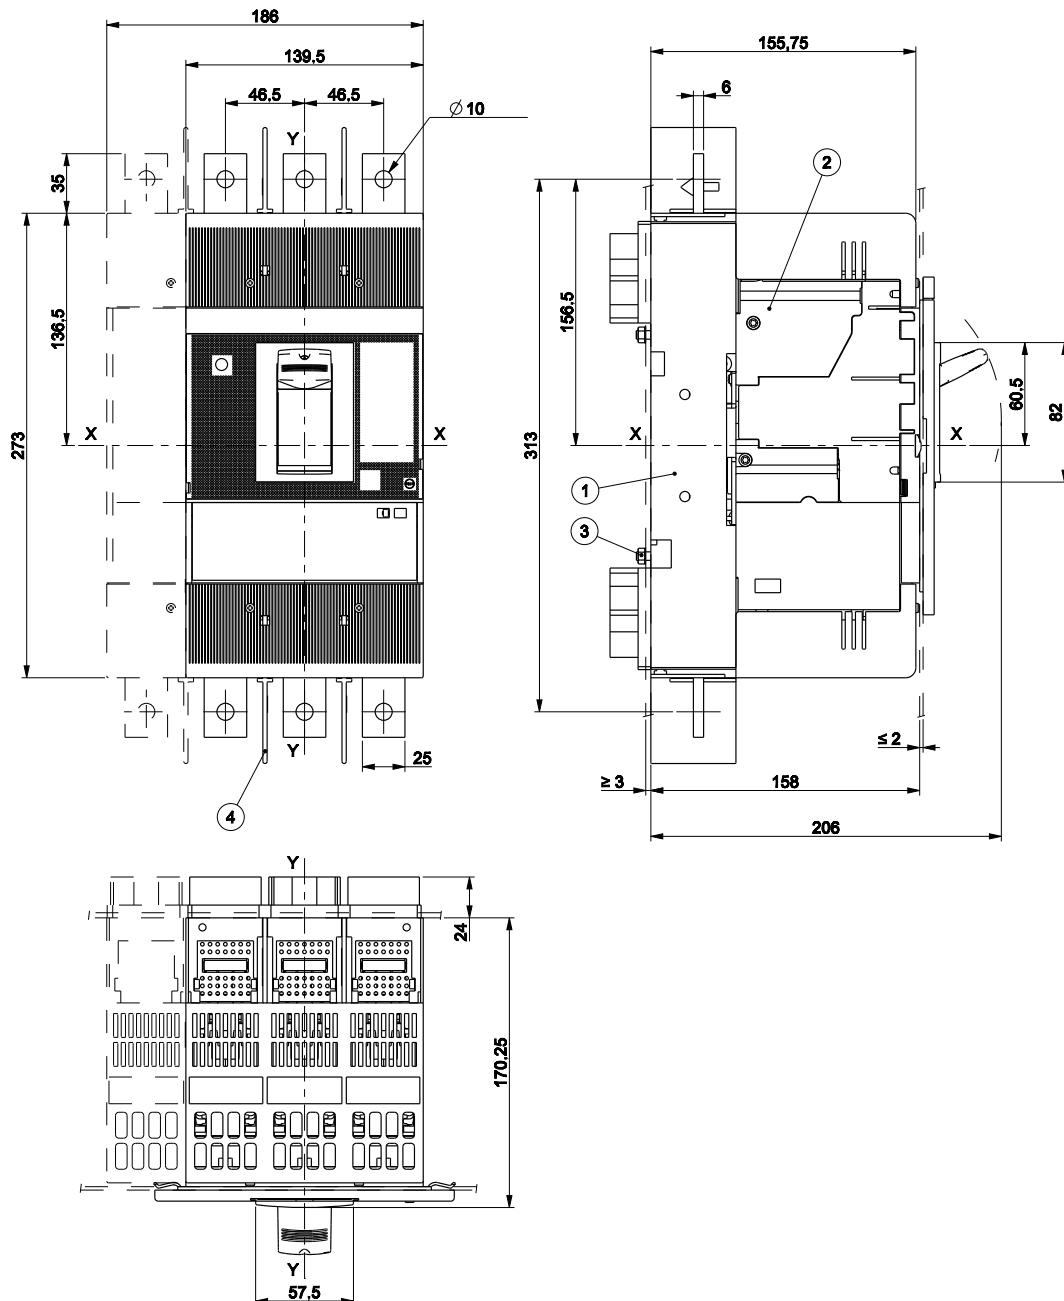


Key

- 1 Fixed part
- 2 Moving part
- 3 Tightening torque 2Nm
- 4 Phase separators 100mm

Tmax XT5 – Installation

Terminals for plug-in circuit-breaker 630A



Terminals HR

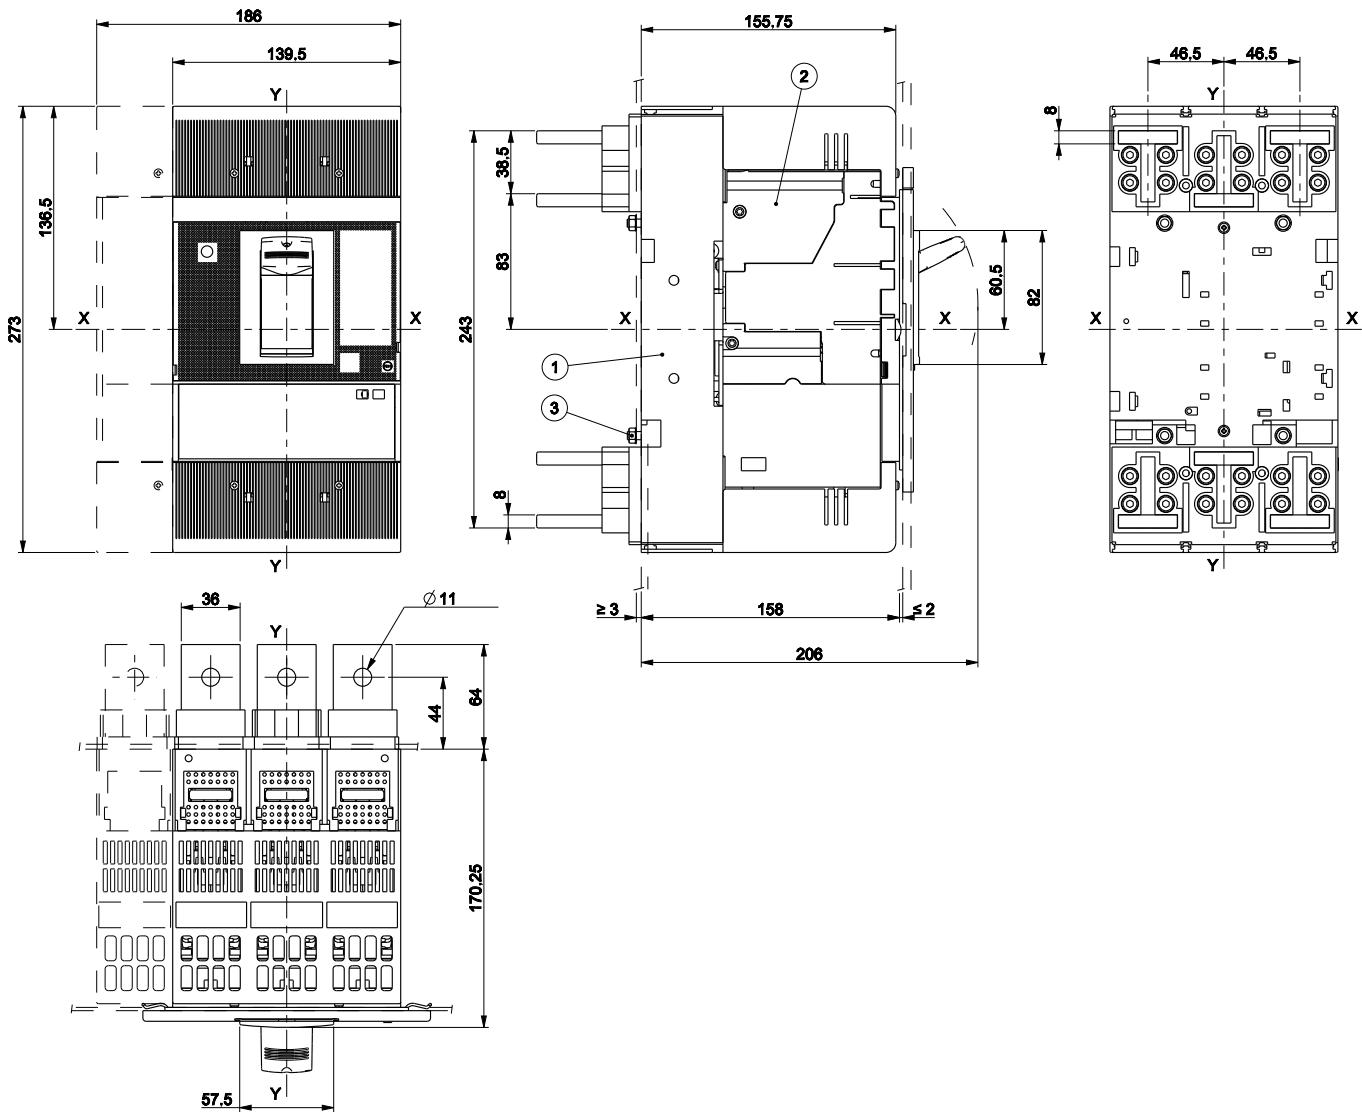

Key

- 1 Fixed part
- 2 Moving part
- 3 Tightening torque 2Nm

Terminals VR

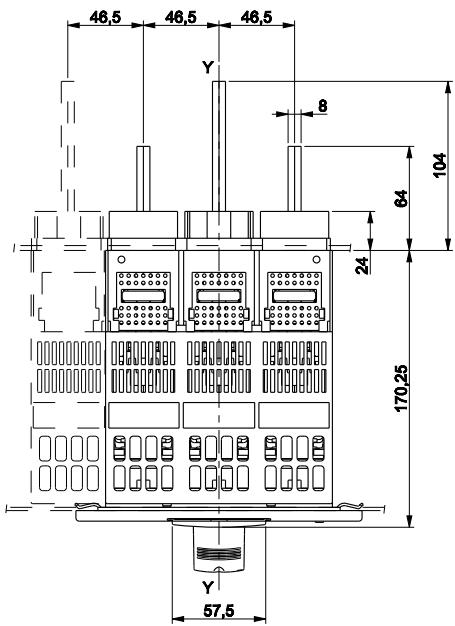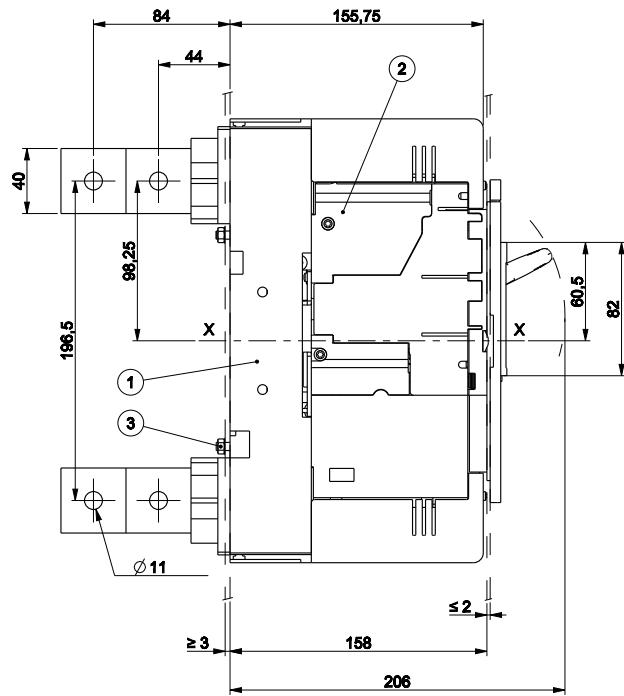


Key

- 1 Fixed part
- 2 Moving part
- 3 Tightening torque 2Nm

Tmax XT5 – Installation

Accessories for plug-in circuit-breaker 630A


Rotary handle operating mechanism on the circuit-breaker (RHD)

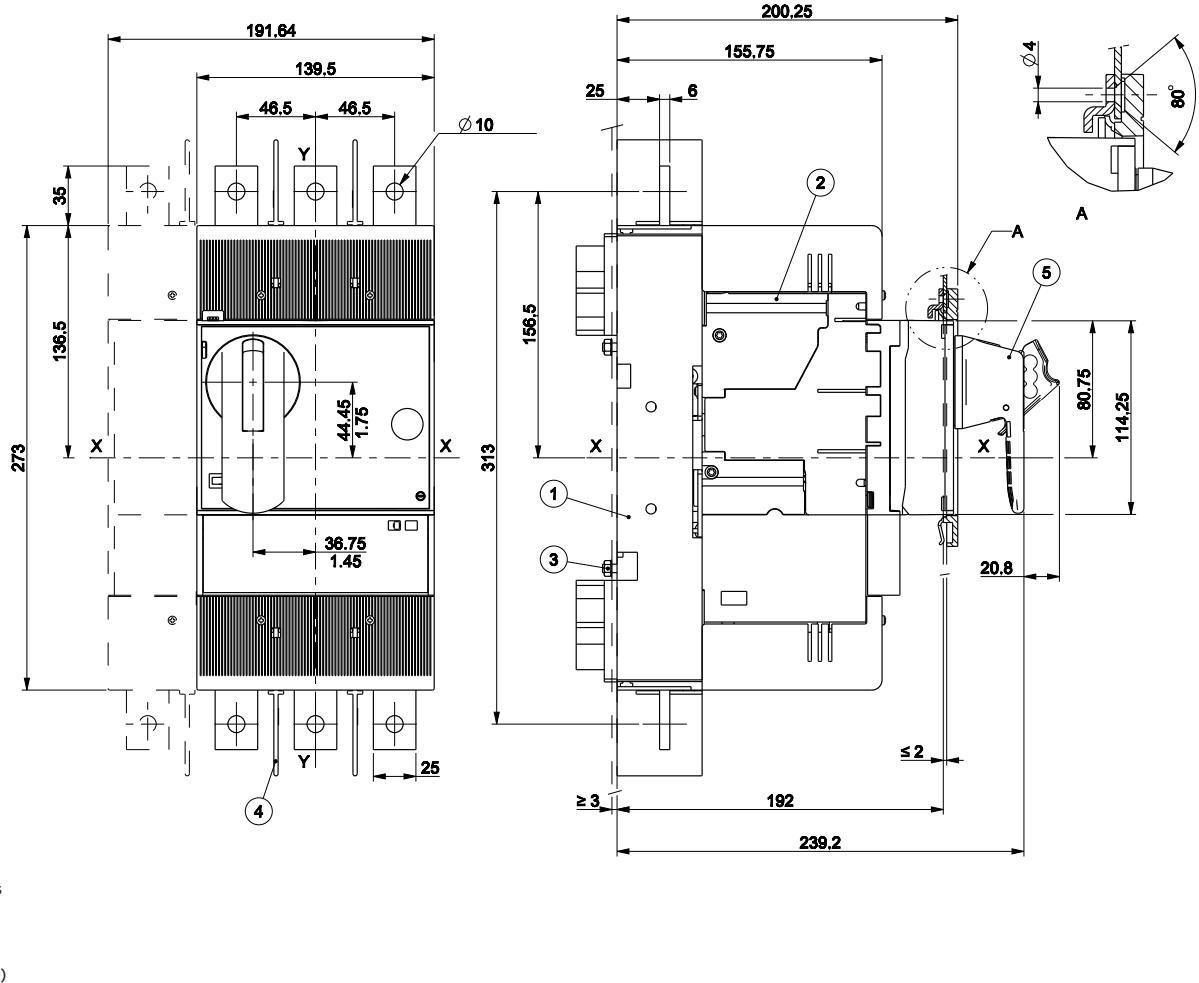

Drilling templates for support sheet


Key

- 8 Drilling template 3p
- 9 Drilling template 4p

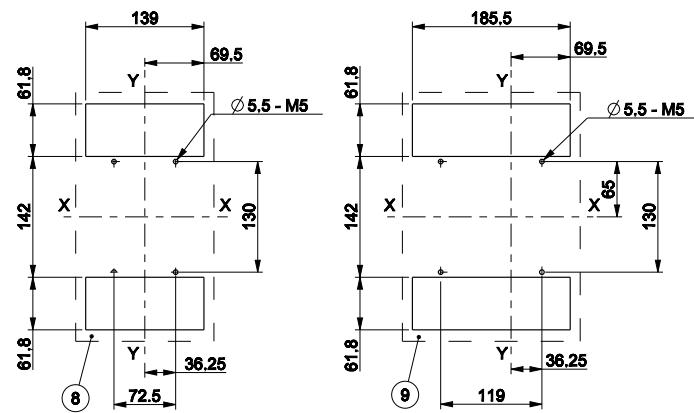


Flange

- Key
6 Compartment door drilling template with/without flange
7 Flange for the compartment door





Drilling template compartment door




| | A [mm] | B [mm] | C [mm] | D [mm] |
|----------------|---------|--------|--------|--------|
| With flange | 3p - 4p | 147.5 | 124.3 | 85.8 |
| Without flange | 3p - 4p | 140.5 | 115.3 | 70.25 |

Flange IP54

- Key
10 IP54 flange for the compartment door
11 Compartment door drilling template with IP54 flange




Drilling template compartment door with flange IP54

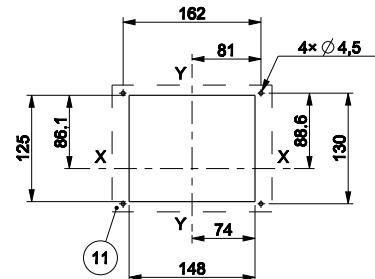


Tmax XT5 – Installation

Accessories for plug-in circuit-breaker 630A

Lateral rotary handle operating mechanism on the compartment door (RHL)

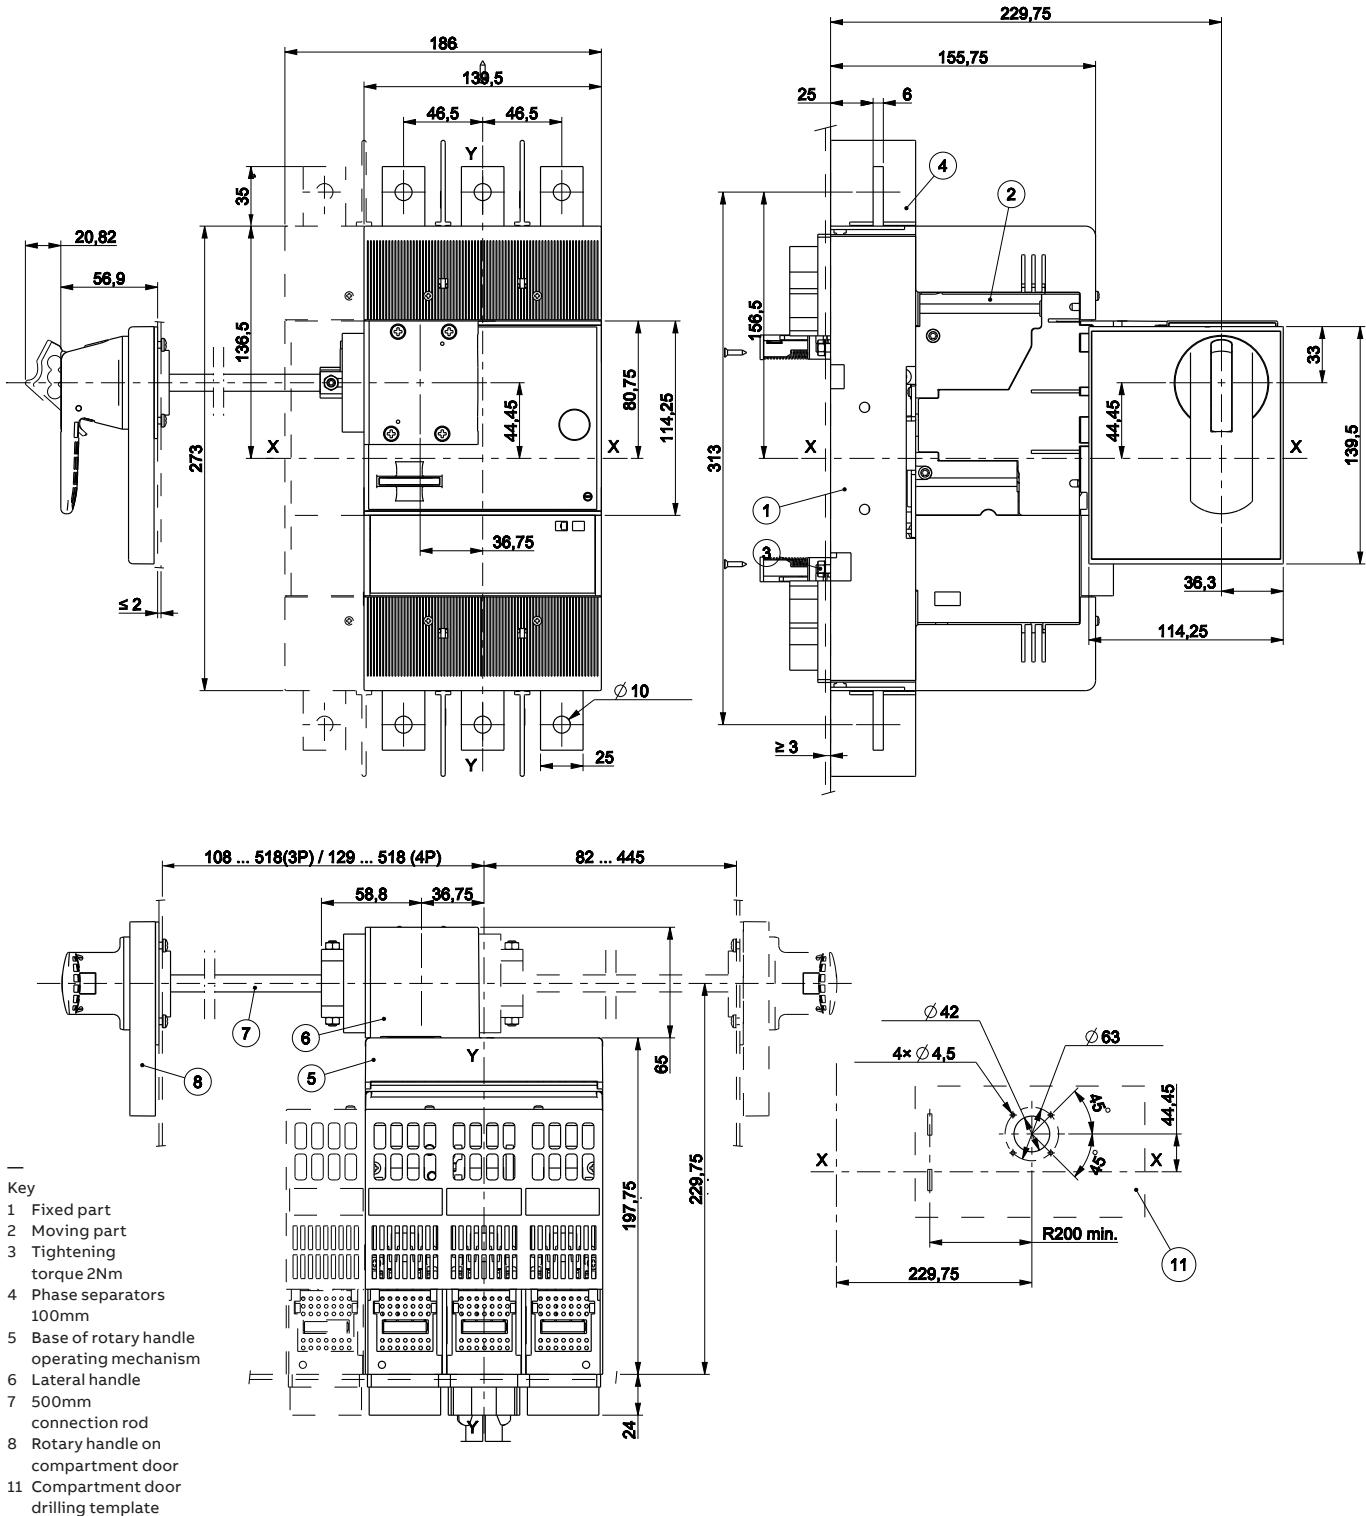

Stored energy motor operator (MOE)

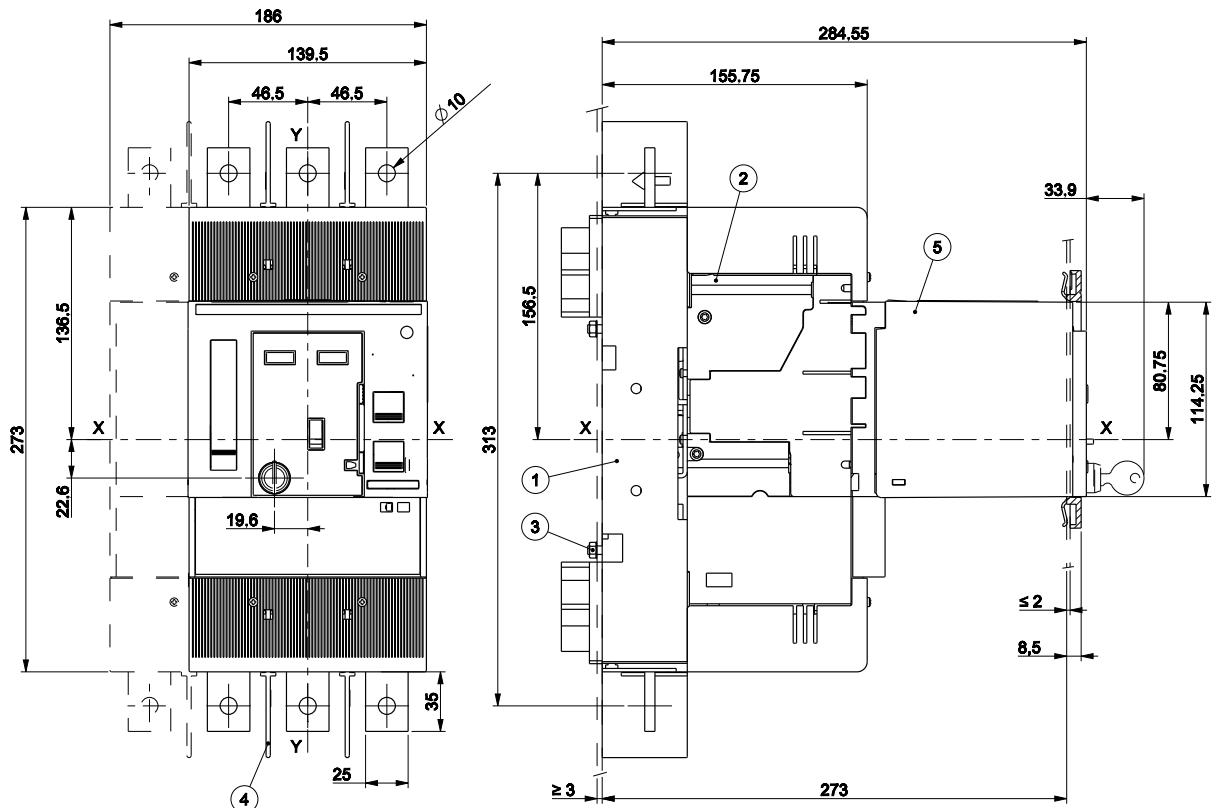

-


- Key**

 - 1 Fixed part
 - 2 Moving part
 - 3 Tightening torque 2Nm
 - 4 Phase separators 100mm
 - 5 Stored energy motor operator (MOE)

Drilling templates for support sheet

-

- ## Key

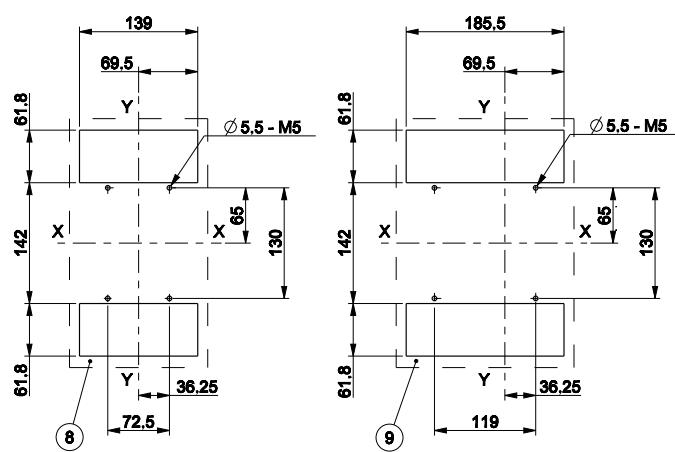


Tmax XT5 – Installation

Accessories for plug-in circuit-breaker 630A


Flange

—
Key
7 Flange without gasket for the compartment door

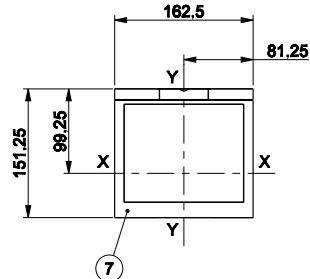


Drilling template compartment door

—
Key
6 Compartment door drilling template with/without flange

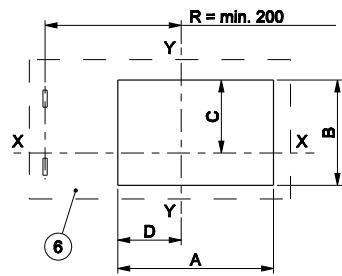


| | A [mm] | B [mm] | C [mm] | D [mm] |
|----------------|---------|--------|--------|--------|
| With flange | 3p - 4p | 147.5 | 124.3 | 85.8 |
| Without flange | 3p - 4p | 140.5 | 115.3 | 70.25 |

Front for lever operating mechanism (FLD)

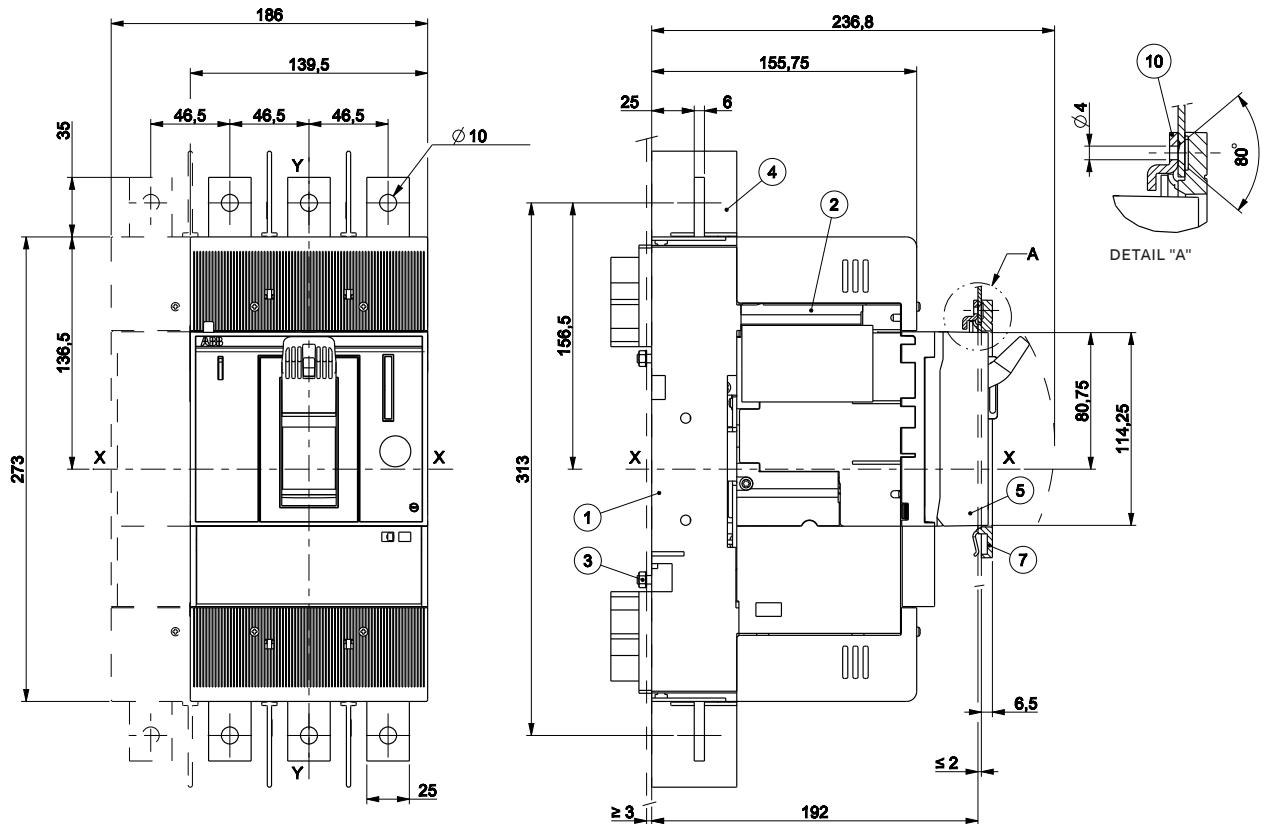

Drilling templates for support sheet

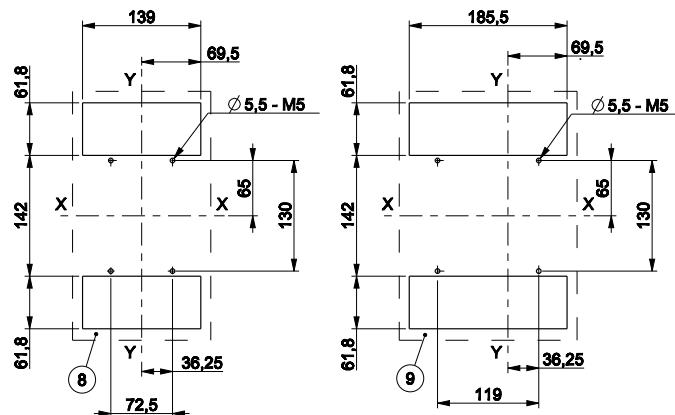

Key


- 1 Fixed part
- 2 Moving part
- 3 Tightening torque 2Nm
- 4 Phase separators 100mm
- 5 Front for lever operating mechanism (FLD)
- 6 Compartment door drilling template with/without flang
- 7 Flange without gasket for the compartment door
- 8 Drilling template 3p
- 9 Drilling template 4p
- 10 Door lock

Tmax XT5 – Installation

Accessories for plug-in circuit-breaker 630A


Flange

—
Key
7 Flange without gasket for the compartment door

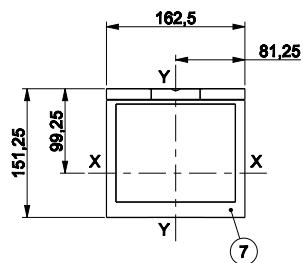



Drilling template compartment door

—
Key
6 Compartment door drilling template with/without flange



| | A [mm] | B [mm] | C [mm] | D [mm] |
|------------------------|--------|--------|--------|--------|
| With flange 3p - 4p | 147.5 | 124.3 | 85.8 | 73.75 |
| Without flange 3p - 4p | 140.5 | 115.3 | 81.3 | 70.25 |


Rotary handle operating mechanism on the compartment door (RHE)

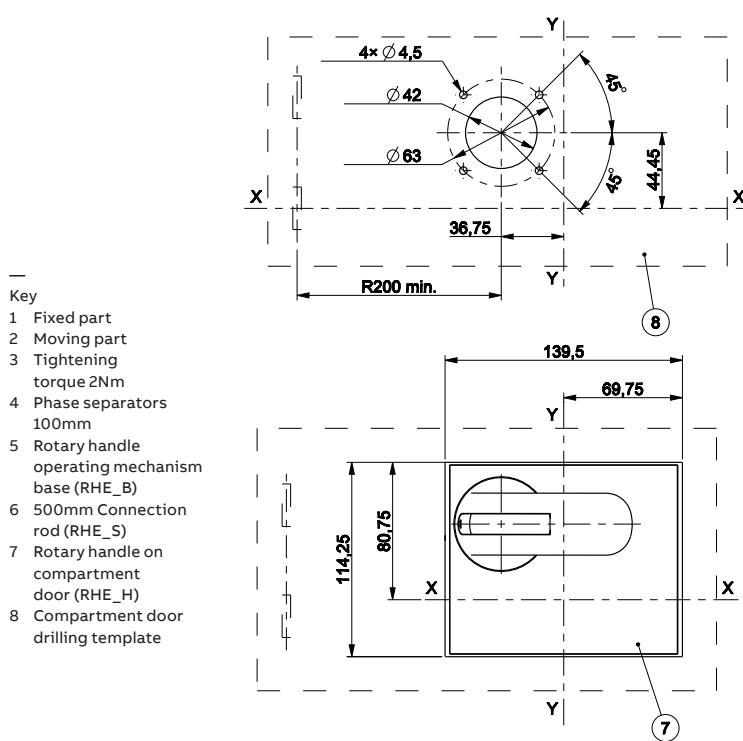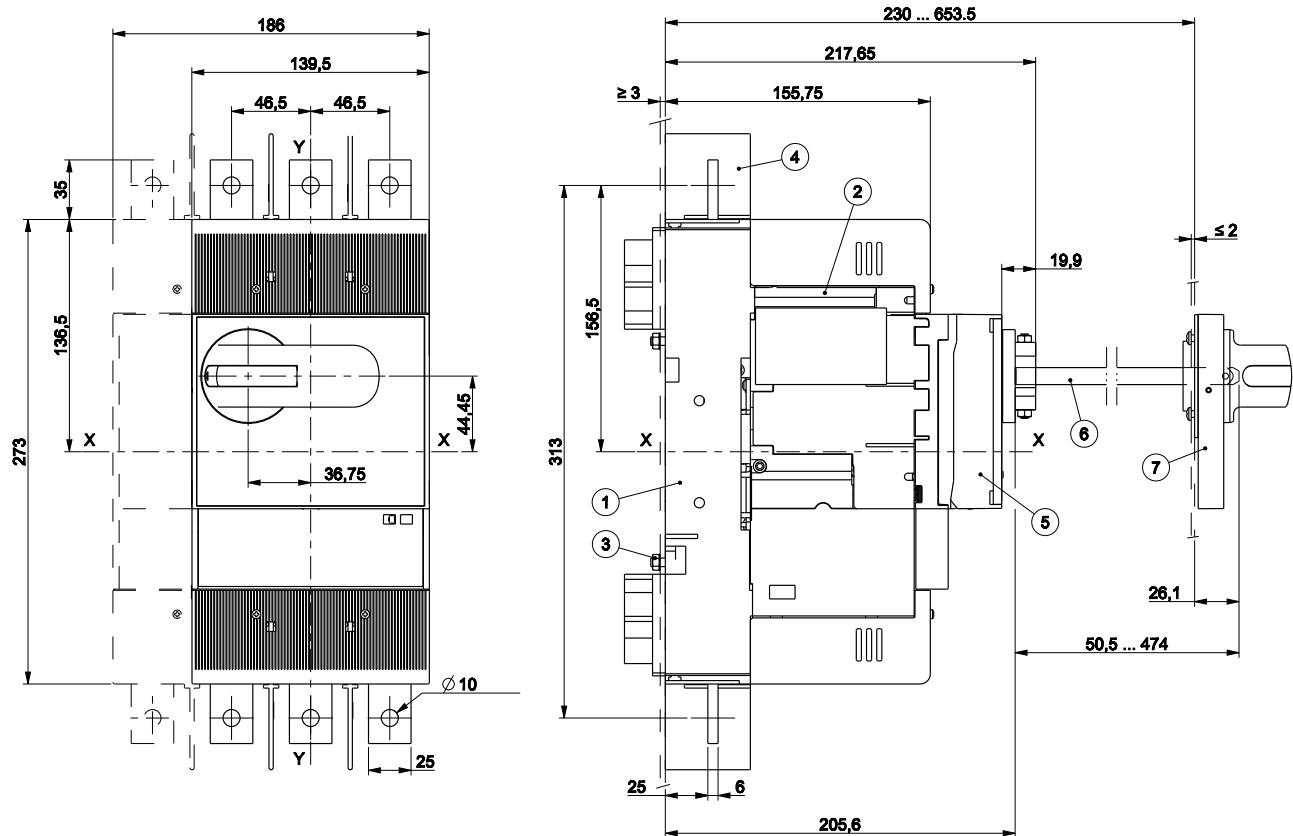

Tmax XT5 – Installation


Accessories for plug-in circuit-breaker 630A

Residual current RC

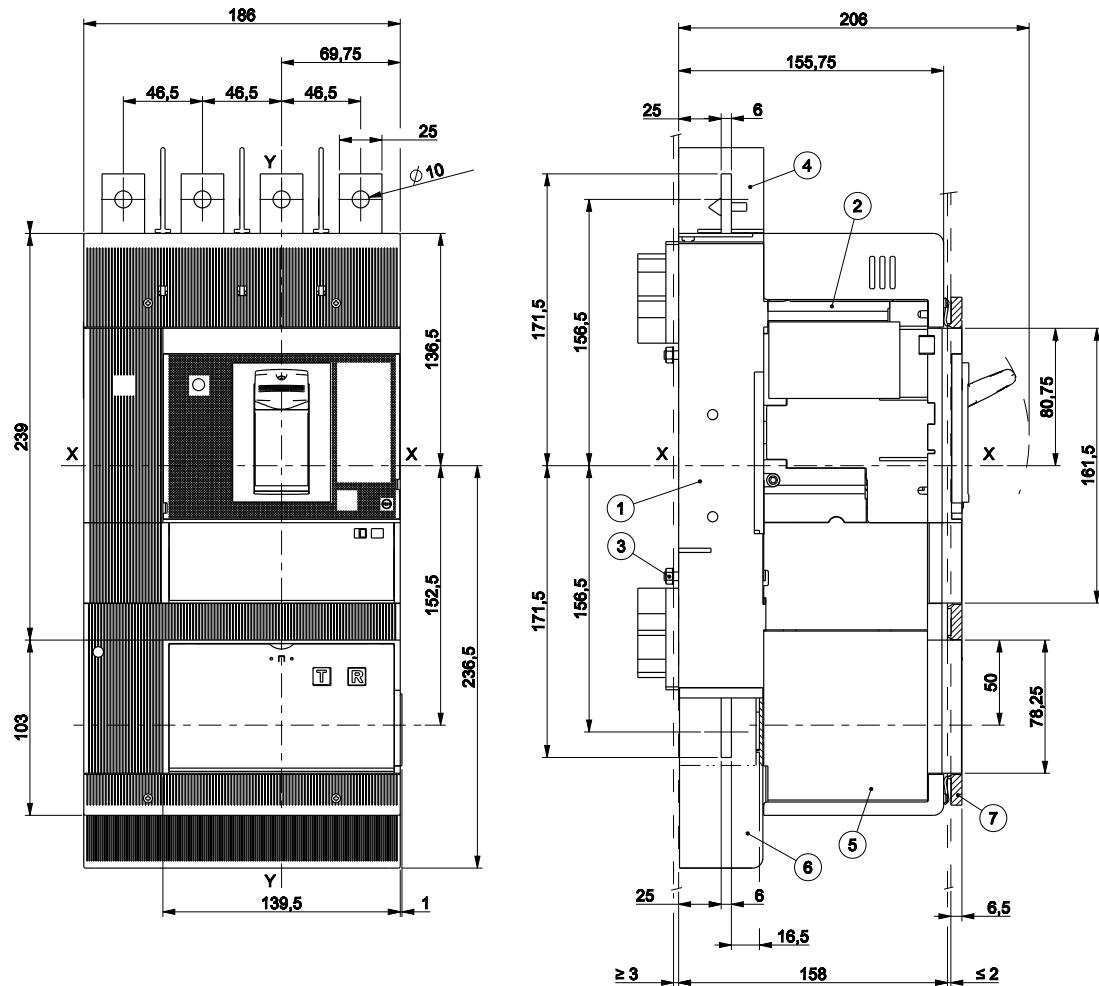


Drilling template for support sheet

- Key
- 1 Fixed part
 - 2 Moving part
 - 3 Tightening torque 2Nm
 - 4 Phase separators 100mm
 - 5 Residual current release
 - 6 Terminal cover for residual current release
 - 9 Fixing on sheet steel

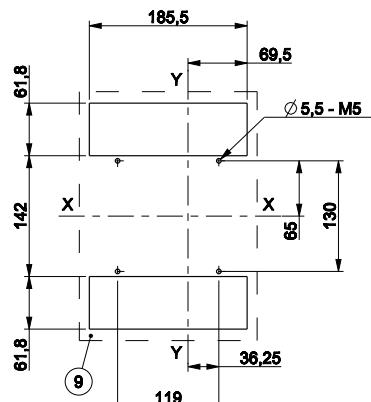


Flange

Key
 7 Flange for the compartment door
 8 Compartment door drilling template with/without flange

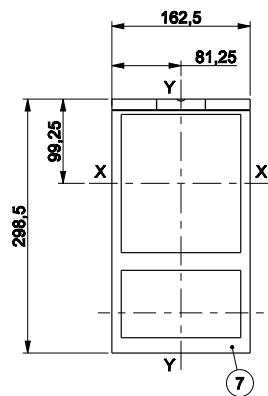

Drilling template compartment door

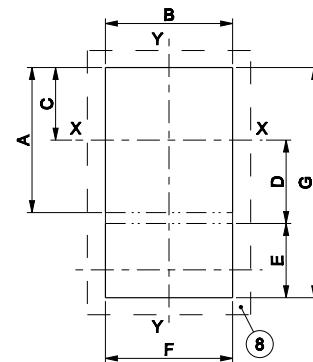


| | A [mm] | B [mm] | C [mm] | D [mm] | E [mm] | F [mm] | G [mm] |
|----------------|-----------|-----------|-----------|-----------|-----------|-----------|-------------|
| With flange | 3p - 4p | - | 147.5 | 84.8 | - | - | 147.5 269.5 |
| Without flange | 3p - 4p | 163.5 | 141.5 | 81.8 | 101.5 | 80.3 | 141.5 - |

Tmax XT5 – Installation


Installation for withdrawable circuit-breaker 400A

Fixing on sheet

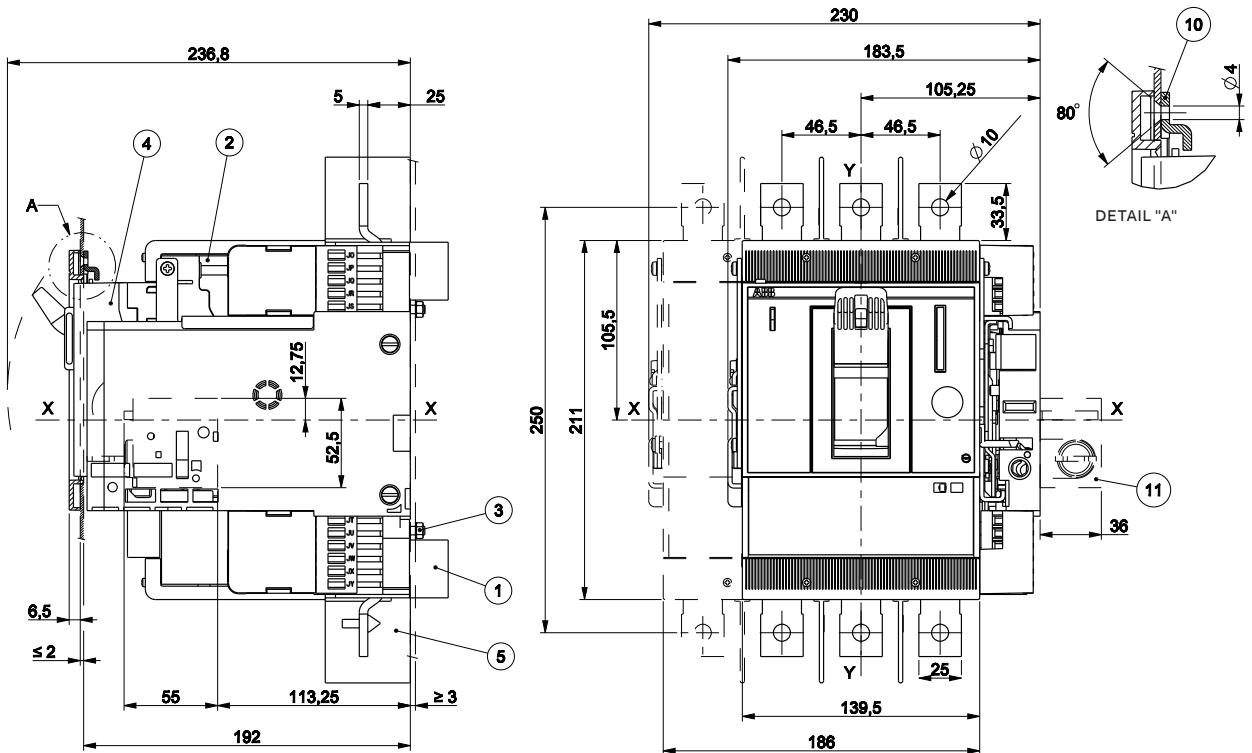


Drilling templates for support sheet


- Key
- 1 Fixed part
 - 2 Moving part
 - 3 Tightening torque 2Nm
 - 4 Front for lever operating mechanism (fld)
 - 5 Phase separators 100mm
 - 8 Drilling template 3p
 - 9 Drilling template 4p
 - 10 Door lock
 - 11 Key lock for fixed part

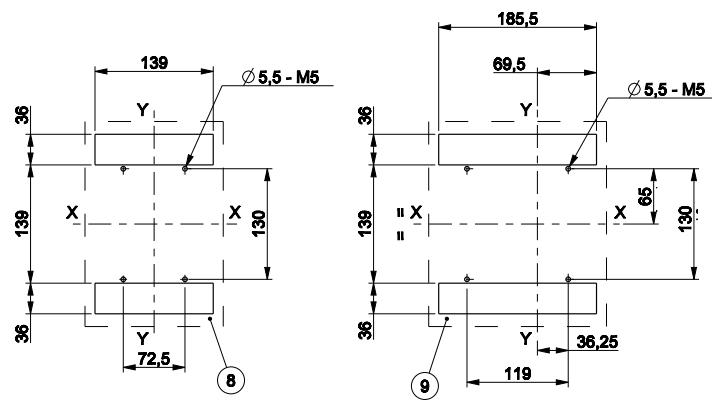

Flange

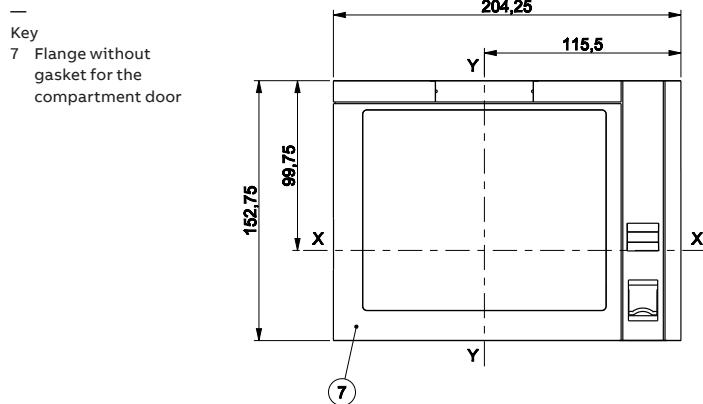


Drilling template compartment door

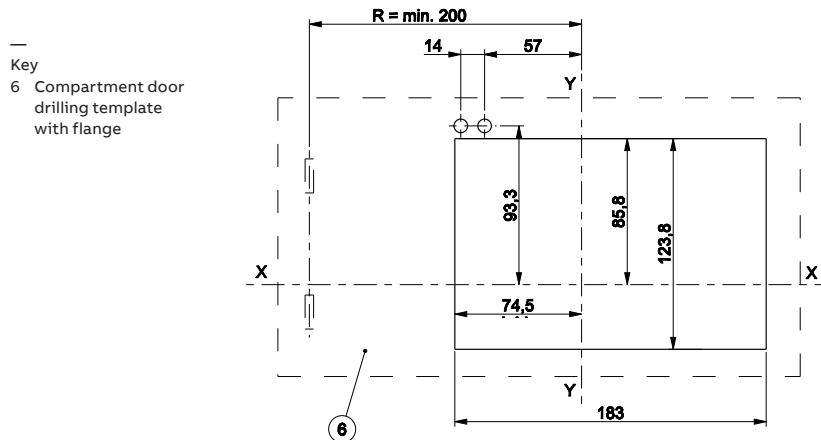

Tmax XT5 – Installation

Terminals for withdrawable circuit-breaker 400A

Terminals EF




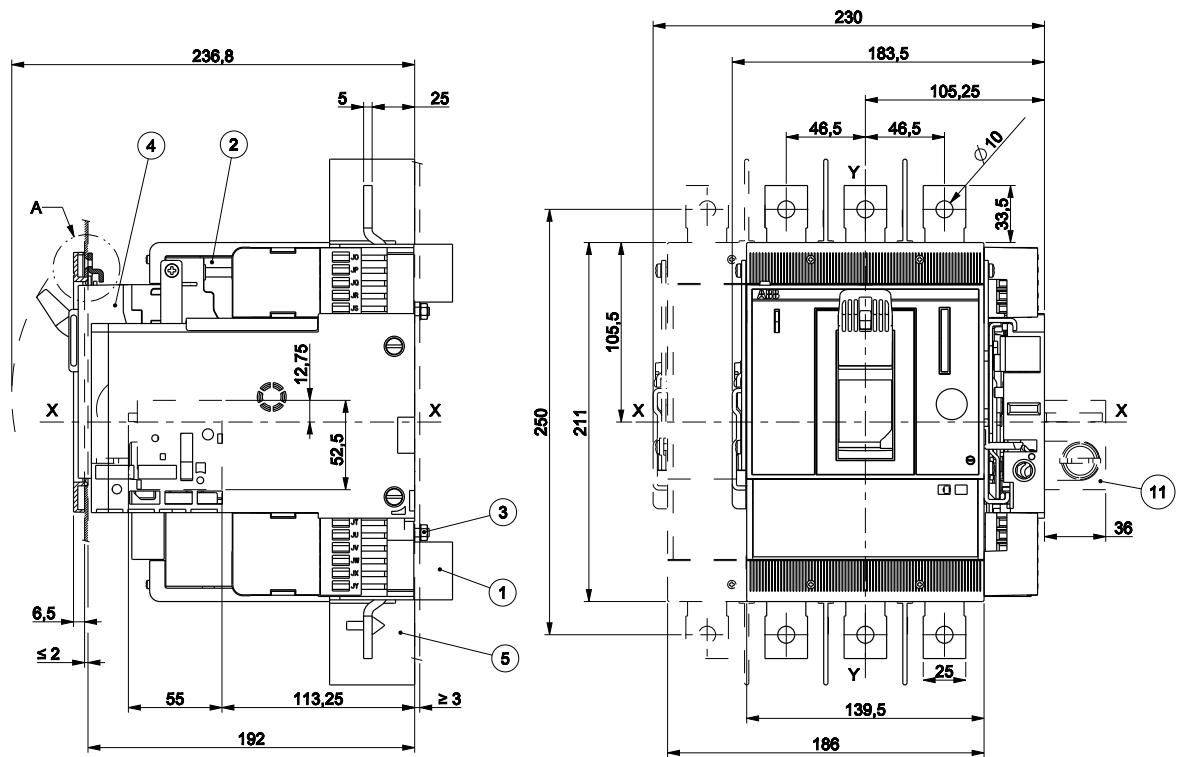


—

Key

- 1 Fixed part
- 2 Moving part
- 3 Tightening torque 2Nm
- 4 Front for lever operating mechanism (fld)
- 5 Phase separators 100mm
- 10 Door lock
- 11 Key lock for fixed part

Terminals HR

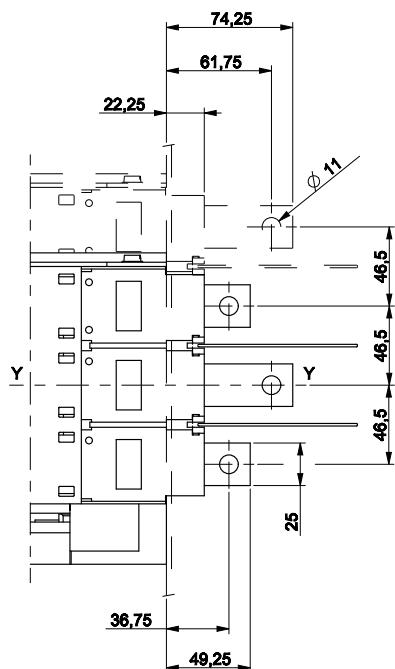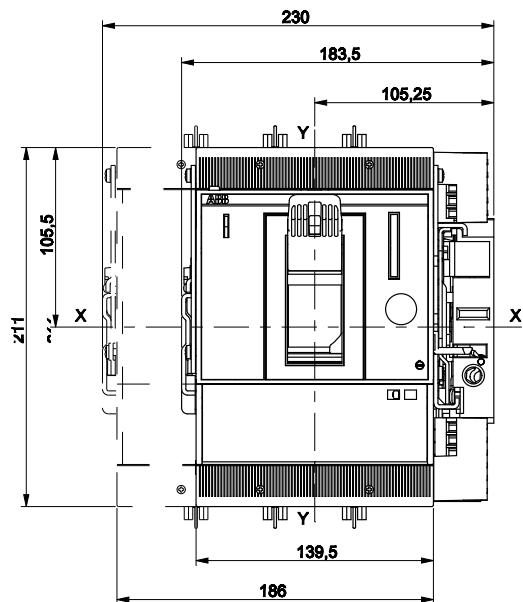
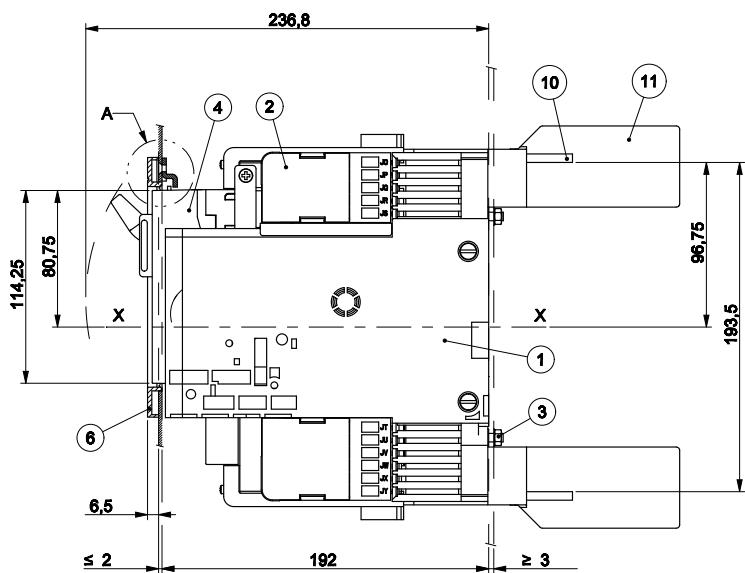


- Key
- 1 Fixed part
 - 2 Moving part
 - 3 Tightening torque 2Nm
 - 4 Front for lever operating mechanism (FLD)
 - 6 Flange without gasket for compartment door
 - 9 Door lock
 - 10 Terminals for connection
 - 11 Rear insulating barriers (optional except same length terminals)

Tmax XT5 – Installation

Terminals for withdrawable circuit-breaker 400A



Terminals VR

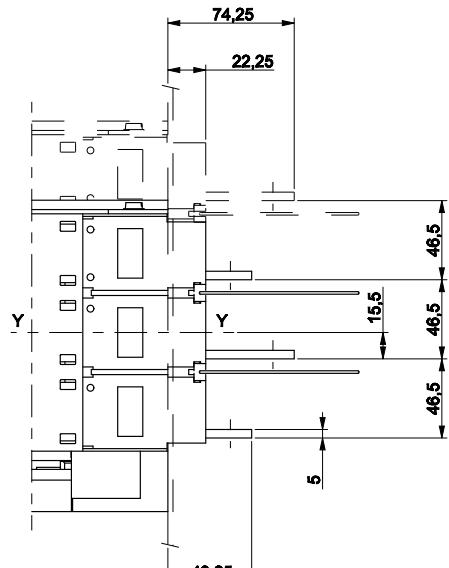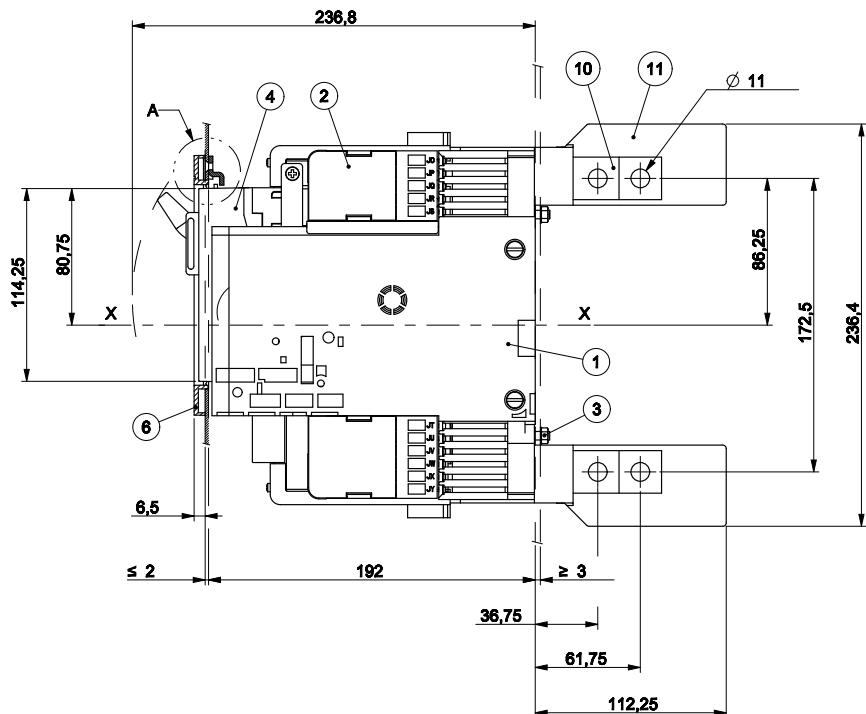

Key

- 1 Fixed part
- 2 Moving part
- 3 Tightening torque 2Nm
- 4 Front for lever operating mechanism (FLD)
- 6 Flange without gasket for compartment door
- 10 Terminals for connection
- 11 Rear insulating barriers (optional except same length terminals)

Residual current (RC) and Front for lever operating mechanism (FLD)

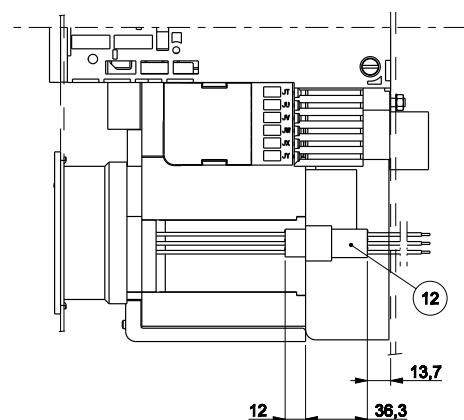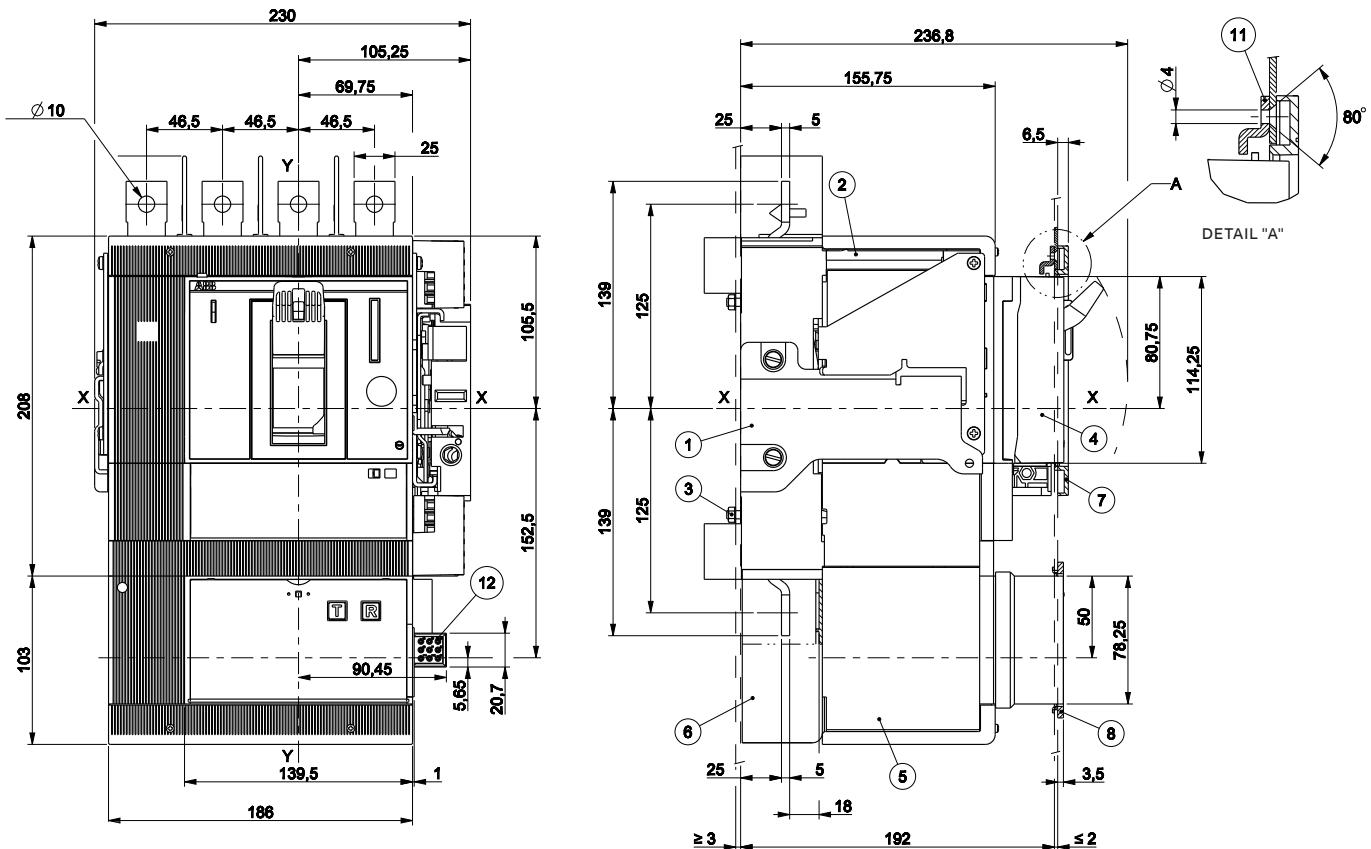


- Key
- 1 Fixed part
 - 2 Moving part
 - 3 Tightening torque 2Nm
 - 4 Front for operating lever mechanism
 - 5 Residual current release
 - 6 Terminal cover for residual current release
 - 7 Flange for the compartment door
 - 8 Flange for residual current release
 - 11 Door lock plate
 - 12 Plug and socket adapter for residual current release


Tmax XT5 – Installation

Terminals for withdrawable circuit-breaker 400A

Drilling template for support sheet Flange

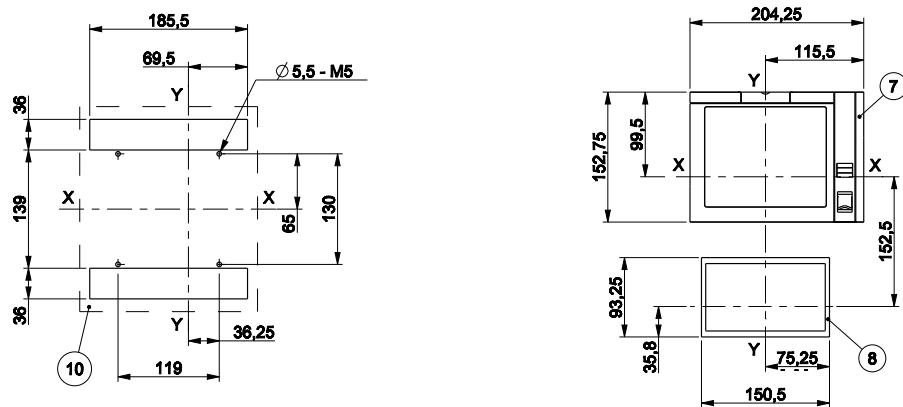

Drilling template compartment door

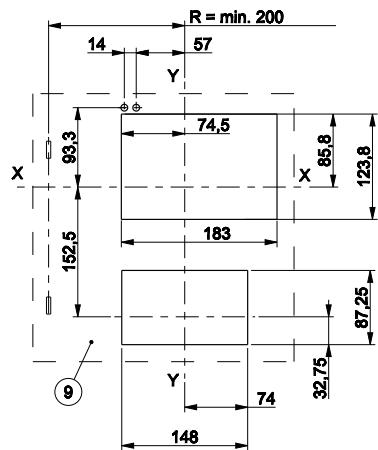


—
Key

- 7 Flange for the compartment door
- 8 Flange for residual current release
- 9 Compartment door drilling template with/without flange
- 10 Fixing on sheet steel

Tmax XT5 – Installation


Accessories for withdrawable circuit-breaker 400A

Rotary handle operating mechanism on the circuit-breaker (RHD)

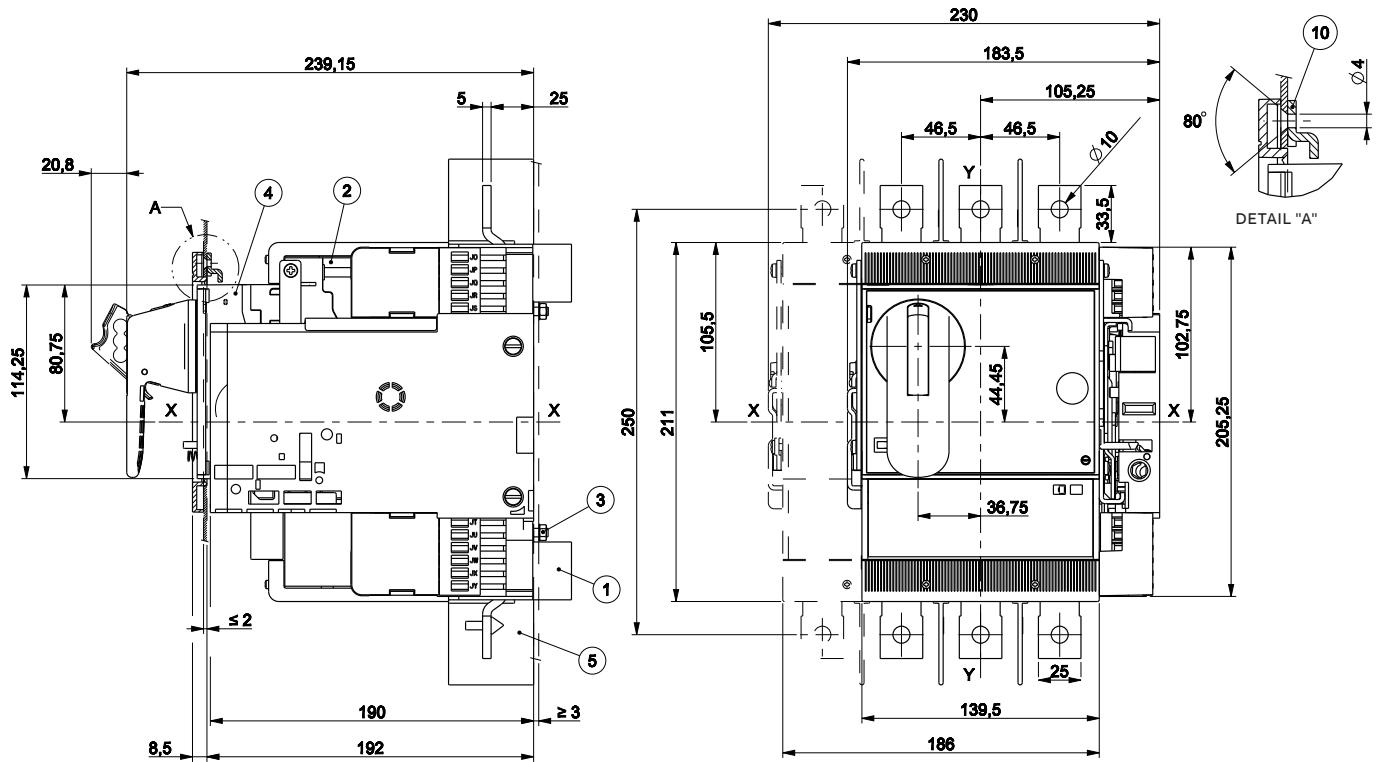

Drilling templates for support sheet

- Key
- 1 Fixed part
- 2 Moving part
- 3 Tightening torque 2Nm
- 4 Rotary handle operating mechanism (RHD)
- 5 Phase separators 100mm
- 8 Drilling template 3p
- 9 Drilling template 4p
- 10 Door lock

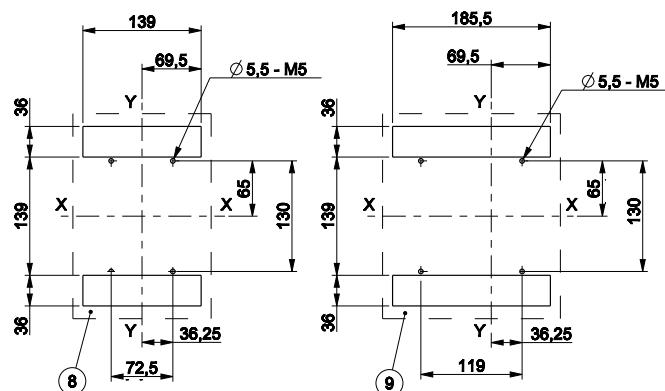


Tmax XT5 – Installation

Accessories for withdrawable circuit-breaker 400A


Flange

—
Key
7 Flange without gasket for the compartment door

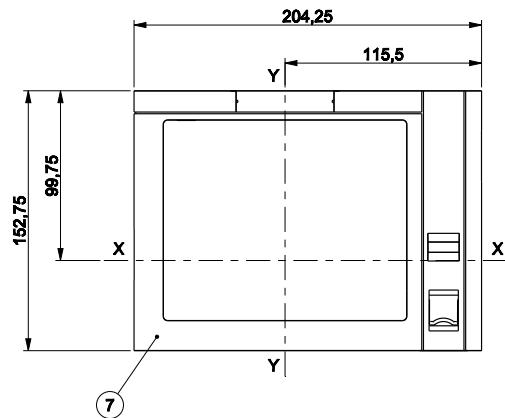


Drilling template compartment door

—
Key
6 Compartment door drilling template with flange

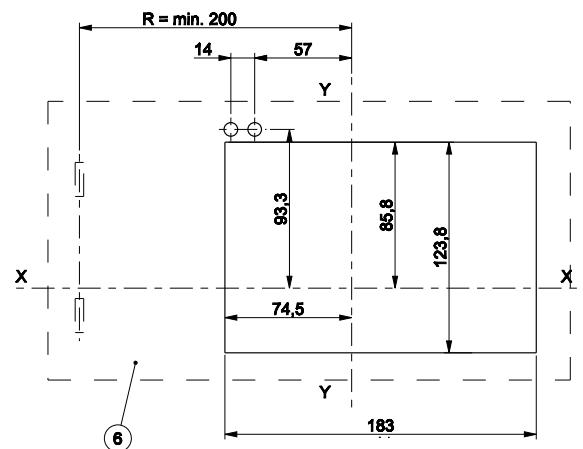


Lateral rotary handle operating mechanism on the compartment door (RHL)

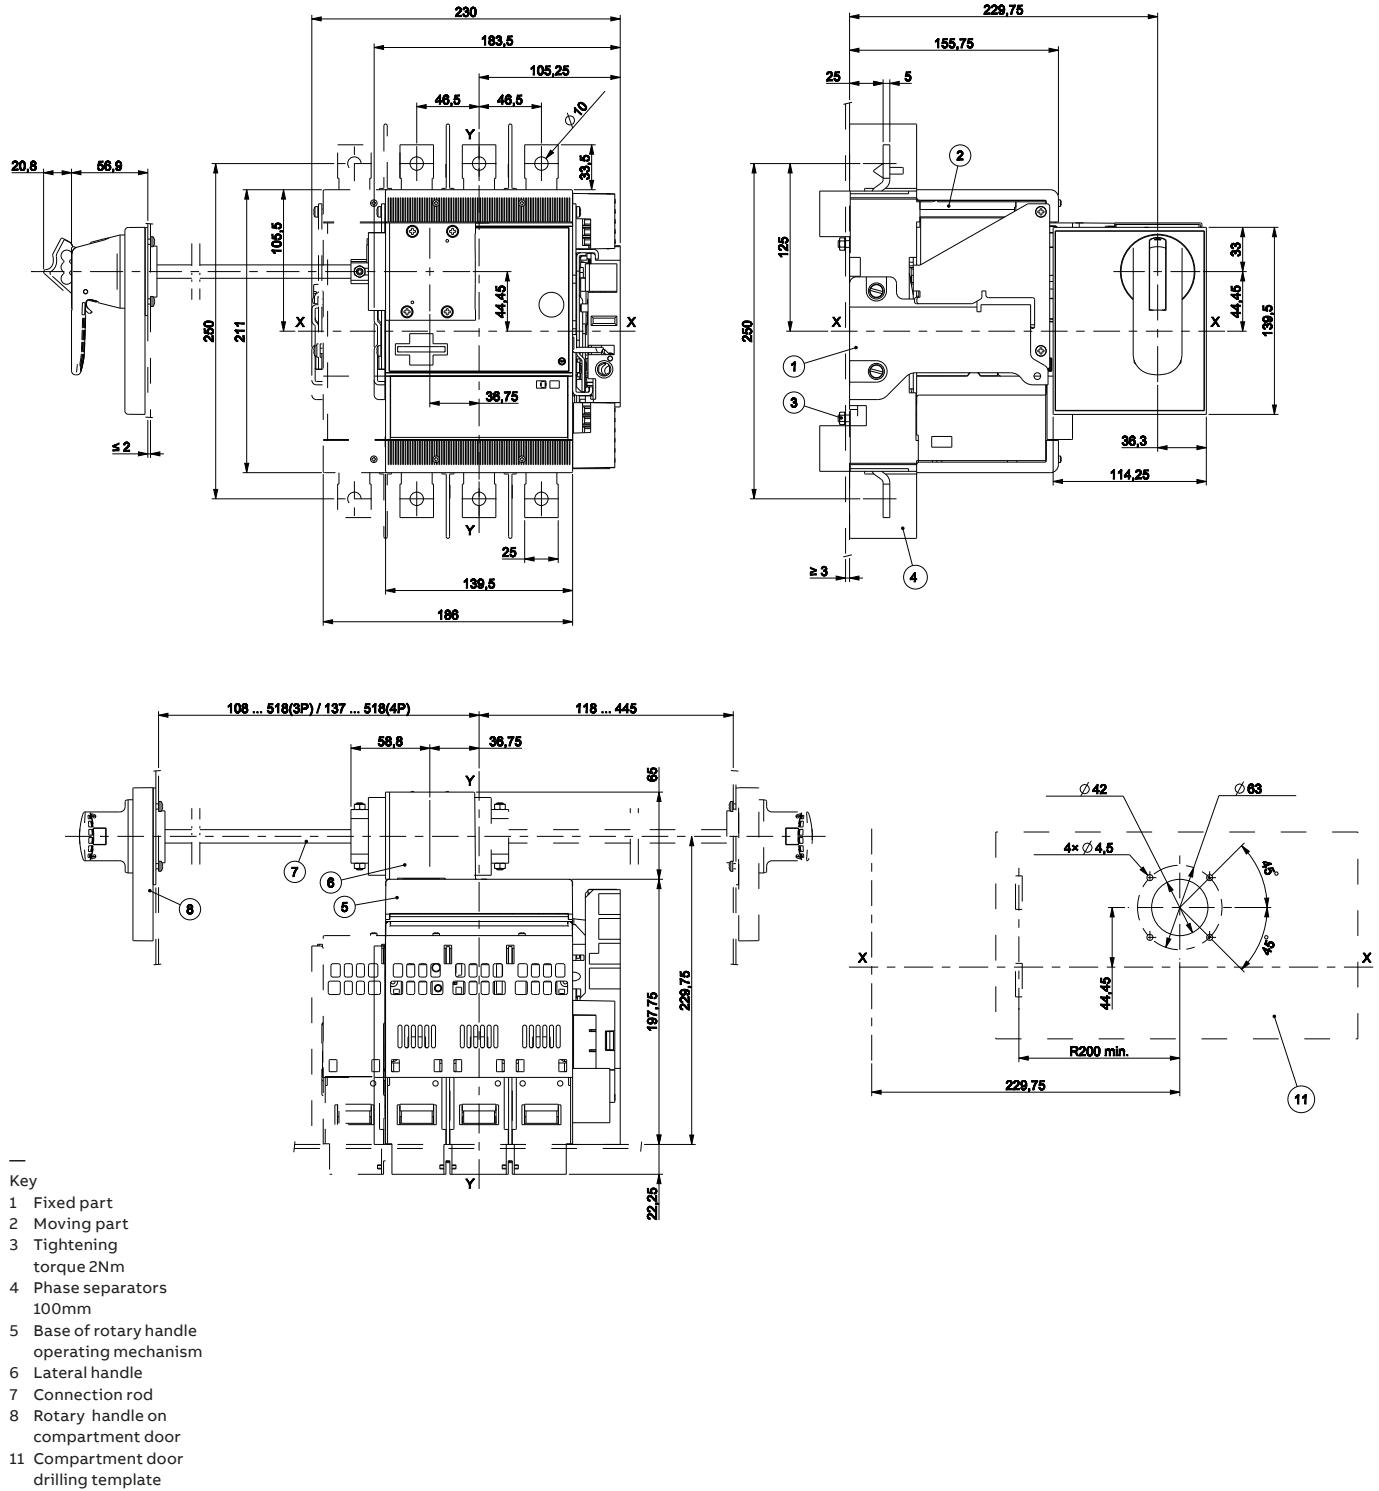

Tmax XT5 – Installation


Accessories for withdrawable circuit-breaker 400A

Stored energy motor operator (MOE)

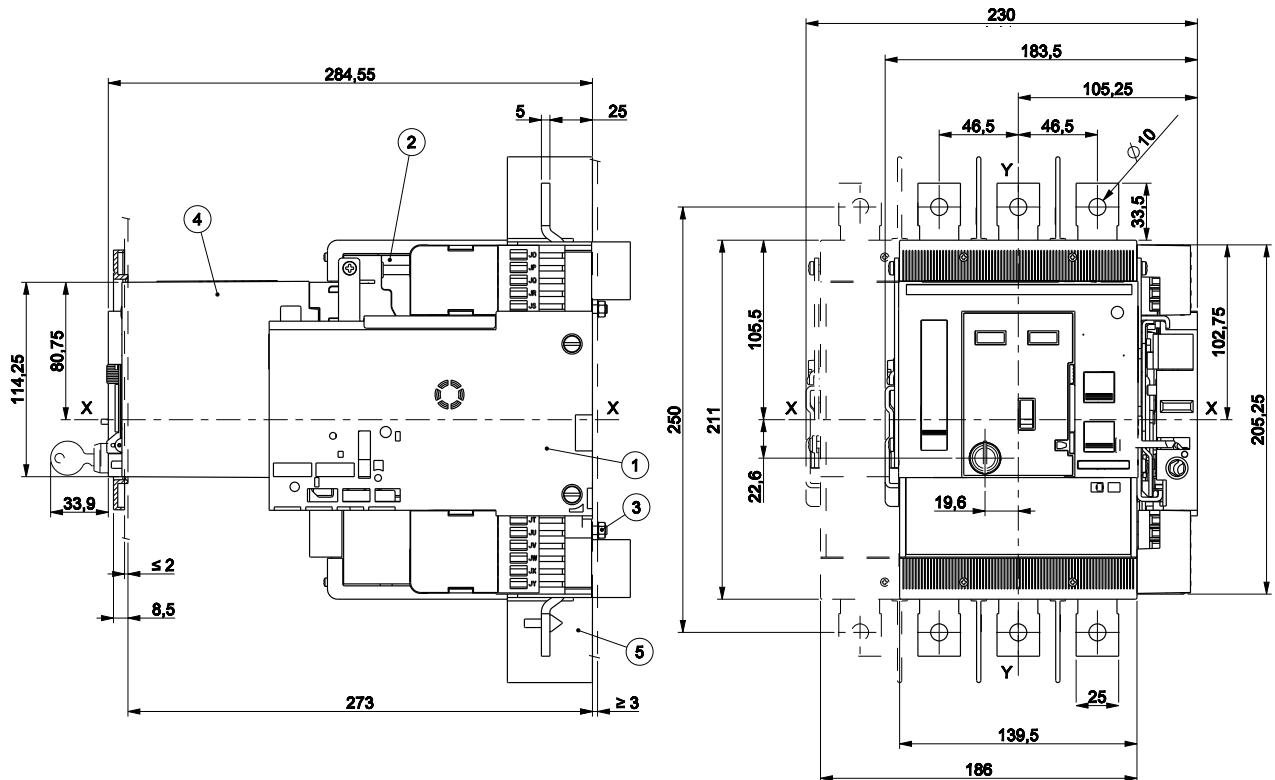


Drilling templates for support sheet


| Key | |
|-----|------------------------------------|
| 1 | Fixed part |
| 2 | Moving part |
| 3 | Tightening torque 2Nm |
| 4 | Stored energy motor operator (MOE) |
| 5 | Phase separators 100mm |
| 8 | Drilling template 3p |
| 9 | Drilling template 4p |

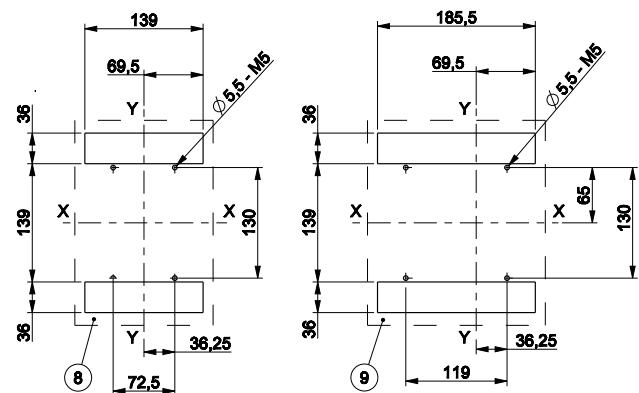

Flange

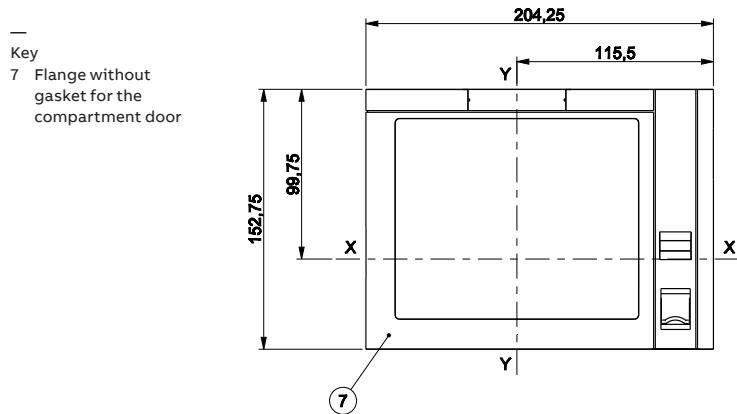


Drilling template compartment door

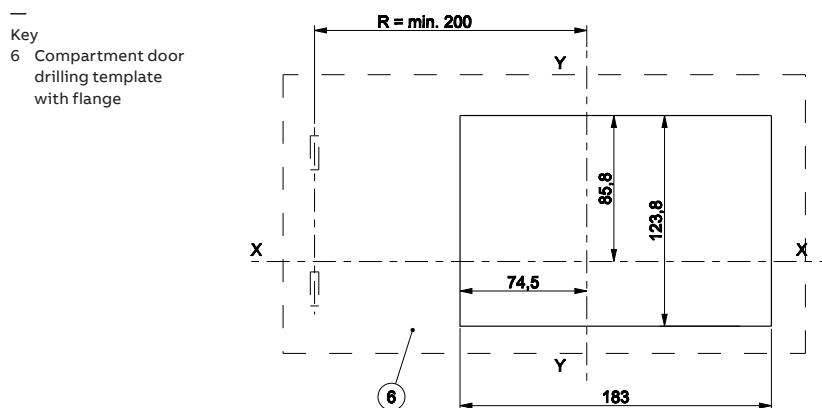



Tmax XT5 – Installation

Accessories for withdrawable circuit-breaker 400A

Rotary handle operating mechanism on the compartment door (RHE)

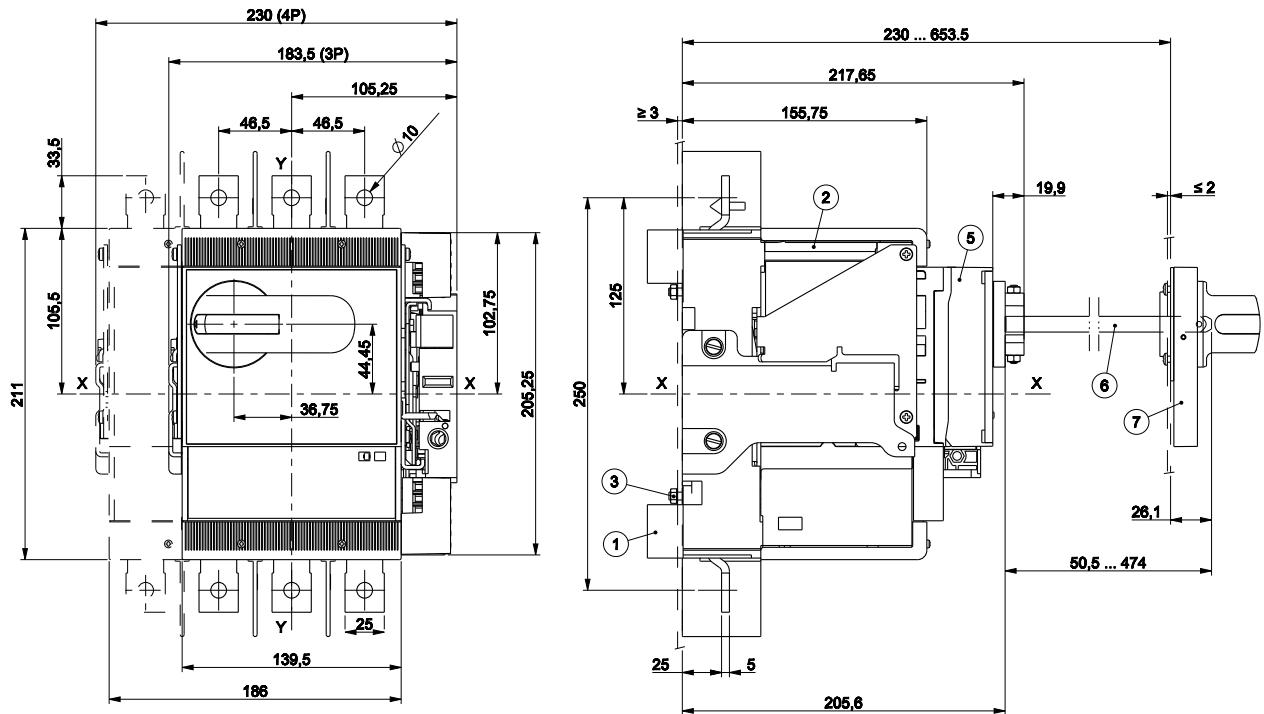


- Key
- 1 Fixed part
 - 2 Moving part
 - 3 Tightening torque 2Nm
 - 4 Phase separators 100mm
 - 5 Rotary handle operating mechanism base (RHE_B)
 - 6 Connection rod (RHE_S)
 - 7 Rotary handle on compartment door (RHE_H)
 - 8 Compartment door drilling template

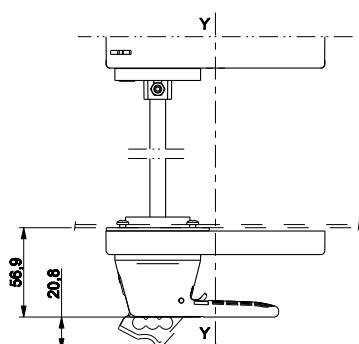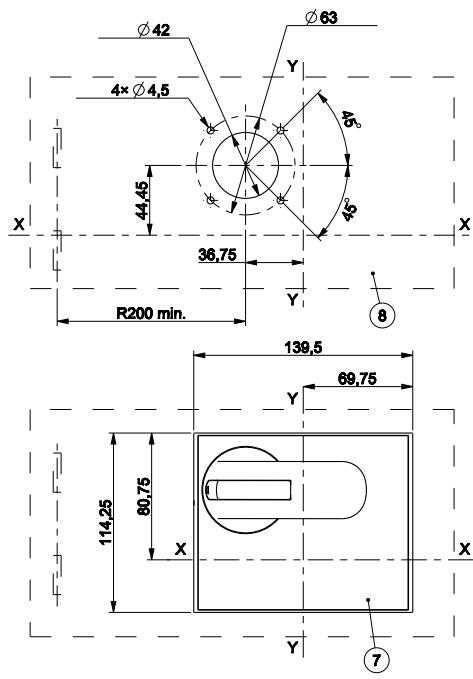

Tmax XT5 – Installation


Installation for withdrawable circuit-breaker 630A

Fixing on sheet

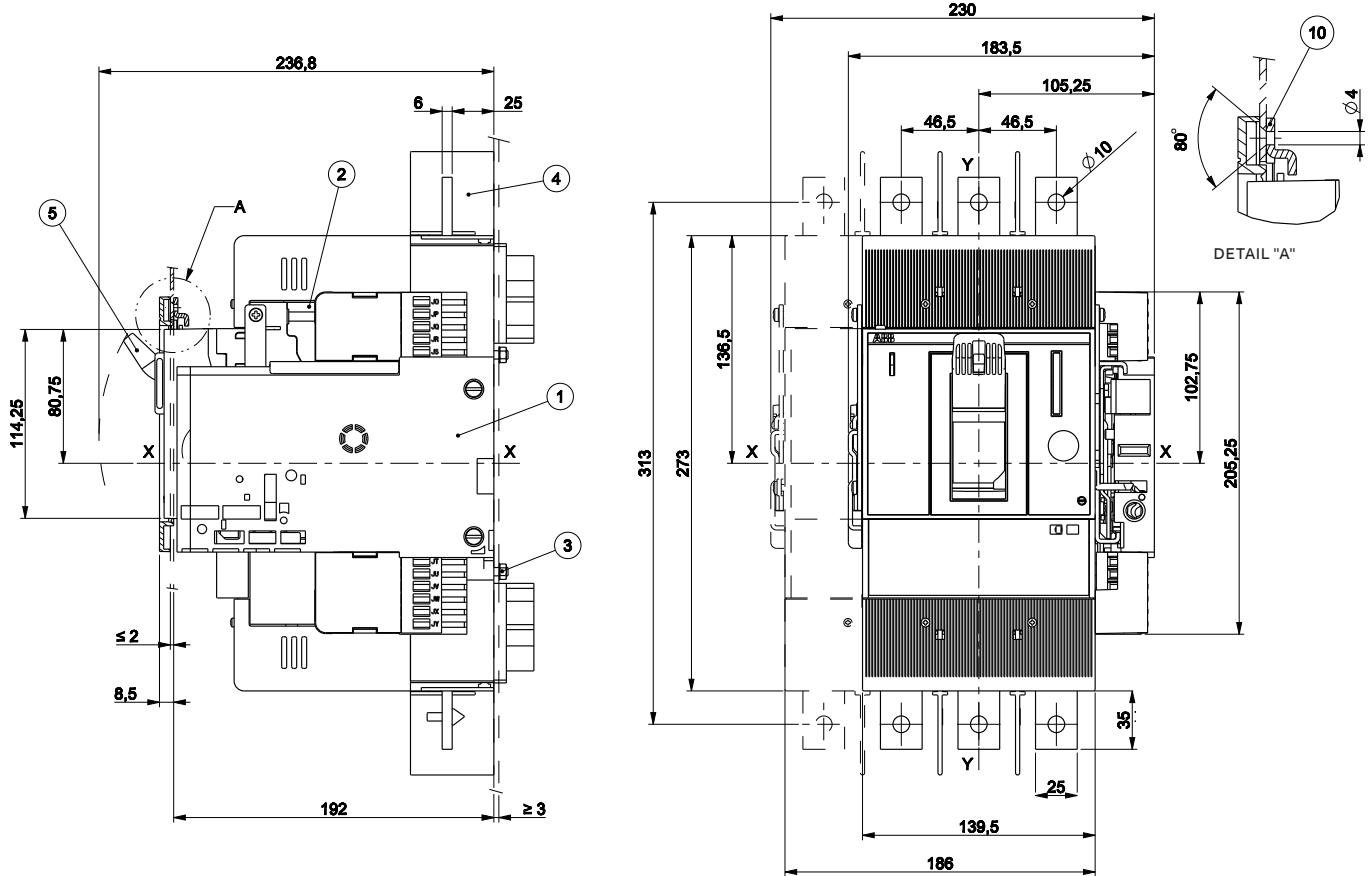

Drilling templates for support sheet

| Key | |
|-----|--|
| 1 | Fixed part |
| 2 | Moving part |
| 3 | Tightening torque 2Nm |
| 4 | Phase separators 100mm |
| 5 | Front for lever operating mechanism |
| 8 | Drilling template 3p |
| 9 | Drilling template 4p |
| 10 | Door lock |

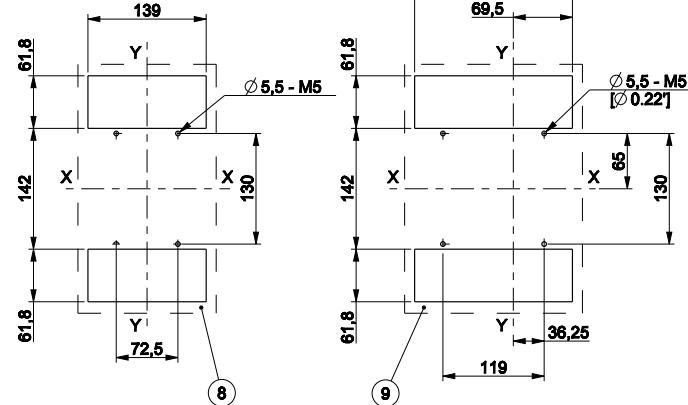


Tmax XT5 – Installation

Installation for withdrawable circuit-breaker 630A


Flange

—
Key
7 Flange without gasket for the compartment door

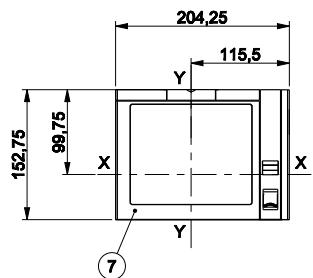

Drilling template compartment door


—
Key
6 Compartment door drilling template with flange

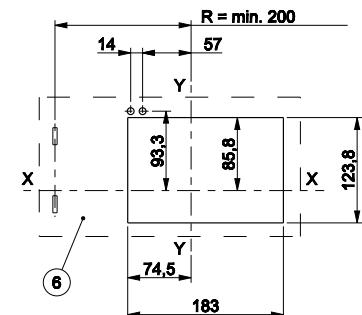

Tmax XT5 – Installation

Terminals for withdrawable circuit-breaker 630A

Terminals EF

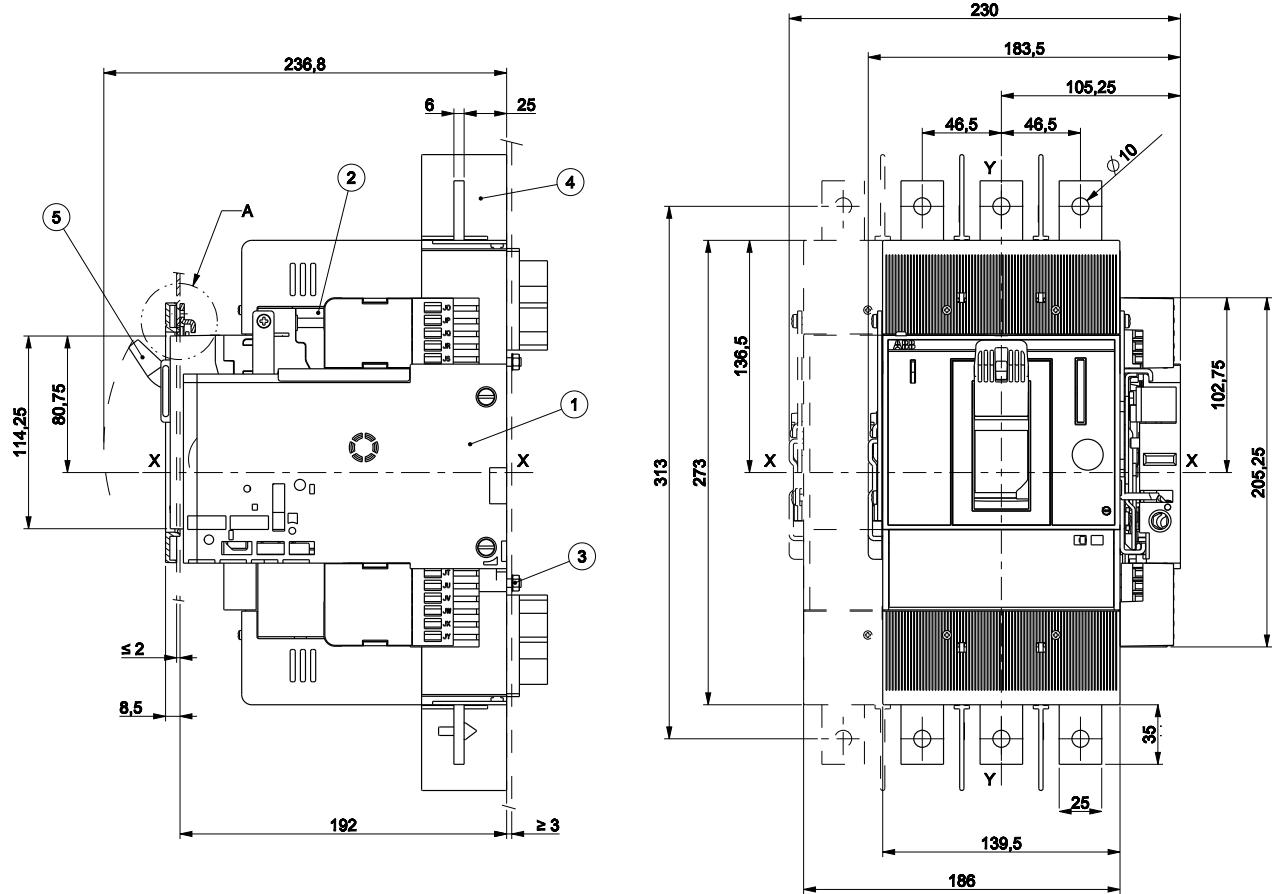


—
Key

- 1 Fixed part
- 2 Moving part
- 3 Tightening torque 2Nm
- 4 Phase separators 100mm
- 5 Front for lever operating mechanism

Tmax XT5 – Installation

Terminals for withdrawable circuit-breaker 630A


Terminals HR

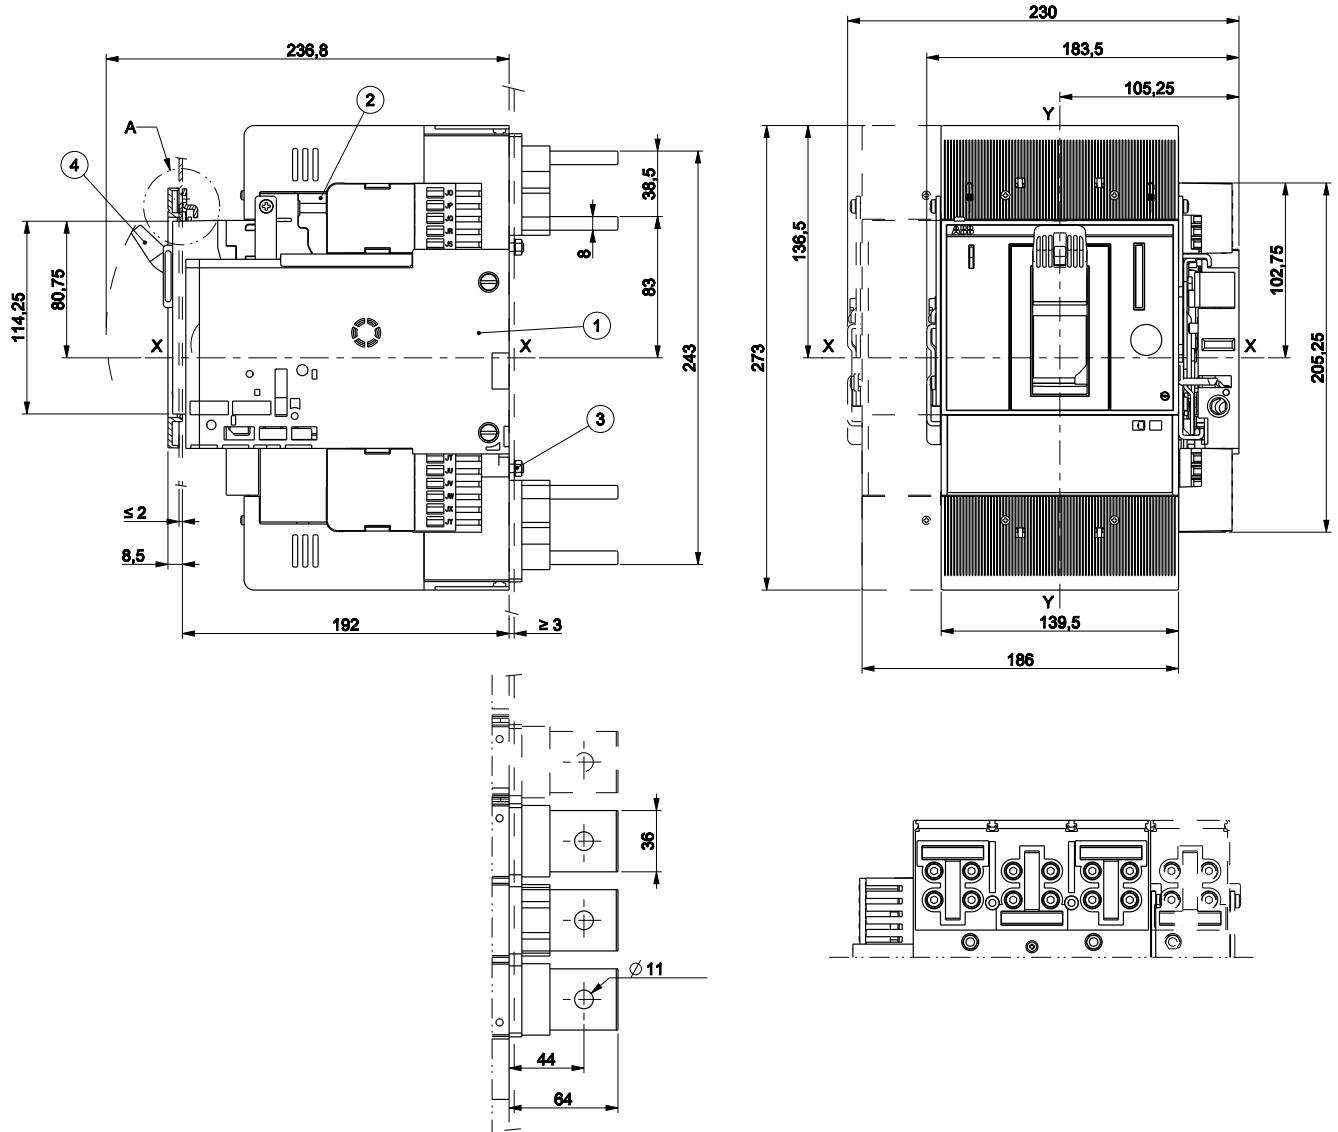

Key

- 1 Fixed part
- 2 Moving part
- 3 Tightening torque 2Nm
- 4 Front for lever operating mechanism

Terminals VR

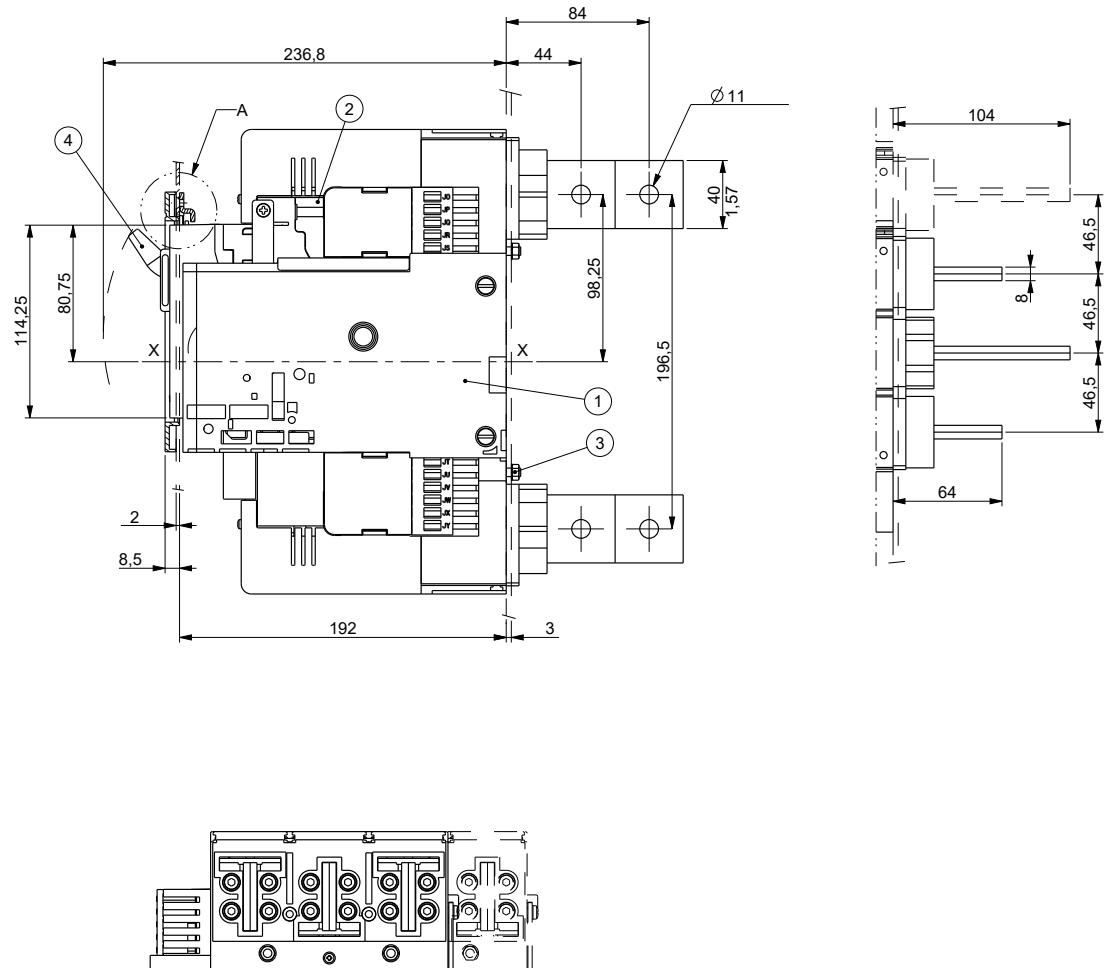


—
Key
 1 Fixed part
 2 Moving part
 3 Tightening torque 2Nm
 4 Front for lever operating mechanism (FLD)


Tmax XT5 – Installation

Terminals for withdrawable circuit-breaker 630A


Residual current (RC) and Front for lever operating mechanism (FLD)

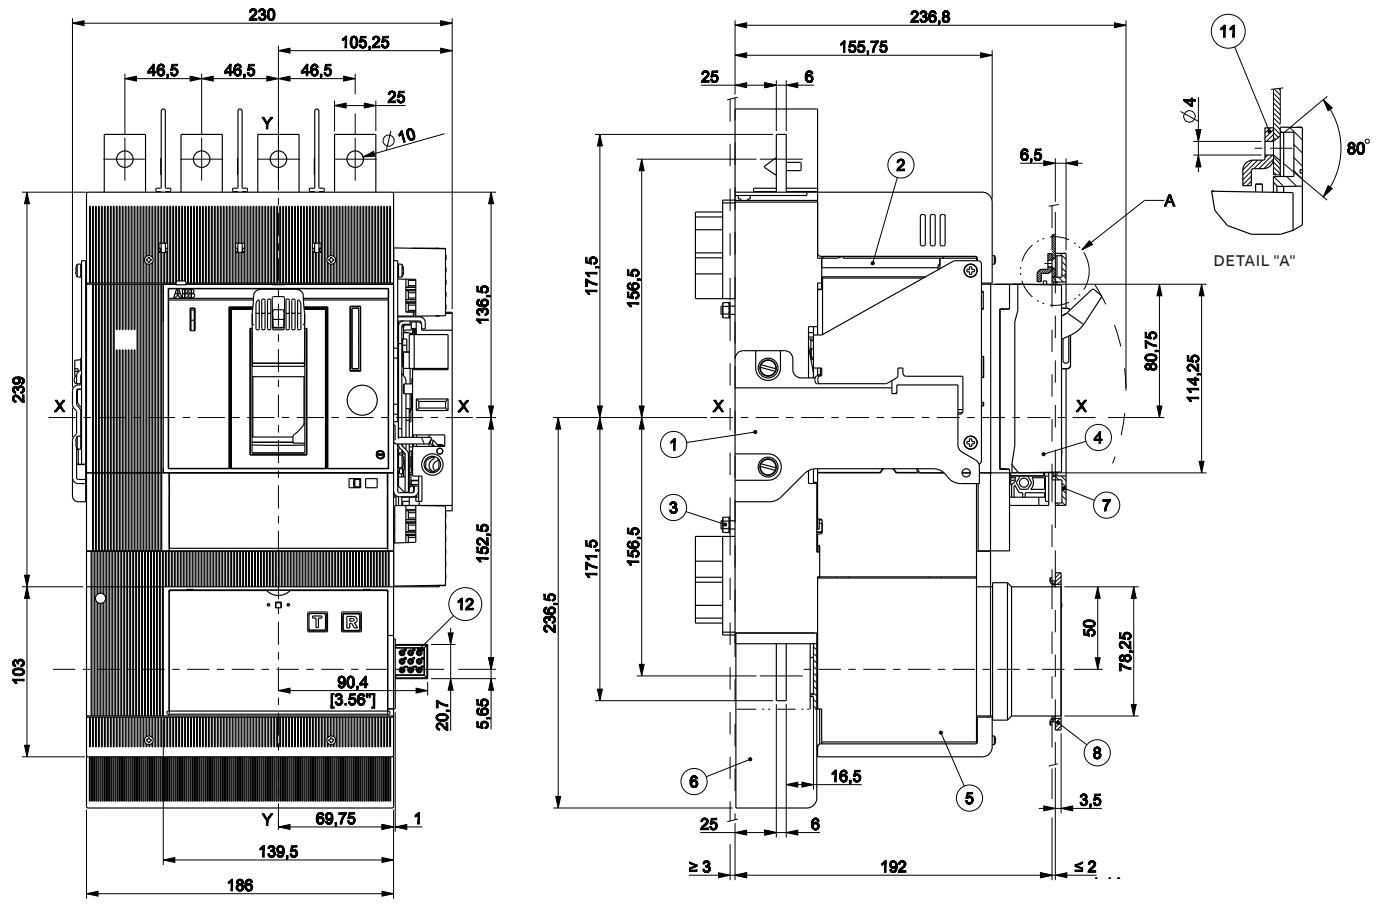


- Key
- 1 Fixed part
 - 2 Moving part
 - 3 Tightening torque 2Nm
 - 4 Front for operating lever mechanism
 - 5 Residual current release
 - 6 Terminal cover for residual current release
 - 7 Flange for the compartment door
 - 8 Flange for residual current release
 - 11 Door lock plate
 - 12 Plug and socket adapter for residual current release

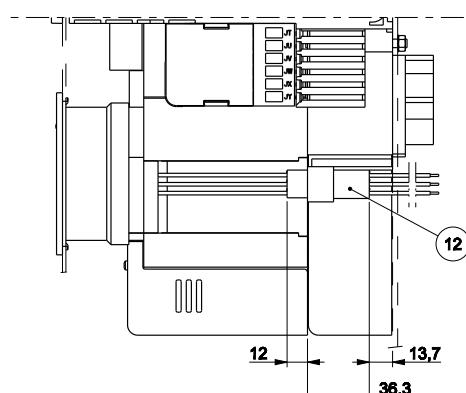


Drilling template for support sheet

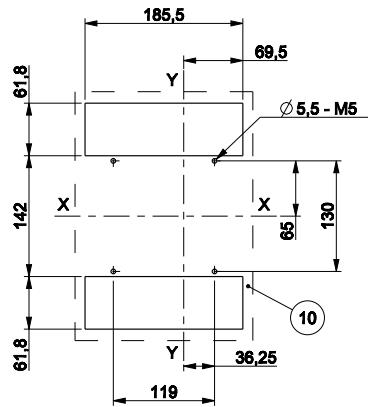

Flange

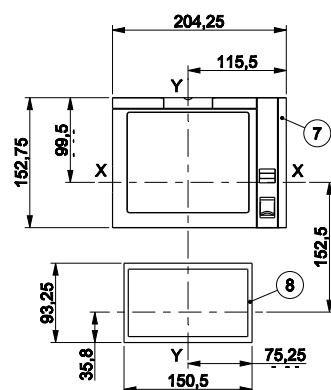

Drilling template compartment door

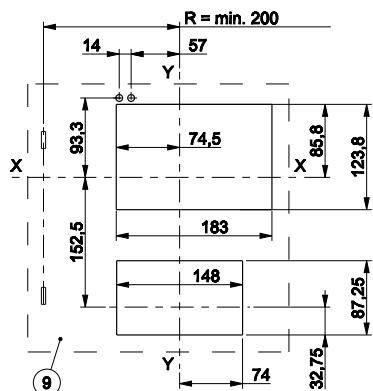


Key

- 7 Flange for the compartment door
- 8 Flange for residual current release
- 9 Compartment door drilling template with/without flange
- 10 Fixing on sheet steel

Tmax XT5 – Installation


Accessories for withdrawable circuit-breaker 630A

Rotary handle operating mechanism on the circuit-breaker (RHD)

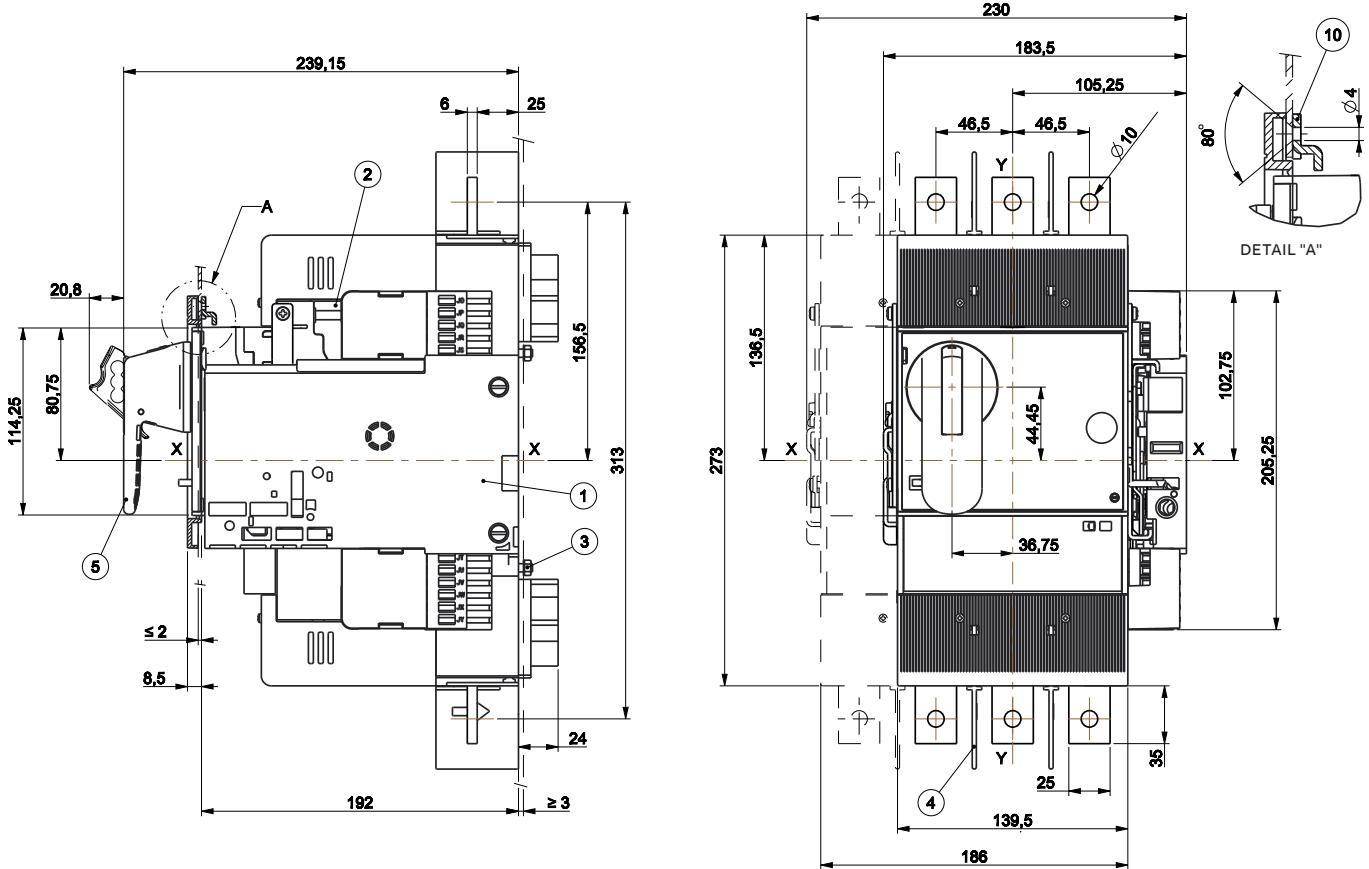


Drilling templates for support sheet

| Key | |
|-----|---|
| 1 | Fixed part |
| 2 | Moving part |
| 3 | Tightening torque 2Nm |
| 4 | Phase separators 100mm |
| 5 | Rotary handle operating mechanism (RHD) |
| 8 | Drilling template 3p |
| 9 | Drilling template 4p |
| 10 | Door lock |

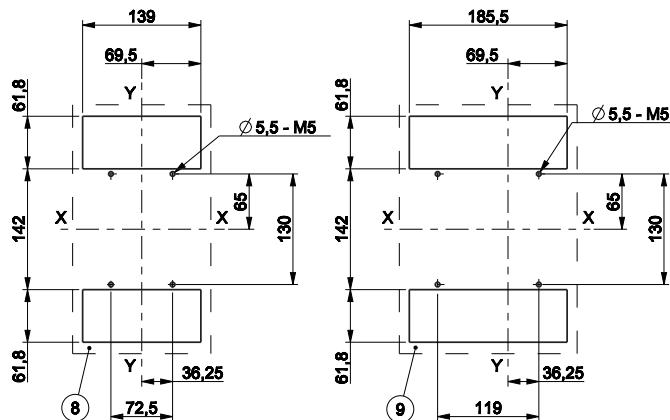


Flange

—
Key
7 Flange without
gasket for the
compartment door

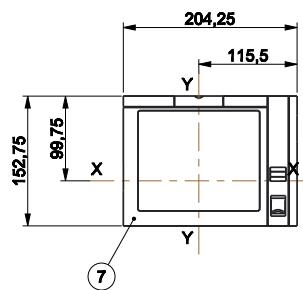

Drilling template compartment door


—
Key
6 Compartment door
drilling template
with flange

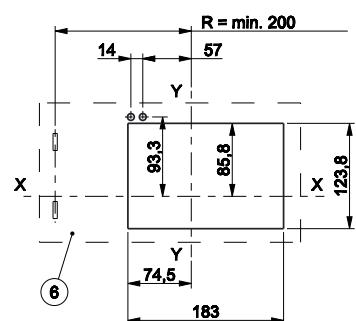

Tmax XT5 – Installation


Accessories for withdrawable circuit-breaker 630A

Lateral rotary handle operating mechanism on the compartment door (RHL)

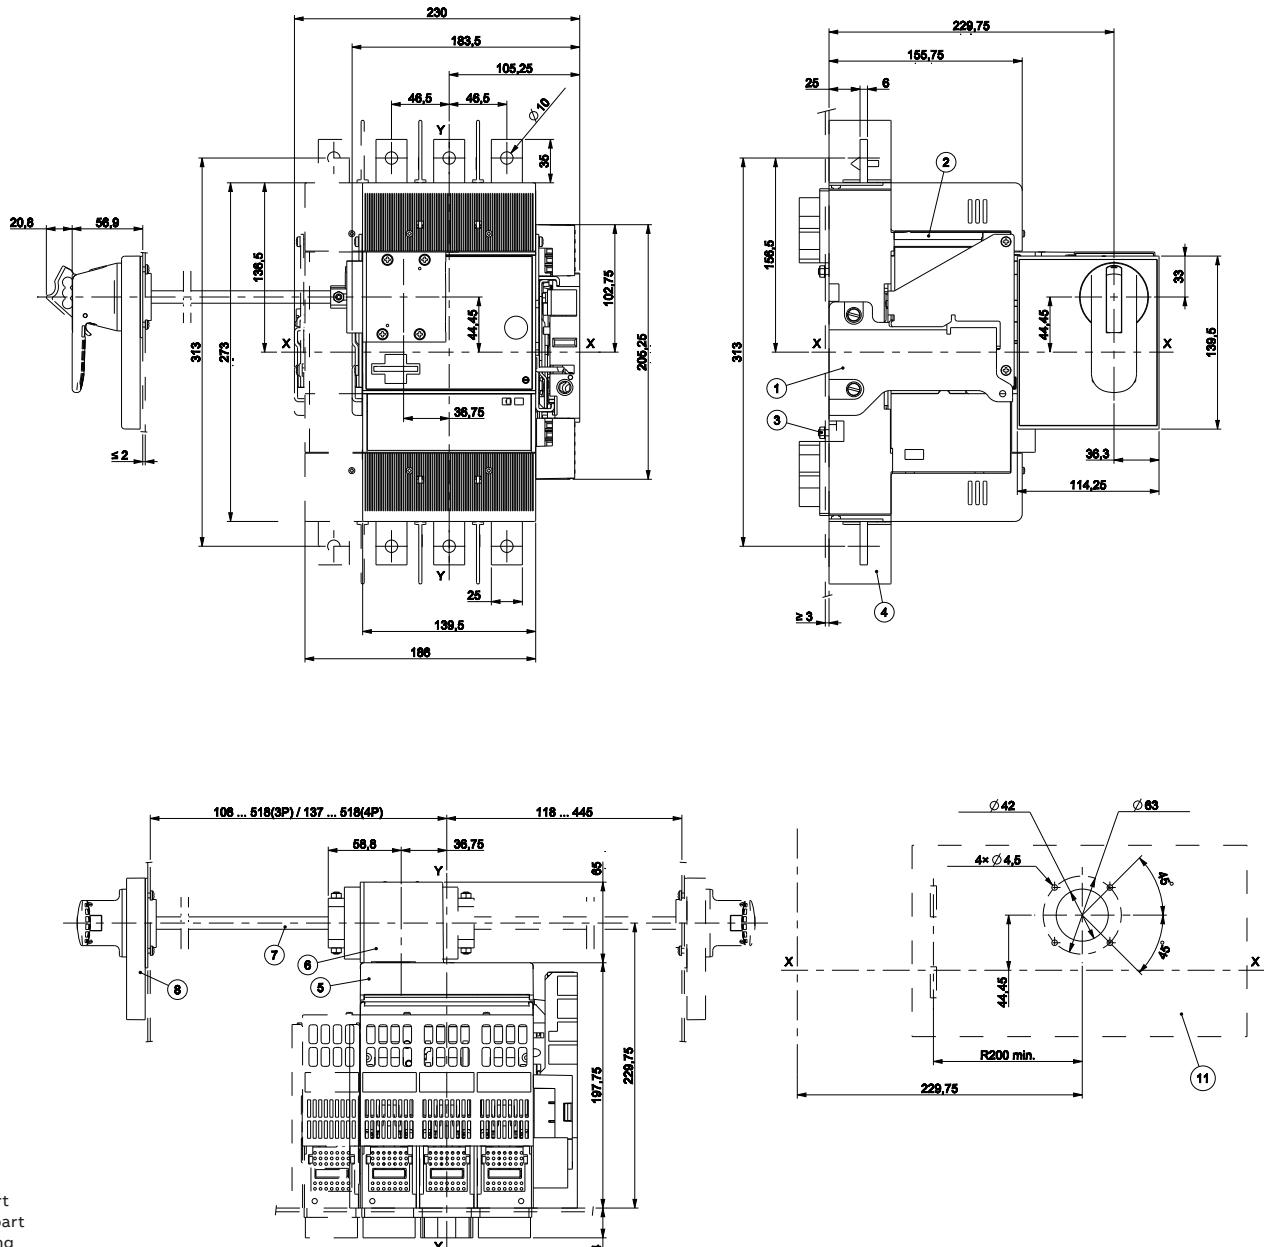


- **Key**
 - 1 Fixed part
 - 2 Moving part
 - 3 Tightening torque 2Nm
 - 4 Phase separators 100mm
 - 5 Base of rotary handle operating mechanism
 - 6 Lateral handle
 - 7 500mm Connection rod
 - 8 Rotary handle on compartment door
 - 11 Compartment door drilling template

Stored energy motor operator (MOE)

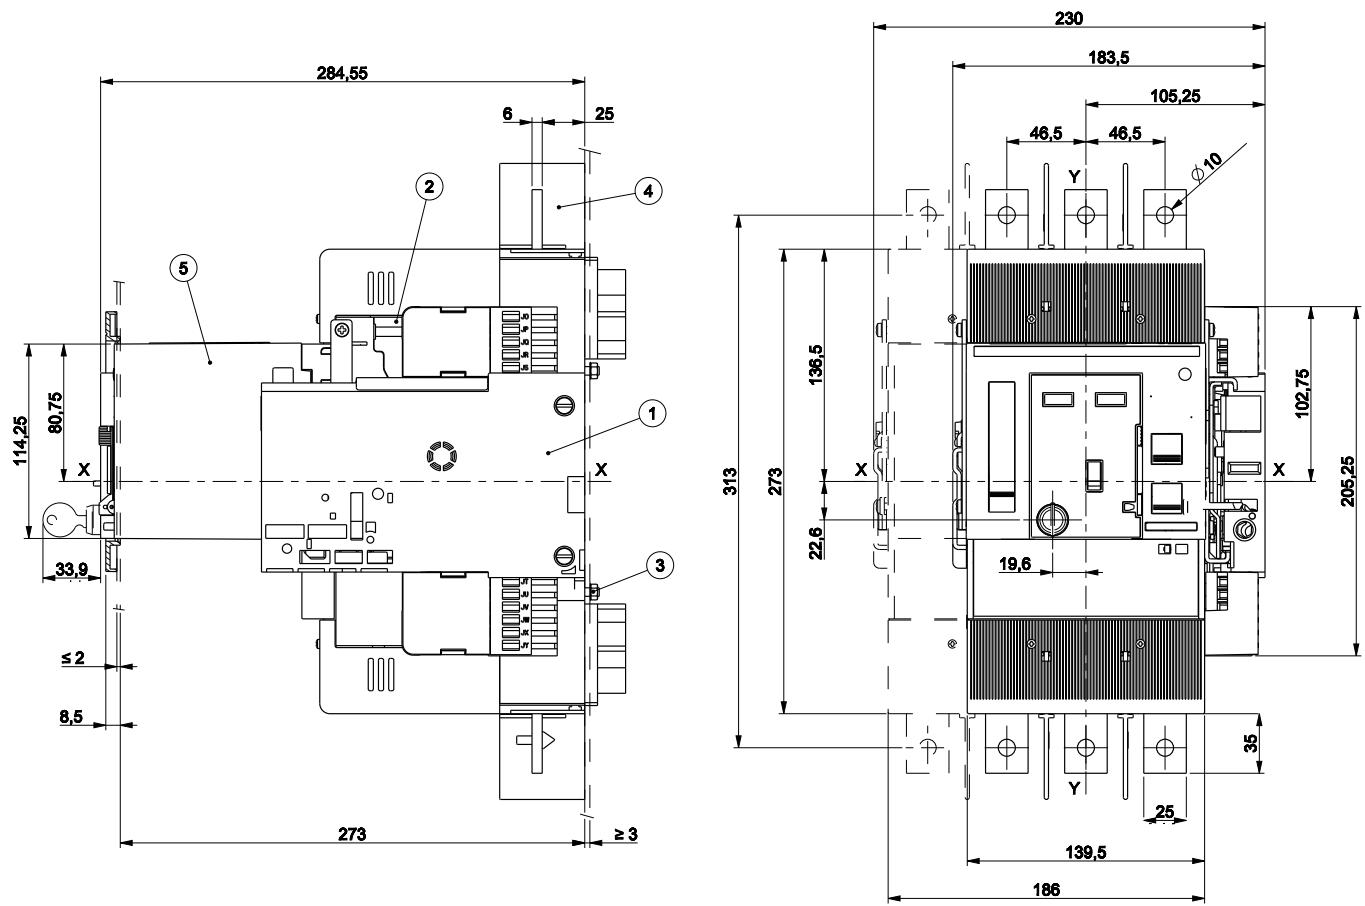

Drilling templates for support sheet

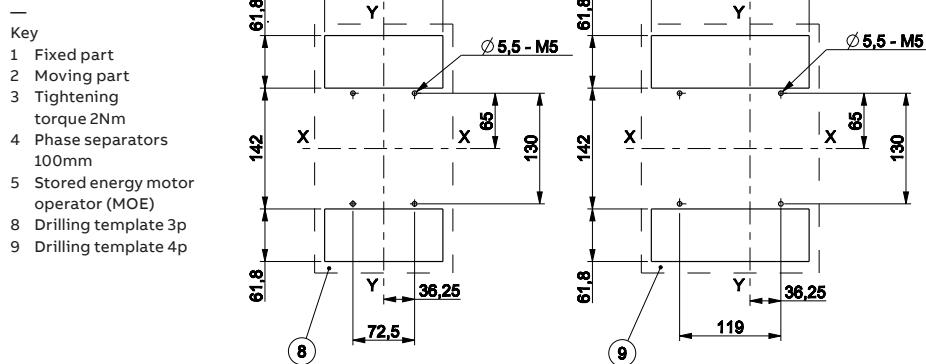


Tmax XT5 – Installation

Accessories for withdrawable circuit-breaker 630A


Flange

—
Key
7 Flange without gasket for the compartment door

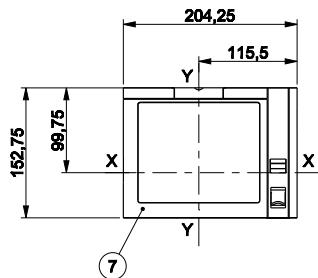


Drilling template compartment door

—
Key
6 Compartment door drilling template with flange

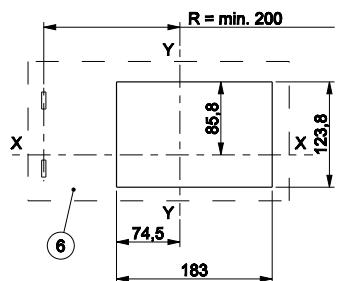

Rotary handle operating mechanism on the compartment door (RHE)

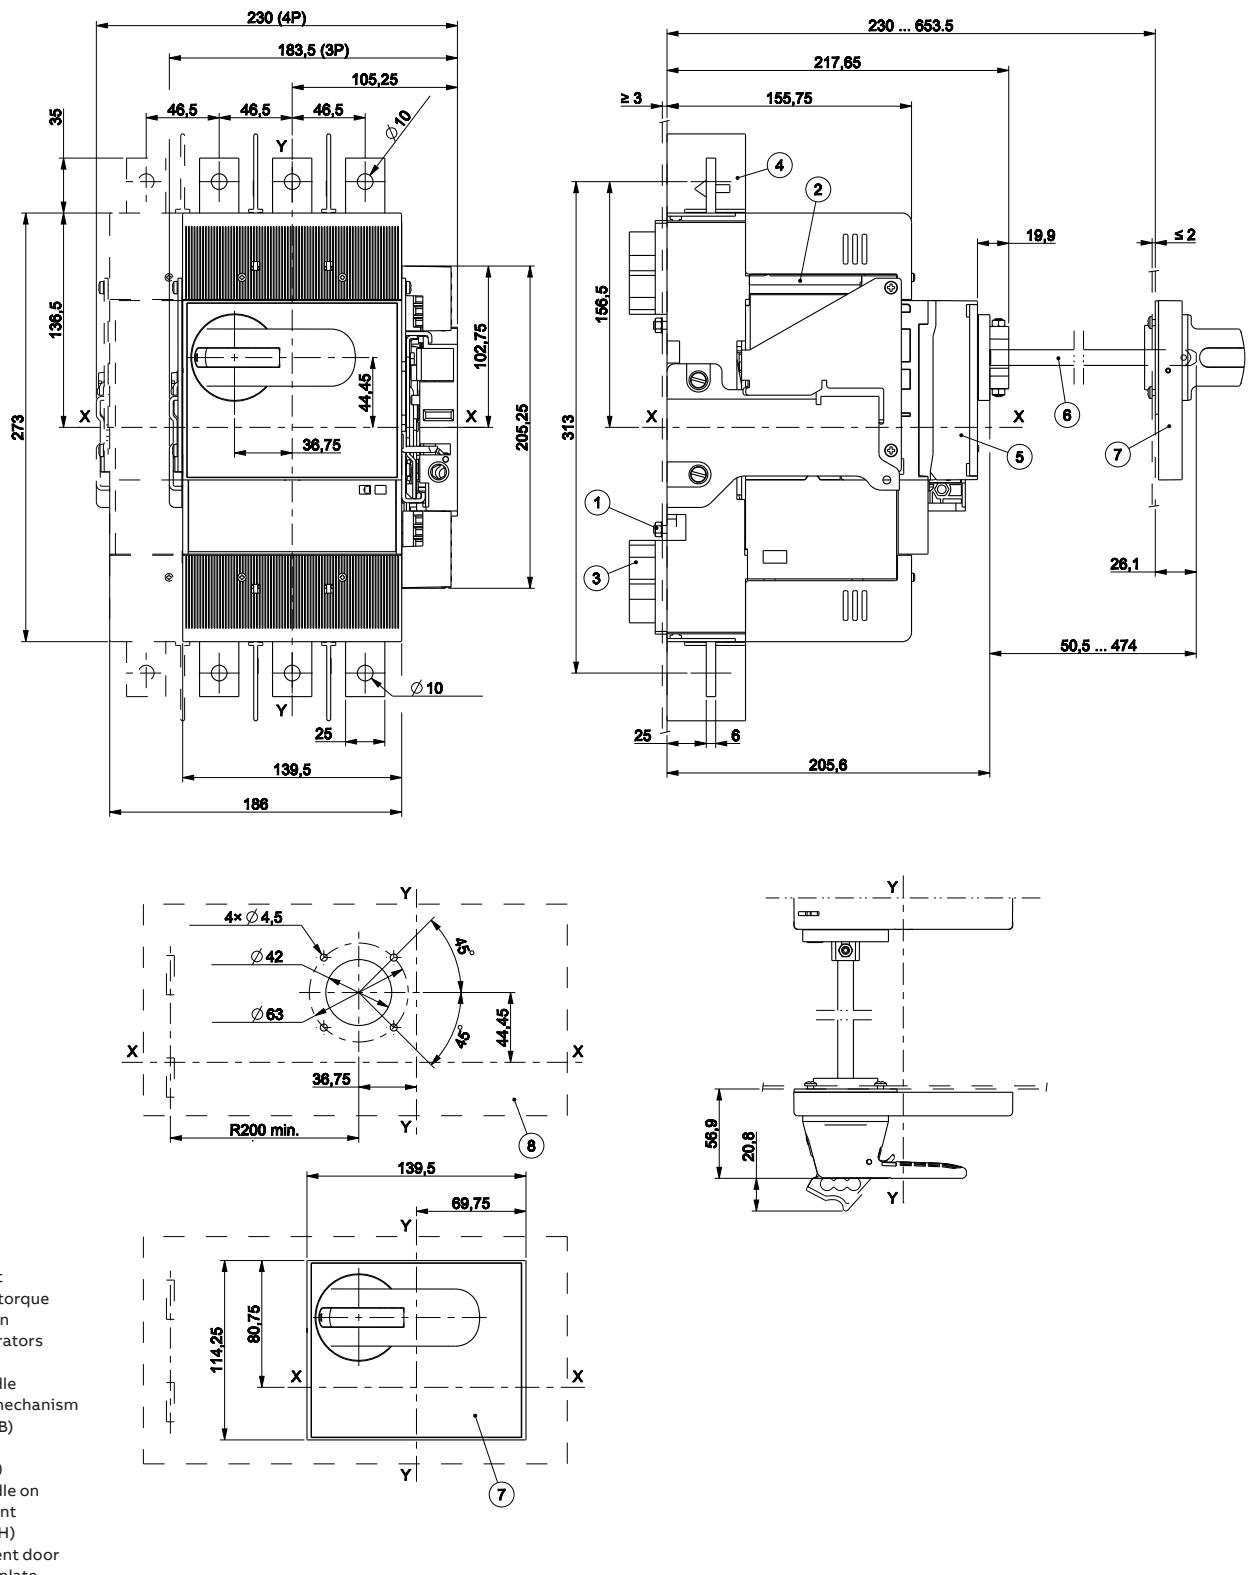


Tmax XT6 – Installation

Installation for fixed circuit-breaker

Fixing on sheet


- Key
 1 Front terminals for flat connection
 2 Busbar
 6 Tightening torque 9Nm
 7 Tightening torque 2Nm
 10 Cable rack

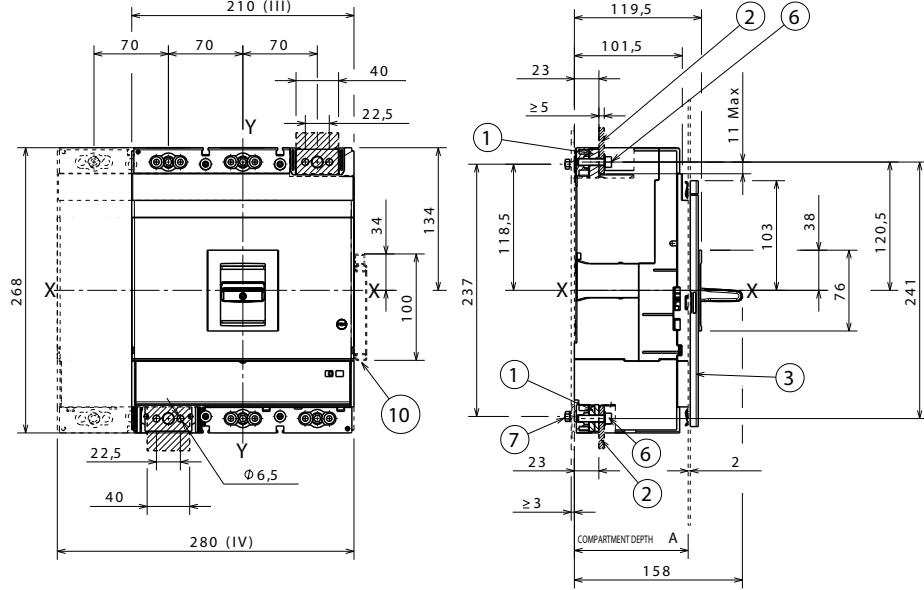

| A [mm] |
|------------------------------|
| With flange 3p - 4p 108 |
| Without flange 3p - 4p 103.5 |


Drilling templates for support sheet

- Key
 4 Drilling template 3p
 5 Drilling template 4p

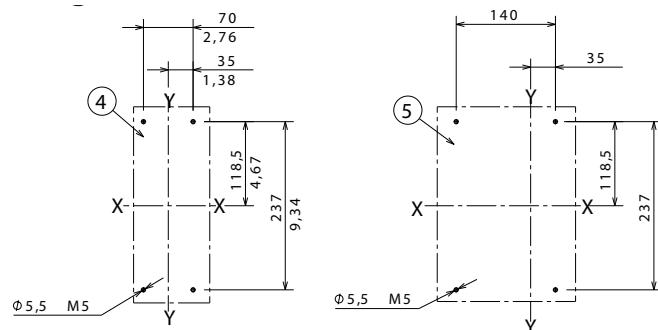


Flange

—
Key
3 Flange without
gasket for
compartment door

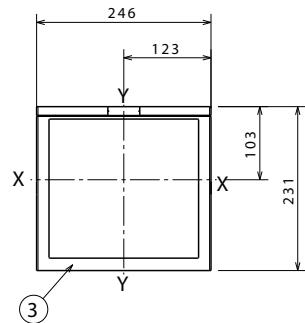

Drilling template compartment door

—
Key
8 Compartment door
drilling template
with/without flange

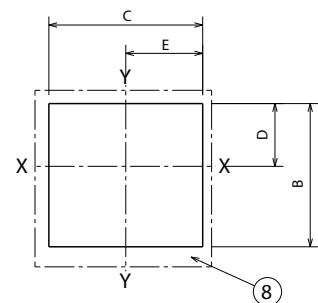


| | A [mm] | B [mm] | C [mm] | D [mm] | E [mm] |
|----------------|---------|--------|--------|--------|--------|
| With flange | 3p - 4p | 108 | 202 | 217 | 88.5 |
| Without flange | 3p - 4p | 103.5 | 197 | 212 | 86 |
| | | | | | 106 |

Tmax XT6 – Installation

Terminals for fixed circuit-breaker

Terminals EF

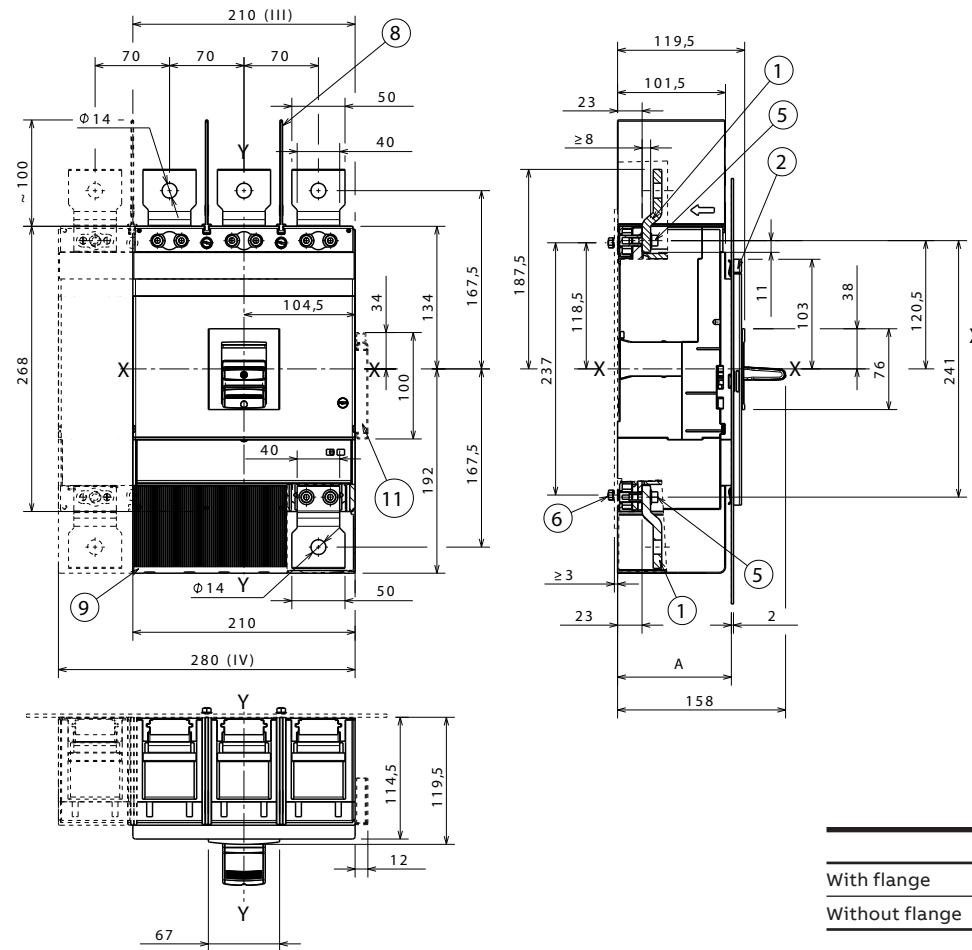


| A [mm] |
|------------------------------|
| With flange 3p - 4p 108 |
| Without flange 3p - 4p 103.5 |

Key

- 1 Extended front terminals
- 5 Tightening torque 9Nm
- 6 Tightening torque 2Nm
- 8 Phase separators 100mm
- 9 High terminal cover with IP40 protection degree
- 11 Cable rack

Terminals ES

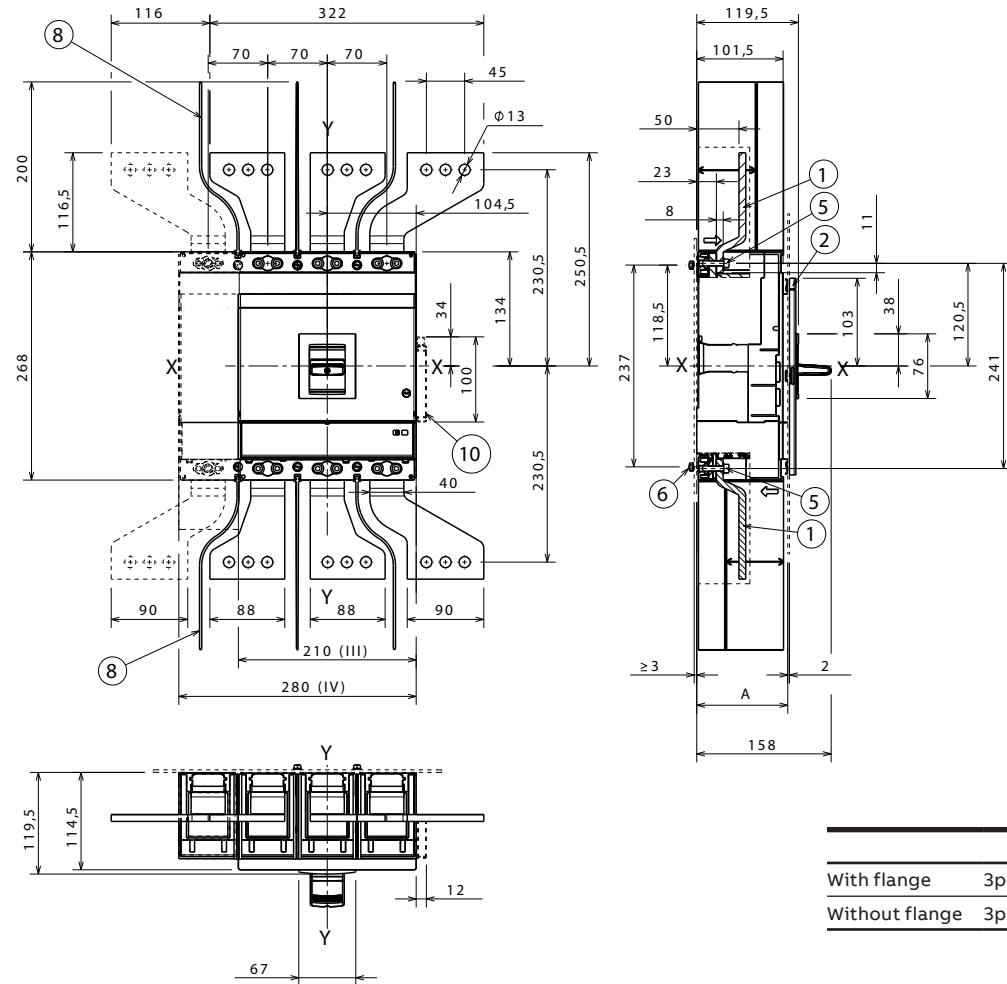


Key

- 1 Extended front terminals
- 5 Tightening torque 9Nm
- 6 Tightening torque 2Nm
- 8 Phase separators 200mm
- 10 Cable rack

Tmax XT6 – Installation

Terminals for fixed circuit-breaker



2 x 120...240mm² and 3 x 70...185mm² terminals FC CuAl

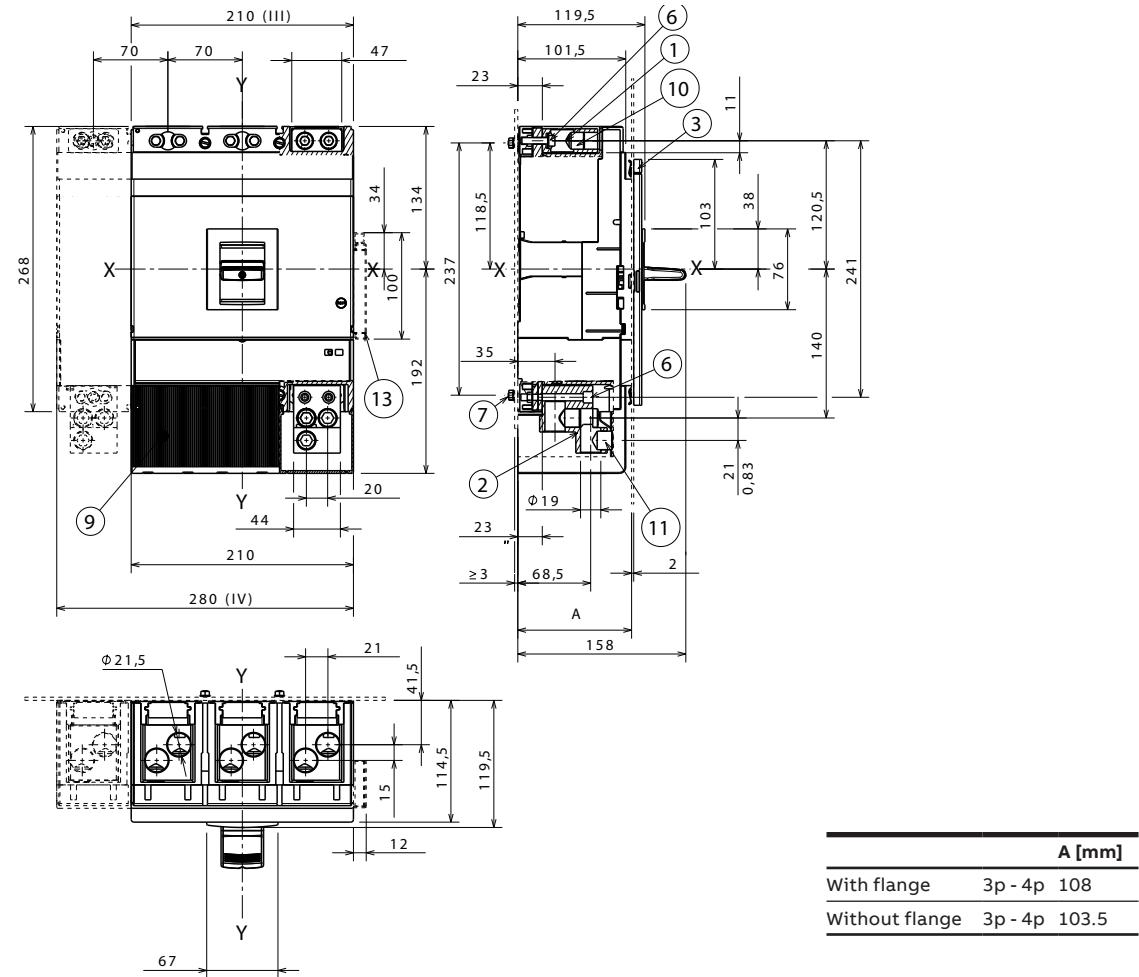

Key

- 1 Terminal FCCuAl 630A
- 2 Terminal FCCuAl 800A
- 6 Tightening
torque 9Nm
- 7 Tightening
torque 2Nm
- 9 High terminal
cover with IP40
protection degree
- 10 Tightening
torque 31Nm
- 11 Tightening
torque 43Nm
- 13 Cable rack

Terminals EF and 4 x 70...150mm² terminals FC CuAl (1000A)

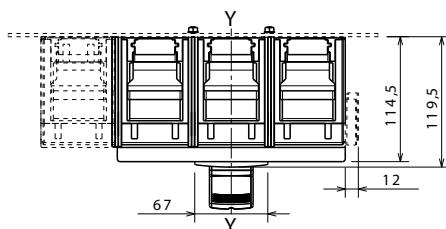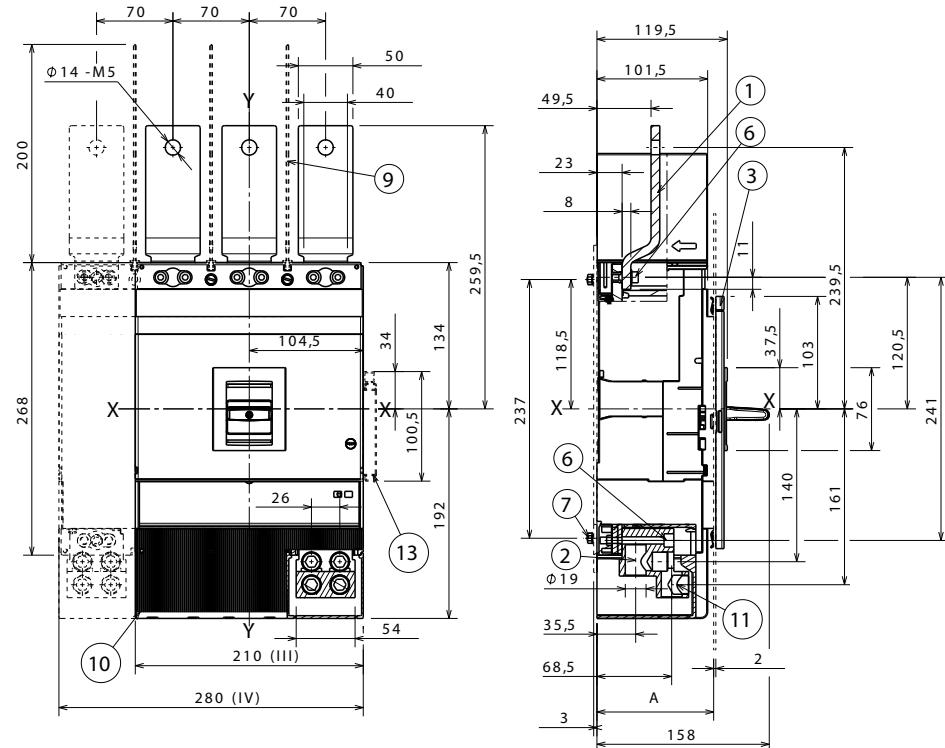


| | A [mm] |
|----------------|---------------|
| With flange | 3p - 4p 108 |
| Without flange | 3p - 4p 103.5 |

- Key
- 1 Extended front terminals
 - 2 Terminal FCCuAl 1000A
 - 6 Tightening torque 9Nm
 - 7 Tightening torque 2Nm
 - 9 Phase separators 200mm
 - 10 High terminal cover with IP40 protection degree
 - 11 Tightening torque 43Nm
 - 13 Cable rack


Tmax XT6 – Installation

Terminals for fixed circuit-breaker

Terminals R

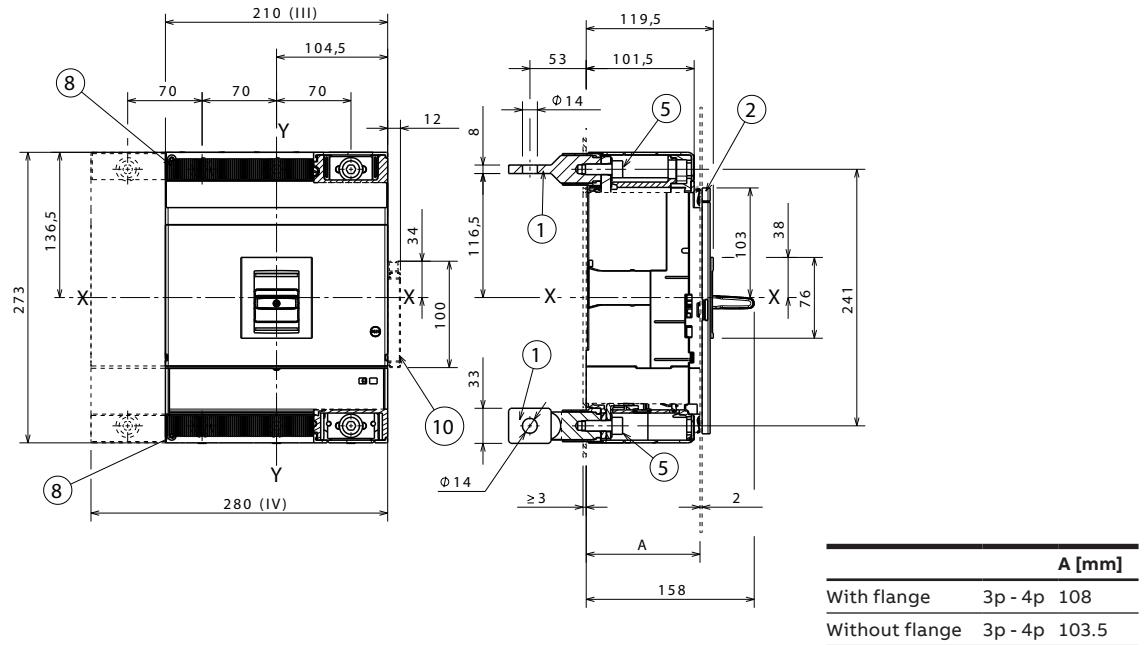


Terminals HR upper

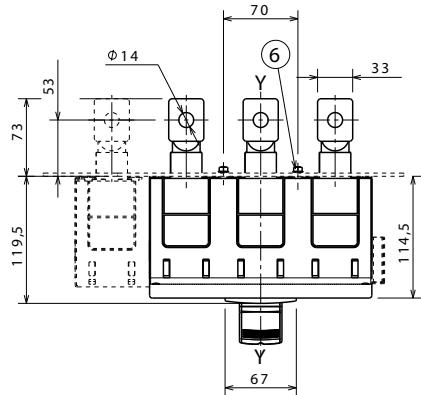

Key

- 1 Rear terminals
(horizontal or vertical)
- 5 Tightening
torque 18Nm
- 6 Tightening torque 2Nm
- 8 Terminals cover with
IP20 protection degree
(included in the supply
of rear terminals)
- 10 Cable rack

Terminals VR lower

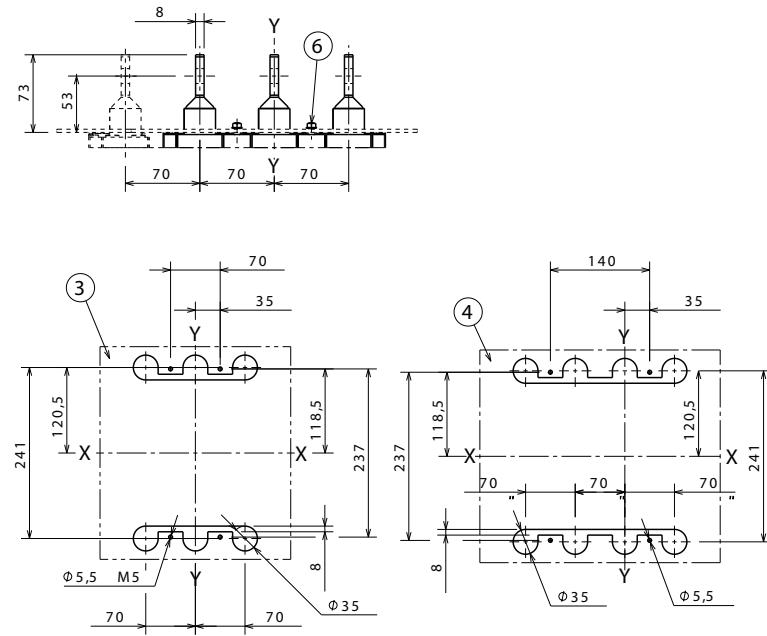


Key

- 3 Drilling template 3p
- 4 Drilling template 4p
- 6 Tightening torque 2Nm


Tmax XT6 – Installation

Accessories for fixed circuit-breaker


Rotary handle operating mechanism on the circuit-breaker (RHD)

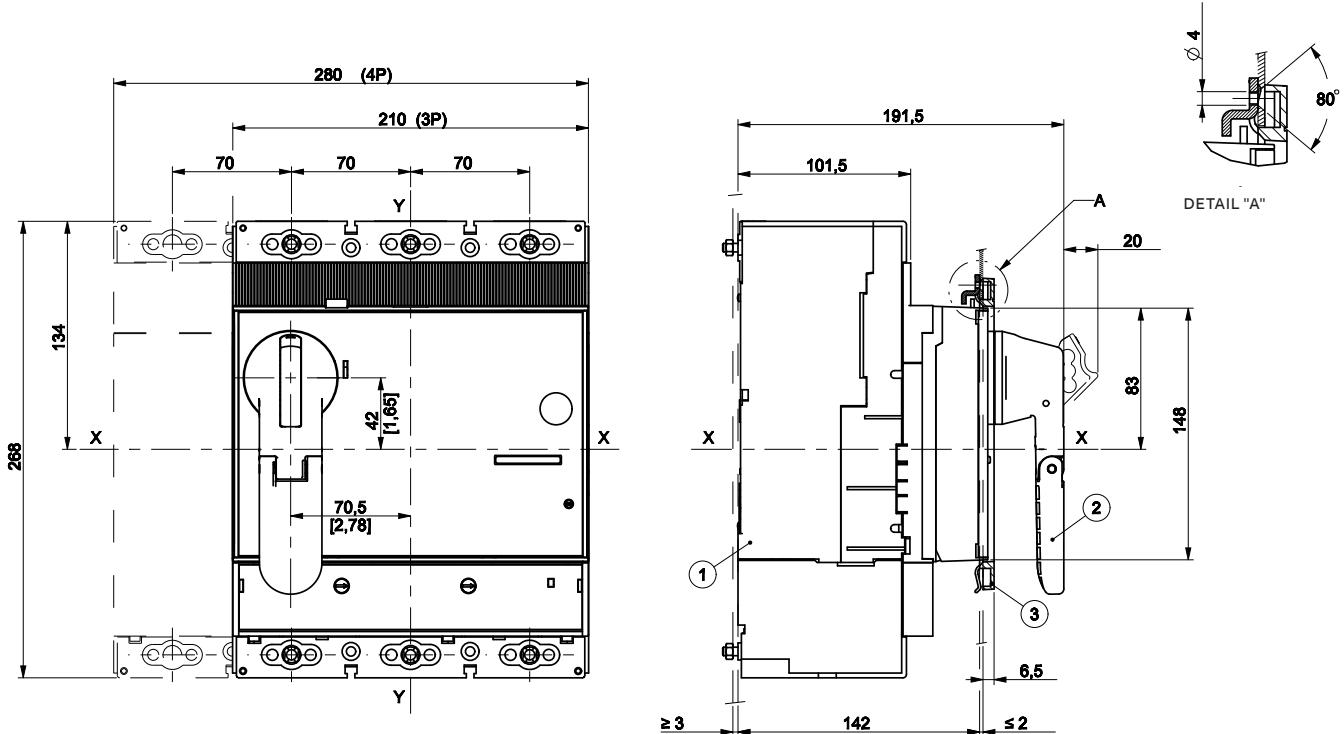


Drilling templates for support sheet

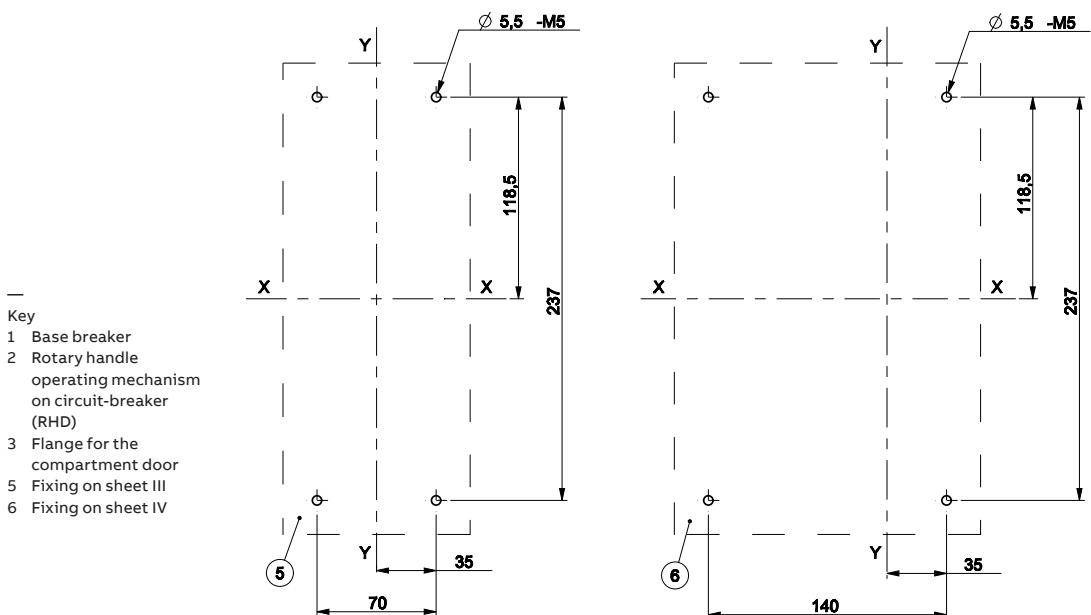

Flange

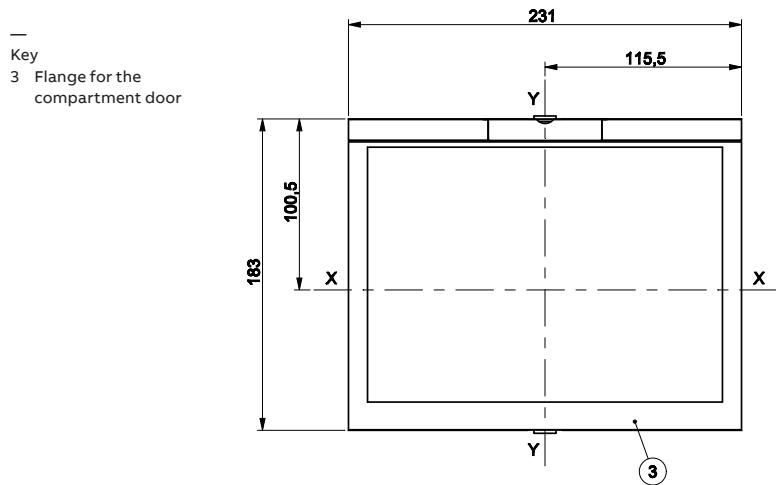

Drilling template compartment door

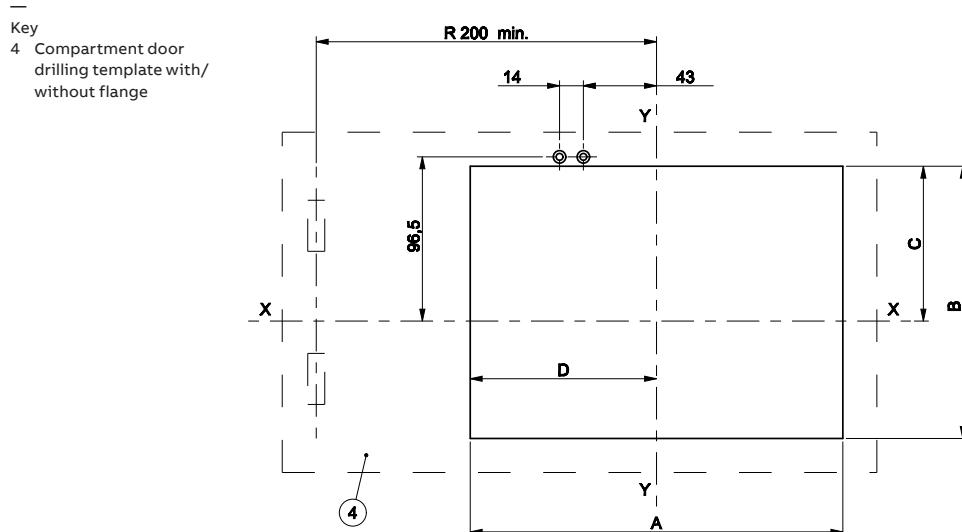


| | A [mm] | B [mm] | C [mm] | D [mm] |
|----------------|-------------|--------|--------|--------|
| With flange | 3p - 4p 219 | 160 | 89 | 109.5 |
| Without flange | 3p - 4p 209 | 149.8 | 83.9 | 104.5 |


Tmax XT6 – Installation

Accessories for fixed circuit-breaker

Stored energy motor operator (MOE)

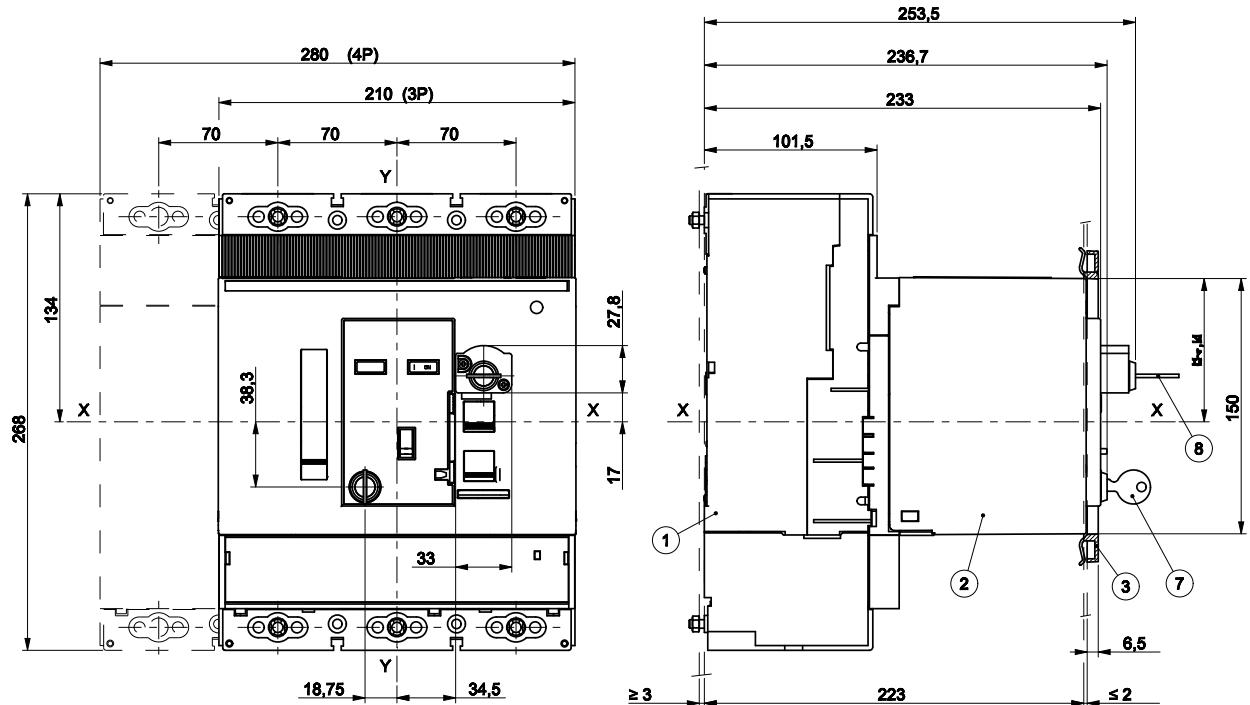


Drilling templates for support sheet

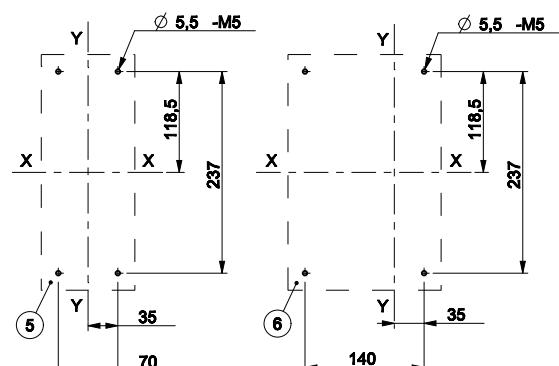

- Key
- 1 Circuit-breaker
 - 2 Rotary handle operating mechanism on circuit-breaker (RHD)
 - 3 Flange for the compartment door
 - 5 Fixing on sheet steel III
 - 6 Fixing on sheet steel IV
 - 7 Key lock for open position for stored energy motor operation (optional)
 - 8 Key lock against manual operation for stored energy motor operator (optional)


Flange

—
Key
3 Flange for the compartment door

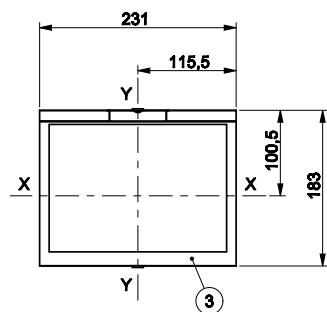

—
Key
4 Compartment door drilling template with/without flange

Drilling template compartment door

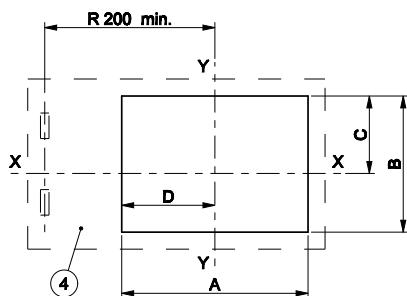


| | A [mm] | B [mm] | C [mm] | D [mm] |
|----------------|---------|--------|--------|--------|
| With flange | 3p - 4p | 219 | 160 | 89 |
| Without flange | 3p - 4p | 209 | 149.8 | 83.9 |
| | | | | 109.5 |
| | | | | 104.5 |

Tmax XT6 – Installation


Accessories for fixed circuit-breaker

Front for lever operating mechanism (FLD)

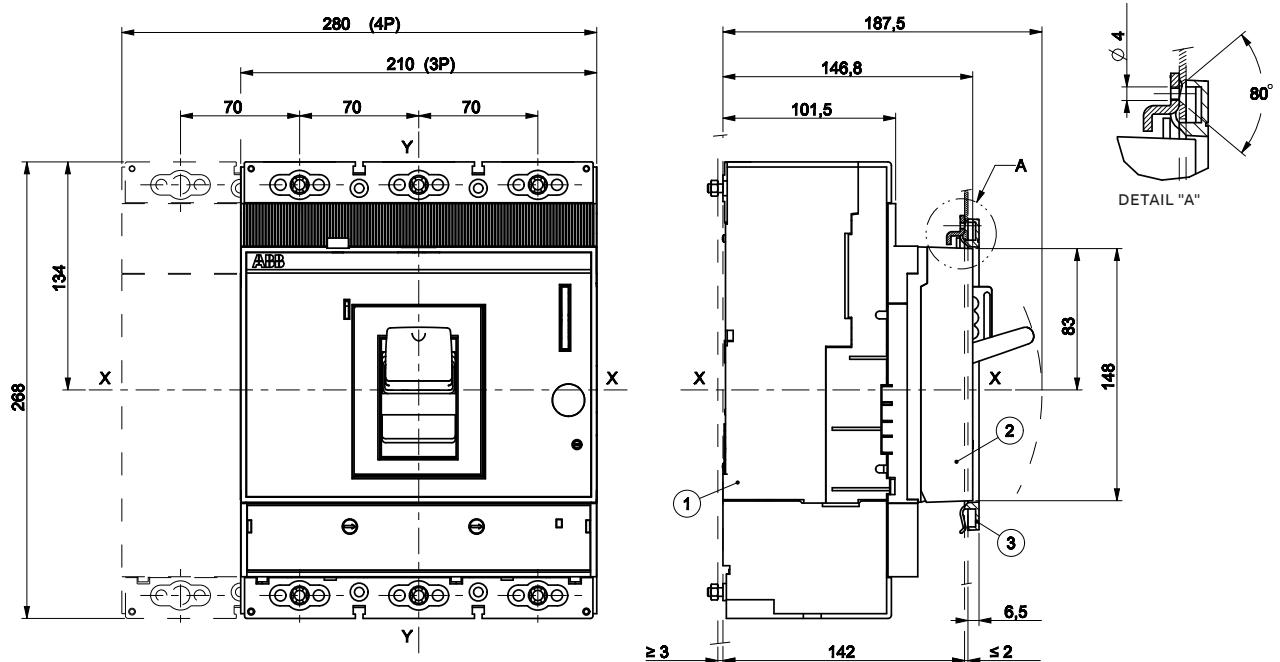


Drilling templates for support sheet

- Key
- 1 Circuit-breaker
 - 2 Front for lever operating mechanism (FLD)
 - 3 Flange for the compartment door
 - 5 Fixing on sheet steel III
 - 6 Fixing on sheet steel IV

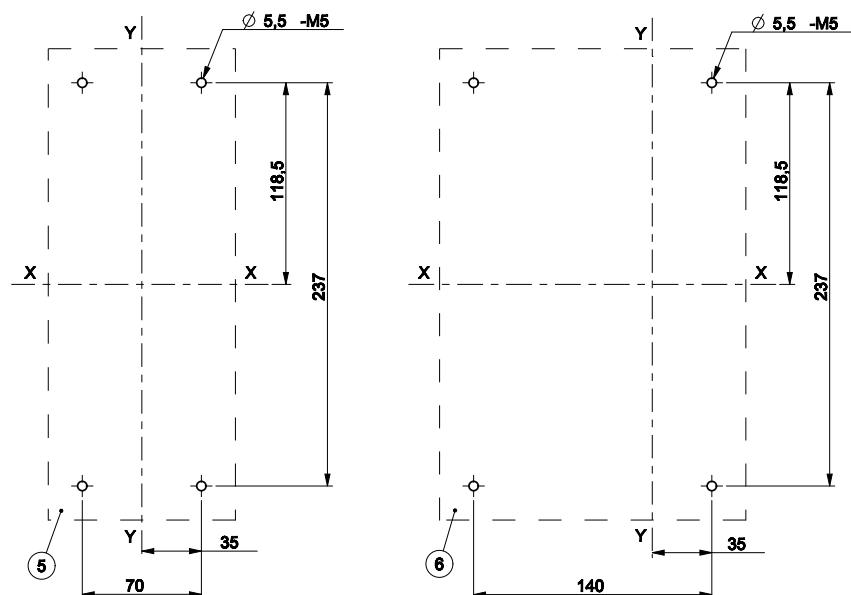


Flange

- Key
 3 Flange for the compartment door
 4 Compartment door drilling template with / without flange

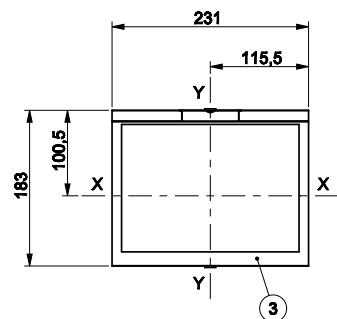

Drilling template compartment door




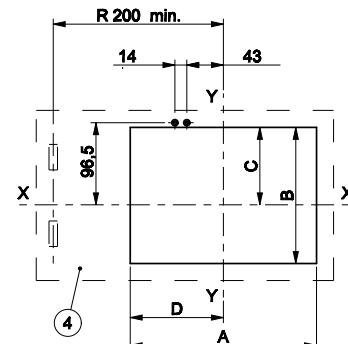


| | A [mm] | B [mm] | C [mm] | D [mm] |
|------------------------|--------|--------|--------|--------|
| With flange 3p - 4p | 219 | 160 | 89 | 109.5 |
| Without flange 3p - 4p | 209 | 149.8 | 83.9 | 104.5 |

Tmax XT6 – Installation

Accessories for fixed circuit-breaker

Rotary handle operating mechanism on the compartment door (RHE)

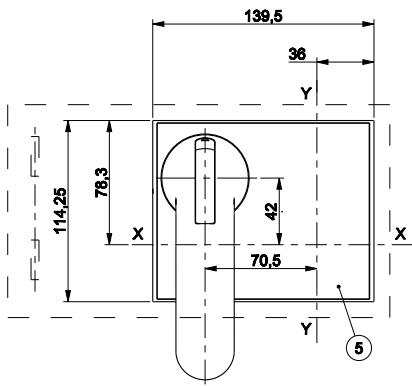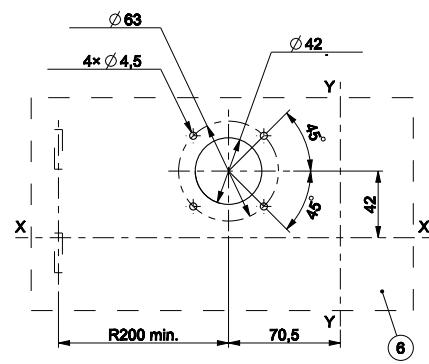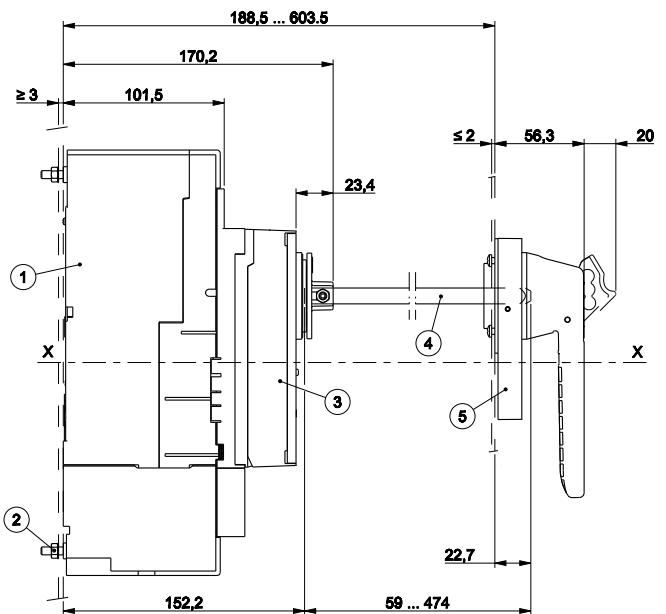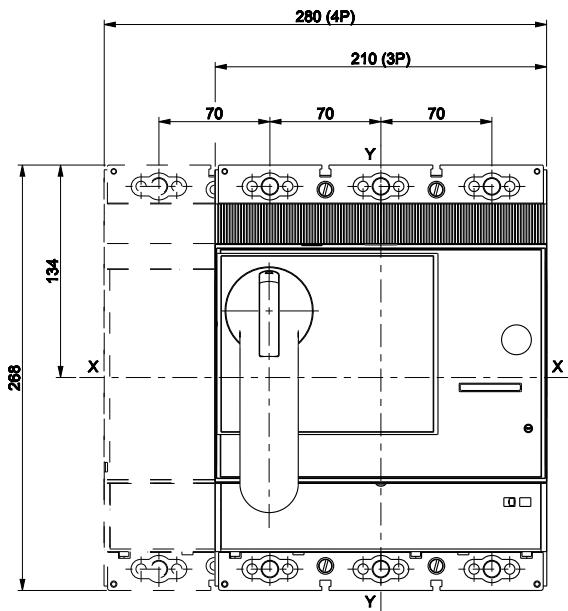

—
Key


- Key**

 - 1 Circuit-breaker
 - 2 Tightening torque 2Nm
 - 3 Base of rotary handle operating mechanism
 - 4 Connection rod
 - 5 Rotary handle operating mechanism of the compartment door
 - 6 Compartment door drilling template

Tmax XT6 – Installation


Installation for withdrawable circuit-breaker

Fixing on sheet

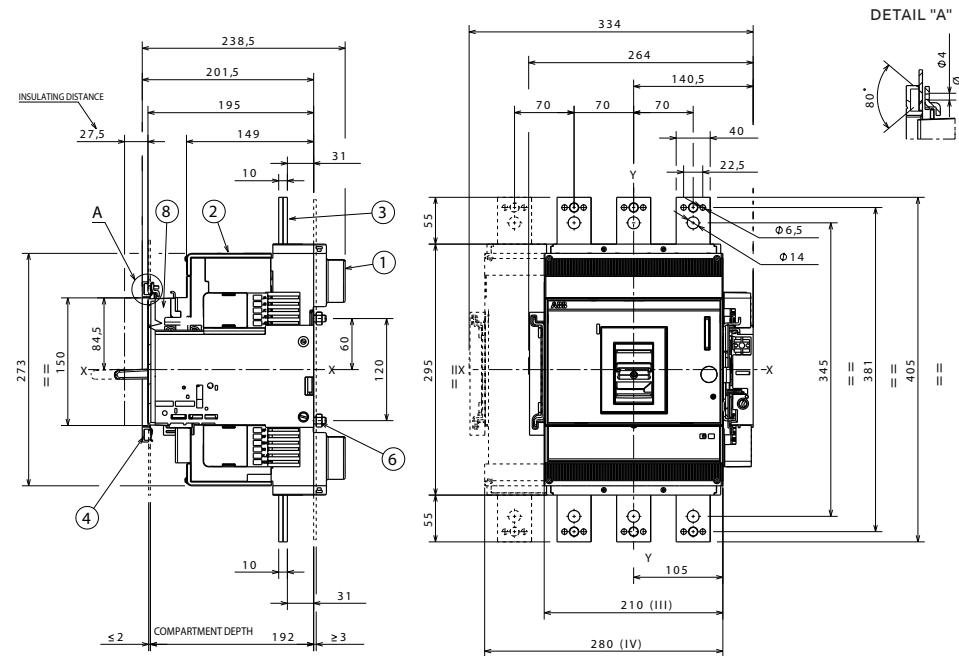

Drilling template for support sheet

- Key**
- 1 Fixed part
 - 2 Moving part
 - 3 Extended front terminals
 - 5 Drilling template 3p-4p
 - 6 Tightening torque 8Nm
 - 8 FLD

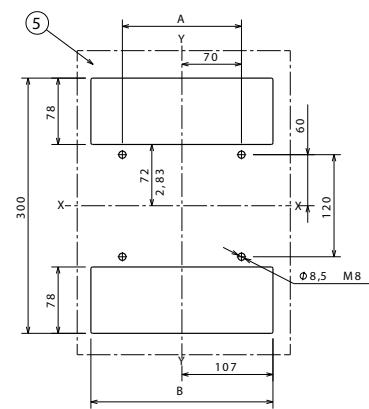


| | A [mm] | B [mm] |
|----|--------|--------|
| 3p | 140 | 214 |
| 4p | 210 | 284 |


Tmax XT6 – Installation

Installation for withdrawable circuit-breaker

Flange

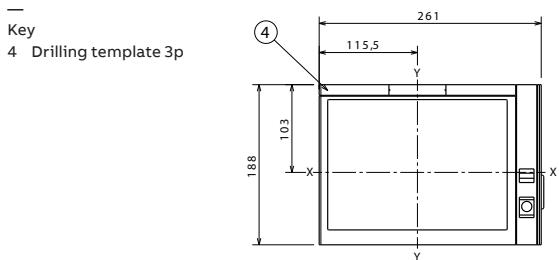


Drilling template compartment door

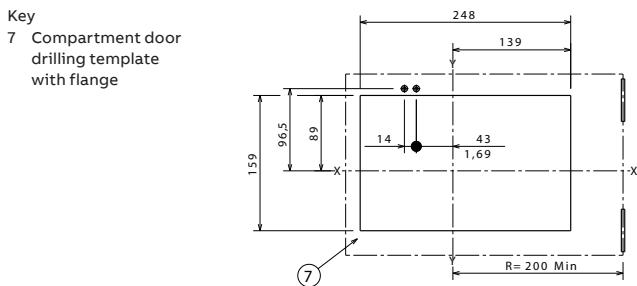

Tmax XT6 – Installation

Terminals for withdrawable circuit-breaker

Terminals EF

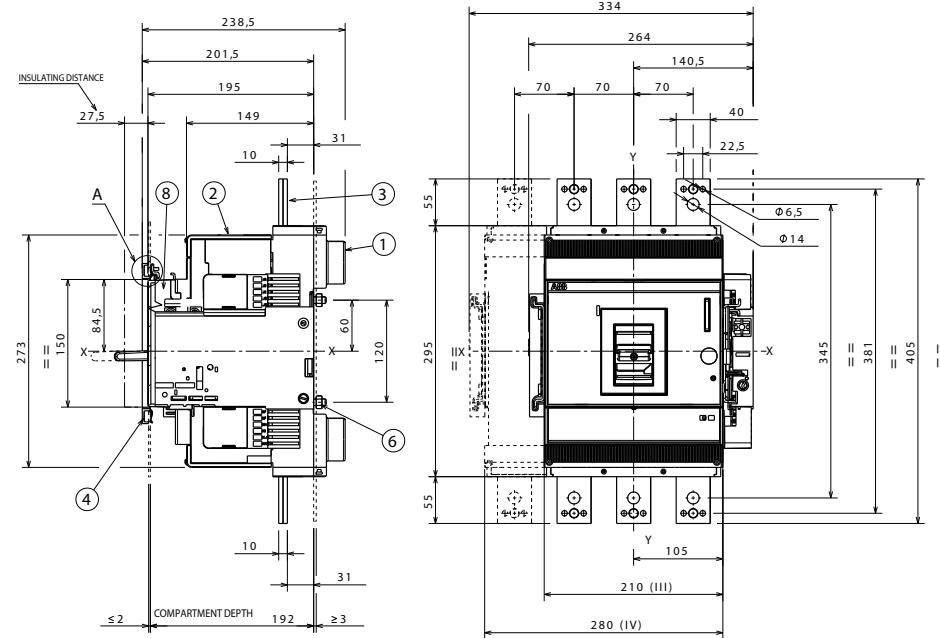



Key

- 1 Fixed part
- 2 Moving part
- 3 Extended front terminals
- 6 Tightening torque 8Nm
- 8 FLD

Tmax XT6 – Installation


Accessories for withdrawable circuit-breaker

Rotary handle operating mechanism on the circuit-breaker (RHD)

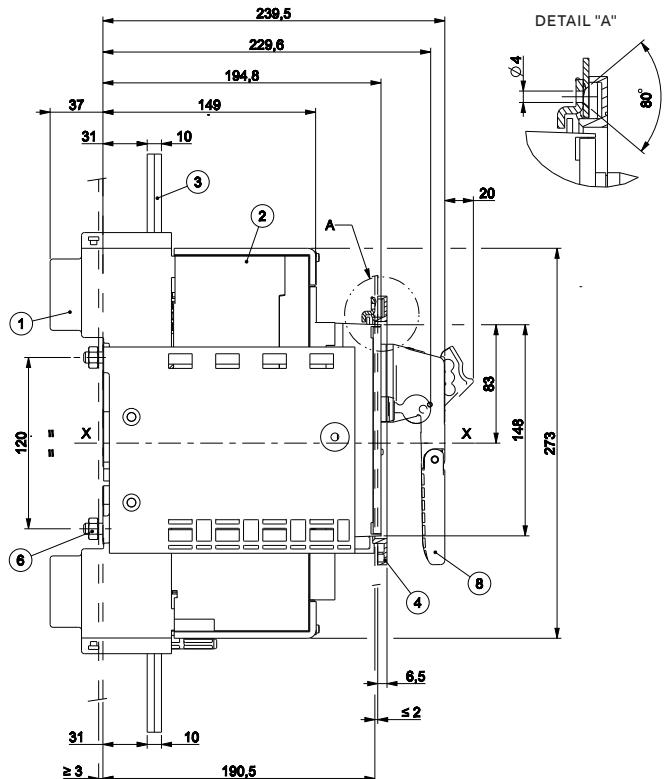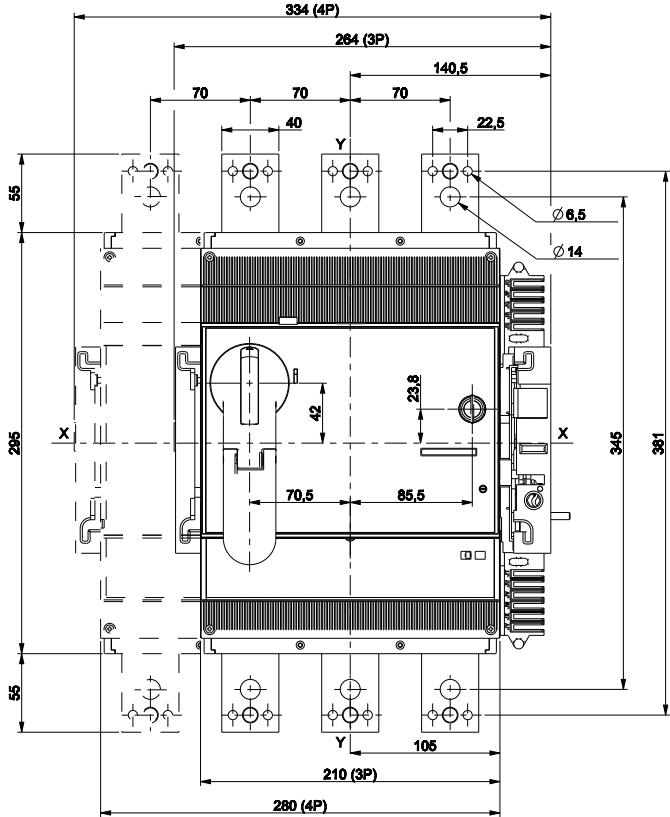

Drilling template for support sheet


- Key
- 1 Fixed part
 - 2 Moving part
 - 3 Extended front terminals
 - 5 Drilling template 3p-4p
 - 6 Tightening torque 8Nm
 - 8 Rotary handle operating mechanism on circuit breaker (RHD)

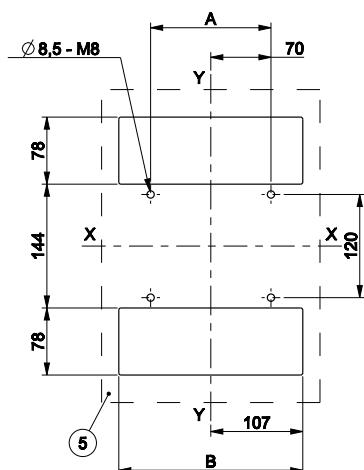

| | A [mm] | B [mm] |
|----|--------|--------|
| 3p | 140 | 214 |
| 4p | 210 | 284 |


Flange

—
Key
4 Flange for the compartment door

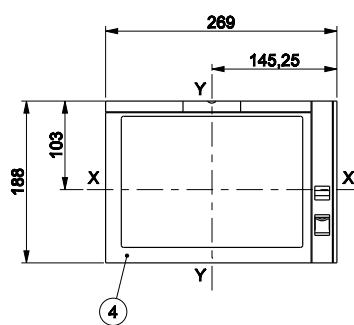

Drilling template compartment door

—
Key
7 Compartment door drilling template with flange

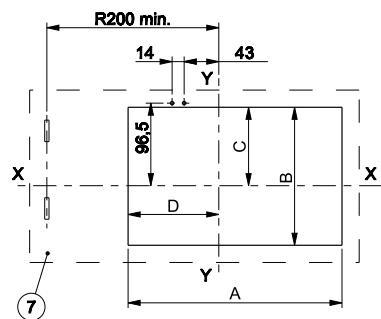


| | A [mm] | B [mm] | C [mm] | D [mm] |
|---------------|--------|--------|--------|--------|
| With flange W | 248 | 159 | 89 | 109 |


Tmax XT6 – Installation

Accessories for withdrawable circuit-breaker

Rotary handle operating mechanism on the compartment door (RHE)

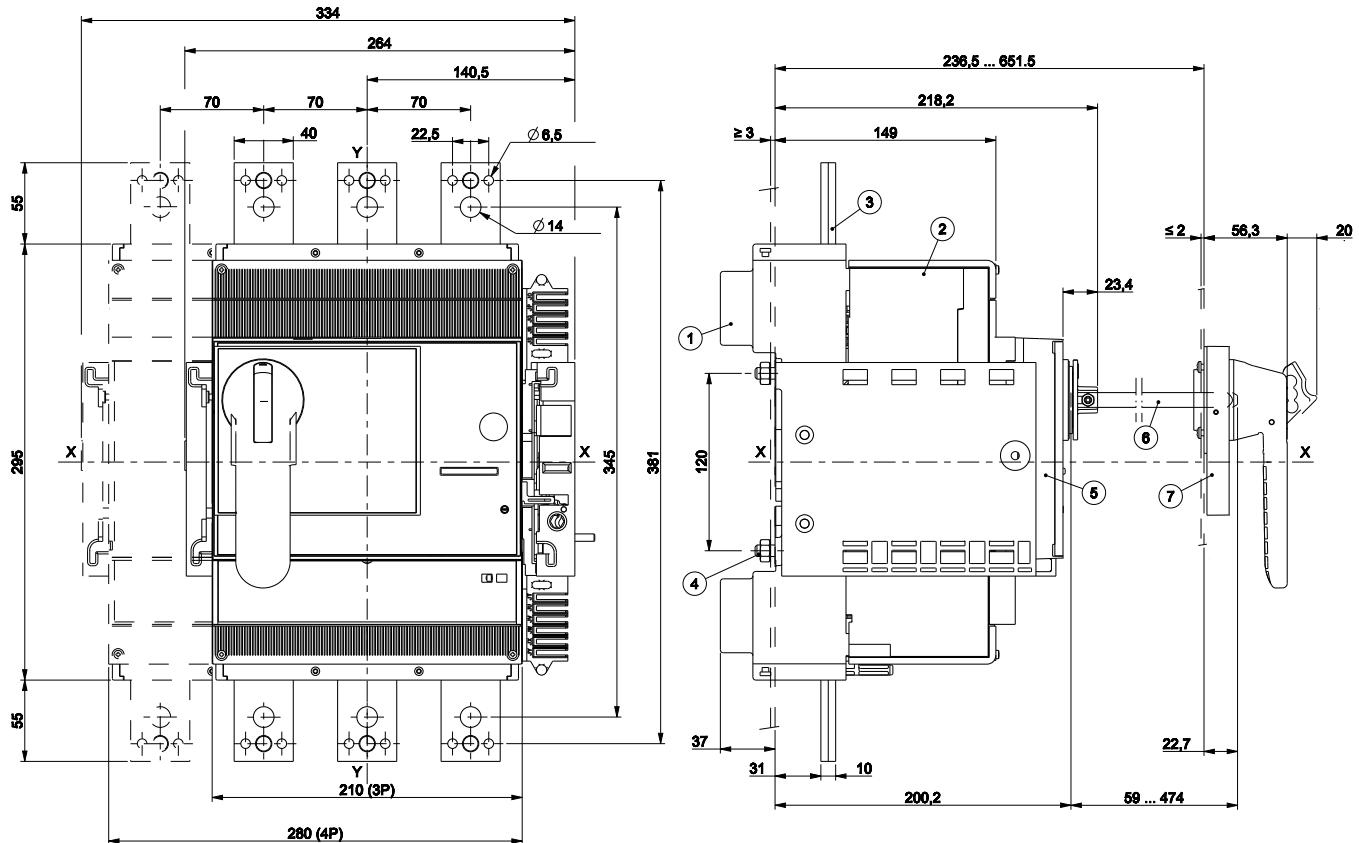


- Key
- 1 Fixed part
 - 2 Moving part
 - 3 Extended front terminals
 - 4 Tightening torque 2Nm
 - 5 Base of rotary handle operating mechanism
 - 6 Connection rod
 - 7 Rotary handle operating mechanism of the compartment door
 - 8 Compartment door drilling template

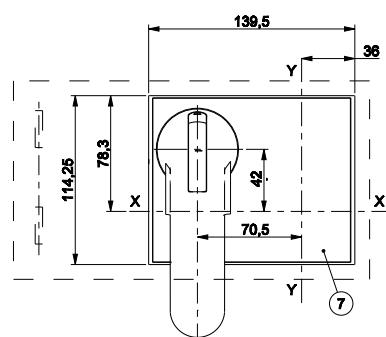


| | A [mm] | B [mm] |
|----|--------|--------|
| 3p | 140 | 214 |
| 4p | 210 | 284 |

Stored energy motor operator (MOE)

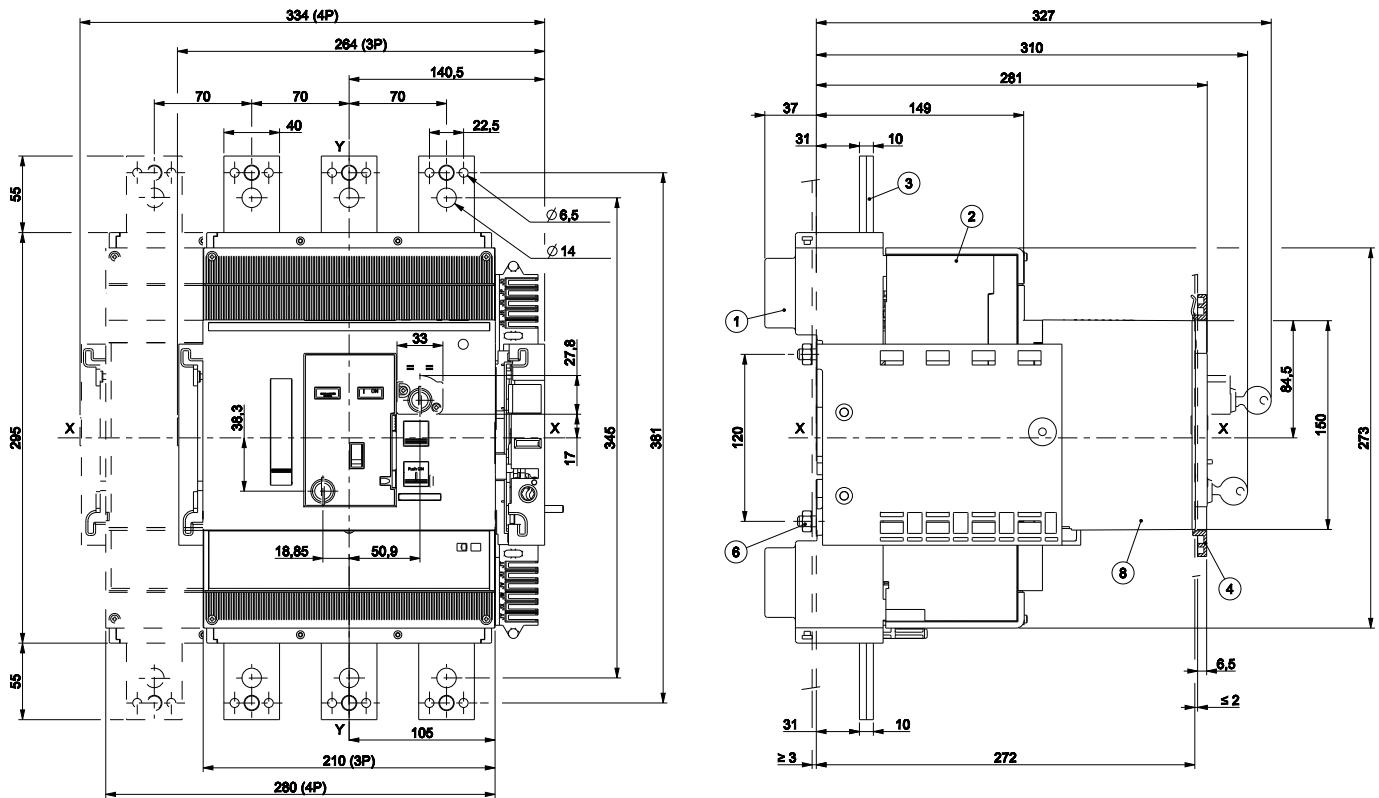

Drilling template for support sheet

- Key
- 1 Fixed part
 - 2 Moving part
 - 3 Extended front terminals
 - 5 Drilling template 3p-4p
 - 6 Tightening torque 8Nm
 - 8 Stored energy motor operator

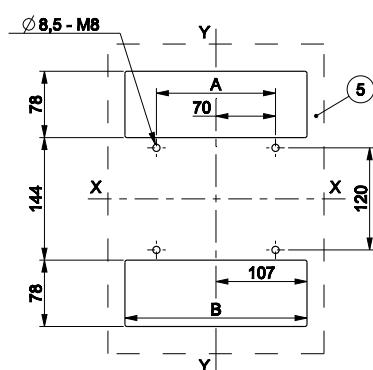


| | A [mm] | B [mm] |
|----|--------|--------|
| 3p | 140 | 214 |
| 4p | 210 | 284 |


Tmax XT6 – Installation

Accessories for withdrawable circuit-breaker

Flange

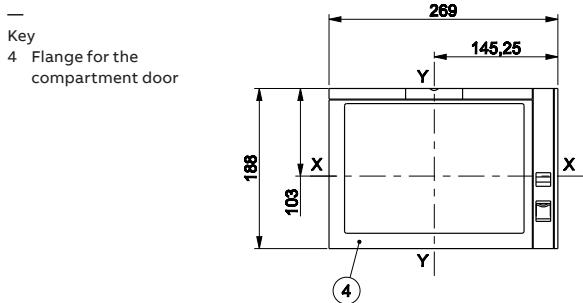


Drilling template compartment door

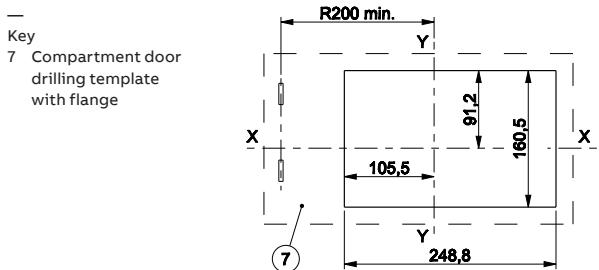


Tmax XT7 – Installation

Installation for fixed circuit-breaker

Fixing on sheet

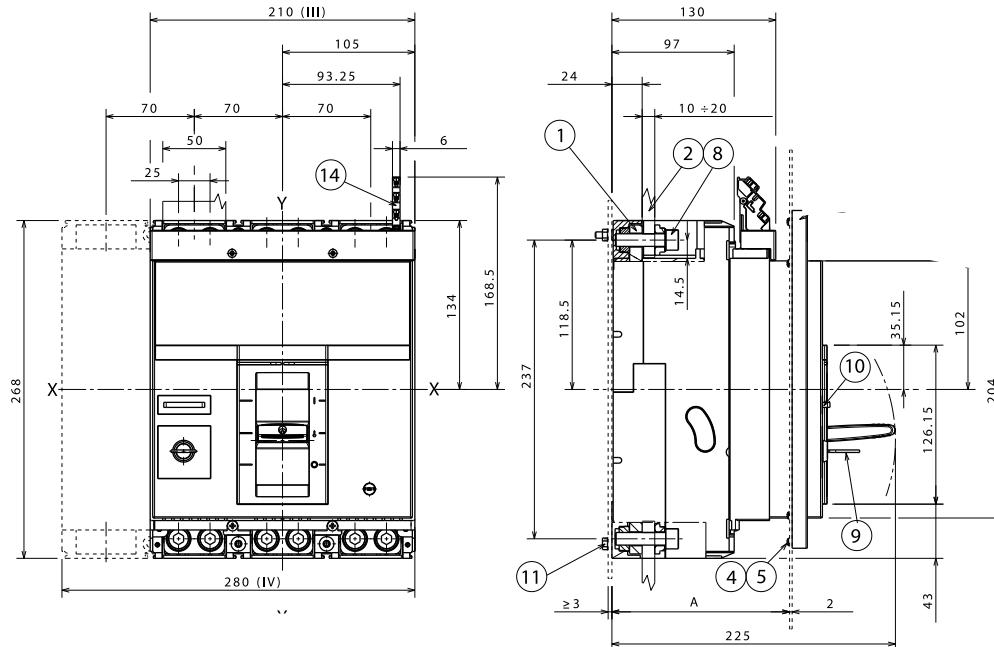


Drilling templates for support sheet

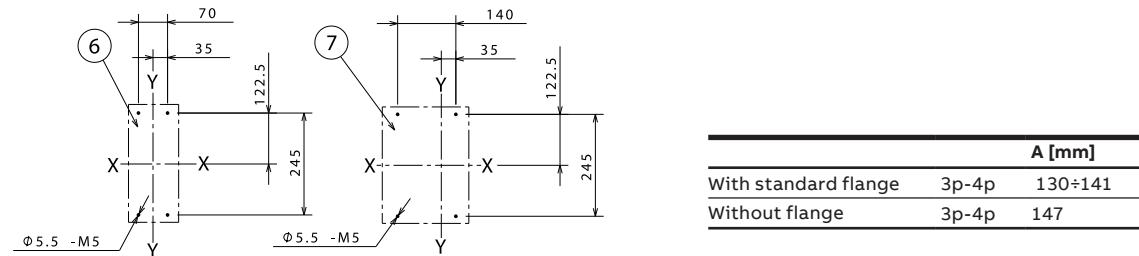


Key

- 1 Front terminals for flat connection
- 2 Extended front terminals
- 3 Flange for the compartment door
- 4 Flange fixing screws
- 5 Tightening torque 0.5 Nm - 4.4 lbs in
- 6 Drilling template 3p
- 7 Drilling template 4p
- 8 Tightening torque 18 Nm - 159 lbs in
- 9 Key lock
- 10 Padlock device
- 11 Tightening torque 2 Nm - 18 lbs in
- 12 Compartment door drilling template for flange
- 13 Compartment door drilling template for 206x204 frontal
- 14 Clamp for auxiliary contacts

Flange



Compartment door drilling templates

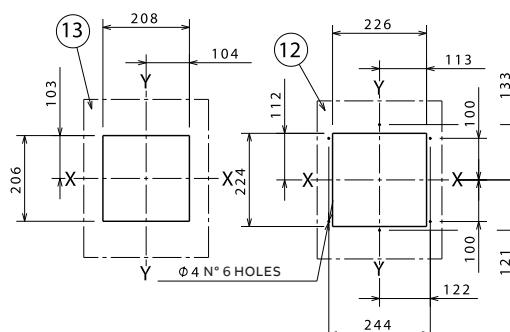


Tmax XT7 – Installation

Terminals for fixed circuit-breaker

| Key | |
|-----|---|
| 1 | Extended front terminals EF |
| 2 | Flange for the compartment door |
| 3 | Flange fixing screws |
| 4 | Tightening torque 0.5 nm - 4.4 lbs in |
| 7 | Tightening torque 18 nm - 159 lbs in |
| 8 | Key lock |
| 9 | Padlock device |
| 10 | Tightening torque 2 Nm - 18 lbs in |
| 13 | Slot for external signaling |
| 14 | Insulating plate |
| 15 | Phase separators 100mm |
| 16 | High terminal cover with IP40 protection degree |



Terminals EF

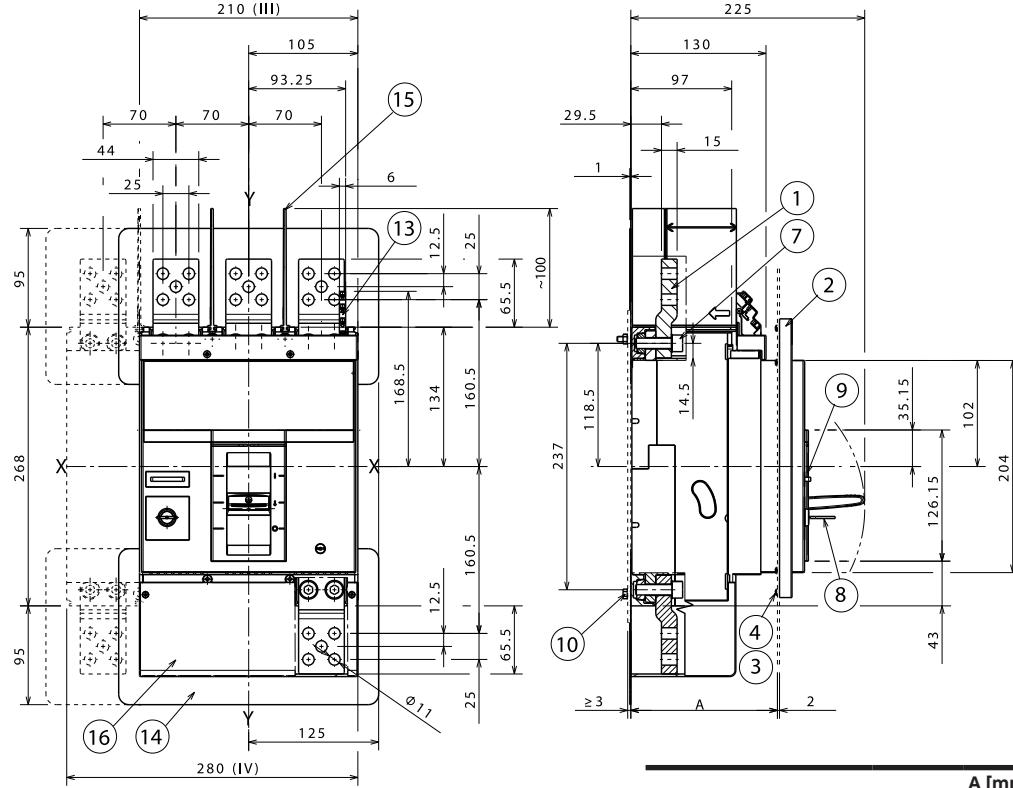

| A [mm] | With standard flange | 3p-4p | 130÷141 |
|--------|----------------------|-------|---------|
| | Without flange | 3p-4p | 147 |

Terminals ES


| Key | |
|-----|---------------------------------------|
| 1 | Spreaded extended front terminals ES |
| 2 | Flange for the compartment door |
| 3 | Flange fixing screws |
| 4 | Tightening torque 0.5 nm - 4.4 lbs in |
| 7 | Tightening torque 18 nm - 159 lbs in |
| 8 | Key lock |
| 9 | Padlock device |
| 10 | Tightening torque 2 Nm - 18 lbs in |
| 13 | Slot for external signaling |
| 14 | Insulating plate |
| 15 | Phase separators 200mm |

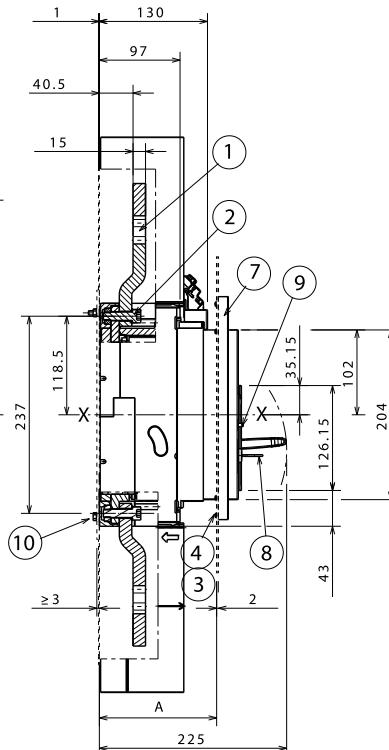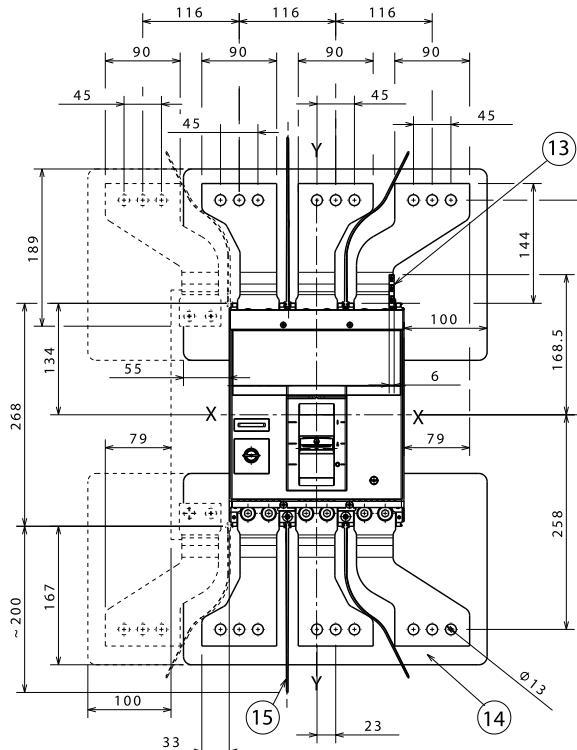

4 x 380mm² and 2 x 240mm² FC CuAl

Key


- 1 Fc Cu-Al terminal 4x240mm²
- 2 Fc Cu-Al terminal 2x240mm²
- 3 Flange for the compartment door
- 4 Flange fixing screws
- 5 Tightening torque 0.5 Nm - 4.4 lbs in
- 8 Tightening torque 18 Nm - 159 lbs in
- 9 Tightening torque 43 Nm - 380 lbs in
- 10 Key lock
- 11 Padlock device
- 12 Tightening torque 2 Nm - 18 lbs in
- 15 Slot for external signaling
- 16 Insulating plate
- 17 High terminal cover with IP40 protection degree
- 18 Low protection cover with IP30 protection degree
- 19 Tightening torque 18 Nm - 159 lbs in

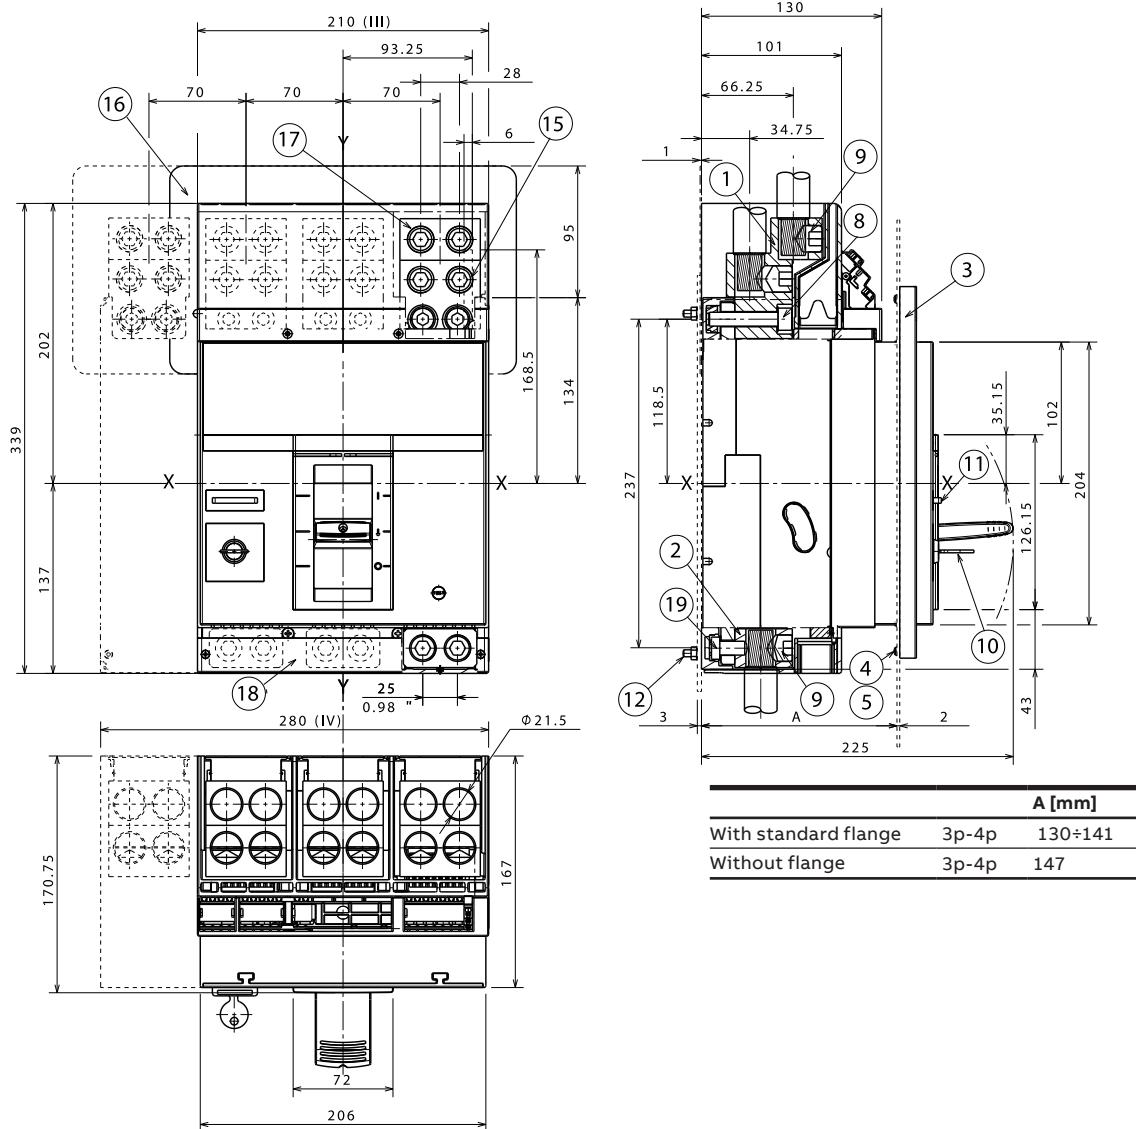

Tmax XT7 – Installation

Terminals for fixed circuit-breaker


Terminals HR/VR adjustable

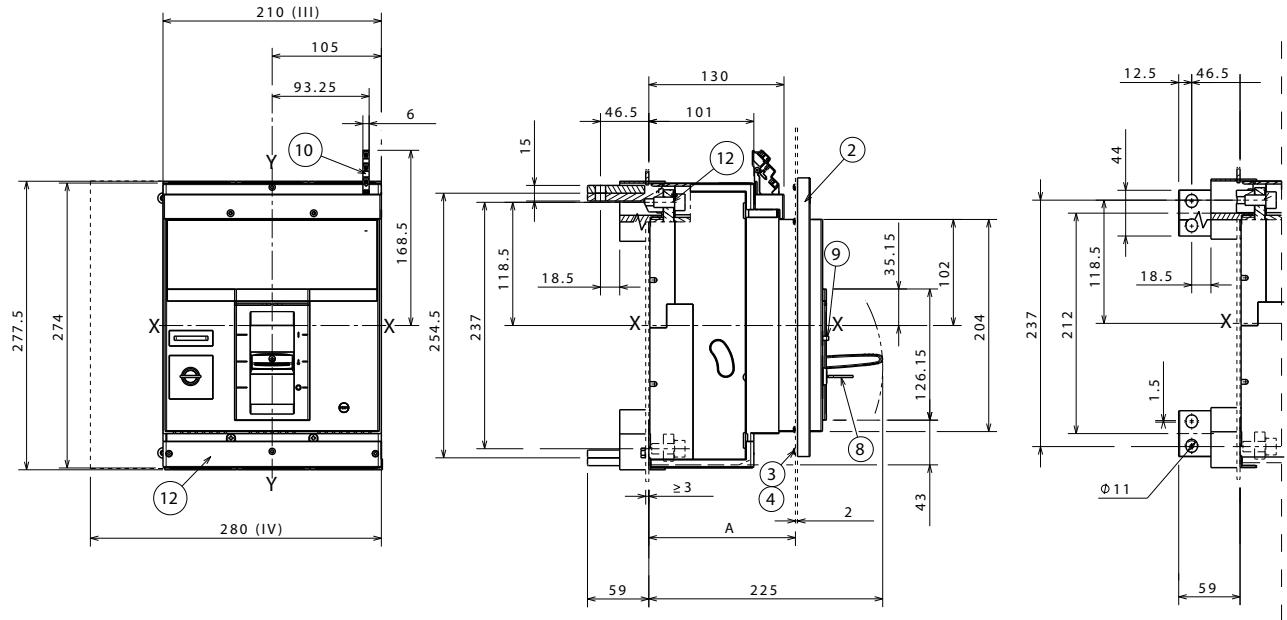


| Key | A [mm] |
|----------------------|---------------|
| With standard flange | 3p-4p 130÷141 |
| Without flange | 3p-4p 147 |

- Key
 1 HR horizontal rear terminal HR
 2 Flange for the compartment door
 3 Flange fixing screws
 4 Tightening torque 0.5 Nm - 4.4 lbs in
 8 Key lock
 9 Padlock
 10 Slot for external signaling
 12 Tightening torque 20 Nm - 177 lbs in
 13 Tightening torque 2 Nm - 18 lbs in


Terminals HR upper

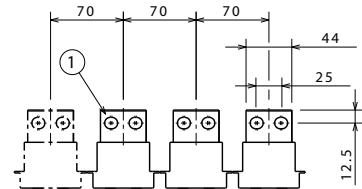

Terminals VR lower

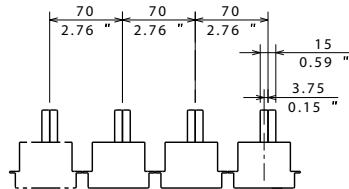


- Key
 8 Drilling template support plate

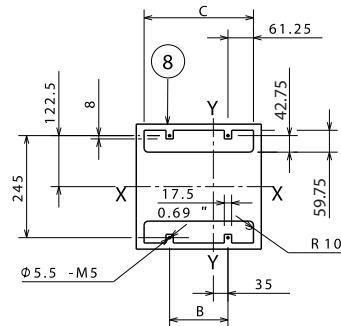

| | 3p | 4p |
|---|-------|-------|
| B | 70 | 140 |
| C | 192.5 | 262.5 |


Terminals HR and VR

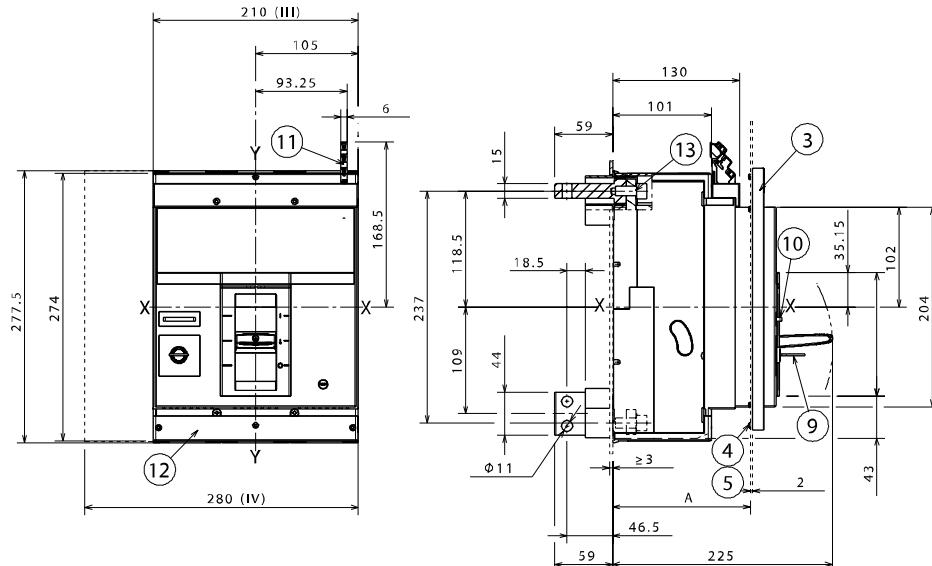


- Key
- 1 HR horizontal rear terminal HR
 - 2 VR vertical rear terminal VR
 - 3 Flange for the compartment door
 - 4 Flange fixing screws
 - 5 Tightening torque 0.5Nm - 4.4lbs in
 - 9 Key lock
 - 10 Padlock
 - 11 Clamp for auxiliary contacts
 - 11 Low protection cover with IP30 protection degree
 - 12 Tightening torque 9Nm

| | A [mm] |
|----------------------|---------------|
| With standard flange | 3p-4p 130÷141 |
| Without flange | 3p-4p 147 |


Terminals HR upper

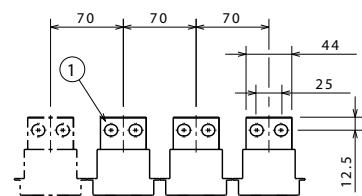

Terminals VR lower

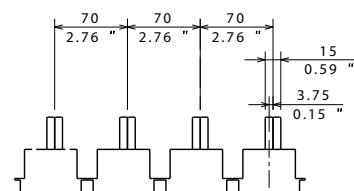

- Key
- 8 Drilling template support plate




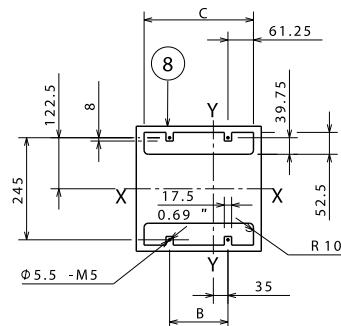


| | 3p | 4p |
|---|-------|-------|
| B | 70 | 140 |
| C | 192.5 | 262.5 |



Tmax XT7 – Installation

Accessories for fixed circuit-breaker


Rotary handle operating mechanism on the circuit-breaker (RHD)

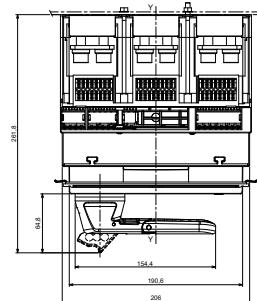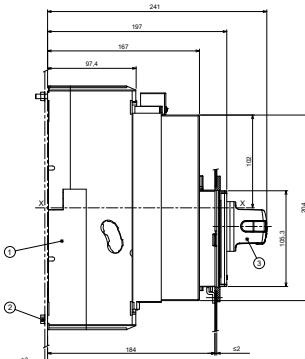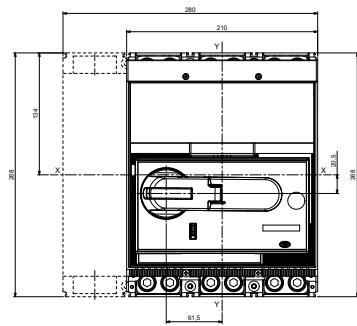


Drilling templates for support sheet

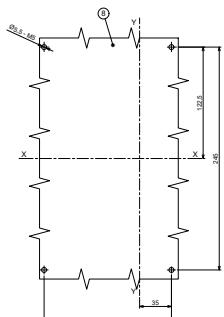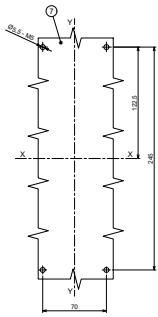

Flange




Drilling template compartment door

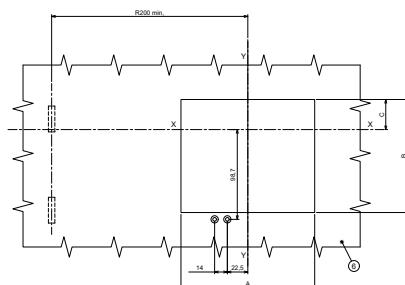

| Key | |
|-----|--|
| 1 | Circuit-breaker |
| 2 | Tightening torque 2Nm |
| 3 | Rotary handle operating mechanism for circuit-breaker |
| 4 | Plate for door lock |
| 5 | Flange without gasket for the compartment door |
| 6 | Compartment door drilling template with/without flange |
| 7 | Drilling template 3p |
| 8 | Drilling template 4p |

| | A | B | C |
|----------------|-----|-----|-------|
| With flange | 201 | 116 | 24.25 |
| Without flange | 192 | 107 | 19.75 |

Rotary handle operating mechanism on the compartment door (RHE)

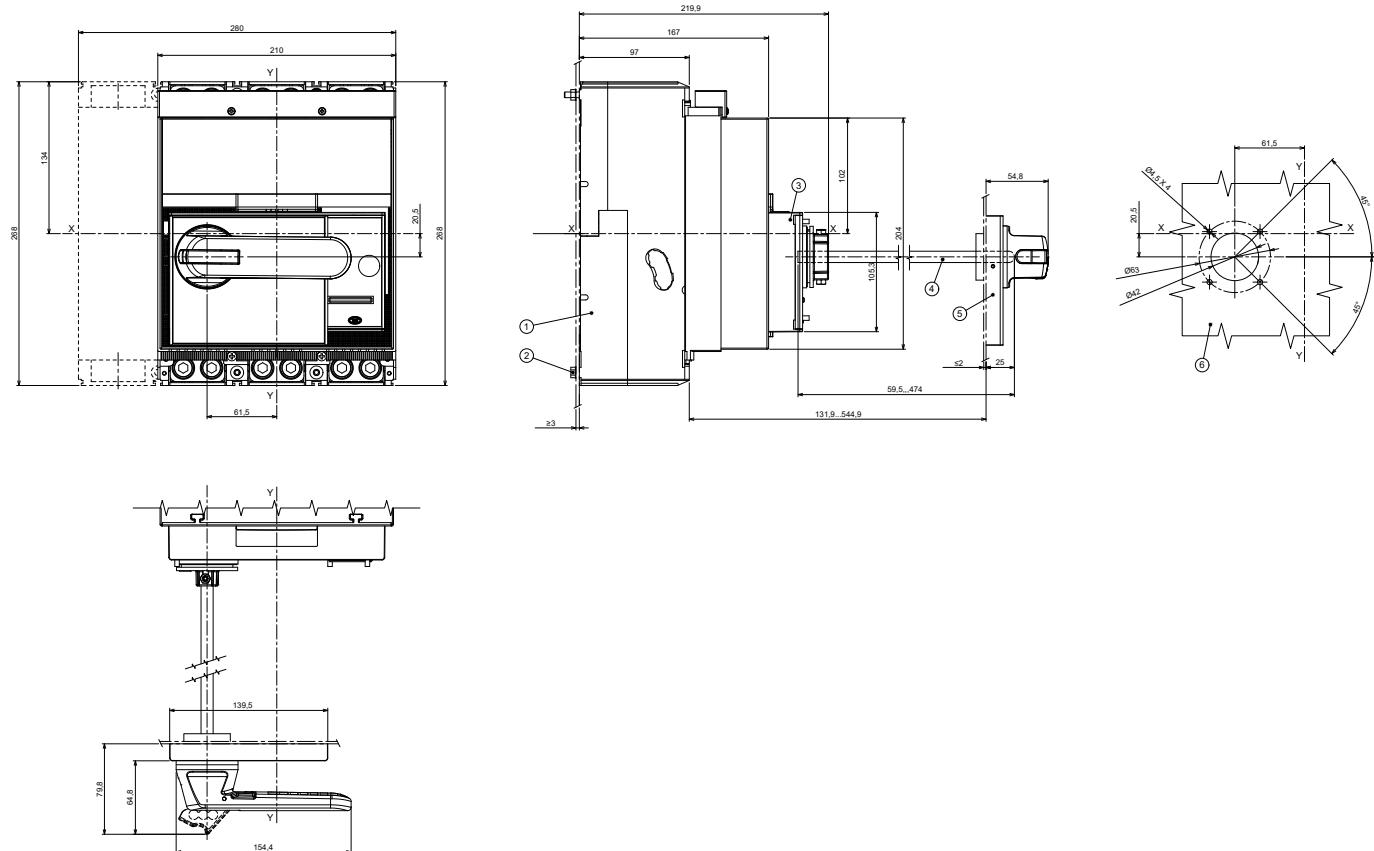


Key

- 1 Circuit-breaker
- 2 Tightening torque
2Nm
- 3 Base for rotary
handle operating
mechanism
- 4 500mm
Connection rod
- 5 Rotary handle
operating
mechanism of the
compartment door
- 6 Compartment door
drilling template


Tmax XT7 – Installation

Installation for withdrawable circuit-breaker

Fixing on sheet

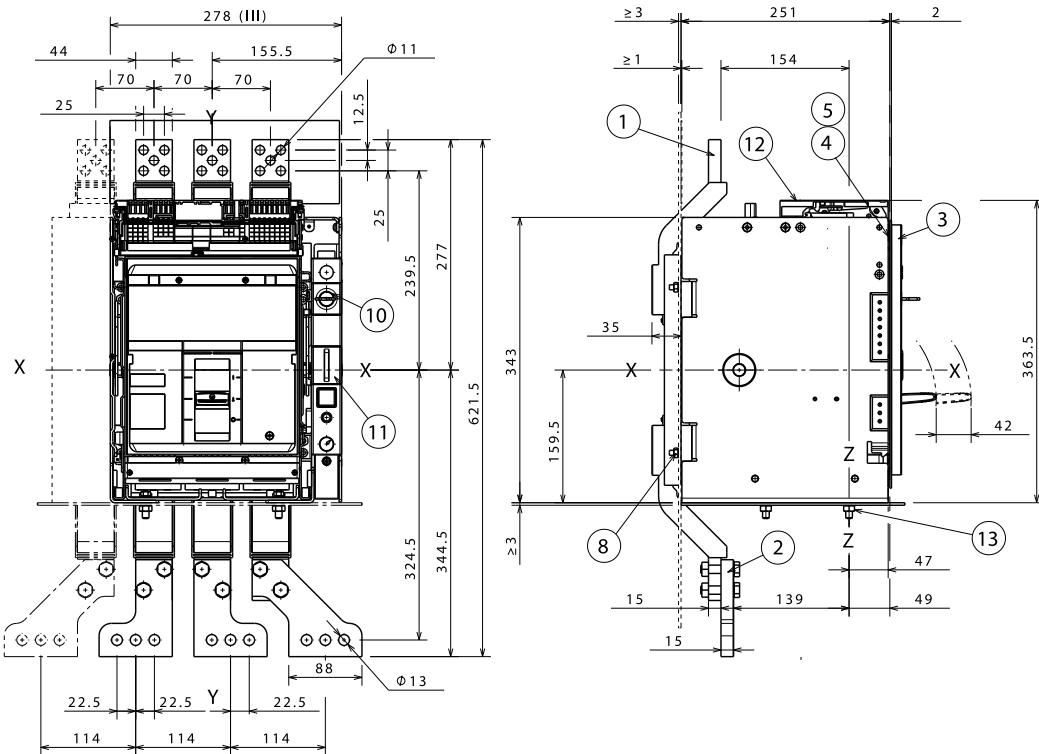


Drilling templates for support sheet

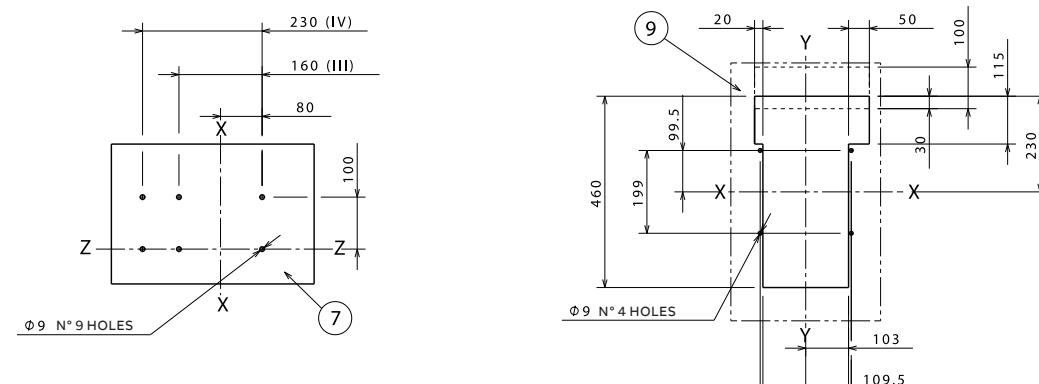


Key

- 1 EF front terminal
- 2 ES front terminal
- 3 Flange for the compartment door
- 4 Flange fixing screws
- 5 Tightening torque 0.5 Nm - 4.4 lbs in
- 6 Compartment door drilling template for flange
- 7 Fixing on sheet steel drilling template
- 8 Tightening torque 9 Nm - 79.6 lbs in
- 9 Mounting at wall
- 10 Keylock
- 11 Padlock
- 12 Clamp for auxiliary contacts
- 13 Tightening torque 9 Nm - 79.6 lbs in

Flange

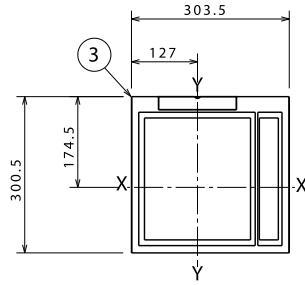


Drilling template compartment door

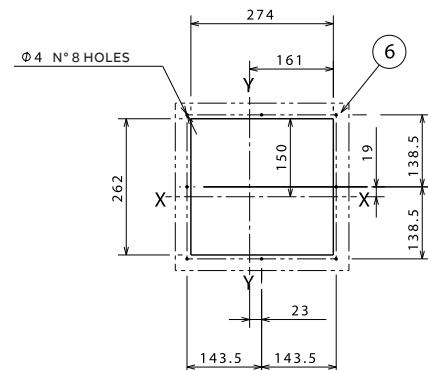

Tmax XT7 – Installation

Terminals for withdrawable circuit-breaker

Terminals EF and ES

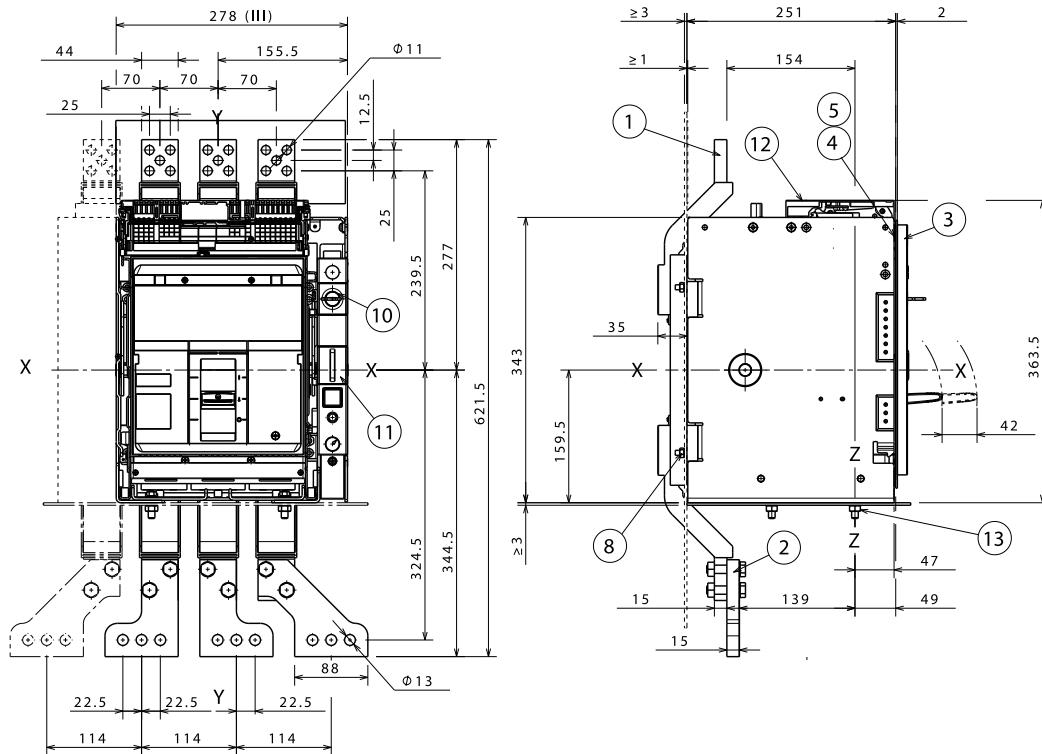


—
Key

- 1 EF front terminal
 - 2 ES front terminal
 - 4 Flange fixing screws
 - 5 Tightening torque
0.5 Nm - 4.4 lbs in
 - 8 Tightening torque
9 Nm - 79.6 lbs in
 - 10 Key lock
 - 11 Padlock
 - 12 Clamp for auxiliary contacts
 - 13 Tightening torque
9 Nm - 79.6 lbs in


Tmax XT7 – Installation

Terminals for withdrawable circuit-breaker


Terminals R

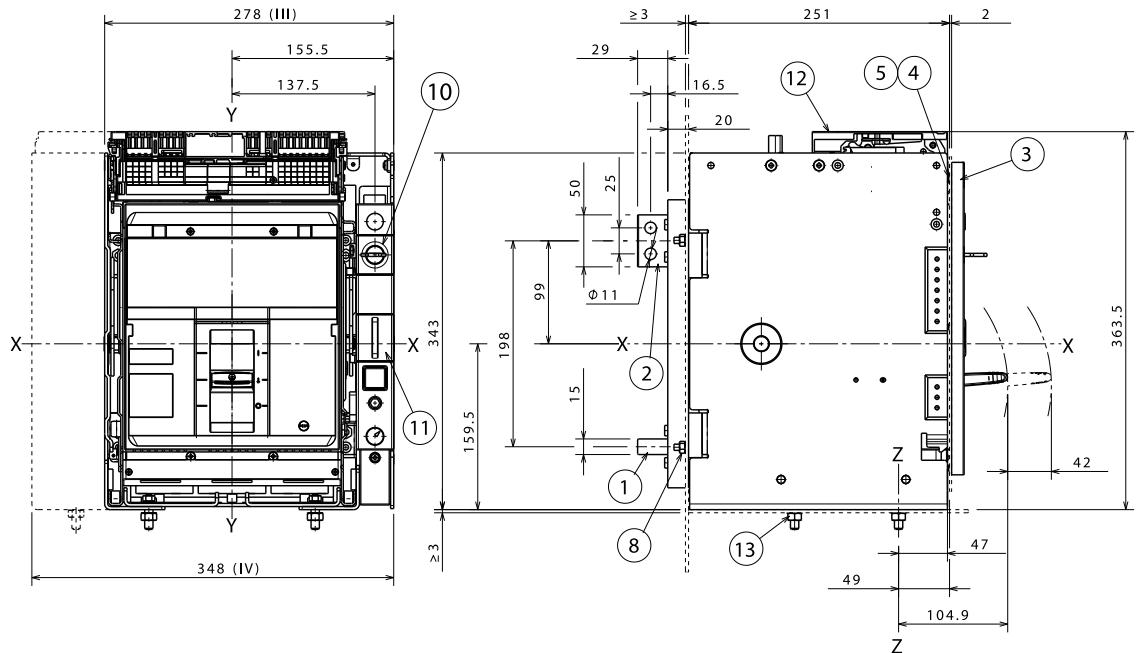


Terminals VR upper

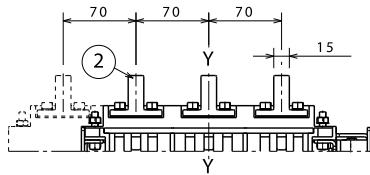


Terminals HR lower

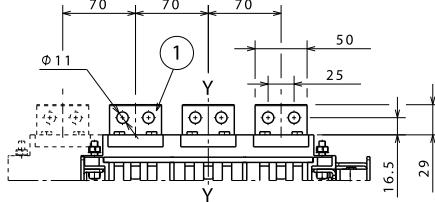


- Key**
- 1 HR horizontal rear terminal HR
 - 2 VR vertical rear terminal VR
 - 3 Flange for the compartment door
 - 4 Flange fixing screws
 - 5 Tightening torque 0.5 Nm - 4.4 lbs in
 - 8 Tightening torque 9 Nm - 79.6 lbs in
 - 9 Mounting at wall
 - 10 Key lock
 - 11 Padlock
 - 12 Slot for external signaling
 - 13 Tightening torque 9 Nm - 79.6 lbs in

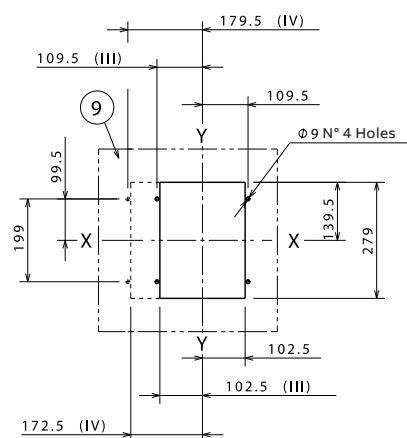


Terminals SHR

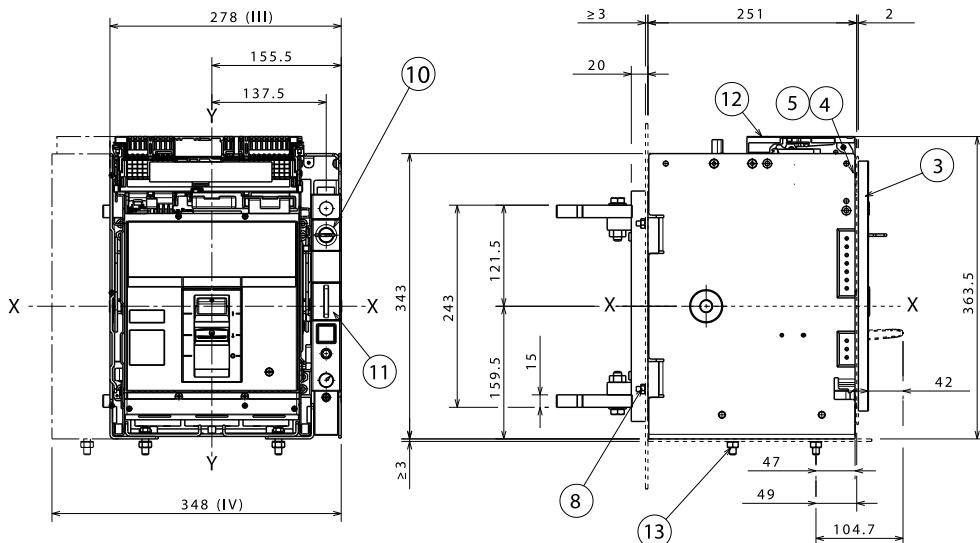

Terminals VR upper

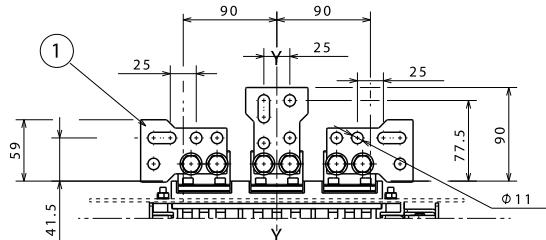


Terminals HR lower

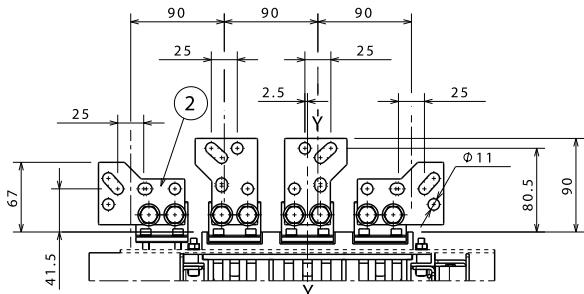

—
Key

- Key**






 - 1 SHR rear side terminals (3p)
 - 2 SHR rear side terminals (4p)
 - 3 Flange for the compartment door
 - 4 Flange fixing screws
 - 5 Tightening torque 0.5 Nm - 4.4 lbs in
 - 8 Tightening torque 9 Nm - 79.6 lbs in
 - 9 Mounting at wall
 - 10 Key lock
 - 11 Padlock
 - 12 Slot for external signaling
 - 13 Tightening torque 9 Nm - 79.6 lbs in

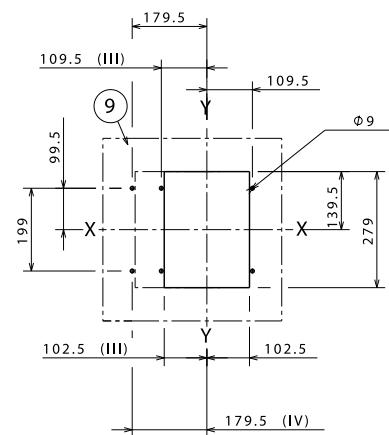

Tmax XT7 – Installation

Accessories for withdrawable circuit-breaker



Rotary handle operating mechanism on the circuit-breaker (RHD)

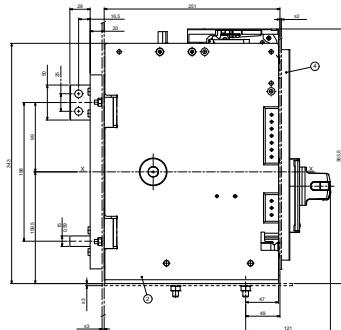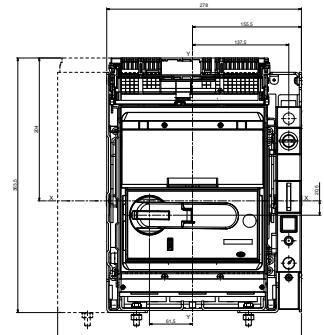

Terminals VR upper


Terminals HR lower

Drilling templates for support sheet

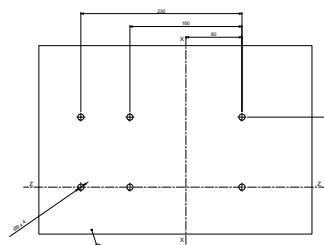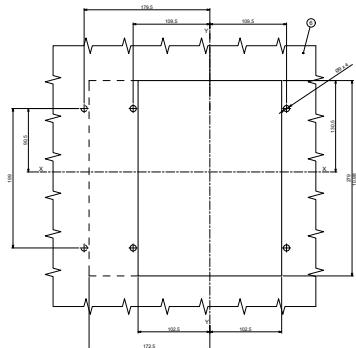


- Key**
- 1 Moving part
 - 2 Fixed part
 - 3 Rotary handle operating mechanism for circuit-breaker
 - 4 Flange for the compartment door
 - 5 Compartment door drilling template for flange
 - 6 Mounting at wall
 - 7 Fixing on sheet steel drilling template


Flange



Drilling template compartment door

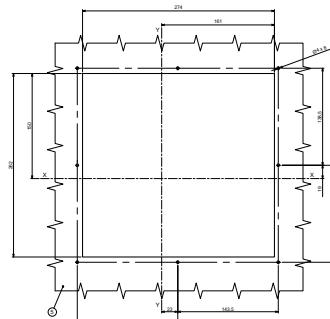

Rotary handle operating mechanism on the compartment door (RHE)

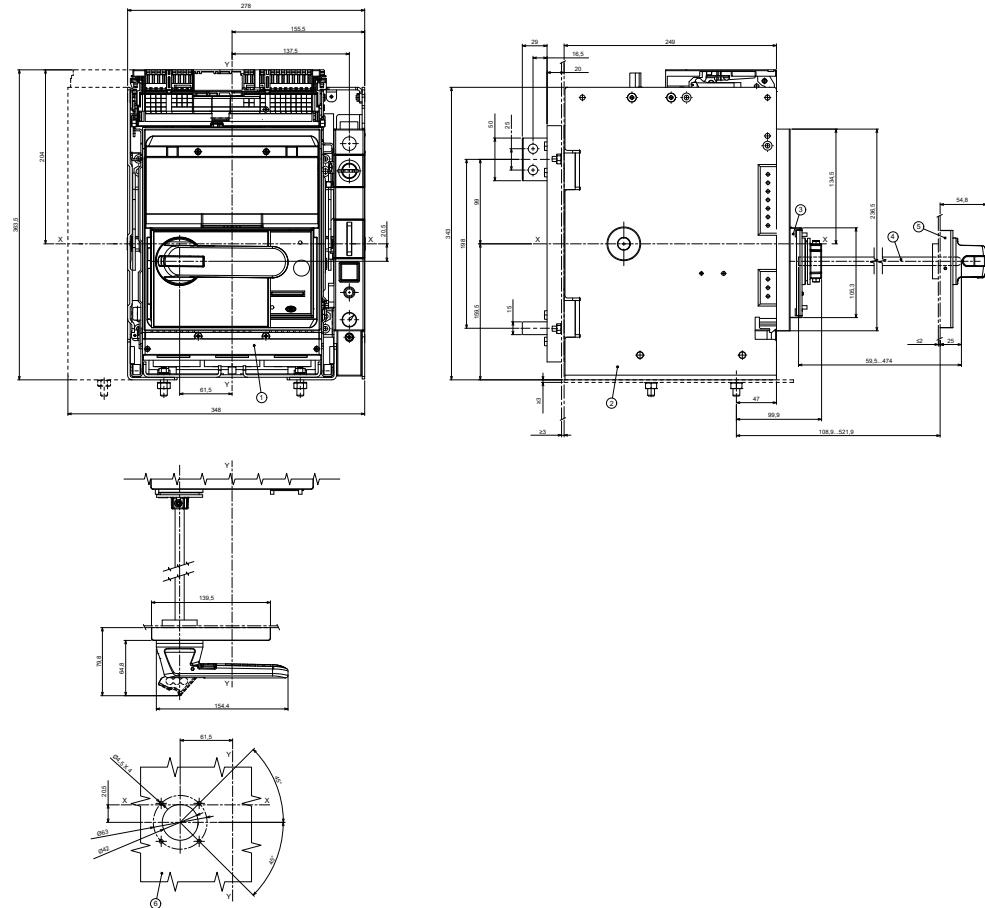


Key

- 1 Circuit-breaker
- 2 Fixed part
- 3 Base for rotary handle operating mechanism
- 4 500mm Connection rod
- 5 Rotary handle operating mechanism of the compartment door
- 6 Compartment door drilling template

Tmax XT7 M – Installation


Installation for fixed circuit-breaker

Fixing on sheet

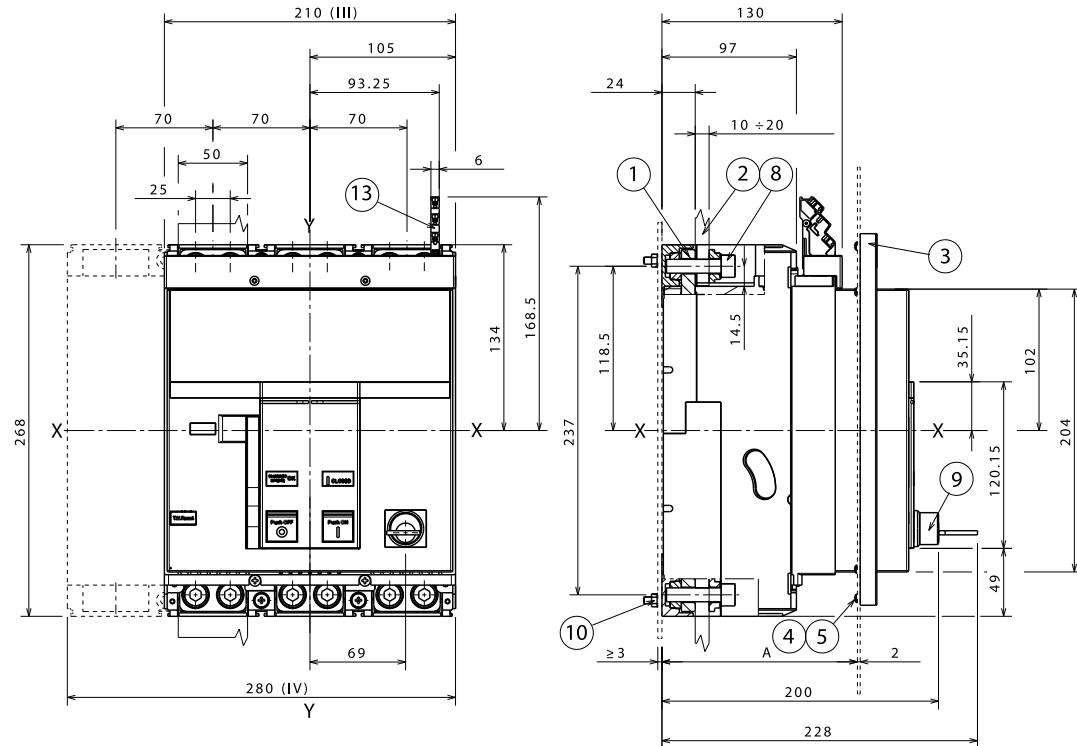


| | A [mm] |
|----------------------|---------------|
| With standard flange | 3p-4p 130÷141 |
| Without flange | 3p-4p 147 |

Drilling templates for support sheet

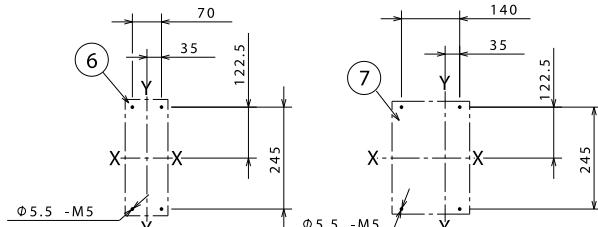


- Key
- 1 Front terminals for flat connection
 - 2 Extended front terminals
 - 3 Flange for the compartment door
 - 4 Flange fixing screws
 - 5 Tightening torque 0.5 Nm - 4.4 lbs in
 - 6 Drilling template 3p
 - 7 Drilling template 4p
 - 8 Tightening torque 18 Nm - 159 lbs in
 - 9 Key lock
 - 10 Tightening torque 2 Nm - 18 lbs in
 - 11 Compartment door drilling template for flange
 - 12 Compartment door drilling template for 206x204 frontal
 - 13 Clamp for auxiliary contacts

Flange



Compartment door drilling templates

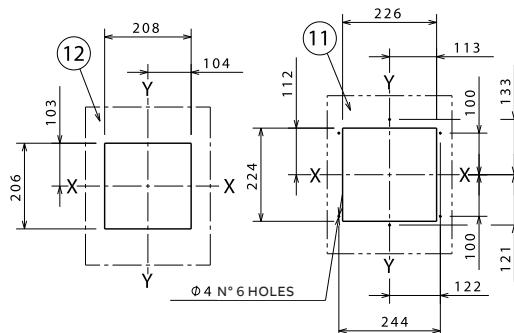


Tmax XT7 M – Installation

Terminals for fixed circuit-breaker


- Key
 1 Extended front terminals EF
 2 Flange for the compartment door
 3 Flange fixing screws
 4 Tightening torque 0,5 Nm - 4,4 lbs in
 7 Tightening torque 18 Nm - 159 lbs in
 8 Key lock
 9 Tightening torque 2Nm - 18 lbs in
 12 Slot for external signaling
 13 Insulating plate
 14 Phase separators 100mm
 15 High terminal cover with IP40 protection degree

Terminals EF

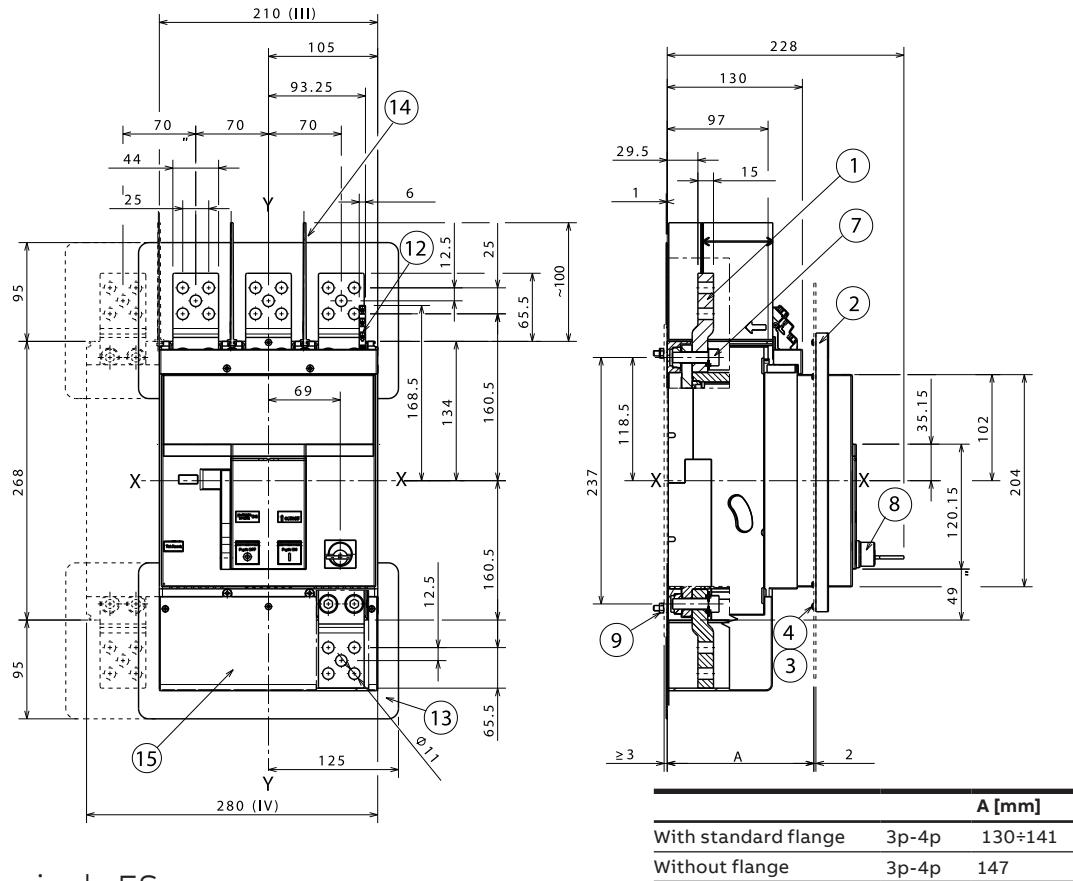

Terminals ES

- Key
 1 Spreaded extended front terminals ES
 2 Flange for the compartment door
 3 Flange fixing screws
 4 Tightening torque 0,5 Nm - 4,4 lbs in
 7 Tightening torque 18 Nm - 159 lbs in
 8 Key lock
 9 Tightening torque 2Nm - 18 lbs in
 12 Slot for external signaling
 13 Insulating plate

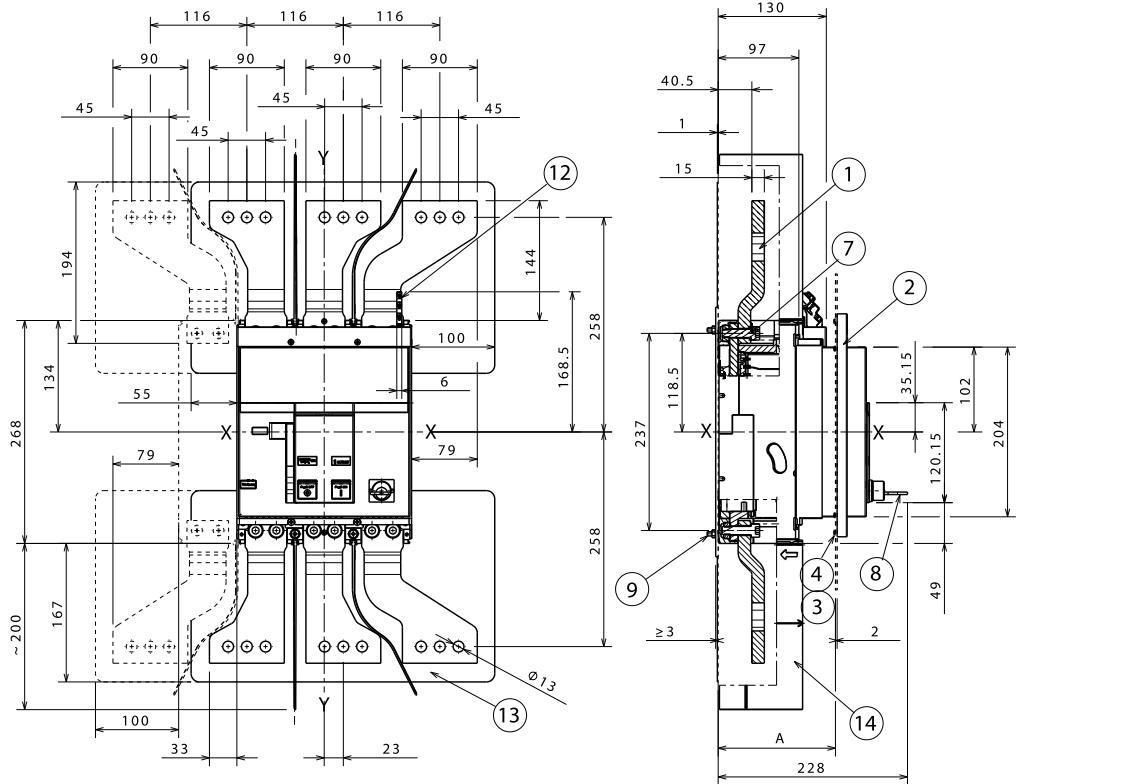


Tmax XT7 M – Installation


Terminals for fixed circuit-breaker

—
Key
1 Fc Cu-Al terminal
4x240mm²
2 Fc Cu-Al terminal
2x240mm²
3 Flange for the
compartment door
4 Flange fixing screws
5 Tightening torque
0.5 Nm - 4.4 lbs in
8 Tightening torque
18 Nm - 159 lbs in
9 Tightening torque 43
Nm - 380 lbs in
10 Key lock
11 Tightening torque
2 Nm - 18 lbs in
14 Slot for external
signaling
15 Insulating plate
16 High terminal
cover with IP40
protection degree
17 Low protection
cover with IP30
protection degree
18 Tightening torque
18 Nm - 159 lbs in

4 x 380mm² and 2 x 240mm² FC CuAl

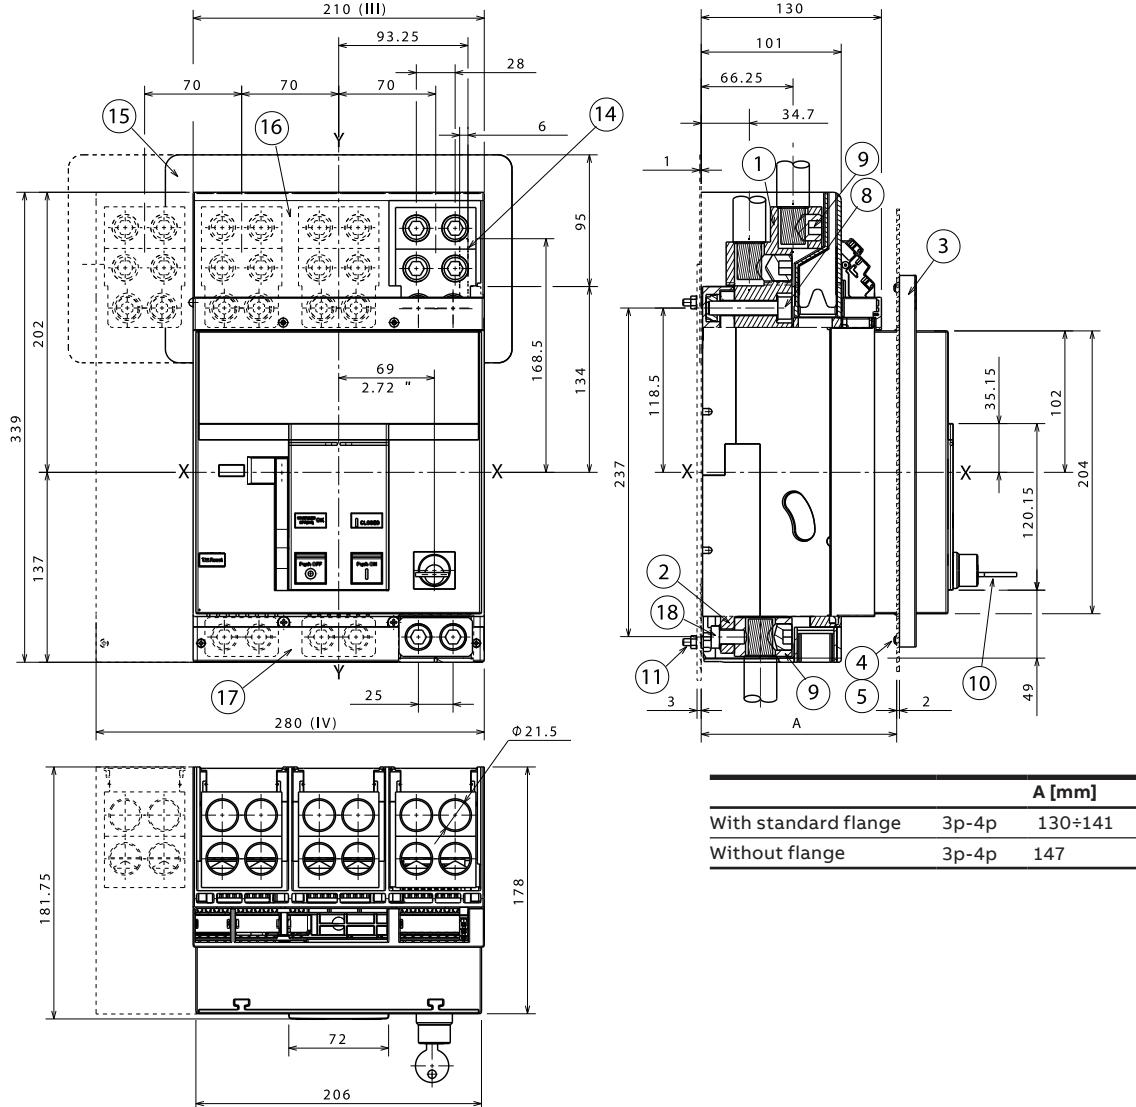


Terminals HR/VR adjustable

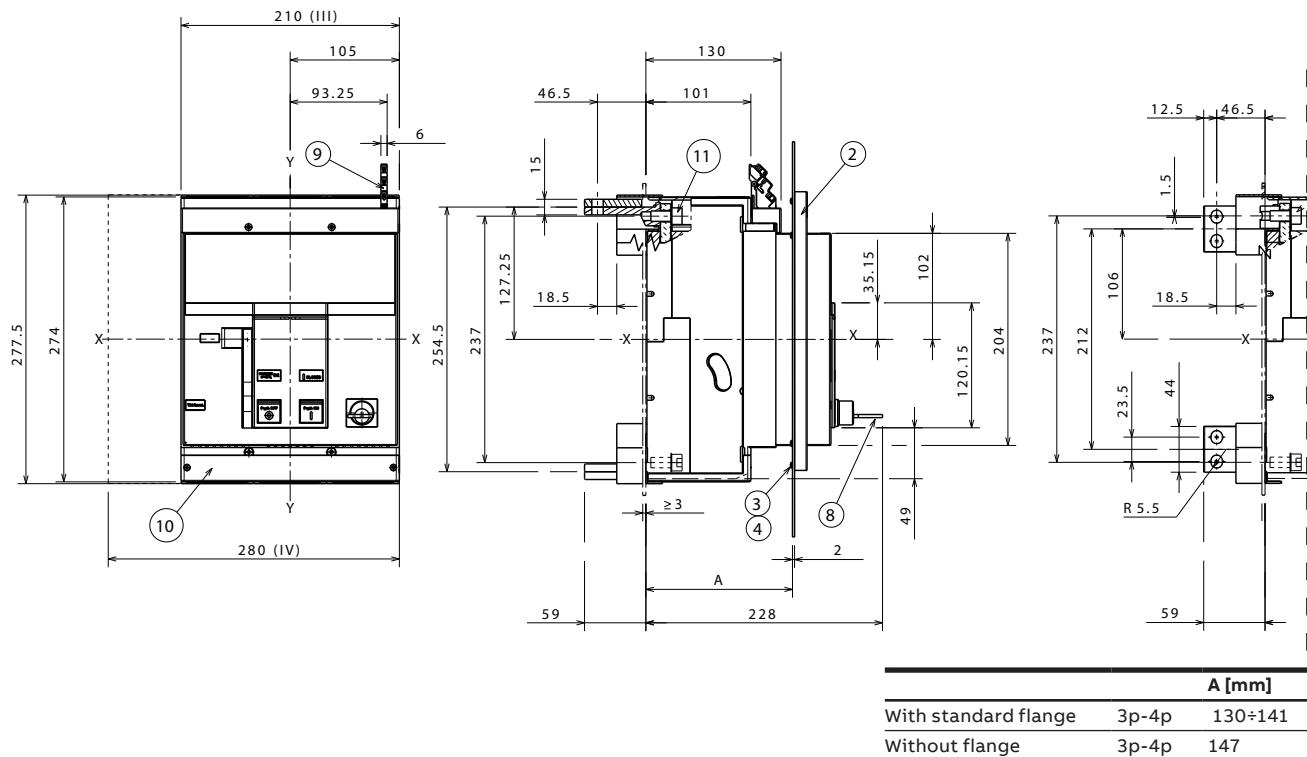


Key

- 1 HR horizontal rear terminal HR
- 2 Flange for the compartment door
- 3 Flange fixing screws
- 4 Tightening torque 0.5 Nm - 4.4 lbs in
- 8 Key lock
- 9 Padlock
- 10 Slot for external signaling
- 11 Tightening torque 20 Nm - 177 lbs in

Terminals HR upper

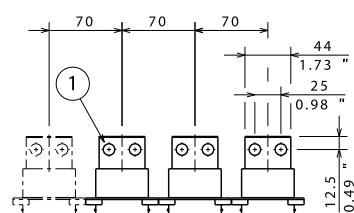


Terminals VR lower

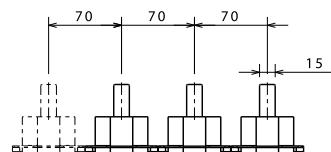

Key

- 8 Drilling template support plate

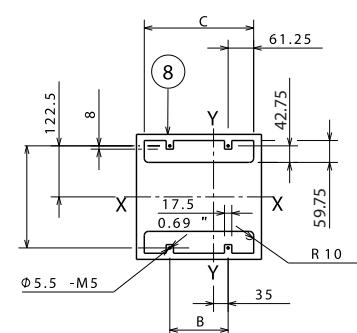


| | 3p | 4p |
|---|-------|-------|
| B | 70 | 140 |
| C | 192.5 | 262.5 |

Tmax XT7 M – Installation

Terminals for fixed circuit-breaker


Terminals HR and VR

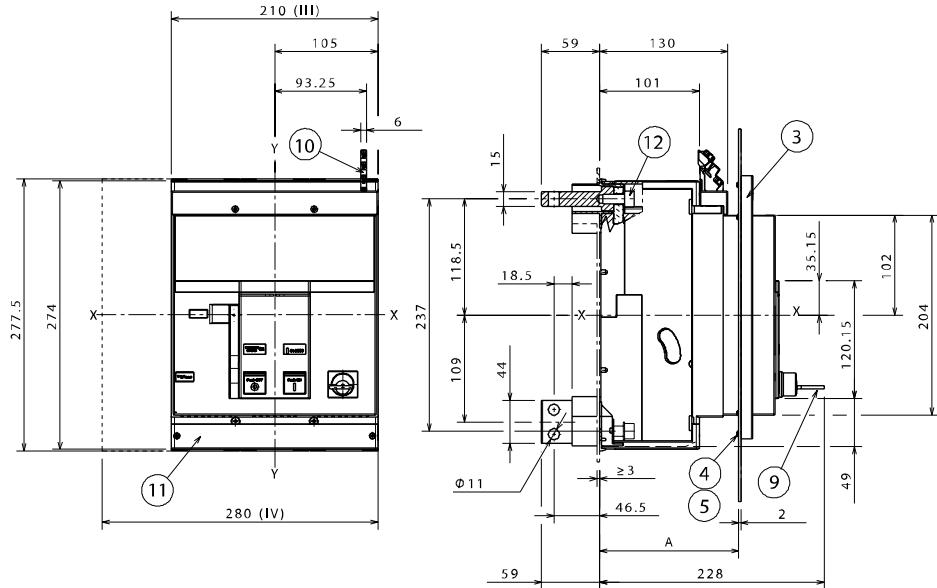


| | A [mm] |
|----------------------|---------------|
| With standard flange | 3p-4p 130÷141 |
| Without flange | 3p-4p 147 |

Key
 1 HR horizontal rear terminal HR
 2 VR vertical rear terminal VR
 3 Flange for the compartment door
 4 Flange fixing screws
 5 Tightening torque 0.5Nm - 4.4lbs in
 9 Key lock
 10 Clamp for auxiliary contacts
 11 Low protection cover with IP30 protection degree
 12 Tightening torque 9Nm


Terminals HR upper

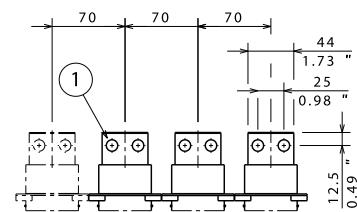

Terminals VR lower

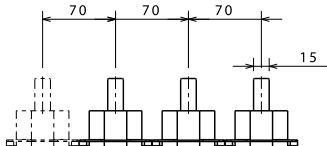

Key
 8 Drilling template support plate

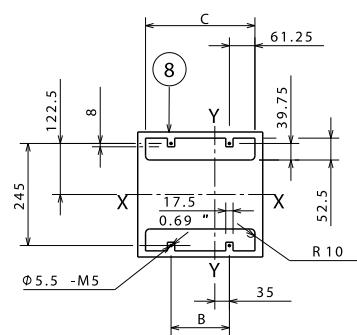


| | 3p | 4p |
|---|-------|-------|
| B | 70 | 140 |
| C | 192.5 | 262.5 |


Tmax XT7 M – Installation

Installation for withdrawable circuit-breaker

Fixing on sheet

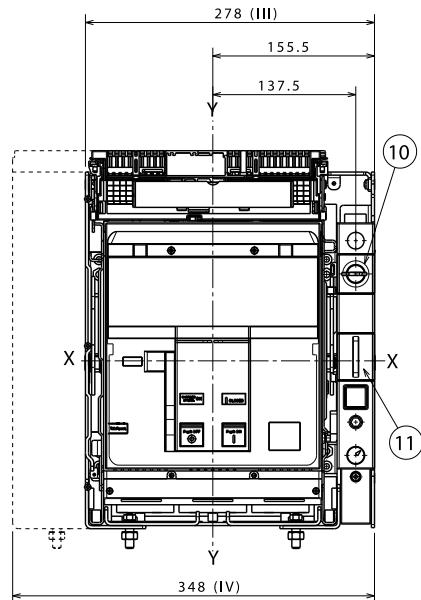


Drilling template for support sheet

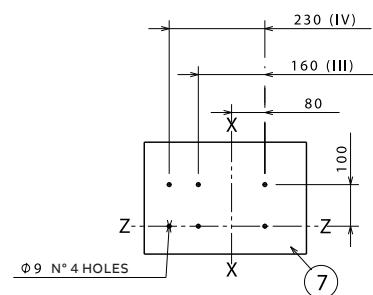


— Key

- 3 Flange for the compartment door
- 6 Compartment door drilling template for flange
- 7 Fixing on sheet steel drilling template
- 10 Key lock
- 11 Padlock

Flange




Drilling template compartment door

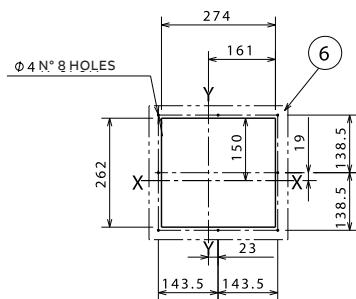


Tmax XT7 M – Installation

Terminals for withdrawable circuit-breaker


Terminals R

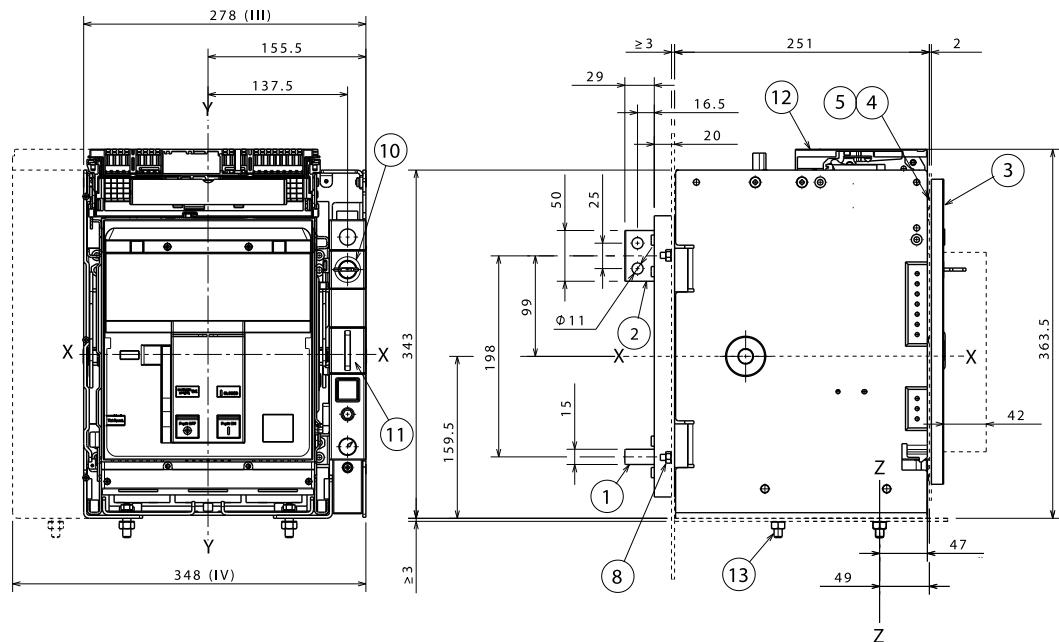

Terminals VR lower

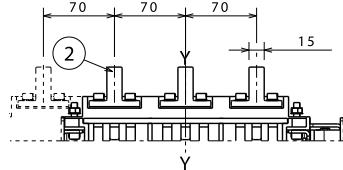

Terminals HR lower

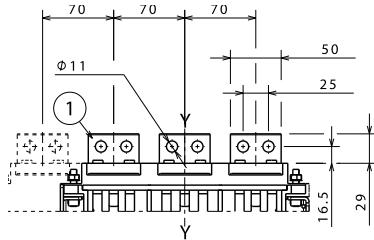


—
Key

-

Tmax XT – Common accessories


Horizontal interlock XT series

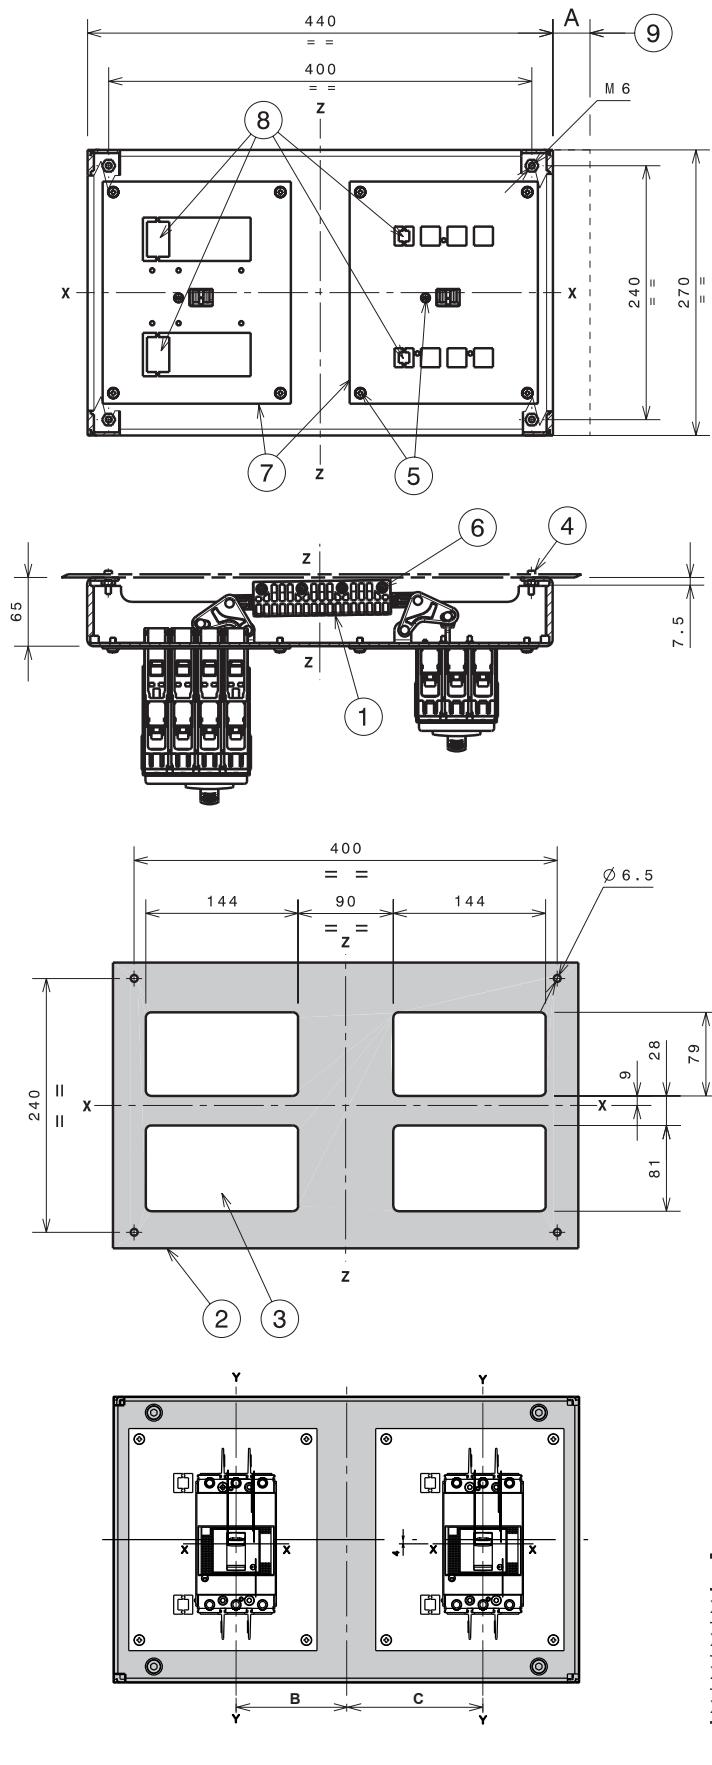


Tmax XT – Common accessories

Horizontal interlock XT series

Horizontal interlock between two circuit breakers (MIR-H)

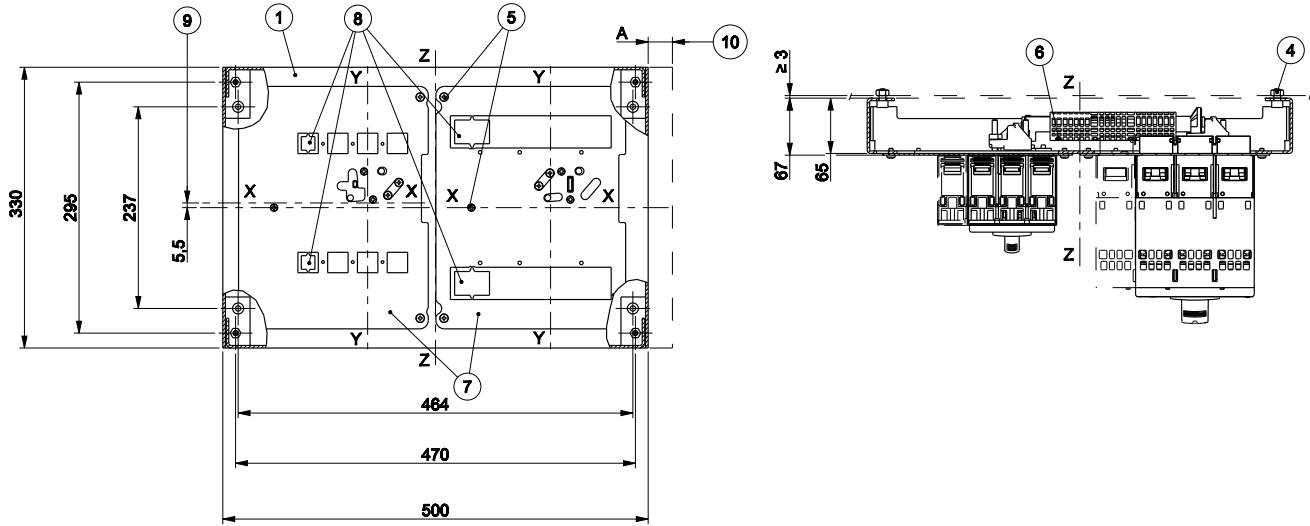


Drilling template

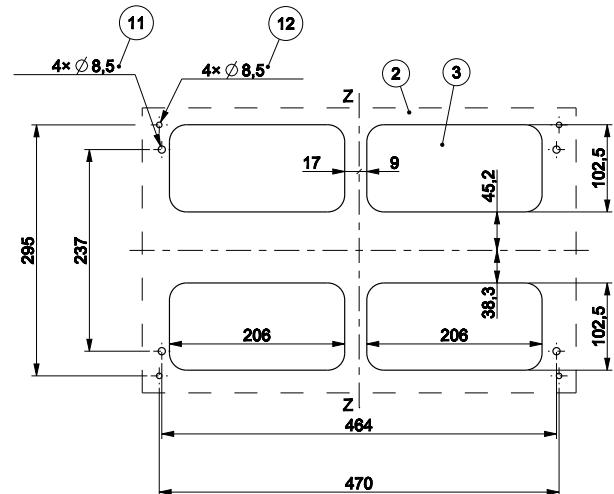


- Key
- 1 Interlocking mechanism
 - 2 Drilling template for fixing interlocking system
 - 3 Drilling template for all version with rear terminals
 - 4 Tightening torque 3,7Nm
 - 5 Tightening torque 3Nm
 - 6 Tightening torque 2,5Nm
 - 7 Interlocking plate for circuit-breakers
 - 8 Provision for 4p circuit-breaker
 - 9 Dimension for XT4 circuit-breaker only
 - 10 A = 23mm XT4 withdrawable with key lock for fixed part
A = 28,5mm XT5 withdrawable with key lock for fixed part
 - 11 Hole for front mounting only
 - 12 Hole for rear mounting only

Interlocking plate

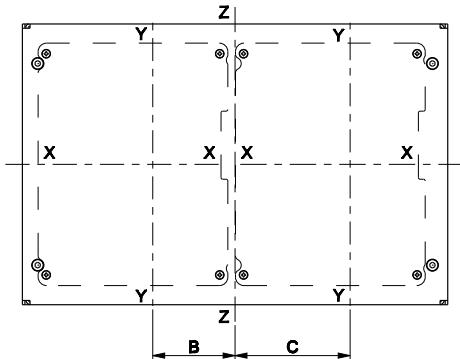

| Type | Description | B | C |
|---------|-------------|-------|--------|
| Plate A | XT4 F | 79.75 | 152.25 |
| Plate B | XT4 P/W | 79.75 | 152.25 |
| Plate C | XT5 F | 96.75 | 135.25 |
| Plate D | XT5 400 P/W | 96.75 | 135.25 |
| Plate E | XT5 630 P/W | 96.75 | 135.25 |

Horizontal interlock between two circuit breakers (MIR-H)

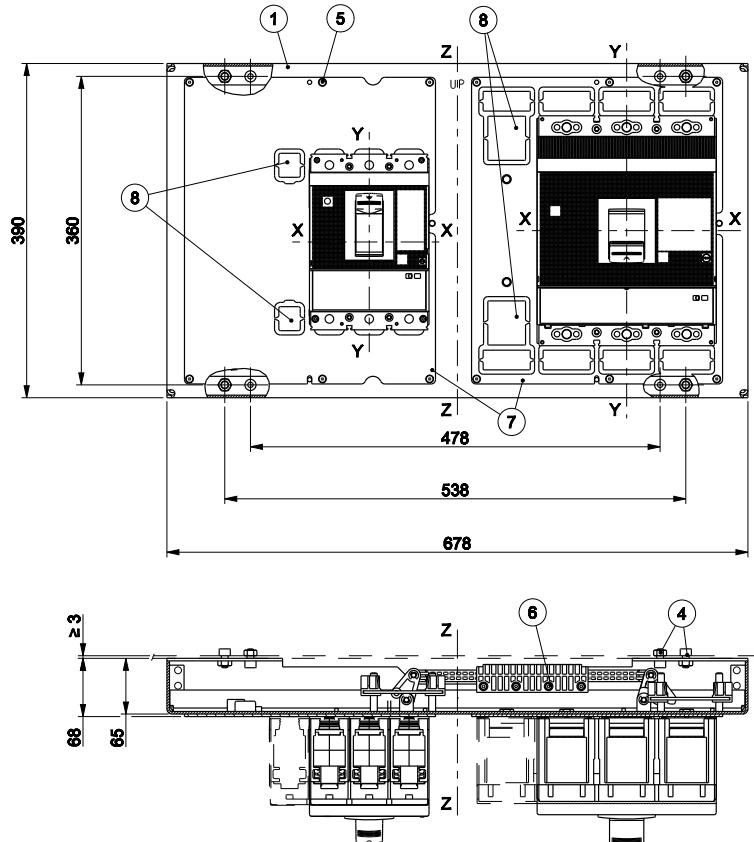


- Key**
- 1 Interlocking mechanism
 - 2 Drilling template for fixing interlocking system
 - 3 Drilling template for all version with rear terminals
 - 4 Tightening torque 18Nm
 - 5 Tightening torque 3Nm
 - 6 Tightening torque 3Nm
 - 7 Interlocking plate for circuit-breakers
 - 8 Provision for 4p circuit-breaker


Tmax XT – Common accessories

Horizontal interlock XT series

Drilling template

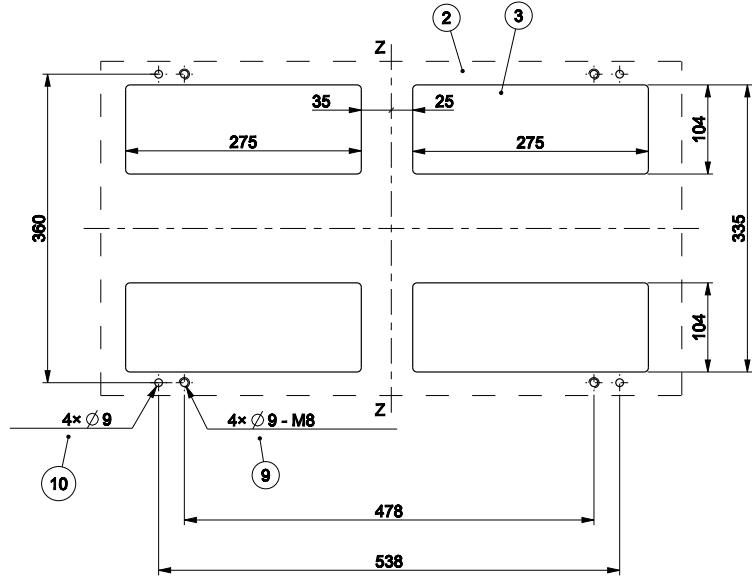

Interlocking plate



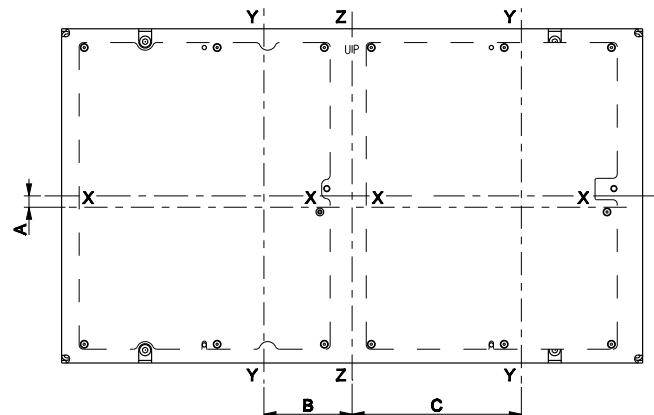


Key
 9 - 4xØ9-M8 hole for front mounting only
 10 - 4xØ9 hole for rear mounting only

| Coupling plate type | A | B | C |
|---------------------|-------|-------|-------|
| MIR-P XT5 F | 13.25 | 102.9 | 232.1 |
| MIR-P XT5 P/W 400 | 13.25 | 102.9 | 232.1 |
| MIR-P XT5 P/W 630 | 13.25 | 102.9 | 232.1 |
| MIR-P XT6 F | 0 | 137.5 | 197.5 |
| MIR-P XT6 W | 0 | 137.5 | 197.5 |

Tmax XT – Common accessories

Vertical interlock XT series

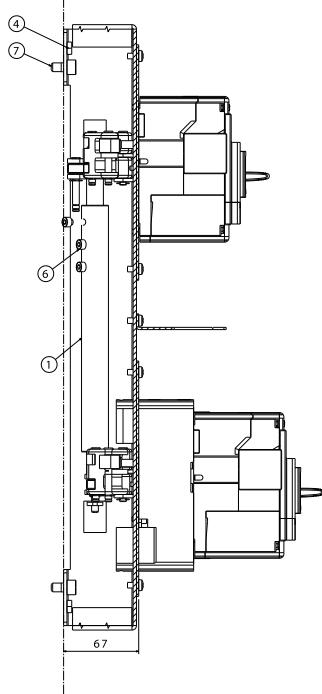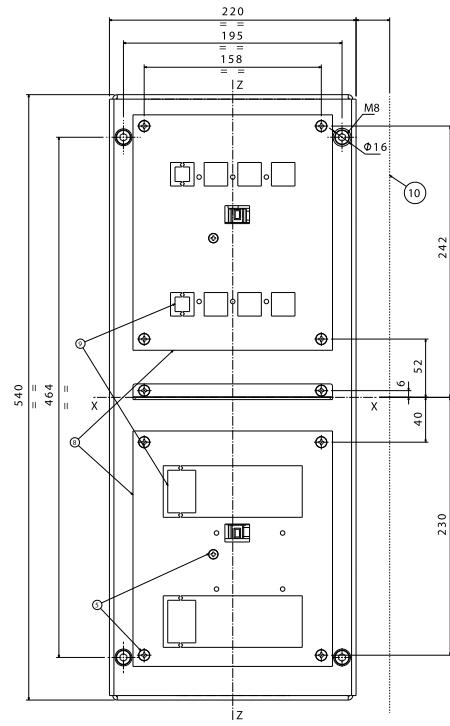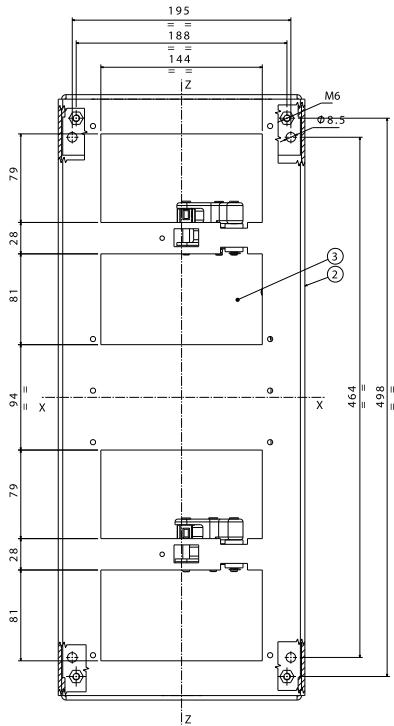

— Key

- 1 Interlock device
- 2 Drilling template for fixing the interlock device on sheet Steel
- 3 Drilling template for all rear terminal version
- 4 Tightening torque 9Nm
- 6 Tightening torque 1Nm
- 7 Tightening torque under customer's responsibility
- 9 Provision for 4p circuit-breaker
- 10 A=35mm for XT4 fixed part Withdrawable with padlock device A=30mm for XT2 fixed part withdrawable with padlock device


— Note:

For the overall dimensions of the circuit-breaker see the relevant dimension tables and the configuration

Tmax XT – Common accessories

Vertical interlock XT series


Vertical interlock between two circuit breakers (MIR-V)

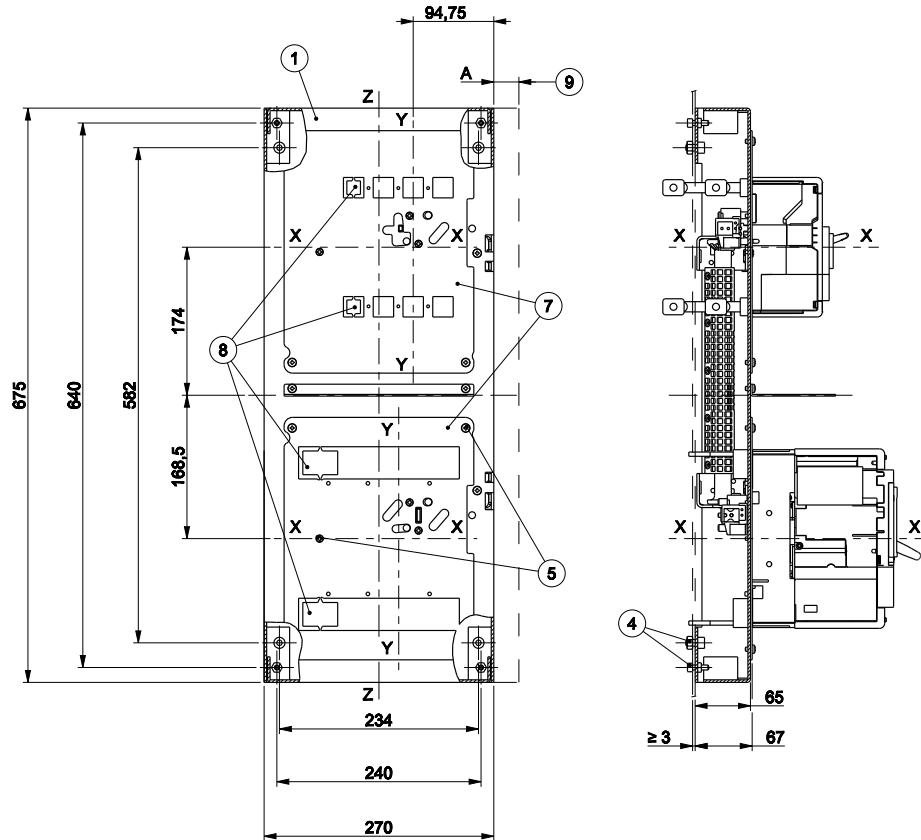


Key

- 1 Interlocking mechanism
- 4 Tightening torque 3,7Nm
- 5 Tightening torque 3Nm
- 6 Tightening torque 2,5Nm
- 7 Interlocking plate for circuit-breakers
- 8 Provision for 4p circuit-breaker
- 9 A = 26mm XT4 withdrawable with key lock for fixed part
A = 29,5mm XT5 withdrawable with key lock for fixed part

Drilling template

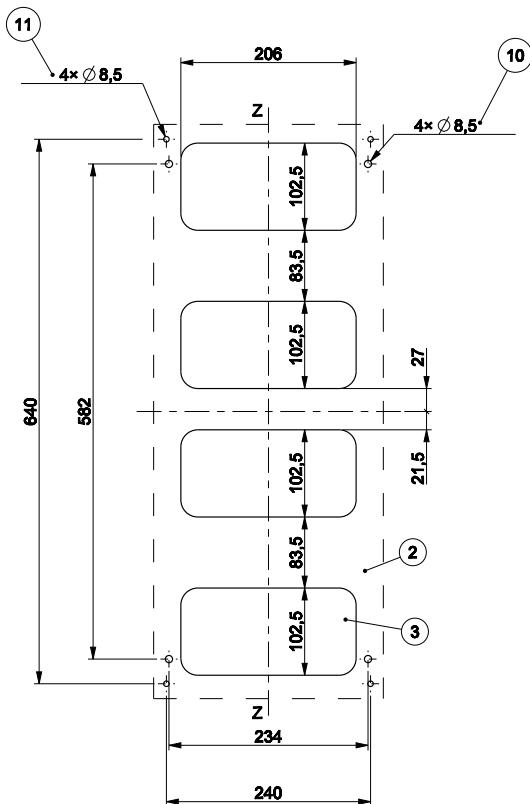

Interlocking plate

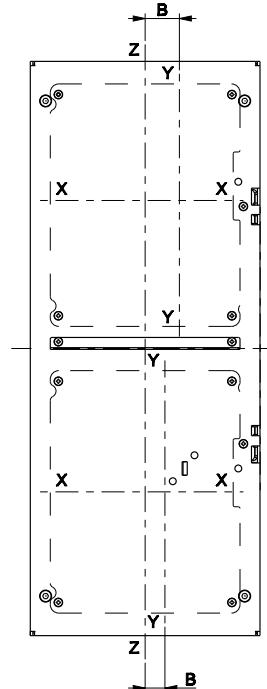

—
Key


- 2 Drilling template for fixing interlocking system
 - 3 Drilling template for all version with rear terminals
 - 10 Hole for front mounting only
 - 11 Hole for rear mounting only

| Type | Description | B |
|----------------|-------------|-------|
| Plate A | XT4 F | 40.25 |
| Plate B | XT4 P/W | 40.25 |
| Plate C | XT5 F | 23.25 |
| Plate D | XT5 400 P/W | 23.25 |
| Plate E | XT5 630 P/W | 23.25 |

Tmax XT – Common accessories


Vertical interlock XT series

Vertical interlock between two circuit breakers (MIR-V)

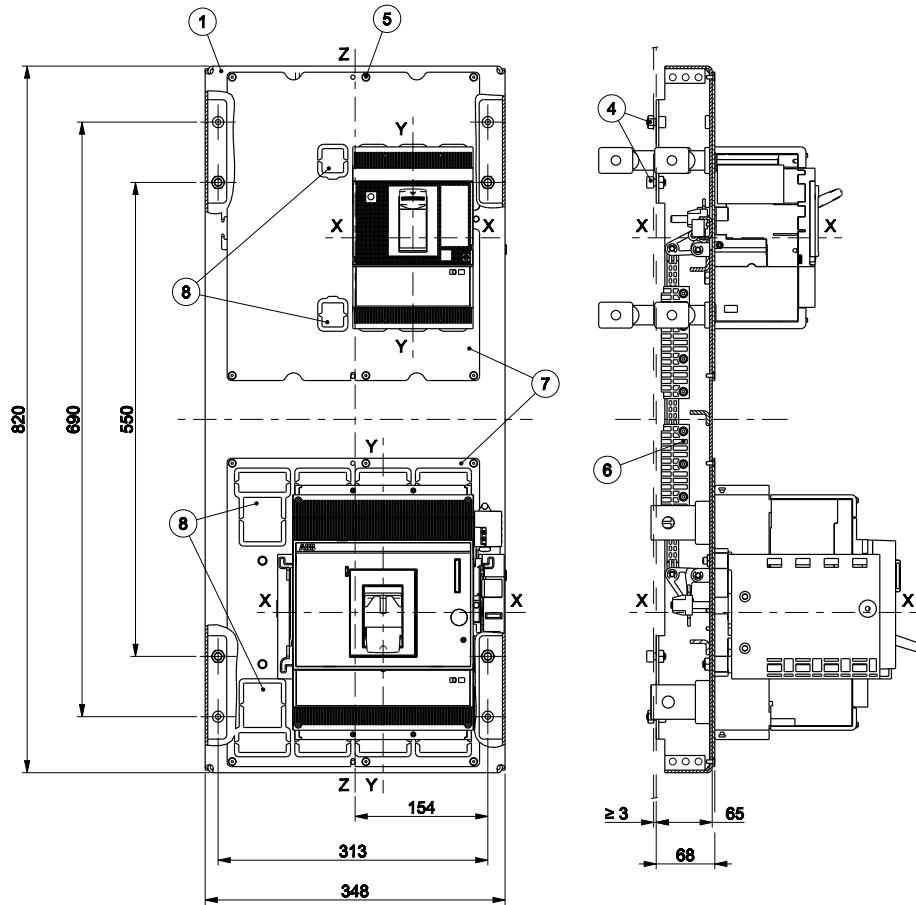


| Key | |
|-----|---|
| 1 | Interlocking mechanism |
| 4 | Tightening torque 18Nm |
| 5 | Tightening torque 3Nm |
| 6 | Tightening torque 3Nm |
| 7 | Interlocking plate for circuit-breakers |
| 8 | Pre-drilling for 4P version |

Drilling template

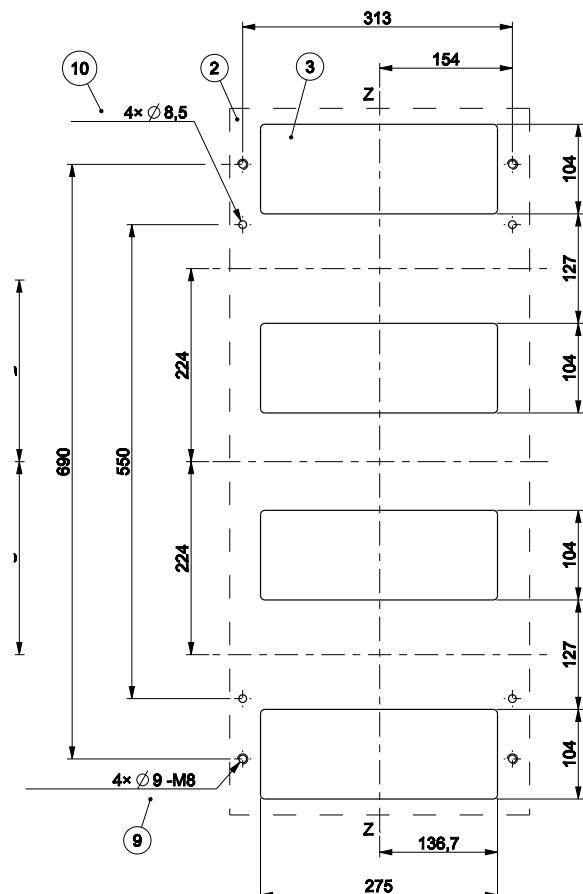

Interlocking plate

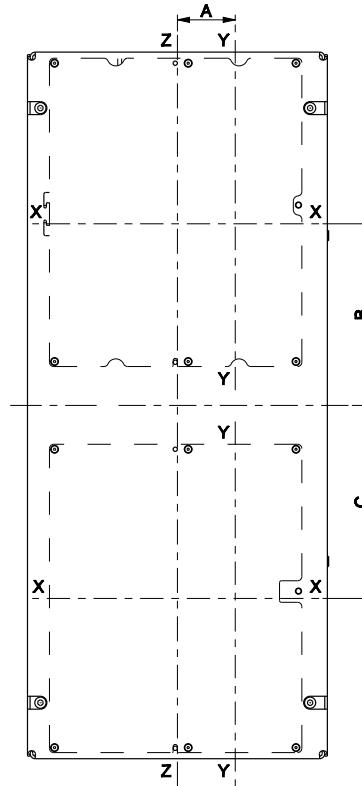**Key**

- 2 Drilling template for fixing interlocking system
- 3 Drilling template for all version with rear terminals
- 9 4xØ9-M8 hole for front mounting only
- 10 4xØ9 hole for rear mounting only

| Coupling plate type | A | B | C |
|---------------------|------|--------|--------|
| MIR-P XT5 F | 67.1 | 210.75 | 237.25 |
| MIR-P XT5 P/W 400 | 67.1 | 210.75 | 237.25 |
| MIR-P XT5 P/W 630 | 67.1 | 210.75 | 237.25 |
| MIR-P XT6 F | 32.5 | 224 | 224 |
| MIR-P XT6 W | 32.5 | 224 | 224 |

Wiring diagrams

Reading information

- 3/2** Graphical symbols for electrical diagrams (617 IEC STANDARDS)
3/4 Information on how to read the diagrams

Wiring diagrams

- 3/13** Diagrams for XT1...XT4
3/17 Diagrams for XT5-XT6
3/37 Diagrams for XT7 and XT7 M
3/61 XT2-XT4-XT5-XT7-XT7 M modules

































To access the full set of wiring diagrams in ABB Library scan the QR code or enter through the following link: to.abb/Z4hPKw-D

Reading information

Graphical symbols for electrical diagrams (60617 IEC STANDARDS)

Graphical symbols for electrical diagrams (Standards IEC 60617)

| | | | | | |
|---|---|---|--|---|---|
|  | Thermal effect |  | Conductors with corded cables (example two conductors) |  | Three-phase asynchronous motor, with short-circuited rotor (cage) |
|  | Electromagnetic effect |  | Key operating mechanism |  | Current transformer |
|  | Timing |  | Cam operating mechanism |  | Current transformer with primary consisting of 4 passing conductors and with wound secondary, with socket |
|  | Mechanical connection |  | Ground (general symbol) |  | Closing contact |
|  | Manual mechanical operating mechanism (general case) |  | Connection of conductors |  | Voltmeter |
|  | Rotary handle operating mechanism |  | Terminal or clamp |  | Opening contact |
|  | Pushbutton operating mechanism |  | Socket and plug (female and male) |  | Changover contact with momentary break |
|  | Converter separated galvanically |  | Resistor (general symbol) |  | Closing position contact (limit switch) |
|  | Conductors in shielded cable (example two conductors) |  | Resistor dependent on the temperature |  | Opening position contact (limit switch) |
|  | Watt-hour meter |  | Motor (general symbol) |  | Changover contact with momentary break (limit switch) |

| | | | | | |
|---|---|---|---|---|---|
|  | Contactor (closing contact) |  | Overcurrent release with long inverse adjustable time delay characteristic |  | Brush |
|  | Power cut-off of switch- disconnector power with automatic opening |  | Overcurrent release for earth fault with short inverse time characteristic |  | Wattmeter |
|  | Switch-disconnector |  | Current relay for unbalance between phases |  | Screen, shield (it may be drawn in any convenient shape) |
|  | Control coil (general symbol) |  | Residual current release |  | Ideal current source |
|  | Thermal trip unit |  | Relay for detecting lack of phase in a three-phase system |  | Three connections |
|  | Instantaneous overcurrent release |  | Relay for detecting blocked rotor by means of current measurement |  | Voltage transformer |
|  | Ammeter |  | Lamp, general symbol |  | Winding of three-phase transformer, connection star |
|  | Overcurrent release with short adjustable time delay characteristic |  | Motor with excitation in series |  | Primary cell, secondary cell, battery of primary cell or secondary cell |
|  | Overcurrent release with short inverse adjustable time delay characteristic | | | | |

Reading information

Information on how to read the diagrams

State of operation shown

The diagrams are shown in the following conditions:

- fixed version circuit-breaker, open;
- withdrawable or plug-in version circuit-breaker, open and connected;
- contactor for starting the motor open;
- circuits de-energised;
- trip units not tripped;
- motor operator with springs charged.

Key XT1...XT4

| | | | |
|-----------------|--|------------|---|
| * | = See note indicated by the letter | K | = Motor starting contactor |
| A12 | = Ekip Com type interface unit | K51 | = Ekip type electronic relay for overcurrent protection |
| A13 | = Ekip Signaling 10K type signaling unit | K51/CI | = Motor starting contactor operator module |
| A14 | = MOE-E type stored energy motor operator actuating unit | K51/COM | = Communication module |
| A15 | = Ekip Multimeter type measurement unit | K51/MEAS | = Measurement module |
| A16 | = Ekip Micro Module I/O type interface unit | K51/SIGN | = Signaling module |
| A17 | = MOE type stored energy motor operator actuating unit | K51/SUPPLY | = Auxiliary supply module (110-240VAC/DC and 24-48VDC) |
| BUS1 | = Serial interface with external bus | K51/SYNC | = Synchronizing module |
| BUS2 | = Redundant serial interface with external bus | K51/TEMP | = Temperature monitoring module |
| LINK BUS | = Interface with external Link bus | K87 | = Residual current relay |
| | D 2 Electronic time-delay device for undervoltage release coil YU, outside circuit-breaker (only for voltage up to 250 V) | M | = Motor with energizing in series for circuit-breaker opening and closing (Fig. 21) |
| H2 | = Signaling lamp for stored energy motor operator blocked | M | = Motor for opening circuit-breaker and loading the closing springs (Fig. 22-54-55-56-57) |
| I 11...32 | = Programmable digital inputs | M1 | = Three-phase asynchronous motor |
| 41...43 51...53 | = Analog inputs from temperature sensor | 0 11...32 | = Programmable signaling contacts |
| 44-54 | = Analog inputs from 4-20mA sensor | OCI | = Contact for motor starting contactor operating mechanism |
| Pt1OO | = Analog input from Pt1OO temperature sensor of motor | 0 SC | = Synchronism monitoring contact |
| I reset | = Digital input for resetting tripped motor starting contactor operating unit | Q | = Main circuit-breaker |
| J... | = Connectors for auxiliary circuits of withdrawable circuit-breaker. Withdrawal of connectors occurs at the same time as that of circuit-breaker | Q/O...7 | = Auxiliary contacts of the circuit-breaker open/closed |
| | | R-R1 | = Resistor |
| | | R2 | = Pt100 temperature sensor of motor |
| | | 81 | = Contact controlled by the motor operator cam |
| | | 82 | = Contact controlled by the key lock of the direct action motor operator |
| | | 83/1-2 | = Contacts operated by Auto/Manual selector switch and by key lock of the stored energy motor operator |
| | | S4 | = Contact operated by direct action motor operator cam |
| | | S4/1-2 | = Early auxiliary contacts operated by circuit-breaker mounted crank handle |
| | | 851 | = Contact for signaling circuit-breaker open due to tripped thermomagnetic overcurrent protection release or electronic relay |

| | | | |
|-------------|--|-----------|--|
| 86/1-2 | = Contacts controlled by Auto/Manual selector switch of direct action motor operator | W2 | = Serial interface with internal bus (local bus) |
| S75E/1-2 | = Contacts for signaling circuit-breaker in withdrawn position (only applicable to withdrawable circuit-breaker versions) | W9...14 | = Connector RJ45 for interface unit and for communication modules |
| S75I/1-2-5 | = Contacts for signaling circuit-breaker in racked-in position (only applicable to withdrawable or plug-in circuit-breaker versions) | W9R...12R | = Connector RJ45 for redundant communication modules |
| S87/1 | = Contact for electrical signaling of residual current relay prealarm | X3-X4-X8 | = Protection relay connectors |
| S87/2 | = Contact for electrical signaling of residual current relay alarm | X41 | = Connector of current circuit for external neutral |
| S87/3 | = Contact for electrical signaling of circuit-breaker open due to residual current relay trip | XB.. | = Three-way connector for auxiliary circuits of plug-in circuit-breaker |
| SC | = Pushbutton or contact for closing the circuit-breaker | XC.. | = Six-way connector for auxiliary circuits of plug-in circuit-breaker |
| SC3 | = Motor start pushbutton | XC2-3 | = Six-way connector for auxiliary circuits of plug-in circuit-breaker for voltage up to 400V |
| SD | = Residual current relay supply disconnect | XCT1-2 | = Terminal box of Ekip DIN Rail Cartridge Basic or Ekip DIN Rail Cartridge |
| SO | = Pushbutton or contact for opening circuit-breaker | XD.. | = Nine-way connector for auxiliary circuits of plug-in circuit-breaker |
| SO3 | = Motor stop pushbutton | XE.. | = Fifteen-way connector for auxiliary circuits of plug-in circuit-breaker |
| SR | = Electrical reset pushbutton or contact | XF.. | = Ekip Com type interface unit connector |
| SY/1...3 | = Contacts for signaling circuit-breaker open due to tripped overcurrent protection relay, thermomagnetic release and coils Y0, YO1, Y02, YU (trip position) | XG | = Protection relay connector |
| TI | = Toroidal current transformer | XH1 | = Protection relay connector |
| TI/L1-L2-L3 | = L1-L2-L3 phase current transformer | XK7 | = Connector of contact S75I/5 |
| TI/N | = Current transformer on neutral | XM | = MOE-E actuator unit connector |
| TU2 | = Insulation voltage transformer (out side circuit-breaker) | XV | = Terminal box of circuit-breaker applications |
| Uaux | = Auxiliary supply voltage | YC | = Closing coil of stored energy motor operator |
| V1 | = Circuit-breaker applications | YO | = Opening coil |
| V2 | = Motor operator applications | YO1 | = Coil for opening due to overcurrent |
| V4 | = Indicative switchgear and connections for operation and signaling, out side circuit-breaker | YO2 | = Opening coil of residual current relay |
| V5 | = Ekip DIN Rail Cartridge Basic or Ekip DIN Rail Cartridge applications | YU | = Undervoltage coil |

Reading information

Information on how to read the diagrams

Notes XT1...XT4

- A) The presence of an auxiliary supply is required for the local bus and zone selectivity functions (see Fig. 51-81).
- B) The undervoltage coil is provided for power supply branched on the supply side of the circuit-breaker or from an independent source: circuit-breaker can only close when coil is energized (closing lock is obtained mechanically).
- C) Contacts 84/1 and 84/2 of Fig. 7-8 open circuit when circuit-breaker is open and close it again when a manual closing command is imparted by means of the rotary handle, in accordance with the Standards governing machine tools (however, circuit-breaker will not close if undervoltage release is not being supplied).
- E) If the application in Fig. 21 and the contacts in Fig. 31 must be installed at the same time, contact 0/2 must be installed in the adjacent slot (marked 0/1).
- F) R= Additional external undervoltage resistor supplied at 380/440 VAC and 480/525 VAC.
R1= Additional external resistor for stored energy motor operator or direct action motor operator supplied at 480/525VAC.
- G) If a three-pole fixed circuit-breaker with current transformer on the neutral conductor outside the circuit-breaker is used, the terminals of the TI/N transformer must be short-circuited when the circuit-breaker must be removed.
- H) "Galvanically separated converters" conforming to standards IEC 60950 (UL 1950) or equivalent must be used since an earthed Uaux is required.
- I) Mandatory in the presence of any sort of Ekip module.
- L) Only one application among Fig. 83...97-131-132 can be supplied in the case of Ekip DIN Rail Cartridge Basic. In the case of Ekip DIN Rail Cartridge, up to three applications can be supplied among Fig. 83...97-131-132, taken once only. In addition, the Ekip Com module (if chosen) can be duplicated by choosing among Fig. 110...116.
- M) To ensure correct operation, at least one module must always be present.
- N) BELDEN 3105A cables or an equivalent type must be used.
- O) When there are several Ekip Com modules with withdrawable circuit-breakers, contact S75I/5 must be connected once only to one single module.
- P) Auxiliary voltage Uaux allows all the functions of EKIP electronic protection relays to be activated. "Galvanically separated converters" conforming to standards IEC 60950 (UL 1950) or equivalent must be used since an earthed Uaux is required.
- Q) BELDEN 3105A cables or an equivalent type must be used. Maximum length 15 m.
- R) Recommended RJ45 cable: CAT6 STP.
- S) Consult "Technical Application Papers - vol. 9: Communication via BUS with ABB circuit-breakers" for connection of the EIA RS485 serial line.
- T) Short-circuit terminals 1200 on to install a termination resistor on the Local Bus.
- U) Use Belden 3079A cables or equivalent. Consult White Paper 1SDCOO741ZGO201 "Communication with SACE Emax 2 circuit-breakers" for further details.
- V) Use Belden 3084A cables or equivalent. Consult White Paper 1SDC00741G0201 "Communication with SACE Emax 2 circuit-breakers" for further details.
- Z) Ekip Supply cannot be used to energize the electronic relay via terminals K1 and K2.
- AA) Consult Fig. 51 or 81 for the connection of W3 and W4.
- AB) Use two-pole shielded cable type BELDEN 8762/8772 or equivalent. The shield must be earthed on the selectivity input side (for zone selectivity) or on both sides (for other applications).
- AC) The rated maximum secondary voltage is 120V.
- AD) Use insulated cables for thermocouples such as PENTRONIC TEC/SITW-24F (Type TX) or equivalent. Maximum length 3 m.
- AE) Use suitable cables up to 3 meters in length compatible with the workplace in which the 4-20mA current sensor is used.

Key XT5-XT6

| | |
|-----------------|---|
| * | = See note indicated by the letter |
| A12 | = Ekip Com type Interface unit |
| A13 | = Ekip Signaling 10K type signaling unit |
| A14 | = MOE-E type stored energy motor operator actuating unit |
| A15 | = Ekip Multimeter type measurement unit |
| A16 | = Ekip Micro Module I/O type interface unit |
| A17 | = MOE type stored energy motor operator actuating unit |
| A18 | = Ekip DIN Rail Cartridge Basic |
| A19 | = Ekip DIN Rail Cartridge |
| BUS1 | = Serial interface with external bus |
| BUS2 | = Redundant serial interface with external bus |
| LINK BUS | = Interface with external Link bus |
| D | = Electronic time delay device for undervoltage release coil YU, outside circuit-breaker (only for voltages up to 250V) |
| H2 | = Signaling lamp for stored energy motor operator blocked |
| I 01-11...32 | = Programmable digital inputs |
| I 41-51 | = Analog inputs from 4-20mA sensor |
| I 42-44 52...54 | = Analog inputs temperature sensor |
| I Pt 100 | = Analog input from Pt 100 temperature sensor of motor |
| I reset | = Digital input for resetting tripped motor startin contactor operating unit |
| J... | = Connectors for auxiliary circuits of a withdrawable circuit-breaker. Withdrawal of connectors occurs at the same time as that of circuit-breaker |
| K | = Motor starting contactor |
| K51 | = Ekip type electronic relay for overcurrent protection |
| K51/Cl | = Motor starting contactor operator module |
| K51/COM | = Communication module |
| K51/SIGN | = Signaling module |
| K51/SUPPLY | = Auxiliary supply module (110-240VAC/DC and 24-48Vdc) |
| K51/SYNC | = Synchronizing module |

| | |
|--------------|--|
| K51/TEMP | = Temperature monitoring |
| K87 | = Residual current release type RC Inst, RC Sel, RC Sel 200, RC B Type |
| KO | = Auxiliary opening relay |
| M | = Motor for opening circuit-breaker and loading closing springs |
| O 01-11...32 | = Programmable signaling contacts |
| OCI | = Contact for motor starting contactor operating mechanism |
| O SC | = Synchronism monitoring contact |
| Q | = Main circuit-breaker |
| Q/0..7 | = Auxiliary contacts of the circuit-breaker open/closed |
| Q/26 | = Open/Close auxiliary used internally by protection release |
| R | = Resistor |
| R2 | = Pt100 temperature sensor of motor |
| S1 | = Contact controlled by the motor operator cam |
| S3/1-2 | = Contacts controlled by Auto/Manual selector switch and key lock of motor |
| S4/1-2 | = Early auxiliary contacts |
| S4/1-4 | = Early auxiliary contacts operated by circuit-breaker mounted crank handle |
| S51 | = Contact for signaling circuit-breaker open due to tripped thermomagnetic overcurrent protection release or electronic relay |
| S52 | = YU/YO trip signaling contact (for voltage up to 250V) |
| S75E/1 | = Contact for signaling circuit-breaker in racked out position (only applicable to withdrawable circuit-breaker versions) |
| S75E/1-2-3 | = Contacts for signaling circuit-breaker in racked-in position (only applicable to withdrawable or plug-in circuit-breaker versions) |
| S75T/1 | = Contact for signaling circuit-breaker in test position (only applicable to withdrawable circuit-breaker versions) |
| S87/1 | = Contact for electrical signaling of residual current relay prealarm |
| S87/2 | = Contact for electrical signaling of residual current relay alarm |

Reading information

Information on how to read the diagrams

| | | | |
|-------------|---|--------|--|
| S87/3 | = Contact for electrical signaling of circuit-breaker open due to residual current relay trip | XCT1-2 | = Terminal box of Ekip DIN Rail Cartridge Basic or Ekip DIN Rail Cartridge |
| SC | = Pushbutton or contact for closing the circuit-breaker | XD.. | = Nine-way connector for auxiliary circuits of plug-in circuit-breaker |
| SC3 | = Motor start pushbutton | XE.. | = Fifteen-way connector for auxiliary circuits of plug-in circuit-breaker |
| SD | = Residual current relay supply disconnector | XF.. | = Ekip Corn type interface unit connector |
| SO | = Pushbutton or contact for opening circuit-breaker | XH1 | = Protection relay connector |
| S03 | = Motor stop pushbutton | XV | = Terminal box of circuit-breaker applications |
| SR | = Electrical reset pushbutton or contact | YC | = Closing coil of stored energy motor operator |
| SY/1...3 | = Contacts for signaling circuit-breaker open due to tripped overcurrent protection relay, thermomagnetic release and coils YO, YO1, YO2, YU (tripped position) | YO | = Opening coil |
| TI | = Toroidal current transformer | YO1 | = Coil for opening due to overcurrent |
| TI/L1-L2-L3 | = L1-L2-L3 phase current transformer | YO2 | = Opening coil of residual current relay |
| TI/N | = Current transformer on neutral | YU | = Undervoltage coil |
| TU2 | = Insulation voltage transformer (out side circuit-breaker) | YU/0 | = Undervoltage and opening coil (Combo) |
| Uaux | = Auxiliary supply voltage | | |
| V1 | = Circuit-breaker applications | | |
| V2 | = Motor operator applications | | |
| V4 | = Indicative switchgear and connections for operation and signaling, outside circuit-breaker | | |
| V5 | = Ekip DIN Rail Cartridge Basic or Ekip DIN Rail Cartridge applications | | |
| W2 | = Serial interface with internal bus (local bus) | | |
| W9...14 | = Connector RJ45 for interface unit and for communication modules | | |
| W9R...12R | = Connector RJ45 for redundant communication modules | | |
| X3-X4-X8 | = Protection relay connectors | | |
| XB.. | = Three-way connector for auxiliary circuits of plug-in circuit-breaker | | |
| XC.. | = Six-way connector for auxiliary circuits of plug-in circuit-breaker | | |
| XC2-3 | = Six-way connector for auxiliary circuits of plug-in circuit-breaker for voltage up to 400V | | |

Notes XT5-XT6

- A) The presence of an auxiliary supply is required for the local bus and zone selectivity functions (see Fig. 41-78).
- B) The undervoltage coil is provided for power supply branched on the supply side of the circuit-breaker or from an independent source: circuit-breaker can only close when coil is energized (closing lock is obtained mechanically).
- C) Contacts S4/1 and S4/2 of Fig. 7-10-15 open circuit when circuit-breaker is open and close it again when a manual closing command is imparted by means of the rotary handle, in accordance with the Standards governing machine tools (however, circuit-breaker will not close if undervoltage release is not being supplied).
- D) Only for XT5 F-P.
- E) Only for XT5.
- G) If a three-pole fixed circuit-breaker with current transformer on the neutral conductor outside the circuit-breaker is used, the terminals of the TI/N transformer must be short-circuited when the circuit-breaker must be removed.
- H) "Galvanically separated converters" conforming to standards IEC 60950 (UL 1950) or equivalent must be used since an earthed Uaux is required.
- I) Mandatory in the presence of any sort of Ekip module.
- L) Only one application among Fig. 79...93-131-132 can be supplied in the case of Ekip DIN Rail Cartridge Basic. In the case of Ekip DIN Rail Cartridge, up to three applications can be supplied among Fig. 79...93-131-132, taken once only. In addition, the Ekip Com module (if chosen) can be duplicated by choosing among Fig. 110...116.
- M) To ensure correct operation, the Ekip Supply module and at least one module must always be present.
- N) BELDEN 3105A cables or an equivalent type must be used.
- O) When there are several Ekip Com modules with withdrawable circuit-breakers, contact 5751/2 must be connected once only to one single module.
- P) Auxiliary voltage Uaux allows all the functions of EKIP electronic protection relays to be activated. "Galvanically separated converters" conforming to standards IEC 60950 (UL 1950) or equivalent must be used since an earthed Uaux is required.
- Q) BELDEN 3105A cables or an equivalent type must be used. Maximum length 15 m.
- R) Recommended RJ45 cable: CAT6 STP.
- S) Consult "Technical Application Papers - vol. 9: Communication via BUS with ABB circuit-breakers" for connection of the EIA RS485 serial line.
- T) Short-circuit terminals 1200 on to install a termination resistor on the Local Bus.
- U) Use Belden 3079A cables or equivalent. Consult White Paper 1SDC007412G0201 "Communication with SACE Emax 2 circuit-breakers" for further details.
- V) Use Belden 3084A cables or equivalent. Consult White Paper 1SDC007412G0201 "Communication with SACE Emax 2 circuit-breakers" for further details.
- Z) Ekip Supply cannot be used to energize the electronic relay via terminals K1 and K2.
- AA) Consult Fig. 78 for the connection of W3 and W4.
- AB) Use two-pole shielded cable type BELDEN 8762/8772 or equivalent. The shield must be earthed on the selectivity input side (for zone selectivity) or on both sides (for other applications).
- AC) The rated maximum secondary voltage is 120V.
- AD) Use insulated cables for thermocouples such as PENTRONIC TEC/SITW-24F (Type TX) or equivalent. Maximum length 3 m.
- AE) Use suitable cables up to 3 meters in length compatible with the workplace in which the 4-20mA current sensor is used
- AG) Relay type TMG for XT5 only
- AH) Designation Connector X .. -> X3 for XT5; X4 for XT6

Reading information

Information on how to read the diagrams

Key XT7-XT7M

| | |
|-----------------|--|
| * | = See note indicated by the letter |
| A1 | = Applications located on the moving part of the circuit-breaker |
| A3 | = Applications located on the fixed part of the circuit-breaker |
| A4 | = Indicative devices and connections for control and signaling, outside the circuit-breaker |
| A13 | = Signaling unit type Ekip Signalling 10K |
| A15 | = Metering unit type Ekip Multimeter |
| BUS1 | = Serial interface with external bus |
| BUS2 | = Redundant serial interface with external bus |
| LINK BUS | = Interface with the external Link bus |
| D | = Electronic time-lag device of YU under voltage coil, outside the circuit-breaker |
| GZi(DBi) | = Zone selectivity input for G protection or input in "reverse" direction for D protection |
| GZo(DBo) | = Zone selectivity output for G protection or output in "reverse" direction for D protection |
| 11...32 | = Programmable digital inputs |
| 41...43 51...53 | = Analogue inputs from temperature sensor |
| 44-54 | = Analogue inputs from 4-20mA sensor |
| K51 | = Ekip type electronic release for overcurrent protection |
| K51/COM | = Communication module |
| K51/MEAS | = Measurement module |
| K51/SIGN | = Signaling module |
| K51/SUPPLY | = Auxiliary supply module (110-220VAC/DC and 24-48VDC) |
| K51/SYNC | = Synchronization module |
| K51/TEMP | = Temperature monitoring module |
| K51/YC | = Closing command from EKIP protection release |
| K51/YO | = Opening command from EKIP protection release |
| M | = Motor for loading closing springs |
| O 11...32 | = Programmable signaling contacts |
| O SC | = Contact for synchronism control |
| Q | = Circuit-breaker |

| | |
|------------|--|
| Q/1...25 | = Open/close auxiliary contacts of circuit-breaker |
| Q/26-27 | = Open/close auxiliary contacts used internally by protection release |
| RC | = RC (residual current) protection sensor |
| RTC EKIP | = Ready to close auxiliary contact of circuit-breaker, used internally by protection release |
| RTC | = Contact for signaling circuit-breaker is ready to close |
| S4/1-2 | = Early auxiliary contacts (AUE1-2) |
| S33M/1-2 | = Limit contacts of spring loading motor |
| S43 | = Switch for presetting remote/local control |
| S51 | = Contact for signaling circuit breaker open due to tripping of overcurrent protection release |
| S52 | = Contact for signaling circuit breaker open due to tripping of opening coil and of undervoltage coil |
| S75E/1-2 | = Contacts for signaling circuit-breaker in racked-out position (only provided with withdrawable circuit-breakers) |
| S75I/1-2-5 | = Contacts for signaling circuit-breaker in racked-in position (only provided with withdrawable circuit-breakers) |
| S75T/1-2 | = Contact for signaling circuit-breaker in test position (only provided with withdrawable circuit-breakers) |
| SC | = Pushbutton or contact for closing circuit-breaker |
| S0 | = Pushbutton or contact for immediate opening of circuit-breaker |
| S01 | = Pushbutton or contact for opening circuit-breaker with time-delayed trip |
| SR | = Pushbutton or contact for electrical resetting of S51 trip contact |
| SY | = Contact for signaling circuit breaker open due to tripping of overcurrent protection release and of Y0, Y02, YU coils (tripped position) |
| SZi(DFi) | = Zone selectivity input for S protection or input in "forward" direction for S protection |

| | |
|-------------|--|
| SZo(DFo) | = Zone selectivity output for S protection or output in "forward" direction for D protection |
| TI/L1-L2-L3 | = Current transformer phase L1-L2-L3 |
| TI/N | = Current transformer on neutral |
| TU1-2 | = Insulation voltage transformer (outside circuit-breaker) |
| Uaux | = Auxiliary supply voltage |
| UI/L1-L2-L3 | = Current sensor phase L1-L2-L3 |
| UI/N | = Current sensor on neutral |
| UI/O | = Single-pole current sensor |
| W2 | = Serial interface with internal bus (local bus) |
| W9...14 | = RJ45 connector for communication modules |
| W9R...12R | = RJ45 connector for redundant communication modules |
| X | = Delivery connector for auxiliary circuits of withdrawable circuit-breaker |
| XB1...7 | = Connectors for circuit-breaker applications |
| XF | = Delivery terminal box for position contacts of withdrawable circuit-breaker |
| XK1...3 | = Connectors for auxiliary circuits of EKIP protection release |
| XK7 | = Connector for auxiliary circuits of communication modules |
| XV | = Delivery terminal board for auxiliary circuits of fixed circuit-breaker |
| YC | = Closing coil |
| YO | = Opening coil |
| YO1 | = Opening coil for overcurrent |
| YO2 | = Second opening coil |
| YR | = Coil for electrical resetting of trip contact S51 |
| YU | = Undervoltage coil |

Notes XT7-XT7M


- A) Auxiliary power supply must be present for zone selectivity and local bus functions (consult Fig. 31-32).
- B) When there are mixed auxiliary contacts, 01 and 02 are 400V, while 03-04 are 24V.
- C) Always supplied with Ekip Com module.
- D) Always supplied with motor for loading closing springs in Fig. 13.
- E) A voltage transformer is mandatory in the case of external sockets. External sockets are mandatory for systems for over 690V rated voltage. Admissible maximum rated secondary voltage is 230V.
- F) Connections between RC residual current protection sensor and poles of connector X (or XV) of the circuit-breaker must be made of 4-pole shielded cable with paired braided conductors (BELDEN 9696 paired type or equivalent) no more than 10 m in length.
- G) Earth fault protection (Gext) by means of a current sensor on the neutral point of the MV/LV transformer is available with all electronic protection releases equipped with display interface with LSIG protections. The connection between terminals 1 and 2 of the UI/O current transformer and Ge+ and Ge- poles of connector X (or XV) must be made of shielded and stranded 2-pole cable (BELDEN 8841 or equivalent) no more than 15 m in length.
- H) Use the supplied cable to make the connection. There must be no break in the cable. Use of other cables or extensions using intermediate terminal boxes is not allowed. With a circuit-breaker, poles Ne+ and Ne- of connector X (or XV) are short-circuited unless the external neutral is present: enable short-circuit if connection is absent.
- I) Mandatory if any Ekip module is present.
- L) Up to two applications between Fig. 41...59 taken only once can be supplied. The Ekip Com module selected can be duplicated by choosing between Fig. 61...67.

Reading information


Information on how to read the diagrams

- M) Opening and closing commands from Ekip Actuator can be obtained with Y0 and Y0 coils, with 110-120VDC and 240-250VAC maximum voltage values.
- N) Use BELDEN 3105A cables or equivalent.
- O) Contact 8751/5 should be connected once only to a single module when there are several Ekip Com modules with withdrawable circuit-breakers.
- P) Auxiliary voltage Uaux. Enables all the functions of the EKIP electronic protection releases to be activated. "Galvanically separated convertors" conforming to standard IEC 60950 (UL 1950) or equivalent must be used since an earthed Uaux is required.
- Q) Use BELDEN 3105A cables or equivalent not more than 15m in length.
- R) Recommended RJ45 cable: CAT6 STP.
- S) Consult "Technical Application Papers - vol. 9: Bus Communication with ABB Circuit-breakers" for serial line connection EIA RS485.
- T) Short-circuit terminals 1200 on if a terminating resistor must be connected to the Local Bus.
- U) Use Belden 3079A cables or equivalent. For further details see White Paper 1SDCOO741200201 "Communication with SACE Emax 2 Circuit- Breakers".
- V) Use Belden 3084A cables or equivalent. For further details see White Paper 18DCOO7412G0201 "Communication with SACE Emax 2 Circuit- Breakers".
- W) Contacts S4/1 and S4/2 in Fig. 17 can be used to open the undervoltage coil circuit shown in Fig. 73-74 when the circuit-breaker is open and to close it again in the presence of a closing command, in compliance with the Standard governing machine tools.
- X) Contact S52 signals the state of the Y02 / YU opening coils.
For coil Y02, the contact connected to poles 25-28 of connector X (or XV) is closed with Y02 energized (circuit-breaker opening activated), contact 25-26 is closed with Y02 de-energized.
For coil YU, the contact connected to poles 25-28 of connector X (or XV) is closed with YU de-energized (circuit-breaker opening activated), contact 25-26 is closed with YU energized.
- Z) Ekip Supply cannot be used for direct supply to the electronic release by means of terminals K1 and K2.
- AA) See Fig. 31 and 32 for connection of W3 and W4.
- AB) Use BELDEN 8762/8722 two-pole shielded cable or equivalent. The shield must be earthed on the selectivity input side (for zone selectivity) or on both sides (for other applications).
- AC) Admissible maximum rated secondary voltage is 120V.
- AD) Use PENTRONIC TEC/SITW-24F (type TX) insulated cables for thermocouples or equivalent, no more than 1'm in length.
- AE) Use appropriate cables compatible with the workplace in which the 4-20mA current sensor is used and not more than 3 m in length.


Wiring diagrams

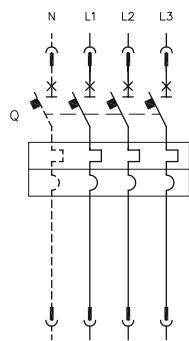


Three-pole or four-pole circuit-breaker with thermal magnetic trip unit

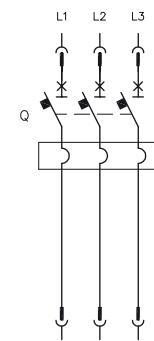

Three-pole circuit-breaker with magnetic trip unit

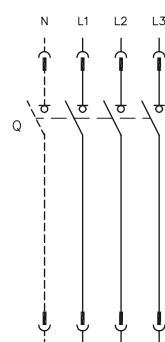


Three-pole or four-pole switch-disconnector

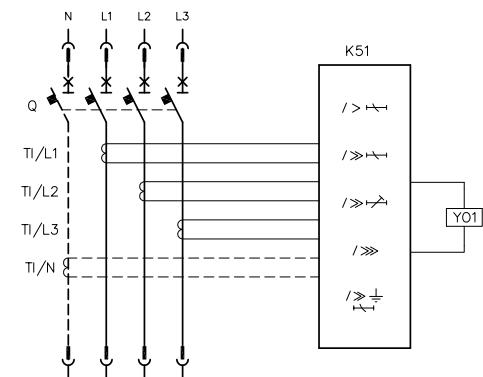


Three-pole or four-pole version circuit-breaker with Ekip Dip trip unit


Wiring diagrams

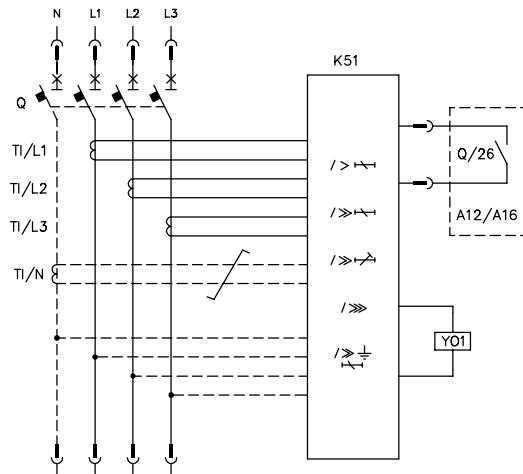


Three-pole or four-pole version circuit-breaker
XT5-XT6 with Ekip Touch trip unit

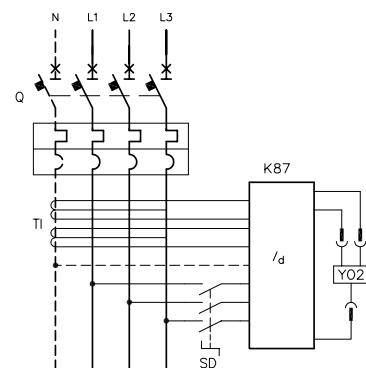


Three-pole or four-pole version circuit-breaker
with thermal magnetic trip unit and residual
current device

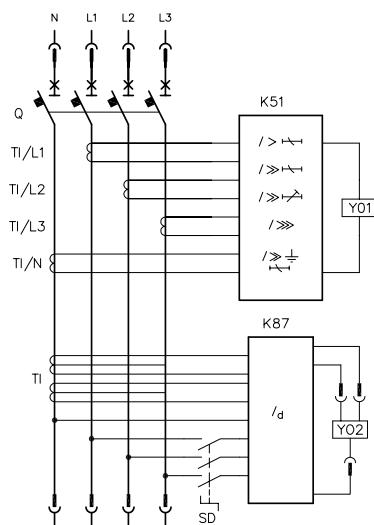


Three-pole or four-pole version circuit-breaker
with Ekip Dip trip unit and residual current device

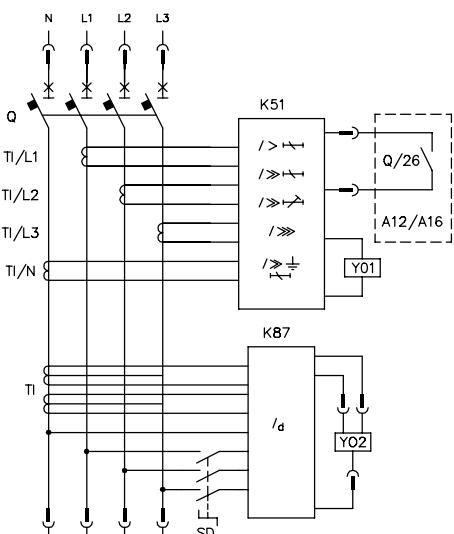


Three-pole or four-pole version circuit-breaker
with Ekip Touch trip unit and residual current
device

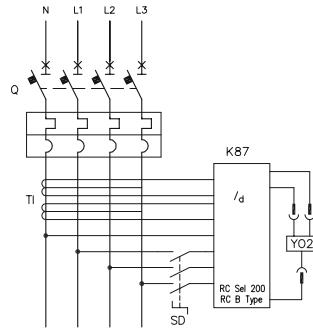


Four-pole circuit-breaker with thermal magnetic trip unit and RC Sel 200 or RC B type residual current release

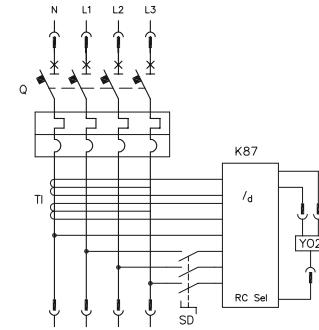


Four-pole circuit-breaker with thermal magnetic trip unit and RC Sel residual current release

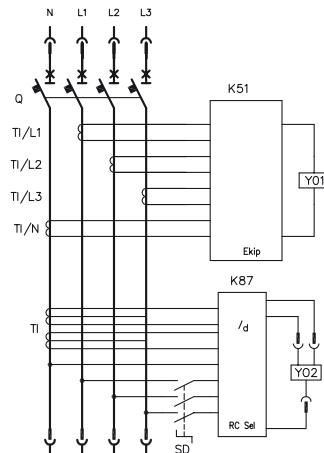


Four-pole circuit-breaker with electronic trip unit and RC Sel residual current release

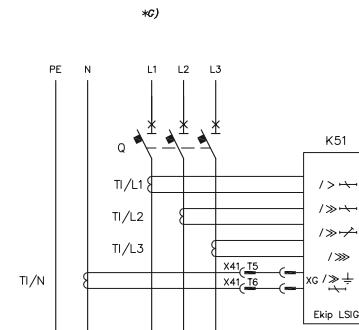

Three-pole fixed version circuit-breaker with Ekip Dip trip unit with current transformer on the neutral conductor outside the circuit-breaker

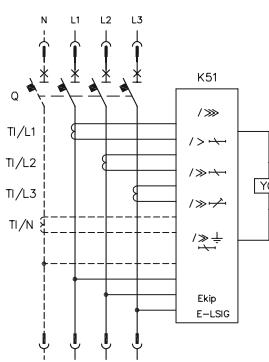


Three-pole or four-pole XT4 circuit-breaker with Ekip E-LSIG microprocessor based release

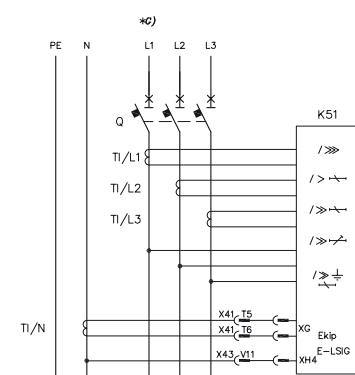


Fixed version three-pole XT4 circuit-breaker with Ekip E-LSIG with current transformer on neutral conductor, external to circuit-breaker

Wiring diagrams

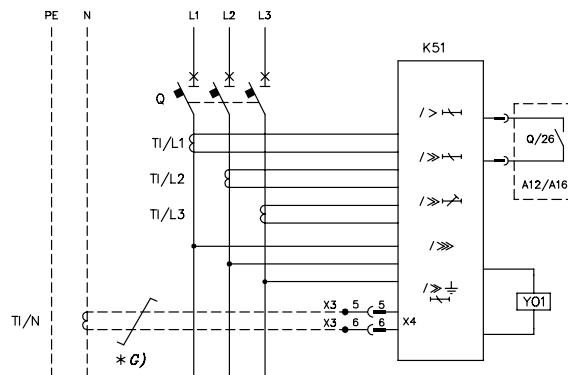

Three-pole fixed version circuit-breaker with Ekip Touch trip unit with current sensor on the neutral conductor outside the circuit-breaker

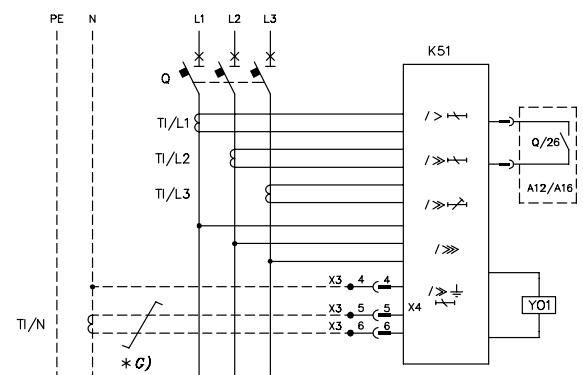

Three-pole fixed version circuit-breaker with Ekip Touch trip unit with current and voltage sensor on the neutral conductor outside the circuit-breaker


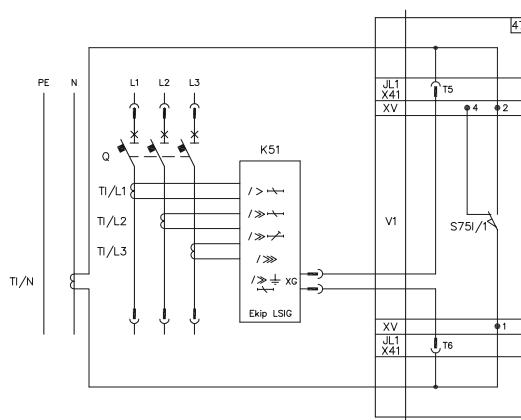


Diagram recommended for three-pole plug-in or withdrawable version circuit-breakers with Ekip Dip trip unit with current sensor on the neutral conductor outside the circuit-breaker

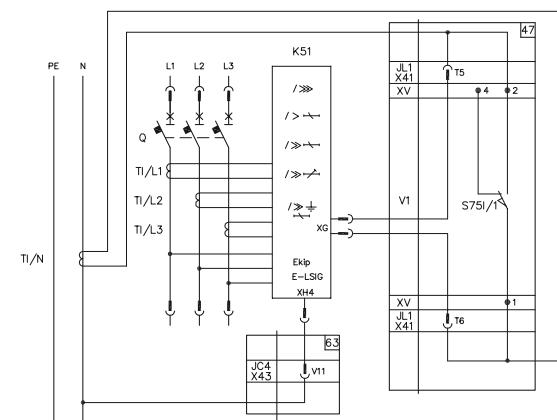


Recommended diagram for plug-in or withdrawable version three-pole circuit-breakers with Ekip Dip trip unit, current transformer and voltage connection on neutral conductor, external to circuit-breaker

Wiring diagrams

Diagrams for XT1...XT4


- 1) Shunt opening release.
- 2) Supplementary shunt opening release (only for four-pole circuit-breakers).
- 3) Instantaneous undervoltage release (see Notes B and F).
- 4) Undervoltage release with electronic time delay device outside the circuit-breaker, see note B).

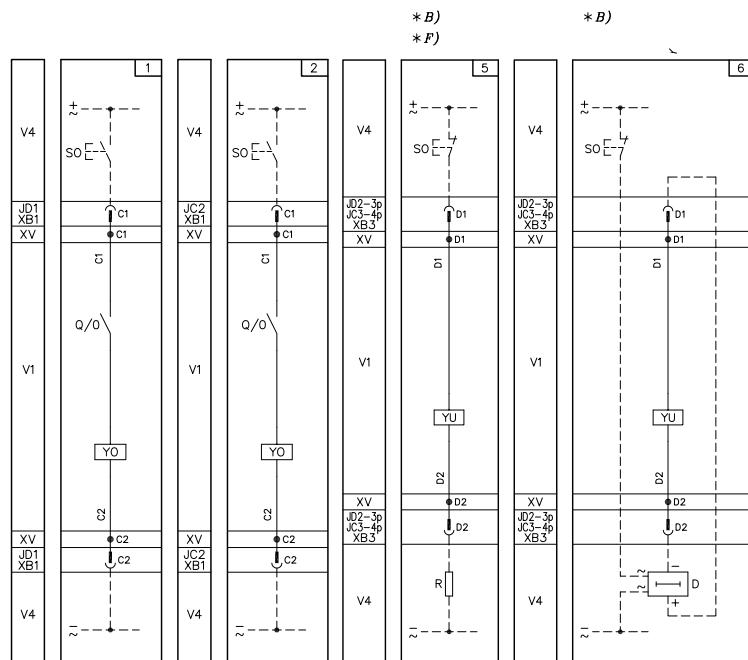

Wiring diagrams


Diagrams for XT1...XT4

- 7) Instantaneous undervoltage release in the version for machine tools with one contact in series (see notes B, C and F).
- 8) Instantaneous undervoltage release in the version for machine tools with two contacts in series (see Notes B, C and F).
- 9) First auxiliary early contact operated by the crank handle.
- 10) Second auxiliary early contact operated by the crank handle.
- 11) One changeover contact for electrical signaling of circuit-breaker open due to tripping of the residual current release type RC Inst, RC Sel, RC B Type or RC Sel 200.
- 12) Residual current release circuits type RC Sel, RC B Type or RC Sel 200.
- 13) Two contacts for electrical signaling of residual current release pre-alarm and alarm type RC Sel, RC B Type or RC Sel 200.

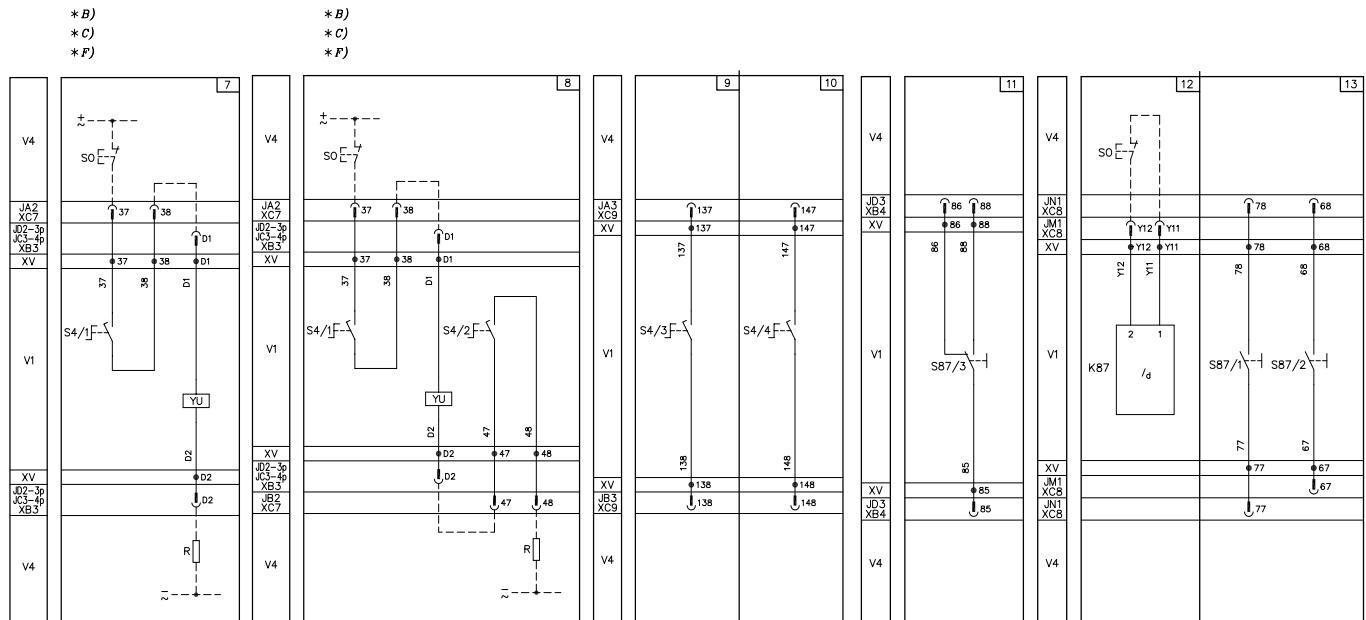

Motor operator

- 21) Direct control motor operator (MOD) (only for XT1 and XT3 fixed or plug-in circuit-breakers) (see note 1).
- 22) Motor operator with stored energy (MOE) (only for circuit-breakers XT2 and XT4).
- 23) A contact for electrical signaling of stored energy motor operator that can be operated remotely.

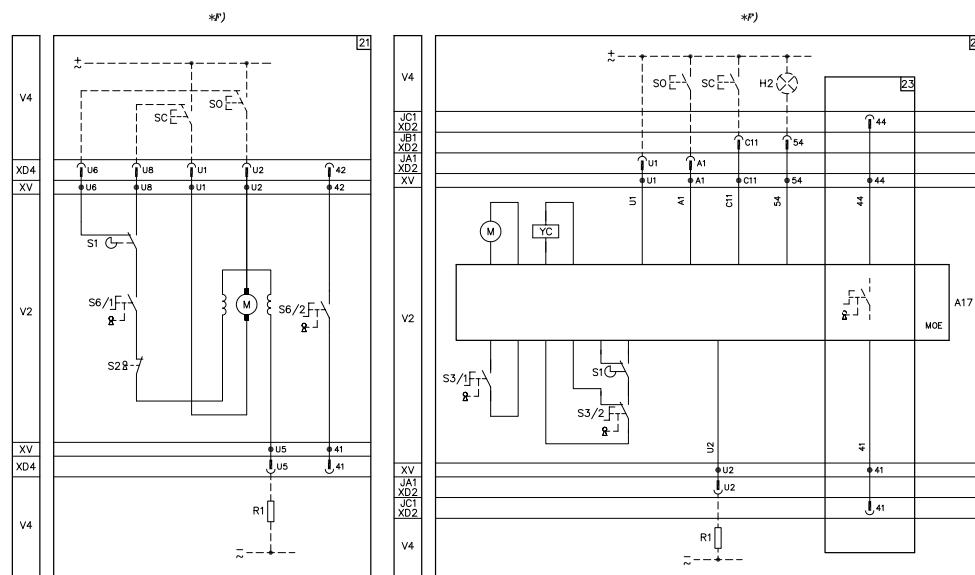


Wiring diagrams

Diagrams for XT1...XT4


Signaling contacts

- 31) One changeover contact for electrical signaling of circuit-breaker open or closed and one changeover contact for electrical signaling of circuit-breaker open due to tripping of the magnetic, thermal magnetic or electronic trip units, YO, YO1, YO2, YU (trippped position) (only for voltages up to 250V) (see notes E and I).
 - 32) Two changeover contacts for electrical signaling of circuit-breaker open or closed, two change over contacts for electrical signaling of circuit-breaker open due to tripping of the magnetic, thermal magnetic or electronic trip units, YO, YO1, YO2, YU (trippped position) and one changeover contact for electrical signaling of circuit-breaker open due to tripping of the ther momagnetic or electronic trip unit (only for voltages up to 250V).
 - 33) Three changeover contacts for electrical signaling of circuit-breaker open or closed and two changeover contacts for electrical signaling of circuit-breaker open due to tripping of the magnetic, thermal magnetic or electronic trip units, YO, YO1, YO2, YU (trippped position) (only for voltages up to 250V).

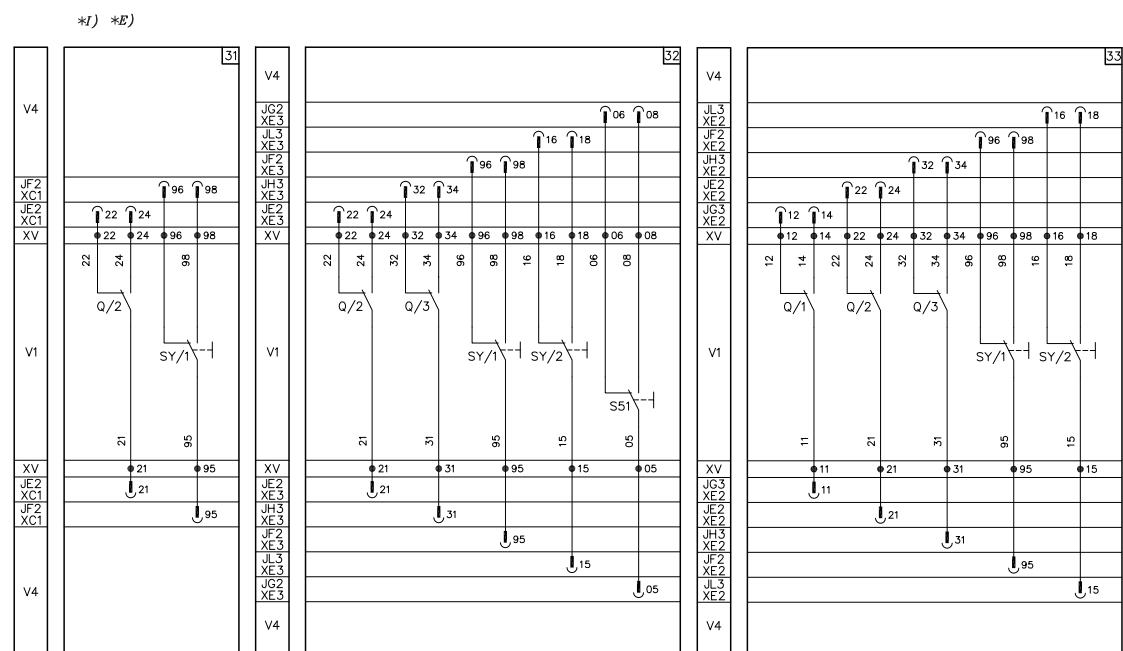

Signaling contacts


- 34) Three changeover contacts for electrical signaling of circuit-breaker open and one changeover contact for electrical signaling of circuit-breaker open due to tripping of the magnetic, thermal-magnetic or electronic trip units, YO, YO1, YO2, YU (trippped position) (only for voltages up to 250V).
 - 35) One changeover contact for electrical signaling of circuit-breaker open due to tripping of the thermal magnetic electronic trip unit (only for voltages up to 250V).
 - 36) Two changeover contacts for electrical signaling of circuit-breaker open or closed and one changeover contact for electrical signaling of circuit-breaker open due to tripping of the magnetic, thermal magnetic or electronic trip units, YO, YO1, YO2, YU (trippped position) (only for voltages up to 250V).
 - 37) One changeover contact for electrical signaling of circuit-breaker open or closed and one changeover contact for electrical signaling of circuit-breaker open due to tripping of the magnetic, thermal magnetic or electronic trip units, YO, YO1, YO2, YU (trippped position) (only for voltage up to 400V).
 - 38) Two changeover contacts for electrical signaling of circuit-breaker open or closed (only for voltage up to 400V).

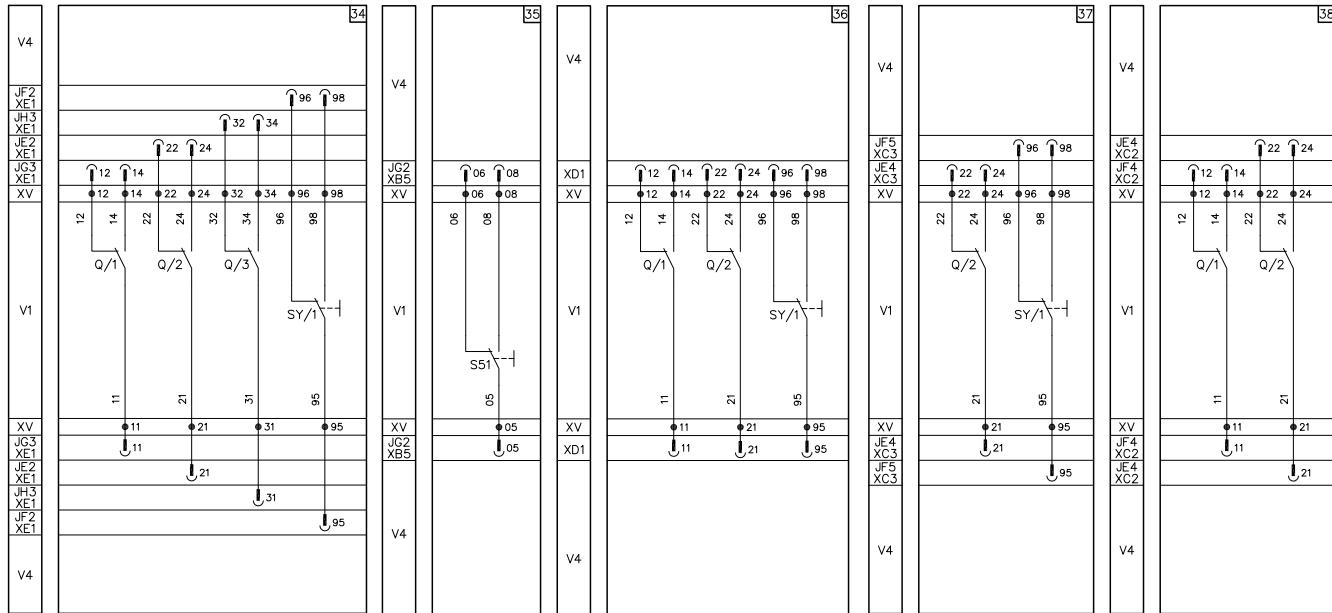

Wiring diagrams


Diagrams for XT1...XT4

- 39) Three supplementary changeover contacts for electrical signaling of circuit-breaker open or closed (only for fixed or plug-in version circuit-breakers).
- 41) First changeover position contact of the circuit-breaker, for electrical signaling of connected (only for plug-in or withdrawable version circuit-breakers).
- 42) Second changeover position contact of the circuit-breaker, for electrical signaling of connected (only for plug-in or withdrawable version circuit-breakers).
- 43) Third changeover position contact of the circuit-breaker, for electrical signaling of connected (only for plug-in or withdrawable version circuit-breakers).
- 44) Fourth changeover position contact of the circuit-breaker, for electrical signaling of connected (only for plug-in or withdrawable version circuit-breakers).
- 45) First changeover position contact of the circuit-breaker, for electrical signaling of isolated (only for withdrawable version circuit-breakers).
- 46) Second changeover position contact of the circuit-breaker, for electrical signaling of isolated (only for withdrawable version circuit-breakers).

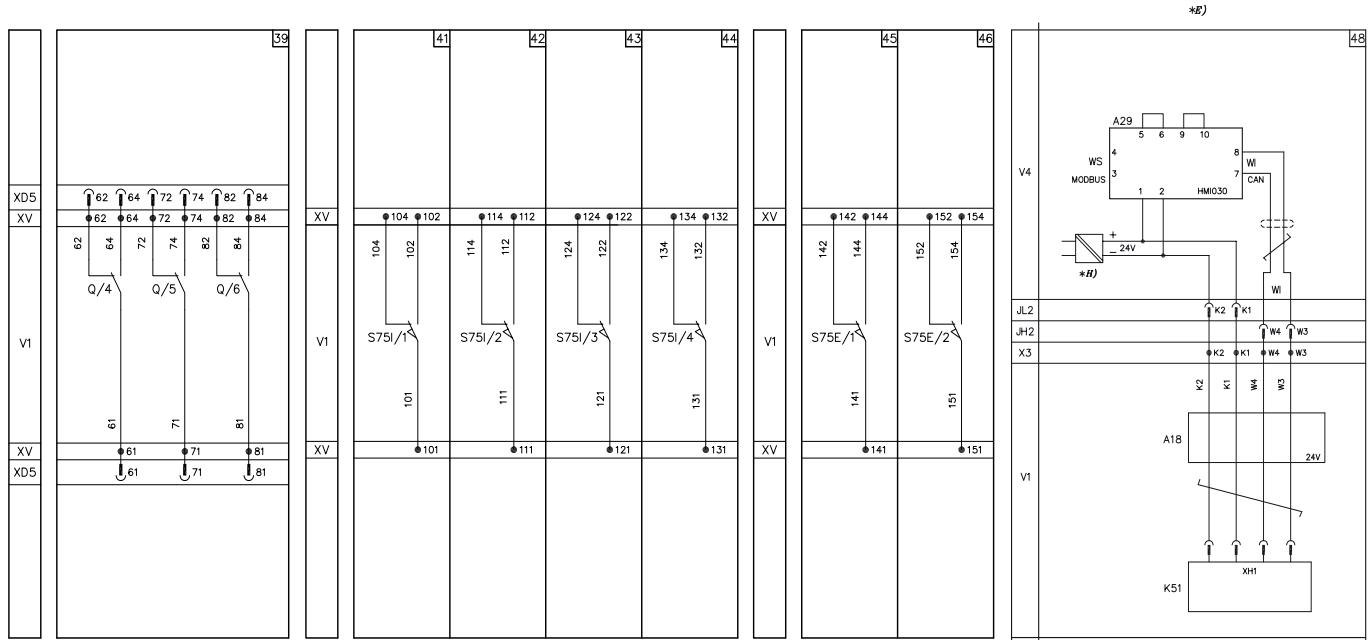

Signaling contacts

142) Auxiliary circuits of Ekip Com or Kit of 24V DC auxiliary voltage for electronic trip units and of Ekip Multimeter display.

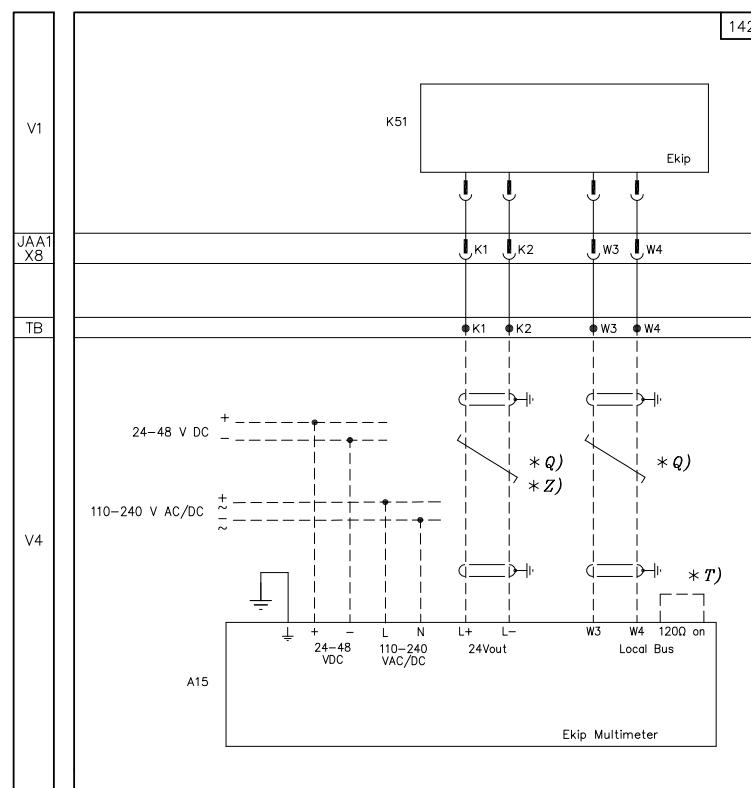



Wiring diagrams

Diagrams for XT1...XT4

Electronic trip unit Touch/Hi-Touch with connections through Slim Micro I/O

Ekip Touch/Hi-Touch with Slim Micro I/O

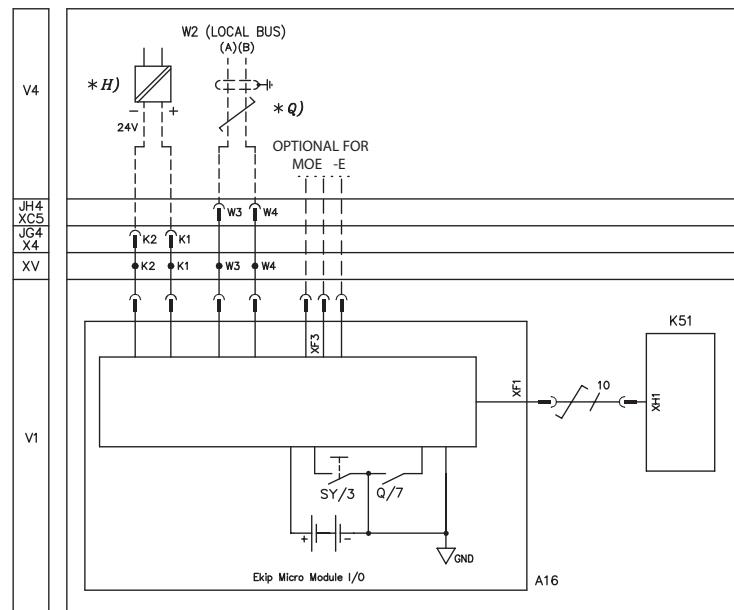


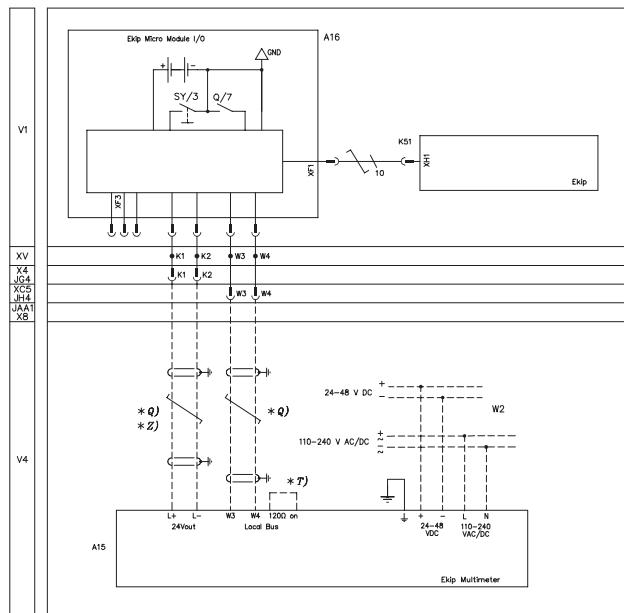Ekip Touch/Hi-Touch with Slim Micro I/O and Ekip Multimeter

Wiring diagrams


Diagrams for XT1...XT4

Ekip Touch/Hi-Touch with Slim Micro I/O, Ekip Cartridge and Ekip Multimeter

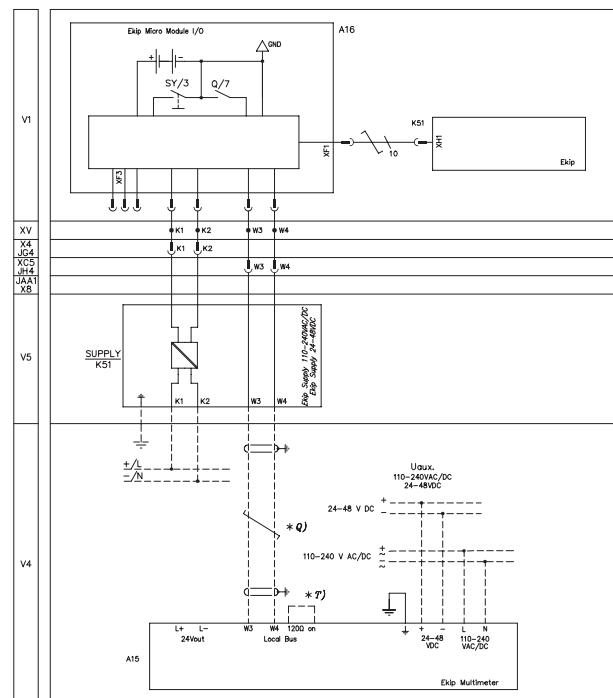

Auxiliary circuit of Ekip-Com

52) Auxiliary circuits of the Ekip Com type interface unit.

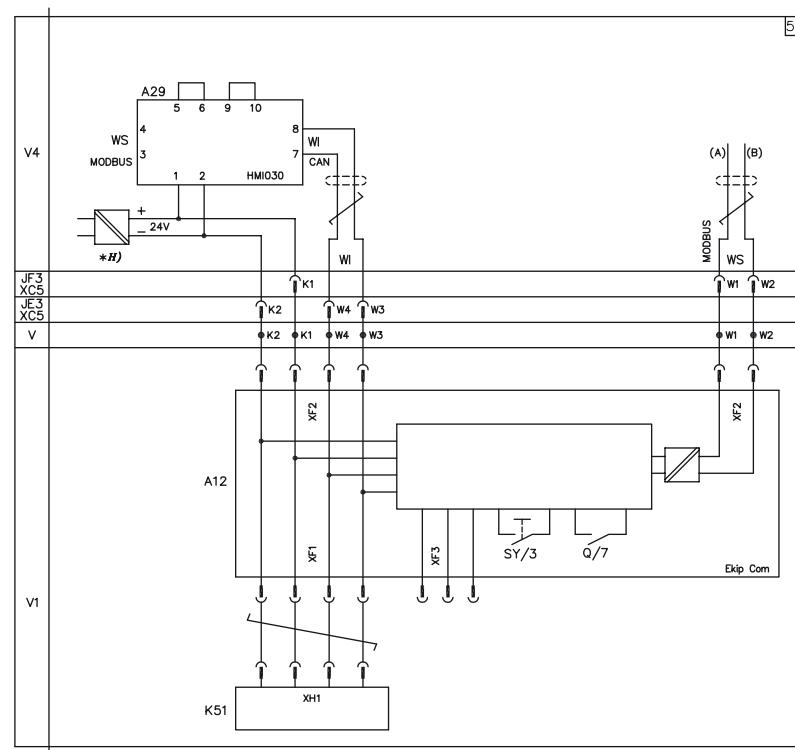


Wiring diagrams

Diagrams for XT1...XT4

Electronic trip unit Ekip Ekip C Dip LSI/LSIG and Ekip Dip Measuring LSI/LSIG connected to interface unit Ekip Com and with actuator unit type MOE-E for the stored energy motor operator


- 23) One Contact for electrical signaling of stored energy motor operator that can be operated remotely.**
53) Auxiliary circuits of the electronic trip unit type Ekip C Dip LSI/LSIG and Ekip Dip Measuring LSI/LSIG connected to interface unit type Ekip Com and with actuator unit type MOE-E for the stored energy motor operator.

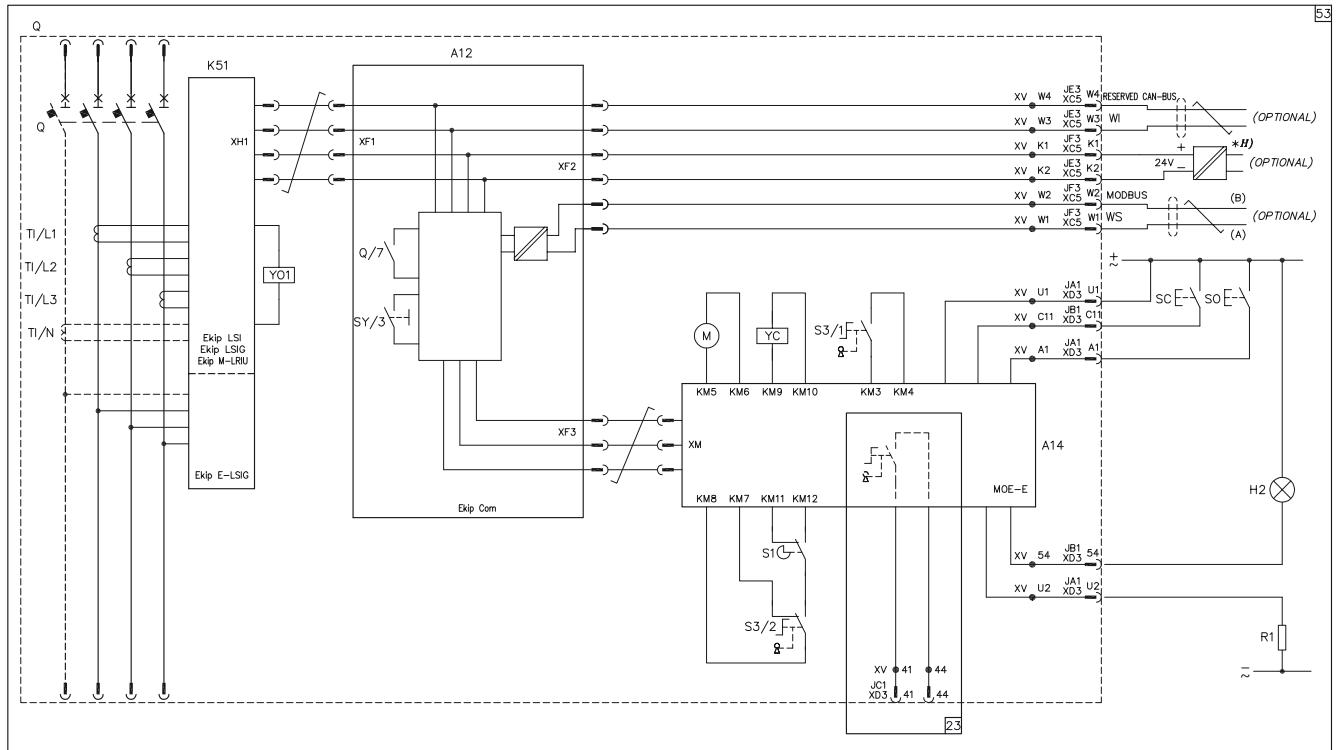

Auxiliary circuits of the electronic trip unit Ekip M-LRIU connected to the contactor control unit for starting the motor PR212/CI (the circuit to the motor thermistor is optional)

54) Auxiliary circuits of the electronic trip unit type Ekip M-LRIU connected to the contactor control unit for starting the motor type PR212/CI (the circuit to the motor thermistor is optional).

62) Motor thermistor circuit.

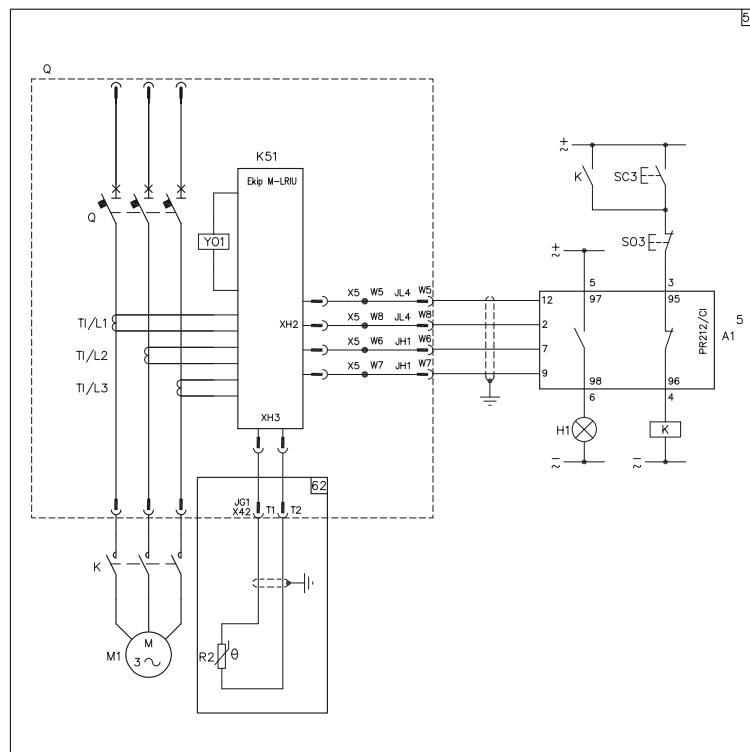

Wiring diagrams

Diagrams for XT1...XT4

Instructions for resetting the circuit-breaker after tripping

Selection of the type of circuit-breaker resetting depends on design requirements and on service conditions.

Resetting can take place following tripping of the following releases:

- overcurrent;
- undervoltage;
- shunt opening.

The following three possibilities are suggested (see diagrams in the following page):

1. Only manual resetting

To be wired (by the customer): contact SO1, contact SY/1 and the auxiliary relay KO (only for MOD).

Opening is prevented until the circuit-breaker is in the tripped position.

To reset the circuit-breaker it is necessary to activate the special lever on the front of the motor until the circuit-breaker goes into the open position.

2. Electrical resetting under the operator's responsibility

To be wired (by the customer): contact SO1, SO2, contact SY/1 and the auxiliary relay KO (only for MOD).

Opening of the circuit-breaker is allowed by means of the contact SO2. Such contact shall be protected to avoid unwanted activation and can be used only if the information received by the operator make it possible to exclude tripping due to a short-circuit, or if the causes of the short-circuit have been removed.


3. Electrical resetting always allowed

To be wired (by the customer): contact SO1, SO2, contact SY/1 and the auxiliary relay KO (only for MOD).


Opening is always allowed by means of contact SO2.

NB: If the magnetic, thermal magnetic or electronic trip unit is present, it is necessary to find the causes which led to the circuit-breaker being in the tripped position so as to prevent reclosing under short-circuit conditions. In all cases, manual resetting is always allowed.

MOD

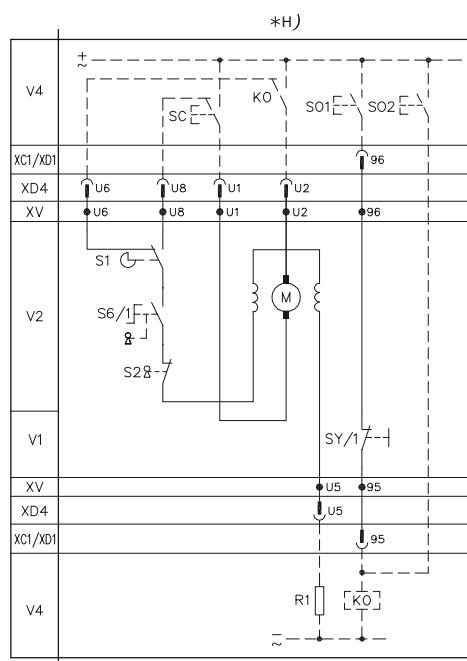


MOE or MOE-E

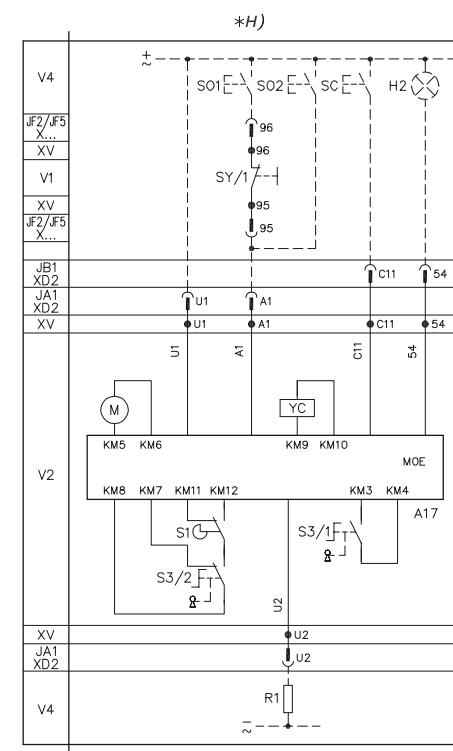


Wiring diagrams

Diagrams for XT1...XT4

57) Interface unit type Ekip Com with direct supply to the trip unit and MOE-E motor operator

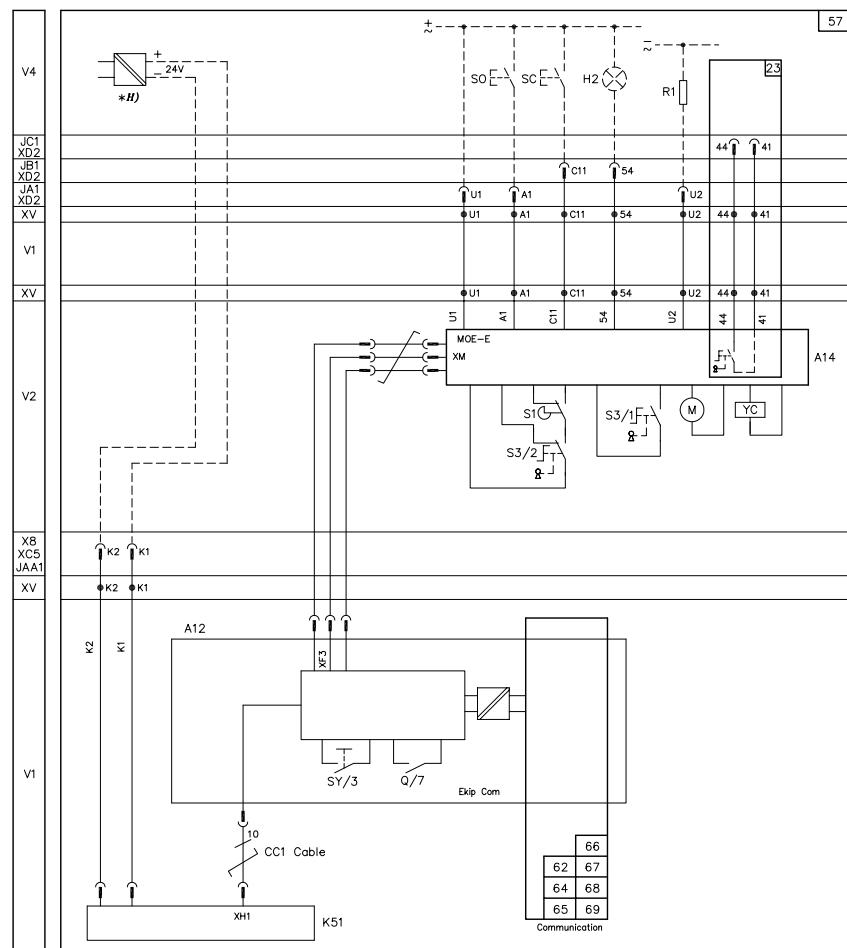

54) Stand-alone interface unit type Ekip Com with MOE-E motor operator

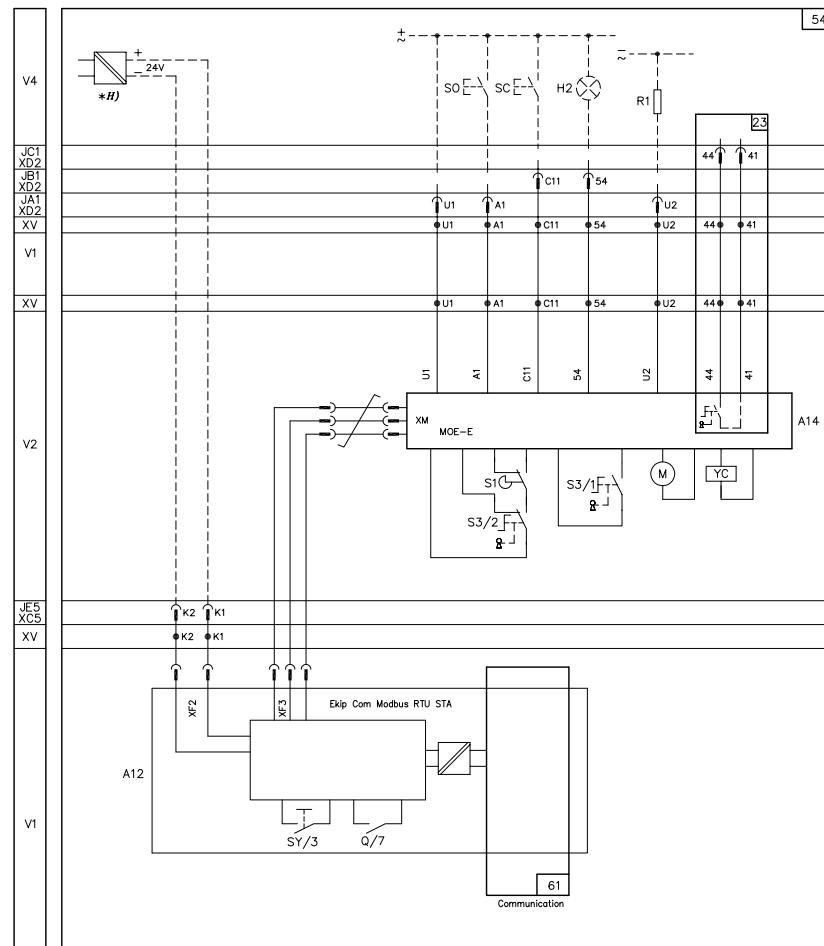



Wiring diagrams

Diagrams for XT1...XT4

- 61) Modbus RTU STA interface of Ekip Com Unit to be installed inside the circuit-breaker
 62) Modbus RTU interface of Ekip Com Unit to be installed inside the circuit-breaker
 63) Modbus TCP STA interface of Ekip Com Unit to be installed inside the circuit-breaker
 64) Modbus TCP interface of Ekip Com Unit to be installed inside the circuit-breaker
 65) Profinet interface of Ekip Com Unit to be installed inside the circuit-breaker
 66) Ethernet IP interface of Ekip Com Unit to be installed inside the circuit-breaker
 67) IEC61850 interface of Ekip Com Unit to be installed inside the circuit-breaker
 68) Ekip Link interface of Ekip Com Unit to be installed inside the circuit-breaker
 69) ABB Ability™ Edge Industrial Gateway interface of Ekip Com Unit to be installed inside the circuit-breaker

—
 61 - 62 - 63 - 64 - 65 -
 66 - 67 - 68 - 69 as an
 alternative to each other

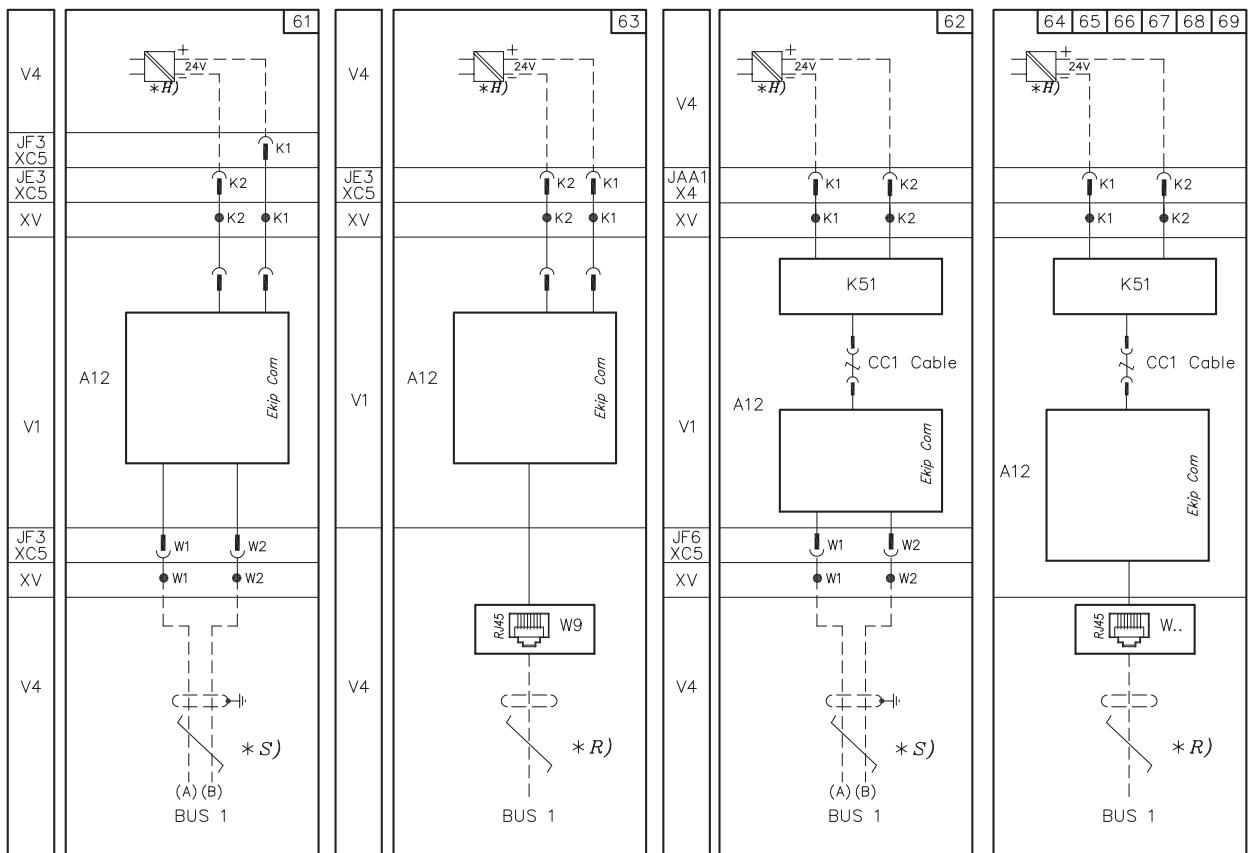


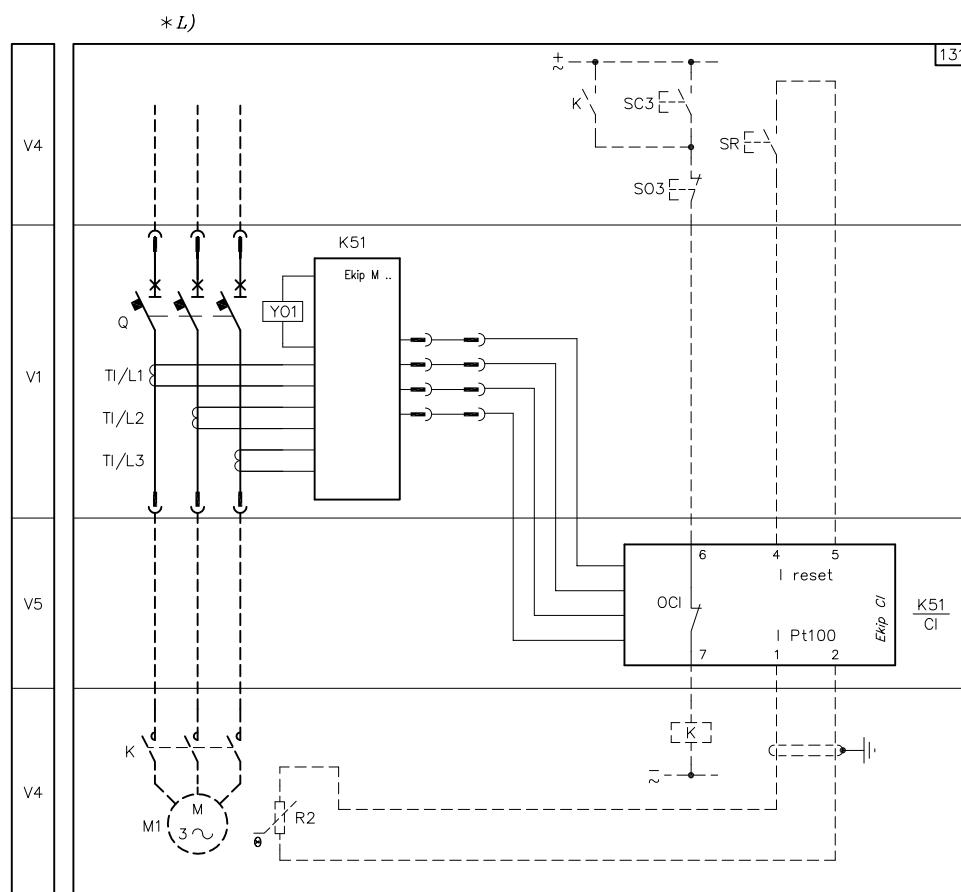131) Motor starting module Ekip CI


Wiring diagrams

Diagrams for XT1...XT4


132) Motor starting module Ekip CI with ABB contactor series AF

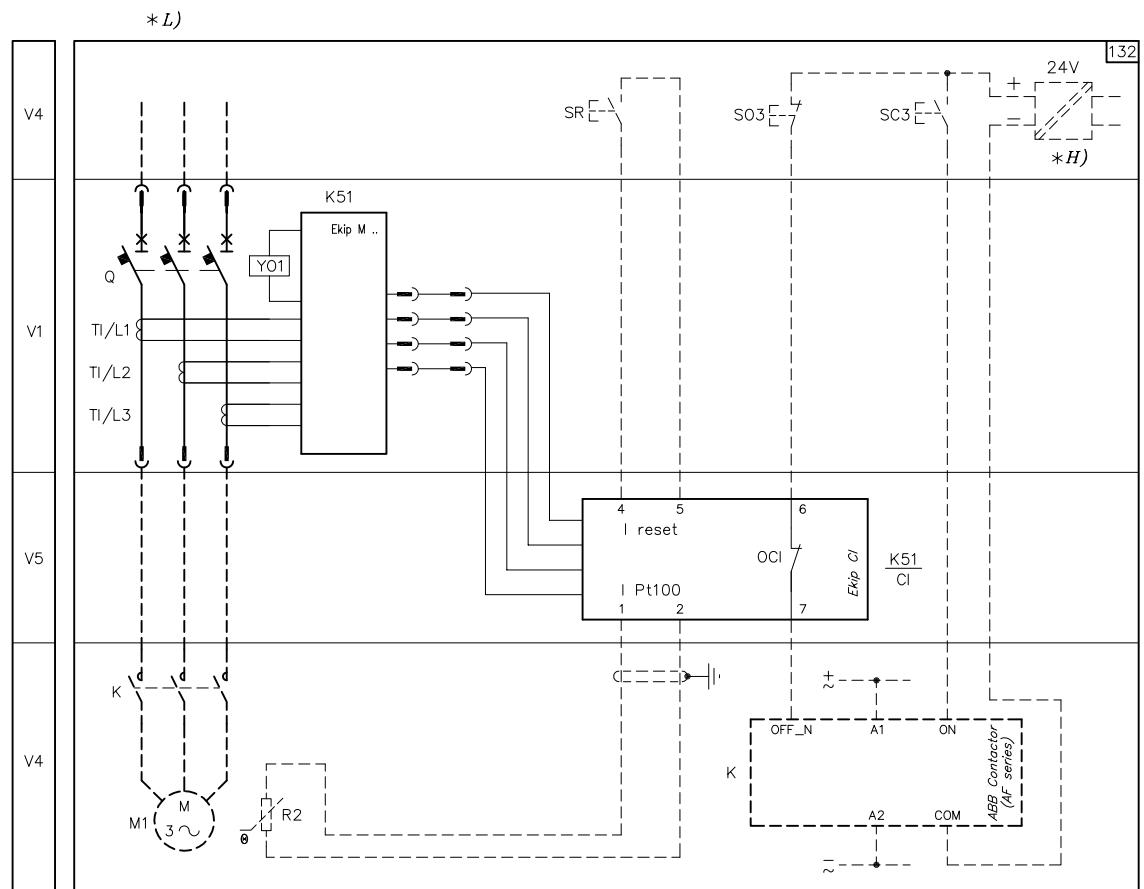

Wiring diagrams

Diagrams for XT5 and XT6

- 1) Left opening coil - YO⁽¹⁾
- 2) Right opening coil - YO⁽¹⁾

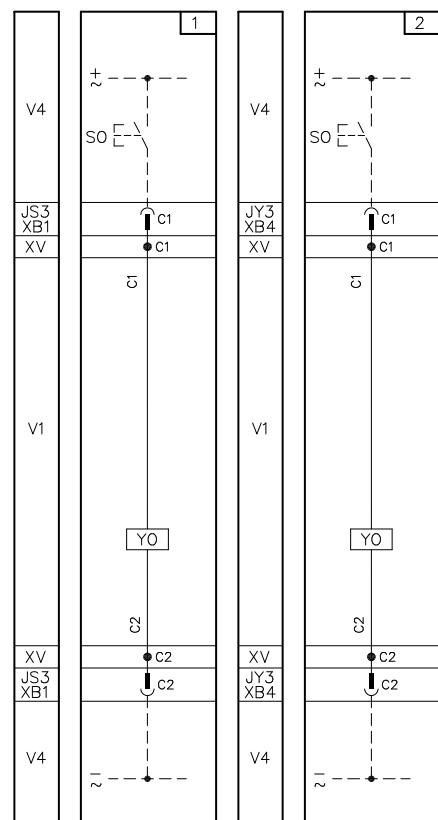


(1) Up to 380-440V YO version

Wiring diagrams

Diagrams for XT5 and XT6

- 5) Instantaneous left undervoltage coil - YU⁽¹⁾
- 6) Left undervoltage coil with electronic time-delay device outside the circuit-breaker - YU⁽²⁾
- 7) Instantaneous left undervoltage coil in the version for machine tools with a contact in series - YU⁽¹⁾

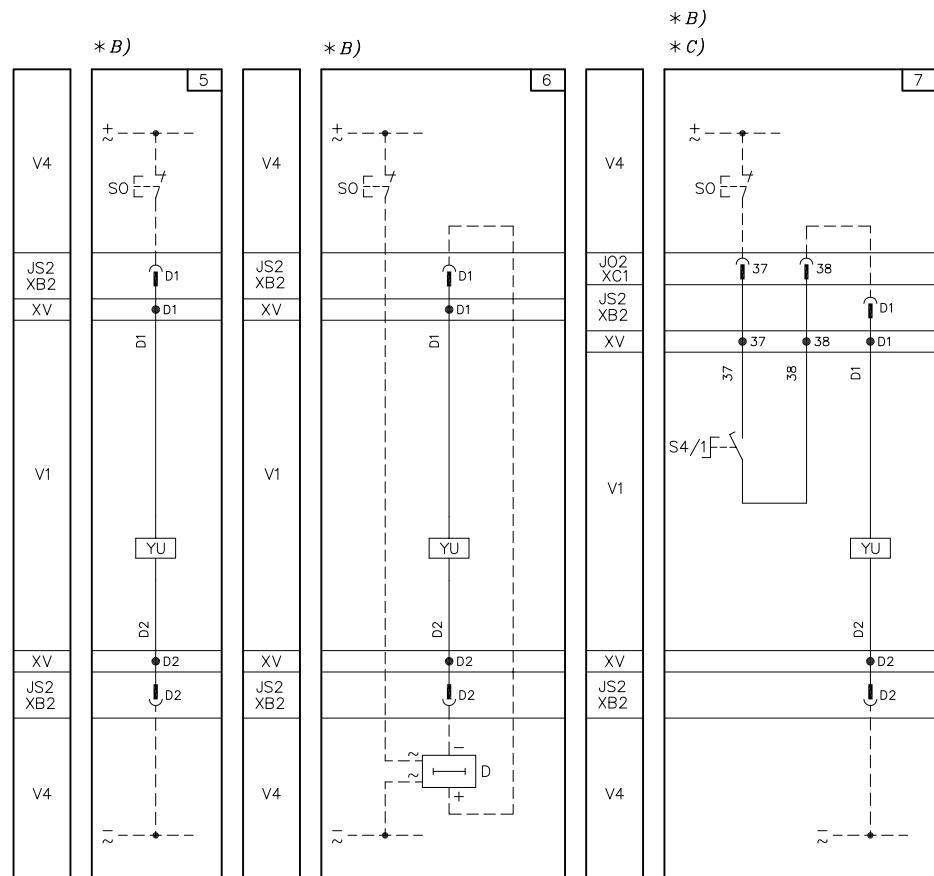


(1) Up to 380-440V YU version

(2) Up to 250V YU version

8) Instantaneous right undervoltage coil - YU⁽¹⁾

9) Right undervoltage coil with electronic time-delay device outside the circuit-breaker - YU⁽²⁾

10) Instantaneous right undervoltage coil in the version for machine tools with a contact in series - YU⁽¹⁾

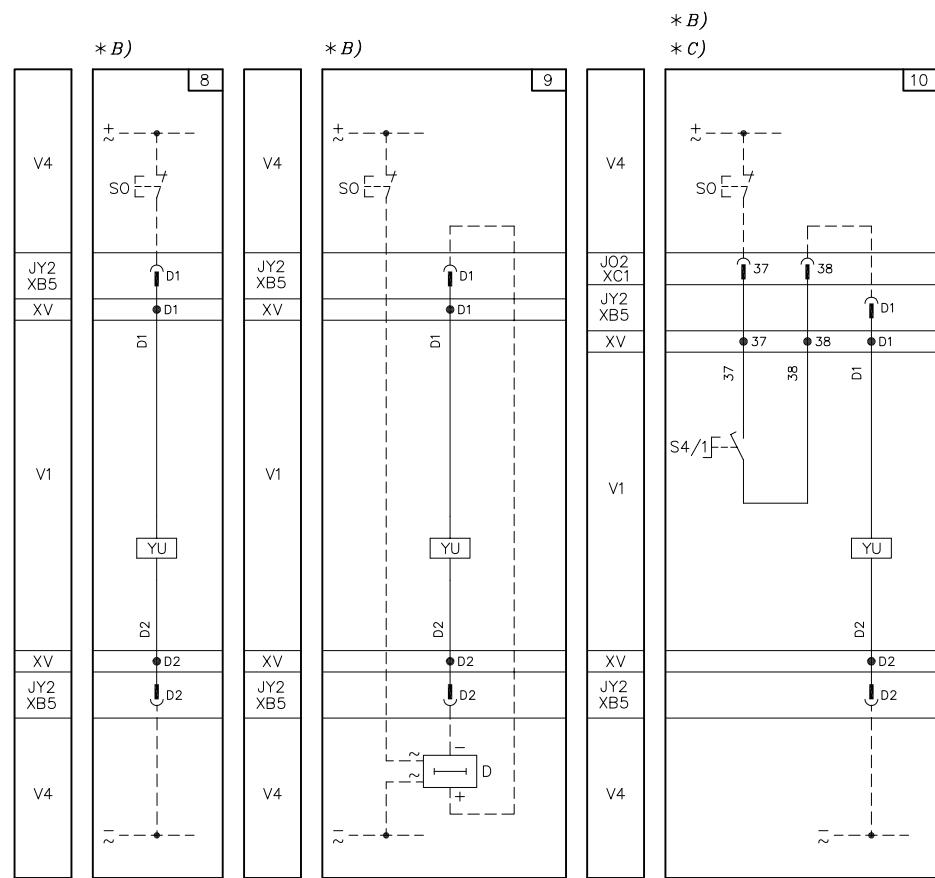


(1) Up to 380-440V YU version

(2) Up to 250V YU version


Wiring diagrams

Diagrams for XT5 and XT6

15) Instantaneous undervoltage coil in the version for machine tools with two contact in series - YU

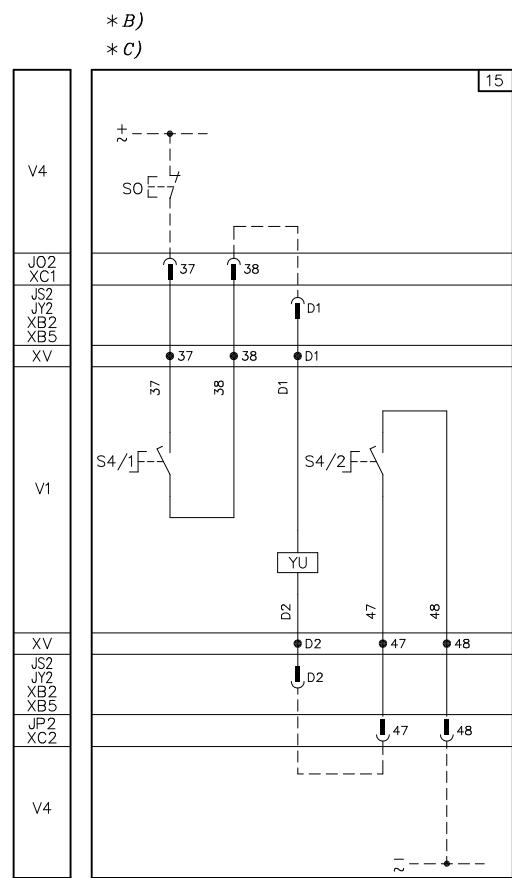

- 18) Open/closed circuit-breaker signalling contact and circuit-breaker tripped signalling contact (for voltage up to 250V)
 - 19) Open/closed circuit-breaker signalling contact and circuit-breaker tripped signalling contact (for voltage up to 250V) left position
 - 20) Signalling contact for minimum voltage relay tripping

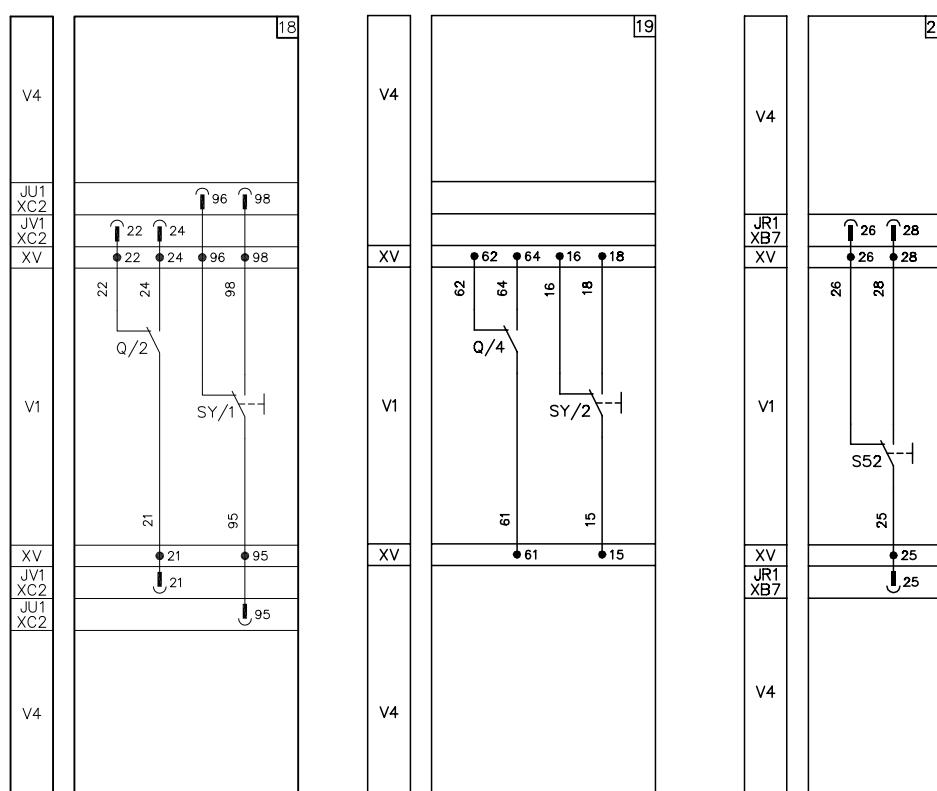


Wiring diagrams

Diagrams for XT5 and XT6

21) Three open/closed circuit-breaker signalling contacts and circuit-breaker tripped signalling contacts (for voltage up to 250V)


22) Open/closed circuit-breaker 2 signalling contacts (for voltage up to 400V)

* D)

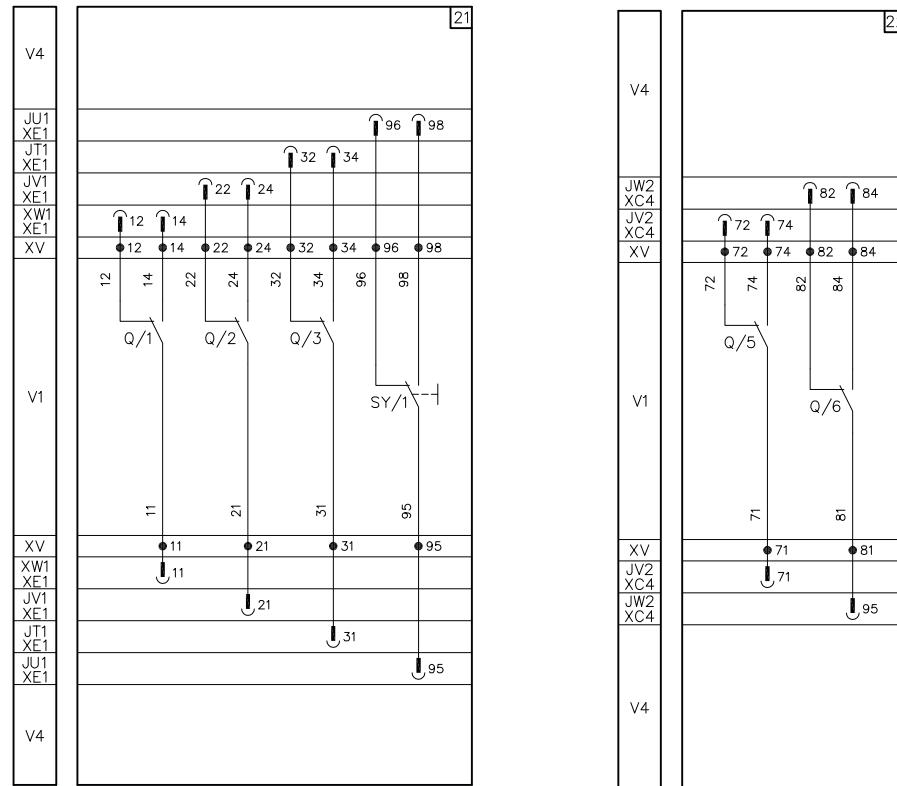

- 23) Protection relay tripped signalling contact (for voltage up to 250V)**
- 24) Two open/closed circuit-breaker signalling contacts and circuit-breaker tripped signalling contacts (for voltage up to 250V)**
- 25) Open/closed circuit-breaker signalling contacts and circuit-breaker tripped signalling contacts (for voltage up to 400V)**

* E)

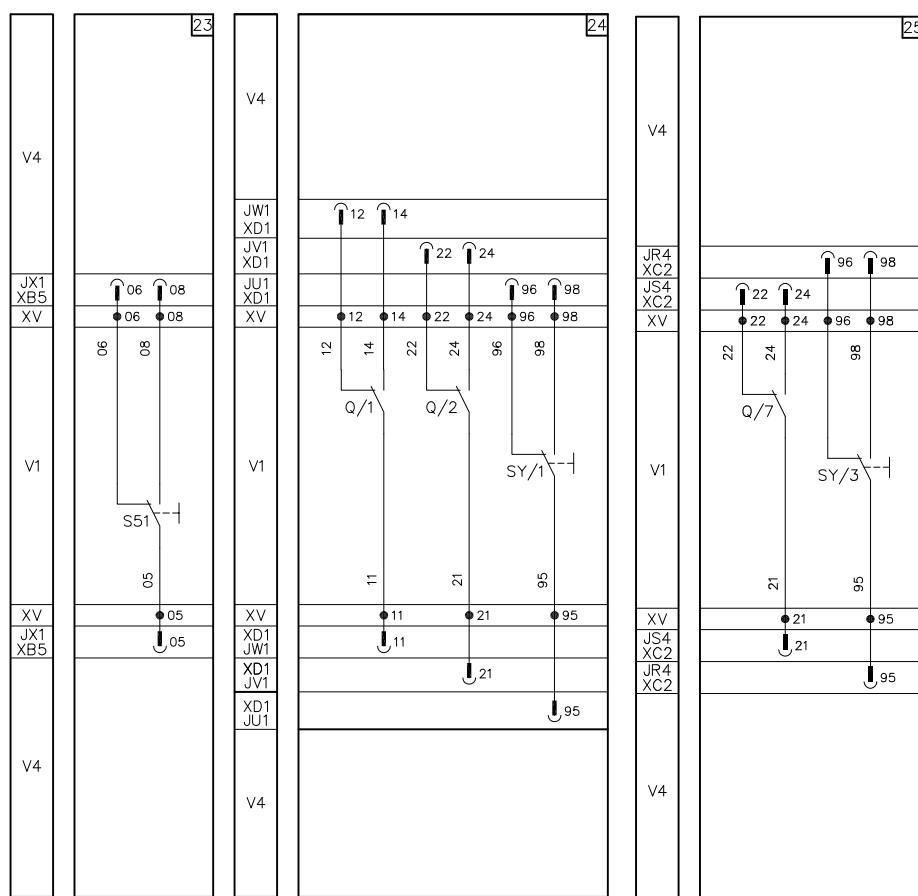


Wiring diagrams


Diagrams for XT5 and XT6

- 28) Circuit-breaker test position signalling contacts**
- 29) Circuit-breaker disconnected position signalling contacts**
- 30) Circuit-breaker inserted position signalling contacts**
- 31) Circuit-breaker inserted position signalling contacts**
- 32) Circuit-breaker inserted position signalling contacts**

—
28 - 29
Only for withdrawable version circuit-breaker

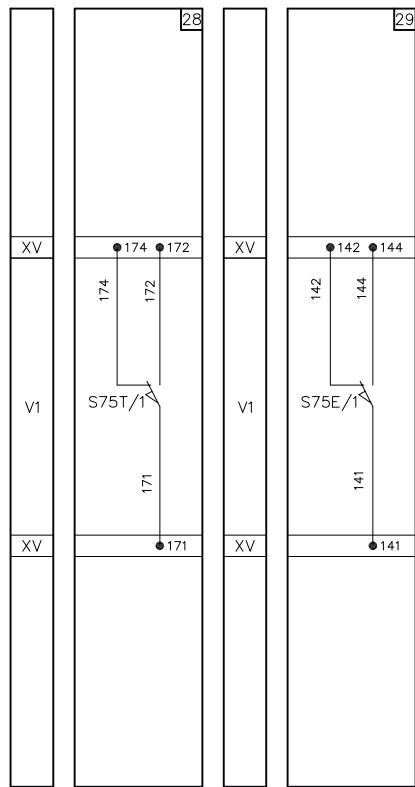


—
30 - 31 - 32
Only for plug-in or withdrawable version circuit-breaker

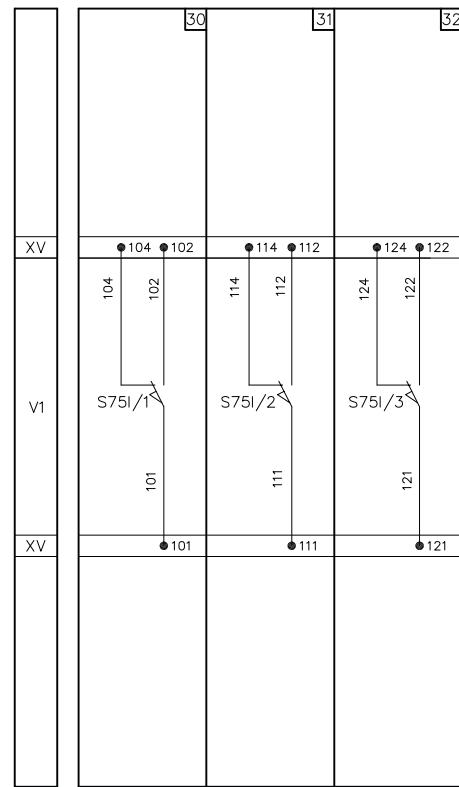

35) Differential relay tripped signalling contact S87/3**36) Differential relay circuits K87****37) Two contacts signalling differential relay pre-alarm and alarm S87**


—
36 - 37
Only for differential
relay type RC sel XT5
4 poles

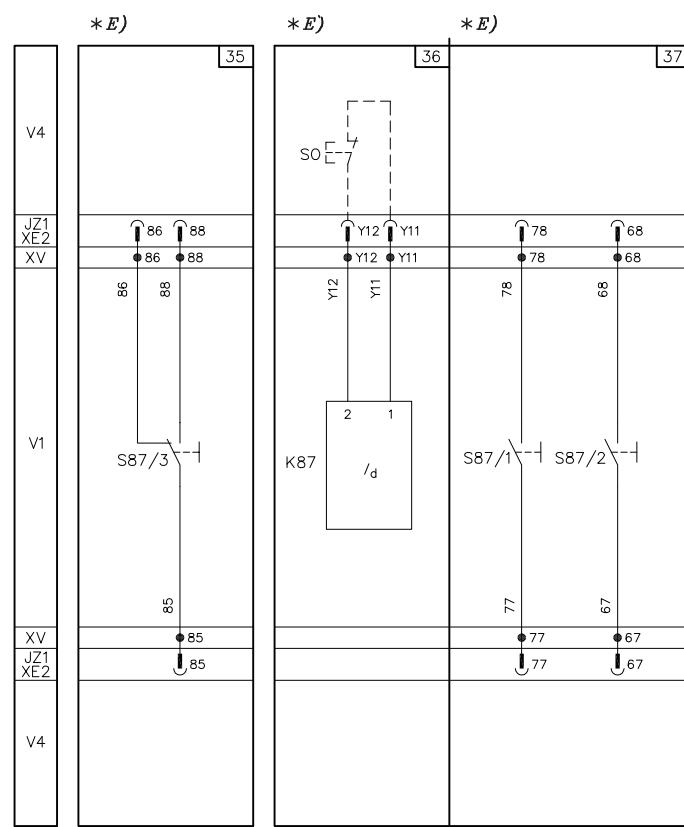

Wiring diagrams


Diagrams for XT5 and XT6

- 39) Auto/manual/lock status feedback**
- 40) Stored energy motor operator (MOE)**

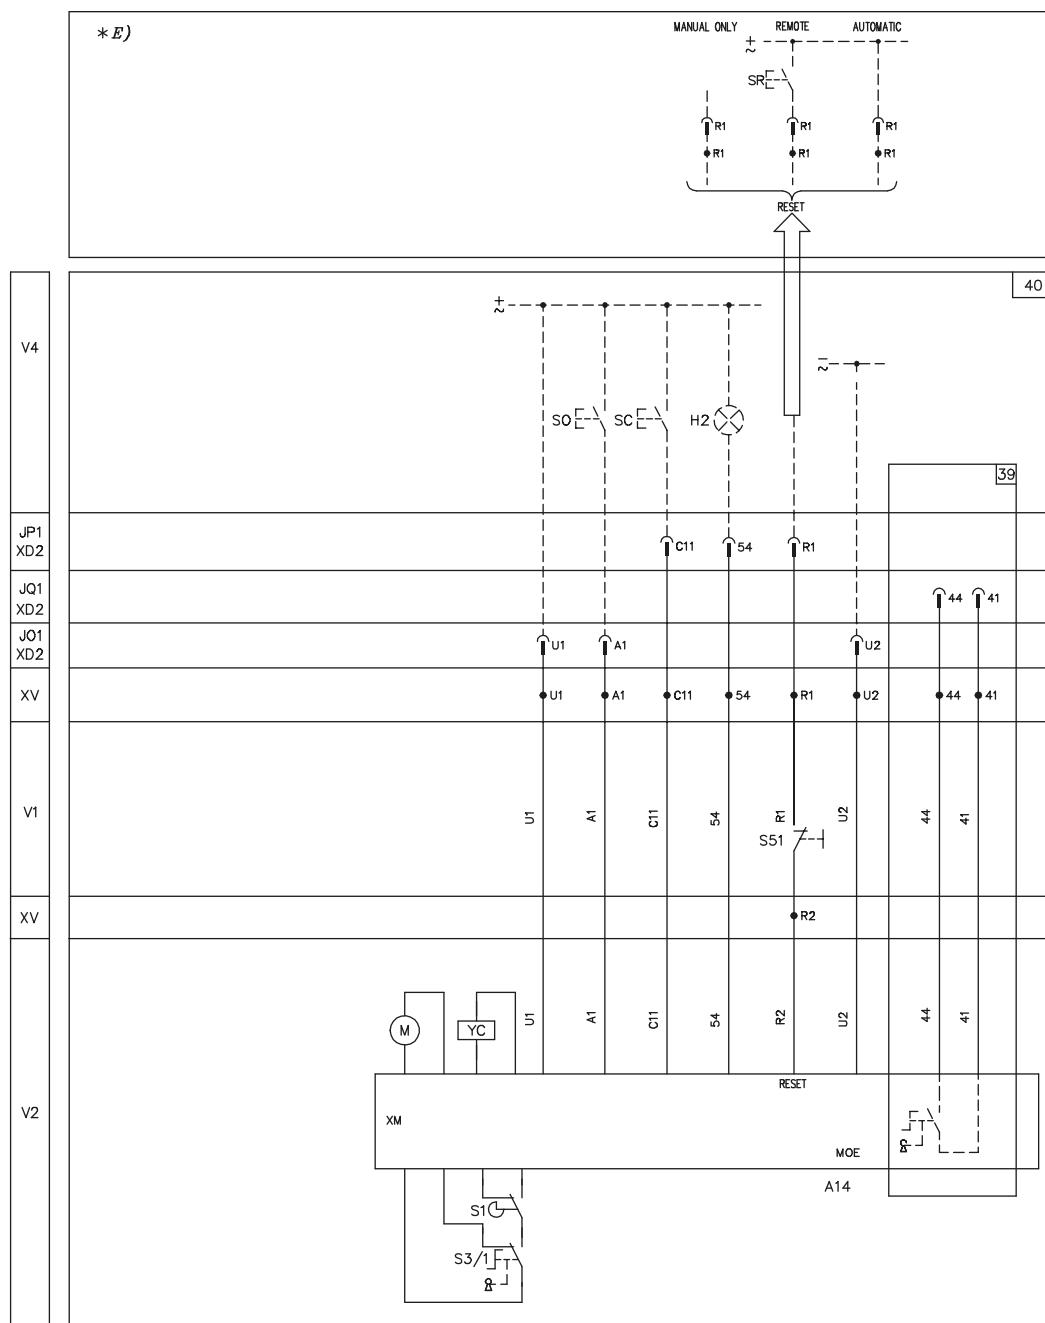

41) Direct auxiliary supply 24Vdc and local bus


—
As an alternative
to figure 78

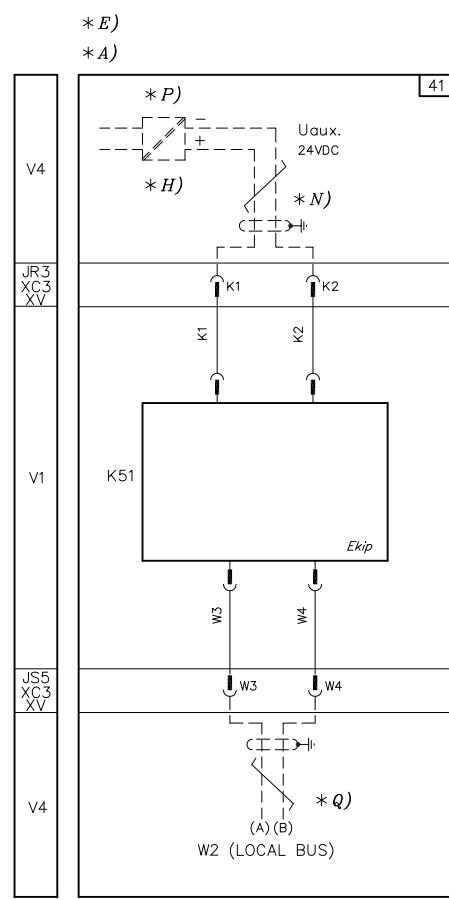


Wiring diagrams

Diagrams for XT5 and XT6

42) Interface unit type Ekip Com

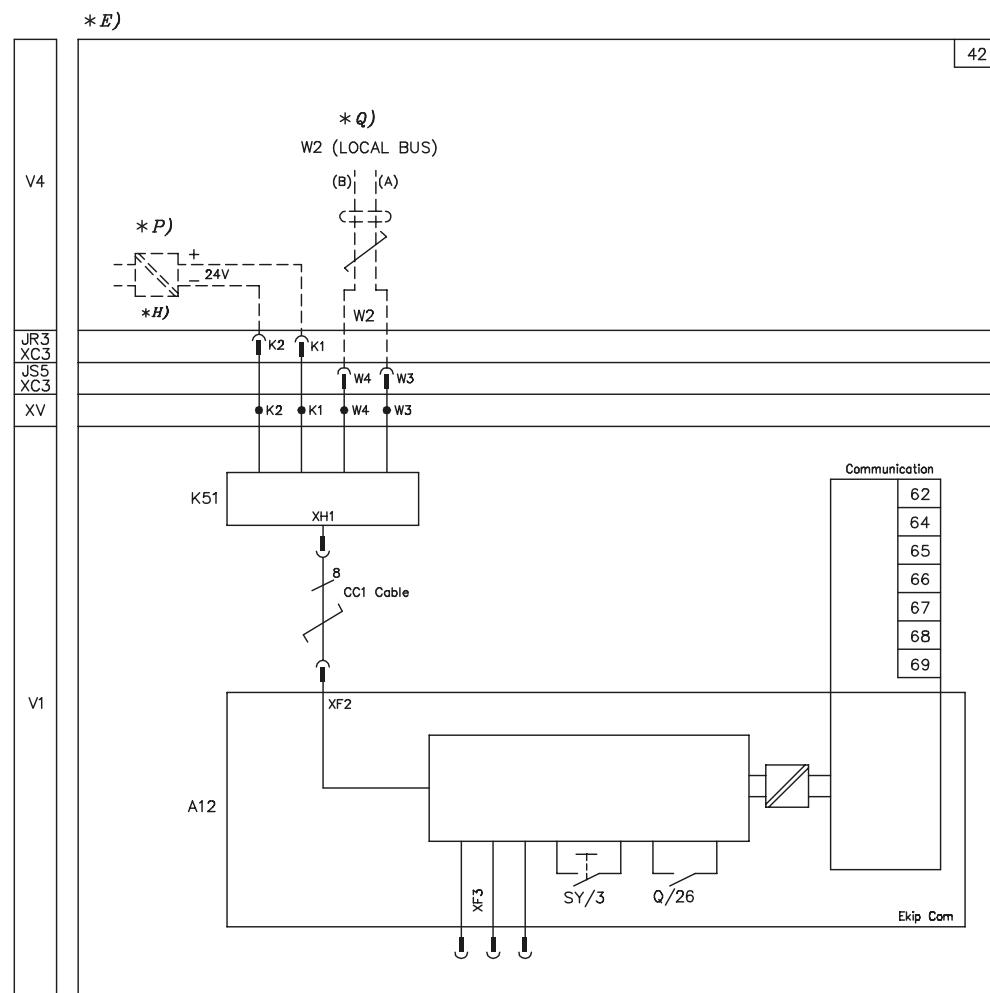

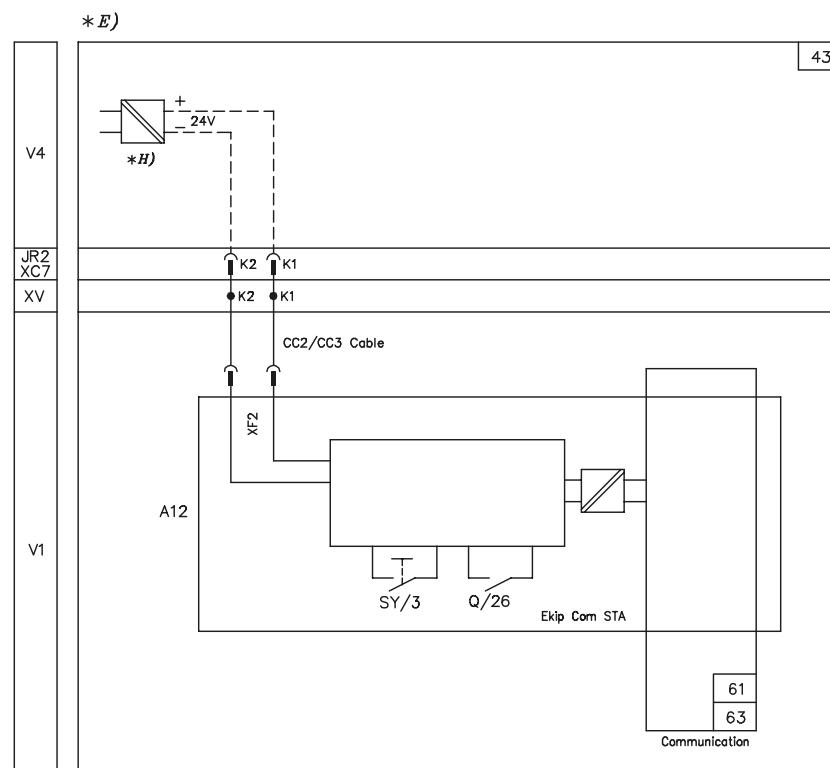
43) Stand alone interface unit type Ekip Com


Wiring diagrams

Diagrams for XT5 and XT6

39) Auto/manual/lock status feedback

44) Stand alone interface unit type Ekip Com with MOE-E motor operator

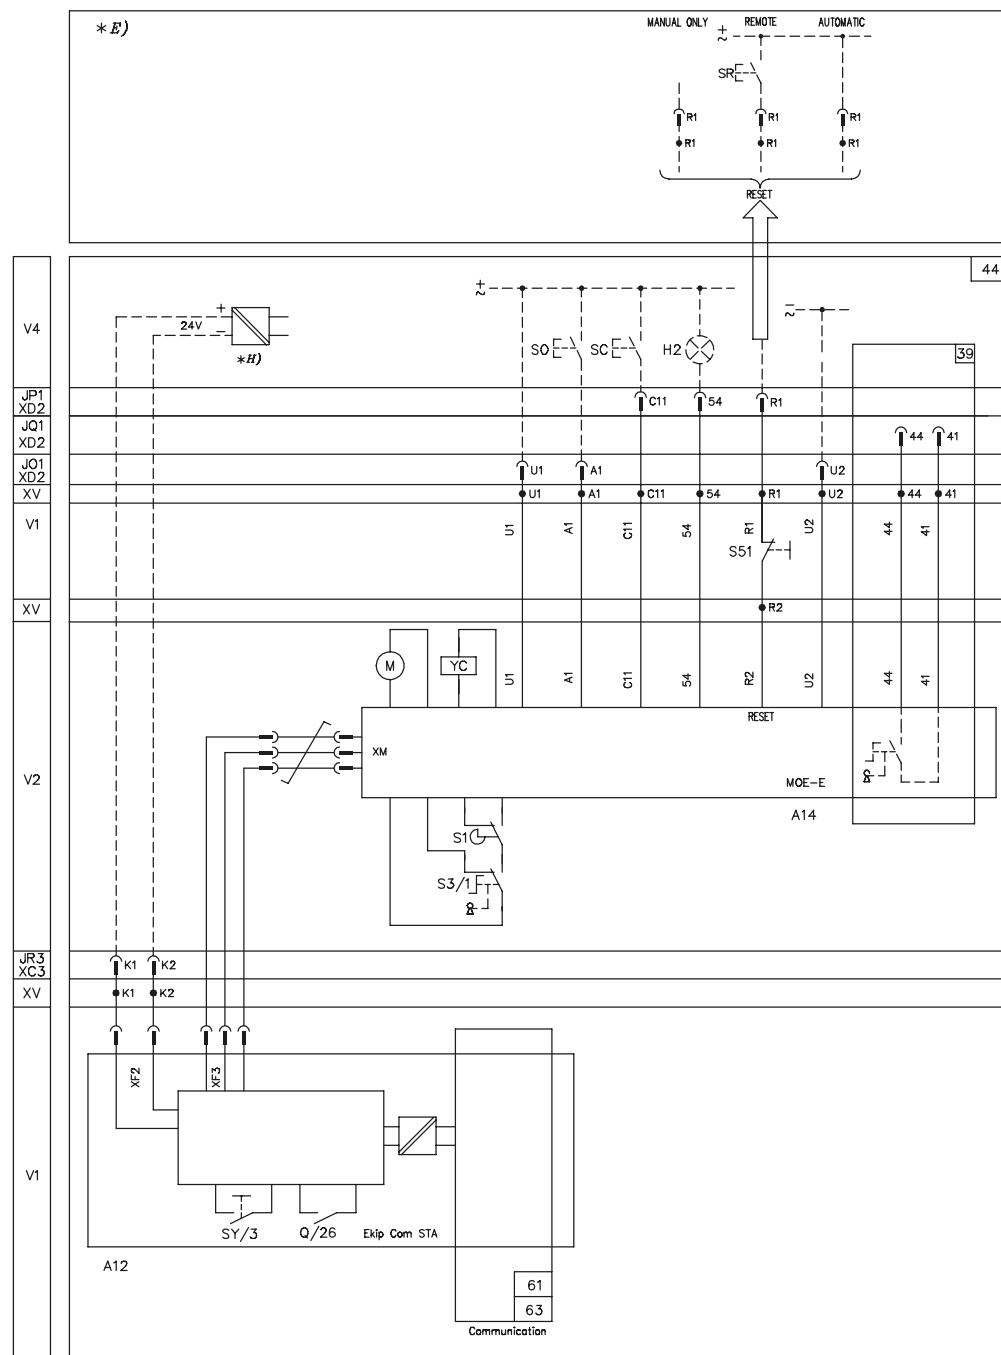

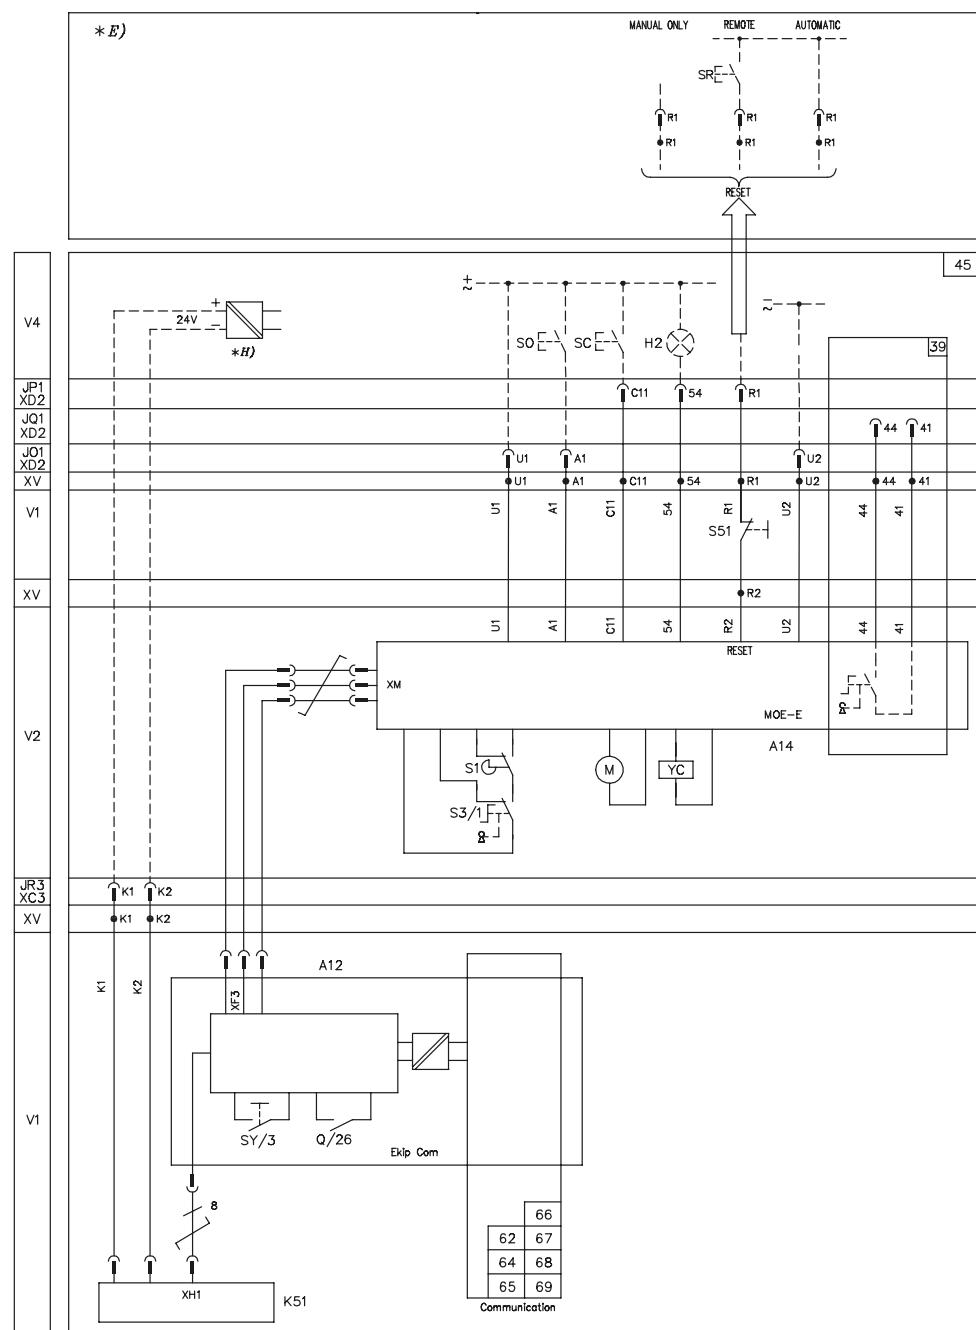39) Auto/manual/lock status feedback**45) Interface unit type Ekip Com with direct supply to relay and MOE-E motor operator**


Wiring diagrams

Diagrams for XT5 and XT6



39) Auto/manual/lock status feedback

46) Interface unit type Ekip Micro Module I/O with MOE-E motor operator

73) Ekip Micro Module I/O

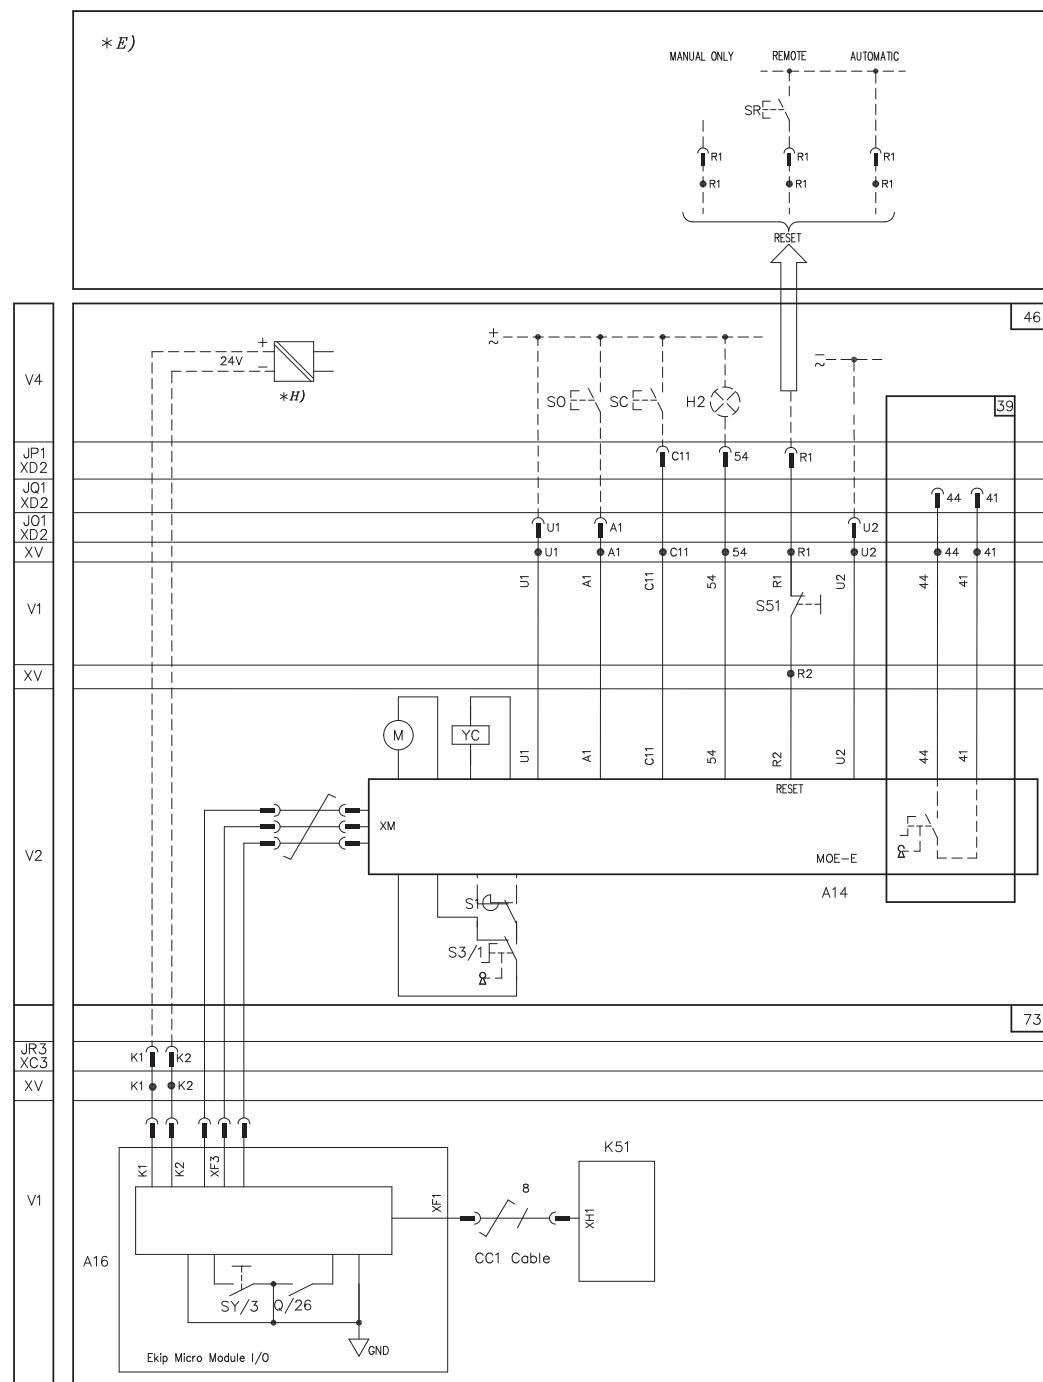

50) Zone selectivity

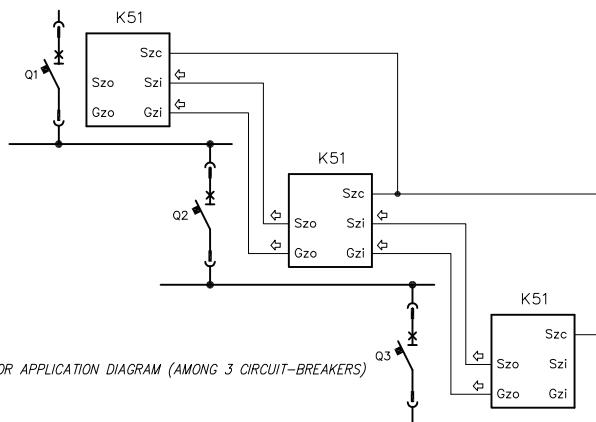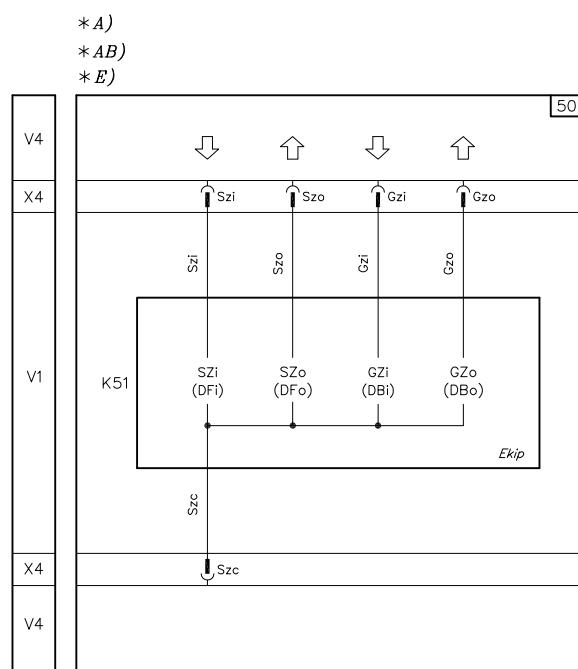


Wiring diagrams

Diagrams for XT5 and XT6

- 61) Modbus RTU STA interface of Ekip Com unit
- 62) Modbus RTU interface of Ekip Com unit
- 63) Modbus TCP STA interface of Ekip Com unit
- 64) Communication interface of Ekip Com unit (see table below)
- 65) Communication interface of Ekip Com unit (see table below)
- 66) Communication interface of Ekip Com unit (see table below)
- 67) Communication interface of Ekip Com unit (see table below)
- 68) Communication interface of Ekip Com unit (see table below)
- 69) Communication interface of Ekip Com unit (see table below)


—
61 - 62 - 63 - 64 - 65 -
66 - 67 - 68 - 69
As in alternative
to each other

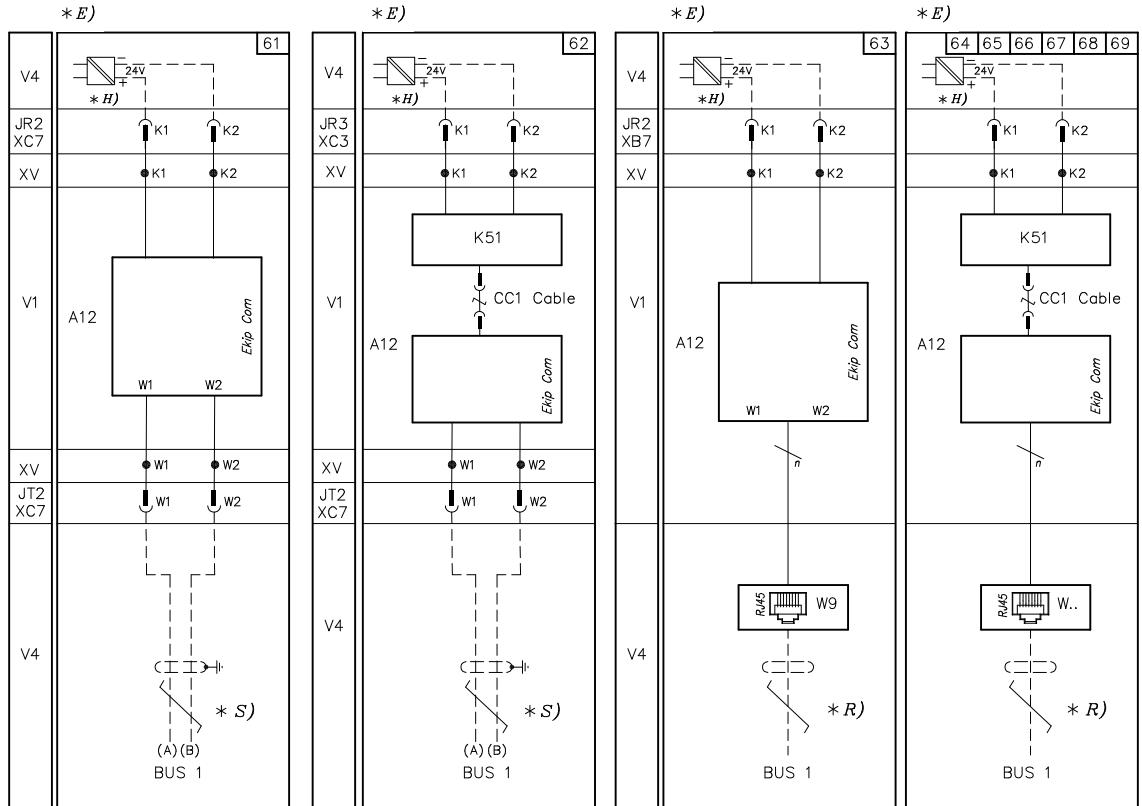

| FIG. | DESCRIZIONE / DESCRIPTION | BUS |
|------|---------------------------|-----|
| 64 | MODBUS TCP | W9 |
| 65 | PROFINET | W10 |
| 66 | ETHERNET I/P™ | W11 |
| 67 | IEC61850 | W12 |
| 68 | LINK | W13 |
| 69 | HUB | W14 |
| | | |

- 71) Ekip signalling 1K**
72) Ekip signalling maintenance module
94) Ekip CI


—
 71 - 72
 As in alternative
 to each other

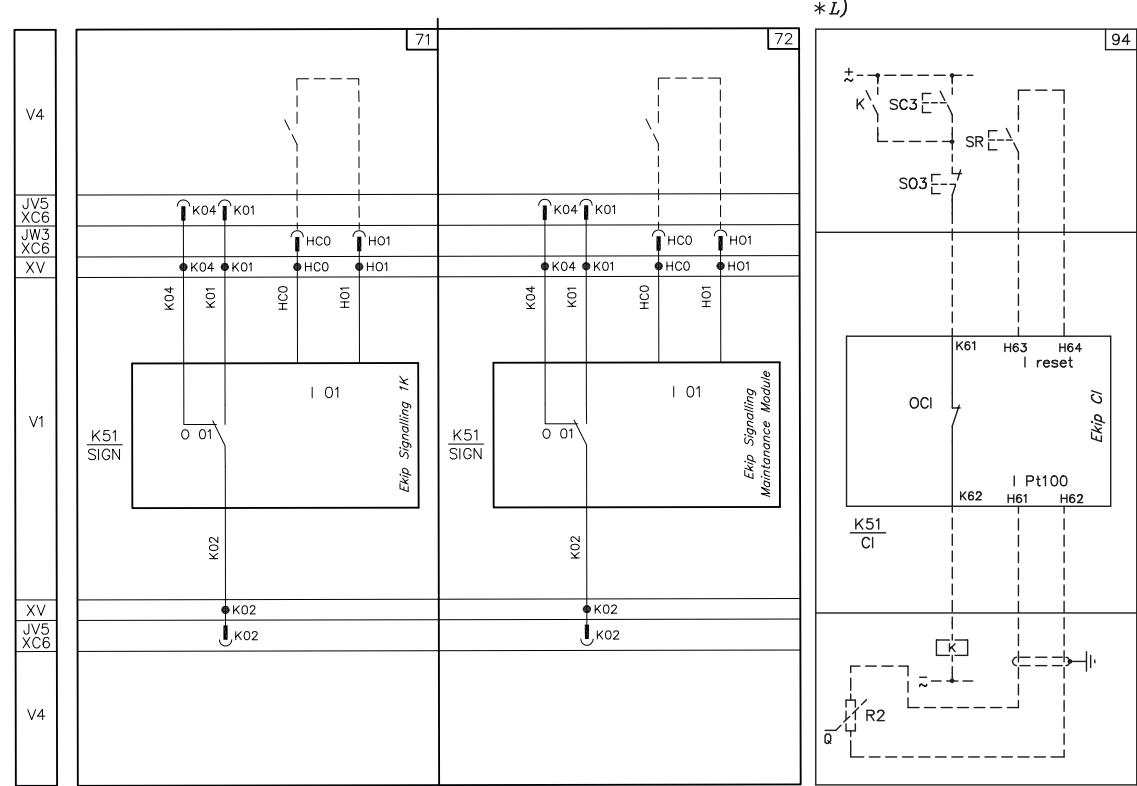


Wiring diagrams

Diagrams for XT5 and XT6

131) Motor starting module Ekip CI

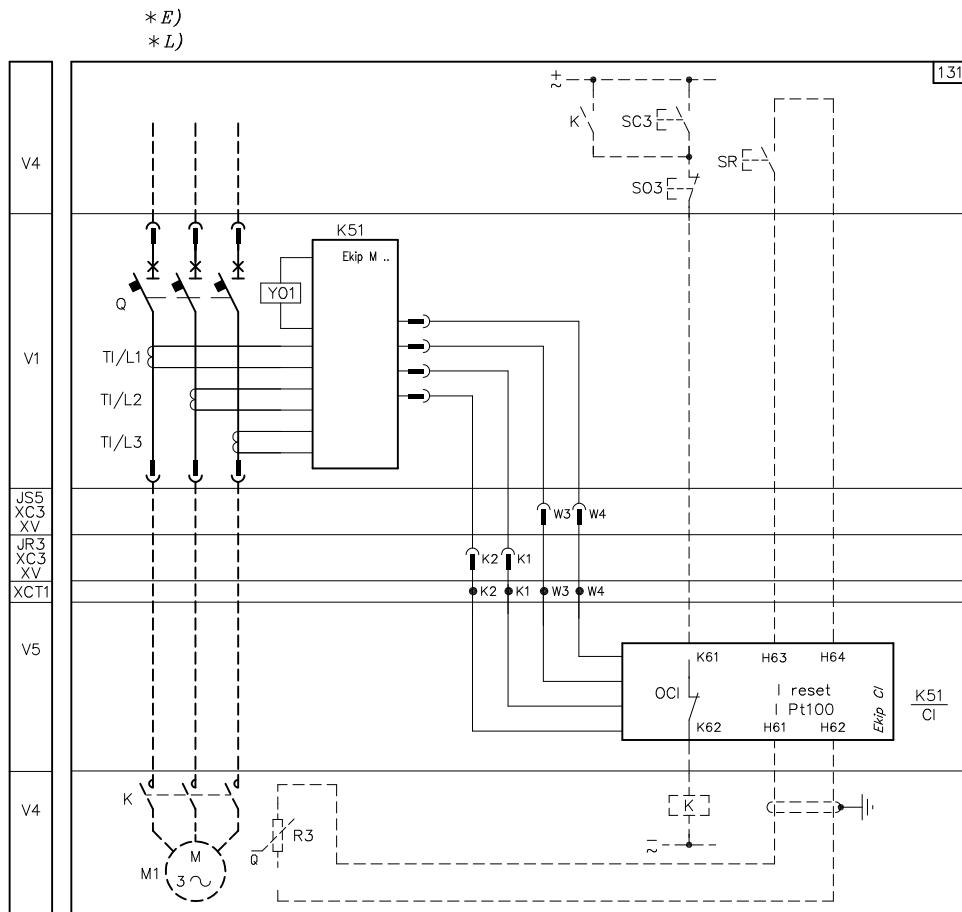


132) Motor starting module Ekip CI with ABB contactor series AF

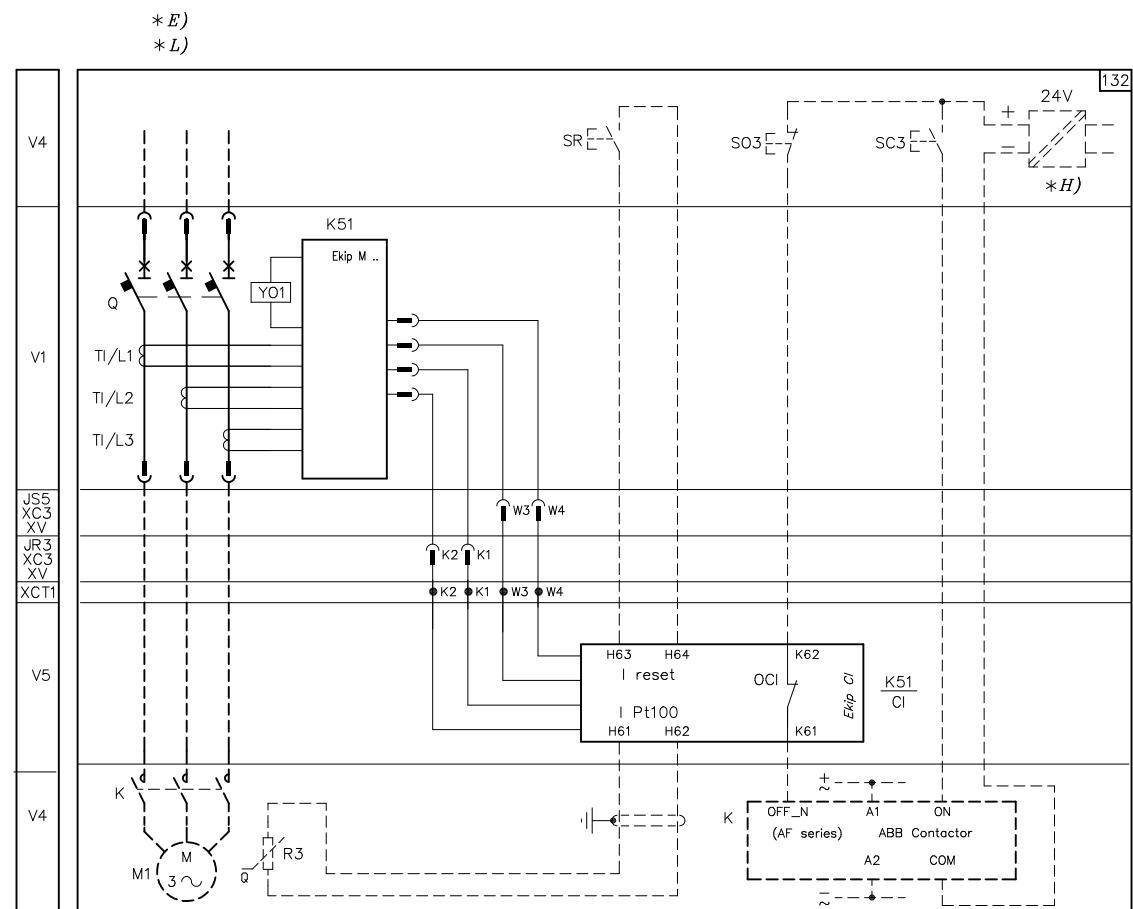


Wiring diagrams

Diagrams for XT5 and XT6

141) Ekip signalling 10K signalling unit

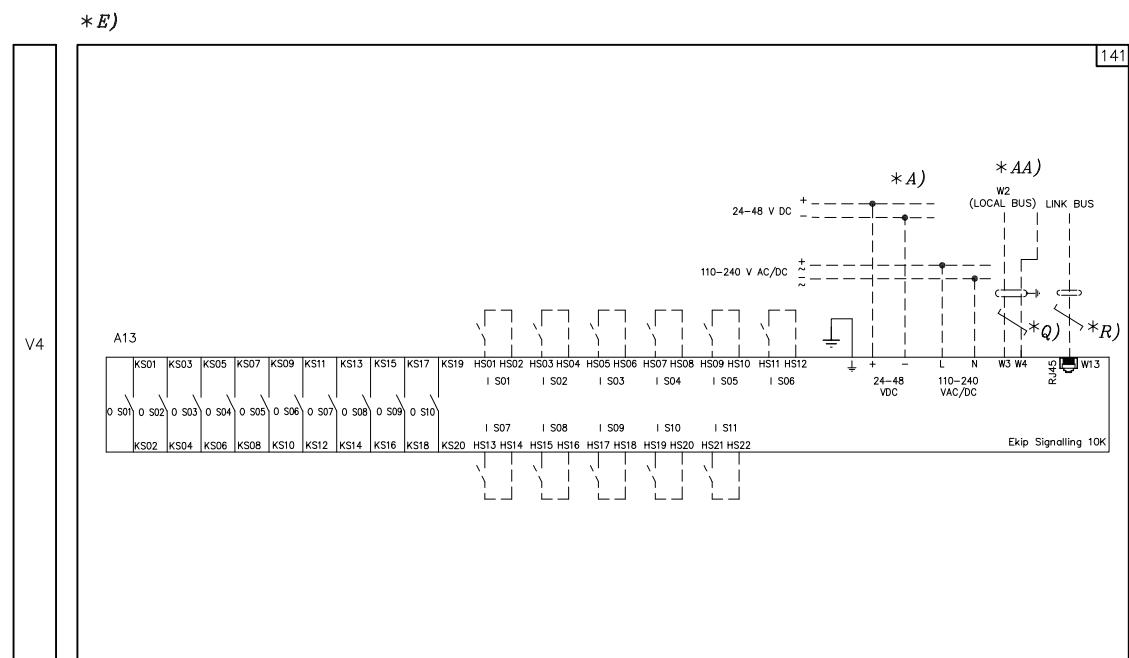


142) Ekip Multimeter unit with relay and direct auxiliary supply 24Vdc

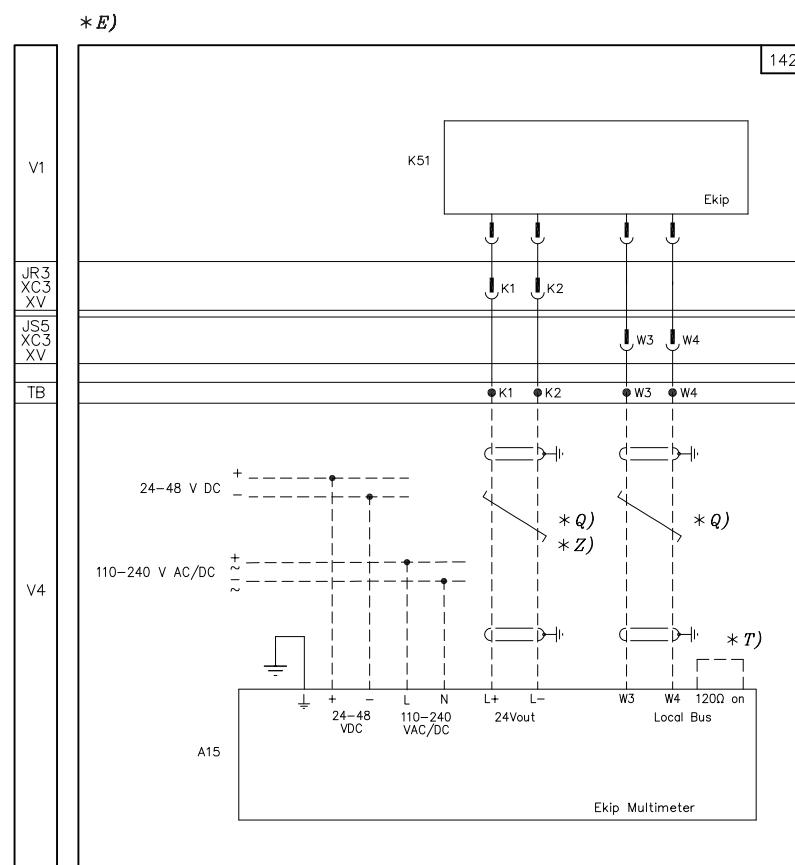

Wiring diagrams


Diagrams for XT5 and XT6

143) Ekip Multimeter unit with relay and auxiliary supply through module 110-240Vac/dc or 24-48Vdc

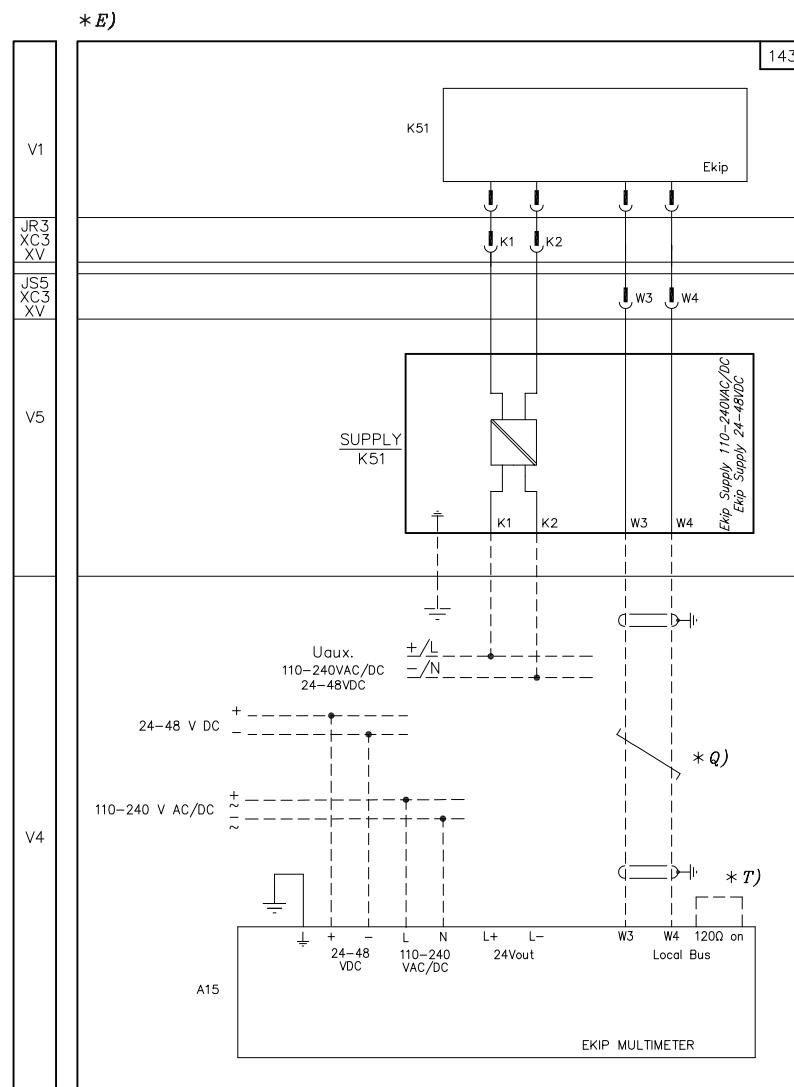


Wiring diagrams


Diagrams for XT7 and XT7 M

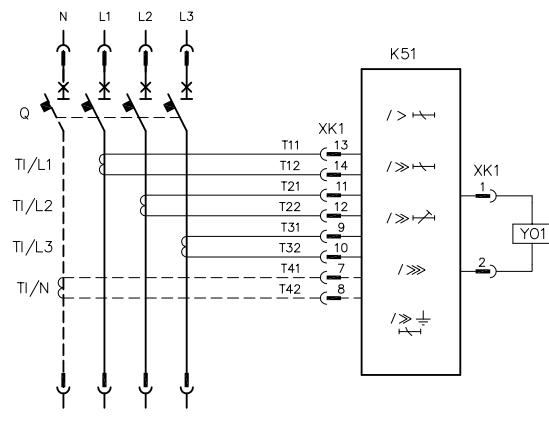

Three-pole or four-pole circuit-breaker with
Ekip Dip trip unit

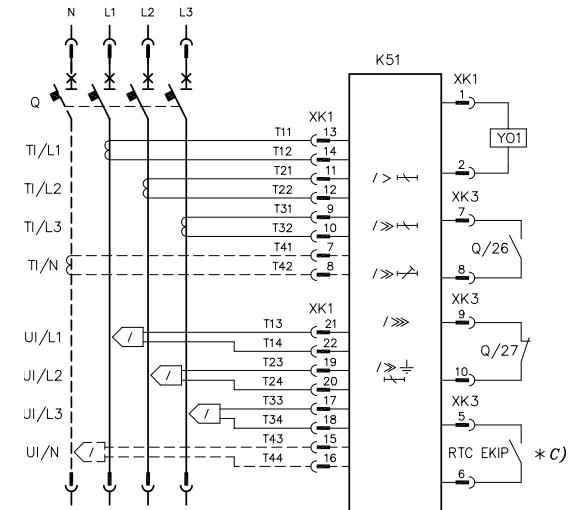

Three-pole or four-pole circuit-breaker with
Ekip Touch trip unit



Three-pole or four-pole switch-disconnector


Wiring diagrams

Diagrams for XT7 and XT7 M




- 11a) Protection trip unit tripped signaling contact – S51
- 12a) Contact for signaling position of loaded springs – S33M
- 13a) Motor for loading closing springs – M
- 14a) Trip contact reset coil – YR

—
12 - 13 - 14 only for XT7 M
circuit-breakers

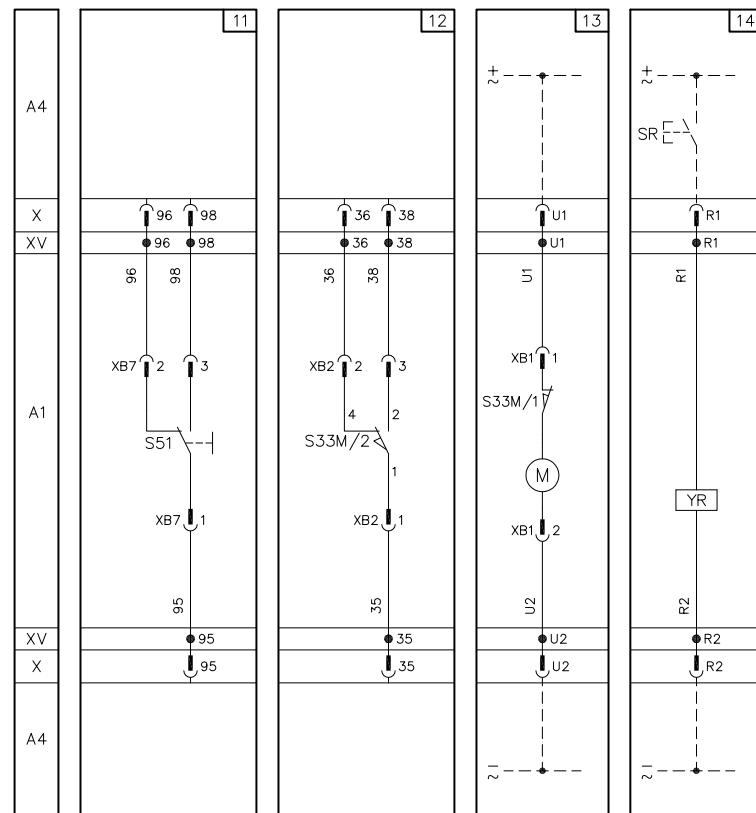

**16) Tripped position breaker signaling contact SY****17) Auxiliary early contacts – S4**

—
16 - 17 only for XT7
circuit-breakers

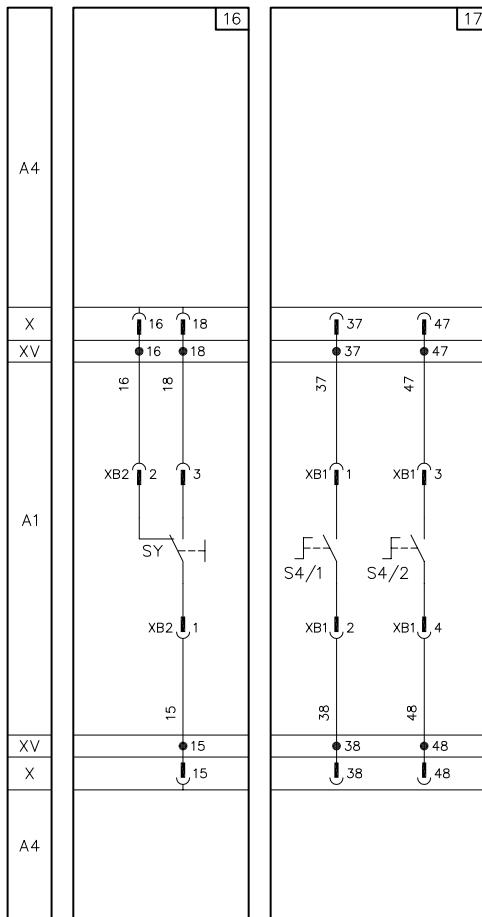

Wiring diagrams

Diagrams for XT7 and XT7 M




| | | | | |
|----|-----|-----|-----|-----|
| V3 | Vn | Ge* | Szi | Ne- |
| V2 | Rct | Ge- | Szo | Ne+ |
| V1 | Gzo | Szc | Gzi | Rca |

Trip Unit I/O

24) RC residual current sensor input (ANSI 64&50N TD)

24a) RC differential ground fault protection sensor input (ANSI 87N)

24 - 24a as an alternative to each other and to figure 25

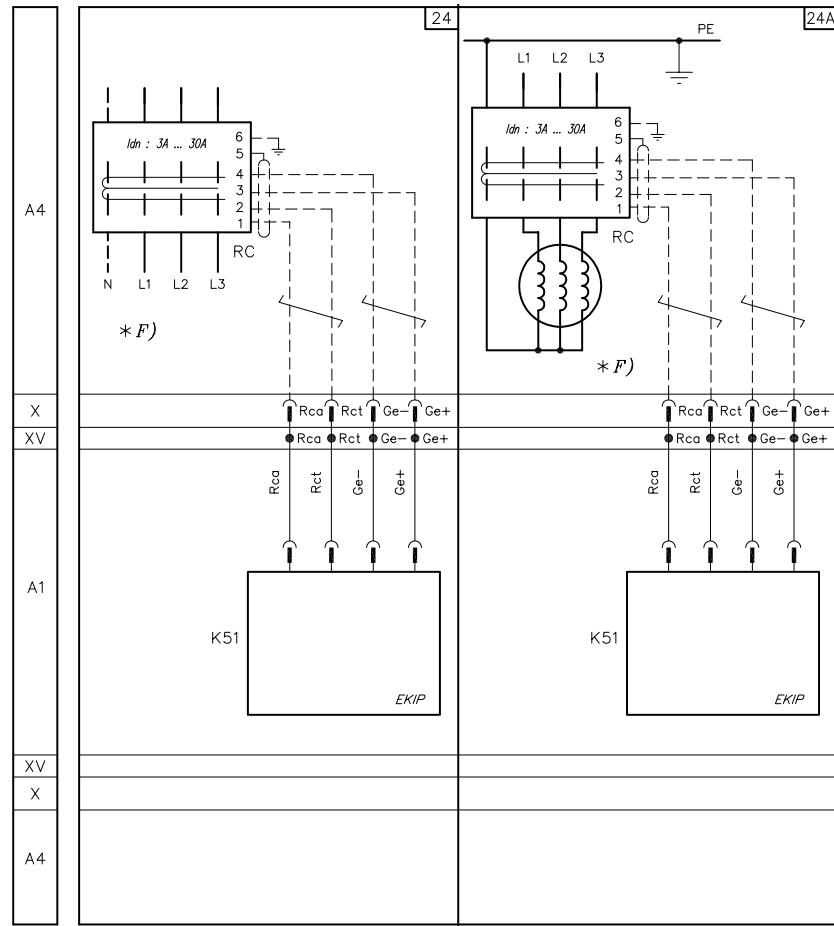




25) Transformer star centre sensor input

27) Current sensor input on external neutral (only for 3-pole circuit breaker)

—
25 as an alternative
to figures 24 - 24a

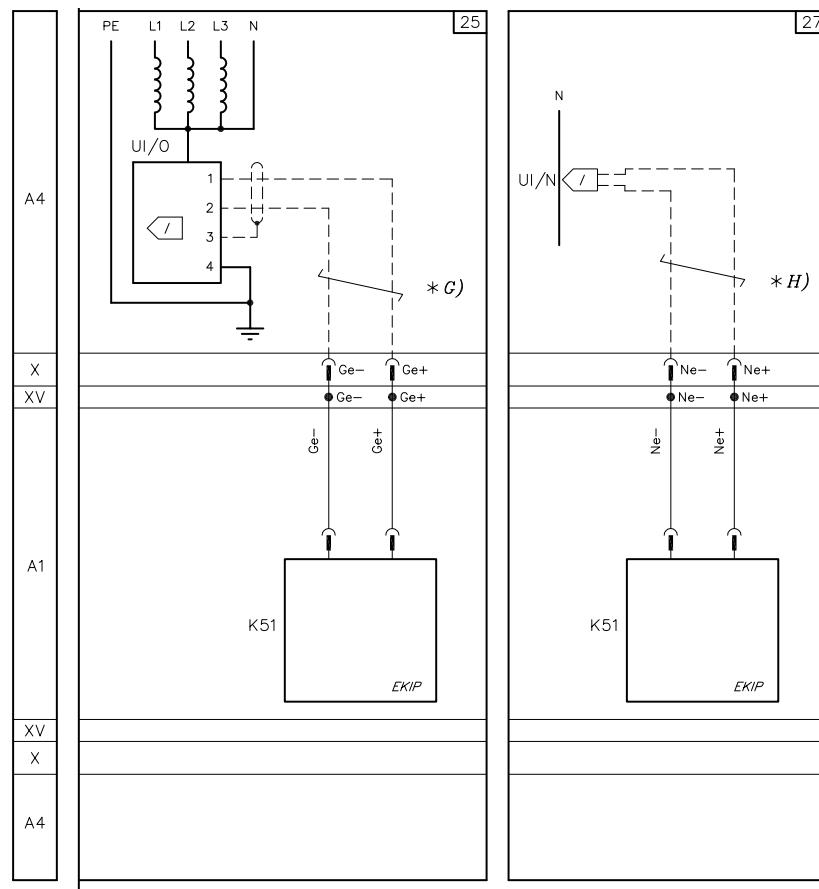

Wiring diagrams

Diagrams for XT7 and XT7 M



70) YO2/YU opening coil state signaling contact – S52

71) Ready to close contact – RTC

72) Second opening coil – YO2


73) Undervoltage coil – YU

73) Undervoltage coil with external time-lag device YU, D

—
70 only for XT7
circuit-breakers

71 only for XT7 M
circuit-breakers

72 - 73 - 74 as an
alternative to each other

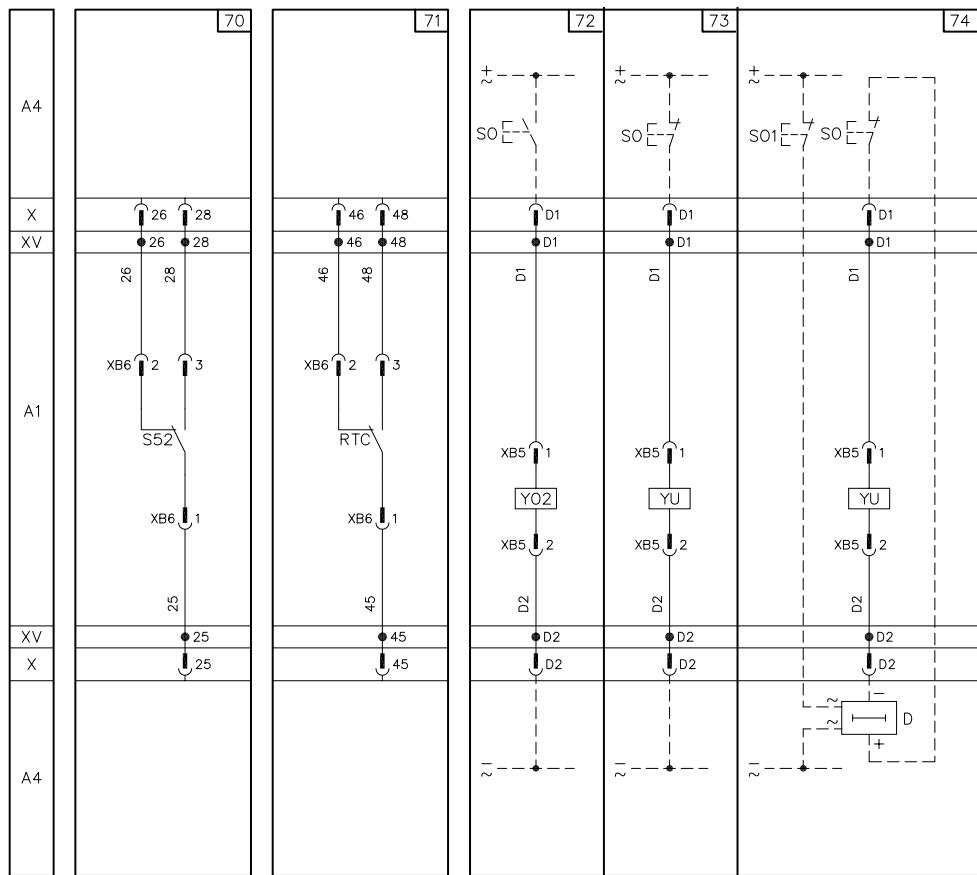



75) First opening coil – YO

76) First opening coil with control from protection trip unit – YO, Ekip Com Actuator


77) First closing coil – YC

78) First opening coil with control from protection trip unit – YC, Ekip Com Actuator

—
75 - 76 as an alternative
to each other

77 - 78 only for XT7 M
circuit-breakers

77 - 78 as an alternative
to each other

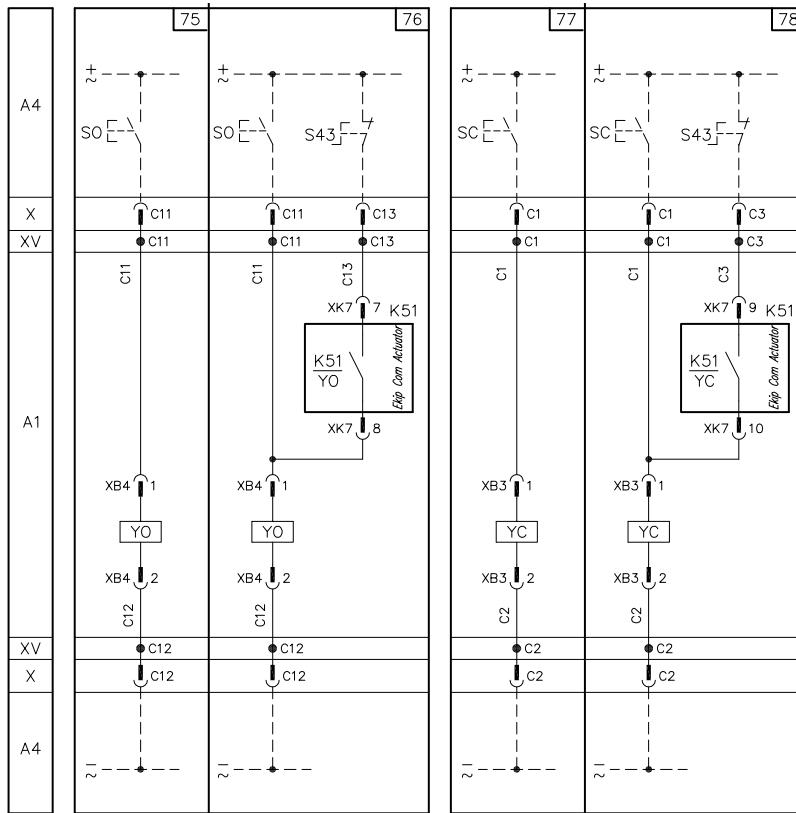


Wiring diagrams

Diagrams for XT7 and XT7 M




81) Open/Close auxiliary contacts of the circuit-breaker (first set)

91a) Supplementary open/close auxiliary contacts outside the circuit-breaker

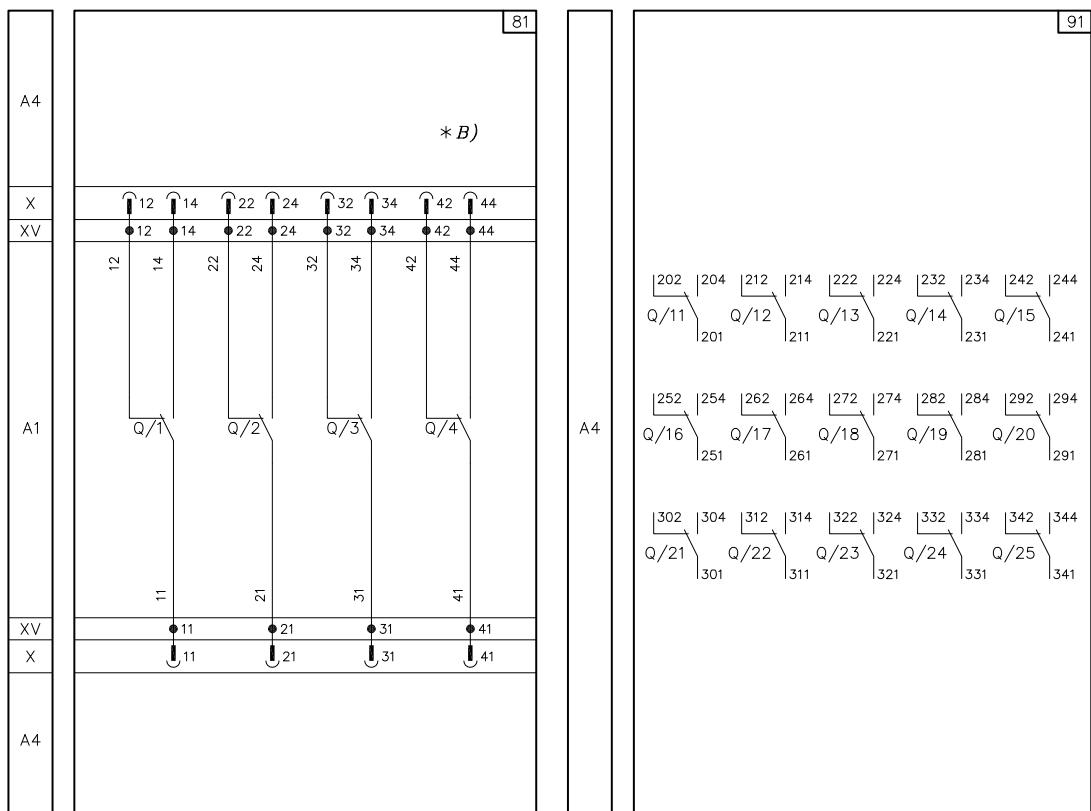


95a) Contacts for signaling of circuit-breaker in racked-in, test, racked-out position

—
only for withdrawable
version

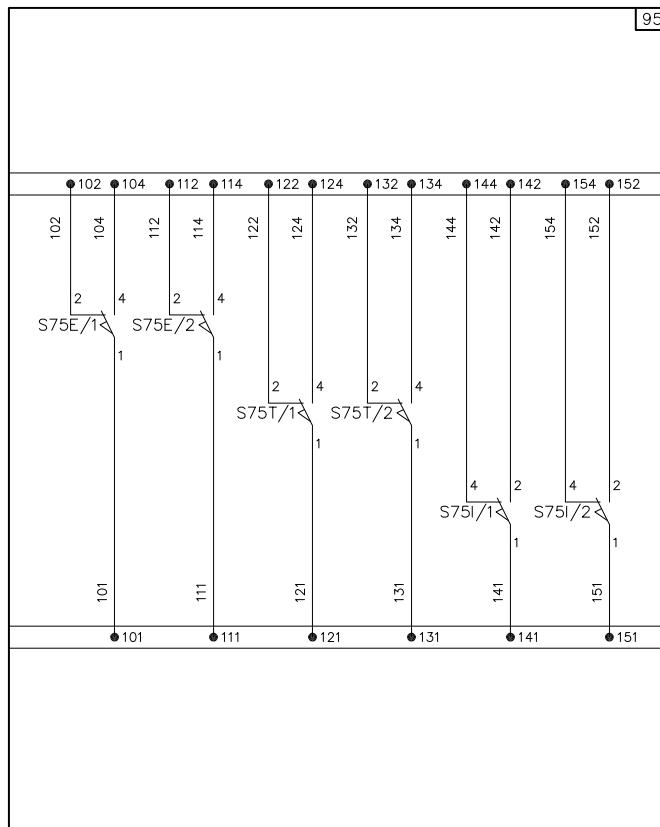

Wiring diagrams


XT2-XT4-XT5-XT7-XT7 M modules

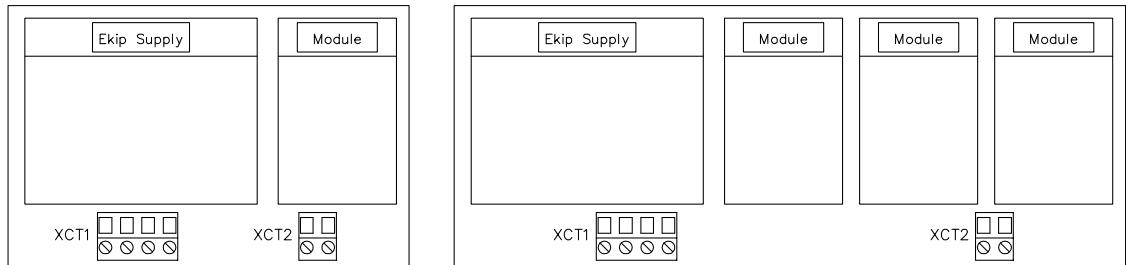


75) Ekip Cartridge for one module and one Ekip Supply

76) Ekip Cartridge for three modules and one Ekip Supply

—
75 - 76 as an alternative
to each other

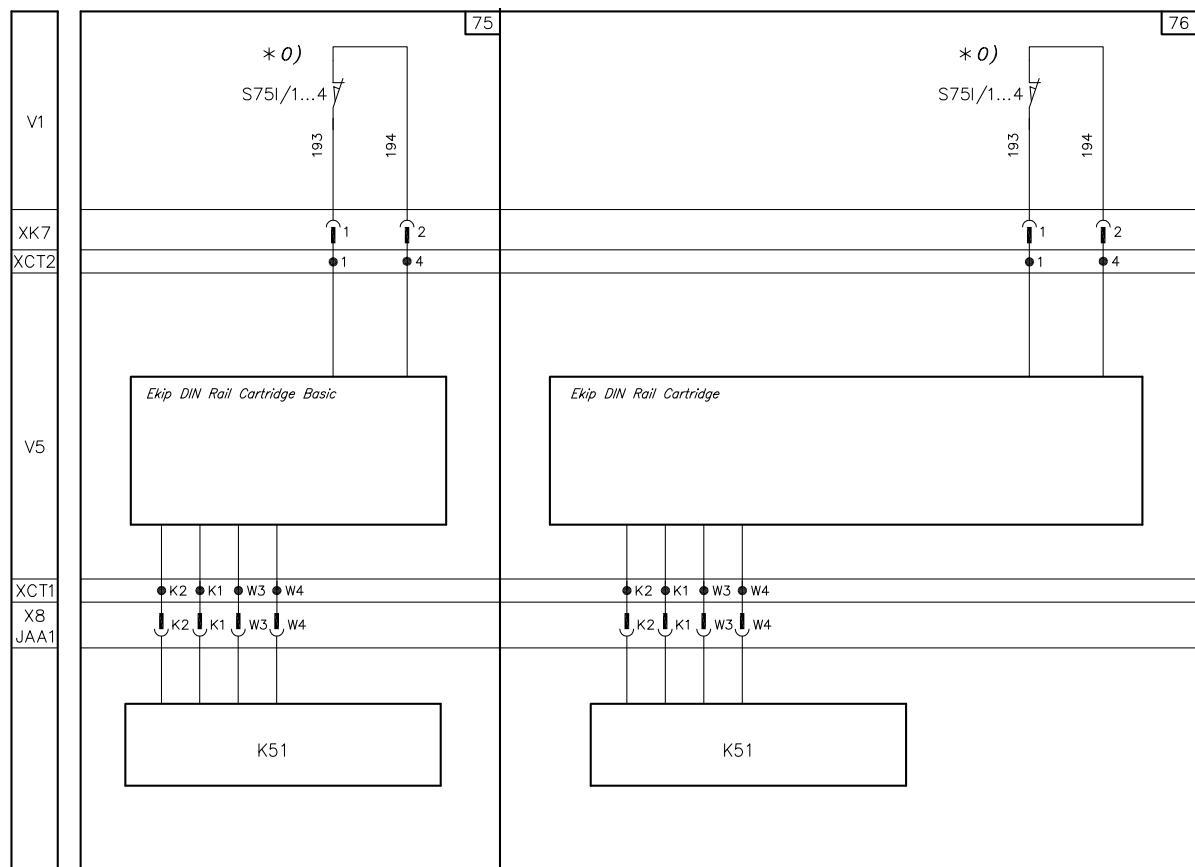

**Installation slot
For XT2-XT4-XT5 Ekip Cartiridge**

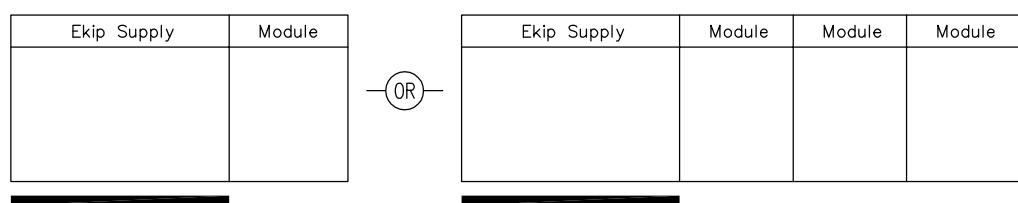


For XT7-X7M terminal box



81a) Ekip Supply: auxiliary supply through module 110-240Vac/dc or 24/48Vdc and local bus

—
81 as an alternative
to figure 49

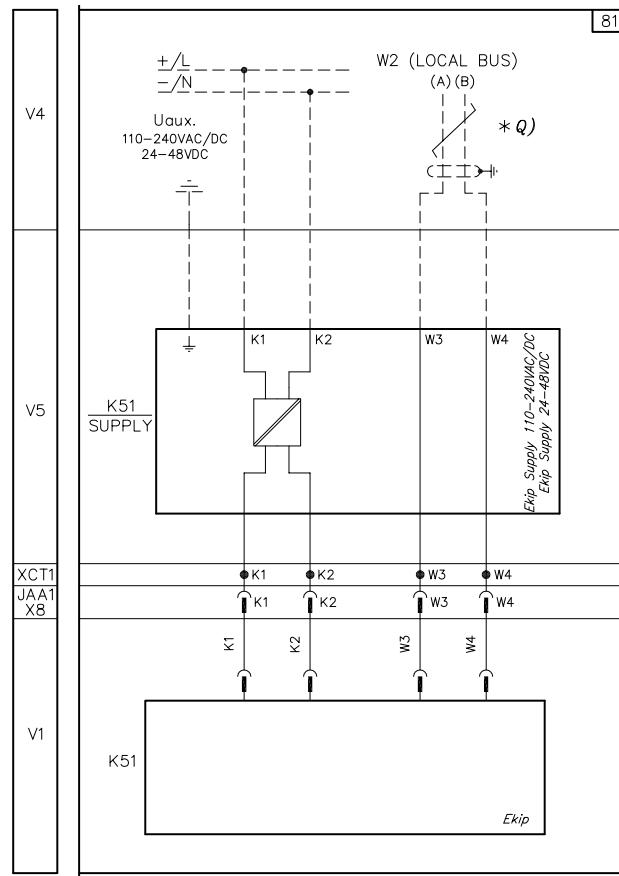



Wiring diagrams

XT2-XT4-XT5-XT7-XT7 M modules

83) Ekip Signalling 2K-1

84) Ekip Signalling 2K-2

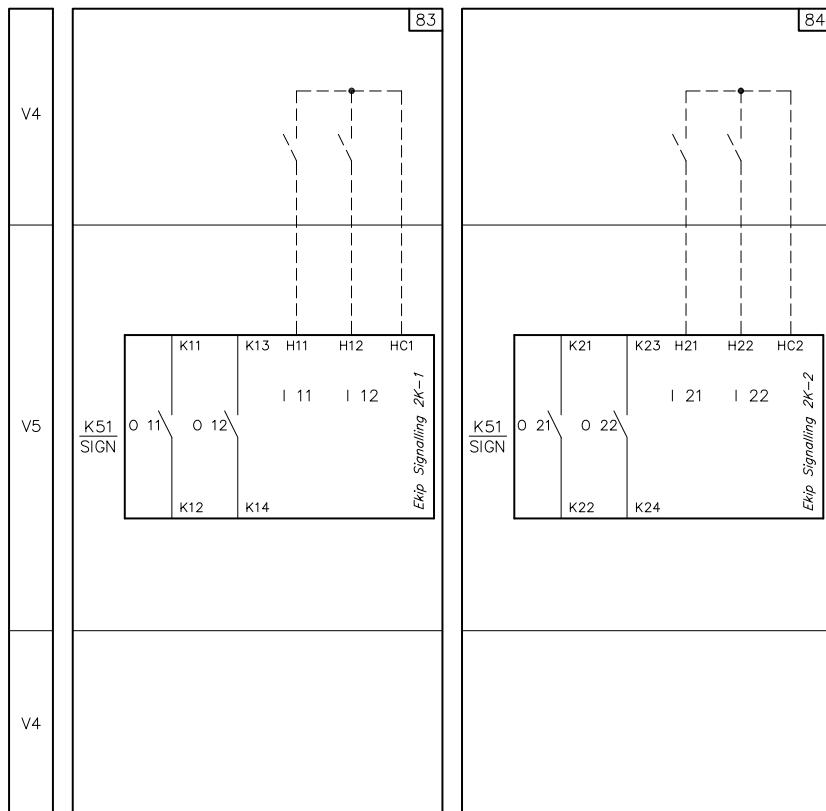

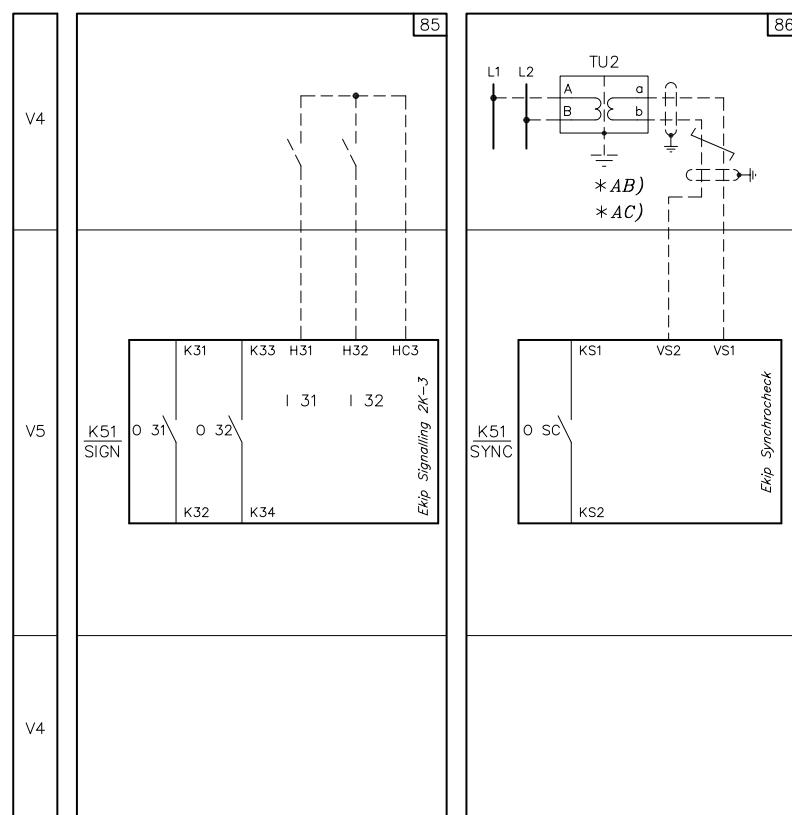
85) Ekip Signalling 2K-3**86) Ekip Synchrocheck**

Wiring diagrams

XT2-XT4-XT5-XT7-XT7 M modules


87) Ekip Signalling 3T-1

88) Ekip Signalling 3T-2

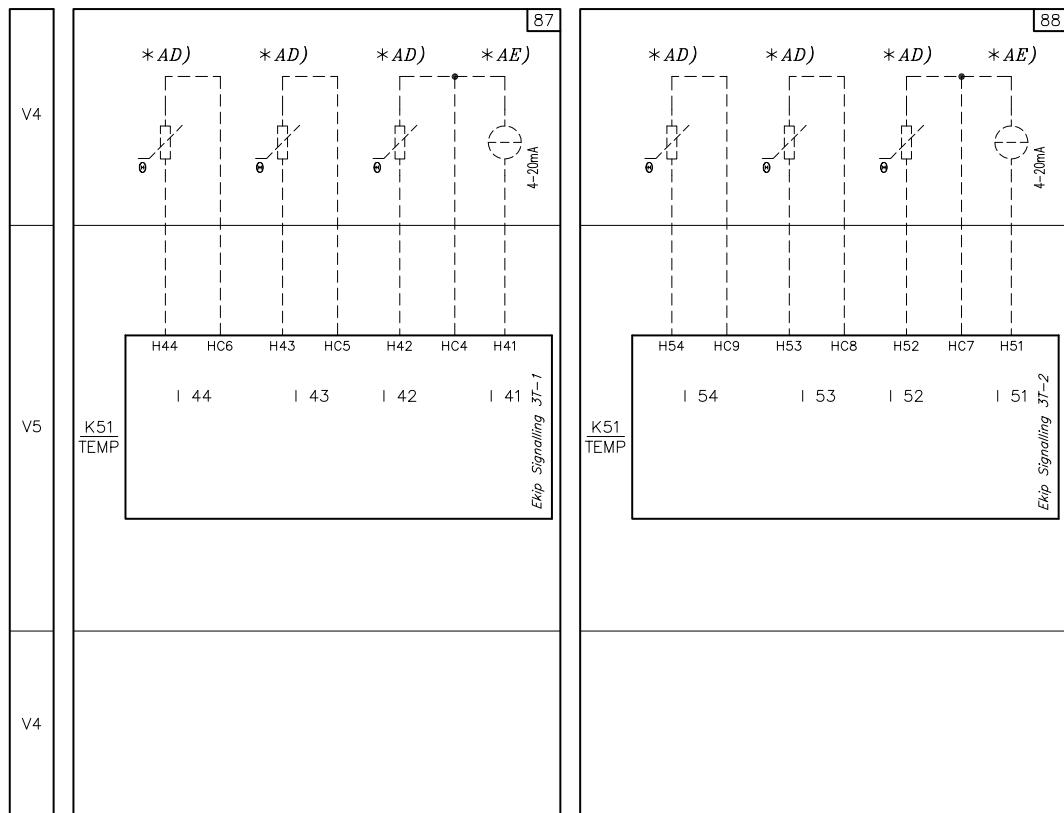

XT2-XT4-XT7-XT7 M

- 89) Ekip Com Modbus RTU**
90) Ekip Com Modbus TCP
92) Ekip Com Ethernet/IP
94) Ekip Com IEC61850
95) Ekip Link
96) ABB Ability™ Edge Industrial Gateway
97) Ekip Com Profinet
91) Ekip Com Profibus DP
93) Ekip Com DeviceNet

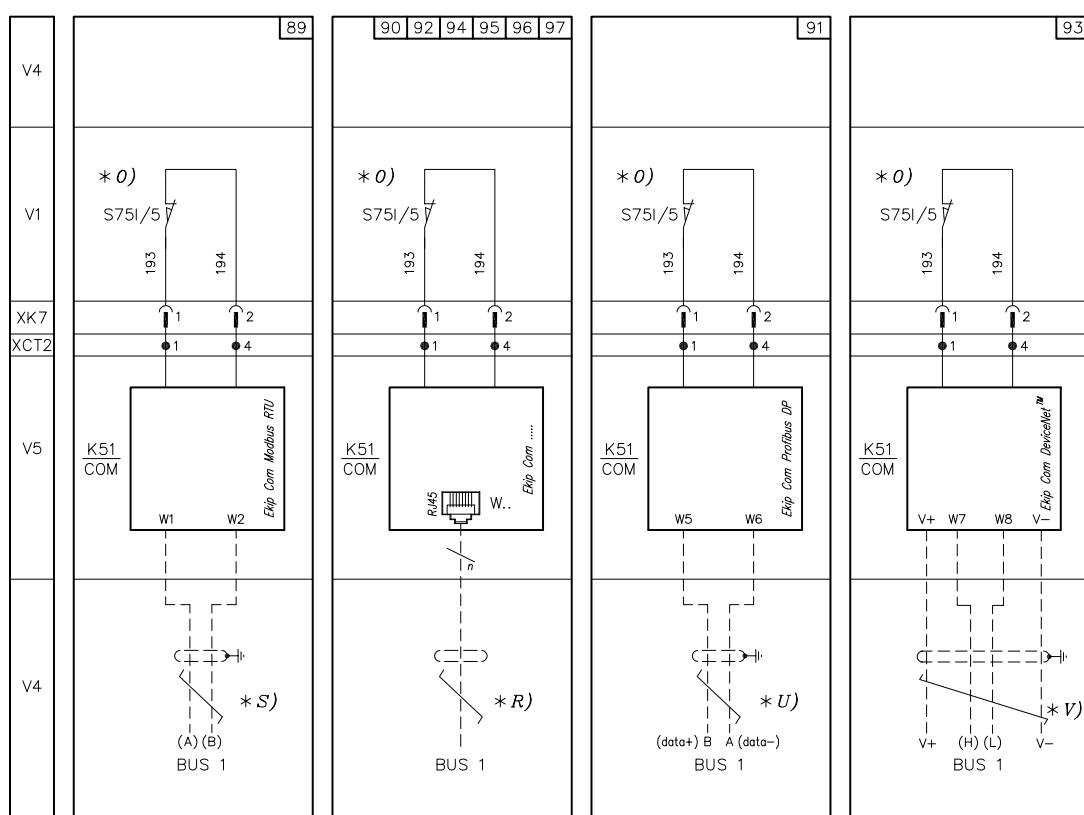


Wiring diagrams


XT2-XT4-XT5-XT7-XT7 M modules

XT5

- 85) Ekip Com Modbus RTU
- 86) Ekip Com Modbus TCP
- 87) Ekip Com Profinet
- 88) Ekip Com I/P™
- 89) Ekip Com IEC61850
- 90) Ekip Com Link
- 91) ABB Ability™ Edge Industrial Gateway
- 92) Ekip Com Profibus DP
- 93) Ekip Com DeviceNet™

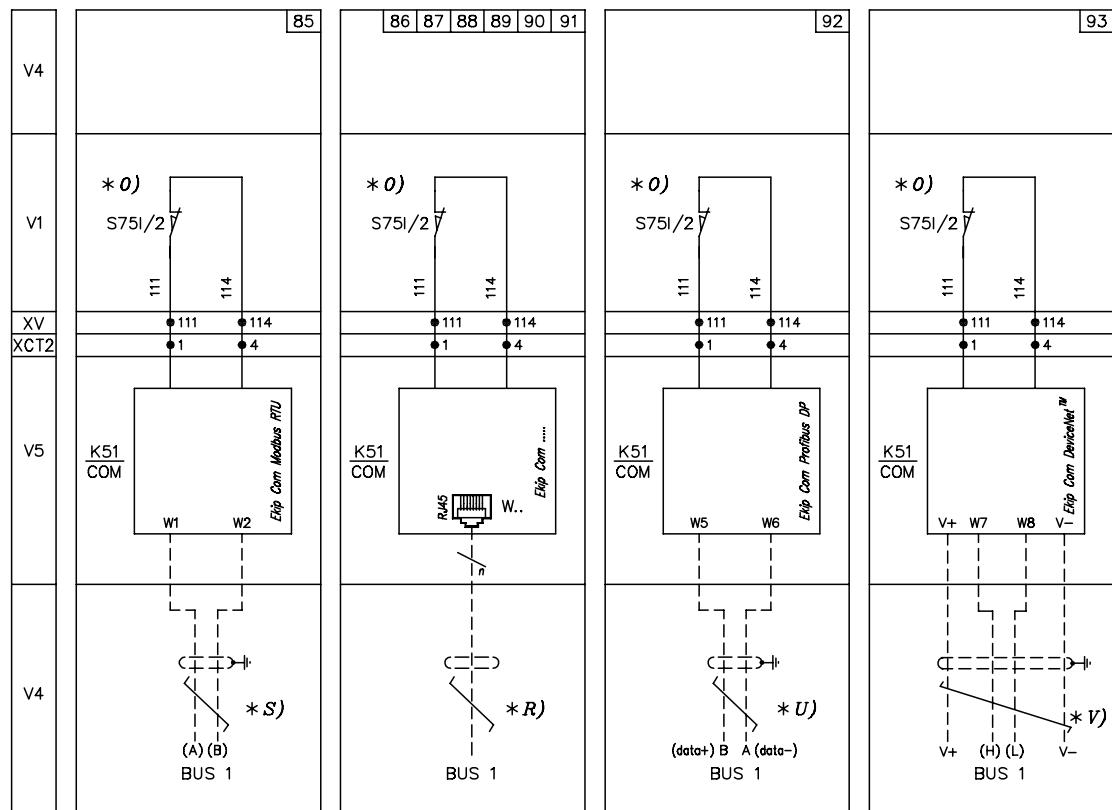

**Installation slot
For XT2-XT4-XT5 Ekip Cartiridge**

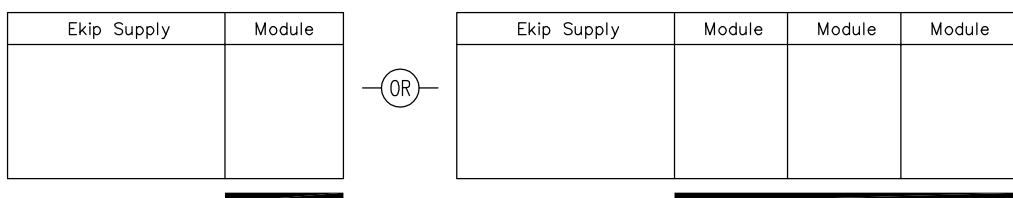

For XT7-X7M terminal box



110) Ekip Com Modbus RTU redundant

111) Ekip Com Modbus TCP redundant


113) Ekip Com Profinet redundant

115) Ekip Com Ethernet IP redundant

116) Ekip Com IEC61850 redundant

112) Ekip Com Profibus DP redundant

114) Ekip Com Devicenet™ redundant

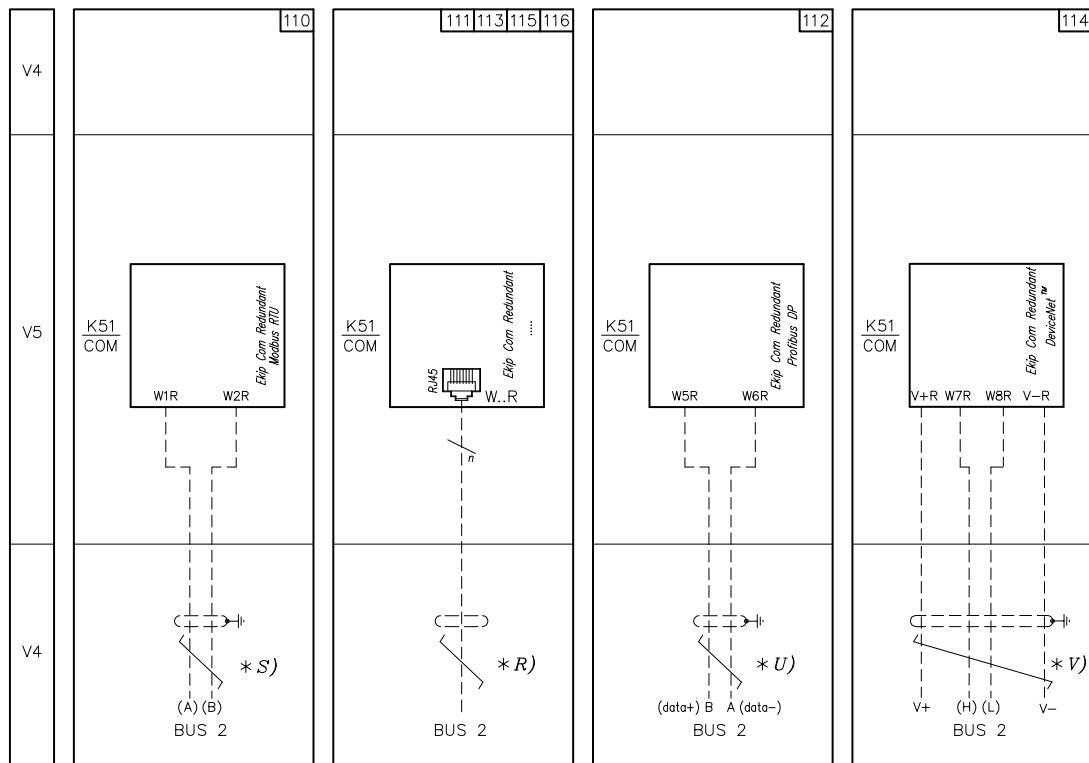



—
ABB SACE S.p.A.
Electrification Business Area
Smart Power Division
5, Via Pescaria
I-24123 Bergamo - Italy
Phone: +39 035 395.111

new.abb.com/low-voltage/products/circuit-breakers/xt



Stay tuned. Discover more by visiting the webpage reserved to SACE Tmax XT and be always up-to-date with the latest edition of the catalogue.