

NOTES:


1. WARNING

Using a non-factory RS232 data cable between UC12 unit may result in damage and may void system warranty.

2. All installations in hazardous locations must comply with requirements of Certification Drawing 2017275-CD.

3. Dial-Up Modem Configuration Shown. When using dial-up dual port modem, power to be connected to P1-9.

4. Software Scheduler Required

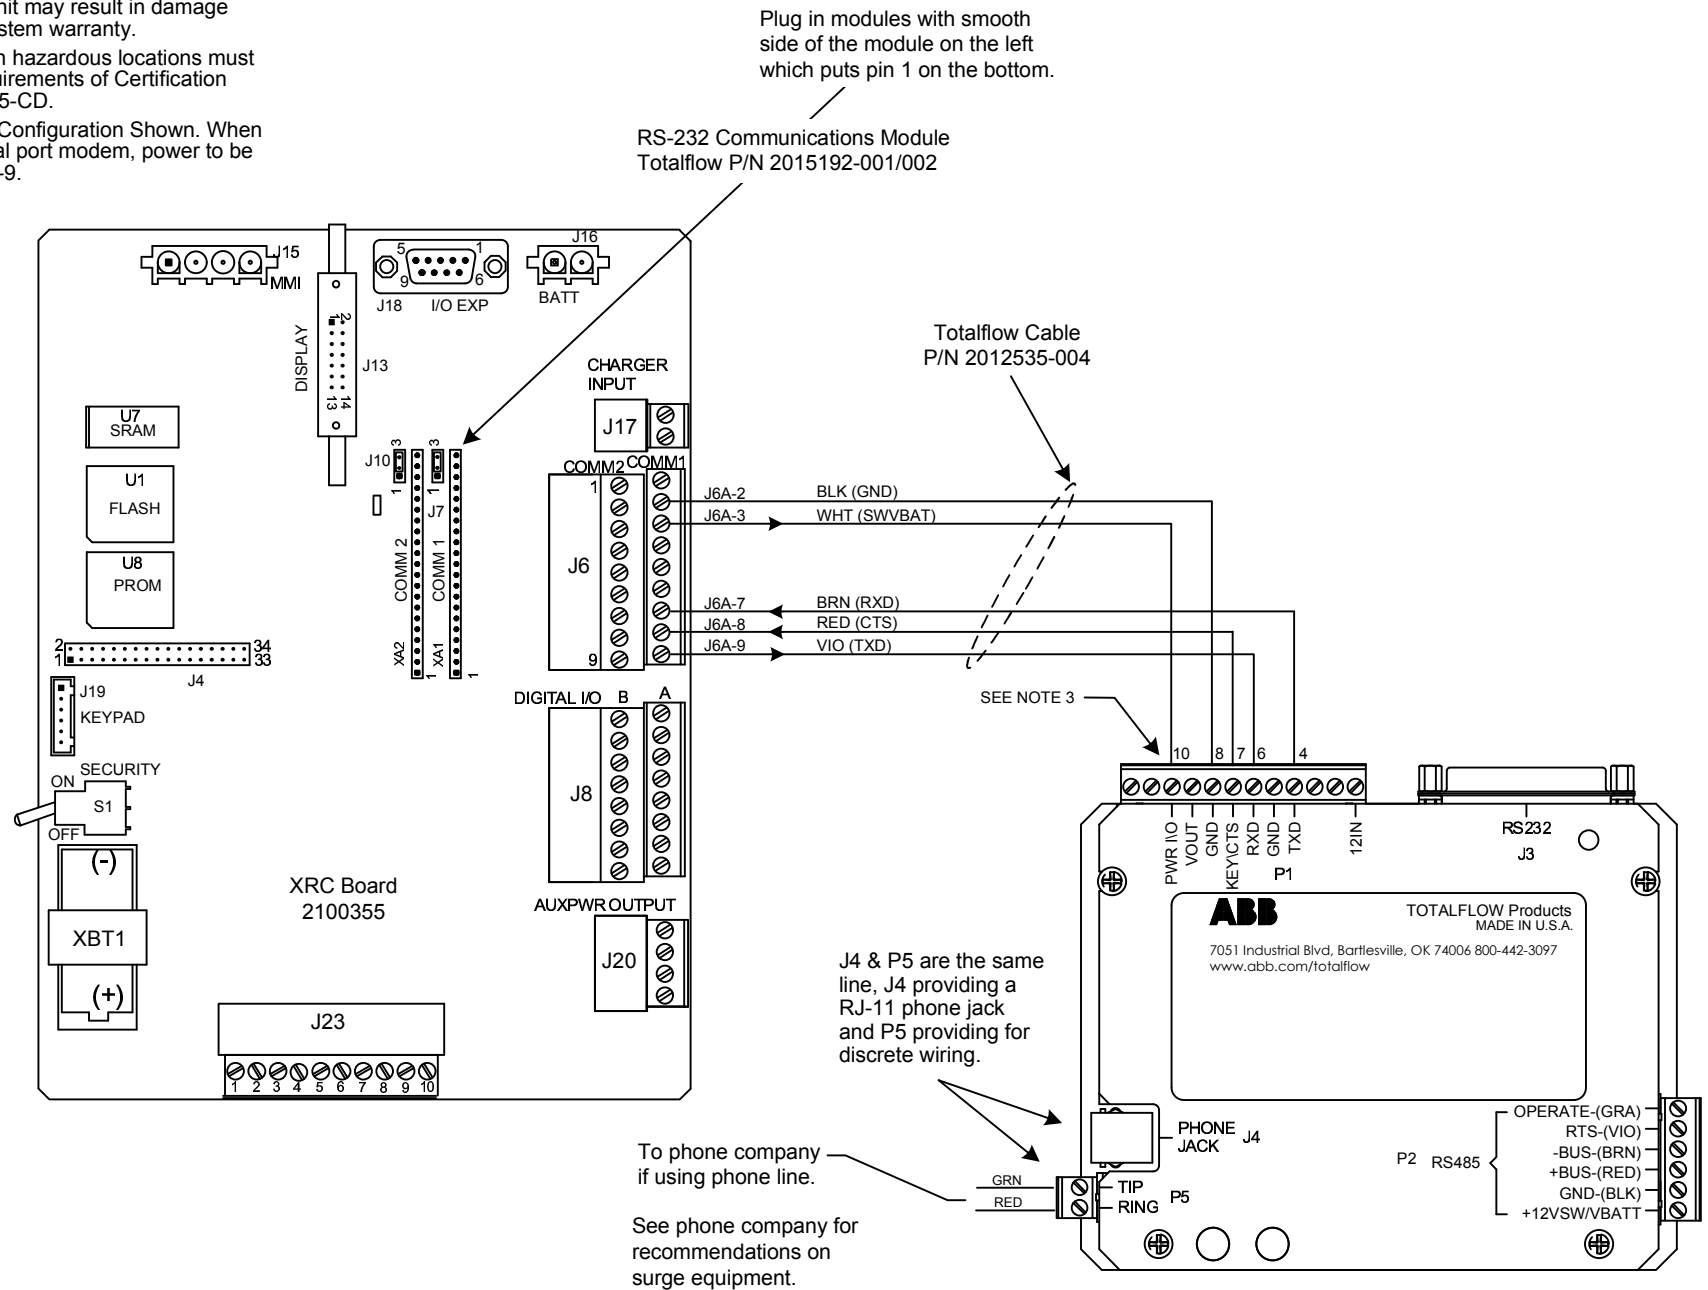

REF: 2100656-WI

ABB	TOTALFLOW Products	ACTION	DOC TYPE	TITLE	DWG NO.	REV	SHEET
		D19339	UD	XRC 6490/6790/6890 COMM 1 (2100355 BD) TO UC12 W/FCU SWITCHED POWER (RS-232)	2102206	AB	1 OF 1