



中国国家强制性产品认证证书

证书编号: 2010010304402983

委托人名称、地址

ABB France
3 Rue Jean Perrin CS 90009 69687, Chassieu Cedex, FRANCE

生产者(制造商)名称、地址

ABB新会低压开关有限公司
广东省江门市新会区今古洲工业开发区

生产企业名称、地址

ABB新会低压开关有限公司
广东省江门市新会区今古洲工业开发区

产品名称和系列、规格、型号

接触器

AF50, AF63, AF75; 详见参数附件

产品标准和技术要求

GB 14048.4-2010

上述产品符合强制性产品认证实施规则
CNCA-C03-02: 2014的要求, 特发此证。

发证日期: 2014年12月31日

有效期至: 2019年12月31日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

本证书为变更证书, 证书首次颁发日期: 2010年05月04日

本证书的相关信息可通过国家认监委网站www.cnca.gov.cn查询



主任:

中国质量认证中心

中国·北京·南四环西路188号9区100070

<http://www.cqc.com.cn>



Q 1068064



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

No. : 2010010304402983

NAME AND ADDRESS OF THE APPLICANT

ABB France
3 Rue Jean Perrin CS 90009 69687, Chassieu Cedex, FRANCE

NAME AND ADDRESS OF THE MANUFACTURER

ABB新会低压开关有限公司
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City,
Guangdong Province, P. R. China

NAME AND ADDRESS OF THE FACTORY

ABB新会低压开关有限公司
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City,
Guangdong Province, P. R. China

NAME, MODEL AND SPECIFICATION

Contactor

AF50, AF63, AF75; See the Appendix

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB 14048.4-2010

This is to certify that the above mentioned products have met the requirements of implementation rules for compulsory certification (REF NO. CNCA-C03-02:2014).

Date of issue: Dec. 31, 2014 Date of expiry: Dec. 31, 2019

Validity of this certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

Date of original certification: May. 04, 2010

This certificate can be verified through CNCA's website: www.cnca.gov.cn



President:

Wang Kejiao



CHINA QUALITY CERTIFICATION CENTRE

Section 9, No. 188, Nanshuan Xilu, Beijing 100070 P. R. China

<http://www.cqc.com.cn>

Q 1068064



中国国家强制性产品认证证书

附录:

第 1 页 共 2 页

证书编号: 2010010304402983

纸号: 1068064

AF50, AF63, AF75

AF50:

Ith: 100A;

Ue/Ie:

AC-3: AC220-230-240V/53A, 380-400V/50A,
415V/50A, 440V/45A, 500V/45A, 690V/35A;

AC-8a: 400V/63A; AC-1: 690V/100A;

AF63:

Ith: 125A;

Ue/Ie: AC-3: AC220-230-240V/65A, 380-400V/65A,
415V/65A, 440V/65A, 500V/55A, 690V/43A;

AC-8a: 400V/85A; AC-1: 690V/115A;

AF75:

Ith: 125A;

Ue/Ie: AC-3: AC220-230-240V/75A, 380-400V/75A,
415V/75A, 440V/70A, 500V/65A, 690V/46A;

AC-8a: 400V/95A; AC-1: 690V/125A;

Us: 48-130V 50/60Hz/DC, 100-250V 50/60Hz/DC, 20-60V DC;

3P;

配用的辅助触头(外置):CAL5

AC-15:Ue/Ie:24-127V/6A,220-240V/4A,380-440V/3A,500-690V/2A;

DC-13:Ue/Ie:24V/6A,48V/2.8A,72V/1A,110V/0.55A,125V/0.55A, 220V/0.3A,
250V/0.3A

注: 此附录与证书同时使用时有效。



主任:

中国质量认证中心

中国·北京·南四环西路188号9区100070

<http://www.cqc.com.cn>





中国国家强制性产品认证证书

附录:


第 2 页 共 2 页

证书编号: 2010010304402983

纸号: 1068064

型号的解释:

AF 50 3 0-1 1

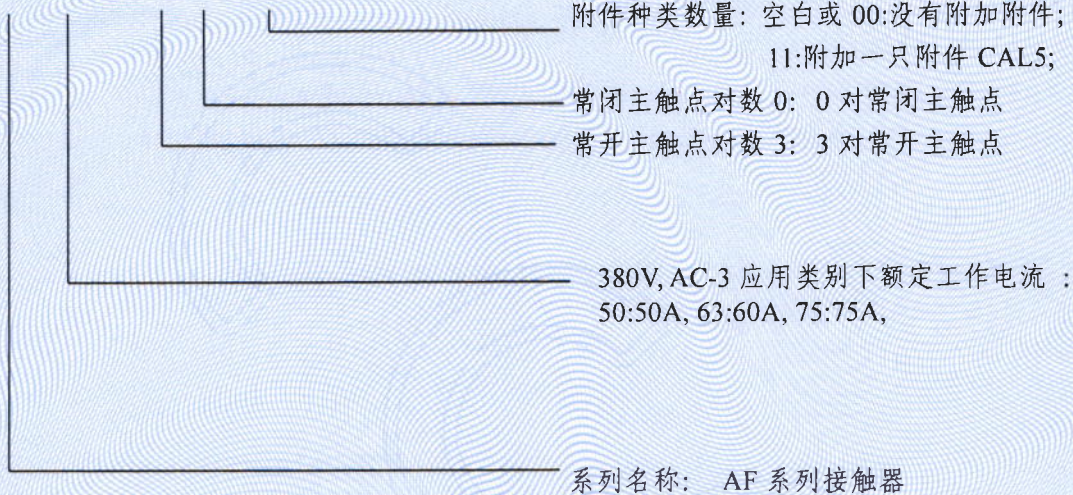

CAL5 附件为辅助触头, 该型号辅助触头已获 CCC 认证, 证书编号为: 2004010305133985

注: 此附录与证书同时使用时有效。



主任:

中国质量认证中心

中国 · 北京 · 南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

