



中国国家强制性产品认证证书

证书编号: 2004010309130463

委托人名称、地址

ABB France

3 Rue Jean Perrin CS 90009 69687, Chassieu Cedex, FRANCE

生产者(制造商)名称、地址

ABB新会低压开关有限公司

广东省江门市新会区今古洲工业开发区

生产企业名称、地址

ABB新会低压开关有限公司

广东省江门市新会区今古洲工业开发区

产品名称和系列、规格、型号

接触器

A9, A12, A16, A9D, A12D, A16D, A18D, A26D; 详见参数附件

产品标准和技术要求

GB 14048.4-2010

上述产品符合强制性产品认证实施规则
CNCA-C03-02: 2014的要求, 特发此证。

发证日期: 2015年11月23日

有效期至: 2020年11月23日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

本证书为变更证书, 证书首次颁发日期: 2004年09月17日

本证书的相关信息可通过国家认监委网站www.cnca.gov.cn查询



主任:

中国质量认证中心

中国·北京·南四环西路188号9区100070

<http://www.cqc.com.cn>



Q 1273068



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

No. : 2004010309130463

NAME AND ADDRESS OF THE APPLICANT

ABB France
3 Rue Jean Perrin CS 90009 69687, Chassieu Cedex, FRANCE

NAME AND ADDRESS OF THE MANUFACTURER

ABB Xinhui Low Voltage Switchgear Co., Ltd
Jinguzhou Industrial Development Zone, Xinhui Region, Jiangmen City,
Guangdong Province

NAME AND ADDRESS OF THE FACTORY

ABB Xinhui Low Voltage Switchgear Co., Ltd
Jinguzhou Industrial Development Zone, Xinhui Region, Jiangmen City,
Guangdong Province

NAME, MODEL AND SPECIFICATION

Contactor

A9, A12, A16, A9D, A12D, A16D, A18D, A26D; See the Appendix

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB 14048.4-2010

This is to certify that the above mentioned products have met the
requirements of implementation rules for compulsory certification (REF
NO. CNCA-C03-02:2014).

Date of issue: Nov. 23, 2015 Date of expiry: Nov. 23, 2020

Validity of this certificate is subject to positive result of the regular
follow up inspection by issuing certification body until the expiry date.

Date of original certification: Sep. 17, 2004

This certificate can be verified through CNCA's website: www.cnca.gov.cn



President:

Wang Kejiao

CHINA QUALITY CERTIFICATION CENTRE

Section 9, No. 188, Nansihuan Xilu, Beijing 100070 P.R. China

<http://www.cqc.com.cn>



Q 1273068



中国国家强制性产品认证证书

附录:

第 1 页 共 4 页

证书编号: 2004010309130463

纸号: 1273068

A9,A12,A16,A9D,A12D,A16D,A18D,A26D

A9:

Ith:26A;

Ue/Ie:220/230/240/380/400/415/440/500V/9A,690V/7A(AC-3);

Ue/Ie:400V/12A(AC-8a);

Ue/Ie:690V25A(AC-1);

3P,4P

A12:

Ith:28A;

Ue/Ie:220/230/240/380/400/415/440/500V/12A,690V/9A(AC-3);

Ue/Ie:400V/16A(AC-8a);

Ue/Ie:690V/27A(AC-1);

3P,4P

A16:

Ith:30A

Ue/Ie:220/230/240/380/400/415V/17A,440V/16A,500V/14A,690V/10A(AC-3);

Ue/Ie:400V/22A(AC-8a);

Ue/Ie:690V/30A(AC-1);

3P,4P

A9D:

Ith:24A;

Ue/Ie:220/230/240/380/400/440V/9A(AC-3);

Ue/Ie:400V/9A(AC-8a);

注: 此附录与证书同时使用时有效。



主 任:

中国质量认证中心

中国 · 北京 · 南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>





中国国家强制性产品认证证书

附录:

第 2 页 共 4 页

证书编号: 2004010309130463

纸号: 1273068

Ue/Ie:690V/22A(AC-1);
3P
A12D:
Ith:26A;
Ue/Ie:220/230/240/380/400/440V/12A(AC-3);
Ue/Ie:400V/12A(AC-8a);
Ue/Ie:690V/25A(AC-3);
3P
A16D:
Ith:28A;
Ue/Ie:220/230/240/380/400/440V/16A(AC-3);
Ue/Ie:400V/16A(AC-8a);
Ue/Ie:690V/27A(AC-1);
3P
A18D:
Ith:28A;
Ue/Ie:220/230/240/380/400/415V/18A(AC-3);
Ue/Ie:400V/16A(AC-8a);
Ue/Ie:690V/27A(AC-1);
3P
A26D:
Ith:30A
Ue/Ie:220/230/240/380/400/440V/22A(AC-3);

注: 此附录与证书同时使用时有效。



主 任:

中国质量认证中心

中国 · 北京 · 南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>





中国国家强制性产品认证证书

附录:

第 3 页 共 4 页

证书编号: 2004010309130463

纸号: 1273068

Ue/Ie:400V/22A(AC-8a);

Ue/Ie:690V/30A(AC-1);

3P

Us:24V 50Hz/60Hz,42V 50Hz/60Hz,48V 50Hz/60Hz,

110V 50 Hz/110-120V 60 Hz,190V 50 Hz/220V 60 Hz,

220-230V 50 Hz/230-240V 60 Hz,230-240V 50 Hz/240-260V 60 Hz,

380-400V 50 Hz/400-415V 60 Hz, 400-415V 50 Hz/415-440V 60Hz;

配用的辅助触头 (本体):

AC-15:Ue/Ie:24-127V/6A,220-240V/4A,380-440V/3A,500V/2A,690V/2A;

DC-13:Ue/Ie:24V/6A,48V/2.8A,72V/2A,125V/1.1A,250V/0.55A

注: 此附录与证书同时使用时有效。



主 任:

中国质量认证中心

中国 · 北京 · 南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>





中国国家强制性产品认证证书

附录:


第 4 页 共 4 页

证书编号: 2004010309130463

纸号: 1273068

型号的解释:

A 18 D 3 0-1 0

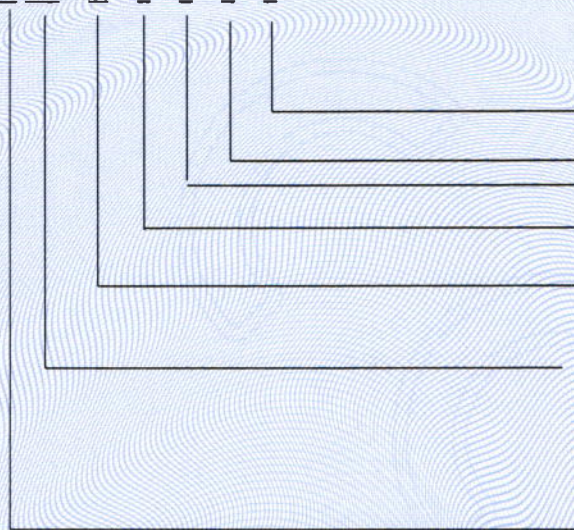

常闭辅助触点对数 0: 0 对常闭辅助触点
常开辅助触点对数 1: 1 对常开辅助触点
常闭主触点对数 0: 0 对常闭主触点
常开主触点对数 3 或 4: 3 或 4 对常开主触点
类别标识 D: 为 OEM 客户标识
无“D”普通客户标识
380V 工作电压, AC-3 下额定工作电流(A) 9:9A,
12:12A; 16:17A 或 16A(A16D); 18:18A;
26:22A
系列名称: A 系列接触器

注: 此附录与证书同时使用时有效。



主任:

中国质量认证中心

中国 · 北京 · 南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

