

IEC**IECEE**

®

TM

Ref. Certif. No.

CN58730

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT
(IECEE) CB SCHEME**CB TEST CERTIFICATE**

Product

Fuse switch-disconnector

Name and address of the applicant

ABB Xiamen Low Voltage Equipment Co., Ltd.
1st Floor, No. 881, FangShanXiEr Road, Xiang'An Industrial
Area, Torch Hi-Tech Industrial Development Zone, Xiamen,
Fujian, P.R. China

Name and address of the manufacturer

ABB Xiamen Low Voltage Equipment Co., Ltd.
1st Floor, No. 881, FangShanXiEr Road, Xiang'An Industrial
Area, Torch Hi-Tech Industrial Development Zone, Xiamen,
Fujian, P.R. China

Name and address of the factory

ABB Xiamen Low Voltage Equipment Co., Ltd.
No. 881, FangShanXiEr Road, Xiang'An Industrial Area, Torch
Hi-Tech Industrial Development Zone, Xiamen, Fujian,
P.R.China*Note: When more than one factory, please report on page 2*

Ratings and principal characteristics

See the Appendix

Trademark / Brand (if any)

ABB

Customer's Testing Facility (CTF) Stage used

N/A

Model / Type Ref.

XLP00, XLP00-A60/60, XLP00-1P, XLP00-2P, XLP00-4P;

Additional information (if necessary may also be reported on page 2)

A sample of the product was tested and found to be in conformity with

IEC 60947-1:2020;IEC 60947-3:2020

As shown in the Test Report Ref. No. which forms part of this Certificate

00901-CB2022CQC-103829

This CB Test Certificate is issued by the National Certification Body

CHINA QUALITY CERTIFICATION CENTRE

Section 9, No. 188 Nansihuan Xilu, Beijing 100070 P. R. China

Tel: +86-10-83886666 Fax: +86-10-83886282

website: <http://www.cqc.com.cn>

Date:

Dec.20,2022

Signature:

谢肇煦

Xie ZhaoXu

**CB 0070420**

XLP00, XLP00-A60/60, XLP00-1P, XLP00-2P, XLP00-4P

U_{imp} :8kV;

U_i :1000V;

I_{th} : XLP00, XLP00-A60/60, XLP00-1P, XLP00-2P, XLP00-4P:160A,

XLP00, XLP00-A60/60: 63A(AC800V), 125A(AC1000V);

U_e :AC400V, AC500V, AC690V, AC800V, AC1000V, DC220V (1P appearance, 2P appearance);

I_e :XLP00,XLP00-A60/60: AC-23B:400V/125A; AC-22B:500V/160A, 800V/63A;

AC-21B:690V/125A, AC-22B:1000V/125A;

XLP00-1P: DC-22B:220V/160A; AC-22B: 500V/160A; AC-21B: 690V/125A;

XLP00-2P: DC-22B:220V/160A; AC-22B: 500V/160A; AC-21B: 690V/125A;

XLP00-4P: AC-22B:500V/160A;

I_q :

AC500V/100kA (XLP00,XLP00-A60/60);

AC690V/80kA (XLP00,XLP00-A60/60);

AC800V/50kA (XLP00,XLP00-A60/60);


AC1000V/120kA (XLP00,XLP00-A60/60);50kA(XLP00-1P/2P/4P);

1P(XLP00-1P), 2P(XLP00-2P), 3P(XLP00, XLP00-A60/60), 4P(XLP00-4P);


50/60Hz;

IP30(front);

Diagram for DC product:

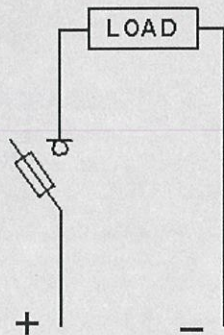

XLP00-1P:160A (220V,DC-22B)

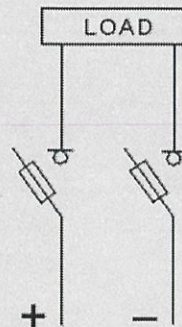

XLP00-2P: 160A(220V,DC-22B)

Additional information (if necessary)

Date:

Dec.20,2022

Signature:



Xie ZhaoXu