

NOTES:

1. WARNING: This drawing does not illustrate the installation methods required for hazardous locations. Prior to any installation in a Classified Hazardous Location, verify installation methods by the Control Drawing referenced on the product's name tag and national and local codes.
2. This is for a 24V power supply system.







ABB TTH300 Temperature Transmitter

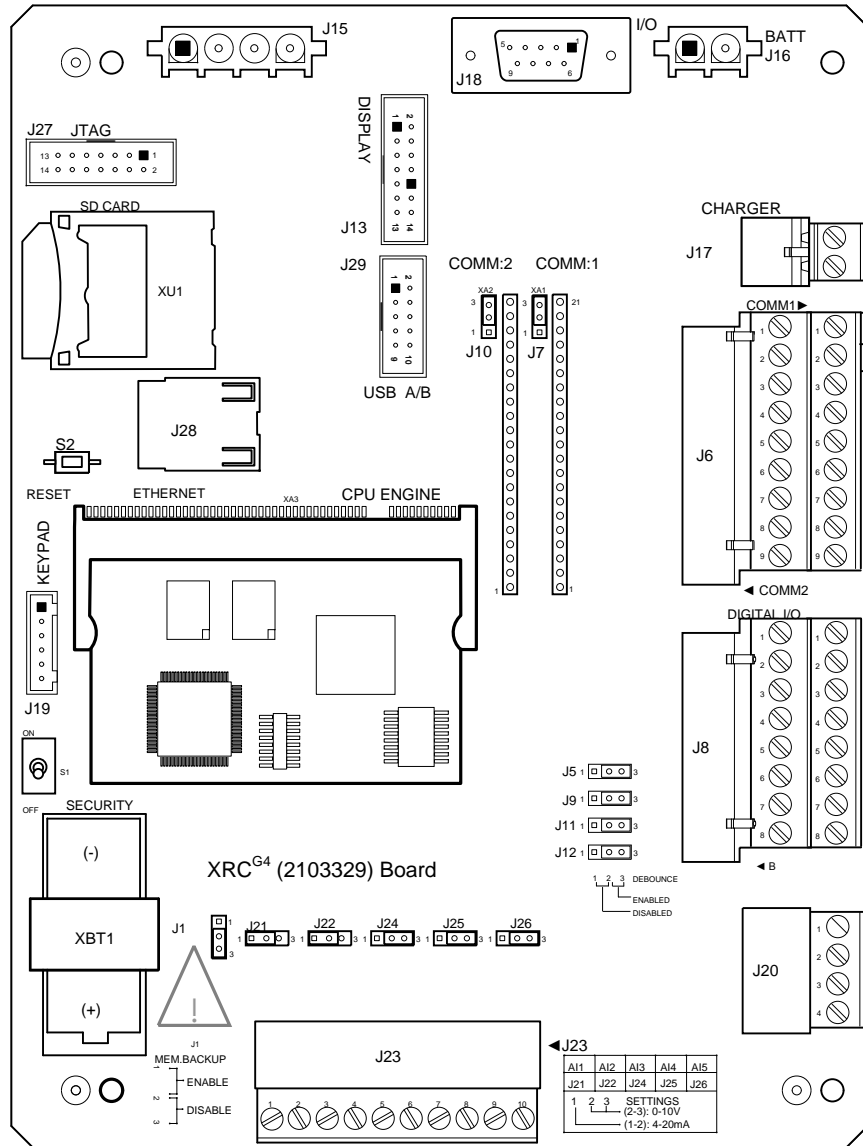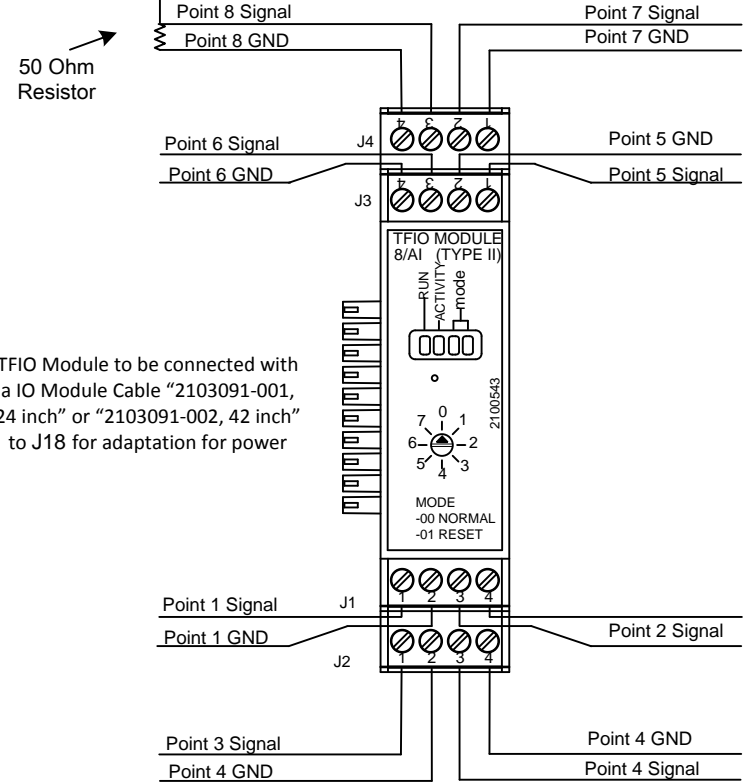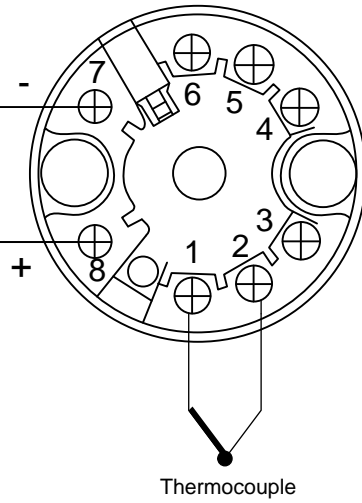

TFIO Module to be connected with a IO Module Cable "2103091-001, 24 inch" or "2103091-002, 42 inch" to J18 for adaptation for power

REF: NA