

SACE Emax 2

Kit ricambio MID - E1.2


Kit spare part MID - E1.2

Ersatzteilsatz MID - E1.2


Kit de rechange MID - E1.2

Kit de recambio MID - E1.2


E1.2

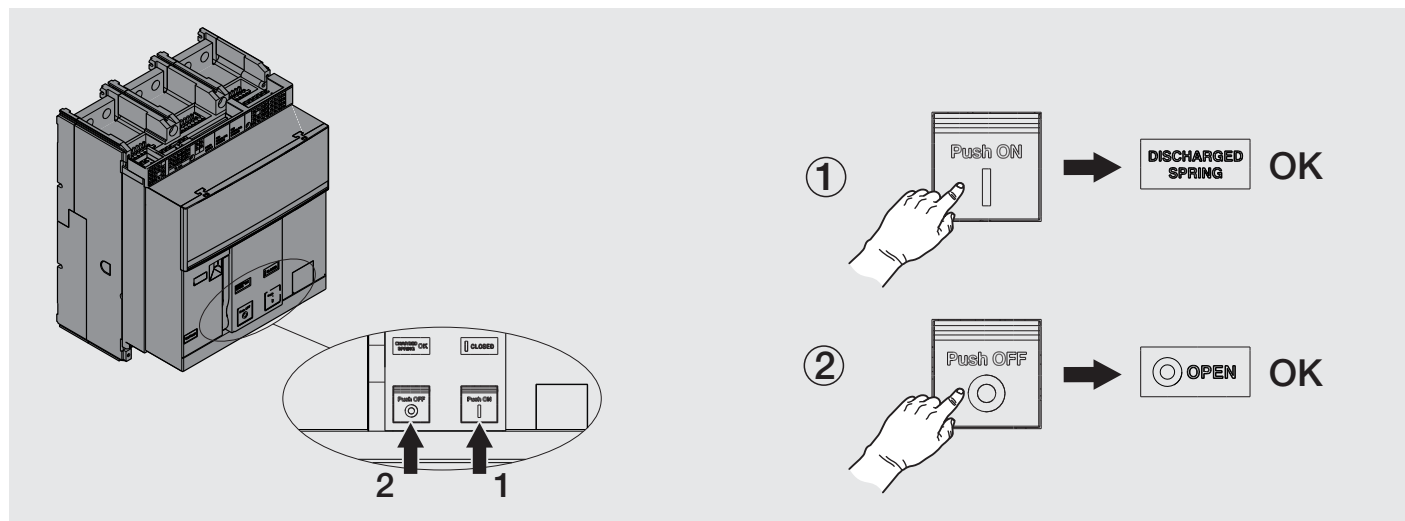


LEGGERE ATTENTAMENTE IL DOCUMENTO RH0100003 PRIMA DI PROCEDERE
READ CAREFULLY THE DOCUMENT RH0100003 BEFORE PROCEEDING

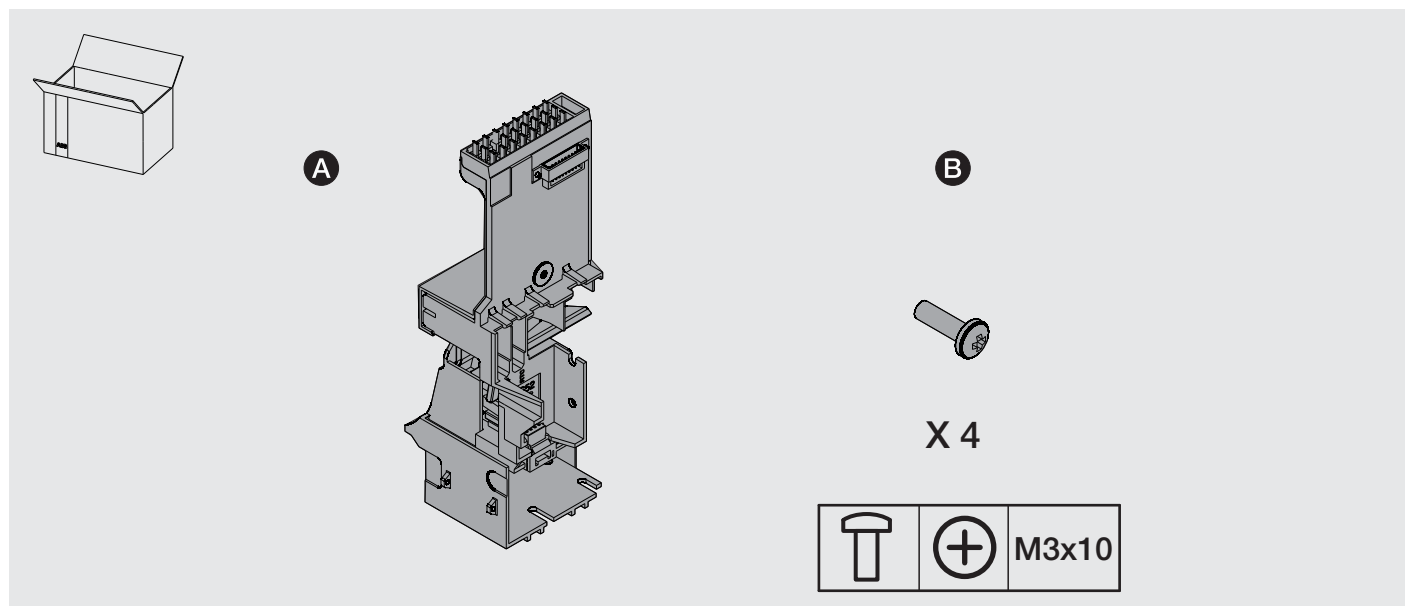

1

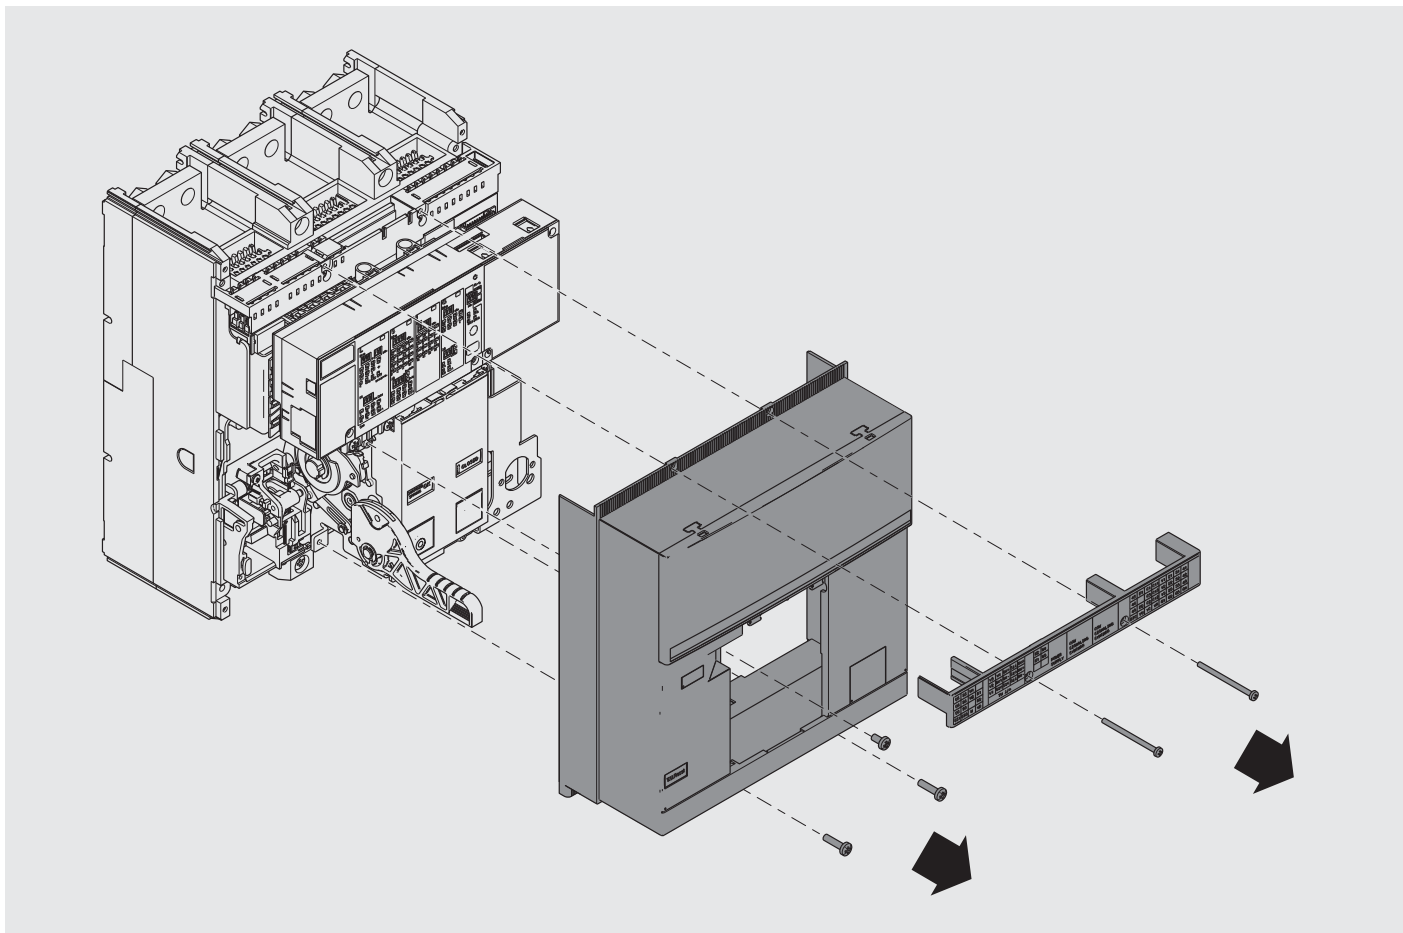

2

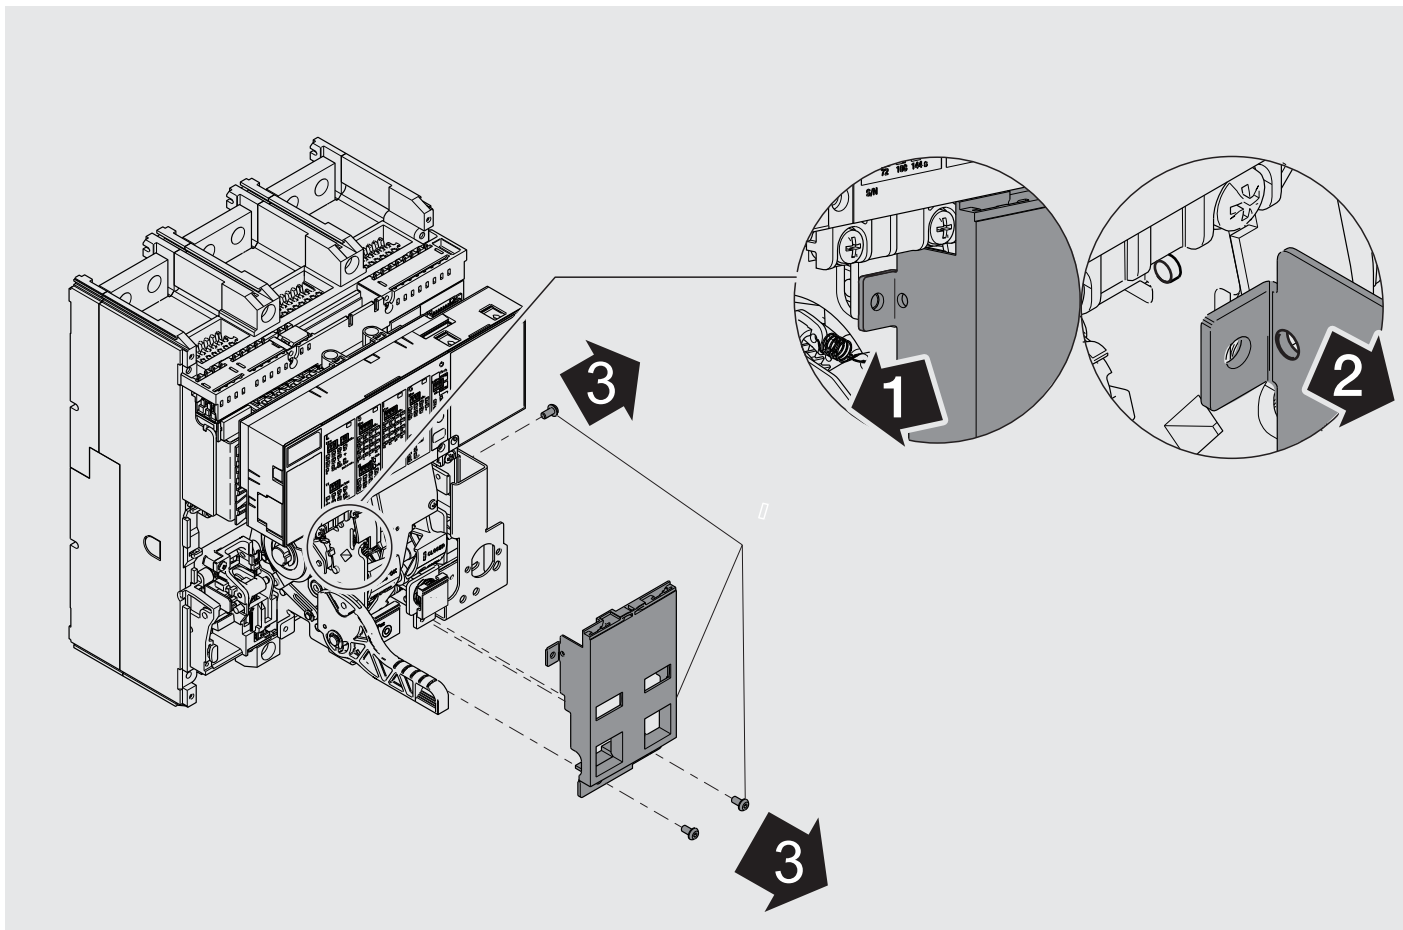


Per la sequenza di smontaggio dei contatti striscianti (versione estraibile) consultare i fogli kit 1SDH001399R0908 per E1.2.

For the sliding contacts (withdrawable version) disassembling sequence refer to the instructions sheets 1SDH001399R0908 for E1.2.


Für die Ausbausequenz des Gleitkontakte (ausfahrbare Version) siehe das Blatt des Bausatzes 1SDH001399R0908 für E1.2.

Pour la séquence de démontage de frotteurs (version débrochable) consulter la notice d'instructions 1SDH001399R0908 pour E1.2.


Para la secuencia de desmontaje de contactos deslizantes (versión extraíble) consulte las instrucciones 1SDH001399R0908 para E1.2.


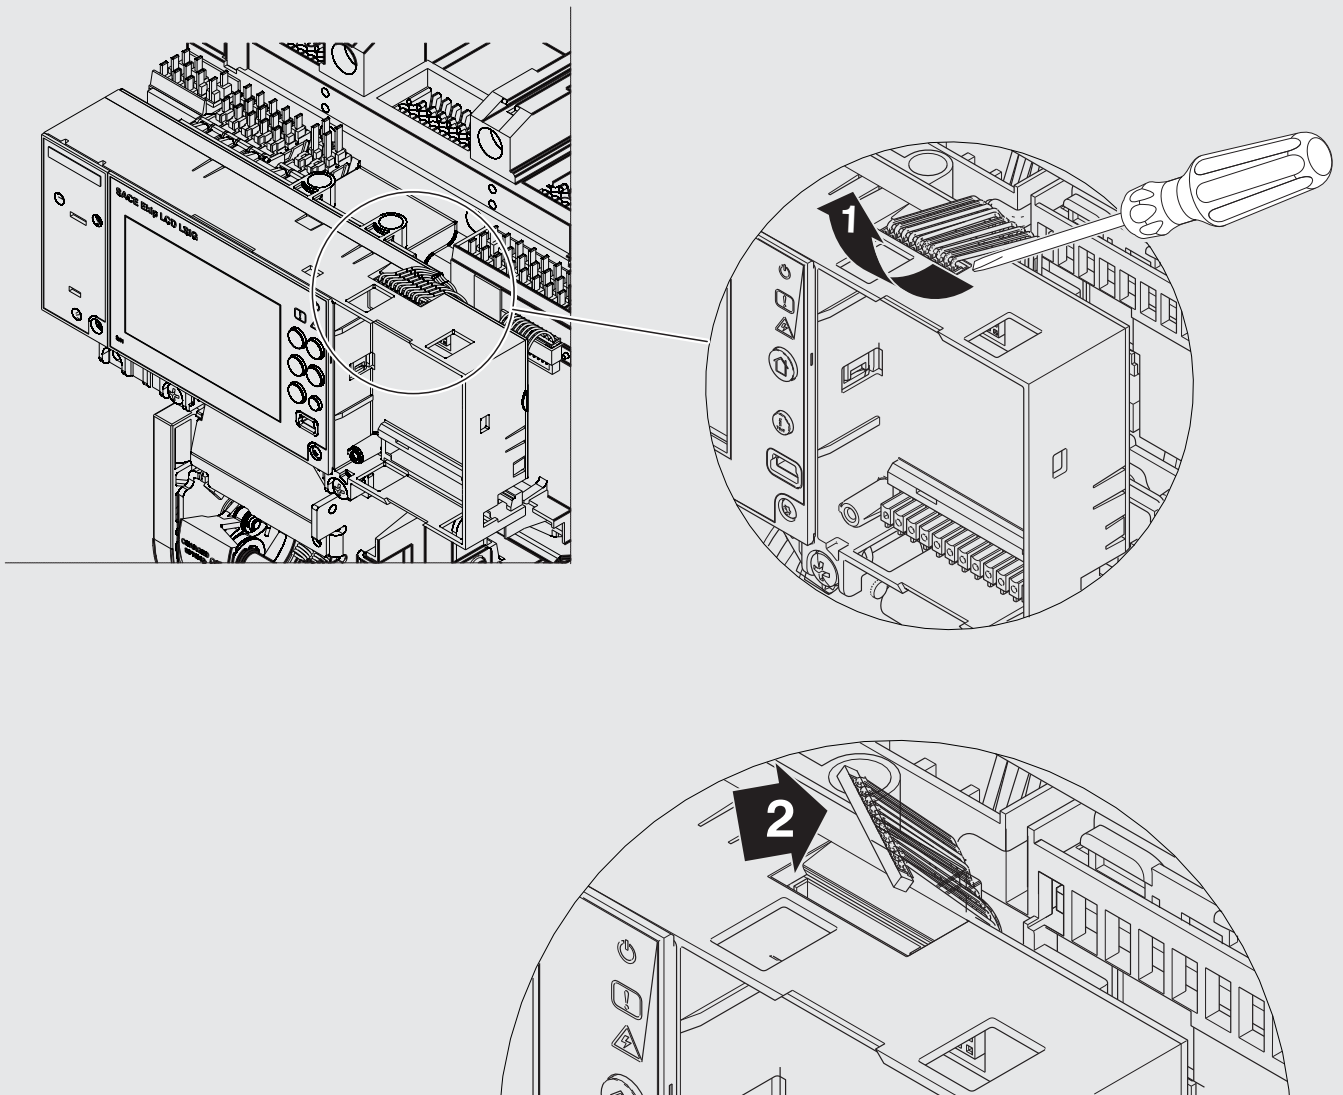


5

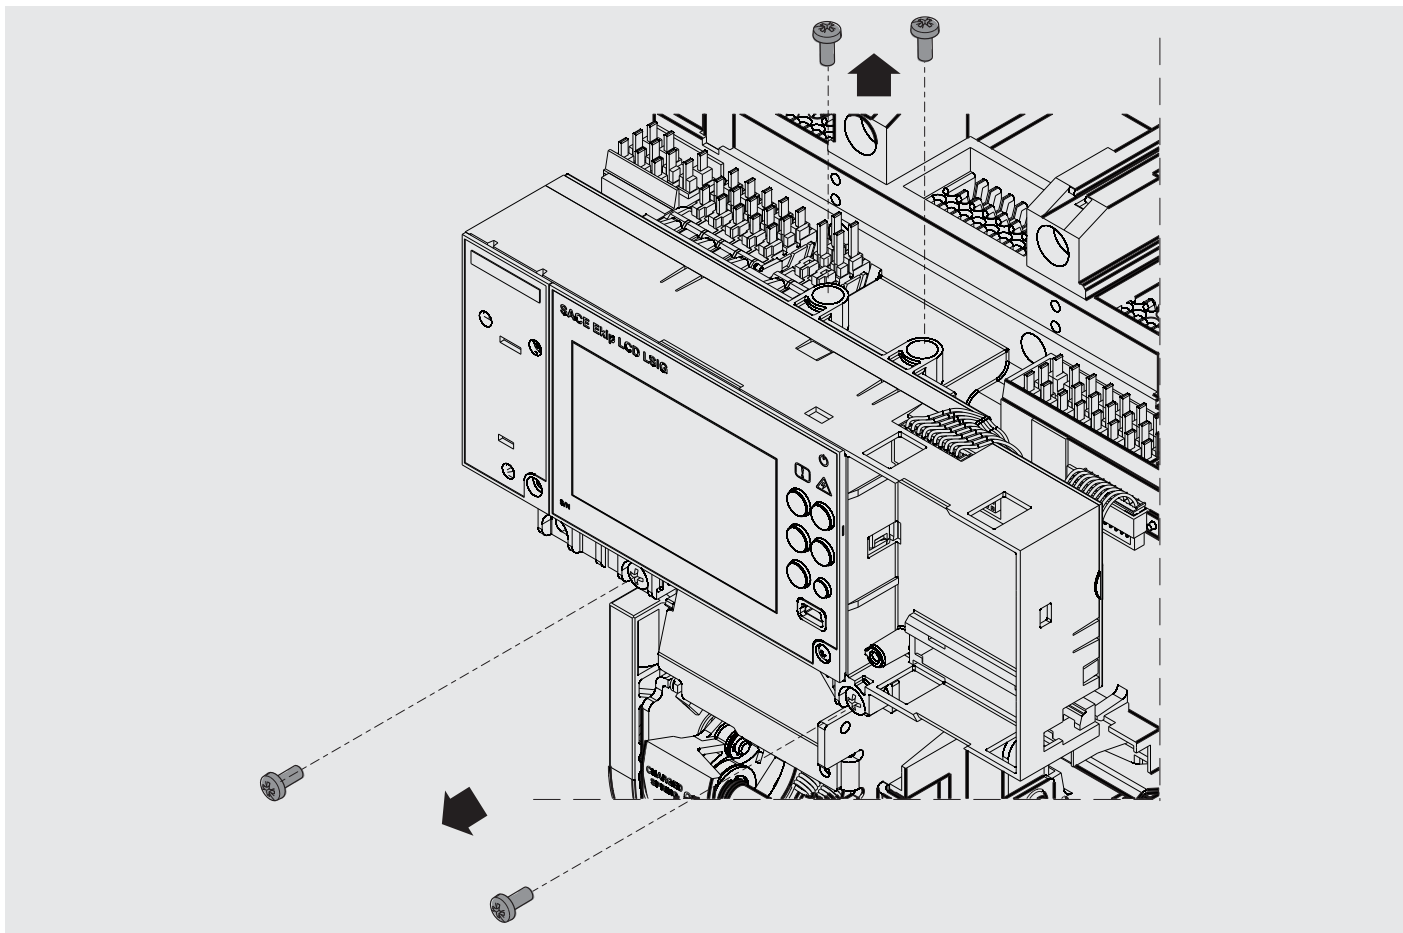


6

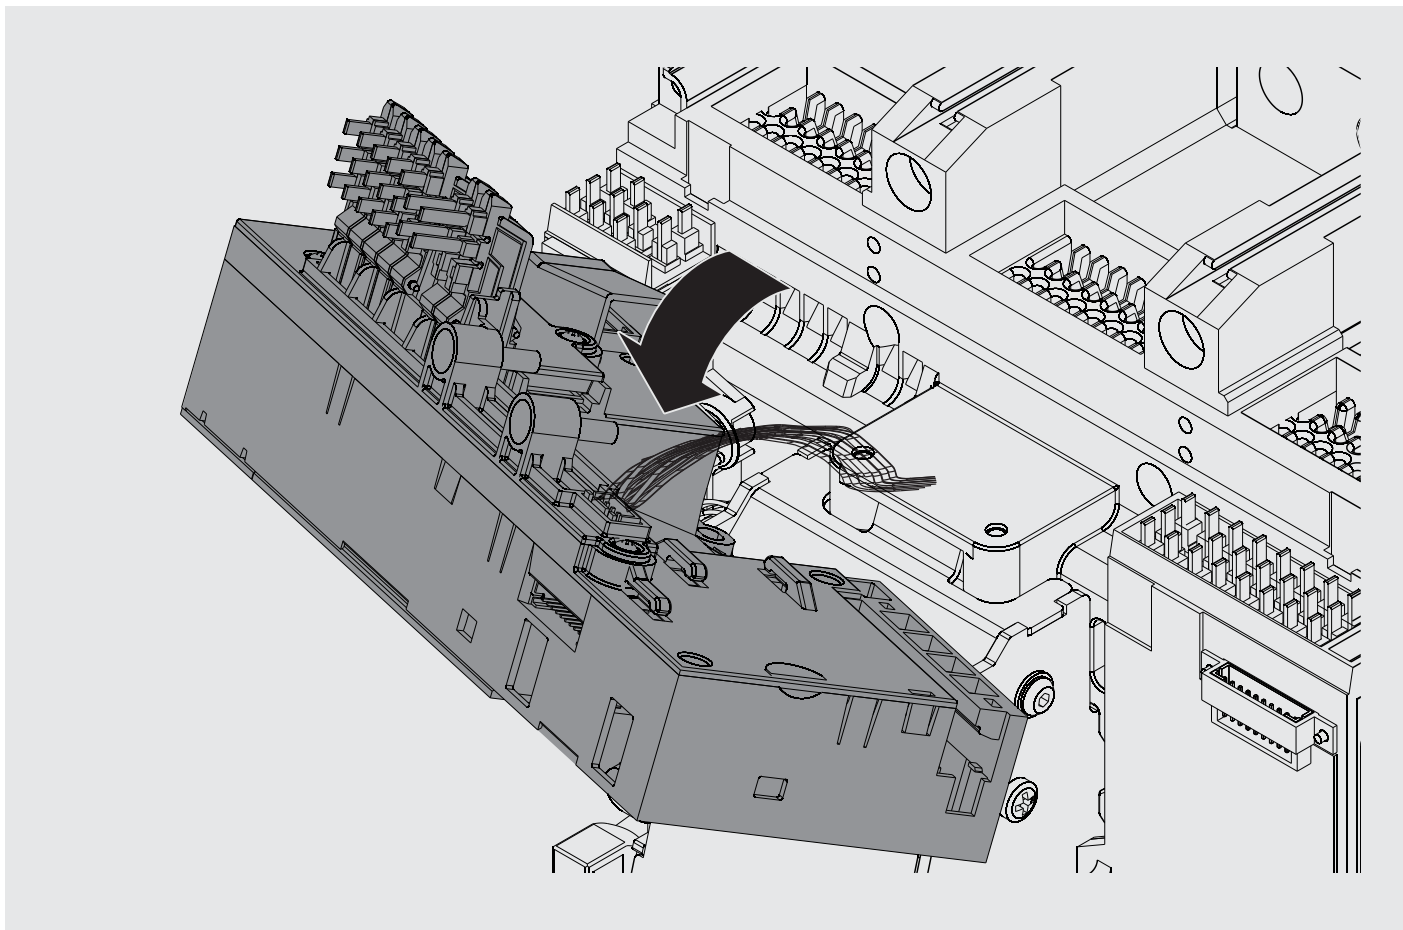


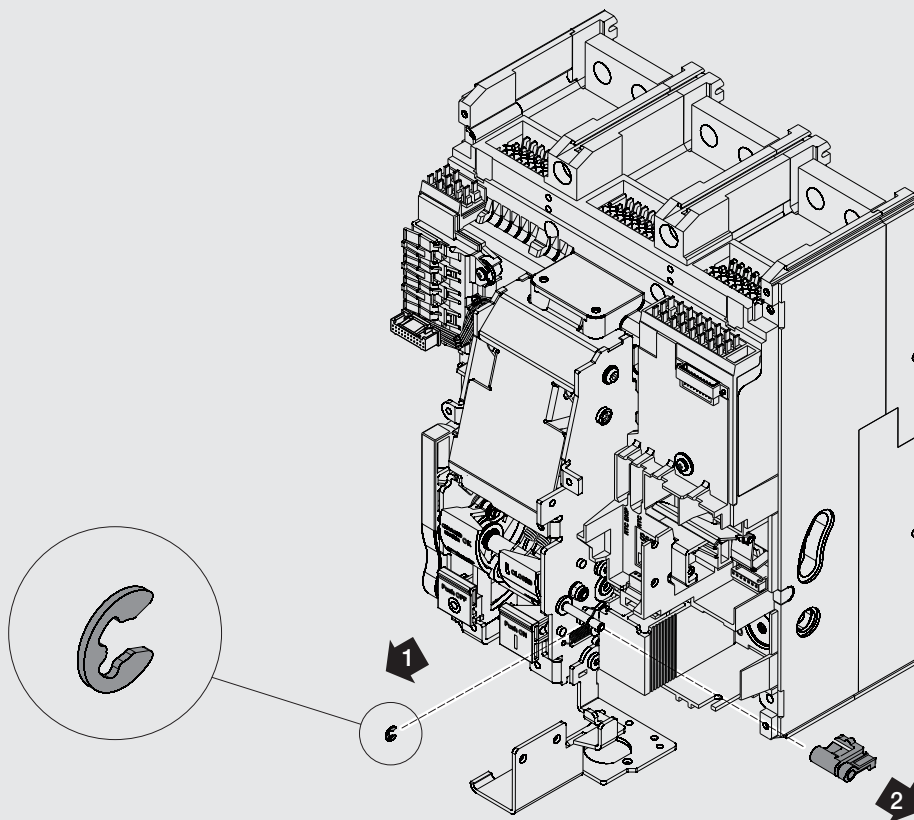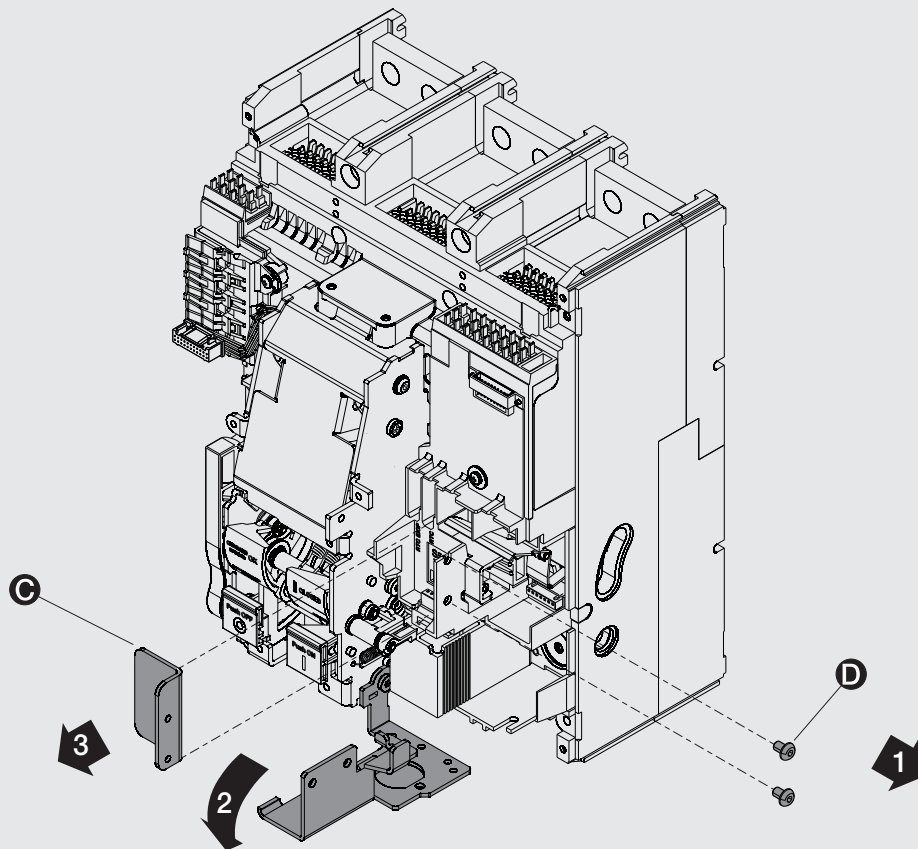


9

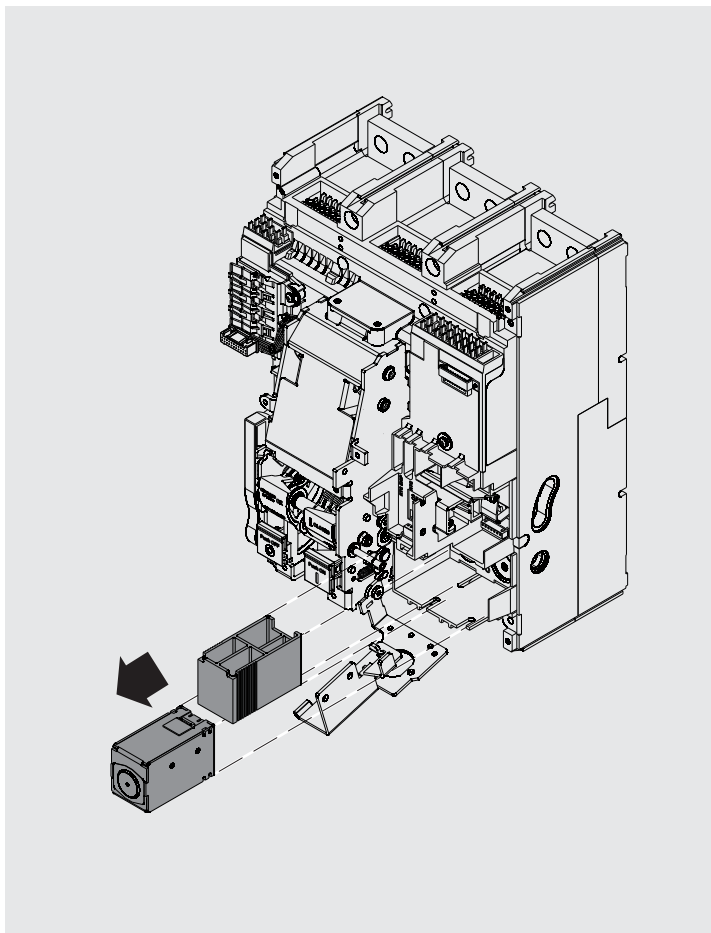

10

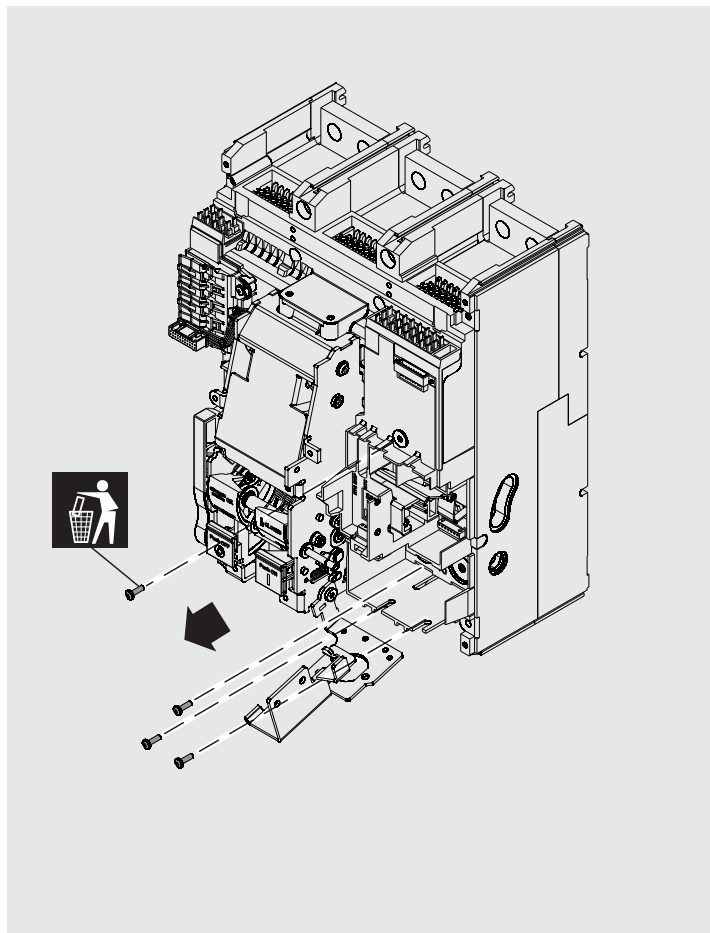

11

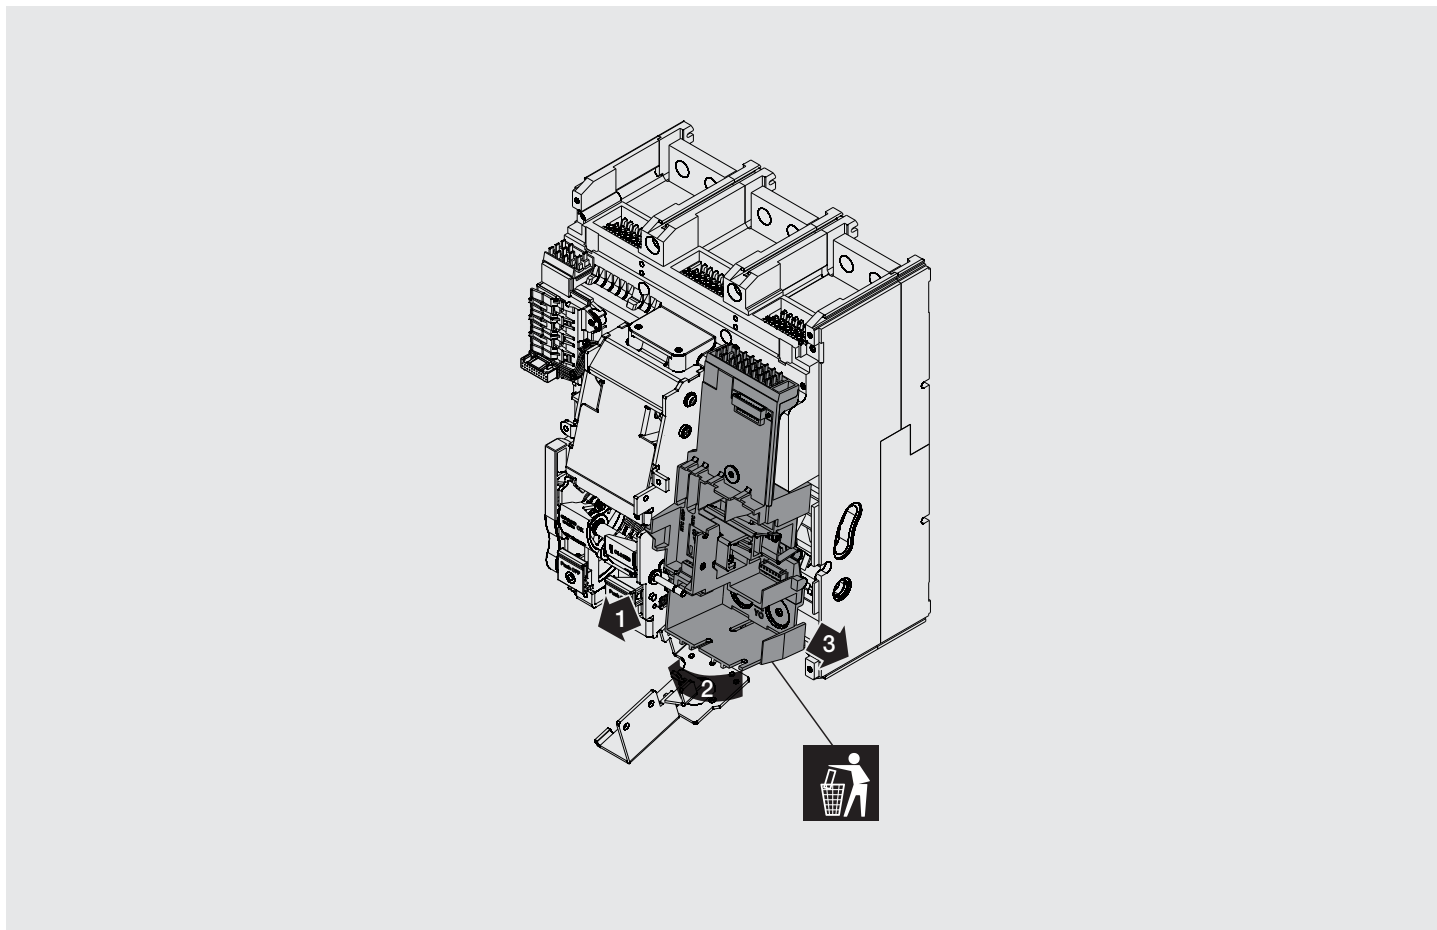


RIMONTARE IL NUOVO MID ESEGUENDO IN SENSO INVERSO TUTTE LE OPERAZIONI INDICATE NELLE FIGURE 1÷11

REASSEMBLE THE NEW MID BY PERFORMING ALL THE OPERATIONS INDICATED FIG.1÷11 IN REVERSE ORDER

DIE NEUE MID MIT DER UMGEKEHRTEN REIHENFOLGE ZU DER ANGABE IN DEN FIG.1÷11 WIEDER EINBAUEN

REMONTER NOUVEAU MID EN EFFECTUANT DANS L'ORDRE INVERSE TOUTES LES OPÉRATIONS INDIQUÉES DANS LE FIG.1÷11

VOLVER A MONTAR LOS NUEVO MID SIGUIENDO, EN SENTIDO INVERSO, TODAS LAS OPERACIONES INDICADAS EN EL FIG.1÷11

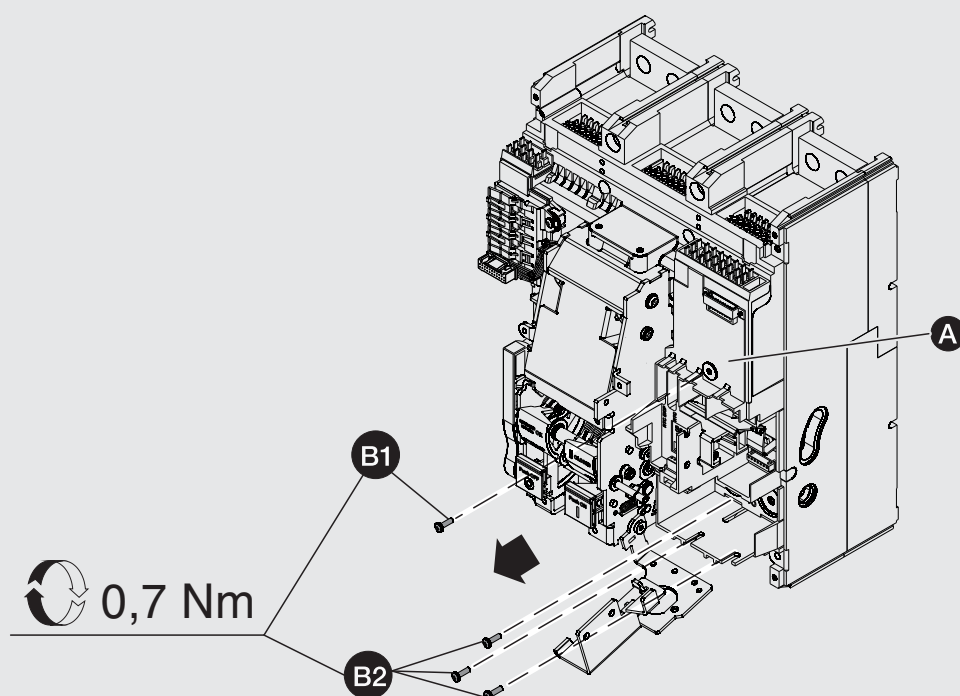

ATTENZIONE! - SEQUENZA MONTAGGIO VITI: B1 - B2

WARNING! - SCREWS ASSEMBLY SEQUENCE: B1-B2

ACHTUNG! - SCHRAUBEN MONTAGE FOLGE: B1 - B2

ATTENTION - SEQUENCE DE L'ASSEMBLAGE DES VIS: B1 - B2

ATENCIÓN - SECUENCIA DE LA ASAMBLEA DE TORNILLOS: B1 - B2

For more information please contact:

ABB S.p.A.

Via Pescaria, 5

24123 Bergamo - Italy

Phone: +39 035 395 111