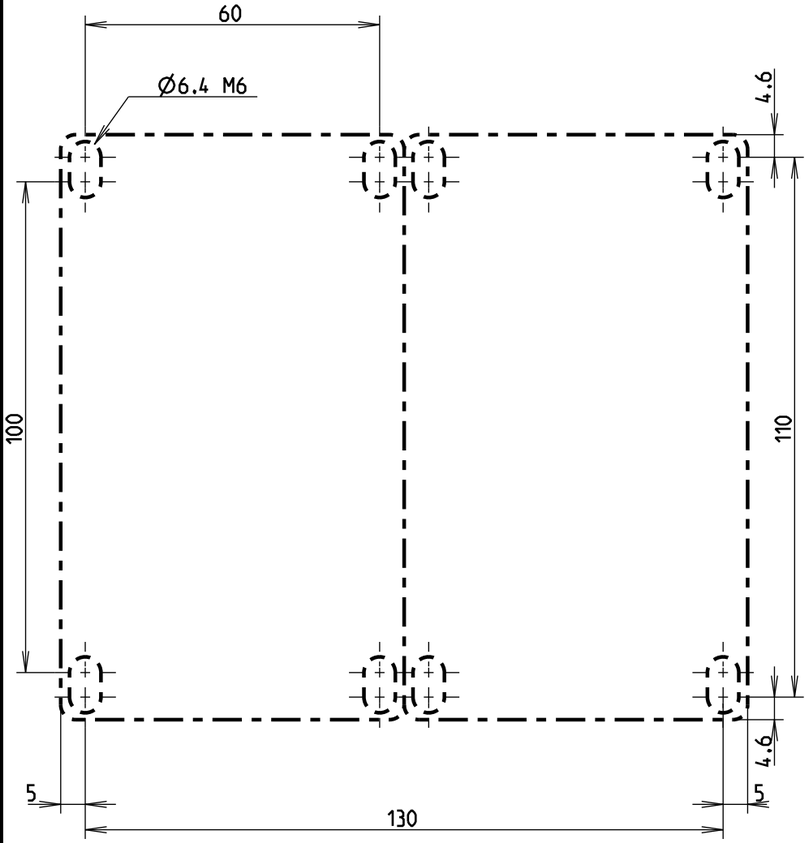

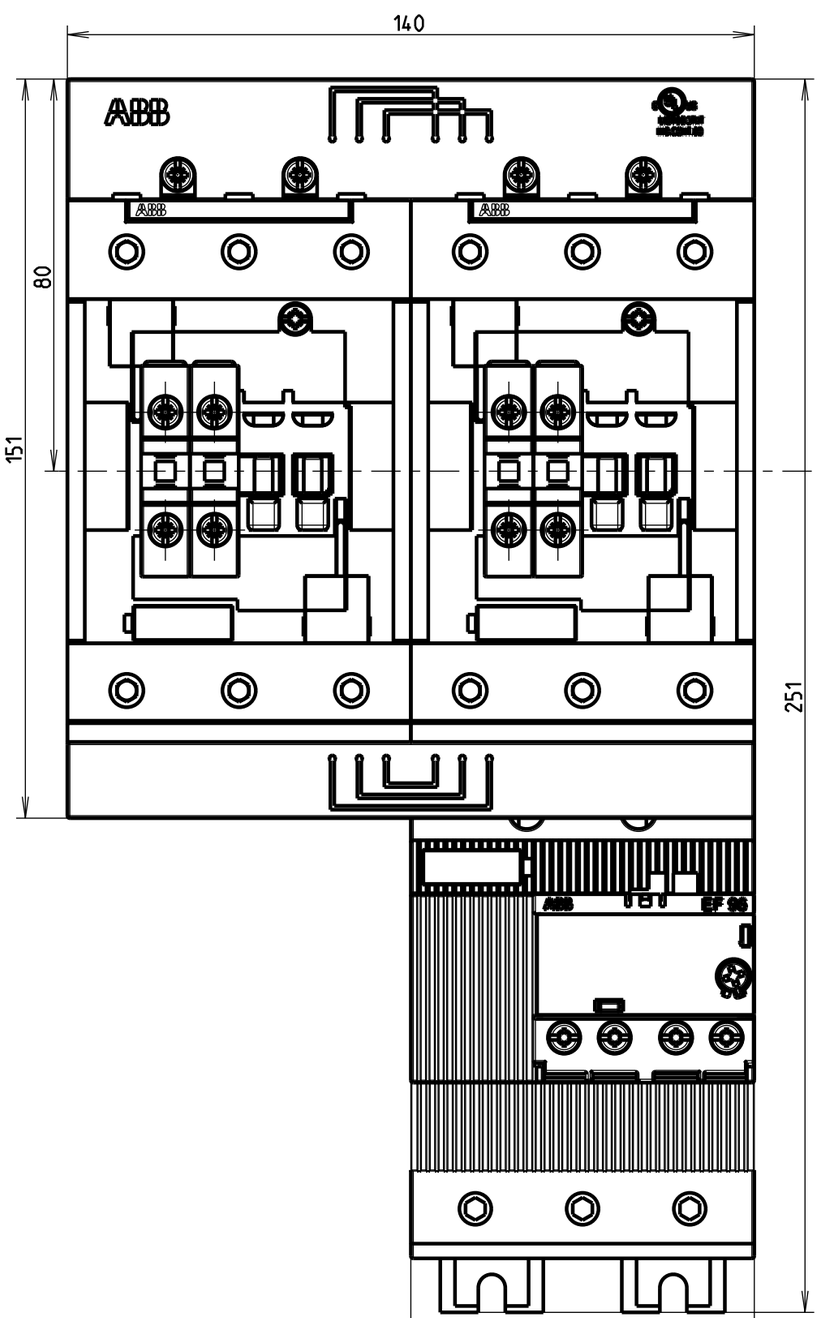

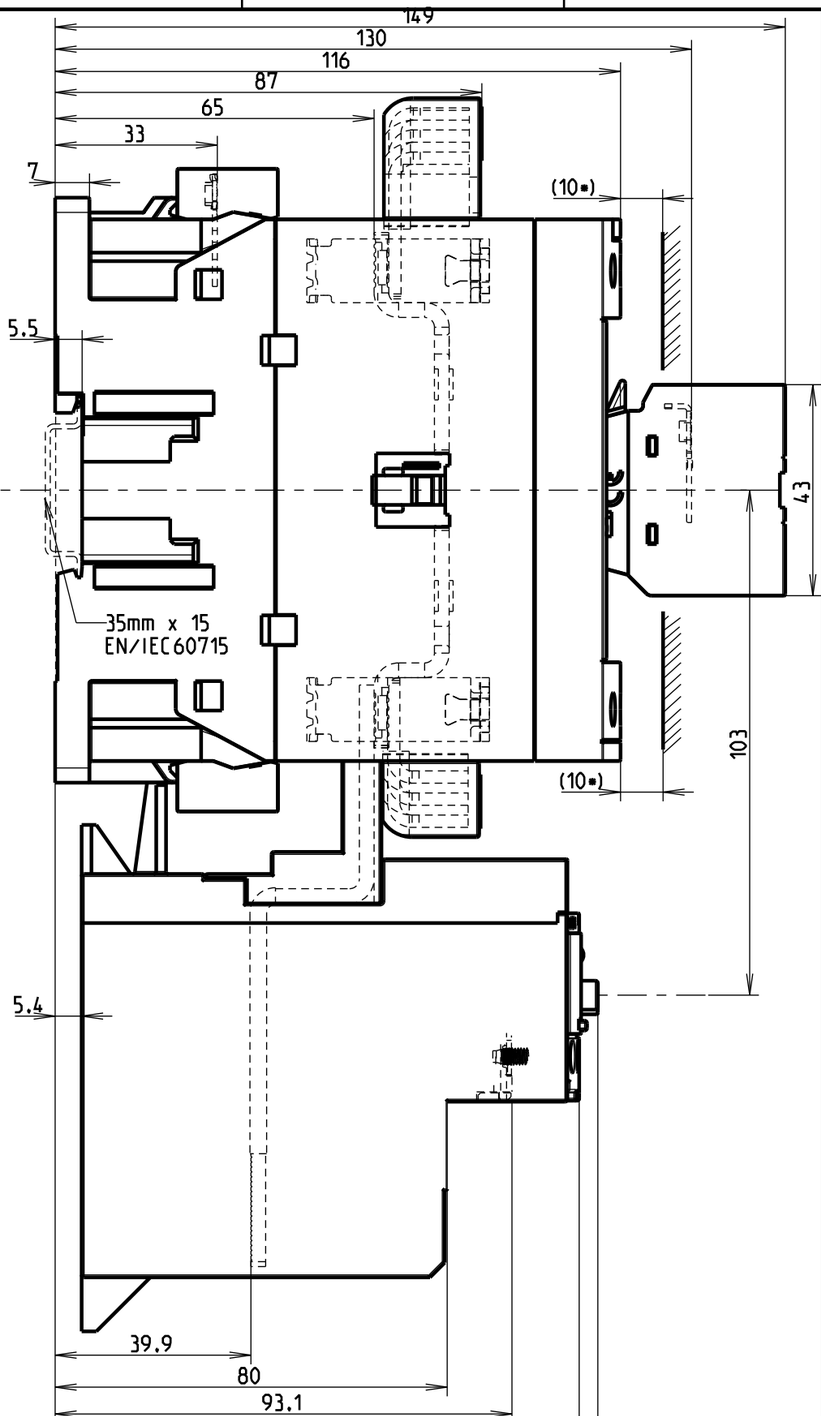

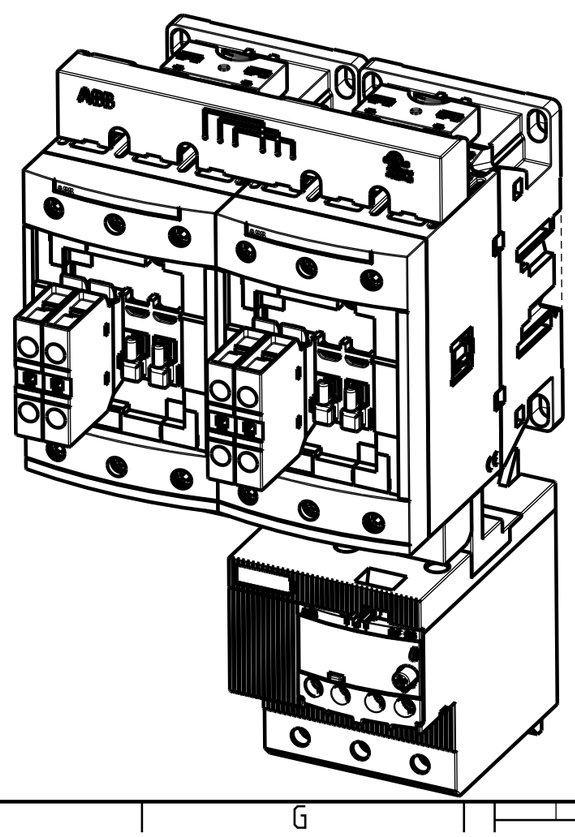

(*) Minimun distance to grounded component

A	Creation	21/06/2013	-	Stephane Bovis	Gerard Valendru
Modif	Description	DATE	N°ECN	Author	Control

State :

Observations: -

Author	Creation	Control	First ECN	Scale	Main Tol.	Nb pg
Bovis S	21/06/2013	Valendru G	501094	3:4	-	1

Title : **AF80..96 3-pole contactor +BER96-4+VM96-4+EF96+CA4-1-pole ENCOMBREMENT/DIMENSION+DRILLING**

Running number	Doc	Size	Type	N°Page	Rev.Ite
1SBB505134D3501					A

The information contained in this document is to be kept strictly confidential.
Any unauthorized use, reproduction, distribution or disclosure is strictly forbidden. ABB reserves all rights.
©Copyright 2012 ABB. All rights reserved.