


NOTES:


1. Prior to any installation in a classified hazardous location, verify installation methods by the Control Drawing referenced on the product's name tag.
2. Maximum length of RS485 bus is 4000 Ft. @9600 baud using Totalflow cable P/N 2011648-001 or equivalent.
3. To access termination board, remove I.S. Junction Box front cover.



4. Redundant Ground Wires per ISA RP 12.6
Wires Must be GRN 12 AWG.
Ground Electrode per CEC C22.1 10-700
or NEC 250-81

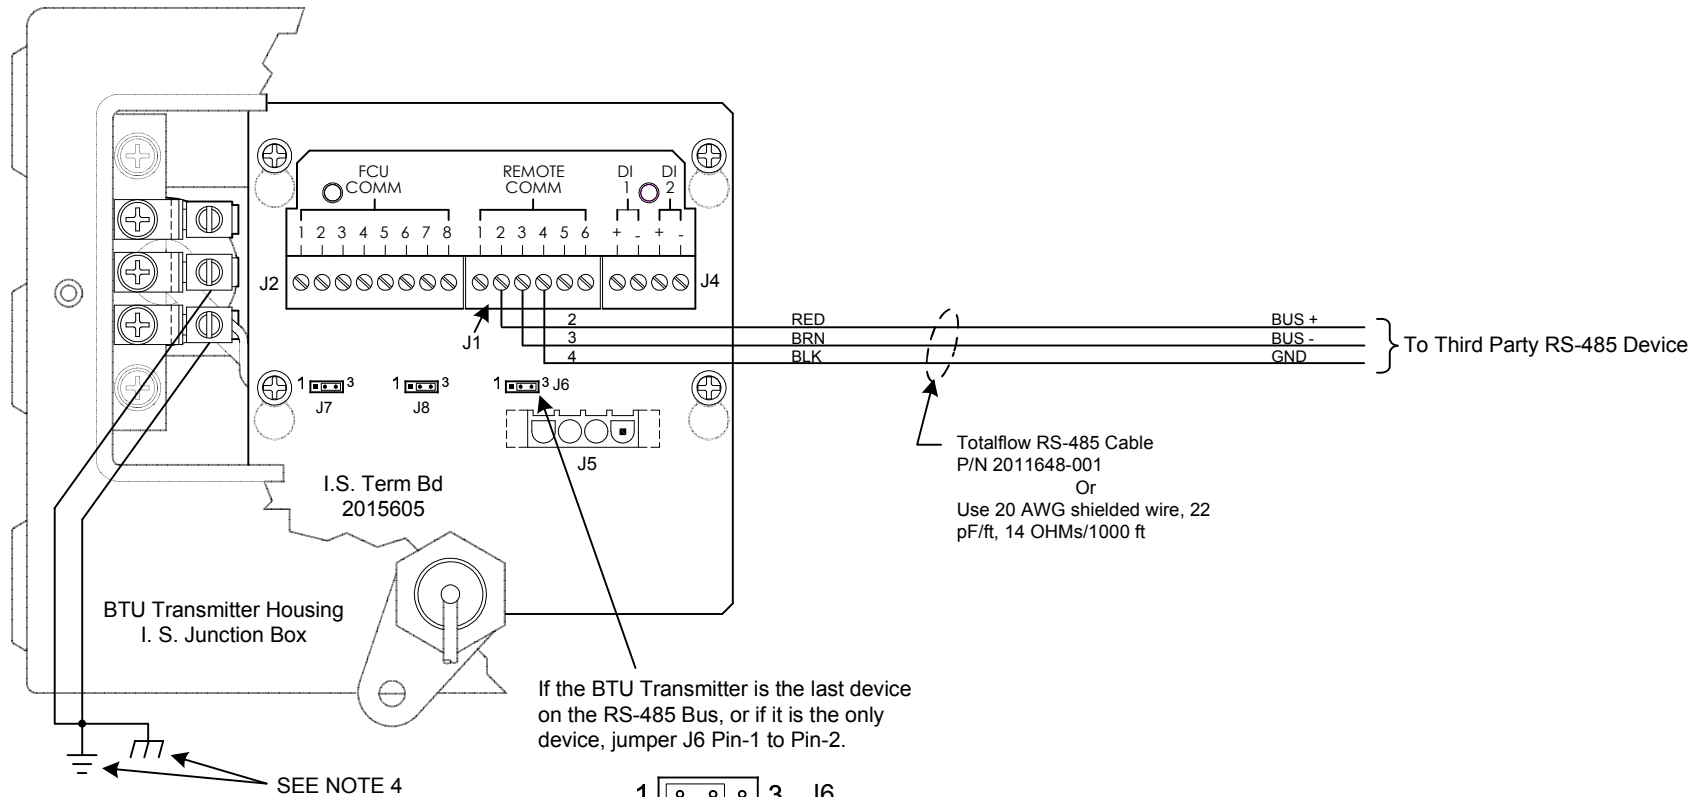

If it is not the last device, jumper J6 Pin-2
to Pin-3 (Pin-1 is on the left, when
viewing the I.S. Board).



REF: N/A

ABB TOTALFLOW Products	ACTION	DOC TYPE	TITLE	DWG NO.	REV	SHEET
	D18507	UD	BTU 8000/8100 REMOTE PORT RS-485 2- WIRE W/GND GENERIC WIRING GUIDE	2102278	AB	1 OF 1