



中国国家强制性产品认证证书

证书编号: 2024010303660003

认证委托人名称及地址

ABB Stotz-Kontakt GmbH
Eppelheimer Strasse 82 69123 Heidelberg Germany

生产者名称及地址

ABB Stotz-Kontakt GmbH
Eppelheimer Strasse 82 69123 Heidelberg Germany

生产企业名称及地址

NOTE Sofia LTD
Varna Str.1 2850 Petrich Bulgaria

产品名称和系列、型号、规格

时间继电器

CT-MFD.xx,CT-ERD.xx,CT-AHD.xx,CT-VWD.xx,CT-EBD.xx,CT-TGD.xx,
CT-SDD.xx,CT-SAD.xx,CT-MFC.xx,CT-ERC.xx,CT-AHC.xx,CT-VWC.xx, CT-TGC.xx,CT-SDC.xx,
CT-SAC.xx,CT-MKC.xx, CT-ARC.xx,CT-EBC.xx, CT-PAC.22;Ui:300V; Uimp:4kV;lthe:5A;
AC-15:Ue/Ie:230V/3A,DC-13:Ue/Ie:24V/2A;CT-MKC:
AC-15:Ue/Ie:230V/0.25A,DC-13:Ue/Ie:24V/1A; IP20; 型号解释详见附页

产品标准和技术要求

GB/T 14048.5-2017

上述产品符合《强制性产品认证实施规则 低压电器 低压元器件》
(CNCA-C03-02:2024)的要求,特发此证。

发证日期: 2025 年 02 月 19 日 有效期至: 2029 年 07 月 17 日

本证书为变更证书,证书首次颁发日期: 2024 年 07 月 18 日
证书信息和有效性可扫描下方二维码或登录发证机构网站查验,
也可在认监委网站 (www.cnca.gov.cn) 查询。



签发:

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司





中国国家强制性产品认证证书

证书编号: 2024010303660003

证书附页: 第 1 页 共 2 页

型号解释:

CT-
I

MFD.
II

1
III

2
IV

I	Series / Type 系列/型号	CT-	Electronic timer relays 电子时间继电器
II	Variant 功能 种类	MFD	Multifunction timer 多功能
		ERD	ON-delay timer 通电延时
		AHD	OFF-delay timer 断电延时
		VWD	Impulse ON timer 通电脉冲延时
		EBD	Flasher starting with ON 通电闪烁, 以 ON (亮态) 开始
		TGD	Pulse generator 脉冲发生器
		SDD	Star-delta timer 星三角转换
		SAD	Star-delta timer with adjustable transition time 星三角转换, 且转换时间可调
		MFC	Multifunction timer 多功能
		ERC	ON-delay timer 通电延时
		AHC	OFF-delay timer 断电延时
		VWC	Impulse ON timer 通电脉冲延时
		TGC	Pulse generator 脉冲发生器
		SDC	Star-delta timer 星三角转换
		SAC	Star-delta timer with adjustable transition time 星三角转换, 且转换时间可调
		EBC	Flasher starting with ON 通电闪烁, 以 ON (亮态) 开始
		MKC	Multifunction timer 多功能
		ARC	OFF-delay timer, without auxiliary voltage 断电延时, 无 辅助电压
III	Relay-Output s 继电器输 出	PAC	time relay ,alternating 输出触点交替导通
		1	1 C/O – Contact 1 C/O 触点
		2	2 C/O – Contact 2 C/O 触点
		3	1 N/O – Contact 1 N/O Solid-state output 1常开-触点固态

本页为证书附页, 应与证书主页同时使用。



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



中国国家强制性产品认证证书

证书编号: 2024010303660003

证书附页: 第 2 页 共 2 页

			输出
IV	Input / Supply Voltage 输入 /供电电压	1	12...240V AC/DC
		2	24...48V DC / 24...240V AC

本页为证书附页，应与证书主页同时使用。



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

中国质量认证中心有限公司



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

本翻译文件不具有法律效力，
不得单独使用
This translated document
does not have legal validity and
cannot be used in isolation

CERTIFICATE NO.: 2024010303660003

NAME AND ADDRESS OF THE APPLICANT

ABB Stotz-Kontakt GmbH
Eppelheimer Strasse 82 69123 Heidelberg Germany

NAME AND ADDRESS OF THE MANUFACTURER

ABB Stotz-Kontakt GmbH
Eppelheimer Strasse 82 69123 Heidelberg Germany

NAME AND LOCATION OF THE FACTORY

NOTE Sofia LTD
Varna Str.1 2850 Petrich Bulgaria

PRODUCT NAME,MODEL AND SPECIFICATION

Timedelay Relay

CT-MFD.xx,CT-ERD.xx,CT-AHD.xx,CT-VWD.xx,CT-EBD.xx,CT-TGD.xx,
CT-SDD.xx,CT-SAD.xx,CT-MFC.xx,CT-ERC.xx,CT-AHC.xx,CT-VWC.xx, CT-TGC.xx,CT-SDC.xx,
CT-SAC.xx,CT-MKC.xx, CT-ARC.xx,CT-EBC.xx, CT-PAC.22;Ui:300V; Uimp:4kV;Ithe:5A ;
AC-15;Ue/Ie:230V/3A,DC-13;Ue/Ie:24V/2A;CT-MKC: AC-15;Ue/Ie:230V/0.25A,DC-13;Ue/Ie:24V/1A; IP20; See the
Appendix for type explanation

STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T 14048.5-2017

This is to certify that the above mentioned product(s) complies with the requirements of
implementation rules for compulsory certification(REFNO. CNCA-C03-02:2024).

Valid from: Feb.19,2025

Valid until: Jul.17,2029

Date of original issued: Jul.18,2024

The certificate information and validity could be checked by scanning the QR code below or logging in to
the website of the issuing authority, or on the website of the CNCA (www.cnca.gov.cn).



SIGNATURE:

谢肇煦



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.





CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO. : 2024010303660003

Appendix: Page 1 of 2

Model explanation:

CT-
I

MFD.
II

1
III

2
IV

I	Series / Type 系列/型号	CT-	Electronic timer relays 电子时间继电器
II	Variant 功能 种类	MFD	Multifunction timer 多功能
		ERD	ON-delay timer 通电延时
		AHD	OFF-delay timer 断电延时
		VWD	Impulse ON timer 通电脉冲延时
		EBD	Flasher starting with ON 通电闪烁, 以 ON (亮态) 开始
		TGD	Pulse generator 脉冲发生器
		SDD	Star-delta timer 星三角转换
		SAD	Star-delta timer with adjustable transition time 星三角转换, 且转换时间可调
		MFC	Multifunction timer 多功能
		ERC	ON-delay timer 通电延时
		AHC	OFF-delay timer 断电延时
		VWC	Impulse ON timer 通电脉冲延时
		TGC	Pulse generator 脉冲发生器
		SDC	Star-delta timer 星三角转换
		SAC	Star-delta timer with adjustable transition time 星三角转换, 且转换时间可调
		EBC	Flasher starting with ON 通电闪烁, 以 ON (亮态) 开始
		MKC	Multifunction timer 多功能
		ARC	OFF-delay timer, without auxiliary voltage 断电延时, 无 辅助电压
		PAC	time relay ,alternating 输出触点交替导通
III	Relay-Output s 继电器输	1	1 C/O – Contact 1 C/O 触点
		2	2 C/O – Contact 2 C/O 触点

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.




CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO. : 2024010303660003

Appendix: Page 2 of 2

	出	3	1 N/O – Contact 1 N/O Solid-state output 1 常开-触点固态输出
IV	Input / Supply Voltage 输入 /供电电压	1	12...240V AC/DC
		2	24...48V DC / 24...240V AC

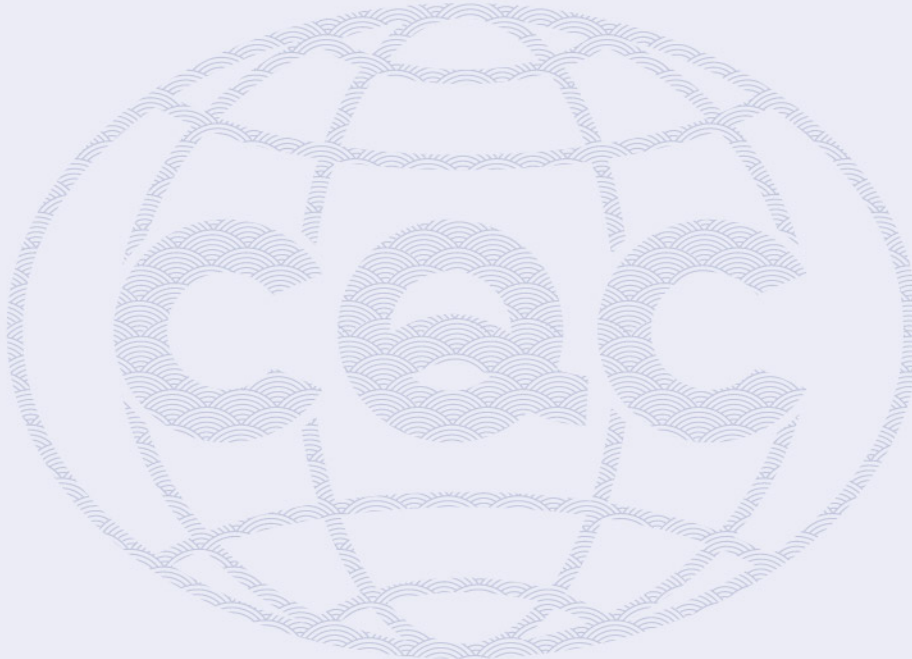

This page is attached to the certificate and should be used at the same time as the certificate page.



中国质量认证中心
CHINA QUALITY CERTIFICATION CENTRE

CHINA QUALITY CERTIFICATION CENTRE CO., LTD.