


NOTES:

1. All installations in hazardous locations must comply with requirements of certification drawing 2017275-CD.

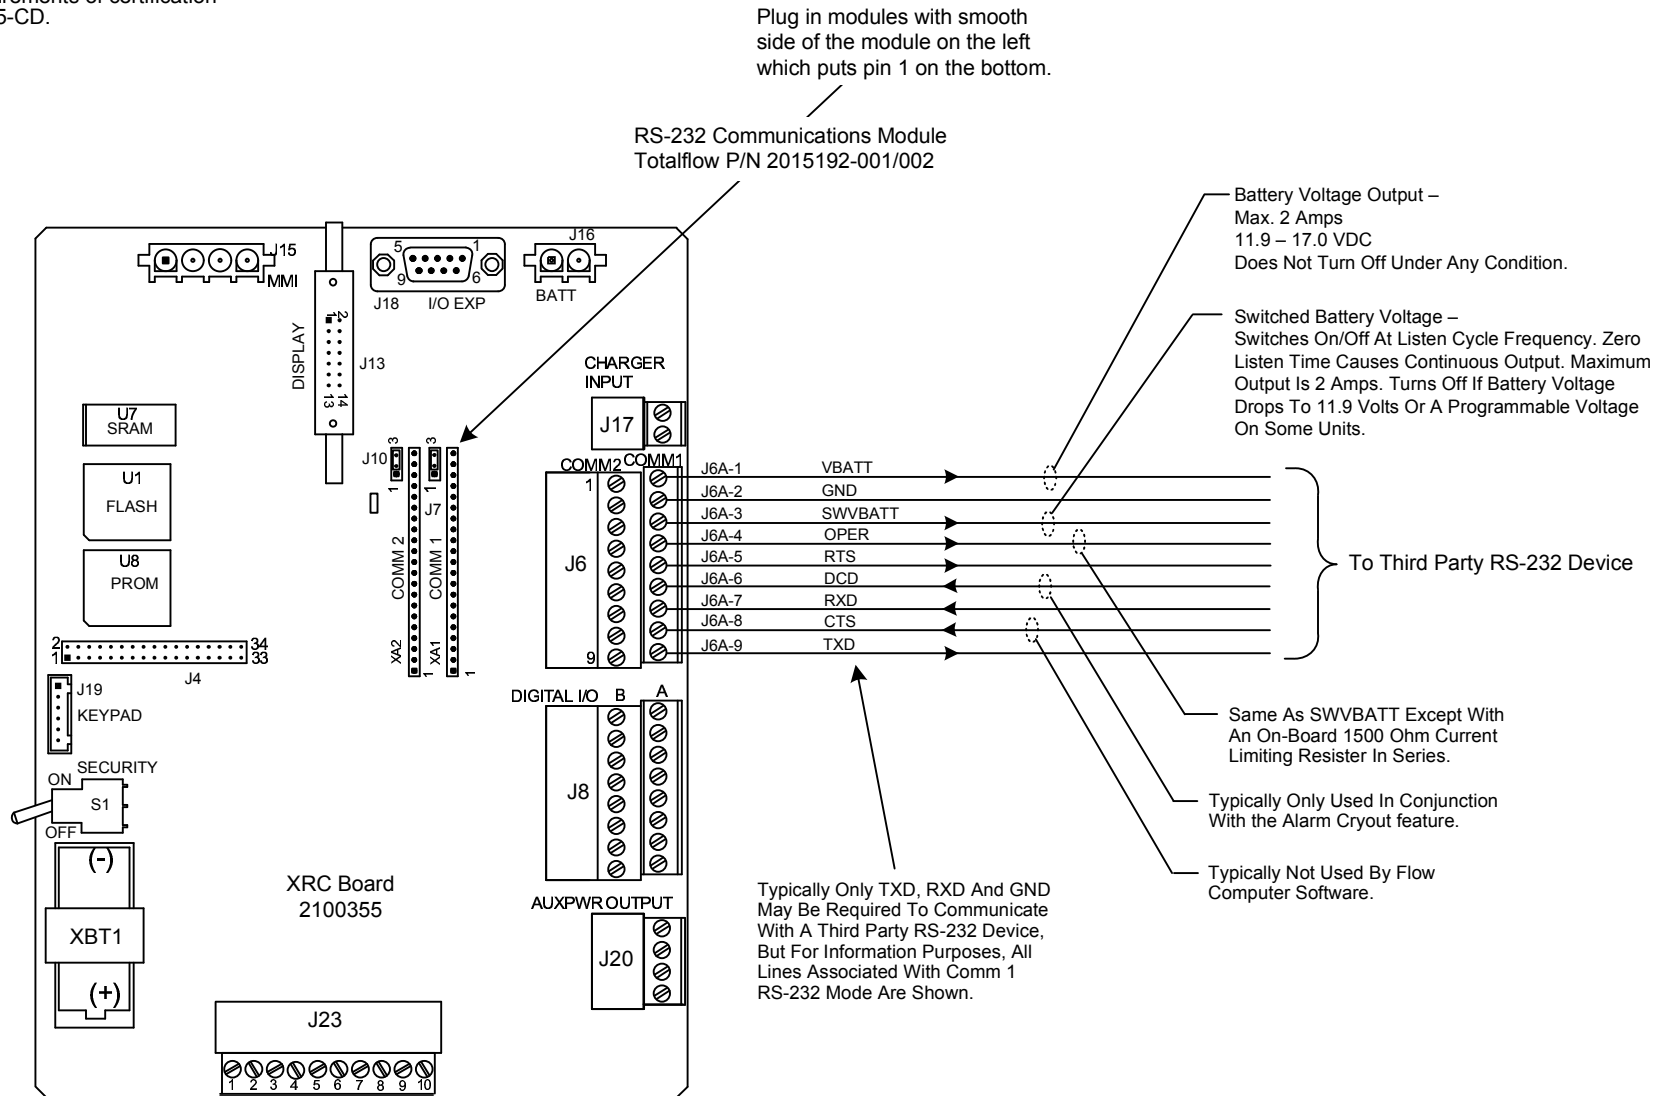

REF: N/A

ABB TOTALFLOW Products	ACTION	DOC TYPE	TITLE	DWG NO.	REV	SHEET
	L17530	UD	XRC 6490/6790/6890 COMM 1 (2100355 BD) GENERIC WIRING GUIDE FOR RS-232	2102226	AA	1 OF 1