



SACE FORMULA A3

Istruzioni di installazione FORMULA A3/III-IV
Installation instructions FORMULA A3/III-IV
Installationsanleitung FORMULA A3/III-IV
Instructions pour l'installation FORMULA A3/III-IV
Instrucciones de instalación FORMULA A3/III-IV
安装说明书 FORMULA A3/III-IV




1SDH000747R0001

A3/III-IV

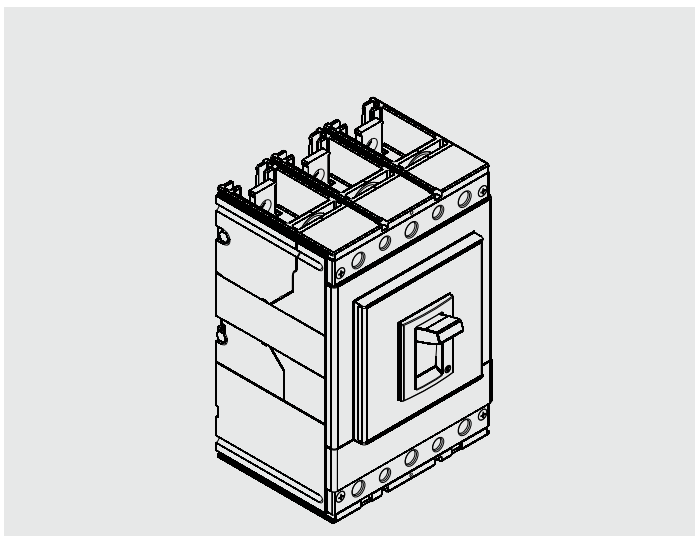


A

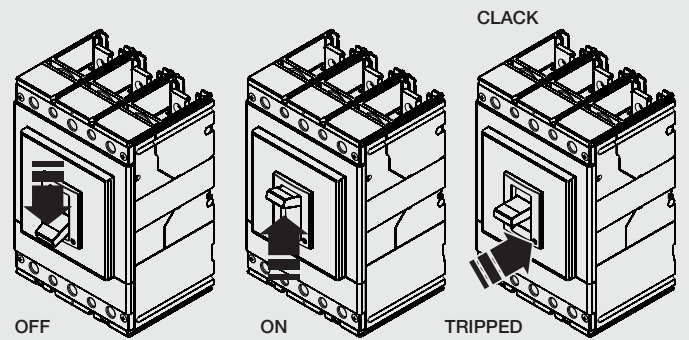


B

A3/III-IV

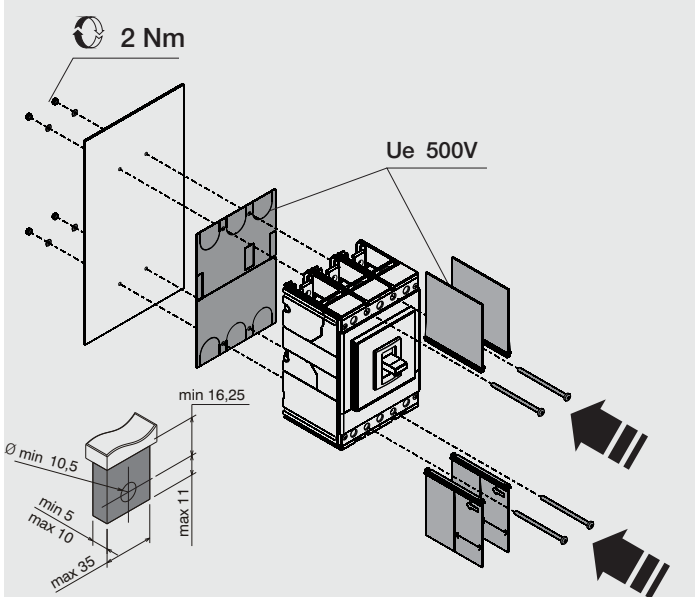


C

A3/III-IV

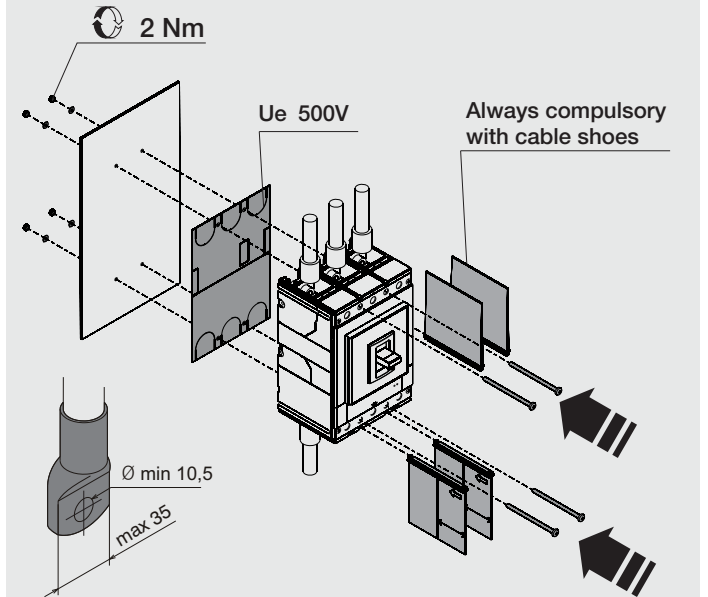


D

A3/III-IV

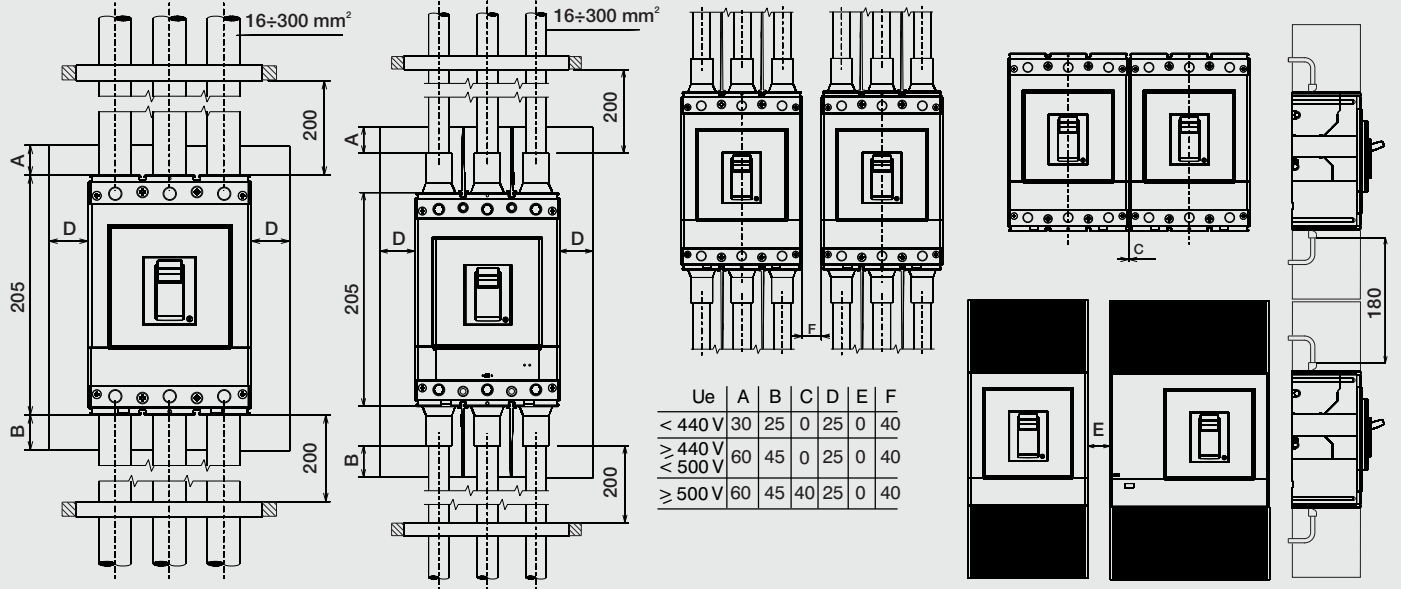

E

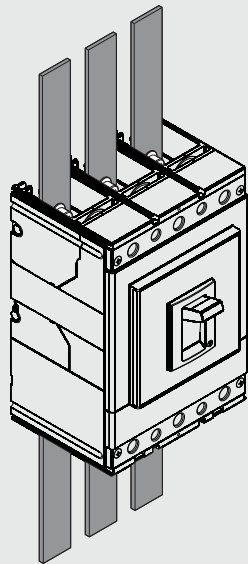

Usare cavi o barre isolate/ o eseguire prove di tipo specifiche sull' installazione.

Use cable or insulated busbars/ or perform specific type test on the installation.

Kabel oder isolierte Sammelschienen verwenden / oder die spezifische Typprüfung auf der Installation durchführen.


Utiliser un câble ou des barres isolées/ ou réaliser un test de type spécifique sur installation.




Utilizar un cable o barras aisladas / o efectuar una prueba de tipo específico sobre instalación.

使用电缆或经绝缘处理的母排，否则需对安装进行指定的型式试验

F


A3/III-IV/F

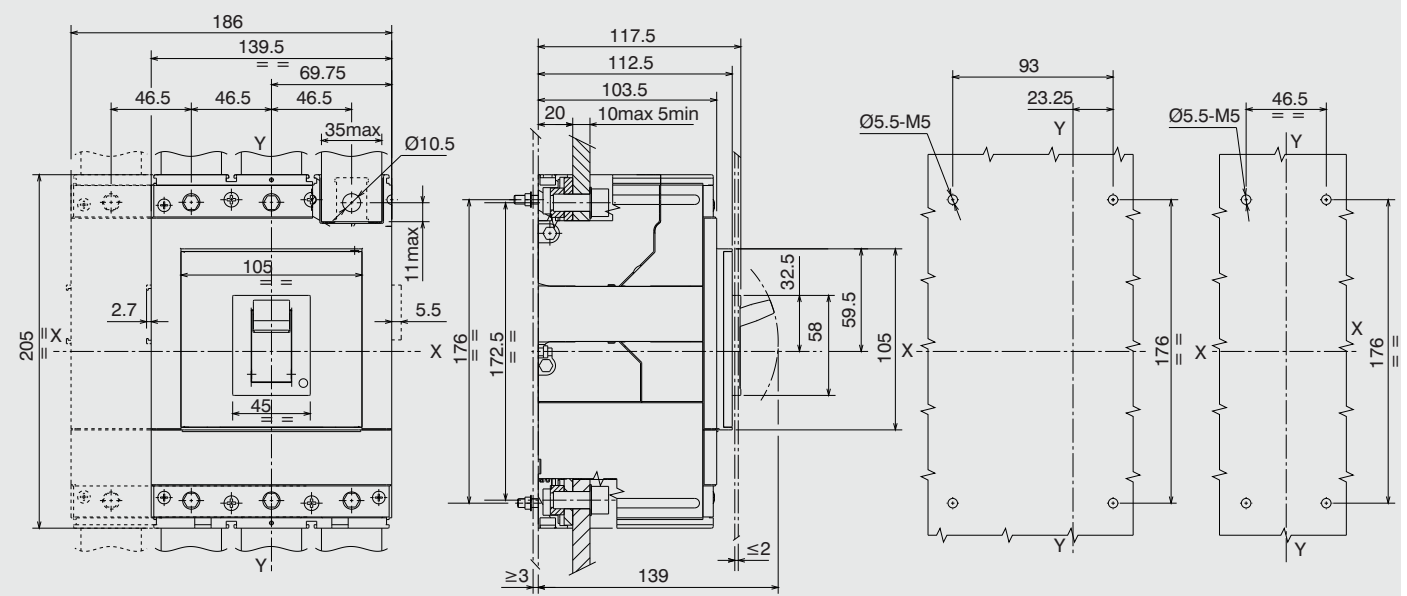

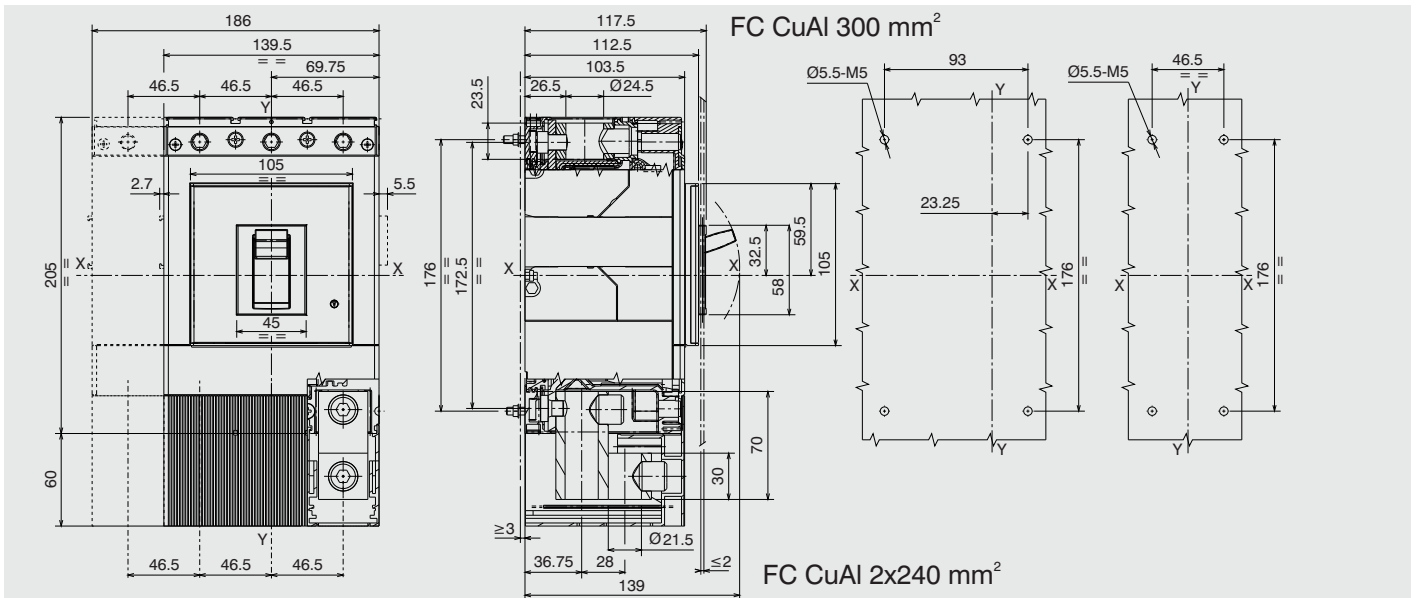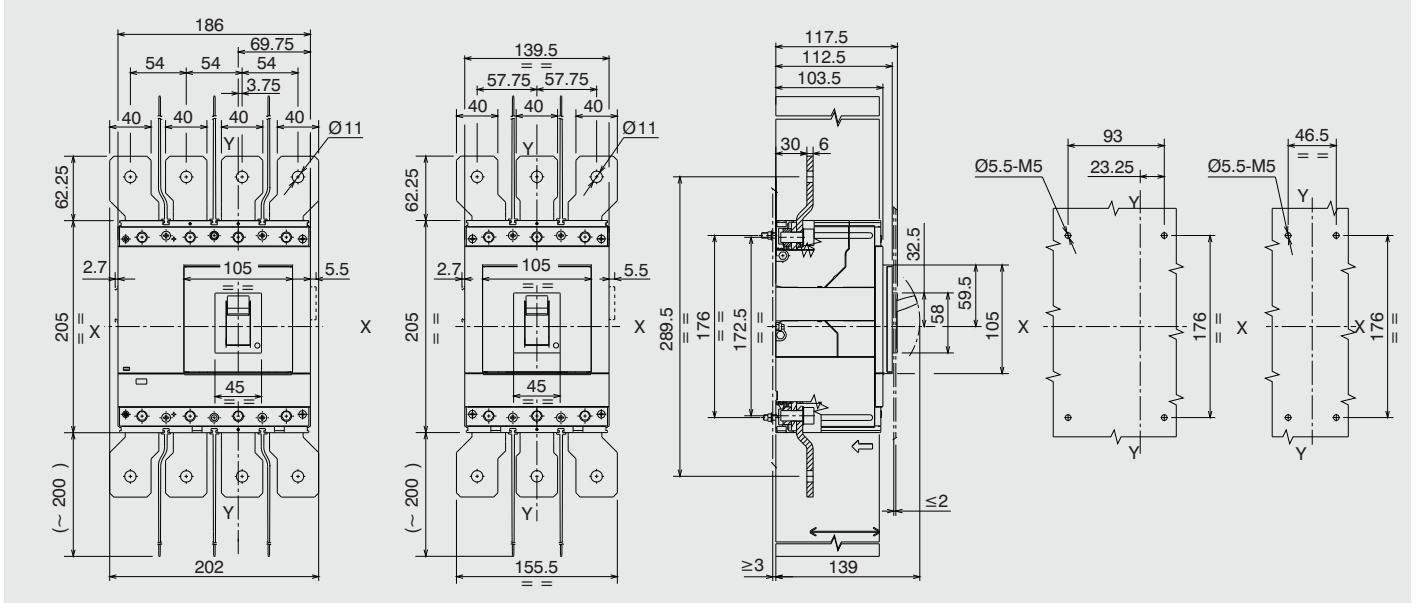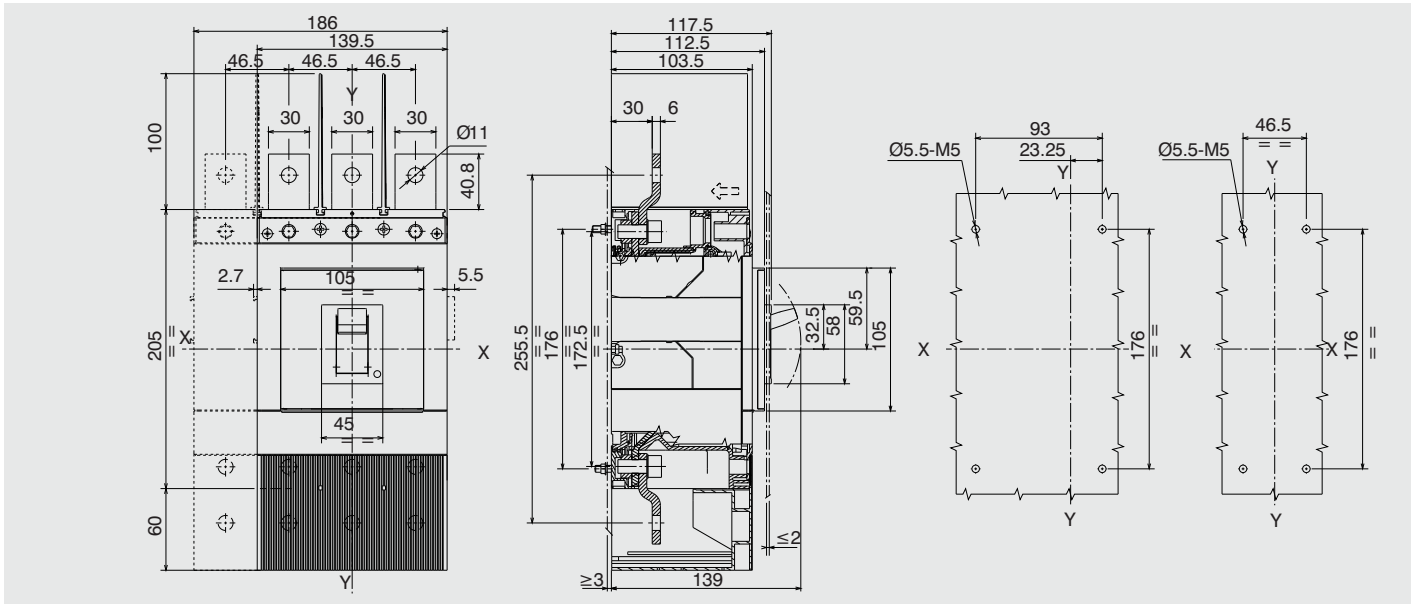

J

A3/III-IV

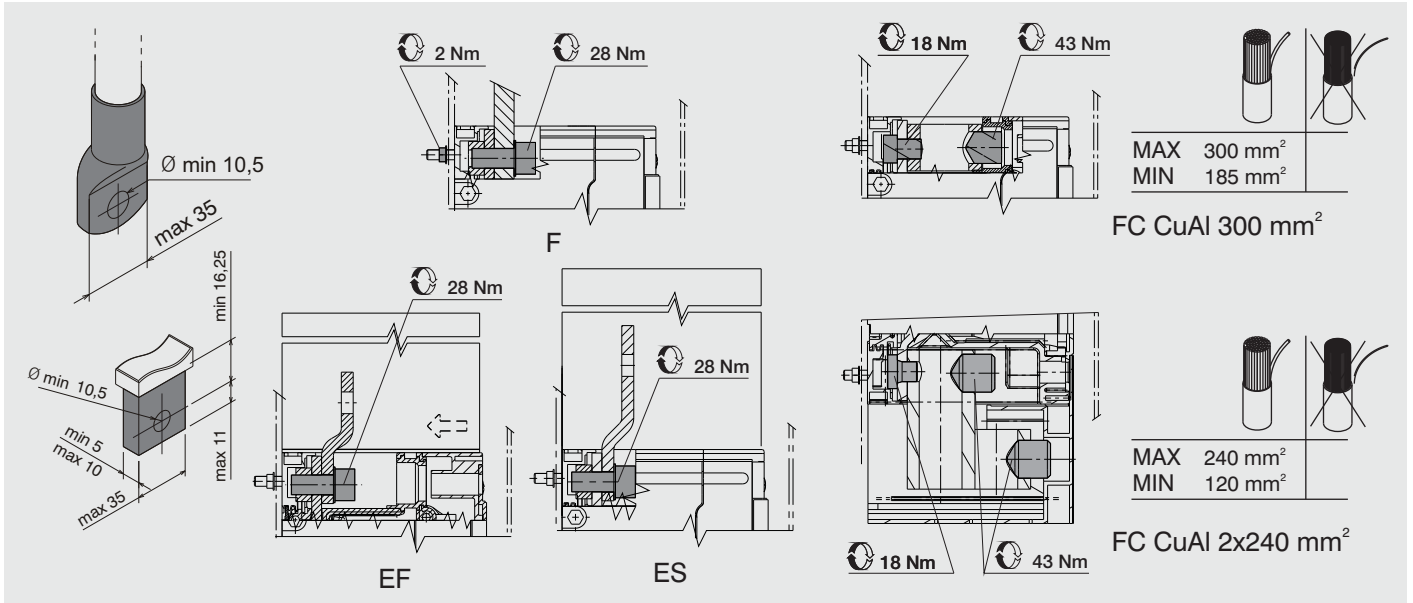

K

A3/III-IV

