

Model 265GR Gauge Model 265AR Absolute

2600T Series Pressure Transmitters Engineered solutions for all applications



With remote seal

Base accuracy

— ± 0.04 %

Span limits

— 6 ... 60000 kPa; 24 in H₂O ... 8700 psi
— 6 ... 3000 kPa abs; 45 mm Hg ... 435 psi

Reliable sensing system coupled with very latest digital technologies

Comprehensive sensor choice

— Optimize in-use total performance and stability

Flexible configuration facilities

— Provided locally via local keys combined with LCD indicator or via hand held terminal or PC configuration platform

Multiple protocol availability

— Provides integration with HART®, PROFIBUS PA and FOUNDATION Fieldbus platforms
— Offering interchangeability and transmitter upgrade capabilities

Broad selection of variants, options fill fluids and wetted materials

— Allows totale flexibility maximizing cost-effective aspect

Full compliance with PED category III

General description

Models detailed in this data sheet apply for those transmitters which include one remote seal connected via a capillary to the transmitter sensor.

Refer of seal data sheet SS/S265 for all data and details relevant to seal element.

Functional Specifications

Range and span limits

Sensor Code	Upper Range Limit (URL)	Lower Range Limit (LRL) (*)	Overrange Limit Sensor	Minimum Span				
				Flush Diaphragm			Extended Diaphragm	
				DN25 / 1in	DN50 / 2in	DN80 / 3in DN100 / 4in	DN50 / 2in	DN80 / 3in DN100 / 4in
				max. 250bar 25MPa, 3625psi max.length of capillary tube 6m	max. 100bar 10MPa, 1450psi max.length of capillary tube 16m	max. 100bar 10MPa, 1450psi max.length of capillary tube 16m	max. 100bar 10MPa, 1450psi max.length of capillary tube 16m	max. 100bar 10MPa, 1450psi max.length of capillary tube 16m
model 265GR								
C	6kPa 60mbar 24inH ₂ O	-6kPa -60mbar -24inH ₂ O	1MPa 10bar 145psi			6kPa 60mbar 24inH ₂ O		6kPa 60mbar 24inH ₂ O
F	40kPa 400mbar 160inH ₂ O	-40kPa -400mbar -160inH ₂ O	1MPa 10bar 145psi	16kPa 160mbar 64inH ₂ O	10kPa 100mbar 40inH ₂ O	6kPa 60mbar 24inH ₂ O	16kPa 160mbar 64inH ₂ O	6kPa 60mbar 24inH ₂ O
L	250kPa 2500mbar 1000inH ₂ O	-100kPa -1000mbar -400inH ₂ O	500kPa 5bar 72.5psi	16kPa 160mbar 64inH ₂ O	10kPa 100mbar 40inH ₂ O	6kPa 60mbar 24inH ₂ O	16kPa 160mbar 64inH ₂ O	6kPa 60mbar 24inH ₂ O
D	1000kPa 10bar 145psi	-100kPa -1bar -145psi	2MPa 20bar 290psi	33kPa 0.33bar 4.9psi	33kPa 0.33bar 4.9psi	33kPa 0.33bar 4.9psi	33kPa 0.33bar 4.9psi	33kPa 0.33bar 4.9psi
U	3000kPa 30bar 435psi	-100kPa -1bar -14.5psi	6MPa 60bar 870psi	100kPa 1bar 14.5psi	100kPa 1bar 14.5psi	100kPa 1bar 14.5psi	100kPa 1bar 14.5psi	100kPa 1bar 14.5psi
R	10MPa 100bar 1450psi	-100kPa -1bar -14.5psi	20MPa 200bar 2900psi	333kPa 3.3bar 49psi	333kPa 3.3bar 49psi	333kPa 3.3bar 49psi	333kPa 3.3bar 49psi	333kPa 3.3bar 49psi
V	60MPa 600bar 8700psi	-100kPa -1bar -14.5psi	90MPa 900bar 13050psi	2kPa 20bar 290psi	2MPa 20bar 290psi	2MPa 20bar 290psi	2MPa 20bar 290psi	2MPa 20bar 290psi
model 265AR								
F	40kPa abs 400mbar abs 300mmHg	0kPa abs 0mbar abs 0mmHg	1MPa 10bar 145psi	16kPa 160mbar 120mmHg	10kPa 100mbar 75mmHg	6kPa 60mbar 45mmHg	16kPa 160mbar 120mmHg	6kPa 60mbar 45mmHg
L	250kPa abs 2500mbar abs 1875mmHg	0kPa abs 0mbar abs 0mmHg	500kPa 5bar 72.5psi	16kPa 160mbar 120mmHg	10kPa 100mbar 75mmHg	6kPa 60mbar 45mmHg	16kPa 160mbar 120mmHg	6kPa 60mbar 45mmHg
D	1000kPa abs 10bar abs 145psia	0kPa abs 0mbar abs 0psia	2MPa 20bar 290psi	50kPa 0.5bar 375mmHg	50kPa 0.5bar 375mmHg	50kPa 0.5bar 375mmHg	50kPa 0.5bar 375mmHg	50kPa 0.5bar 375mmHg
U	3000kPa abs 30bar abs 435psia	0kPa abs 0mbar abs 0psia	6MPa 60bar 870psi	150kPa 1.5bar 22.5psi	150kPa 1.5bar 22.5psi	150kPa 1.5bar 22.5psi	150kPa 1.5bar 22.5psi	150kPa 1.5bar 22.5psi

(*) Additional application limits due to filling fluids see table "Pressure ratings".

Sensor Code	Upper Range Limit (URL)	Minimum Span			
		In-Line remote seal			
		DN25 / 1in	DN40 / 1 1/2in	DN50 / 2in	DN80 / 3in
		max. 250bar 25MPa, 3625psi	max. 250bar 25MPa, 3625psi	max. 250bar 25MPa, 3625psi	max. 250bar 25MPa, 3625psi
		max.length of capillary tube 4m	max.length of capillary tube 6m	max.length of capillary tube 8m	max.length of capillary tube 16m
model 265GR					
C	6kPa 60mbar 24inH ₂ O				
F	40kPa 400mbar 160inH ₂ O				
L	250kPa 2500mbar 1000inH ₂ O				
D	1000kPa 10bar 145psi	400kPa 4bar 58psi	250kPa 2.5bar 36.3psi	250kPa 2.5bar 36.3psi	250kPa 2.5bar 36.3psi
U	3000kPa 30bar 435psi	400kPa 4bar 58psi	250kPa 2.5bar 36.3psi	250kPa 2.5bar 36.3psi	250kPa 2.5bar 36.3psi
R	10MPa 100bar 1450psi	400kPa 4bar 58psi	333kPa 3.3bar 49psi	333kPa 3.3bar 49psi	333kPa 3.3bar 49psi
V	60MPa 600bar 8700psi	2MPa 20bar 290psi	2MPa 20bar 290psi	2MPa 20bar 290psi	2MPa 20bar 290psi
model 265AR					
F	40kPa abs 400mbar abs 300mmHg				
L	250kPa abs 2500mbar abs 1875mmHg				
D	1000kPa abs 10bar abs 145psia	400kPa 4bar 58psi	250kPa 2.5bar 36.3psi	250kPa 2.5bar 36.3psi	250kPa 2.5bar 36.3psi
U	3000kPa abs 30bar abs 435psia	400kPa 4bar 58psi	250kPa 2.5bar 36.3psi	250kPa 2.5bar 36.3psi	250kPa 2.5bar 36.3psi

Span limits

Maximum span = URL

IT IS RECOMMENDED TO SELECT THE TRANSMITTER SENSOR CODE PROVIDING THE TURNDOWN VALUE AS LOWEST AS POSSIBLE TO OPTIMIZE PERFORMANCE CHARACTERISTICS.

Zero suppression and elevation

Zero and span can be adjusted to any value within the range limits detailed in the table as long as:

– calibrated span ≥ minimum span

Damping

Adjustable time constant : 0 to 60s.

This is in addition to sensor response time

Turn on time

Operation within specification in less than 2.5s with minimum damping.

Insulation resistance

> 100MΩ at 1000VDC (terminals to earth)

Operative limits

Temperature limits °C (°F) :

Ambient (is the operating temperature)

Silicone oil filling: -40°C and +85°C (-40°F and +185°F)

Inert filling: -20°C and +85°C (-4°F and +185°F)

Note : For Hazardous Atmosphere applications see the temperature range specified on the certificate/approval relevant to the aimed type of protection.

Process

The following table show characteristics of capillary/seal fill fluids when used in transmitters with remote seal.

Filling Liquid	Id	Density at 20° C in Kg/m	Process temperature in° C(° F)
Silicone oil	IC	1055	-30 and +250 (-22 and +482)
Carbon Fluoride	L	1860	-30 and +150 (-22 and +302)
High-temperature Oil	SH	1070	-10 and +375 (+14 and +707)
White Oil	WB	849	-6 and +200 (+21 and +392)
Vacuumproof Design	IC-V	1055	-30 and +200 (-22 and +392)

Storage

Lower limit: -50°C (-58°F); -40°C (-40°F) for LCD indicators –

6°C (+21 °F) with white oil filling

Upper limit: +85°C (+185°F)

Pressure limits

For maximum pressure refer to sensor overrange limit and seal working pressure in table "Range and Span limits" at pages 2 and 3. For minimum pressure refer to the following table:

Filling Liquid	Id	Pressure rating in kPa abs.					
		20° C (68° F)	100° C (212° F)	150° C (302° F)	200° C (392° F)	250° C (482° F)	375° C (707° F)
Silicone oil	IC	> 50	> 50	> 50	> 75	> 100	
Carbon Fluoride	L	> 100	> 100	> 100			
High-temperature	SH	> 50	> 50	> 50	> 75	> 100	> 100
White Oil	WB	> 50	> 100	> 100	> 100	> 100	
Vacuumproof Design	IC-V	> 0.5	> 2.5	> 3.8	> 5.0		

Overpressure limits (without damage to the transmitter)

The transmitter can be exposed without leaking to line pressure up to the overrange limit of the sensor or 2 times the flange rating of seal, whichever is less.

Environmental limits

Electromagnetic compatibility (EMC)

Definition	Class 3
Radio suppression (according to EN 550011)	Limit class B
Fulfills NAMUR recommendation	

Low voltage directive

Comply with 73/23/EEC

Pressure equipment directive (PED)

Comply with 97/23/EEC Category III module H.

Humidity

Relative humidity:	up to 100% annual average
Condensing, icing:	admissible

Vibration resistance

Accelerations up to 2g at frequency up to 1000Hz
(according to IEC 60068–2–26)

Shock resistance (according to IEC 60068–2–27)

Acceleration:	50g
Duration:	11ms

Wet and dust-laden atmospheres

The transmitter is dust and sand tight and protected against immersion effects as defined by IEC EN60529 (1989) to IP 67 (IP 68 on request) or by NEMA to 4X or by JIS to C0920.

Hazardous atmospheres

- Transmitters of the type of protection "Intrinsically safe EEx ia" according to the directions 94 / 9 / EC (ATEX)
Transmitter with 4 to 20mA output signal and HART communication
Marking (DIN EN 50 014): II 1/2 GD T50°C EEx ia IIC T6 or resp.
II 1/2 GD T95°C EEx ia IIC T4

Supply and signal circuit type of protection Intrinsic Safety
EEx ib IIB/IIC resp. EEx ia IIB/IIC

for connection to supply units with maximum values:

II 1/2 GD T50°C EEx ia resp. ib IIC T6 resp.

II 1/2 GD T95°C EEx ia resp. ib IIC T4

for Temperature class T4 resp. T95°C:

U_i = 30V

I_i = 200mA

P_i = 0.8W for T4 with T_a = (–40 to +85)°C / (–40 to +185)°F

P_i = 1.0W for T4 with T_a = (–40 to +70)°C / (–40 to +158)°F

for Temperature class T6 resp. T50°C:

P_i = 0.7W for T6 with T_a = (–40 to +40)°C / (–40 to +104)°F

effective internal capacitance, C_i ≤ 10nF

effective internal inductance, negligible.

The capacitive measuring element (range code C, F) supplied with an intrinsically safe circuit EEx ib IIB/IIC must not be mounted into the separation wall between category 1G and category 2G.

Fieldbus transmitters (PROFIBUS PA / FOUNDATION Fieldbus)

Marking (DIN EN 50 014): II 1/2 GD T50°C EEx ia IIC T6 or resp.

II 1/2 GD T95°C EEx ia IIC T4

Supply and signal circuit type of protection Intrinsic Safety

EEx ib IIB/IIC resp. EEx ia IIB/IIC

for connection to FISCO supply units with rectangular or trapezoidal characteristics with maximum values:

II 1/2 G EEx ia respectively ib IIC T4/T6 U_i = 17.5V

I_i = 360mA

P_i = 2.52W

II 1/2 G EEx ia respectively ib IIB T4/T6 U_i = 17.5V

I_i = 380mA

P_i = 5.32W

resp. for connection to supply unit or barrier with linear characteristics with maximum values:

II 1/2 G EEx ia respectively ib IIC T4/T6	U _i = 24V
	I _i = 250mA
	P _i = 1.2W

effective internal inductance L_i ≤ 10 μH,

effective internal capacitance C_i ≈ 0

Maximum permissible ambient temperatures depending on the temperature class:

T4: –40°C to +85°C (–40°F to +185°F)

T5, T6: –40°C to +40°C (–40°F to +104°F)

The capacitive measuring element (range code C, F) supplied with an intrinsically safe circuit EEx ib IIB/IIC must not be mounted into the separation wall between category 1G and category 2G.

- Transmitters of the type of protection "flameproof enclosure EEx d" according to the directions 94 / 9 / EC (ATEX)

Transmitter with 4 to 20mA output signal and HART communication and Fieldbus transmitters (PROFIBUS PA / FOUNDATION Fieldbus)

Marking (DIN EN 50 014): II 1/2 G EEx d IIC T6

Ambient temperature range: –40°C to +75°C (–40°F to +167°F)

- Transmitters of category 3 for the application in "Zone 2"

Transmitter with 4 to 20mA output signal and HART communication
according to the directions 94 / 9 / EC (ATEX)

Marking (DIN EN 50 014): II 3 GD T50°C EEx nL IIC T6 or resp.

II 3 GD T95°C EEx nL IIC T4

Operating conditions:

Supply and signal circuit (terminals signal +/-): U ≤ 45V

I ≤ 22.5mA

Ambient temperature range:

Temperature class T4 T_a = –40°C to +85°C (–40°F to +185°F)

Temperature class T5, T6 T_a = –40°C to +40°C (–40°F to +104°F)

- Factory Mutual (FM)

Transmitter with 4 to 20mA output signal and HART communication

Intrinsically safe: Class I; Division 1; Groups A, B, C, D;

Class I; Zone 0; Group IIC; AEx ia IIC

Degree of protection : NEMA Type 4X (indoor or outdoor)

Permissible ambient temperature depending on temperature class

U _{max} = 30V, C _i = 10.5nF, L _i = 10μH			
Ambient Temperature	Temperature class	I _{max}	P _i
–40 to +85° C (–40 to +185° F)	T4	200mA	0.8W
–40 to +70° C (–40 to +129° F)	T4	200mA	1W
–40 to +40° C (–40 to +104° F)	T5	25mA	0.75W
–40 to +40° C (–40 to +104° F)	T6	25mA	0.5W

Fieldbus transmitters (PROFIBUS PA/FOUNDATION Fieldbus)

Intrinsically Safe : Class I, II and III; Division 1; Groups A, B, C, D, E, F, G;

Class I; Zone 0, AEx ia Group IIC T6; T4

Non-incendive Class I, II and III, Division

2; Groups A, B, C, D, F, G

Transmitter with 4 to 20mA output signal and HART communication and Fieldbus transmitters (PROFIBUS PA/FOUNDATION Fieldbus)

Explosion-Proof: Class I; Division 1; Groups A, B, C, D;

Class II/III, Division 1; Groups E, F, G

Degree of protection : NEMA Type 4X (indoor or outdoor)

- Canadian Standard (CSA)

Transmitter with 4 to 20mA output signal and HART communication and Fieldbus transmitters (PROFIBUS PA/FOUNDATION Fieldbus)

Explosion-Proof: Class I; Division 1; Groups B, C, D

Class II; Division 1; Groups E, F, G

Class III

Degree of protection : NEMA Type 4X (indoor or outdoor)

Electrical Characteristics and Options

HART digital communication and 4 to 20mA output

Power Supply

The transmitter operates from 10.5 to 45VDC with no load and is protected against reverse polarity connection (additional load allows operations over 45VDC).

Minimum power supply is 14VDC with backlit indicator.

For EEx ia and other intrinsically safe approval power supply must not exceed 30VDC.

Ripple

Maximum permissible voltage ripple of power supply during the communication:

7Vpp at f = 50 to 100Hz

1Vpp at f = 100 to 200Hz

0.2Vpp at f = 200 to 300Hz

Load limitations

4 to 20mA and HART total loop resistance :

$$R(k\Omega) = \frac{\text{Supply voltage} - \text{min. operating voltage (VDC)}}{22.5 \text{ mA}}$$

A minimum of 250Ω is required for HART communication.

Integral display (optional)

2-line, 6-character 19-segment alphanumeric display with additional bar chart display, optionally with back illumination. User-specific display:

percentage of the output current or

output current in mA or

free process variable

Diagnostic message, alarms, measuring range infringements and changes in the configuration are also displayed.

Output signal

Two-wire 4 to 20mA, user-selectable for linear or freely programmable with 20 reference points output.

HART® communication provides digital process variable (% , mA or engineering units) superimposed on 4 to 20mA signal, with protocol based on Bell 202 FSK standard.

Output current limits (to NAMUR standard)

Overload condition

- Lower limit: 3.8mA (configurable down to 3.5mA)

- Upper limit: 20.5mA (configurable up to 22.5mA)

Alarm current

Min. alarm current: configurable from 3.5mA to 4mA,
standard setting: 3.6mA

Max. alarm current: configurable from 20mA to 22.5mA,
standard setting: 21mA

Standard setting: max. alarm current

SIL - Functional Safety (optional)

according to IEC 61508 / 61511 Device with Declaration of SIL Conformity for use in safety related applications up to SIL2.

PROFIBUS PA output

Device type

Pressure transmitter compliant to Profile 3.0 Class A & B; ident. number 04C2 HEX.

Power supply

The transmitter operates from 10.2 to 32VDC with no polarity.

For EEx ia approval power supply must not exceed 17.5VDC. Intrinsic safety installation according to FISCO model.

Current consumption

operating (quiescent): 11.7mA

fault current limiting: 17.3mA max.

Output signal

Physical layer in compliance to IEC 1158-2/EN 61158-2 with transmission to Manchester II modulation, at 31.25kbit/sec.

Output interface

PROFIBUS PA communication according to Profibus DP50170 Part 2/ DIN 19245 part 1-3.

Output update time

40ms

Function blocks

2 standard Analog Input Function Block,

1 Transducer Block, 1 Physical Block

Integral display

2-line, 6-character 19-segment alphanumeric display with additional bar chart display, optionally with back illumination. User-specific display:

percentage of the output or

OUT (analog input function block)

Diagnostic message, alarms, measuring range infringements and changes in the configuration are also displayed.

Transmitter failure mode

Permanent self-diagnostic; possible errors indicated in diagnostic parameters and in the status of process values.

FOUNDATION Fieldbus output

Power supply

The transmitter operates from 10.2 to 32VDC polarity independent.

For EEx ia approval power supply must not exceed 24VDC (entity certification) or 17.5VDC (FISCO certification), according to FF-816.

Current consumption

operating (quiescent): 11.7mA

fault current limiting: 17.3mA max.

Output signal

Physical layer in compliance to IEC 1158-2/EN 61158-2 with transmission to Manchester II modulation, at 31.25kbit/sec.

Function blocks/execution period

2 Standard Analog Input Function Block/25ms max

1 Standard PID Function Block

Additional blocks

1 manufacturer specified Pressure with Calibration Transducer Block,

1 enhanced Resource Block

Number of link objects

10

Number of VCRs

16

Output interface

FOUNDATION fieldbus digital communication protocol to standard H1, compliant to specification V. 1.5; FF registration in progress.

Integral display

2-line, 6-character 19-segment alphanumeric display with additional bar chart display, optionally with back illumination. User-specific display:

percentage of the output or

OUT (analog input)

Diagnostic message, alarms, measuring range infringements and changes in the configuration are also displayed.

Transmitter failure mode

Permanent self-diagnostic; possible errors indicated in diagnostic parameters and in the status of process values.

Performance specifications

Stated at reference condition to IEC 60770 ambient temperature of 20°C (68°F), relative humidity of 65%, atmospheric pressure of 1013hPa (1013mbar), zero based range for transmitter with isolating diaphragms ceramic or Hastelloy and silicone oil fill and HART digital trim values equal to 4–20mA span end points, in linear mode.

Unless otherwise specified, errors are quoted as % of span.

Some performance data (based to URL) are affected by the actual turndown (TD) as ratio between Upper Range Limit (URL) and calibrated span.

IT IS RECOMMENDED TO SELECT THE TRANSMITTER SENSOR CODE PROVIDING THE TURNDOWN VALUE AS LOWEST AS POSSIBLE TO OPTIMIZE PERFORMANCE CHARACTERISTICS.

Accuracy rating

% of calibrated span, including combined effects of terminal based linearity, hysteresis and repeatability.

For fieldbus versions SPAN refer to Analog Input Function Block outscale range

– ±0.04% for TD from 1:1 to 10:1

– $\pm(0.04 + 0.005 \times \frac{\text{URL}}{\text{Span}} - 0.05)\%$ for TD greater than 10:1

Operating influences

Ambient temperature (for turndown up to 15:1)

per 20K (36°F) change between the limits of –20°C to +65°C (–4 to +150°F)

– ±(0.03% URL + 0.05% span)

The total temperature error is the combination of the above transmitter effect with seal errors, as applicable due to application temperatures.

Refer to seal data sheets for additional effects of the remote seal.

Supply voltage

Within voltage/load specified limits the total effect is less than 0.001% of URL per volt.

Load

Within load/voltage specified limits the total effect is negligible.

Electromagnetic field

Total effect : less than 0.05% of span from 80 to 1000MHz and for field strengths up to 10V/m when tested with unshielded conduit, with or without meter.

Common mode interference

No effect from 250Vrms @ 50Hz, or 50VDC

Physical Specification

(Refer to ordering information sheets for variant availability related to specific model or versions code)

Materials

Process isolating diaphragms (*)

Refer to ordering information

Process connection (*)

Refer to ordering information

Seal fill fluid

Refer to ordering information

Sensor fill fluid

Silicone oil; inert fill (Carbon fluoride); white oil (FDA)

Mounting bracket

AISI 316 L ss

Sensor housing

AISI 316 L ss.

Electronic housing and covers

Barrel version

– Low-copper content aluminium alloy with baked epoxy finish;

– AISI 316 L ss.

DIN version

– Low-copper content aluminium alloy with baked epoxy finish.

Covers O-ring

Viton™.

Local zero and span adjustments:

Glass filled polycarbonate plastic (removable).

No local zero and span adjustments with housing made of stainless steel.

Tagging

AISI 316ss or plastic data plate attached to the electronics housing.

Calibration

Standard: at maximum span, zero based range, ambient temperature and pressure;

Optional: at specified range and ambient conditions; or at operating temperature

™ Hastelloy is a Cabot Corporation trademark

™ Viton is a Dupont de Nemour trademark

(*) Wetted parts of the transmitter.

Optional extras

Mounting brackets

For vertical and horizontal 60mm. (2in) pipes or wall mounting.

Integral display

plug-in rotatable LCD indicator

Supplemental customer tag

AISI 316 ss tag fastened to the transmitter with stainless steel wire for customer's tag data up to a maximum of 30 characters and spaces.

Surge protection (optional)

Up to 4kV

– voltage 1.2 μ s rise time / 50 μ s delay-time to half value

– current 8 μ s rise Time / 20 μ s delay time to half value

Available for HART instruments only general purpose and intrinsically safe to ATEX; for PROFIBUS PA and FOUNDATION Fieldbus instruments only general purpose.

Cleaning procedure for oxygen service

Test Certificates (test, design, calibration, material traceability)

Process connections

Refer to ordering information

Electrical connections

Two 1/2 – 14 NPT or M20x1.5 threaded conduit entries, direct on housing, or plug connector:

– HART: straight or angle Harting Han 8U connector and one plug.

– PROFIBUS PA, FOUNDATION Fieldbus : M12x1 or 7/8in (without mating female plug)

Terminal block

HART version: four terminals for signal/external meter wiring up to 2.5mm² (14AWG) and four connection points for test and communication purposes.

Fieldbus versions: two terminals for signal (bus connection) wiring up to 2.5mm² (14AWG).

Grounding

Internal and external 4mm² (12AWG) ground termination points are provided.

Mounting position

Transmitter can be mounted in any position.

Electronics housing may be rotated to any position. A positive stop prevents over travel.

Mass (without options)

Transmitter: approx 1.2kg

Flange seal

- DN50, PN16/40 with flush diaphragm: approx 3.3kg

- 2in, Class 300 with flush diaphragm: approx 3.7kg

- DN50, PN16/40 with extended diaphr.100mm: approx 4.0kg

- 2in, Class 300 with extended diaphr.100mm: approx 5.4kg

- DN80, PN16/40 with flush diaphragm: approx 5.8kg

- 3in, Class 150 with flush diaphragm: approx 5.3kg

- DN80, PN16/40 with extended diaphr.100mm: approx 7.5kg

- 3in, Class 150 with extended diaphr.100mm: approx 7.0kg

Flush diaphragm seals DN25/1in, miniature seals, in-line seals and fast coupled seals: see dimensional diagrams.

Packing

Carton

Configuration

Transmitter with HART communication and 4 to 20 mA

Standard configuration

Transmitters are factory calibrated to customer's specified range. Calibrated range and tag number are stamped on the type plate. If calibration range and tag data are not specified, the transmitter will be supplied configured as follows:

4 mA	Zero
20 mA	Upper Range Limit (URL)
Output	Linear
Damping	0.125s
Transmitter failure mode	21mA
Optional LCD-indicators	0 to 100% linear

Any or all the above configurable parameters, including Lower range-value and Upper range-value can be easily changed using the HART hand-held communicator or by a PC, running the configuration software SMART VISION with DTM for 2600T.

The transmitter database is customized with specified flange type and material, o-ring and filling liquid.

Transmitter with PROFIBUS PA communication

Transmitters are factory calibrated to customer's specified range. Calibrated range and tag number are stamped on the type plate. If calibration range and tag data are not specified, the transmitter will be supplied configured as follows:

Measure Profile	Pressure
Engineering Unit	mbar/bar
Output scale 0%	Lower Range Limit (LRL)
Output scale 100%	Upper Range Limit (URL)
Output	Linear
Hi-Hi Limit	Upper Range Limit (URL)
Hi Limit	Upper Range Limit (URL)
Low Limit	Lower Range Limit (LRL)
Low-Low Limit	Lower Range Limit (LRL)
Limits hysteresis	0.5% of output scale
PV filter	0.125s.
Address	126

Any or all the above configurable parameters, including Lower range-value and Upper range-value can be easily changed by a PC, running the configuration software SMART VISION with DTM for 2600T.

The transmitter database is customized with specified flange type and material, o-ring and filling liquid.

Transmitter with FOUNDATION Fieldbus communication

Transmitters are factory calibrated to customer's specified range. Calibrated range and tag number are stamped on the type plate. If calibration range and tag data are not specified, the transmitter will be supplied configured as follows:


Measure Profile	Pressure
Engineering Unit	mbar/bar
Output scale 0%	Lower Range Limit (LRL)
Output scale 100%	Upper Range Limit (URL)
Output	Linear
Hi-Hi Limit	Upper Range Limit (URL)
Hi Limit :	Upper Range Limit (URL)
Low Limit	Lower Range Limit (LRL)
Low-Low Limit	Lower Range Limit (LRL)
Limits hysteresis	0.5% of output scale
PV filter	0.125s
Address	Not necessary

Any or all the above configurable parameters, including lower range value and upper range value can be changed by any FOUNDATION Fieldbus compatible configurator.

The transmitter database is customized with specified flange type and material, o-ring and filling liquid.


MOUNTING DIMENSIONS (not for construction unless certified) - dimensions in mm (in)

Transmitter with barrel-type amplifier housing

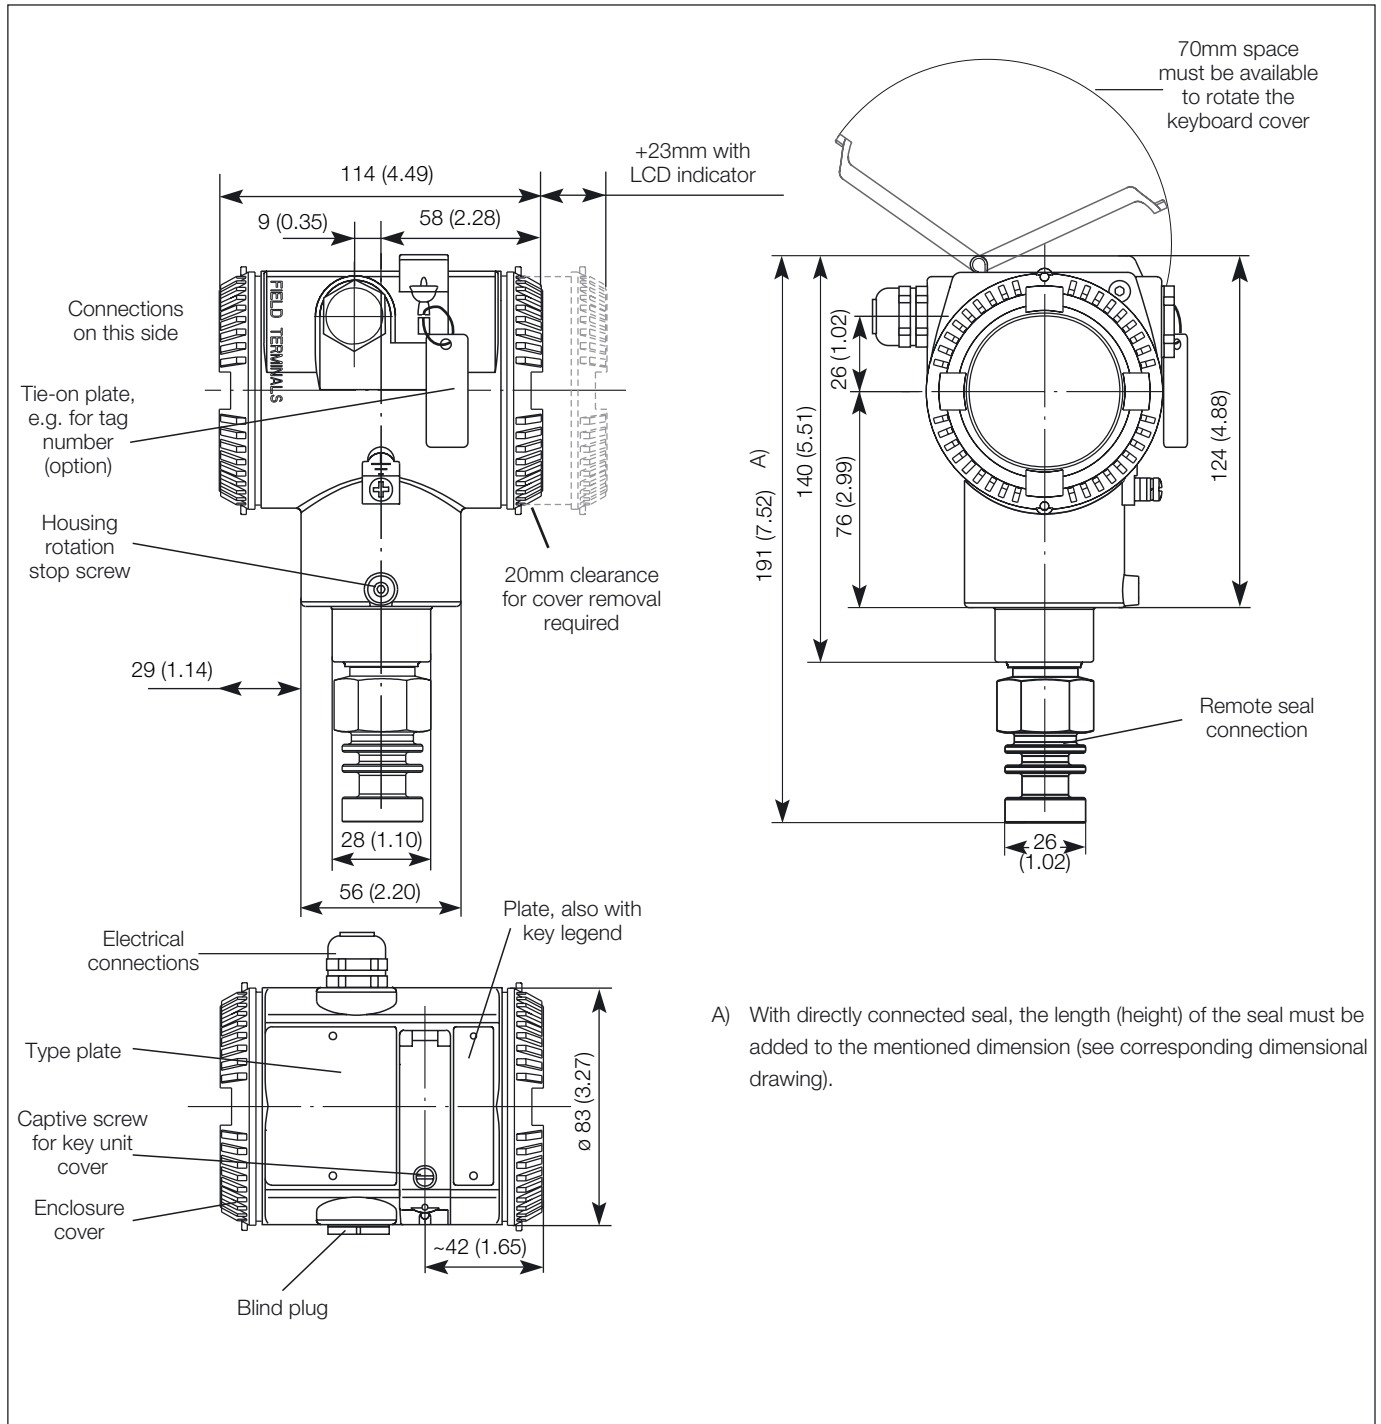

MOUNTING DIMENSIONS (not for construction unless certified) - dimensions in mm (in)

Transmitter with DIN-type amplifier housing

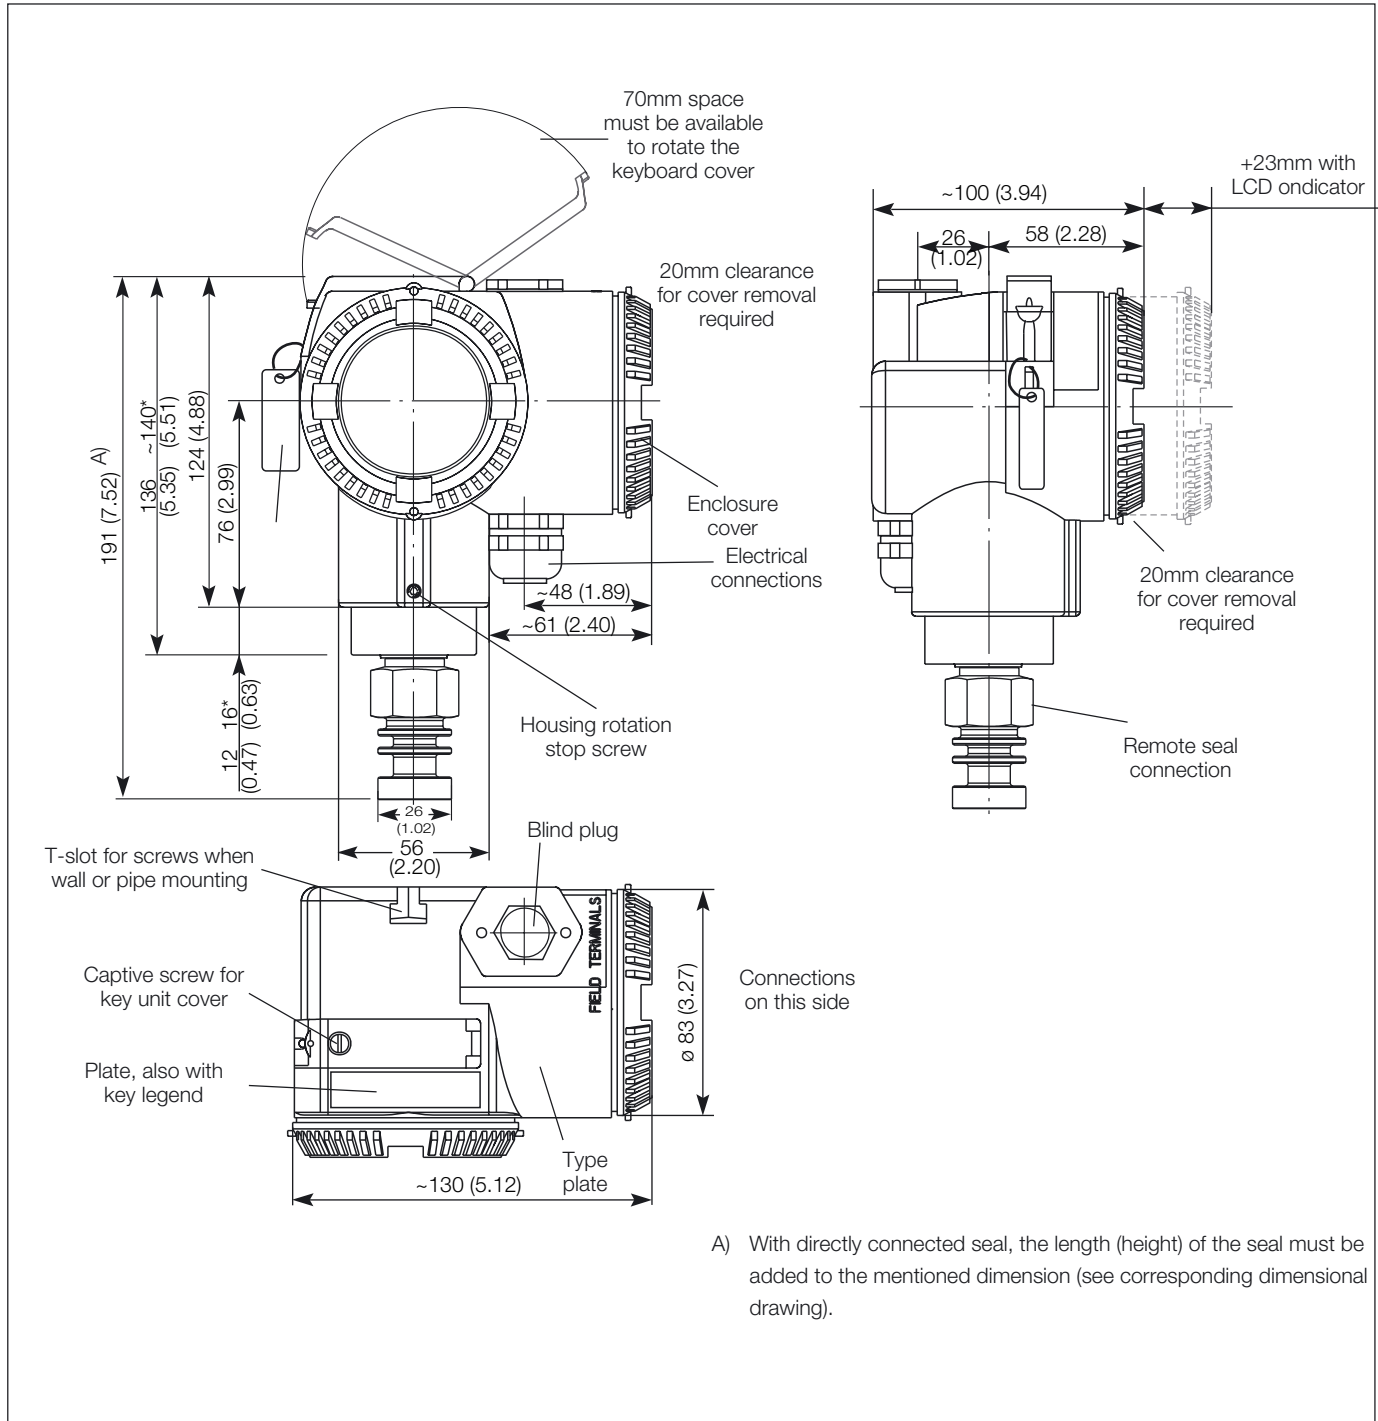

Electrical connections

Standard Terminal block and fieldbus connector versions

7/8in connector

M12 x 1 connector

PIN (male) IDENTIFICATION		
	FOUNDATION Fieldbus	PROFIBUS PA
1	FF-	PA+
2	FF+	GROUND
3	SHIELD	PA-
4	GROUND	SHIELD

Mating female plug NOT SUPPLIED

Harting Han 8U connector

89 (3.5)

Harting pin identification
(view onto socket)

26 (1.02)

BASIC ORDERING INFORMATION model 265GR Gauge Pressure Transmitter with remote seal

Select one character or set of characters from each category and specify complete catalog number.
 Refer to additional ordering information code and specify one or more codes for each transmitter if additional options are required.
 Quote separately one seal as required. FOR ORDER NUMBER OF REMOTE SEAL REFER TO DATA SHEET SS/S265.

BASE MODEL – 1 st to 5 th characters				2	6	5	G	R	X	X	X	X
Gauge Pressure Transmitter with remote seal – BASE ACCURACY 0.04%												
SENSOR - Range / max Span – 6th character (Refer to table pag. 2 and 3)												
6kPa	60mbar	24inH ₂ O							C			
40kPa	400mbar	160inH ₂ O							F			
250kPa	2500mbar	1000inH ₂ O							L			
1000kPa	10bar	145psi							D			
3000kPa	30bar	435psi							U			
10000kPa	100bar	1450psi							R			
60000 kPa	600bar	8700psi							V			
Diaphragm material / Fill fluid (wetted parts) – 7th character												
Hastelloy C276™	Silicone oil	with remote seal	(Note 1)						NACE	R		
Hastelloy C276™	Inert fluid	with remote seal	(Note 1)						NACE	2		
Ceramic	No filling	with remote seal	(Note 2)						NACE	3		
Housing material and electrical connection – 8th character												
Aluminium alloy (Barrel version)		1/2 – 14 NPT										A
Aluminium alloy (Barrel version)		M20 x 1.5 (CM 20)	(Not available FM, CSA)									B
Aluminium alloy (Barrel version)		Harting Han 8U connector	(Not available ATEX EExd, FM, CSA)				(Note 3)					E
Aluminium alloy (Barrel version)		Fieldbus connector	(Not available ATEX EExd, FM, CSA)				(Note 3)					G
AISI 316 L ss (Barrel version)		1/2 – 14 NPT										S
AISI 316 L ss (Barrel version)		M20 x 1.5 (CM 20)	(Not available FM, CSA)									T
Aluminium alloy (DIN version)		M20 x 1.5 (CM 20)	(Not available FM, CSA)									J
Aluminium alloy (DIN version)		Harting Han 8U connector	(Not available ATEX EExd, FM, CSA)				(Note 3)					K
Aluminium alloy (DIN version)		Fieldbus connector	(Not available ATEX EExd, FM, CSA)				(Note 3)					W
Output/Additional options – 9th character												
HART digital communication and 4 to 20mA		No additional options	(Note 4, 5)									H
HART digital communication and 4 to 20mA		Options requested (to be ordered by "Additional ordering code")	(Note 4)									1
PROFIBUS PA		No additional options	(Note 4, 5)									P
PROFIBUS PA		Options requested (to be ordered by "Additional ordering code")	(Note 5)									2
FOUNDATION Fieldbus		No additional options	(Note 4, 5)									F
FOUNDATION Fieldbus		Options requested (to be ordered by "Additional ordering code")	(Note 5)									3

ADDITIONAL ORDERING INFORMATION for model 265GR

Add one or more 2-digit code(s) after the basic ordering information to select all required options

	XX	XX	XX	XX	XX	XX	XX	XX	XX
Electrical certification									
ATEX Group II Category 1/2 GD – Intrinsic Safety EEx ia	E1								
ATEX Group II Category 1/2 G – Flameproof EEx d (Note 1)	E2								
ATEX Group II Category 3 GD – Type of protection "N" EEx nL energy limited	E3								
Factory Mutual (FM) – Intrinsically Safe	EA								
Factory Mutual (FM) – Explosion Proof (only with 1/2 – 14 NPT electrical connection and SS label) (Note 1)	EB								
Canadian Standard Association – Intrinsically Safe (pending)	ED								
Canadian Standard Association – Explosion Proof (Note 1)	EE								
Integral LCD									
Digital LCD integral display	L1								
Backlit digital LCD integral display	L2								
Mounting bracket (shape and material)									
For pipe mounting AISI 316 L ss								B2	
For wall mounting AISI 316 L ss								B4	
Surge									
Surge/Transient Protector (Note 6)								S1	
Operating manual									
German								M1	
Labels & tag language									
German in stainless steel (not available with DIN Electronic Housing code J, K, W)								T1	
German and English plastic (not suitable for Factory Mutual - Explosion Proof)								TA	
Additional tag plate									
In stainless steel								I1	
Certificates									
Inspection certificate EN 10204–3.1.B of calibration								C1	
Inspection certificate EN 10204–3.1.B of the cleanliness stage according to DIN 25410								C3	
Inspection certificate EN 10204–3.1.B of helium leakage test of the sensor module								C4	
Inspection certificate EN 10204–3.1.B of the pressure test								C5	
Certificate of compliance with the order EN 10204–2.1 of instrument design								C6	
SIL2 - classification								CL	
Material traceability									
Certificate of compliance with the order EN 10204–2.1 of process wetted parts								H1	
Inspection certificate EN 10204–3.1.B of process wetted parts (small parts with certificate of compliance EN 10204)								H3	
Test report EN 10204-2.2 of the pressure bearing and process wetted parts								H4	
Connector									
Fieldbus 7/8in (without mating female plug) Recommended for FOUNDATION Fieldbus							(Notes 5, 7)	U1	
Fieldbus M12x1 (without mating female plug) Recommended for PROFIBUS PA							(Notes 5, 7)	U2	
Harting Han 8U – straight entry							(Notes 4, 7)	U3	
Harting Han 8U – angle entry							(Notes 4, 8)	U4	

2600T Pressure Transmitters

Model 265GR, 265AR

SS/265GR/AR-EN_03

Note 1: Not available with Sensor code C, F

Note 2: Not available with Sensor code L, D, U, R, V

Note 3: Select type in additional ordering code

Note 4: Not available with Electronic Housing code G, W

Note 5: Not available with Electronic Housing code E, K

Note 6: Not available with ATEX-EEEx nL (code E3) or PROFIBUS PA / FOUNDATION Fieldbus (code 2 or 3) with Intrinsic Safety EEx i (code E1) or FM-Intrinsically Safe (code EA).

Note 7: Not available with Electronic housing code T, S, A, B, J, E

Note 8: Not available with Electronic housing code T, S, A, B, J, K

™ Hastelloy is a Cabot Corporation trademark

Standard delivery items (can be differently specified by additional ordering code)

- General purpose (no Ex design)
- No meter/display, no mounting bracket, no surge protection
- English manual and labels (stainless steel nameplate for Barrel housing code A, B, E, G, S, T; plastic nameplate for DIN housing code J, K, W)
- Configuration with kPa and deg. C units
- No test, inspection or material traceability certificates

THE SELECTION OF SUITABLE WETTED PARTS AND FILLING FLUID FOR COMPATIBILITY WITH THE PROCESS MEDIA IS A CUSTOMER'S RESPONSIBILITY, IF NOT OTHERWISE NOTIFIED BEFORE MANUFACTURING.

BASIC ORDERING INFORMATION model 265AR Absolute Pressure Transmitter with remote seal

Select one character or set of characters from each category and specify complete catalog number.

Refer to additional ordering information code and specify one or more codes for each transmitter if additional options are required.

Quote separately one seal as required. FOR ORDER NUMBER OF REMOTE SEAL REFER TO DATA SHEET SS/S265.

BASE MODEL – 1 st to 5 th characters				2	6	5	A	R	X	X	X	X
Absolute Pressure Transmitter with remote seal – BASE ACCURACY 0.04%												
SENSOR - Range / max Span – 6th character (Refer to table pag. 2 and 3)												
40kPa	400mbar		300mmHg						F			
250kPa	2500mbar		1875mmHg						L			
1000kPa	10bar		145psi						D			
3000kPa	30bar		435psi						U			
Diaphragm material / Fill fluid (wetted parts) – 7th character												
Hastelloy C276™	Silicone oil	with remote seal	(Note 1)					NACE	R			
Hastelloy C276™	Inert fluid	with remote seal	(Note 1)					NACE	2			
Ceramic	No filling	with remote seal	(Note 2)					NACE	3			
Housing material and electrical connection – 8th character												
Aluminium alloy (Barrel version)		1/2 – 14 NPT										A
Aluminium alloy (Barrel version)		M20 x 1.5 (CM 20)	(Not available FM, CSA)									B
Aluminium alloy (Barrel version)		Harting Han 8U connector	(Not available ATEX EExd, FM, CSA)				(Note 3)					E
Aluminium alloy (Barrel version)		Fieldbus connector	(Not available ATEX EExd, FM, CSA)				(Note 3)					G
AISI 316 L ss (Barrel version)		1/2 – 14 NPT										S
AISI 316 L ss (Barrel version)		M20 x 1.5 (CM 20)	(Not available FM, CSA)									T
Aluminium alloy (DIN version)		M20 x 1.5 (CM 20)	(Not available FM, CSA)									J
Aluminium alloy (DIN version)		Harting Han 8U connector	(Not available ATEX EExd, FM, CSA)				(Note 3)					K
Aluminium alloy (DIN version)		Fieldbus connector	(Not available ATEX EExd, FM, CSA)				(Note 3)					W
Output/Additional options – 9th character												
HART digital communication and 4 to 20mA		No additional options	(Note 4, 5)									H
HART digital communication and 4 to 20mA		Options requested (to be ordered by "Additional ordering code")	(Note 4)									1
PROFIBUS PA		No additional options	(Note 4, 5)									P
PROFIBUS PA		Options requested (to be ordered by "Additional ordering code")	(Note 5)									2
FOUNDATION Fieldbus		No additional options	(Note 4, 5)									F
FOUNDATION Fieldbus		Options requested (to be ordered by "Additional ordering code")	(Note 5)									3

ADDITIONAL ORDERING INFORMATION for model 265AR

Add one or more 2-digit code(s) after the basic ordering information to select all required options

	XX	XX	XX	XX	XX	XX	XX	XX	XX
Electrical certification									
ATEX Group II Category 1/2 GD – Intrinsic Safety EEx ia	E1								
ATEX Group II Category 1/2 G – Flameproof EEx d (Note 1)	E2								
ATEX Group II Category 3 GD – Type of protection "N" EEx nL energy limited	E3								
Factory Mutual (FM) – Intrinsically Safe	EA								
Factory Mutual (FM) – Explosion Proof (only with 1/2 – 14 NPT electrical connection and SS label) (Note 1)	EB								
Canadian Standard Association – Intrinsically Safe (pending)	ED								
Canadian Standard Association – Explosion Proof (Note 1)	EE								
Integral LCD									
Digital LCD integral display	L1								
Backlit digital LCD integral display	L2								
Mounting bracket (shape and material)									
For pipe mounting AISI 316 L ss								B2	
For wall mounting AISI 316 L ss								B4	
Surge									
Surge/Transient Protector (Note 6)								S1	
Operating manual									
German								M1	
Labels & tag language									
German in stainless steel (not available with DIN Electronic Housing code J, K, W)								T1	
German and English plastic (not suitable for Factory Mutual - Explosion Proof)								TA	
Additional tag plate									
In stainless steel								I1	
Certificates									
Inspection certificate EN 10204–3.1.B of calibration								C1	
Inspection certificate EN 10204–3.1.B of the cleanliness stage according to DIN 25410								C3	
Inspection certificate EN 10204–3.1.B of helium leakage test of the sensor module								C4	
Inspection certificate EN 10204–3.1.B of the pressure test								C5	
Certificate of compliance with the order EN 10204–2.1 of instrument design								C6	
SIL2 - classification								CL	
Material traceability									
Certificate of compliance with the order EN 10204–2.1 of process wetted parts								H1	
Inspection certificate EN 10204–3.1.B of process wetted parts (small parts with certificate of compliance EN 10204)								H3	
Test report EN 10204-2.2 of the pressure bearing and process wetted parts								H4	
Connector									
Fieldbus 7/8in (without mating female plug) Recommended for FOUNDATION Fieldbus							(Notes 5, 7)	U1	
Fieldbus M12x1 (without mating female plug) Recommended for PROFIBUS PA							(Notes 5, 7)	U2	
Harting Han 8U – straight entry							(Notes 4, 7)	U3	
Harting Han 8U – angle entry							(Notes 4, 8)	U4	

- Note 1: Not available with Sensor code F
- Note 2: Not available with Sensor code L, D, U
- Note 3: Select type in additional ordering code
- Note 4: Not available with Electronic Housing code G, W
- Note 5: Not available with Electronic Housing code E, K
- Note 6: Not available with ATEX-EEEx nL (code E3) or PROFIBUS PA / FOUNDATION Fieldbus (code 2 or 3) with Intrinsic Safety EEx i (code E1) or FM-Intrinsically Safe (code EA).
- Note 7: Not available with Electronic housing code T, S, A, B, J, E
- Note 8: Not available with Electronic housing code T, S, A, B, J, K

™ Hastelloy is a Cabot Corporation trademark

Standard delivery items (can be differently specified by additional ordering code)

- General purpose (no Ex design)
- No meter/display, no mounting bracket, no surge protection
- English manual and labels (stainless steel nameplate for Barrel housing code A, B, E, G, S, T; plastic nameplate for DIN housing code J, K, W)
- Configuration with kPa and deg. C units
- No test, inspection or material traceability certificates

THE SELECTION OF SUITABLE WETTED PARTS AND FILLING FLUID FOR COMPATIBILITY WITH THE PROCESS MEDIA IS A CUSTOMER'S RESPONSIBILITY, IF NOT OTHERWISE NOTIFIED BEFORE MANUFACTURING.

Contact us

ABB Ltd.

Process Automation

Howard Road, St. Neots
Cambridgeshire, PE19 8EU
UK

Phone: +44 (0)1480 475321

Fax: +44 (0)1480 217948

ABB Inc.

Process Automation

125 E. County Line Road
Warminster PA 18974
USA

Phone: +1 215 674 6000

Fax: +1 215 674 7183

ABB Automation Products GmbH

Process Automation

Schillerstr. 72
32425 Minden
Germany

Phone: +49 551 905-534

Fax: +49 551 905-555

www.abb.com

Note

We reserve the right to make technical changes or modify the contents of this document without prior notice. With regard to purchase orders, the agreed particulars shall prevail. ABB does not accept any responsibility whatsoever for potential errors or possible lack of information in this document.

We reserve all rights in this document and in the subject matter and illustrations contained therein. Any reproduction, disclosure to third parties or utilization of its contents – in whole or in parts – is forbidden without prior written consent of ABB.

Copyright© 2011 ABB

All rights reserved

3KXP200021R1001