


NOTES:

1. WARNING: This drawing does not illustrate completely the installation methods required for hazardous locations. Prior to any installation in a Classified Hazardous Location, verify installation methods by the Control Drawing referenced on the product's name tag and national and local codes.

Plug in modules with smooth side of the module on the left which puts pin 1 on the bottom.

RS-232 Communications Module  
Totalflow P/N 2015192-001/002

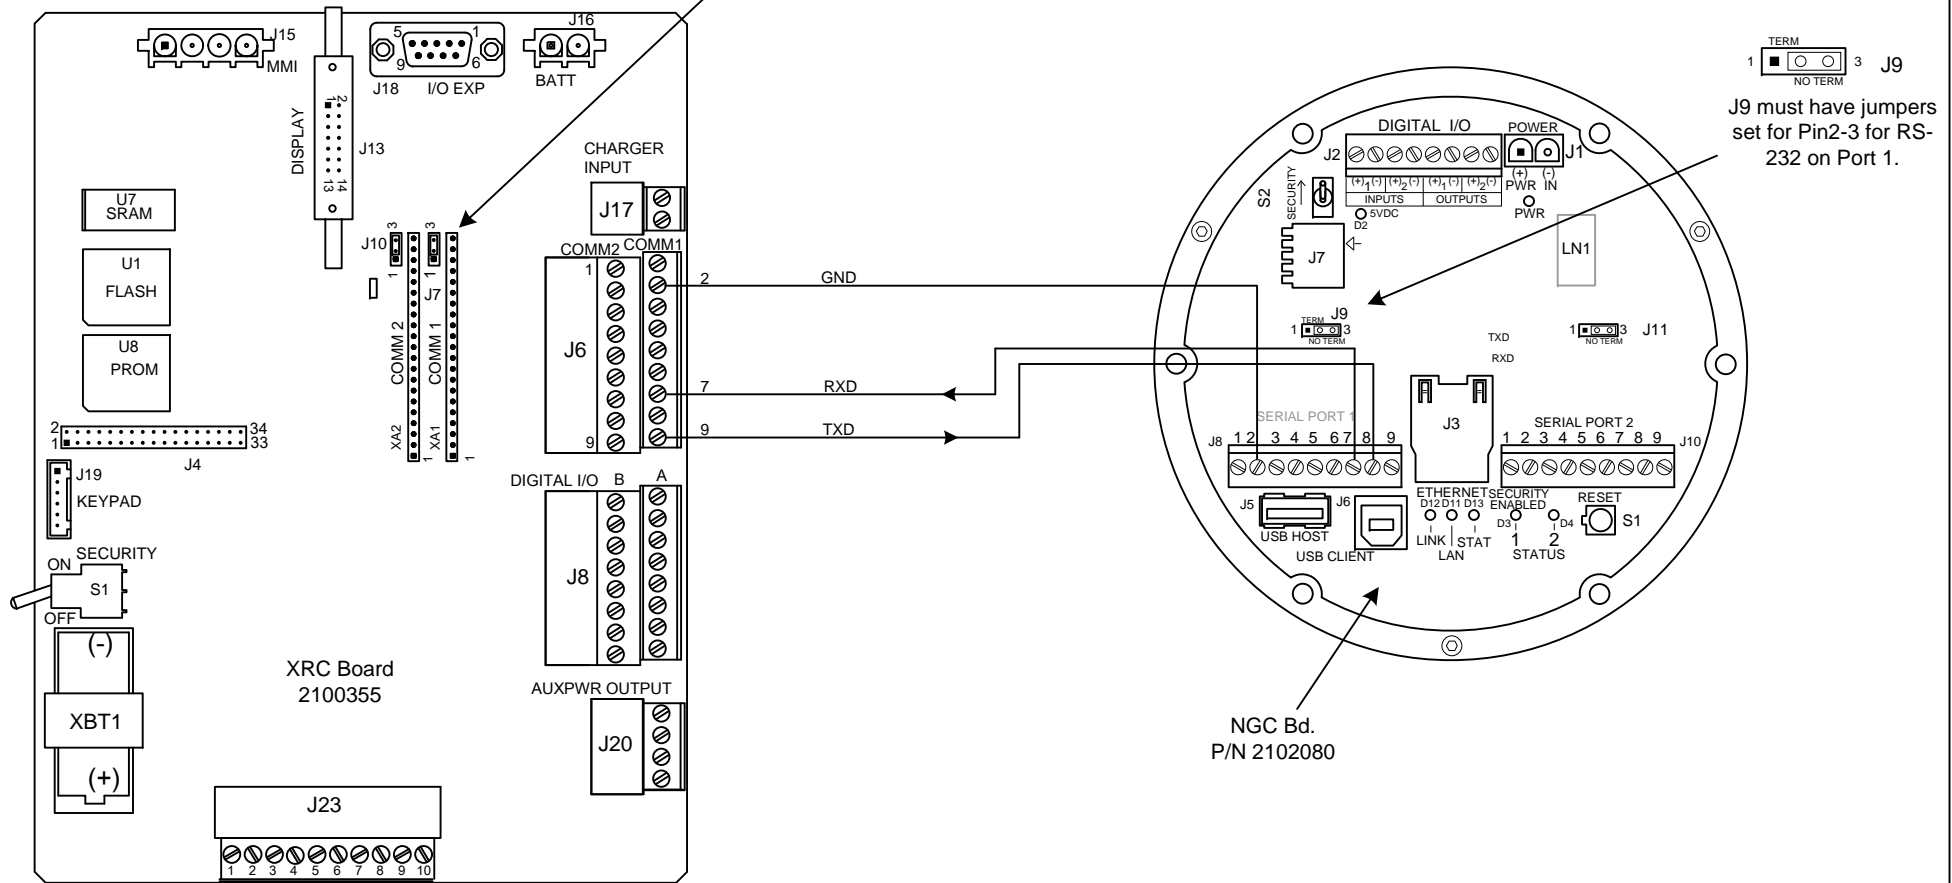

REF: N/A

	TOTALFLOW Products	ACTION L21020	DOC TYPE UD	TITLE XRC (2100355 BD) COMM1 (RS-232) TO NGC PORT1 (RS-232)	DWG NO. 2103678	REV AA	SHEET 1 OF 1