


Flow chart selection of MO surge arresters

for medium-voltage 3-phase a.c. systems

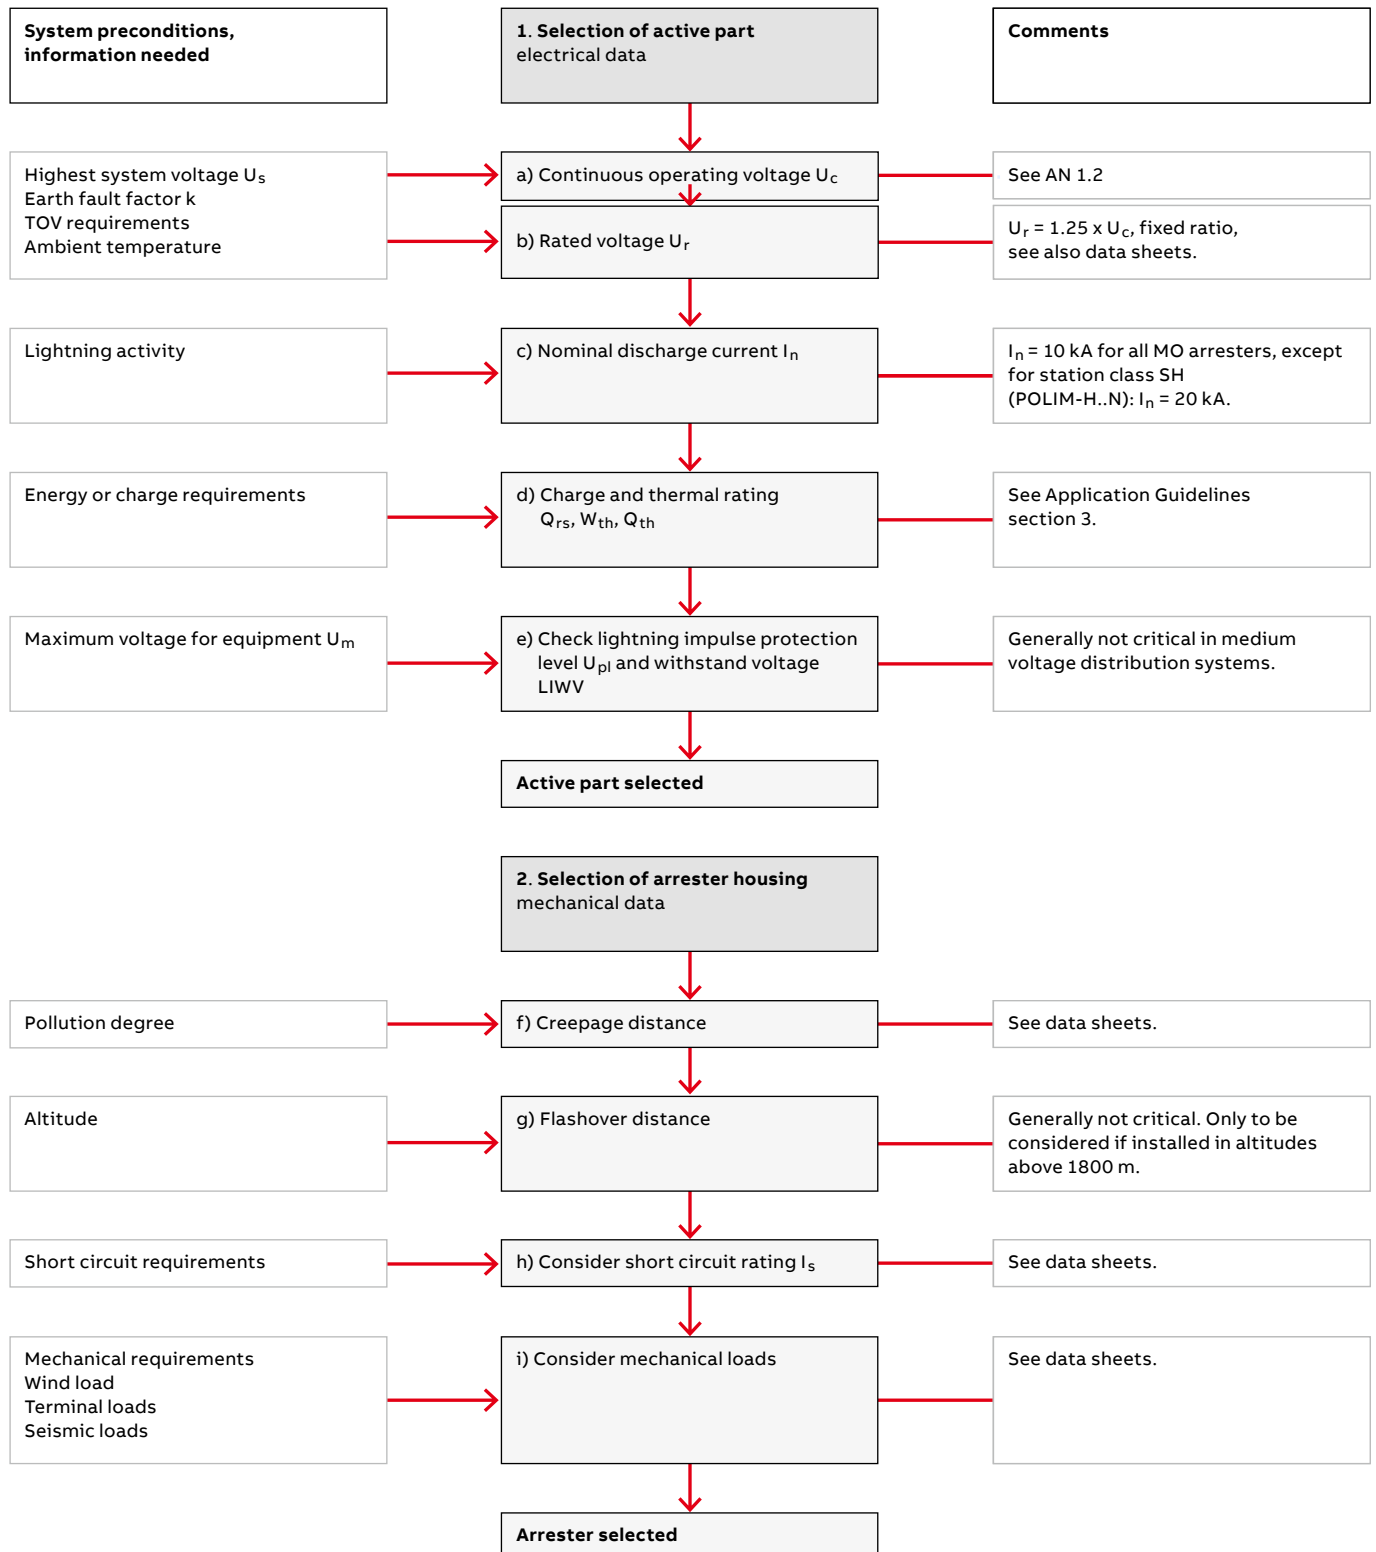

The APPLICATION NOTES (AN) are intended to be used in conjunction with the

APPLICATION GUIDELINES

Overvoltage protection

Metal-oxide surge arresters in medium-voltage systems.

Each APPLICATION NOTE gives in a concentrated form additional and more detailed information for the selection and application of MO surge arresters in general or for a specific equipment.

First published October 2018

—

ABB Switzerland Ltd.

PGHV
Surge Arresters
Jurastrasse 45
CH-5430 Wettingen/Switzerland
Tel. + 41 58585 2911
Fax + 41 58585 5570
Email: sales.sa@ch.abb.com

abb.com/arrestersonline

Additional information

We reserve the right to make technical changes or modify the content of this document without prior notice. With regard to purchase orders, the agreed particulars shall prevail. ABB AG does not accept any responsibility whatsoever for potential errors or possible lack of information in this document.

We reserve all rights in this document and in the subject matter and illustrations contained therein. Any reproduction, disclosure to third parties or utilization of its contents – in whole or in parts – is forbidden without prior written consent of ABB AG.