



Relion® 615 series

Feeder Protection and Control REF615 IEC 60870-5-103 Point List Manual

Power and productivity
for a better world™





Document ID: 1MRS756712
 Issued: 2013-02-21
 Revision: E
 Product version: 4.0 FP1

© Copyright 2013 ABB. All rights reserved

Copyright

This document and parts thereof must not be reproduced or copied without written permission from ABB, and the contents thereof must not be imparted to a third party, nor used for any unauthorized purpose.

The software or hardware described in this document is furnished under a license and may be used, copied, or disclosed only in accordance with the terms of such license.

Trademarks

ABB and Relion are registered trademarks of the ABB Group. All other brand or product names mentioned in this document may be trademarks or registered trademarks of their respective holders.

Warranty

Please inquire about the terms of warranty from your nearest ABB representative.

<http://www.abb.com/substationautomation>

Disclaimer

The data, examples and diagrams in this manual are included solely for the concept or product description and are not to be deemed as a statement of guaranteed properties. All persons responsible for applying the equipment addressed in this manual must satisfy themselves that each intended application is suitable and acceptable, including that any applicable safety or other operational requirements are complied with. In particular, any risks in applications where a system failure and/or product failure would create a risk for harm to property or persons (including but not limited to personal injuries or death) shall be the sole responsibility of the person or entity applying the equipment, and those so responsible are hereby requested to ensure that all measures are taken to exclude or mitigate such risks.

This document has been carefully checked by ABB but deviations cannot be completely ruled out. In case any errors are detected, the reader is kindly requested to notify the manufacturer. Other than under explicit contractual commitments, in no event shall ABB be responsible or liable for any loss or damage resulting from the use of this manual or the application of the equipment.

Conformity

This product complies with the directive of the Council of the European Communities on the approximation of the laws of the Member States relating to electromagnetic compatibility (EMC Directive 2004/108/EC) and concerning electrical equipment for use within specified voltage limits (Low-voltage directive 2006/95/EC). This conformity is the result of tests conducted by ABB in accordance with the product standards EN 50263 and EN 60255-26 for the EMC directive, and with the product standards EN 60255-1 and EN 60255-27 for the low voltage directive. The product is designed in accordance with the international standards of the IEC 60255 series.

Table of contents

Section 1	Introduction.....	5
	This manual.....	5
	Intended audience.....	5
	Product documentation.....	5
	Product documentation set.....	5
	Document revision history.....	6
	Related documentation.....	6
	Symbols and conventions.....	7
	Symbols.....	7
	Document conventions.....	7
	Functions, codes and symbols.....	8
Section 2	IEC 60870-5-103 data mappings.....	11
	Overview.....	11
	Supported functions.....	11
	Indications and controls.....	13
	General Data(FUN=0) IEC 60870-5-103 standard.....	14
	General Data(FUN=0) IEC 60870-5-103 standard - AR data.....	14
	General Data(FUN=10) - 615-specific.....	14
	LD0.MVGAPC1 Multipurpose binary inputs (1).....	15
	LD0.MVGAPC2 Multipurpose binary inputs (2).....	16
	LD0.SRGAPC1 Multipurpose binary outputs - flip-flop resets (1).....	16
	LD0.SRGAPC2 Multipurpose binary outputs - flip-flop resets (2).....	16
	LD0.SPCGGIO1 Multipurpose binary outputs (1).....	17
	LD0.SPCGGIO2 Multipurpose binary outputs (2).....	17
	LD0.NSPTOC1 Negative-sequence overcurrent protection (1).....	18
	LD0.NSPTOC2 Negative-sequence overcurrent protection (2).....	18
	LD0.SEQRFUF1 Fuse failure protection.....	19
	CTRL.CCRDIF1 Current circuit failure protection.....	19
	LD0.EFPADM1 Admittance-based earth-fault protection (1).....	19
	LD0.EFPADM2 Admittance-based earth-fault protection (2).....	19
	LD0.EFPADM3 Admittance-based earth-fault protection (3).....	19

Table of contents

LD0.SECRSYN1 Synchrocheck indications	20
LD0.FRPFRQ1 Frequency protection (1).....	20
LD0.FRPFRQ2 Frequency protection (2).....	20
LD0.FRPFRQ3 Frequency protection (3).....	21
LD0.DPHHPDOC1 Three-phase directional overcurrent protection - high stage (1).....	21
LD0.DPHLPDOC2 Three-phase directional overcurrent protection - low stage (2).....	21
LD0.DPHLPDOC1 Three-phase directional overcurrent protection - low stage (1).....	22
LD0.PHPTOV3 Phase overvoltage protection - stage 3.....	22
LD0.PHPTOV2 Phase overvoltage protection - stage 2.....	22
LD0.PHPTOV1 Phase overvoltage protection - stage 1.....	23
LD0.PHPTUV3 Phase undervoltage protection - stage 3.....	23
LD0.PHPTUV2 Phase undervoltage protection - stage 2.....	23
LD0.PHPTUV1 Phase undervoltage protection - stage 1.....	24
LD0.PSPTUV1 Positive-sequence undervoltage protection - stage 1.....	24
LD0.NSPTOV1 Negative-sequence overvoltage protection - stage 1.....	24
LD0.ROVPTOV1 Residual overvoltage protection - stage 1.....	24
LD0.ROVPTOV2 Residual overvoltage protection - stage 2.....	25
LD0.ROVPTOV3 Residual overvoltage protection - stage 3.....	25
LD0.XGGIO130 Physical binary I/O signals (status only).....	25
LD0.XGGIO120 Physical binary I/O signals (status only).....	25
LD0.XGGIO110 Physical binary I/O signals (status only).....	26
LD0.XGGIO100 Physical binary I/O signals (status only).....	26
LD0.XAGGIO130 Physical binary I/O signals (status only).....	26
LD0.CMHAI1 Power quality - current total demand distortion.....	27
LD0.VMHAI1 Power quality - voltage total harmonic distortion.....	27
LD0.PH1QVVR1 Power quality - voltage variation.....	27
LD0.WPWDE1 Wattmetric-based earth-fault protection - stage 1.....	27
LD0.WPWDE2 Wattmetric-based earth-fault protection - stage 2.....	28
LD0.WPWDE3 Wattmetric-based earth-fault protection - stage 3.....	28
LD0.HAEFPTOC1 Harmonics-based earth-fault protection	28
LD0.ARCSARC1 Fault arc protection - stage 1.....	28
LD0.ARCSARC2 Fault arc protection - stage 2.....	29
LD0.ARCSARC3 Fault arc protection - stage 3.....	29
LD0.PDNSPTOC1 Phase discontinuity protection.....	29

LD0.INTRPTEF1 Transient/intermittent earth-fault protection.....	29
LD0.EFLPTOC1 Non-directional earth-fault and sensitive earth-fault protection - low stage 1.....	30
LD0.EFLPTOC2 Non-directional earth-fault and sensitive earth-fault protection - low stage 2.....	30
LD0.EFHPTOC1 Non-directional earth-fault and sensitive earth-fault protection - high stage 1.....	30
LD0.EFIPTOC1 Non-directional earth-fault and sensitive earth-fault protection - instantaneous stage 1.....	30
LD0.PHIPTOC1 Phase overcurrent protection - instantaneous stage 1	31
LD0.PHHPTOC2 Phase overcurrent protection - high stage 2	31
LD0.PHHPTOC1 Phase overcurrent protection - high stage 1.....	31
LD0.PHLPTOC1 Phase overcurrent protection - low stage 1.....	32
LD0.DEFLPDEF1 Directional earth-fault protection - low stage 1.....	32
LD0.DEFLPDEF2 Directional earth-fault protection - low stage 2.....	32
LD0.DEFHPDEF1 Directional earth-fault protection - high stage 1.....	32
LD0.INPHAR1 Three-phase inrush detection.....	33
LD0.T1PTTR1 Thermal overload protection (1).....	33
LD0.DARREC1 Autorecloser.....	33
LD0.CMMXU1 Phase currents (1) limit supervision.....	34
LD0.RESCMMXU1 Residual current (1) limit supervision.....	34
LD0.VMMXU1 Phase voltage (1) limit supervision.....	34
LD0.RESVMMXU1 Residual voltage (1) limit supervision.....	35
CTRL.Cxxxxx1 Circuit breaker (1) CB object and failure protection.....	35
LD0.SSCBR1 Circuit breaker (1) condition monitoring.....	35
CTRL.DCXSWI1 Disconnecter (1) - controllable object.....	36
CTRL.DCXSWI2 Disconnecter (2) - controllable object.....	36
CTRL.ESXSWI1 Earth switch - controllable object.....	37
CTRL.DCSXSWI1 Disconnecter (1) - non-controllable object.....	37
CTRL.DCSXSWI2 Disconnecter (2) - non-controllable object.....	37
CTRL.DCSXSWI3 Disconnecter (3) - non-controllable object.....	37
CTRL.ESSXSWI1 Earth switch (1) - non-controllable object.....	38

	CTRL.ESSXSWI2 Earth switch (2) - non-controllable object.....	38
	LD0.LEDGGIO1 LHMI LED indications Type 1 (2 states).....	38
	LD0.LEDGGIO1 LHMI LED indications Type 2 (3 states).....	38
	Class 2 data measurands.....	39
	Class 2 private measurand data (6 and 7).....	40
Section 3	Interoperability profile for 615 series IEC 60870-5-103.....	43
	Physical layer.....	43
	Electrical interface.....	43
	Optical interface.....	43
	Transmission speed.....	43
	Link layer.....	43
	Application layer.....	44
	Transmission mode for application data.....	44
	COMMON ADDRESS of ASDU.....	44
	Selection of standard information numbers in monitor direction.....	44
	System functions in monitor directions.....	44
	Status indications in monitor direction.....	44
	Supervision indications in monitor direction.....	45
	Earth fault indications in monitor direction.....	45
	Fault indications in monitor direction.....	45
	Auto-reclosure indications in monitor direction.....	46
	Measurands in monitor direction.....	47
	Generic functions in monitor direction.....	47
	Selection of standard information numbers in control direction.....	47
	System functions in control direction.....	47
	Generic functions in monitor direction.....	47
	Basic application functions.....	48
	Miscellaneous.....	48
Section 4	Glossary.....	49

Section 1 Introduction

1.1 This manual

The point list manual describes the outlook and properties of the data points specific to the IED. The manual should be used in conjunction with the corresponding communication protocol manual.

1.2 Intended audience

This manual addresses the communication system engineer or system integrator responsible for pre-engineering and engineering for communication setup in a substation from an IED perspective.

The system engineer or system integrator must have a basic knowledge of communication in protection and control systems and thorough knowledge of the specific communication protocol.

1.3 Product documentation

1.3.1 Product documentation set

The application manual contains application descriptions and setting guidelines sorted per function. The manual can be used to find out when and for what purpose a typical protection function can be used. The manual can also be used when calculating settings.

The communication protocol manual describes a communication protocol supported by the IED. The manual concentrates on vendor-specific implementations.

The engineering guide provides information for IEC 61850 engineering of the protection IEDs with PCM600 and IET600. This guide concentrates especially on the configuration of GOOSE communication with these tools. The guide can be used as a technical reference during the engineering phase, installation and commissioning phase, and during normal service. For more details on tool usage, see the PCM600 documentation.

The engineering manual contains instructions on how to engineer the IEDs using the different tools in PCM600. The manual provides instructions on how to set up a PCM600 project and insert IEDs to the project structure. The manual also

recommends a sequence for engineering of protection and control functions, LHMI functions as well as communication engineering for IEC 61850 and other supported protocols.

The installation manual contains instructions on how to install the IED. The manual provides procedures for mechanical and electrical installation. The chapters are organized in chronological order in which the IED should be installed.

The operation manual contains instructions on how to operate the IED once it has been commissioned. The manual provides instructions for monitoring, controlling and setting the IED. The manual also describes how to identify disturbances and how to view calculated and measured power grid data to determine the cause of a fault.

The point list manual describes the outlook and properties of the data points specific to the IED. The manual should be used in conjunction with the corresponding communication protocol manual.

The technical manual contains application and functionality descriptions and lists function blocks, logic diagrams, input and output signals, setting parameters and technical data sorted per function. The manual can be used as a technical reference during the engineering phase, installation and commissioning phase, and during normal service.

1.3.2

Document revision history

Document revision/date	Product version	History
A/2009-03-04	2.0	First release
B/2009-07-03	2.0	Content updated
C/2010-06-11	3.0	Content updated to correspond to the product version
D/2012-05-11	4.0	Content updated to correspond to the product version
E/2013-02-21	4.0 FP1	Content updated to correspond to the product series version



Download the latest documents from the ABB Website
<http://www.abb.com/substationautomation>.

1.3.3

Related documentation

Name of the document	Document ID
IEC 60870-5-103 Communication Protocol Manual	1MRS756710

1.4 Symbols and conventions

1.4.1 Symbols



The caution icon indicates important information or warning related to the concept discussed in the text. It might indicate the presence of a hazard which could result in corruption of software or damage to equipment or property.



The information icon alerts the reader of important facts and conditions.



The tip icon indicates advice on, for example, how to design your project or how to use a certain function.

Although warning hazards are related to personal injury, it is necessary to understand that under certain operational conditions, operation of damaged equipment may result in degraded process performance leading to personal injury or death. Therefore, comply fully with all warning and caution notices.

1.4.2 Document conventions

A particular convention may not be used in this manual.

- Abbreviations and acronyms in this manual are spelled out in the glossary. The glossary also contains definitions of important terms.
- Push-button navigation in the LHMI menu structure is presented by using the push-button icons.
To navigate between the options, use  and .
- HMI menu paths are presented in bold.
Select **Main menu/Settings**.
- LHMI messages are shown in Courier font.
To save the changes in non-volatile memory, select Yes and press .
- Parameter names are shown in italics.
The function can be enabled and disabled with the *Operation* setting.
- Parameter values are indicated with quotation marks.
The corresponding parameter values are "On" and "Off".
- IED input/output messages and monitored data names are shown in Courier font.
When the function starts, the *START* output is set to TRUE.

1.4.3 Functions, codes and symbols

Table 1: REF615 functions, codes and symbols

Function	IEC 61850	IEC 60617	IEC-ANSI
Protection			
Three-phase non-directional overcurrent protection, low stage	PHLPTOC1	3I> (1)	51P-1 (1)
Three-phase non-directional overcurrent protection, high stage	PHHPTOC1	3I>> (1)	51P-2 (1)
	PHHPTOC2	3I>> (2)	51P-2 (2)
Three-phase non-directional overcurrent protection, instantaneous stage	PHIPTOC1	3I>>> (1)	50P/51P (1)
Three-phase directional overcurrent protection, low stage	DPHLPDOC1	3I> -> (1)	67-1 (1)
	DPHLPDOC2	3I> -> (2)	67-1 (2)
Three-phase directional overcurrent protection, high stage	DPHHPDOC1	3I>> ->	67-2
Non-directional earth-fault protection, low stage	EFLPTOC1	Io> (1)	51N-1 (1)
	EFLPTOC2	Io> (2)	51N-1 (2)
Non-directional earth-fault protection, high stage	EFHPTOC1	Io>> (1)	51N-2 (1)
Non-directional earth-fault protection, instantaneous stage	EFIPTOC1	Io>>>	50N/51N
Directional earth-fault protection, low stage	DEFLPDEF1	Io> -> (1)	67N-1 (1)
	DEFLPDEF2	Io> -> (2)	67N-1 (2)
Directional earth-fault protection, high stage	DEFHPDEF1	Io>> ->	67N-2
Admittance based earth-fault protection	EFPADM1	Yo> -> (1)	21YN (1)
	EFPADM2	Yo> -> (2)	21YN (2)
	EFPADM3	Yo> -> (3)	21YN (3)
Wattmetric based earth-fault protection	WPWDE1	Po> -> (1)	32N (1)
	WPWDE2	Po> -> (2)	32N (2)
	WPWDE3	Po> -> (3)	32N (3)
Transient / intermittent earth-fault protection	INTRPTEF1	Io> -> IEF	67NIEF
Harmonics based earth-fault protection	HAEFPTOC1	Io>HA	51NHA
Non-directional (cross-country) earth fault protection, using calculated Io	EFHPTOC1	Io>> (1)	51N-2 (1)
Negative-sequence overcurrent protection	NSPTOC1	I2> (1)	46 (1)
	NSPTOC2	I2> (2)	46 (2)
Phase discontinuity protection	PDNSPTOC1	I2/I1>	46PD
Residual overvoltage protection	ROVPTOV1	Uo> (1)	59G (1)
	ROVPTOV2	Uo> (2)	59G (2)
	ROVPTOV3	Uo> (3)	59G (3)
Three-phase undervoltage protection	PHPTUV1	3U< (1)	27 (1)
	PHPTUV2	3U< (2)	27 (2)
	PHPTUV3	3U< (3)	27 (3)
Table continues on next page			

Function	IEC 61850	IEC 60617	IEC-ANSI
Three-phase overvoltage protection	PHPTOV1	3U> (1)	59 (1)
	PHPTOV2	3U> (2)	59 (2)
	PHPTOV3	3U> (3)	59 (3)
Positive-sequence undervoltage protection	PSPTUV1	U1< (1)	47U+ (1)
Negative-sequence overvoltage protection	NSPTOV1	U2> (1)	47O- (1)
Frequency protection	FRPFRQ1	f>/f<,df/dt (1)	81 (1)
	FRPFRQ2	f>/f<,df/dt (2)	81 (2)
	FRPFRQ3	f>/f<,df/dt (3)	81 (3)
Three-phase thermal protection for feeders, cables and distribution transformers	T1PTTR1	3Ith>F	49F
Circuit breaker failure protection	CCBRBRF1	3I>/Io>BF	51BF/51NBF
Three-phase inrush detector	INRPHAR1	3I2f>	68
Master trip	TRPPTRC1	Master Trip (1)	94/86 (1)
	TRPPTRC2	Master Trip (2)	94/86 (2)
Arc protection	ARCSARC1	ARC (1)	50L/50NL (1)
	ARCSARC2	ARC (2)	50L/50NL (2)
	ARCSARC3	ARC (3)	50L/50NL (3)
Power quality			
Current total demand distortion	CMHAI1	PQM3I (1)	PQM3I (1)
Voltage total harmonic distortion	VMHAI1	PQM3U (1)	PQM3V (1)
Voltage variation	PHQVVR1	PQMU (1)	PQMV (1)
Control			
Circuit-breaker control	CBXCBR1	I <-> O CB	I <-> O CB
Disconnecter control	DCXSWI1	I <-> O DCC (1)	I <-> O DCC (1)
	DCXSWI2	I <-> O DCC (2)	I <-> O DCC (2)
Earthing switch control	ESXSWI1	I <-> O ESC	I <-> O ESC
Disconnecter position indication	DCSXSWI1	I <-> O DC (1)	I <-> O DC (1)
	DCSXSWI2	I <-> O DC (2)	I <-> O DC (2)
	DCSXSWI3	I <-> O DC (3)	I <-> O DC (3)
Earthing switch indication	ESSXSWI1	I <-> O ES (1)	I <-> O ES (1)
	ESSXSWI2	I <-> O ES (2)	I <-> O ES (2)
Auto-reclosing	DARREC1	O -> I	79
Synchronism and energizing check	SECRSYN1	SYNC	25
Condition monitoring			
Circuit-breaker condition monitoring	SSCBR1	CBCM	CBCM
Trip circuit supervision	TCSSCBR1	TCS (1)	TCM (1)
	TCSSCBR2	TCS (2)	TCM (2)
Current circuit supervision	CCRDIF1	MCS 3I	MCS 3I
Fuse failure supervision	SEQRFUF1	FUSEF	60
Measurement			
Table continues on next page			

Function	IEC 61850	IEC 60617	IEC-ANSI
Disturbance recorder	RDRE1	-	-
Three-phase current measurement	CMMXU1	3I	3I
Sequence current measurement	CSMSQI1	I1, I2, I0	I1, I2, I0
Residual current measurement	RESCMMXU1	I _o	I _n
Three-phase voltage measurement	VMMXU1	3U	3U
Residual voltage measurement	RESVMMXU1	U _o	V _n
Sequence voltage measurement	VSMSQI1	U1, U2, U0	U1, U2, U0
Three-phase power and energy measurement	PEMMXU1	P, E	P, E
Frequency measurement	FMMXU1	f	f

Section 2 IEC 60870-5-103 data mappings

2.1 Overview

This document describes the IEC 60870-5-103 data points and structures available in the IED. The point lists describe a superset of all data available through the standard configuration/s. The tables show the default point definitions. All these data can be freely remapped in which case PCM600 can provide an updated point list export of the new outlook.

2.2 Supported functions

Table 2: *Supported functions in REF615*

Function block	FE01	FE02	FE03	FE04	FE05	FE06	FE07	FE08	FE09
PHLPTOC1	•	•	•	•	•			•	
PHHPTOC1	•	•	•	•	•			•	
PHHPTOC2	•	•	•	•	•			•	
PHIPTOC1	•	•	•	•	•	•	•	•	•
DPHLPDOC1						•	•		•
DPHLPDOC2						•	•		•
DPHHPDOC1						•	•		•
EFLPTOC1			•	•				•	
EFLPTOC2			•	•				•	
EFHPTOC1	•	•	•	•	•	•	•	•	•
EFIPTOC1			•	•				•	
DEFLPDEF1	•	•			•	•	•		•
DEFLPDEF2	•	•			•	•	•		•
DEFHPDEF1	•	•			•	•	•		•
EFPADM1	o	o			o	o	o		o
EFPADM2	o	o			o	o	o		o
EFPADM3	o	o			o	o	o		o
WPWDE1	o	o			o	o	o		o
WPWDE2	o	o			o	o	o		o
WPWDE3	o	o			o	o	o		o
INTRPTEF1	•	•			•	•			•
HAEFPDOC1		o		o		o			o
Table continues on next page									

Function block	FE01	FE02	FE03	FE04	FE05	FE06	FE07	FE08	FE09
NSPTOC1	•	•	•	•	•	•	•	•	•
NSPTOC2	•	•	•	•	•	•	•	•	•
PDNSPTOC1	•	•	•	•	•	•	•	•	•
ROVPTOV1	•	•			•	•	•	•	•
ROVPTOV2	•	•			•	•	•	•	•
ROVPTOV3	•	•			•	•	•	•	•
PHPTUV1						•	•	•	•
PHPTUV2						•	•	•	•
PHPTUV3						•	•	•	•
PHPTOV1						•	•	•	•
PHPTOV2						•	•	•	•
PHPTOV3						•	•	•	•
PSPTUV1						•	•		•
NSPTOV1						•	•		•
FRPFRQ1								•	•
FRPFRQ2								•	•
FRPFRQ3								•	•
T1PTTR1	•	•	•	•	•	•	•		•
CCBRBRF1	•	•	•	•	•	•	•	•	•
INRPHAR1	•	•	•	•	•	•	•	•	•
TRPPTRC1	•	•	•	•	•	•	•	•	•
TRPPTRC2	•	•	•	•	•	•	•	•	•
ARCSARC1	o	o	o	o	o	o	o	o	o
ARCSARC2	o	o	o	o	o	o	o	o	o
ARCSARC3	o	o	o	o	o	o	o	o	o
CMHAI1									o
VMHAI1									o
PHQVVR1									o
CBXCBR1	•	•	•	•	•	•	•	•	•
DCXSWI1		•		•	•	•	•	•	•
DCXSWI2		•		•	•	•	•	•	•
ESXSWI1		•		•	•	•	•	•	•
DCSXSWI1		•		•	•	•	•	•	•
DCSXSWI2		•		•	•	•	•	•	•
DCSXSWI3		•		•	•	•	•	•	•
ESSXSWI1		•		•	•	•	•	•	•
ESSXSWI2		•		•	•	•	•	•	•
DARREC1	o	o	o	o	o	o	o	o	o
SECRSYN1								•	•
Table continues on next page									

Function block	FE01	FE02	FE03	FE04	FE05	FE06	FE07	FE08	FE09
SSCBR1		•		•	•	•	•	•	•
TCSSCBR1	•	•	•	•	•	•	•	•	•
TCSSCBR2	•	•	•	•	•	•	•	•	•
CCRDIF1					•	•	•	•	•
SEQRFUF1					•	•	•	•	•
RDRE1	•	•	•	•	•	•	•	•	•
CMMXU1	•	•	•	•	•	•	•	•	•
CSMSQI1	•	•	•	•	•	•	•	•	•
RESCMMXU1	•	•	•	•	•	•	•	•	•
VMMXU1					•	•	•	•	•
RESVMMXU1	•	•			•	•		•	•
VSMSQI1					•	•	•	•	•
PEMMXU1					•	•	•	•	•
FMMXU1								•	•
• = available in the device variant, o = optionally available in the device variant									

2.3

Indications and controls

Table 3: *Explanations of the indications and controls table columns*

Column name	Description
IEC 61850 name	Original IED data object identification. Described in the IEC 61850 format as Logical Device.Logical Node and thereafter .Data Object.Data Attribute. Logical Node is the same as the application function block name.
SA name	The signal may have a defined label that is visible, for example, in ACT.
Description	Short description of the signal. See the application function block documentation for more details.
DPI value	IEC 60870-5-103 indication and control values are coded as two-bit values (= DPI). 10 = ON, 01 = OFF
FUN and INF	Default function type and information number definition for the signal. Can be modified via PCM600.
U	Signal in use or not as default. 1 = In use, 0 = Not in use Can be configured via PCM600.
ASDU	ASDU type of the signal as default. ASDU type of indications can be modified via PCM600. ASDU 1 and 2 are indications. ASDU 20 is control.
I	General interrogation (GI) setting as default. 1 = In GI, 0 = Not in GI Can be modified via PCM600.
C	Extended DPI coding. 1 = Regular OFF/ON (01/10) values 2 = Four-pole INTERMEDIATE/OFF/ON/ERROR values (00/01/10/11)

2.3.1 General Data(FUN=0) IEC 60870-5-103 standard

Table 4: General Data(FUN=0) IEC 60870-5-103 standard

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.LNN0									
.LEDRs1.ctIVal	-	LED reset	10=Reset	0	19	1	20	0	1
.Beh.stVal.(Test)	-	Test mode	10=On	0	21	1	1	1	1
LD0.I3CGGIO1									
.ActSG.ctIVal/stVal	-	Param setting group 1	10=SG 1	0	23	1	1,20	1	1
.ActSG.ctIVal/stVal	-	Param setting group 2	10=SG 2	0	24	1	1,20	1	1
.ActSG.ctIVal/stVal	-	Param setting group 3	10=SG 3	0	25	1	1,20	1	1
.ActSG.ctIVal/stVal	-	Param setting group 4	10=SG 4	0	26	1	1,20	1	1
.ActSG.ctIVal/stVal	-	Param setting group 5	10=SG 5	0	27	1	1,20	1	1
.ActSG.ctIVal/stVal	-	Param setting group 6	10=SG 6	0	28	1	1,20	1	1
LD0.TCSSCBR1									
.CirAlm.stVal	ALARM	Trip circuit 1 alarm	10=Alarm	0	36	1	1	1	1
LD0.LEDPTRC1									
.Op.general	-	Global operate	10=Operate	0	68	1	2	0	1
.Str.general	-	Global start	10=Start	0	84	1	2	1	1

2.3.2 General Data(FUN=0) IEC 60870-5-103 standard - AR data

Table 5: General Data(FUN=0) IEC 60870-5-103 standard - AR data

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.DARREC1									
.AROn.stVal	-	AR state	10=On	0	16	1	1	1	1
.SucRec.stVal	SUC_RECL	AR success	10=Succ.	0	128	1	1	0	1

2.3.3 General Data(FUN=10) - 615-specific

Table 6: General Data(FUN=10) - 615-specific

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.TRPPTRC1									
.Op.general	-	Trip1 input	10=On	10	1	1	2	0	1
.Tr.general	-	Trip1 output	10=On	10	2	1	2	0	1
LD0.TRPPTRC2									
.Op.general	-	Trip2 input	10=On	10	3	1	2	0	1
.Tr.general	-	Trip2 output	10=On	10	4	1	2	0	1
CTRL.LLN0									
.Loc.stVal	-	Local/Remote state	10=Local	10	10	1	1	1	1

Table continues on next page

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
.LocRem.Station	-	Station state	10=On	10	11	1	1	1	1
LD0.LLN0									
.LEDs2.ctlVal	-	Reset alarm LEDs	10=Reset	10	21	1	20	0	1
.SetSeld.stVal	-	Param.setting reserved	10=Res	10	80	1	1	1	1
.SetChg.stVal	-	Param.setting changed	10=Chng	10	81	1	1	1	1
LD0.TCSSCBR2									
.CirAlm.stVal	ALARM	Trip circuit 2 alarm	10=Alarm	10	36	1	1	1	1
DR.RDRE1									
.RcdTrg.ctlVal	-	Trig DR recording	10=Trig	10	41	1	20	0	1
.MemClr.ctlVal	-	Clear DR memory	10=Clear	10	42	1	20	0	1
LD0.CMSTA1									
.RecRs.ctlVal	-	Reset max.demands 1	10=Reset	10	45	1	20	0	1
LD0.LEDPTRC1		Global protection:							
.Str.phsA	-	Start-phsA	10=Start	10	61	0	2	1	1
.Str.phsB	-	Start-phsB	10=Start	10	62	0	2	1	1
.Str.phsC	-	Start-phsC	10=Start	10	63	0	2	1	1
.Op.phsA	-	Operate-phsA	10=Operate	10	65	0	2	0	1
.Op.phsB	-	Operate-phsB	10=Operate	10	66	0	2	0	1
.Op.phsC	-	Operate-phsC	10=Operate	10	67	0	2	0	1

2.3.4 LD0.MVGAPC1 Multipurpose binary inputs (1)

Table 7: LD0.MVGAPC1 Multipurpose binary inputs (1)

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.MVGAPC1									
.Q1.stVal	-	Input 1 signal	10=On	11	1	0	1	1	1
.Q2.stVal	-	Input 2 signal	10=On	11	2	0	1	1	1
.Q3.stVal	-	Input 3 signal	10=On	11	3	0	1	1	1
.Q4.stVal	-	Input 4 signal	10=On	11	4	0	1	1	1
.Q5.stVal	-	Input 5 signal	10=On	11	5	0	1	1	1
.Q6.stVal	-	Input 6 signal	10=On	11	6	0	1	1	1
.Q7.stVal	-	Input 7 signal	10=On	11	7	0	1	1	1
.Q8.stVal	-	Input 8 signal	10=On	11	8	0	1	1	1

2.3.5 LD0.MVGAPC2 Multipurpose binary inputs (2)

Table 8: *LD0.MVGAPC2 Multipurpose binary inputs (2)*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.MVGAPC2									
.Q1.stVal	-	Input 1 signal	10=On	11	11	0	1	1	1
.Q2.stVal	-	Input 2 signal	10=On	11	12	0	1	1	1
.Q3.stVal	-	Input 3 signal	10=On	11	13	0	1	1	1
.Q4.stVal	-	Input 4 signal	10=On	11	14	0	1	1	1
.Q5.stVal	-	Input 5 signal	10=On	11	15	0	1	1	1
.Q6.stVal	-	Input 6 signal	10=On	11	16	0	1	1	1
.Q7.stVal	-	Input 7 signal	10=On	11	17	0	1	1	1
.Q8.stVal	-	Input 8 signal	10=On	11	18	0	1	1	1

2.3.6 LD0.SRGAPC1 Multipurpose binary outputs - flip-flop resets (1)

Table 9: *LD0.SRGAPC1 Multipurpose binary outputs - flip-flop resets (1)*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.SRGAPC1									
.Rs1.ctlVal	-	Reset flip-flop 1	10=Reset	11	101	1	20	0	1
.Rs2.ctlVal	-	Reset flip-flop 2	10=Reset	11	102	1	20	0	1
.Rs3.ctlVal	-	Reset flip-flop 3	10=Reset	11	103	1	20	0	1
.Rs4.ctlVal	-	Reset flip-flop 4	10=Reset	11	104	1	20	0	1
.Rs5.ctlVal	-	Reset flip-flop 5	10=Reset	11	105	1	20	0	1
.Rs6.ctlVal	-	Reset flip-flop 6	10=Reset	11	106	1	20	0	1
.Rs7.ctlVal	-	Reset flip-flop 7	10=Reset	11	107	1	20	0	1
.Rs8.ctlVal	-	Reset flip-flop 8	10=Reset	11	108	1	20	0	1

2.3.7 LD0.SRGAPC2 Multipurpose binary outputs - flip-flop resets (2)

Table 10: *LD0.SRGAPC2 Multipurpose binary outputs - flip-flop resets (2)*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.SRGAPC2									
.Rs1.ctlVal	-	Reset flip-flop 1	10=Reset	11	111	1	20	0	1
.Rs2.ctlVal	-	Reset flip-flop 2	10=Reset	11	112	1	20	0	1
.Rs3.ctlVal	-	Reset flip-flop 3	10=Reset	11	113	1	20	0	1
.Rs4.ctlVal	-	Reset flip-flop 4	10=Reset	11	114	1	20	0	1
.Rs5.ctlVal	-	Reset flip-flop 5	10=Reset	11	115	1	20	0	1

Table continues on next page

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
.Rs6.ctIVal	-	Reset flip-flop 6	10=Reset	11	116	1	20	0	1
.Rs7.ctIVal	-	Reset flip-flop 7	10=Reset	11	117	1	20	0	1
.Rs8.ctIVal	-	Reset flip-flop 8	10=Reset	11	118	1	20	0	1

2.3.8 LD0.SPCGGIO1 Multipurpose binary outputs (1)

The binary outputs may be configured either as pulse- or persistent-type outputs. Pulse-type outputs are triggered with the write value "ON". Persistent-type outputs can be written with both "ON" and "OFF" values. The persistent type is the same as the toggled mode on LHMI and WHMI.

Table 11: *LD0.SPCGGIO1 Multipurpose binary outputs (1)*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.SPCGGIO1									
.SPCS01.ctIVal	-	Output control 1	10/01=On/Off	11	141	1	20	0	1
.SPCS02.ctIVal	-	Output control 2	10/01=On/Off	11	142	1	20	0	1
.SPCS03.ctIVal	-	Output control 3	10/01=On/Off	11	143	1	20	0	1
.SPCS04.ctIVal	-	Output control 4	10/01=On/Off	11	144	1	20	0	1
.SPCS05.ctIVal	-	Output control 5	10/01=On/Off	11	145	1	20	0	1
.SPCS06.ctIVal	-	Output control 6	10/01=On/Off	11	146	1	20	0	1
.SPCS07.ctIVal	-	Output control 7	10/01=On/Off	11	147	1	20	0	1
.SPCS08.ctIVal	-	Output control 8	10/01=On/Off	11	148	1	20	0	1
.SPCS09.ctIVal	-	Output control 9	10/01=On/Off	11	149	1	20	0	1
.SPCS10.ctIVal	-	Output control 10	10/01=On/Off	11	150	1	20	0	1
.SPCS11.ctIVal	-	Output control 11	10/01=On/Off	11	151	1	20	0	1
.SPCS12.ctIVal	-	Output control 12	10/01=On/Off	11	152	1	20	0	1
.SPCS13.ctIVal	-	Output control 13	10/01=On/Off	11	153	1	20	0	1
.SPCS14.ctIVal	-	Output control 14	10/01=On/Off	11	154	1	20	0	1
.SPCS15.ctIVal	-	Output control 15	10/01=On/Off	11	155	1	20	0	1
.SPCS16.ctIVal	-	Output control 16	10/01=On/Off	11	156	1	20	0	1

2.3.9 LD0.SPCGGIO2 Multipurpose binary outputs (2)

The binary outputs may be configured either as pulse- or persistent-type outputs. Pulse-type outputs are triggered with the write value "ON". Persistent-type outputs can be written with both "ON" and "OFF" values. The persistent type is the same as the toggled mode on LHMI and WHMI.

Table 12: *LD0.SPCGGIO2 Multipurpose binary outputs (2)*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.SPCGGIO2									
.SPCS01.ctIVal	-	Output control 1	10/01=On/Off	11	181	1	1,20	0	1
.SPCS02.ctIVal	-	Output control 2	10/01=On/Off	11	182	1	1,20	0	1
.SPCS03.ctIVal	-	Output control 3	10/01=On/Off	11	183	1	1,20	0	1
.SPCS04.ctIVal	-	Output control 4	10/01=On/Off	11	184	1	1,20	0	1
.SPCS05.ctIVal	-	Output control 5	10/01=On/Off	11	185	1	1,20	0	1
.SPCS06.ctIVal	-	Output control 6	10/01=On/Off	11	186	1	1,20	0	1
.SPCS07.ctIVal	-	Output control 7	10/01=On/Off	11	187	1	1,20	0	1
.SPCS08.ctIVal	-	Output control 8	10/01=On/Off	11	188	1	1,20	0	1
.SPCS09.ctIVal	-	Output control 9	10/01=On/Off	11	189	1	1,20	0	1
.SPCS10.ctIVal	-	Output control 10	10/01=On/Off	11	190	1	1,20	0	1
.SPCS11.ctIVal	-	Output control 11	10/01=On/Off	11	191	1	1,20	0	1
.SPCS12.ctIVal	-	Output control 12	10/01=On/Off	11	192	1	1,20	0	1
.SPCS13.ctIVal	-	Output control 13	10/01=On/Off	11	193	1	1,20	0	1
.SPCS14.ctIVal	-	Output control 14	10/01=On/Off	11	194	1	1,20	0	1
.SPCS15.ctIVal	-	Output control 15	10/01=On/Off	11	195	1	1,20	0	1
.SPCS16.ctIVal	-	Output control 16	10/01=On/Off	11	196	1	1,20	0	1

2.3.10 LD0.NSPTOC1 Negative-sequence overcurrent protection (1)

Table 13: *LD0.NSPTOC1 Negative-sequence overcurrent protection (1)*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.NSPTOC1									
.Str.general	START	Stage1 start	10=Start	21	84	1	2	1	1
.Op.general	OPERATE	Stage1 operate	10=Operate	21	90	1	2	0	1

2.3.11 LD0.NSPTOC2 Negative-sequence overcurrent protection (2)

Table 14: *LD0.NSPTOC2 Negative-sequence overcurrent protection (2)*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.NSPTOC2									
.Op.general	OPERATE	Stage2 operate	10=Operate	21	91	1	2	0	1
.Str.general	START	Stage2 start	10=Start	21	94	1	2	1	1

2.3.12 LD0.SEQRFUF1 Fuse failure protection

Table 15: LD0.SEQRFUF1 Fuse failure protection

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.SEQRFUF1									
.Str.general	FUSEF_U	General start	10=Start	22	84	1	2	1	1
.Str3Ph.general	FUSEF_3PH	3 phase start	10=Start	22	94	1	2	1	1

2.3.13 CTRL.CCRDIF1 Current circuit failure protection

Table 16: CTRL.CCRDIF1 Current circuit failure protection

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
CTRL.CCRDIF1									
.Alm.stVal	ALARM	Fail Alarm	10=Alarm	23	1	1	1	1	1
.Op.general	FAIL	Fail Operate	10=Operate	23	90	1	2	0	1

2.3.14 LD0.EFPADM1 Admittance-based earth-fault protection (1)

Table 17: LD0.EFPADM1 Admittance-based earth-fault protection (1)

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.EFPADM1									
.Str.general	START	Stage1 start	10=Start	25	84	1	2	1	1
.Op.general	OPERATE	Stage1 operate	10=Operate	25	90	1	2	0	1

2.3.15 LD0.EFPADM2 Admittance-based earth-fault protection (2)

Table 18: LD0.EFPADM2 Admittance-based earth-fault protection (2)

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.EFPADM2									
.Op.general	OPERATE	Stage2 operate	10=Operate	25	91	1	2	0	1
.Str.general	START	Stage2 start	10=Start	25	94	1	2	1	1

2.3.16 LD0.EFPADM3 Admittance-based earth-fault protection (3)

Table 19: LD0.EFPADM3 Admittance-based earth-fault protection (3)

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.EFPADM3									
.Str.general	START	Stage3 start	10=Start	25	96	1	2	1	1
.Op.general	OPERATE	Stage3 operate	10=Operate	25	98	1	2	0	1

2.3.17 LD0.SECRSYN1 Synchrocheck indications

Table 20: LD0.SECRSYN1 Synchrocheck indications

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.SECRSYN1									
.SynPrg.stVal	SYNC_INPRO	Synch in progress	10=Progress	26	1	1	1	1	1
.FailCmd.stVal	CMD_FAIL_AL	CB close req failed	10=Fail	26	2	1	1	0	1
.FailSyn.stVal	CL_FAIL_AL	CB close cmd failed	10=Fail	26	3	1	1	0	1
.EnSt.stVal	ENERG_STATE	Line and bus en.state	Value 0...4	26	10	1	4	1	-

2.3.18 LD0.FRPFRQ1 Frequency protection (1)

Table 21: LD0.FRPFRQ1 Frequency protection (1)

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.FRPTRC1									
.Str.general	START	Stage start	10=Start	27	11	1	2	1	1
LD0.FRPTOF1		Overfrequency							
.Op.general	OPR_OFRQ	-Operate	10=Operate	27	12	1	2	0	1
LD0.FRPTUF1		Underfrequency							
.Op.general	OPR_UFRQ	-Operate	10=Operate	27	13	1	2	0	1
LD0.FRPFRQ1		Frequency gradient							
.Op.general	OPR_FRG	-Operate	10=Operate	27	14	1	2	0	1

2.3.19 LD0.FRPFRQ2 Frequency protection (2)

Table 22: LD0.FRPFRQ2 Frequency protection (2)

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.FRPTRC2									
.Str.general	START	Stage start	10=Start	27	21	1	2	1	1
LD0.FRPTOF2		Overfrequency							
.Op.general	OPR_OFRQ	-Operate	10=Operate	27	22	1	2	0	1
LD0.FRPTUF2		Underfrequency							
.Op.general	OPR_UFRQ	-Operate	10=Operate	27	23	1	2	0	1
LD0.FRPFRQ2		Frequency gradient							
.Op.general	OPR_FRG	-Operate	10=Operate	27	24	1	2	0	1

2.3.20 LD0.FRPFRQ3 Frequency protection (3)

Table 23: LD0.FRPFRQ3 Frequency protection (3)

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.FRPTRC3									
.Str.general	START	Stage start	10=Start	27	31	1	2	1	1
LD0.FRPTOF3		Overfrequency							
.Op.general	OPR_OFRQ	-Operate	10=Operate	27	32	1	2	0	1
LD0.FRPTUF3		Underfrequency							
.Op.general	OPR_UFRQ	-Operate	10=Operate	27	33	1	2	0	1
LD0.FRPFC3		Frequency gradient							
.Op.general	OPR_FRG	-Operate	10=Operate	27	34	1	2	0	1

2.3.21 LD0.DPHHPDOC1 Three-phase directional overcurrent protection - high stage (1)

Table 24: LD0.DPHHPDOC1 Three-phase directional overcurrent protection - high stage (1)

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.DPHHPTOC1		High stage							
.Str.phsA	-	-phsA start	10=Start	32	44	0	2	1	1
.Str.phsB	-	-phsB start	10=Start	32	45	0	2	1	1
.Str.phsC	-	-phsC start	10=Start	32	46	0	2	1	1
.Str.general	START	-general start	10=Start	32	96	1	2	1	1
.Op.general	OPERATE	-general operate	10=Operate	32	98	1	2	0	1

2.3.22 LD0.DPHLPDOC2 Three-phase directional overcurrent protection - low stage (2)

Table 25: LD0.DPHLPDOC2 Three-phase directional overcurrent protection - low stage (2)

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.DPHLPDOC2		Low (2) stage							
.Str.phsA	-	-phsA start	10=Start	32	54	0	2	1	1
.Str.phsB	-	-phsB start	10=Start	32	55	0	2	1	1
.Str.phsC	-	-phsC start	10=Start	32	56	0	2	1	1
.Op.general	OPERATE	-general operate	10=Operate	32	91	1	2	0	1
.Str.general	START	-general start	10=Start	32	94	1	2	1	1

2.3.23 LD0.DPHLPDOC1 Three-phase directional overcurrent protection - low stage (1)

Table 26: LD0.DPHLPDOC1 Three-phase directional overcurrent protection - low stage (1)

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.DPHLPDOC1		Low (1) stage							
.Str.phsA	-	-phsA start	10=Start	32	64	0	2	1	1
.Str.phsB	-	-phsB start	10=Start	32	65	0	2	1	1
.Str.phsC	-	-phsC start	10=Start	32	66	0	2	1	1
.Str.general	START	-general start	10=Start	32	84	1	2	1	1
.Op.general	OPERATE	-general operate	10=Operate	32	90	1	2	0	1

2.3.24 LD0.PHPTOV3 Phase overvoltage protection - stage 3

Table 27: LD0.PHPTOV3 Phase overvoltage protection - stage 3

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.PHPTOV3		Stage 3							
.Str.phsA	-	-phsA start	10=Start	40	44	0	2	1	1
.Str.phsB	-	-phsB start	10=Start	40	45	0	2	1	1
.Str.phsC	-	-phsC start	10=Start	40	46	0	2	1	1
.Str.general	START	-general start	10=Start	40	96	1	2	1	1
.Op.general	OPERATE	-general operate	10=Operate	40	98	1	2	0	1

2.3.25 LD0.PHPTOV2 Phase overvoltage protection - stage 2

Table 28: LD0.PHPTOV2 Phase overvoltage protection - stage 2

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.PHPTOV2		Stage 3							
.Str.phsA	-	-phsA start	10=Start	40	54	0	2	1	1
.Str.phsB	-	-phsB start	10=Start	40	55	0	2	1	1
.Str.phsC	-	-phsC start	10=Start	40	56	0	2	1	1
.Op.general	OPERATE	-general operate	10=Start	40	91	1	2	0	1
.Str.general	START	-general start	10=Operate	40	94	1	2	1	1

2.3.26 LD0.PHPTOV1 Phase overvoltage protection - stage 1**Table 29:** *LD0.PHPTOV1 Phase overvoltage protection - stage 1*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.PHPTOV1		Stage 1							
.Str.phsA	-	-phsA start	10=Start	40	64	0	2	1	1
.Str.phsB	-	-phsB start	10=Start	40	65	0	2	1	1
.Str.phsC	-	-phsC start	10=Start	40	66	0	2	1	1
.Str.general	START	-general start	10=Start	40	84	1	2	1	1
.Op.general	OPERATE	-general operate	10=Operate	40	90	1	2	0	1

2.3.27 LD0.PHPTUV3 Phase undervoltage protection - stage 3**Table 30:** *LD0.PHPTUV3 Phase undervoltage protection - stage 3*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.PHPTUV3		Stage 3							
.Str.phsA	-	-phsA start	10=Start	41	44	0	2	1	1
.Str.phsB	-	-phsB start	10=Start	41	45	0	2	1	1
.Str.phsC	-	-phsC start	10=Start	41	46	0	2	1	1
.Str.general	START	-general start	10=Start	41	96	1	2	1	1
.Op.general	OPERATE	-general operate	10=Operate	41	98	1	2	0	1

2.3.28 LD0.PHPTUV2 Phase undervoltage protection - stage 2**Table 31:** *LD0.PHPTUV2 Phase undervoltage protection - stage 2*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.PHPTUV2		Stage 2							
.Str.phsA	-	-phsA start	10=Start	41	54	0	2	1	1
.Str.phsB	-	-phsB start	10=Start	41	55	0	2	1	1
.Str.phsC	-	-phsC start	10=Start	41	56	0	2	1	1
.Op.general	OPERATE	-general start	10=Operate	41	91	1	2	0	1
.Str.general	START	-general operate	10=Start	41	94	1	2	1	1

2.3.29 LD0.PHPTUV1 Phase undervoltage protection - stage 1

Table 32: LD0.PHPTUV1 Phase undervoltage protection - stage 1

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.PHPTUV1		Stage 1							
.Str.phsA	-	-phsA start	10=Start	41	64	0	2	1	1
.Str.phsB	-	-phsB start	10=Start	41	65	0	2	1	1
.Str.phsC	-	-phsC start	10=Start	41	66	0	2	1	1
.Str.general	START	-general start	10=Start	41	84	1	2	1	1
.Op.general	OPERATE	-general operate	10=Operate	41	90	1	2	0	1

2.3.30 LD0.PSPTUV1 Positive-sequence undervoltage protection - stage 1

Table 33: LD0.PSPTUV1 Positive-sequence undervoltage protection - stage 1

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.PSPTUV1		Stage 1							
.Str.general	START	-general start	10=Start	42	84	1	2	1	1
.Op.general	OPERATE	-general operate	10=Operate	42	90	1	2	0	1

2.3.31 LD0.NSPTOV1 Negative-sequence overvoltage protection - stage 1

Table 34: LD0.NSPTOV1 Negative-sequence overvoltage protection - stage 1

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.NSPTOV1		Stage 1							
.Str.general	START	-general start	10=Start	43	84	1	2	1	1
.Op.general	OPERATE	-general operate	10=Operate	43	90	1	2	0	1

2.3.32 LD0.ROVPTOV1 Residual overvoltage protection - stage 1

Table 35: LD0.ROVPTOV1 Residual overvoltage protection - stage 1

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.ROVPTOV1									
.Str.general	START	Stage 1 start	10=Start	44	84	1	2	1	1
.Op.general	OPERATE	Stage 1 operate	10=Operate	44	90	1	2	0	1

2.3.33 LD0.ROVPTOV2 Residual overvoltage protection - stage 2

Table 36: *LD0.ROVPTOV2 Residual overvoltage protection - stage 2*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.ROVPTOV2									
.Op.general	OPERATE	Stage 2 operate	10=Operate	44	91	1	2	0	1
.Str.general	START	Stage 2 start	10=Start	44	94	1	2	1	1

2.3.34 LD0.ROVPTOV3 Residual overvoltage protection - stage 3

Table 37: *LD0.ROVPTOV3 Residual overvoltage protection - stage 3*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.ROVPTOV3									
.Str.general	START	Stage 3 Start	10=Start	44	96	1	2	1	1
.Op.general	OPERATE	Stage 3 Operate	10=Operate	44	98	1	2	0	1

2.3.35 LD0.XGGIO130 Physical binary I/O signals (status only)

Table 38: *LD0.XGGIO130 Physical binary I/O signals (status only)*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.XGGIO130									
.Ind1.stVal	-	X130-Input 1	10/01=On/Off	50	1	0	1	1	1
.Ind2.stVal	-	X130-Input 2	10/01=On/Off	50	2	0	1	1	1
.Ind3.stVal	-	X130-Input 3	10/01=On/Off	50	3	0	1	1	1
.Ind4.stVal	-	X130-Input 4	10/01=On/Off	50	4	0	1	1	1
.Ind5.stVal	-	X130-Input 5	10/01=On/Off	50	5	0	1	1	1
.Ind6.stVal	-	X130-Input 6	10/01=On/Off	50	6	0	1	1	1
.SPCSO1.stVal	-	X130-Output 1	10/01=On/Off	50	101	0	1	1	1
.SPCSO2.stVal	-	X130-Output 2	10/01=On/Off	50	102	0	1	1	1
.SPCSO3.stVal	-	X130-Output 3	10/01=On/Off	50	103	0	1	1	1

2.3.36 LD0.XGGIO120 Physical binary I/O signals (status only)

Table 39: *LD0.XGGIO120 Physical binary I/O signals (status only)*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.XGGIO120									
.Ind1.stVal	-	X120-Input 1	10/01=On/Off	51	1	0	1	1	1
.Ind2.stVal	-	X120-Input 2	10/01=On/Off	51	2	0	1	1	1
.Ind3.stVal	-	X120-Input 3	10/01=On/Off	51	3	0	1	1	1
.Ind4.stVal	-	X120-Input 4	10/01=On/Off	51	4	0	1	1	1

2.3.37 LD0.XGGIO110 Physical binary I/O signals (status only)

Table 40: LD0.XGGIO110 Physical binary I/O signals (status only)

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.XGGIO110									
.Ind1.stVal	-	X110-Input 1	10/01=On/Off	52	1	0	1	1	1
.Ind2.stVal	-	X110-Input 2	10/01=On/Off	52	2	0	1	1	1
.Ind3.stVal	-	X110-Input 3	10/01=On/Off	52	3	0	1	1	1
.Ind4.stVal	-	X110-Input 4	10/01=On/Off	52	4	0	1	1	1
.Ind5.stVal	-	X110-Input 5	10/01=On/Off	52	5	0	1	1	1
.Ind6.stVal	-	X110-Input 6	10/01=On/Off	52	6	0	1	1	1
.Ind7.stVal	-	X110-Input 7	10/01=On/Off	52	7	0	1	1	1
.Ind8.stVal	-	X110-Input 8	10/01=On/Off	52	8	0	1	1	1
.SPCSO1.stVal	-	X110-Output 1	10/01=On/Off	52	101	0	1	1	1
.SPCSO2.stVal	-	X110-Output 2	10/01=On/Off	52	102	0	1	1	1
.SPCSO3.stVal	-	X110-Output 3	10/01=On/Off	52	103	0	1	1	1
.SPCSO4.stVal	-	X110-Output 4	10/01=On/Off	52	104	0	1	1	1

2.3.38 LD0.XGGIO100 Physical binary I/O signals (status only)

Table 41: LD0.XGGIO100 Physical binary I/O signals (status only)

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.XGGIO100									
.SPCSO1.stVal	-	X100-Output 1	10/01=On/Off	53	101	0	1	1	1
.SPCSO2.stVal	-	X100-Output 2	10/01=On/Off	53	102	0	1	1	1
.SPCSO3.stVal	-	X100-Output 3	10/01=On/Off	53	103	0	1	1	1
.SPCSO4.stVal	-	X100-Output 4	10/01=On/Off	53	104	0	1	1	1
.SPCSO5.stVal	-	X100-Output 5	10/01=On/Off	53	105	0	1	1	1
.SPCSO6.stVal	-	X100-Output 6	10/01=On/Off	53	106	0	1	1	1

2.3.39 LD0.XAGGIO130 Physical binary I/O signals (status only)

Table 42: LD0.XAGGIO130 Physical binary I/O signals (status only)

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.XAGGIO130									
.Ind1.stVal	-	XA130-Input 1	10/01=On/Off	54	1	0	1	1	1
.Ind2.stVal	-	XA130-Input 2	10/01=On/Off	54	2	0	1	1	1
.Ind3.stVal	-	XA130-Input 3	10/01=On/Off	54	3	0	1	1	1
.Ind4.stVal	-	XA130-Input 4	10/01=On/Off	54	4	0	1	1	1

2.3.40 LD0.CMHAI1 Power quality - current total demand distortion**Table 43:** *LD0.CMHAI1 Power quality - current total demand distortion*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.CMHAI1									
.Alm.stVal	ALARM	Distortion Alarm	10=Alarm	95	101	1	2	0	1

2.3.41 LD0.VMHAI1 Power quality - voltage total harmonic distortion**Table 44:** *LD0.VMHAI1 Power quality - voltage total harmonic distortion*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.VMHAI1									
.Alm.stVal	ALARM	Distortion Alarm	10=Alarm	95	105	1	2	0	1

2.3.42 LD0.PH1QVVR1 Power quality - voltage variation**Table 45:** *LD0.PH1QVVR1 Power quality - voltage variation*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.PH1QVVR1									
.VarStrGen.stVal		Variation event detected	10=Detected	95	121	1	2	0	1
.VarEnd.stVal		Variation event ended	10=Ended	95	122	1	2	0	1
.SwlOp.stVal		Swell event detected	10=Detected	95	123	1	2	0	1
.DipOp.stVal		Dip event detected	10=Detected	95	124	1	2	0	1
.IntrOptVal		Interruption event detected	10=Detected	95	125	1	2	0	1

2.3.43 LD0.WPWDE1 Wattmetric-based earth-fault protection - stage 1**Table 46:** *LD0.WPWDE1 Wattmetric-based earth-fault protection - stage 1*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.WPDSE1		Stage 1							
Str.general	START	-start	10=Start	100	101	1	2	1	1
Op.general	OPERATE	-operate	10=Operate	100	102	1	2	0	1

2.3.44 LD0.WPWDE2 Wattmetric-based earth-fault protection - stage 2

Table 47: LD0.WPWDE2 Wattmetric-based earth-fault protection - stage 2

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.WPDSE2		Stage 2							
Str.general	START	-start	10=Start	100	103	1	2	1	1
Op.general	OPERATE	-operate	10=Operate	100	104	1	2	0	1

2.3.45 LD0.WPWDE3 Wattmetric-based earth-fault protection - stage 3

Table 48: LD0.WPWDE3 Wattmetric-based earth-fault protection - stage 3

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.WPDSE3		Stage 3							
Str.general	START	-start	10=Start	100	105	1	2	1	1
Op.general	OPERATE	-operate	10=Operate	100	106	1	2	0	1

2.3.46 LD0.HAEFPTOC1 Harmonics-based earth-fault protection

Table 49: LD0.HAEFPTOC1 Harmonics-based earth-fault protection

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.HAEFPTOC1		Stage							
Str.general	START	-start	10=Start	100	121	1	2	1	1
Op.general	OPERATE	-operate	10=Operate	100	122	1	2	0	1

2.3.47 LD0.ARCSARC1 Fault arc protection - stage 1

Table 50: LD0.ARCSARC1 Fault arc protection - stage 1

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.ARCSARC11									
.FADet.stVal	ARC_FLT_DE T	Arc detected	10=Detect	156	211	1	1	0	1
LD0.ARCPTRC11									
.Op.general	OPERATE	Operate	10=Operate	156	213	1	2	0	1

2.3.48 LD0.ARCSARC2 Fault arc protection - stage 2

Table 51: LD0.ARCSARC2 Fault arc protection - stage 2

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.ARCSARC21									
.FADet.stVal	ARC_FLT_DE T	Arc detected	10=Detect	156	221	1	1	0	1
LD0.ARCPTRC21									
.Op.general	OPERATE	Operate	10=Operate	156	223	1	2	0	1

2.3.49 LD0.ARCSARC3 Fault arc protection - stage 3

Table 52: LD0.ARCSARC3 Fault arc protection - stage 3

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.ARCSARC31									
.FADet.stVal	ARC_FLT_DE T	Arc detected	10=Detect	156	231	1	1	0	1
LD0.ARCPTRC31									
.Op.general	OPERATE	Operate	10=Operate	156	233	1	2	0	1

2.3.50 LD0.PDNSPTOC1 Phase discontinuity protection

Table 53: LD0.PDNSPTOC1 Phase discontinuity protection

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.PDNSPTOC1									
.Str.general	START	Stage start	10=Start	157	84	1	2	1	1
.Op.general	OPERATE	Stage operate	10=Operate	157	90	1	2	0	1

2.3.51 LD0.INTRPTEF1 Transient/intermittent earth-fault protection

Table 54: LD0.INTRPTEF1 Transient/intermittent earth-fault protection

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.INTRPTEF1									
.Str.general	START	Stage start	10=Start	158	84	1	2	1	1
.Op.general	OPERATE	Stage operate	10=Operate	158	90	1	2	0	1

2.3.52 LD0.EFLPTOC1 Non-directional earth-fault and sensitive earth-fault protection - low stage 1

Table 55: *LD0.EFLPTOC1 Non-directional earth-fault and sensitive earth-fault protection - low stage 1*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.EFLPTOC1		Low (1) stage							
.Str.general	START	-start	10=Start	159	84	1	2	1	1
.Op.general	OPERATE	-operate	10=Operate	159	90	1	2	0	1

2.3.53 LD0.EFLPTOC2 Non-directional earth-fault and sensitive earth-fault protection - low stage 2

Table 56: *LD0.EFLPTOC2 Non-directional earth-fault and sensitive earth-fault protection - low stage 2*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.EFLPTOC2		Low (2) stage							
.Op.general	OPERATE	-operate	10=Operate	159	91	1	2	0	1
.Str.general	START	-start	10=Start	159	94	1	2	1	1

2.3.54 LD0.EFHPTOC1 Non-directional earth-fault and sensitive earth-fault protection - high stage 1

Table 57: *LD0.EFHPTOC1 Non-directional earth-fault and sensitive earth-fault protection - high stage 1*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.EFHPTOC1		High stage							
.Str.general	START	-start	10=Start	159	96	1	2	1	1
.Op.general	OPERATE	-operate	10=Operate	159	98	1	2	0	1

2.3.55 LD0.EFIPTOC1 Non-directional earth-fault and sensitive earth-fault protection - instantaneous stage 1

Table 58: *LD0.EFIPTOC1 Non-directional earth-fault and sensitive earth-fault protection - instantaneous stage 1*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.EFIPTOC1		Instantaneous stage							
.Str.general	START	-start	10=Start	159	97	1	2	1	1
.Op.general	OPERATE	-operate	10=Operate	159	99	1	2	0	1

2.3.56 LD0.PHIPTOC1 Phase overcurrent protection - instantaneous stage 1

Table 59: LD0.PHIPTOC1 Phase overcurrent protection - instantaneous stage 1

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.PHIPTOC1		Instantaneous stage (1)							
.Str.phsA	-	-phsA start	10=Start	162	34	0	2	1	1
.Str.phsB	-	-phsB start	10=Start	162	35	0	2	1	1
.Str.phsC	-	-phsC start	10=Start	162	36	0	2	1	1
.Str.general	START	-general start	10=Start	162	97	1	2	1	1
.Op.general	OPERATE	-general operate	10=Operate	162	99	1	2	0	1

2.3.57 LD0.PHHPTOC2 Phase overcurrent protection - high stage 2

Table 60: LD0.PHHPTOC2 Phase overcurrent protection - high stage 2

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.PHHPTOC2		High stage (2)							
.Str.phsA	-	-phsA start	10=Start	162	44	0	2	1	1
.Str.phsB	-	-phsB start	10=Start	162	45	0	2	1	1
.Str.phsC	-	-phsC start	10=Start	162	46	0	2	1	1
.Str.general	START	-general start	10=Start	162	96	1	2	1	1
.Op.general	OPERATE	-general operate	10=Operate	162	98	1	2	0	1

2.3.58 LD0.PHHPTOC1 Phase overcurrent protection - high stage 1

Table 61: LD0.PHHPTOC1 Phase overcurrent protection - high stage 1

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.PHHPTOC1		High stage (1)							
.Str.phsA	-	-phsA start	10=Start	162	54	0	2	1	1
.Str.phsB	-	-phsB start	10=Start	162	55	0	2	1	1
.Str.phsC	-	-phsC start	10=Start	162	56	0	2	1	1
.Op.general	OPERATE	-general operate	10=Operate	162	91	1	2	0	1
.Str.general	START	-general start	10=Start	162	94	1	2	1	1

2.3.59 LD0.PHLPTOC1 Phase overcurrent protection - low stage 1

Table 62: LD0.PHLPTOC1 Phase overcurrent protection - low stage 1

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.PHLPTOC1		Low stage (1)							
.Str.phsA	-	-phsA start	10=Start	162	64	0	2	1	1
.Str.phsB	-	-phsB start	10=Start	162	65	0	2	1	1
.Str.phsC	-	-phsC start	10=Start	162	66	0	2	1	1
.Str.general	START	-general start	10=Start	162	84	1	2	1	1
.Op.general	OPERATE	-general operate	10=Operate	162	90	1	2	0	1

2.3.60 LD0.DEFLPDEF1 Directional earth-fault protection - low stage 1

Table 63: LD0.DEFLPDEF1 Directional earth-fault protection - low stage 1

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.DEFLPTOC1		Low (1) stage							
.Str.general	START	-start	10=Start	163	84	1	2	1	1
.Op.general	OPERATE	-operate	10=Operate	163	90	1	2	0	1

2.3.61 LD0.DEFLPDEF2 Directional earth-fault protection - low stage 2

Table 64: LD0.DEFLPDEF2 Directional earth-fault protection - low stage 2

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.DEFLPTOC2		Low (2) stage							
.Op.general	OPERATE	-operate	10=Operate	163	91	1	2	0	1
.Str.general	START	-start	10=Start	163	94	1	2	1	1

2.3.62 LD0.DEFHPDEF1 Directional earth-fault protection - high stage 1

Table 65: LD0.DEFHPDEF1 Directional earth-fault protection - high stage 1

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.DEFHPTOC1		High (1) stage							
.Str.general	START	-start	10=Start	163	96	1	2	1	1
.Op.general	OPERATE	-operate	10=Operate	163	98	1	2	0	1

2.3.63 LD0.INPHAR1 Three-phase inrush detection

Table 66: LD0.INPHAR1 Three-phase inrush detection

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.INPHAR1									
.Str.phsA	-	-phsA start	10=Start	167	64	0	2	1	1
.Str.phsB	-	-phsB start	10=Start	167	65	0	2	1	1
.Str.phsC	-	-phsC start	10=Start	167	66	0	2	1	1
.Str.general	-	-general start	10=Start	167	84	1	2	1	1

2.3.64 LD0.T1PTTR1 Thermal overload protection (1)

Table 67: LD0.T1PTTR1 Thermal overload protection (1)

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.T1PTTR1									
.Str.general	START	Start	10=Start	168	84	1	2	1	1
.AlmThm.general	ALARM	Thermal alarm	10=Alarm	168	85	1	2	1	1
.Op.general	OPERATE	Operate	10=Operate	168	90	1	2	0	1

2.3.65 LD0.DARREC1 Autorecloser

Table 68: LD0.DARREC1 Autorecloser

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.DARREC1									
.RsRec.ctfVal	-	AR reset	10=Reset	169	19	1	20	0	1
.RsCnt.ctfVal	-	AR counters reset	10=Reset	169	20	1	20	0	1
.PrgRec1.stVal	INPRO_1	AR 1st reclose	10=In progress	169	101	1	2	0	1
.PrgRec2.stVal	INPRO_2	AR 2nd reclose	10=In progress	169	102	1	2	0	1
.PrgRec3.stVal	INPRO_3	AR 3rd reclose	10=In progress	169	103	1	2	0	1
.PrgRec4.stVal	INPRO_4	AR 4th reclose	10=In progress	169	104	1	2	0	1
.PrgRec5.stVal	INPRO_5	AR 5th reclose	10=In progress	169	105	1	2	0	1
.PrgRec.stVal	INPRO	AR in progress	10=In progress	169	120	1	2	0	1
.CBManCls.stVal	MAN_CB_CL	CB manually closed	10=CB closed	169	159	1	2	0	1
.LO.stVal	LOCKED	Lockout status	10=Lockout	169	164	1	2	0	1
.UnsRec.stVal	UNSUC_RECL	Reclose fail status	10=Failed	169	170	1	2	0	1
.RdyRec.stVal	READY	Ready reclose status	10=Ready	169	172	1	2	0	1
.ActRec.stVal	ACTIVE	Active reclose status	10=Active	169	173	1	2	0	1
.PrgDsr.stVal	DISCR_INPRO	Discrimination time in p.	10=In progress	169	174	1	2	0	1
.PrgCutOut.stVal	CUTOUT_INPRO	Cutout time in progress	10=In progress	169	175	1	2	0	1
.FrqOpAlm.stVal	FRQ_OP_ALM	Frequent operation alarm	10=Alarm	169	176	1	2	0	1

Table continues on next page

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
.Op.general	CLOSE_CB	Operate (close XCBR)	10=Close CB	169	179	1	2	0	1
.OpOpn.general	OPEN_CB	Operate (open XCBR)	10=Open CB	169	180	1	2	0	1
.UnsCBCIs.stVal	UNSUC_CB	CB closing failed	10=Failed	169	181	1	2	0	1
.WtMstr.stVal	CMD_WAIT	Master signal to follower	10=Signal	169	182	1	2	0	1

2.3.66 LD0.CMMXU1 Phase currents (1) limit supervision

Table 69: LD0.CMMXU1 Phase currents (1) limit supervision

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.CMMXU1									
.HiAlm.stVal	HIGH_ALARM	High alarm	10=Alarm	210	1	1	1	1	1
.HiWrn.stVal	HIGH_WARN	High warning	10=Warning	210	2	1	1	1	1
.LoWrn.stVal	LOW_WARN	Low warning	10=Warning	210	3	1	1	1	1
.LoAlm.stVal	LOW_ALARM	Low alarm	10=Alarm	210	4	1	1	1	1

2.3.67 LD0.RESCMMXU1 Residual current (1) limit supervision

Table 70: LD0.RESCMMXU1 Residual current (1) limit supervision

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.RESCMMXU1									
.HiAlm.stVal	HIGH_ALARM	High alarm	10=Alarm	210	11	0	1	1	1
.HiWrn.stVal	HIGH_WARN	High warning	10=Warning	210	12	0	1	1	1

2.3.68 LD0.VMMXU1 Phase voltage (1) limit supervision

Table 71: LD0.VMMXU1 Phase voltage (1) limit supervision

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.VMMXU1									
.HiAlm.stVal	HIGH_ALARM	High alarm	10=Alarm	211	1	1	1	1	1
.HiWrn.stVal	HIGH_WARN	High warning	10=Warning	211	2	1	1	1	1
.LoWrn.stVal	LOW_WARN	Low warning	10=Warning	211	3	1	1	1	1
.LoAlm.stVal	LOW_ALARM	Low alarm	10=Alarm	211	4	1	1	1	1

2.3.69 LD0.RESVMMXU1 Residual voltage (1) limit supervision

Table 72: *LD0.RESVMMXU1 Residual voltage (1) limit supervision*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.RESVMMXU1									
.HiAlm.stVal	HIGH_ALARM	High alarm	10=Alarm	211	11	1	1	1	1
.HiWrn.stVal	HIGH_WARN	High warning	10=Warning	211	12	1	1	1	1

2.3.70 CTRL.Cxxxxx1 Circuit breaker (1) CB object and failure protection

Table 73: *CTRL.Cxxxxx1 Circuit breaker (1) CB object and failure protection*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
CTRL.CBCILO1									
.EnaOpn.stVal	ENA_OPEN	Open enabled	10=Enabled	240	21	1	1	1	1
.EnaCls.stVal	ENA_CLOSE	Close enabled	10=Enabled	240	22	1	1	1	1
.ItlByPss.stVal	ITL_BYPASS	Interlocking bypass	10=Bypassed	240	25	0	1	1	1
CTRL.CBXCBR1									
.BlkOpn.stVal	BLK_OPEN	Open blocked	10=Blocked	240	23	1	1	1	1
.BlkCls.stVal	BLK_CLOSE	Close blocked	10=Blocked	240	24	1	1	1	1
CTRL.CCBBRBF1									
.Str.general	CB_FAULT_AL	Start, timer running	10=Start	240	101	0	2	1	1
.OpEx.general	TRBU	Failure, ext trip	10=Failure	240	102	0	2	0	1
.OpIn.general	TRRET	Operate, retrip	10=Operate	240	103	0	2	0	1
CTRL.CBCSWI1									
.stSeld.stVal	SELECTED	CB selected	10=Selected	240	120	1	1	1	1
.Pos.stVal/ctlVal	POSITION	CB pos/control	10/01=Close/Open	240	160	1	1,20	1	2

2.3.71 LD0.SSCBR1 Circuit breaker (1) condition monitoring

Table 74: *LD0.SSCBR1 Circuit breaker (1) condition monitoring*

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.SSCBR1									
.RsAccAPwr.ctlVal	RST_IPOW	Accumul. energy reset	10=Reset	242	19	1	20	0	1
.RsCBWear.ctlVal	RST_CB_WEAR	CB life/op.counters reset	10=Reset	242	20	1	20	0	1
.RsTrvTm.ctlVal	RST_TRV_T	Travel time alarm reset	10=Reset	242	21	1	20	0	1
.RsSprChaTm.ctlVal	RST_SPR_T	Charge time alarm reset	10=Reset	242	22	1	20	0	1
.OpnAlm.stVal	TRV_T_OP_ALM	Opn travel time alarm	10=Alarm	242	101	0	1	0	1
.ClsAlm.stVal	TRV_T_CL_ALM	Cls travel time alarm	10=Alarm	242	102	0	1	0	1
.SprChaAlm.stVal	SPR_CHR_ALM	Spring charge time alarm	10=Alarm	242	103	0	1	0	1

Table continues on next page

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
.OpNumAlm.stVal	OPR_ALM	CB operations alarm	10=Alarm	242	104	0	1	0	1
.OpNumLO.stVal	OPR_LO	CB operations lockout	10=Lockout	242	105	0	1	0	1
.LonTmAlm.stVal	MON_ALM	CB inactive alarm	10=Alarm	242	106	0	1	0	1
.PresAlm.stVal	PRES_ALM	Low pressure alarm	10=Alarm	242	107	0	1	0	1
.PresLO.stVal	PRES_LO	Low pressure lockout	10=Lockout	242	108	0	1	0	1
.APwrAlm.stVal	IPOW_ALM	lyt alarm	10=Alarm	242	109	0	1	0	1
.APwrLO.stVal	IPOW_LO	lyt lockout	10=Lockout	242	110	0	1	0	1
.CBLifAlm.stVal	CB_LIFE_ALM	CB lifetime alarm	10=Alarm	242	111	0	1	0	1

2.3.72 CTRL.DCXSWI1 Disconnecter (1) - controllable object

Table 75: CTRL.DCXSWI1 Disconnecter (1) - controllable object

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
CTRL.DCCIO1									
.EnaOpn.stVal	ENA_OPEN	Open enabled	10=Enabled	245	21	1	1	1	1
.EnaCls.stVal	ENA_CLOSE	Close enabled	10=Enabled	245	22	1	1	1	1
.ItlByPss.stVal	ITL_BYPASS	Interlocking bypass	10=Bypassed	245	25	1	1	1	1
CTRL.DCXSWI1									
.BlkOpn.stVal	BLK_OPEN	Open blocked	10=Blocked	245	23	1	1	1	1
.BlkCls.stVal	BLK_CLOSE	Close blocked	10=Blocked	245	24	1	1	1	1
CTRL.DCCSWI1									
.stSeld.stVal	SELECTED	DC selected	10=Selected	245	120	1	1	1	1
.Pos.stVal/ctlVal	POSITION	DC pos/control	10/01=Close/Open	245	160	1	1,20	1	2

2.3.73 CTRL.DCXSWI2 Disconnecter (2) - controllable object

Table 76: CTRL.DCXSWI2 Disconnecter (2) - controllable object

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
CTRL.DCCIO2									
.EnaOpn.stVal	ENA_OPEN	Open enabled	10=Enabled	246	21	1	1	1	1
.EnaCls.stVal	ENA_CLOSE	Close enabled	10=Enabled	246	22	1	1	1	1
.ItlByPss.stVal	ITL_BYPASS	Interlocking bypass	10=Bypassed	246	25	1	1	1	1
CTRL.DCXSWI2									
.BlkOpn.stVal	BLK_OPEN	Open blocked	10=Blocked	246	23	1	1	1	1
.BlkCls.stVal	BLK_CLOSE	Close blocked	10=Blocked	246	24	1	1	1	1
CTRL.DCCSWI2									
.stSeld.stVal	SELECTED	DC selected	10=Selected	246	120	1	1	1	1
.Pos.stVal/ctlVal	POSITION	DC pos/control	10/01=Close/Open	246	160	1	1,20	1	2

2.3.74 CTRL.ESXSWI1 Earth switch - controllable object

Table 77: CTRL.ESXSWI1 Earth switch - controllable object

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
CTRL.ESCILO1									
.EnaOpn.stVal	ENA_OPEN	Open enabled	10=Enabled	247	21	1	1	1	1
.EnaCls.stVal	ENA_CLOSE	Close enabled	10=Enabled	247	22	1	1	1	1
.ItlByPss.stVal	ITL_BYPASS	Interlocking bypass	10=Bypassed	247	25	1	1	1	1
CTRL.ESXSWI1									
.BlkOpn.stVal	BLK_OPEN	Open blocked	10=Blocked	247	23	1	1	1	1
.BlkCls.stVal	BLK_CLOSE	Close blocked	10=Blocked	247	24	1	1	1	1
CTRL.ESCSWI1									
.stSeld.stVal	SELECTED	ES selected	10=Selected	247	120	1	1	1	1
.Pos.stVal/ctlVal	POSITION	ES pos/control	10/01=Close/Open	247	160	1	1,20	1	2

2.3.75 CTRL.DCSXSWI1 Disconnecter (1) - non-controllable object

Table 78: CTRL.DCSXSWI1 Disconnecter (1) - non-controllable object

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
CTRL.DCSXSWI1									
.Pos.stVal	POSITION	Disconnecter 1 pos	10/01=Close/Open	253	1	1	1	1	2

2.3.76 CTRL.DCSXSWI2 Disconnecter (2) - non-controllable object

Table 79: CTRL.DCSXSWI2 Disconnecter (2) - non-controllable object

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
CTRL.DCSXSWI2									
.Pos.stVal	POSITION	Disconnecter 2 pos	10/01=Close/Open	253	2	1	1	1	2

2.3.77 CTRL.DCSXSWI3 Disconnecter (3) - non-controllable object

Table 80: CTRL.DCSXSWI3 Disconnecter (3) - non-controllable object

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
CTRL.DCSXSWI3									
.Pos.stVal	POSITION	Disconnecter 3 pos	10/01=Close/Open	253	3	1	1	1	2

2.3.78 CTRL.ESSXSWI1 Earth switch (1) - non-controllable object

Table 81: CTRL.ESSXSWI1 Earth switch (1) - non-controllable object

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
CTRL.ESSXSWI1									
.Pos.stVal	POSITION	Earth switch pos	10/01=Close/Open	253	11	1	1	1	2

2.3.79 CTRL.ESSXSWI2 Earth switch (2) - non-controllable object

Table 82: CTRL.ESSXSWI2 Earth switch (2) - non-controllable object

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
CTRL.ESSXSWI2									
.Pos.stVal	POSITION	Earth switch pos	10/01=Close/Open	253	12	1	1	1	2

2.3.80 LD0.LEDGGIO1 LHMI LED indications Type 1 (2 states)

Table 83: LD0.LEDGGIO1 LHMI LED indications Type 1 (2 states)

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.LEDGGIO1									
.ISCSO1.stVal	-	LED 1 state	10=On	253	89	1	1	1	1
.ISCSO2.stVal	-	LED 2 state	10=On	253	90	1	1	1	1
.ISCSO3.stVal	-	LED 3 state	10=On	253	91	1	1	1	1
.ISCSO4.stVal	-	LED 4 state	10=On	253	92	1	1	1	1
.ISCSO5.stVal	-	LED 5 state	10=On	253	93	1	1	1	1
.ISCSO6.stVal	-	LED 6 state	10=On	253	94	1	1	1	1
.ISCSO7.stVal	-	LED 7 state	10=On	253	95	1	1	1	1
.ISCSO8.stVal	-	LED 8 state	10=On	253	96	1	1	1	1
.ISCSO9.stVal	-	LED 9 state	10=On	253	97	1	1	1	1
.ISCSO10.stVal	-	LED 10 state	10=On	253	98	1	1	1	1
.ISCSO11.stVal	-	LED 11 state	10=On	253	99	1	1	1	1

2.3.81 LD0.LEDGGIO1 LHMI LED indications Type 2 (3 states)

Table 84: LD0.LEDGGIO1 LHMI LED indications Type 2 (3 states)

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
LD0.LEDGGIO1									
.ISCSO1.stVal	-	LED 1 state	01=Ok;10=Alarm	253	119	1	1	0	2
.ISCSO2.stVal	-	LED 2 state	01=Ok;10=Alarm	253	120	1	1	0	2
.ISCSO3.stVal	-	LED 3 state	01=Ok;10=Alarm	253	121	1	1	0	2
Table continues on next page									

IEC 61850 name	SA name	Description	DPI value	FUN	INF	U	ASDU	I	C
.ISCSO4.stVal	-	LED 4 state	01=Ok;10=Alarm	253	122	1	1	0	2
.ISCSO5.stVal	-	LED 5 state	01=Ok;10=Alarm	253	123	1	1	0	2
.ISCSO6.stVal	-	LED 6 state	01=Ok;10=Alarm	253	124	1	1	0	2
.ISCSO7.stVal	-	LED 7 state	01=Ok;10=Alarm	253	125	1	1	0	2
.ISCSO8.stVal	-	LED 8 state	01=Ok;10=Alarm	253	126	1	1	0	2
.ISCSO9.stVal	-	LED 9 state	01=Ok;10=Alarm	253	127	1	1	0	2
.ISCSO10.stVal	-	LED 10 state	01=Ok;10=Alarm	253	128	1	1	0	2
.ISCSO11.stVal	-	LED 11 state	01=Ok;10=Alarm	253	129	1	1	0	2

2.4 Class 2 data measurands

Class 2 data measurands use ASDU type 9, function type 10 and information number 236 for frame 6 and 237 for frame 7.

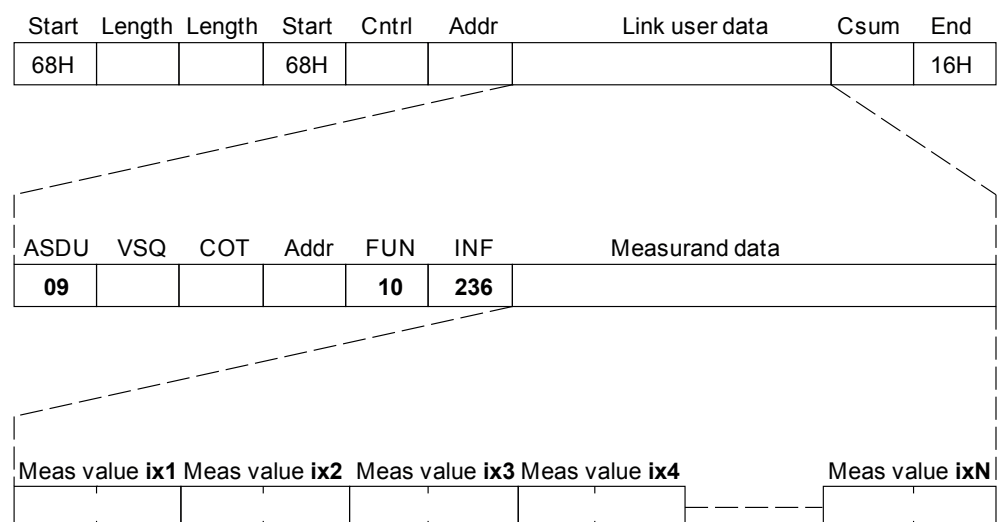


Figure 1: Class 2 frame response in the predefined private Class 2 frames, numbers 6 or 7

The data value indexes, named ix in the Class 2 point list table, runs from 1 to N. Each measurand data value occupies two data octets. The indexes in the Class 2 point list table are necessarily not presented in incremental order. Indexes are common for frame numbers 6 and 7. Indexes containing an asterisk (*) are only relevant for frame number 7. Index 999 means that objects are available but not pre-mapped to any Class 2 frame.

The user can freely compose an own private Class 2 frame using PCM600. The Function Type and the Information Number for this user-definable Class 2 frame can be configured through the setting parameters. Default values are FUN = 10, INF = 230.

Table 85: *Explanations of the class 2 data measurands table columns*

Column name	Description
IEC 61850 name	Original IED data object identification. Described in the IEC 61850 format as Logical Device.Logical Node and thereafter .Data Object.Data Attribute. Logical Node is the same as the application function block name.
Description	Short description of the signal. See the application function block documentation for more details.
Scale	Absolute IED object value that corresponds to the IEC 60870-5-103 maximum value.
ix (F-a)	F-a relates to variants FE01, 02, 03, 04.
ix (F-b)	F-b to variants FE05, 06, 07, 08 and 09.

2.4.1

Class 2 private measurand data (6 and 7)

Table 86: *Class 2 private measurand data (6 and 7)*

IEC 61850 name	Description	Scale	ix (F-a)	ix (F-b)
LD0.CMMXU1 Phase currents (1)				
LD0.CMMXU1	Phase-to-ground current			
.A.phsA.cVal.mag	-phsA magnitude	2.4	1	1
.A.phsB.cVal.mag	-phsB magnitude	2.4	2	2
.A.phsC.cVal.mag	-phsC magnitude	2.4	3	3
LD0.RESCMMXU1 Residual current (1)				
LD0.RESCMMXU1	Residual current			
.A.res.cVal.mag	-magnitude	2.4	4	4
LD0.RESVMMXU1 Residual voltage (1)				
LD0.RESVMMXU1	Residual voltage			
.PhV.res.cVal.mag	-magnitude	2.4	5	5
LD0.CSMSQI1 Sequence of currents (1)				
LD0.CSMQI1	Sequence of currents			
.SeqA.c1.cVal.mag	-positive magnitude	2.4	6	6
.SeqA.c2.cVal.mag	-negative magnitude	2.4	7	7
.SeqA.c3.cVal.mag	-zero magnitude	2.4	8	8
LD0.T1PTTR1 Temperature of protected object (T1)				
LD0.T1PTTR1				
.Tmp.mag	Temperature	1000	9	9
LD0.CMSTA1 Demand currents (1)				
LD0.CMSTA1	Phase-current demands			
.AvAmpsA.mag	-phsA magnitude	2.4	10*	24*
.AvAmpsB.mag	-phsB magnitude	2.4	11*	25*
.AvAmpsC.mag	-phsC magnitude	2.4	12*	26*
LD0.VMMXU1 Voltage measurands (1)				
Table continues on next page				

IEC 61850 name	Description	Scale	ix (F-a)	ix (F-b)
LD0.VMMXU1.phV	Phase-to-ground voltage			
.phsA.cVal.mag	-phsA magnitude	2.4		10
.phsB.cVal.mag	-phsB magnitude	2.4		11
.phsC.cVal.mag	-phsC magnitude	2.4		12
LD0.VMMXU1.PPV	Phase-to-phase voltage			
.phsAB.cVal.mag	-phsAB magnitude	2.4		13
.phsBC.cVal.mag	-phsBC magnitude	2.4		14
.phsCA.cVal.mag	-phsCA magnitude	2.4		15
LD0.VSMSQI1 Sequence of voltages (1)				
LD0.VSMSQI1	Sequence of voltages			
.SeqA.c1.cVal.mag	-positive magnitude	2.4		16
.SeqA.c2.cVal.mag	-negative magnitude	2.4		17
.SeqA.c3.cVal.mag	-zero magitude	2.4		18
LD0.PEMMXU1 Power measurands (1)				
LD0.PEMMXU1				
.TotW.instMag	Active power P value	1000		19
.TotVAr.instMag	Reactive power Q value	1000		20
.TotVA.instMag	Apparent power S value	1000		21
.TotPF.instMag	Power factor value	1		22
LD0.FMMXU1 Frequency measurement (1)				
LD0.FMMXU1				
.Hz.Mag	Frequency value	100		23
LD0.HAEFMHAI1 Current harmonics (1)				
LD0.HAEFMHAI1				
.HRmsA.res.cVal.mag	Current harmonics	250		999

Section 3 Interoperability profile for 615 series IEC 60870-5-103

3.1 Physical layer

3.1.1 Electrical interface

- ☒ EIA RS-485
- ☐ Number of loads for one protection equipment

NOTE - EIA RS-485 standard defines unit loads so that 32 of them can be operated on one line.
For detailed information refer to clause 3 of EIA RS-485 standard.

3.1.2 Optical interface

- ☒ Glass fibre
- ☐ Plastic fibre
- ☐ F-SMA type connector
- ☐ BFOC/2,5 type connector

3.1.3 Transmission speed

- ☒ 9 600 bit/s
- ☒ 19 200 bit/s

3.2 Link layer

There are no choices for the link layer.

3.3 Application layer

3.3.1 Transmission mode for application data

Mode 1 (least significant octet first), as defined in 4.10 of IEC 60870-5-4, is used exclusively in this companion standard.

3.3.2 COMMON ADDRESS of ASDU

- ☒ One COMMON ADDRESS OF ASDU (identical with station address)
- ☐ More than one COMMON ADDRESS OF ASDU

3.3.3 Selection of standard information numbers in monitor direction

3.3.3.1 System functions in monitor directions

	INF	Semantics
☒	<0>	End of general interrogation
☒	<0>	Time synchronization
☒	<2>	Reset FCB
☒	<3>	Reset CU
☒	<4>	Start/restart
☒	<5>	Power on

3.3.3.2 Status indications in monitor direction

	INF	Semantics
☒	<16>	Auto-recloser active 1
☐	<17>	Teleprotection active
☐	<18>	Protection active
☐	<19>	LED reset
☐	<20>	Monitor direction blocked
☒	<21>	Test mode
☐	<22>	Local parameter setting
☒	<23>	Characteristic 1
☒	<24>	Characteristic 2
☒	<25>	Characteristic 3
☒	<26>	Characteristic 4

Table continues on next page

- | | | |
|--------------------------|------|-------------------|
| ☐ | <27> | Auxiliary input 1 |
| ☐ | <28> | Auxiliary input 2 |
| ☐ | <29> | Auxiliary input 3 |
| ☐ | <30> | Auxiliary input 4 |

Note <27>...<30>: Depending on Binary I/O options and application usage there may be additional auxiliary inputs available in the IED. As default, all "raw" binary input data are mapped to private data. It is possible for user to re-map these additional inputs into standard <27>...<30> 'Auxiliary Inputs', if wanted.

3.3.3.3

Supervision indications in monitor direction

- | | INF | Semantics |
|-------------------------------------|------|----------------------------|
| ☐ | <32> | Measurand supervision I |
| ☐ | <33> | Measurand supervision V |
| ☐ | <35> | Phase sequence supervision |
| ☒ | <36> | Trip circuit supervision |
| ☐ | <37> | I>> back-up operation |
| ☐ | <38> | VT fuse failure |
| ☐ | <39> | Teleprotection disturbed |
| ☐ | <46> | Group warning |
| ☐ | <47> | Group alarm |

Note <32>, <33> and <38>: IED current and voltage measurement supervision signals and alarms are found in private data definitions. Semantics of these signals are more complex in this IED series than what is defined by the IEC 60870-5-103 standard.

3.3.3.4

Earth fault indications in monitor direction

- | | INF | Semantics |
|--------------------------|------|---|
| ☐ | <48> | Earth fault L ₁ |
| ☐ | <49> | Earth fault L ₂ |
| ☐ | <50> | Earth fault L ₃ |
| ☐ | <51> | Earth fault forward, for example line |
| ☐ | <52> | Earth fault reverse, for example busbar |

Note: In this IED series there exist different functions (and signals) for non-directional or directional earth fault protection. Function- and stage-dependent start/pickup signals are found in private data locations.

3.3.3.5

Fault indications in monitor direction

- | | INF | Semantics |
|--------------------------|------|-------------------------------|
| ☐ | <64> | Start /pick-up L ₁ |
| ☐ | <65> | Start /pick-up L ₂ |

Table continues on next page

- | | | |
|-------------------------------------|------|--------------------------------------|
| ☐ | <66> | Start /pick-up L ₃ |
| ☐ | <67> | Start /pick-up N |
| ☒ | <68> | General trip |
| ☐ | <69> | Trip L ₁ |
| ☐ | <70> | Trip L ₂ |
| ☐ | <71> | Trip L ₃ |
| ☐ | <72> | Trip I>> (back-up operation) |
| ☐ | <73> | Fault location X in ohms |
| ☐ | <74> | Fault forward/line |
| ☐ | <75> | Fault reverse/busbar |
| ☐ | <76> | Teleprotection signal transmitted |
| ☐ | <77> | Teleprotection signal received |
| ☐ | <78> | Zone 1 |
| ☐ | <79> | Zone 2 |
| ☐ | <80> | Zone 3 |
| ☐ | <81> | Zone 4 |
| ☐ | <82> | Zone 5 |
| ☐ | <83> | Zone 6 |
| ☐ | <84> | General start/pick-up |
| ☒ | <85> | Breaker failure |
| ☐ | <86> | Trip measuring system L ₁ |
| ☐ | <87> | Trip measuring system L ₂ |
| ☐ | <88> | Trip measuring system L ₃ |
| ☐ | <89> | Trip measuring system E |
| ☐ | <90> | Trip I> |
| ☐ | <91> | Trip I>> |
| ☐ | <92> | Trip IN> |
| ☐ | <93> | Trip IN>> |

Note: In this IED series, function-specific fault signals are as default mapped to private data locations.

3.3.3.6

Auto-reclosure indications in monitor direction

- | | INF | Semantics |
|-------------------------------------|-------|-------------------------|
| ☒ | <128> | CB 'on' by AR |
| ☐ | <129> | CB 'on' by long-time AR |
| ☒ | <130> | AR blocked |

Note <129>: Terms 'short-' or 'long-time' AR are not directly usable in this IED series. The AR functionality in the IED performs AR shots (1..5) that are user configurable. See private AR data definitions. Depending on user AR configuration it is possible to re-map some private data into standard data, if wanted.

3.3.3.7 Measurands in monitor direction

INF	Semantics
☒ <144>	Measurand I
☒ <145>	Measurands I, V
☒ <146>	Measurands I, V, P, Q
☒ <147>	Measurands I_N , V_{EN}
☒ <148>	Measurands $I_{L1,2,3}$, $V_{L1,2,3}$, P, Q, f

3.3.3.8 Generic functions in monitor direction

INF	Semantics
☐ <240>	Read headings of all defined groups
☐ <241>	Read values or attributes of all entries of one group
☐ <243>	Read directory of a single entry
☐ <244>	Read value or attribute of a single entry
☐ <245>	End of general interrogation of generic data
☐ <249>	Write entry with confirmation
☐ <250>	Write entry with execution
☐ <251>	Write entry aborted

3.3.4 Selection of standard information numbers in control direction**3.3.4.1 System functions in control direction**

INF	Semantics
☒ <0>	Initiation of general interrogation
☒ <0>	Time synchronization

3.3.4.2 Generic functions in monitor direction

INF	Semantics
☐ <240>	Read headings of all defined groups
☐ <241>	Read values or attributes of all entries of one group
☐ <243>	Read directory of a single entry
☐ <244>	Read value or attribute of a single entry
☐ <245>	End of general interrogation of generic data
☐ <249>	Write entry with confirmation
☐ <250>	Write entry with execution
☐ <251>	Write entry aborted

3.3.5 Basic application functions

- ☒ Test mode
- ☐ Blocking of monitor direction
- ☒ Disturbance data
- ☐ Generic services
- ☒ Private data

3.3.6 Miscellaneous

Measurands are transmitted as Class2 data using ASDU 3 or ASDU 9. The default MVAL scalings in this IED series is 2.4. The MVAL for each separate measurand can be freely reprogrammed.

Measurand	Max. MVAL = rated value times	
	1.2 or	2.4
Current L ₁	☒	☒
Current L ₂	☒	☒
Current L ₃	☒	☒
Voltage L _{1-E}	☒	☒
Voltage L _{2-E}	☒	☒
Voltage L _{3-E}	☒	☒
Active power P	☒	☒
Reactive power Q	☒	☒
Frequency f	☒	☒
Voltage L ₁ - L ₂	☒	☒

The IED contains additional private Class2 frames, including private measurands. User can freely select between standard or private Class2 frames.



If some required application data is not included in the interoperability profile chapter, it does not necessarily mean that it is missing from the IED. For example, the data is available in the IED, but it does not create timetagged change events which are required for Class1 data, or the data in the IED is not defined like in the IEC 60870-5-103 standard. Map this missing data into generic application object points using Application Configuration tool. The protocol identification (function type, information number) for the generic points can thereafter be freely modified by PCM600. Refer to the point list for the outlook and default definitions of the generic application object points.

Section 4 Glossary

AR	Autoreclosing
EMC	Electromagnetic compatibility
HMI	Human-machine interface
IEC	International Electrotechnical Commission
IEC 60870-5-103	1. Communication standard for protective equipment 2. A serial master/slave protocol for point-to-point communication
IEC 61850	International standard for substation communication and modeling
IED	Intelligent electronic device
IET600	Integrated Engineering Toolbox in PCM600
LHMI	Local human-machine interface
PCM600	Protection and Control IED Manager

Contact us

ABB Oy

**Medium Voltage Products,
Distribution Automation**

P.O. Box 699

FI-65101 VAASA, Finland

Phone +358 10 22 11

Fax +358 10 22 41094

ABB Limited

Distribution Automation

Maneja

Vadodara 390013, India

Phone +91 265 2604032

Fax +91 265 2638922

www.abb.com/substationautomation