



Switching gears

Moving to smart switch-gear for primary and secondary substations

VINCENZO BALZANO, MARTIN CELKO – Medium-voltage (MV) distribution systems are undergoing a revolution: Gone are the days when they merely distributed power of consistent quality from some far-off generator and performed basic switching and protection duties. Now, intermittent local generators, such as wind and solar sources, present a more complex energy flow for the distribution equipment to handle. Further, there are heightened quality and reliability expectations from operators and consumers. This puts the onus on utilities to make sure their often aging grids become safer, smarter, more efficient, more reliable and more environmentally friendly, and in addition, easier to engineer, install and operate. This is why MV distribution networks are becoming “smart.” To address the demand for smart switchgear, ABB has developed the UniGear Digital concept for primary substations and the SafeRing, SafePlus and UniSec products for secondary substations.



Major changes are running through the power industry: On top of industry-mandated indices like the system average interruption duration index (SAIDI) and system average interruption frequency index (SAIFI), many states are introducing a range of other grid efficiency regulations. Further, the energy generator and consumer landscape is becoming more mixed and more sophisticated with intermittent generators like solar and wind sources jostling for grid access and major new consumers, like data centers, placing stringent demands on power providers.

All this is happening to an infrastructure that has changed little since its inception in the early 1900s. This situation has led to the genesis of the so-called smart grid. At the power distribution level, the smart grid offers an intelligent way to approach grid efficiency and reliability, and provides a solid foundation for the automation, and remote monitoring and control of switching. But smart distribution needs smart products, at both the primary and secondary substation levels.

Title picture

Improved levels of automation and communication in substations give central operators the ability to optimize grid operation. ABB's smart switchgear enables this optimization at the primary and secondary substation levels.

ABB UniGear Digital

ABB's UniGear Digital is not just the next version of an established product. Rather, it is a new concept – a new way of going about MV switchgear. The concept combines well-proven switchgear design with an innovative approach to protection, control, measurement and digital communication. It is based on an optimized integration of current and voltage sensors into MV switchgear, combined with the latest intelligent electronic devices (IEDs) and IEC 61850 communication. The concept is embodied in the UniGear ZS1, an ABB MV air-insulated switchgear (AIS) for primary substations.

This switchgear is produced locally around the world and more than 200,000 UniGear panels have already been installed in more than 100 countries. The UniGear ZS1 is used in demanding locations such as offshore platforms, container or cruise ships and mines, as well as in the more common applications, like utility substations, power plants, chemical plants, etc.

Lower cost and easier setup

With the UniGear Digital concept, “one size fits all,” so there is no need to change primary MV components, for example, instrument transformers, if the load changes. This saves time and money during project planning and execution.

The smart grid offers an intelligent way to approach grid efficiency and reliability, and provides a solid foundation for the automation, and remote monitoring and control of switching.

Energy losses during operation are lower with the UniGear Digital than with equivalent devices: Instrument transformer losses are eliminated and this can save around 250 MWh over the 30-year life of a typical substation. This represents a reduction of about 150t of CO₂ emissions.


Costs are also reduced because the UniGear Digital has fewer live parts, so outages are less frequent and troubleshooting effort is reduced. UniGear Digital takes up less space in the substation – a real cost-saver where real estate is expensive or limited.



Setup is easier too. The streamlined setup procedure eliminates the necessity, in many cases, to define details such as relay parameters, current transformer (CT) data and voltage transformer (VT) data. CT/VT data does not have to be calculated, checked and approved, and last-minute changes can be realized in the IED logic. IEDs are perfectly suited to protection, control, measurement and supervision duties concerning utility and industrial power distribution – including radial, looped and meshed networks.

Using the IEC 61850 standard, the international standard for electrical system automation, further simplifies things. Protection and control IEDs publish signals for interlocking, blocking and tripping between panels via horizontal GOOSE communication. GOOSE (generic object-oriented substation events) – defined under the IEC 61850 standard – is a control model mechanism in which any format of data (status, value) is grouped into a data set and transmitted. GOOSE communication is becoming popular in substations as it offers simplicity, functionality, flexibility, easy scalability, improved diagnostics and faster performance.

The IEC 61850-9-2 LE process bus is also used by IEDs for transmitting sampled measured values (SMVs). UniGear Digital uses it for sharing busbar voltages, for example.

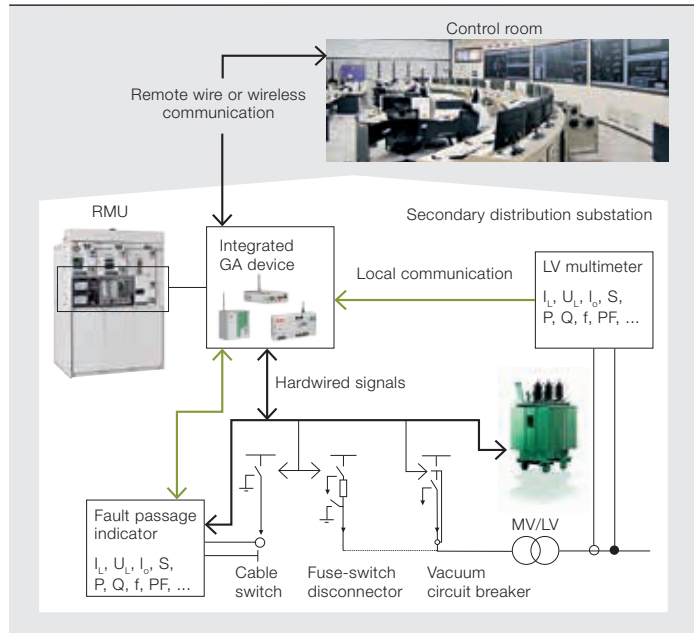

UniGear Digital combines well-proven switchgear design with an innovative approach to protection, control, measurement and digital communication.

Secondary substation automation products

Two elements are essential to enable the smart grid at the secondary substation level: automation of the secondary substation switchgear itself and the ability to communicate with the remote SCADA (supervisory control and data acquisition) system. ABB has products that address these: gas-insulated SafeRing and SafePlus ring main units (RMUs) and UniSec air-insulated switchgear.


SafeRing and SafePlus RMU gas-insulated switchgear (GIS) is designed with flexibility and compactness in mind → 1. Each consists of a completely sealed system with a stainless steel tank containing all the live parts.

4 Typical automation level features

Feature	Level name:			
	Monitoring	Control	Measurement	Protection
MV network switches position monitoring	x	x	x	x
MV network fault monitoring (including fault direction)	x	x	x	x
Distribution transformer feeders fault monitoring	x	x	x	x
MV network switches position control	n/a	x	x	x
MV network analog values measurement	n/a	n/a	x	x
Protection functions (including autorecloser)	n/a	n/a	n/a	x
MV network faults indication reset command	o	o	o	o
LV network analog values measurement	o	o	o	o
Distribution transformer feeders emergency trip command	o	o	o	o
Customer-specific signals (LV network faults, water intrusion, etc.)	x	x	x	x

x – available o – option n/a – not available/applicable

5 Nonavailability (SAIDI) of a network against number of MV substations equipped with remote control (RC) technology

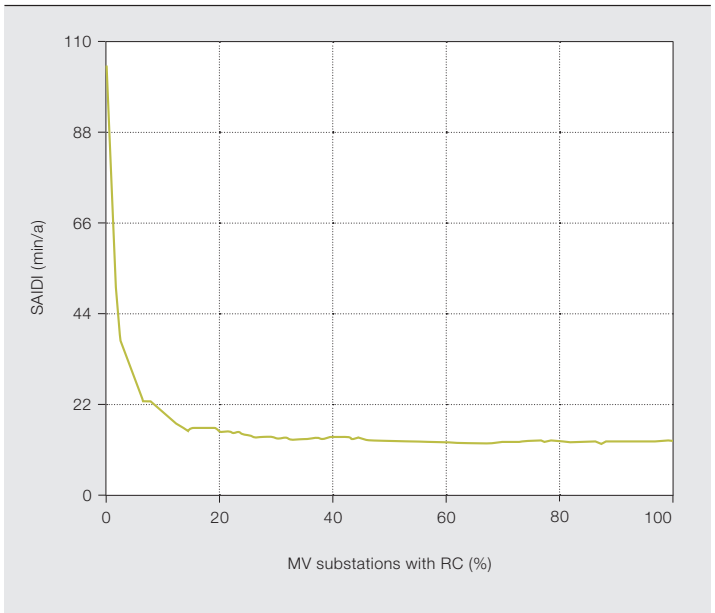

This virtually maintenance-free system ensures a high level of reliability and personnel safety.

UniSec AIS is based on a highly flexible, modular concept that can be readily configured to meet the specific needs of each application → 2. UniSec is used in secondary substations where normal environmental conditions prevail, no severe space restrictions apply and complex configurations and accessories – with, for example, MV instrument transformers or surge arresters – are required.

Secondary substation automation

To enable automation, MV switchgear is equipped with an advanced grid automation (GA) controller. This device collects data available within the substation, puts it into a standard communication protocol and transfers it to the remote control center for evaluation → 3.

This improved level of automation and communication in substations gives the remote operator the ability to adjust different operations in order to:

- Provide high-quality power at all times
- Reduce energy transport losses
- Enhance network stability

- Avoid (or shorten) outages
- Avoid overloading network components
- Improve maintenance planning
- Enhance field crew efficiency
- Optimize asset management

Different levels of remote automation are available for ABB secondary switchgear and the user can select the one that best suits his needs → 4. Each level comes with a predefined IED standard package,

The streamlined setup procedure eliminates the necessity, in many cases, to define details such as CT/VT data, and last minute changes can be realized in the IED logic.

which, in some cases, can even be integrated into the MV switchgear, thus eliminating the need for additional mounting space. Customization of these standard packages is also possible. All standard packages include:

- Power supply backup source for IEDs (24V DC batteries)
- Wired and/or wireless (GSM/GPRS) communication interfaces
- Preconfigured IEC 60870-5-104 remote protocol signals

Acea Distribution, an Italian utility, is committed to making electricity distribution in the MV and LV networks more intelligent, with the aim of making Rome a smarter city. Acea started with a pilot project – one of eight pilot projects in Italy approved and partially financed by the Authority for Electricity and Gas. For Acea, ABB is a partner in this venture, rather than just a supplier – indeed, a cooperation agreement was signed in this regard.

In the experimentation phase, ABB provided UniSec switchgear, current sensors, voltage sensors and IEDs for the secondary substations. The logic employed is based on IEC 61850 protocol. Inter-substation and control system communication use GOOSE, over a private wireless network.

The system is installed on a new portion of the Rome electrical distribution grid and will allow Acea to substantially reduce the number and average duration of service interruptions, with a consequent reduction in restoration times and penalties.


Energy losses during operation are lower with the UniGear Digital than with equivalent devices.

All IEDs installed within the switchgear or kiosk are factory preconfigured based on the standard package specification. The communication system details (IP addresses, access point name, SIM card PIN, etc.) and MV network parameters (fault pickup current, fault current pickup time, etc.) are usually configured on-site.

GA effectiveness

For a quick evaluation of the effectiveness of a particular GA solution, ABB uses an activity-based costing (ABC) calculation tool developed in cooperation with the National Technical University in Aachen, Germany. This allows calculation of, for example, the impact of a SafeRing installation and standard GA package on SAIDI → 5.

Smart switchgear is already making a big impression → 6–7. The smart grid is still in its infancy. Renewable sources,

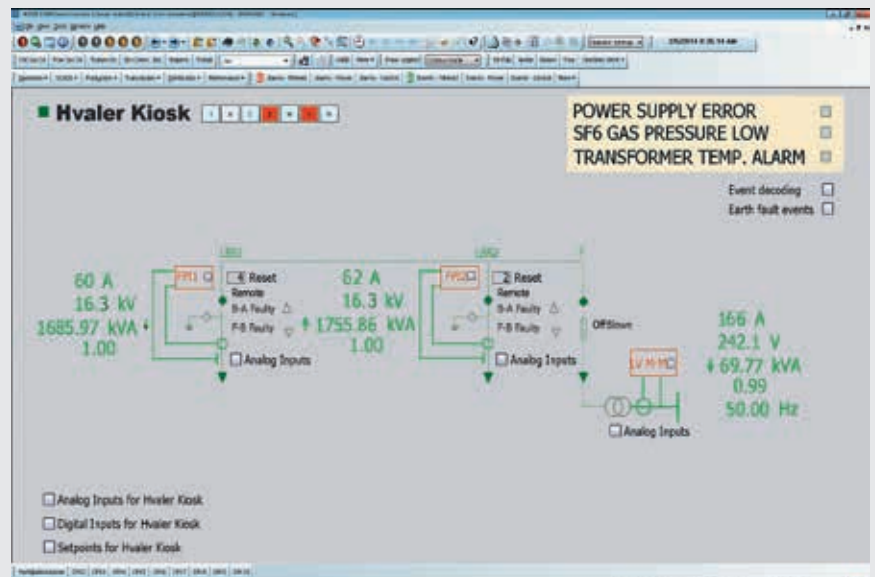

The island municipality of Hvaler in Østfold, Norway, was chosen to be the test laboratory for smart technology in MV and low-voltage (LV) distribution networks. This project is called DeVID (Demonstration and Verification of Intelligent Distribution networks) and is part of the Norwegian Smart Grid Centre.

The archipelago has a mix of homes that are occupied year-round, vacation condominiums, and commercial activity that provide the opportunity to study different electricity usage profiles.

Hvaler has 3,000 houses and 4,300 condominiums. The population increases from 4,000 in winter to 30,000 in summer, presenting a challenge for the entire infrastructure, including the power network.

ABB is one of several participants in DeVID and ABB's contribution is a Magnum compact secondary substation (CSS) with a SafeRing 24 kV switchgear that allows the local utility, Fredrikstad Energi, to locate any faults quickly and to monitor power quality and load in this part of the network.

The CSS is monitored via ABB's Network Manager SCADA, part of the company's Ventyx (enterprise) software portfolio; communication between SCADA and the CSS is via GSM. The two load break switches in the RMU can be controlled from the SCADA system and approximately 200 measurement parameters are monitored.

distributed generation and an increasingly complex and demanding network of power consumers are just some of the factors that will drive future product development in smart distribution switchgear.

This article was previously published in ABB Review Special Report Medium-voltage Products, 2014, pages 11–15.

Vincenzo Balzano

ABB Power Products
Dalmine, Italy
vincenzo.balzano@it.abb.com

Martin Celko

ABB Power Products, Medium Voltage Products
Brno, Czech Republic
martin.celko@cz.abb.com