


# SRIO 500M

## Data communication and reporting unit

User's manual and Technical description

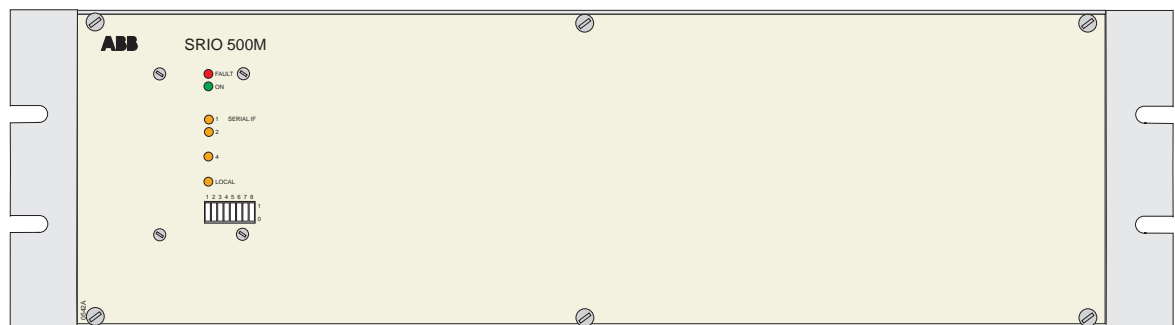

Issued 1996-10-23  
Modified 2002-10-09  
Version B (replaces 34 SRIO 500M 1 EN1)  
Checked MK  
Approved OL

# SRIO 500M

## Data communication and reporting unit

Data subject to change without notice

**Contents**

Features .....	2
Introduction .....	3
Applications .....	4
Substation and remote control systems .....	4
Functions .....	5
Event logging .....	5
Data acquisition .....	5
Real-time clock .....	5
Host interface, ANSI X3.28 protocol .....	6
Host interface, SACO 100M protocol .....	6
Programming .....	6
Mechanical and electrical design .....	7
Mechanical structure .....	7
Printed circuit boards .....	8
Memory chips on CPU and memory boards .....	8
Interfaces .....	9
Front panel .....	9
Serial interfaces .....	9
Connectors .....	9
Serial interface connector pin assignment .....	10
User selectable options .....	11
Power supply .....	11
Special purpose I/O .....	12
Technical data ( <i>modified 2002-10</i> ) .....	13
Maintenance and service .....	14
Self diagnostics .....	14
Fault localization .....	14
Service and spare parts .....	15
Ordering information .....	15

**Features**


Interface unit between a host level system and the SPACOM system	Three serial interfaces: No 1: host computer or programming terminal interface
Host interface unit using the ANSI X3.28 or SACO 100M protocol	No 2: SPA-bus interface No 4: programming terminal or event printer interface
Data base of max. 500 data items	
Event buffer of max. 500 events	

## Introduction

SRIO 500M is a data communication and reporting unit for the SPACOM system. The SPACOM system may incorporate slave devices such as protective relays, control units and annunciator units, capable of communicating via the SPA bus.

The task of the SRIO 500M unit is to form the master unit of the SPA bus, to connect the SPACOM system to a host computer.

The SRIO 500M unit connects to the host computer using the ANSI X3.28 or the SACO 100M protocol. The ANSI X3.28 protocol is used with the SCS 100 or S.P.I.D.E.R Micro-SCADA control systems. The SACO 100M protocol can be used for the communication with, for example, a personal computer or a control system of a foreign manufacturer.

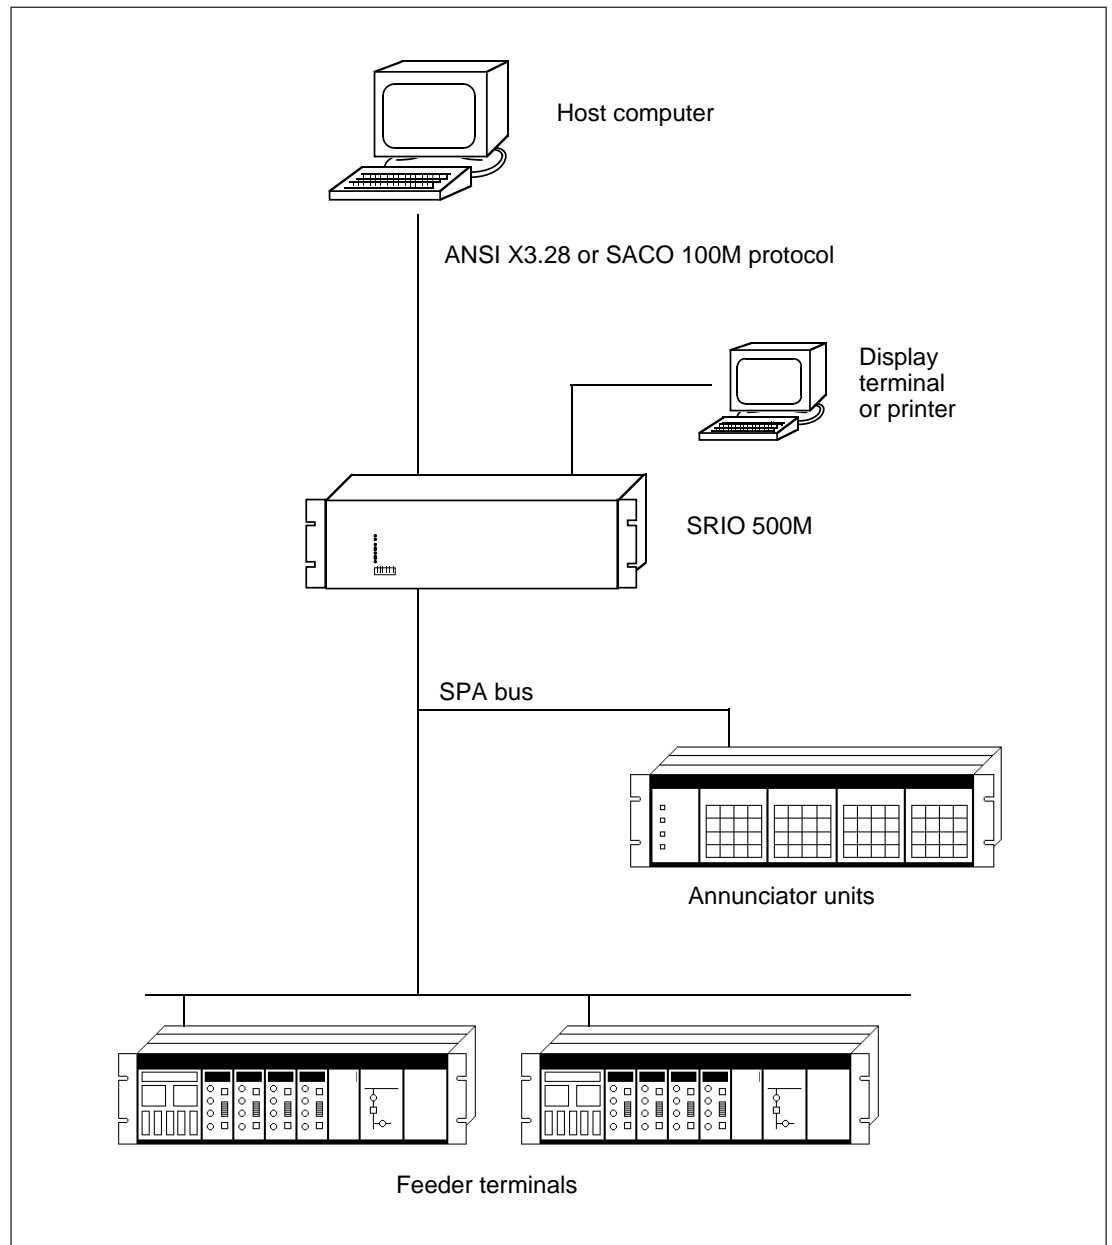

## Applications

Substation and  
remote control  
systems

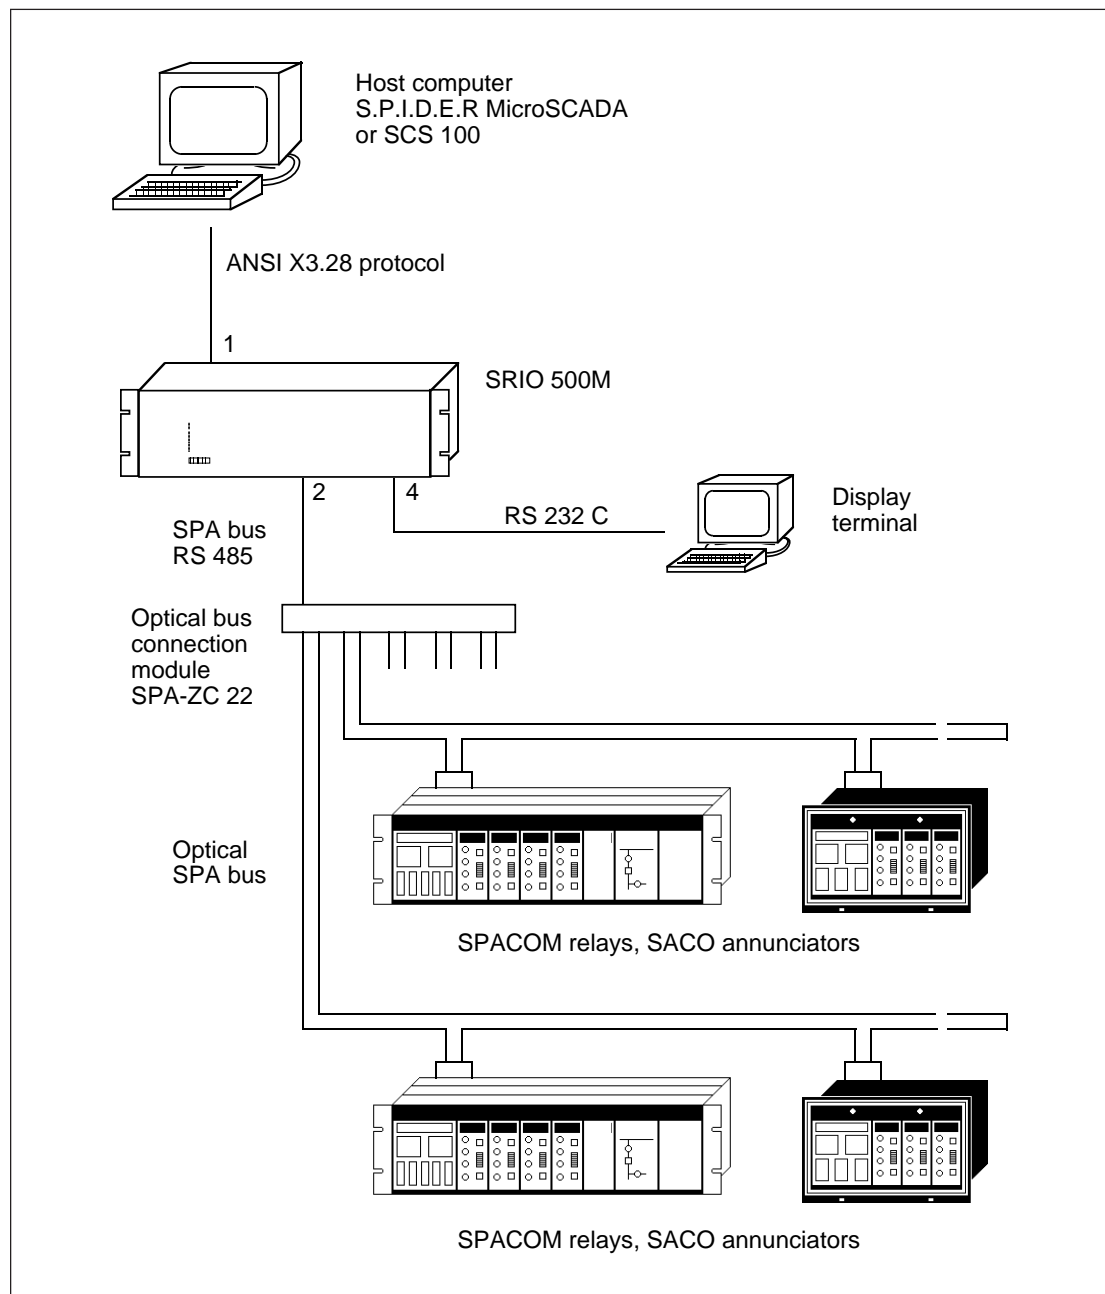


Figure 1. Basic system configuration.

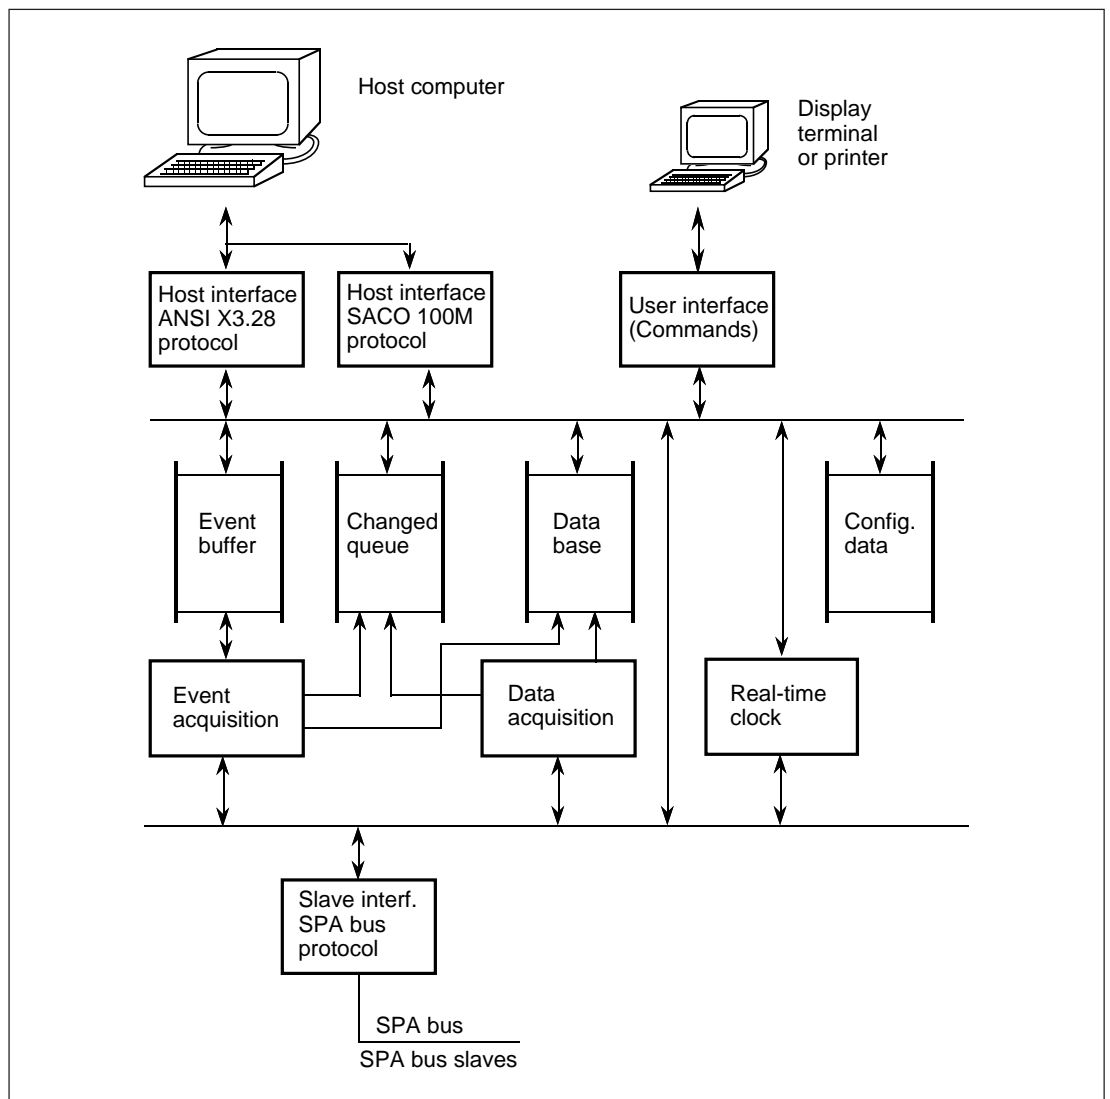


Figure 2. Functions of the SRIO 500M unit.

### Event logging

Using the SACO 100M protocol the SRIO 500M unit polls the SPA bus units and the slave devices connected to the SRIO 500M unit for event data including time markings. The events are sorted in time order and stored in the event buffer.

From the event buffer the events are delivered to the host computer.

### Data acquisition

The user can define up to 500 data items for the data base. A data item can be one of the following data types:

- DI: digital input data (digital status data)
- AI: analog input data (measured data)
- DO: digital output data (digital control data)
- AO: analog output data (analog control data)
- EV: event data (analog status data)

#### Cyclic data acquisition (polling):

The SRIO 500M unit acquires DI and AI data for the data base by cyclic polling.

#### Event based data acquisition:

The EV data is acquired by converting slave event codes, acquired by the event acquisition, to analog data values.

### Real-time clock

The SRIO 500M unit includes a real-time clock. The clock contains the current time including time from years to milliseconds. A battery back-up clock chip is used to maintain time during power off situations.

The clock can be set by the user through the programming terminal or host interface. The clock can also be synchronized with an external minute pulse.

Host interface, ANSI X3.28 protocol	<p>The ANSI X3.28 protocol is described, for example, in "Allen-Bradley: 1771-811 PLC-2-family/RS 232C Interface module 1771-KG; Users's Manual". With this protocol the SRIO 500M can communicate with, for example ABB's Substation Control System SCS 100, ABB's Remote Control System S.P.I.D.E.R MicroSCADA and Allen-Bradley's PLC 2.</p> <p>The protocol used by the SRIO 500M unit is the same as that of Allen-Bradley, except that the ways of presenting data have been extended.</p> <p>Analog data base data is transferred in 32 bit integer format or in BCD format. Digital data</p>	<p>base data is transferred in 16 bit binary format. EV-data from the data base is transferred using 16 bits for data and 32 bits for time stamps. Parameter data is transferred in ASCII format. The clock time is transferred in BCD format. Events with time markings are sent to the host using 32 bits transmitted for event identification and 32 bits for time stamps.</p> <p>Data base data, i.e. process data, is transferred to the host either on request or spontaneously when there is a change in the data. Parameter data is transferred only on request. Events are transmitted spontaneously.</p>
-------------------------------------	------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

Host interface, SACO 100M protocol	<p>The SACO 100M protocol used for the SRIO 500M host interface is described in document: "SACO 100M communication protocol for</p>	<p>data communicators SRIO 500M and SRIO 1000M".</p>
------------------------------------	-------------------------------------------------------------------------------------------------------------------------------------	------------------------------------------------------

Programming	<p>The SRIO 500 M unit is programmed from a display terminal or a PC provided with a terminal emulator program. The display terminal can be connected to the SRIO 500M unit, serial interface 4. By turning the front panel switch 1 to ON position the communication parameters of the serial interface 4 are set at: 1200 b/s, 8 data bits, no parity, 1 stop bit.</p>	<p>The programming language is a command language based on ASCII characters. The programming is described in detail in the "PROGRAMMING MANUAL SRIO 1000M AND SRIO 500M".</p>
-------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

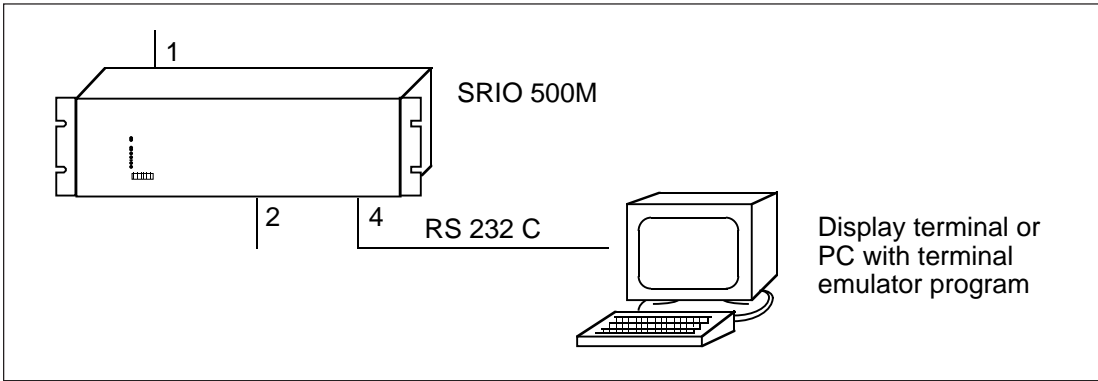


Figure 3. Connection to programming terminal.

Display terminal	SRIO 500M	PC/AT serial port	SRIO 500M
25- pin male D-connector	25- pin male D-connector	9- pin female D-connector	25- pin male D-connector
RXD 3	2 TXD	RXD 2	2 TXD
TXD 2	3 RXD	TXD 3	3 RXD
GND7	7 GND	GND5	7 GND
Cable between a display terminal and SRIO 500M.		Cable between 9-pin serial port of a PC/AT and SRIO 500M.	

Figure 4. Cables for connecting a terminal or PC to the SRIO 500M unit.

The following programming commands are available:

General commands

HELP command  
VERS command  
CLOCK command  
STORE command

Commands for serial interface setup

BUS\_MODE command  
SETUP command  
ANSI\_SETUP command

Commands for setting general operating parameters

SYSPAR command  
SIGNAL command  
LOCAL\_REMOTE command

Commands for programming the event and data acquisition

UNIT command  
DATA command  
DATA\_CONVERSION command  
DATA\_GROUP command

Commands for programming the ANSI X3.28 host interface

ADDRESS\_MAP command  
ANSI\_DATA command  
ANSI\_ADDR command

Control commands for local event reporting

SET\_PRINTER command  
DEVICE command  
PAGE\_HEADER command  
T command (event text command)

Diagnostic commands


DIAGNOSTIC command  
RESPONSE command  
ANSI\_DIAGNOSTIC command

Utility commands

Z command  
X command  
EVENT\_MONITOR command  
IOTEST command  
EXEC\_TIMES command  
RESET command  
PIC command  
A command  
EVENT\_POINTER command


## Mechanical and electrical design

### Mechanical structure

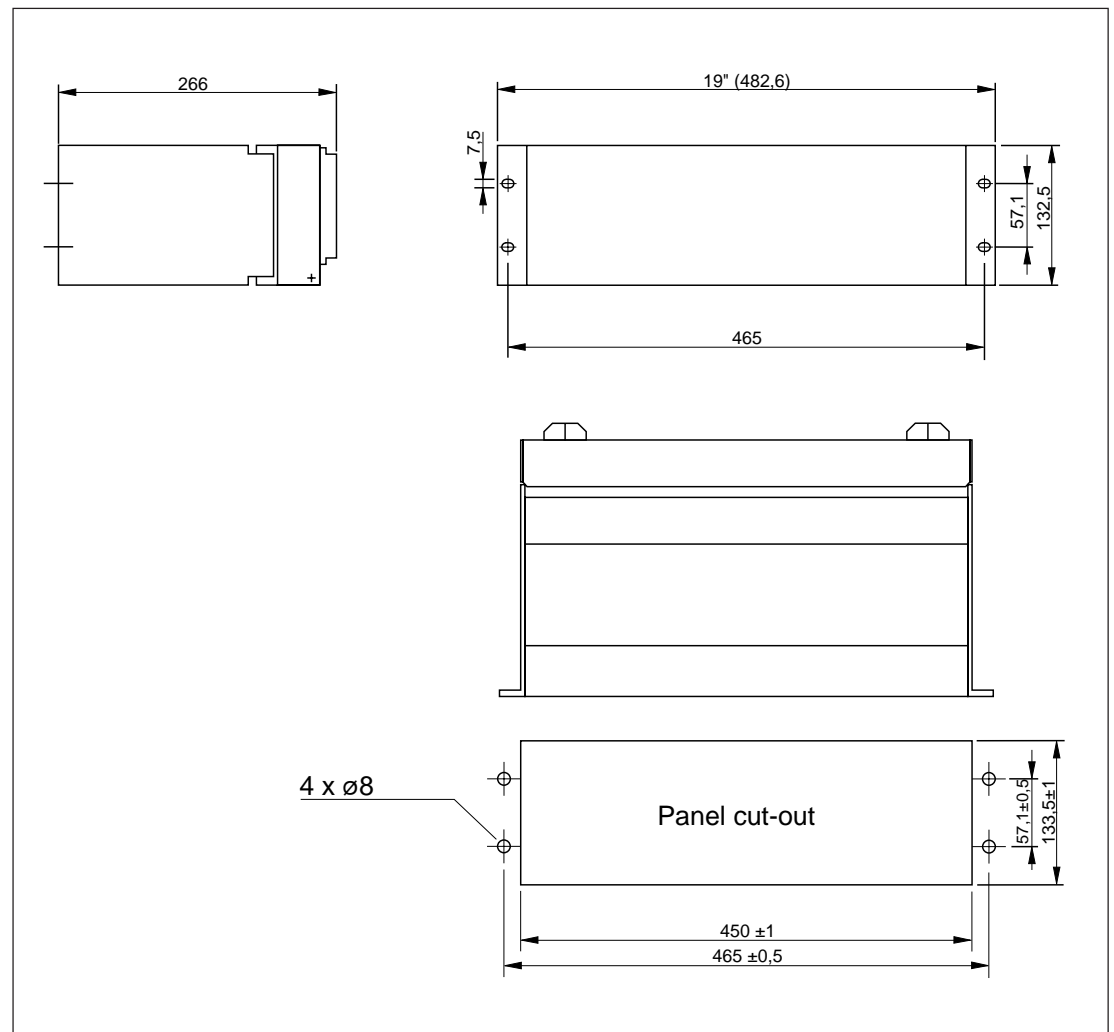


Printed circuit boards


In addition to the boards mentioned in the figure below the SRIO 500M unit includes a mother board, a connection board and a LED board.

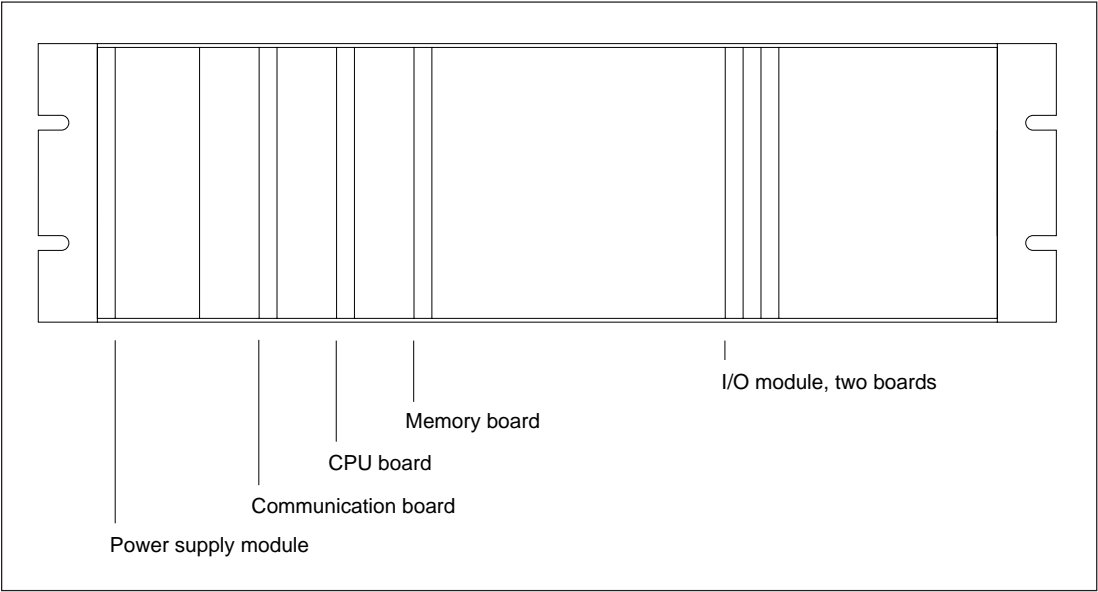

Memory chips on CPU and memory boards

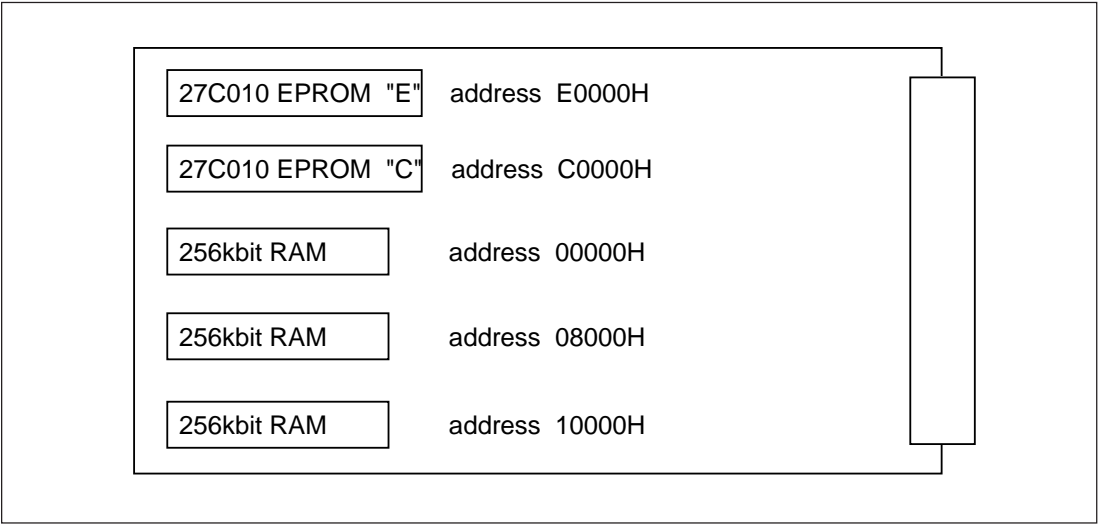

Memory chips on the CPU board

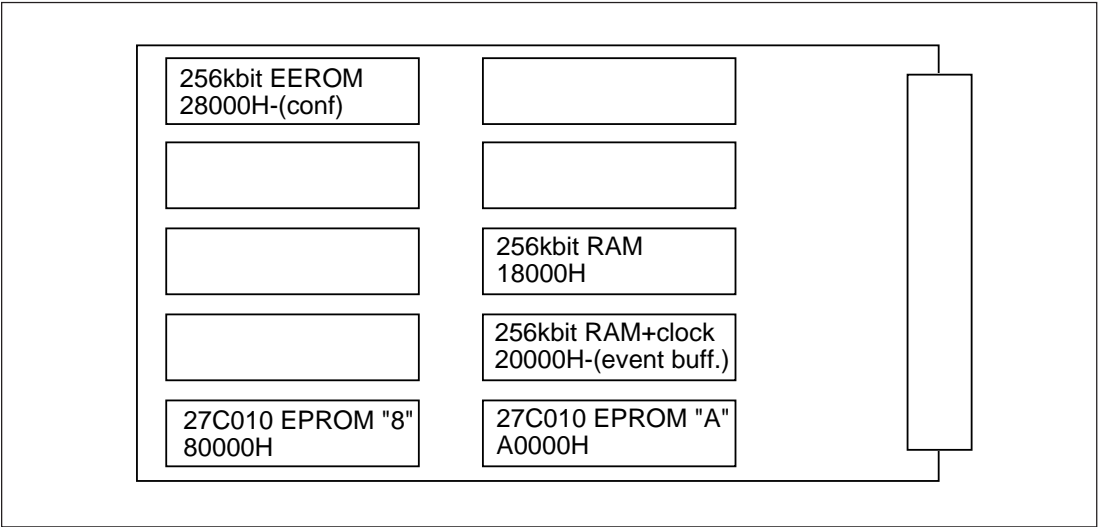

Memory chips on the memory board



Interfaces

Front panel

The front panel has seven LEDs and eight DIP switches.

Front panel LEDs

FAULT:

Red. When LED lit, the SRIO 500M unit has detected a fault on at least one of the serial interfaces.

ON:

Green. When LED lit, the power is on.

SERIAL IF 1...4:

Yellow. Diagnostic LEDs for serial interfaces.  
Blinking: Transmission in progress.  
Steady light: Line error.

TEST:

Yellow. SRIO 500M local mode indicator.  
Flashing: Local mode.

Front panel DIP switches

SW1:

Selection of operating mode and communications parameters for serial interface 4.

When SW1 is switched ON:

Serial interface 4 changes its mode to terminal mode with default parameters. (1200 b/s, 8 bits per character, no parity, 1 stop bit).

When SW1 is switched OFF:

Serial interface 4 loads its mode and parameters from the EEROM memory.

Power up or reset situation:

If SW1 is ON, serial interface 1 starts up in terminal mode with default parameters, otherwise mode and parameters are loaded from the EEROM memory.

SW2-8 has no funktion.

Serial interfaces

Connectors

The rear plate of the SRIO 500M unit contains 3 connectors for three serial interfaces:

Serial interface 1:

25- pin RS 232/current loop connector

Serial interface 2:

9- pin RS 485 connector

Serial interface 4:

25- pin RS 232/current loop connector

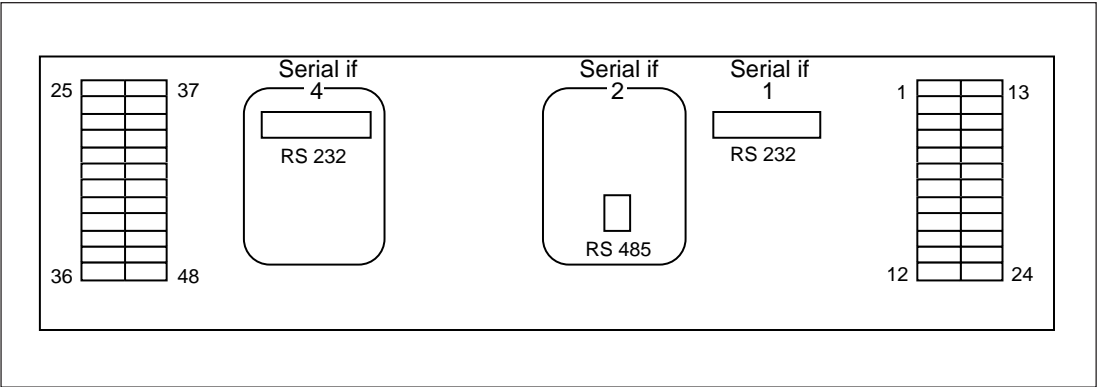


Figure 5. Connectors of the rear plate of the SRIO 500M unit.

Serial interface 1, RS 232/Current loop connector:

Pin	Direction	Name
2	out	TXD, Transmit data
3	in	RXD, Receive data
4	out	RTS, Request to send
5	in	CTS, Clear to send
6	in	DSR, Data set ready
7	-	GND, Signal ground
8	in	DCD, Data carrier detect
20	out	DTR, Data terminal ready
9	-	TX+, Current loop, transmit data +
10	-	TX-, Current loop, transmit data -
11	-	RX+, Current loop, receive data +
12	-	RX-, Current loop, receive data -
13	-	Ready+, Current loop, Ready (DCD) +
14	-	Ready-, Current loop, Ready (DCD) -

Serial interface 2, RS 485 connectors:

Pin	Name
1	DATA A, Data signal pair, signal A
2	DATA B, Data signal pair, signal B
3	RTS A, Request to send signal pair, signal A
4	RTS B, Request to send signal pair, signal B
7	GND, Power supply for optical bus connection module.
8	
9	+8V, Power supply for optical bus connection module.

Serial interface 4, RS 232/Current loop connector:

Pin	Direction	Name
2	out	TXD, Transmit data
3	in	RXD, Receive data
4	out	RTS, Request to send
5	in	CTS, Clear to send
7	-	GND, Signal ground
8	in	DCD, Data carrier detect
20	out	DTR, Data terminal ready
9	-	TX+, Current loop, transmit data +
10	-	TX-, Current loop, transmit data -
11	-	RX+, Current loop, receive data +
12	-	RX-, Current loop, receive data -
13	-	Ready+, Current loop, Ready (DCD) +
14	-	Ready-, Current loop, Ready (DCD) -

### User selectable options

The DIL switches on the communication board are used for selecting the operation modes of the serial interfaces.

#### Serial interface 1:

Mode	S1.1	S1.2
RS 232 Current loop	OFF ON	OFF ON

#### Serial interface 2:

Mode	S1.3	S1.4	S1.5	S1.6	S1.7	Note
RS 485	ON	ON	OFF	OFF	OFF	RS 485 is active

#### Serial interface 4:

Mode	S3.1	S3.2	S3.3	S3.4	S3.5	S3.6	S3.7	S3.8
RS 232 Current loop	ON OFF	OFF OFF	ON OFF	OFF ON	OFF ON	OFF OFF	OFF OFF	OFF OFF
							 DCD	 CTS
Short-circuited to DTR								

### Power supply

The SRIO 500M unit can be supplied from two sources:

Supply 1: 80...265 V DC or  
(device type SRIO 500M AA)  
19...70 V DC  
(device type SRIO 500M BA)  
Supply 2: 80...265 V AC or DC

The supply voltages are connected to the screw terminals 20...24 of the rear plate:

Screw terminal 20:	supply 2 minus
Screw terminal 21:	supply 2 plus
Screw terminal 22:	shield ground
Screw terminal 23:	supply 1 minus
Screw terminal 24:	supply 1 plus

The screw terminal block of the rear plate also includes terminals for some special purpose opto-isolated inputs and relay outputs. Output

relay 1 can be used separately, but output relays 2-6 have to be used as one group with the same control voltage.

#### Inputs:

Screw terminal 1: general input 1 (programmed with SIGNAL PRG)  
 Screw terminal 2: general input 2 (programmed with SIGNAL PRG)  
 Screw terminal 3: general input 3 (programmed with SIGNAL PRG)  
 Screw terminal 4: general input 4 (programmed with SIGNAL PRG)  
 Screw terminal 5: general input 5 (programmed with SIGNAL PRG)  
 Screw terminal 6: general input 6 (programmed with SIGNAL PRG)  
 Screw terminal 7: general input 7 (programmed with SIGNAL PRG)  
 or MINUTE PULSE CLOCK SYNC INPUT  
 (programmed with SYSPAR 18)

#### Outputs:

Screw terminal 8: +48V contact loop voltage.  
 Screw terminal 9: relay 1 (audible alarm)  
 Screw terminal 10: relay 1 (audible alarm)  
 Screw terminal 11: relay 2 (fault relay)  
 Screw terminal 12: relay 2 (fault relay)  
 Screw terminal 13: relay 3 (minute pulse output, programmed with SYSPAR 18)  
 Screw terminal 14: relay 3 and 4 common  
 Screw terminal 15: relay 4 (not used)  
 Screw terminal 16: relay 5 (not used)  
 Screw terminal 17: relay 5 and 6 common  
 Screw terminal 18: relay 6 (not used)  
 Screw terminal 19: not used

Screw terminal block of the SRIO 500M unit:

Clock sync. in	1	I1	R3	13	Clock sync. out
	2	I2	R3 , 4	14	
	3	I3	R4	15	
	4	I4	R5	16	
	5	I5	R5 , 6	17	
	6	I6	R6	18	
Audible alarm	7	I7		19	Supply 2 (80...265 ac/dc)
	8	+48V	N-	20	
	9	R1	L+	21	
Self-supervision alarm relay	10	R1	⊕	22	Shield ground
	11	R2	-	23	
	12	R2	+	24	
					Supply 1 (80...265 dc or (19...70V dc )

**Technical data**  
(modified 2002-10)

**Serial interfaces**

Serial interface 1: Interface to host computer or programming terminal	RS 232 C, max. 9600 b/s (also current loop if used as programming terminal)
Serial interface 2: Interface to SPA-bus	RS 485, max. 9600 b/s
Serial interface 4: Interface to programming terminal or event printer	RS 232 C or current loop, max. 9600 b/s.

**Event polling**

Maximum number of units in the event poll list	100
Capacity of event buffer	500 events
Accuracy of time markings	1 ms
Time resolution between events from one serial interface	10 ms
Time resolution between events from two different serial interfaces	50 ms

**Data acquisition**

Capacity of data base	500 data items
System response time:	
- EV-data from high priority slaves	amount of high priority slaves x 70 ms
- EV-data from normal priority slaves	amount of slaves x 200 ms
- AI- or DI-data from slaves	amount of cyclically polled data items x 200 ms

Weight	about 8 kg
--------	------------

**Power sources**

Supply No. 1	80...265 V dc or 17...70 V dc
Supply No. 2	80...265 V ac/dc
Power consumption	30 W

**Test voltages**

- power supply inputs versus chassis
- relay outputs versus chassis
- opto-isolated inputs versus chassis

Dielectric test voltage as per IEC 60255-5 and SS 436 15 03	2 kV, 50 Hz, 1 min
----------------------------------------------------------------	--------------------

Impulse test voltage as per IEC 60255-5 and SS 436 15 03	5 kV, 1.2/50 µs, 0.5J
-------------------------------------------------------------	-----------------------

High frequency test voltage as per IEC 60255-5 and SS 436 15 03	2.5 kV, 1 MHz
--------------------------------------------------------------------	---------------

Rated contact current/max. breaking voltage of the relay outputs	3 A/250 V, 50 Hz
---------------------------------------------------------------------	------------------

**Environmental conditions**

Service temperature range	0...+55 °C
Storage temperature range	-40...+70 °C
Maximum relative humidity (without condensation)	95 %

## Maintenance and service

### Self-diagnostics

If the self-supervision system of the SRIO 500M unit detects a fault on one of the serial interfaces, the fault relay is activated and the "FAULT" indicator on the front panel and one of the "SERIAL IF" indicators are lit.

---

### Fault localization

The fault can be localized and repair measures can be taken using the following table:

Fault type	Recognition	Repair step
Supply failing	Fault relay is activated. Front panel "ON" light dark	Check and repair the power supply
Line fault	Fault relay is activated. One of the front panel "SERIAL IF" lights is on	Check the connections. Check the serial interface setup  Check the data definitions Check the event poll list Check the devices connected to the serial interface line Check the DIL switches on communication board
Display terminal failure	No response, when a command is given or Return/Enter key is pressed	Check the cable Check the terminal Check the setup parameters of the terminal  Check front panel switch 1

Service and spare parts

If the fault is found to be in the SRIO 500M unit, the normal service operation is to replace the faulty printed circuit board or fibre optic connector module with a new one. Please refer to the spare part list.

If the improper function cannot be eliminated, please contact the manufacturer or his nearest representative for further information on measures to be taken.

List of spare parts:

Power supply module	SWSM 220A48
Power supply module	SWSM 220A220
Communication board	SRXM 2A1
CPU board	SWPM 4A2
Memory board	SRMM 1A1
I/O module	SROM 8A1 + SROM 8A2
Front panel LED board	SRDM 1A1
Rear lid connector board	SRCM 1A1
Fibre optic connector module (plastic transmitter, plastic receiver)	SPA-ZC 21BB
Fibre optic connector module (plastic transmitter, glass receiver)	SPA-ZC 21BM
Fibre optic connector module (glass transmitter, plastic receiver)	SPA-ZC 21MB
Fibre optic connector module (glass transmitter, glass receiver)	SPA-ZC 21MM
Fibre optic connector module (5 plastic loops)	SPA-ZC 22A 5B0M
Fibre optic connector module (4 plastic loops, 1 glass loops)	SPA-ZC 22A 4B1M
Fibre optic connector module (3 plastic loops, 2 glass loops)	SPA-ZC 22A 3B2M
Fibre optic connector module (2 plastic loops, 3 glass loops)	SPA-ZC 22A 2B3M
Fibre optic connector module (1 plastic loop, 4 glass loops)	SPA-ZC 22A 1B4M
Fibre optic connector module (5 glass loops)	SPA-ZC 22A 0B5M

## Ordering information

When ordering, please state the following things:

1. Quantity and type designation
2. Auxiliary power supply voltages
3. Accessories

Example:

1 pc SRIO 500M data communicator  
Supply voltage No. 1 = 110 V dc, supply 2 = 220 V ac  
1 pc fibre optic connector module type SPA-ZC 22A 5B0M

Ordering numbers:

RS 822 002-AA

(80...265 V dc and 80...265 V ac/dc)

RS 822 002-BA

(17...70 V dc and 80...265 V ac/dc)



**ABB Oy**

Distribution Automation

P.O.Box 699

FI-65101 Vaasa

FINLAND

Tel. +358 (0)10 22 11

Fax.+358 (0)10 22 41094

[www.abb.com/substationautomation](http://www.abb.com/substationautomation)