


NOTES:

1. WARNING: This drawing does not illustrate the installation methods required for hazardous locations. Prior to any installation in a Classified Hazardous Location, verify installation methods by the Control Drawing referenced on the product's name tag and national and local codes.
2. The RS-485 Communications Module card (2015193) must be installed in the appropriate slot for the communication port to be active.

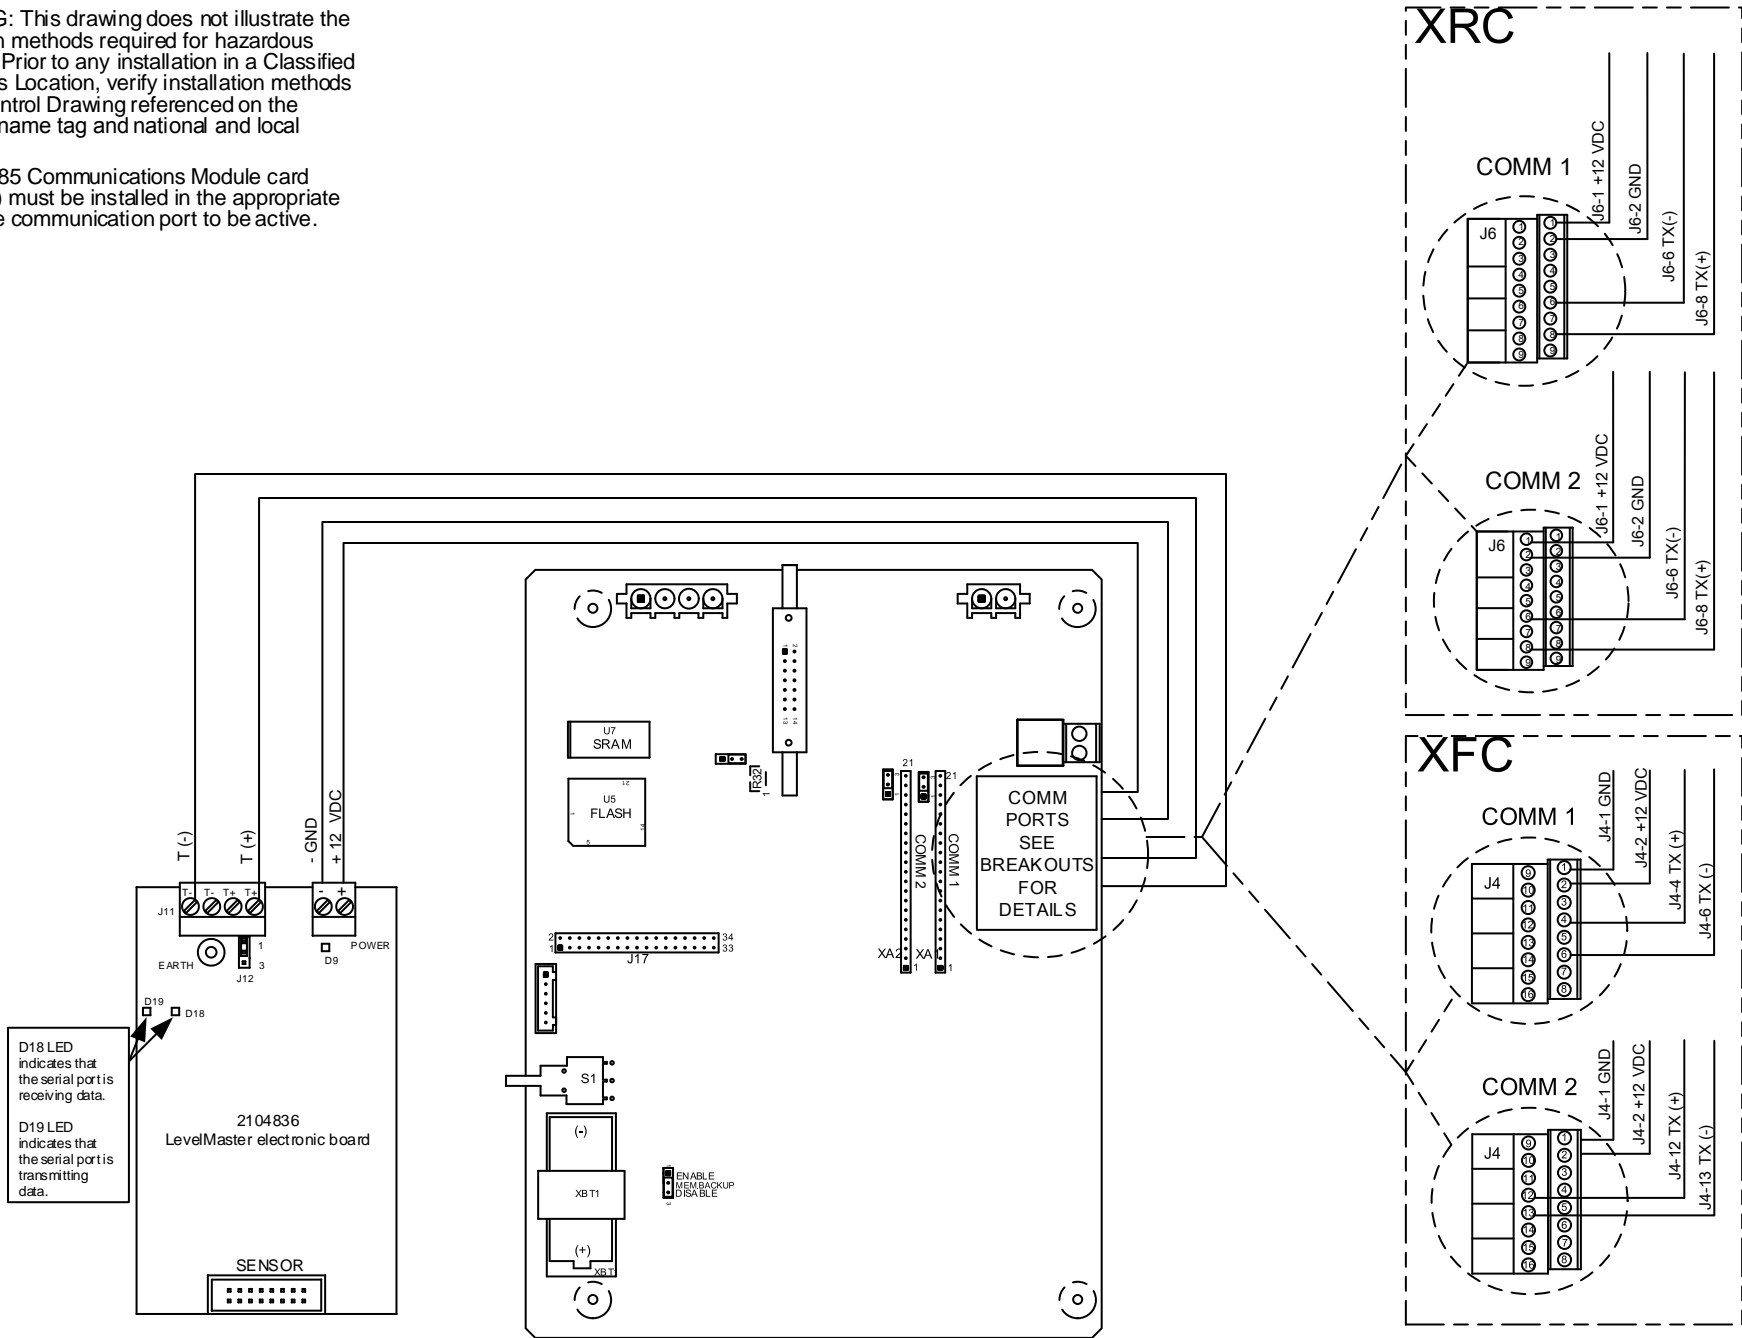

XFC, or XFC^{G4} Flow Computer

	TOTALFLOW Products	ACTION L37271	DOC TYPE UD	TITLE XRC/XFC (2100355/2100204 BD) CONNECTED TO LEVELMASTER (2104836 BD)	DWG NO. 2105833	REV AA	SHEET 1 OF 1