

This webinar brought to you by The Relion® Product Family Next Generation Protection and Control IEDs from ABB

Relion. Thinking beyond the box.

Designed to seamlessly consolidate functions, Relion relays are smarter, more flexible and more adaptable. Easy to integrate and with an extensive function library, the Relion family of protection and control delivers advanced functionality and improved performance.



ABB Protective Relay School Webinar Series

Disclaimer

ABB is pleased to provide you with technical information regarding protective relays. The material included is not intended to be a complete presentation of all potential problems and solutions related to this topic. The content is generic and may not be applicable for circumstances or equipment at any specific facility. By participating in ABB's web-based Protective Relay School, you agree that ABB is providing this information to you on an informational basis only and makes no warranties, representations or guarantees as to the efficacy or commercial utility of the information for any specific application or purpose, and ABB is not responsible for any action taken in reliance on the information contained herein. ABB consultants and service representatives are available to study specific operations and make recommendations on improving safety, efficiency and profitability. Contact an ABB sales representative for further information.



ABB Protective Relay School Webinar Series

Line Current Differential Protection

Roger Hedding

October 22, 2013

Presenter



Roger Hedding

Roger graduated from Marquette University and joined Westinghouse Electric Corp. After receiving a Masters degree in Electrical Engineering from the University of Pittsburgh, Roger became a District Engineer, and eventually moved to Milwaukee where he currently resides.

As a Relay Development Consultant he guides the development of relay products for the North American market. Roger is a IEEE senior member, and Chair of the IEEE Power Systems Relay Committee. Roger has authored or co-authored many papers in power systems protection.


Learning objectives

- What is a current differential relay ?
- What is a line current differential relay ?
- What are the application issues of line current differential relays vs line distance relays ?

Line differential protection


Agenda

- Introduction
- Differential Relay
- Line Current Differential Relay
- Application Issues
- Communications
- Summary

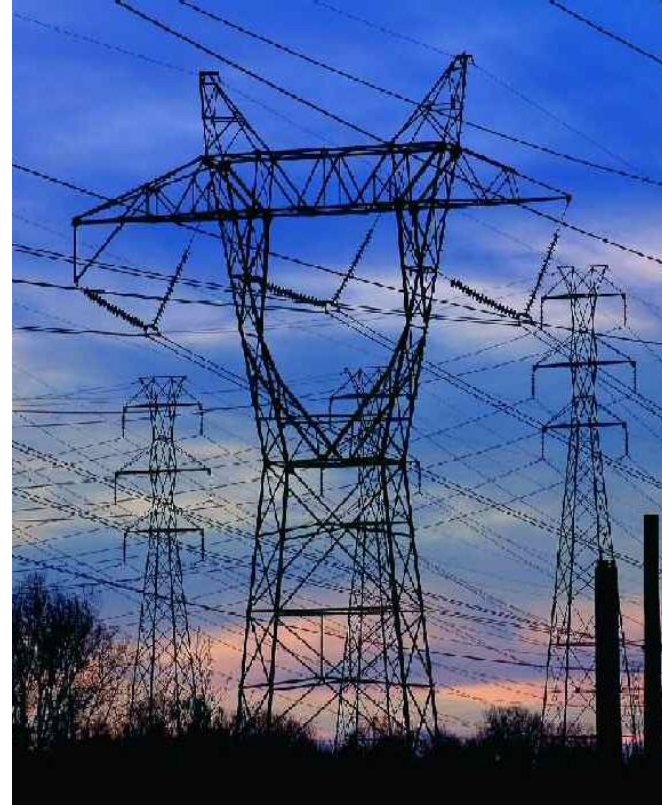

Simple line differential protection

Application

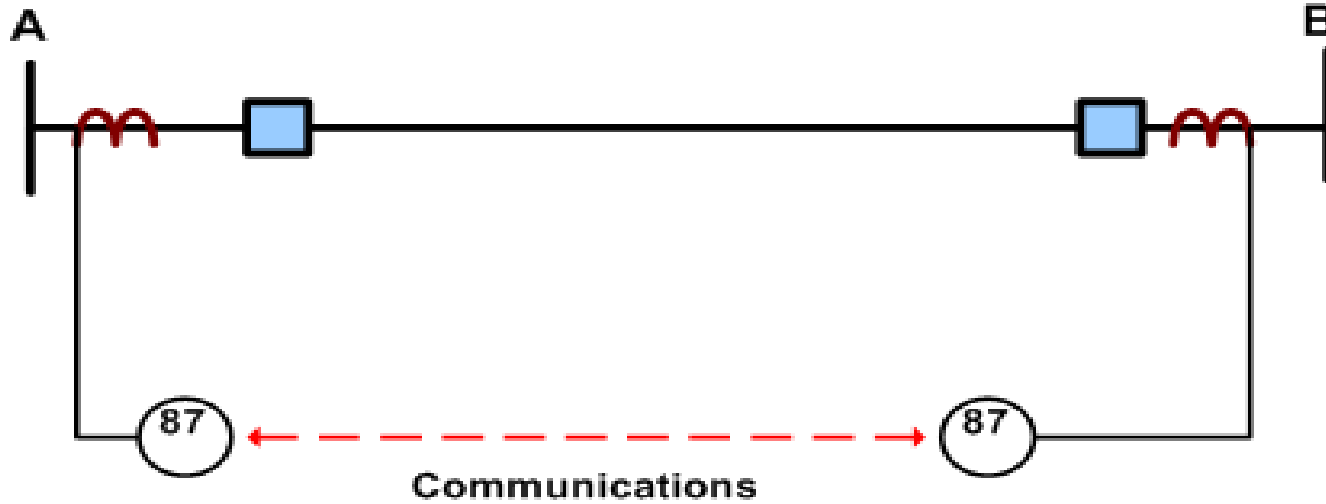

Multi-terminal differential protection

- Unit Protection
- Task – To Determine if fault is within protected zone or outside the protected zone
- Protected Zone
 - Transmission Line Terminals
 - Power Transformer Terminals
- Measures Currents at the terminals of the protected circuit
- Transmits information about the currents to the remote end(s)
- Compares the currents using classical current differential principles
- Supplemented by additional criteria
- High Dependability – Operates for all faults which it is designed to operate
- Highly Security – Doesn't operate for faults for which it should not operate
- Good performance during evolving faults, and cross country faults
- Immune to power swings, mutual coupling, and series impedance unbalances
- With sample data its easy to calculate
 - Sequence components
 - Harmonic Currents

Line current differential Basics



Current only scheme


- ✓ No dependence on VTs
 - Relief from Fuse fail, CCVT, Power swings
- ✓ Can be very sensitive in detecting ground faults- Not matched by distance relays
- ✓ Segregated phase
 - Ideal for evolving faults
 - and cross country faults
 - Single pole tripping
 - Series compensated lines
- ✗ Communication dependent

Types of current only schemes

- Current Differential
 - Analog
 - Digital

- Phase Comparison
 - Segregated
 - Combined Sequence
 - Not used much anymore

Current differential relay

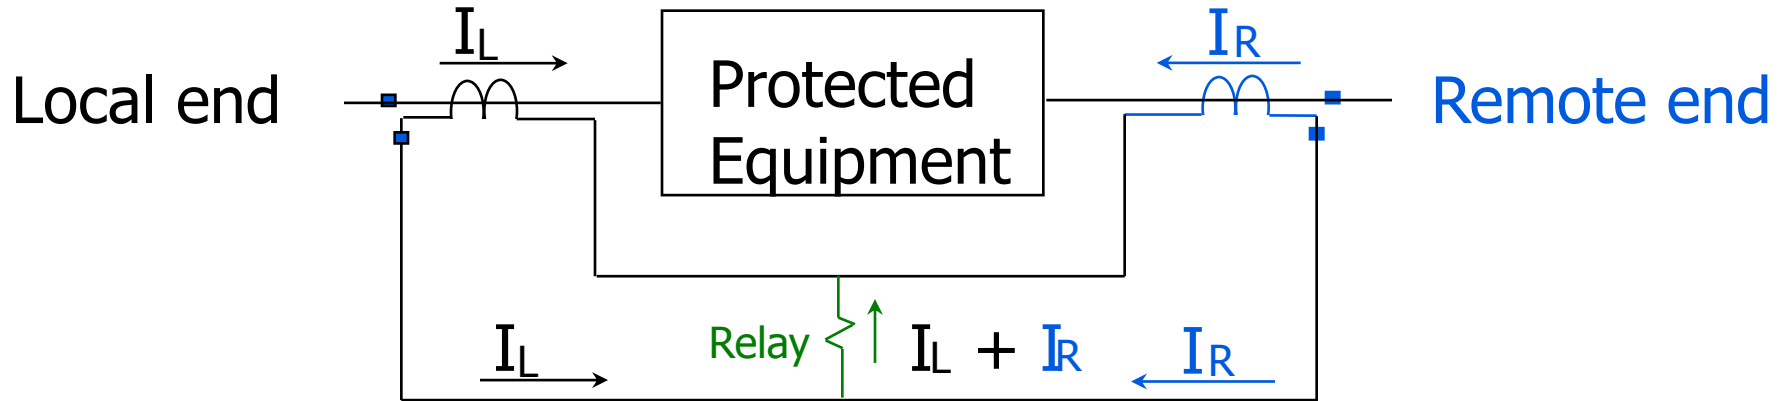


Normal operations or external faults

$$I_L = -I_R$$


$$I_L + I_R = 0$$

⇒ Should **NOT TRIP!**

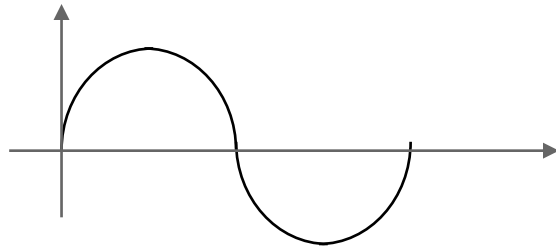

Local end

+

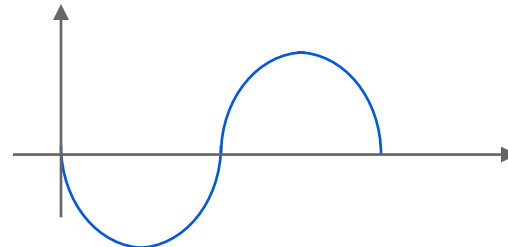


Remote end

Internal faults


$$I_L + I_R \neq 0$$

⇒ Should **TRIP!**

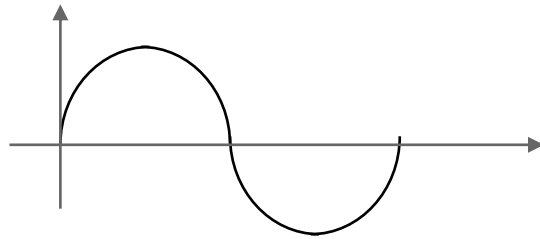

Local end


+

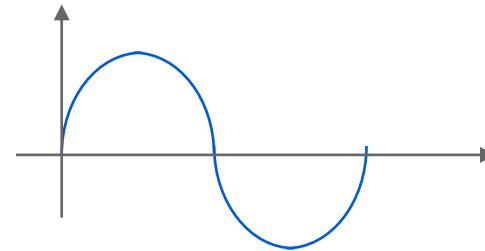

Remote end

Operating and restraint regions


$$\frac{I_L}{I_R} = x + j y = -1$$

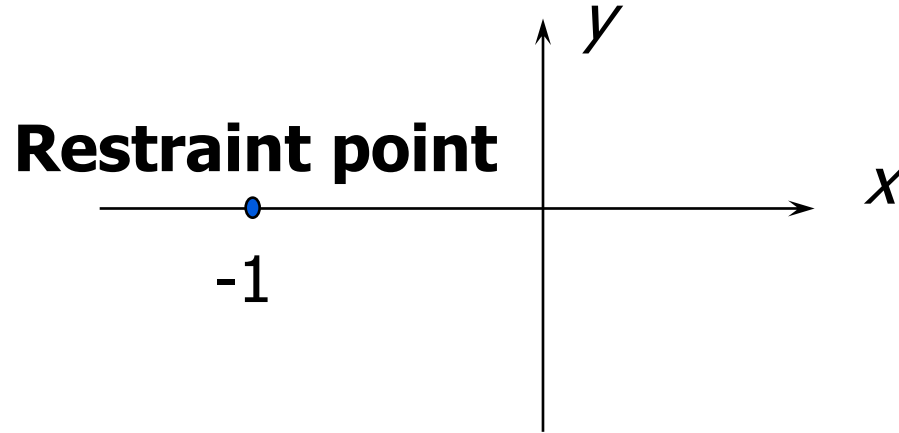


Operating and restraint regions

- High security for external faults
- High sensitivity for internal faults

Operating and restraint regions

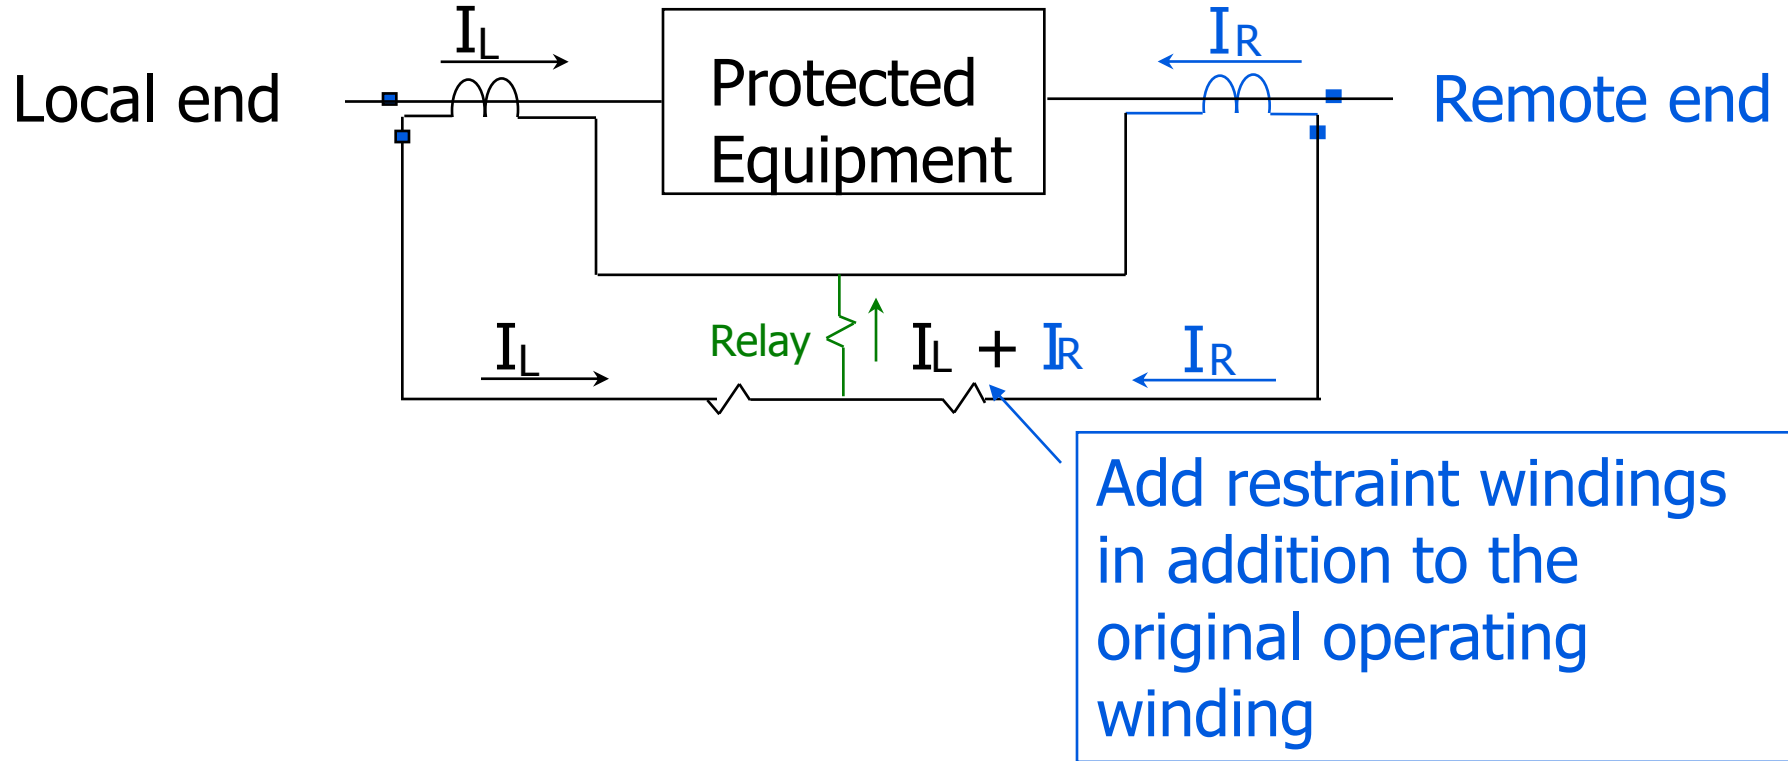

Operating (trip) condition

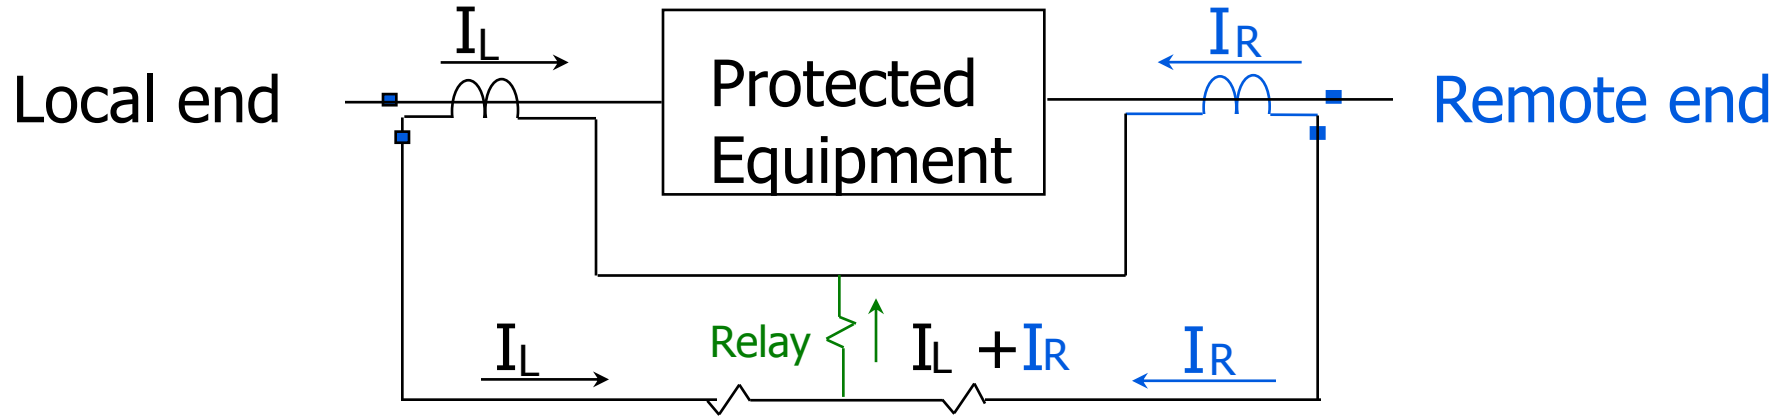


$$|I_L + I_R| \geq K(|I_L| + |I_R|)$$

or $|I_L + I_R| \geq K(|I_L - I_R|)$

or $|I_L + I_R| \geq K|I_{\max}|$


Operating and restraint regions

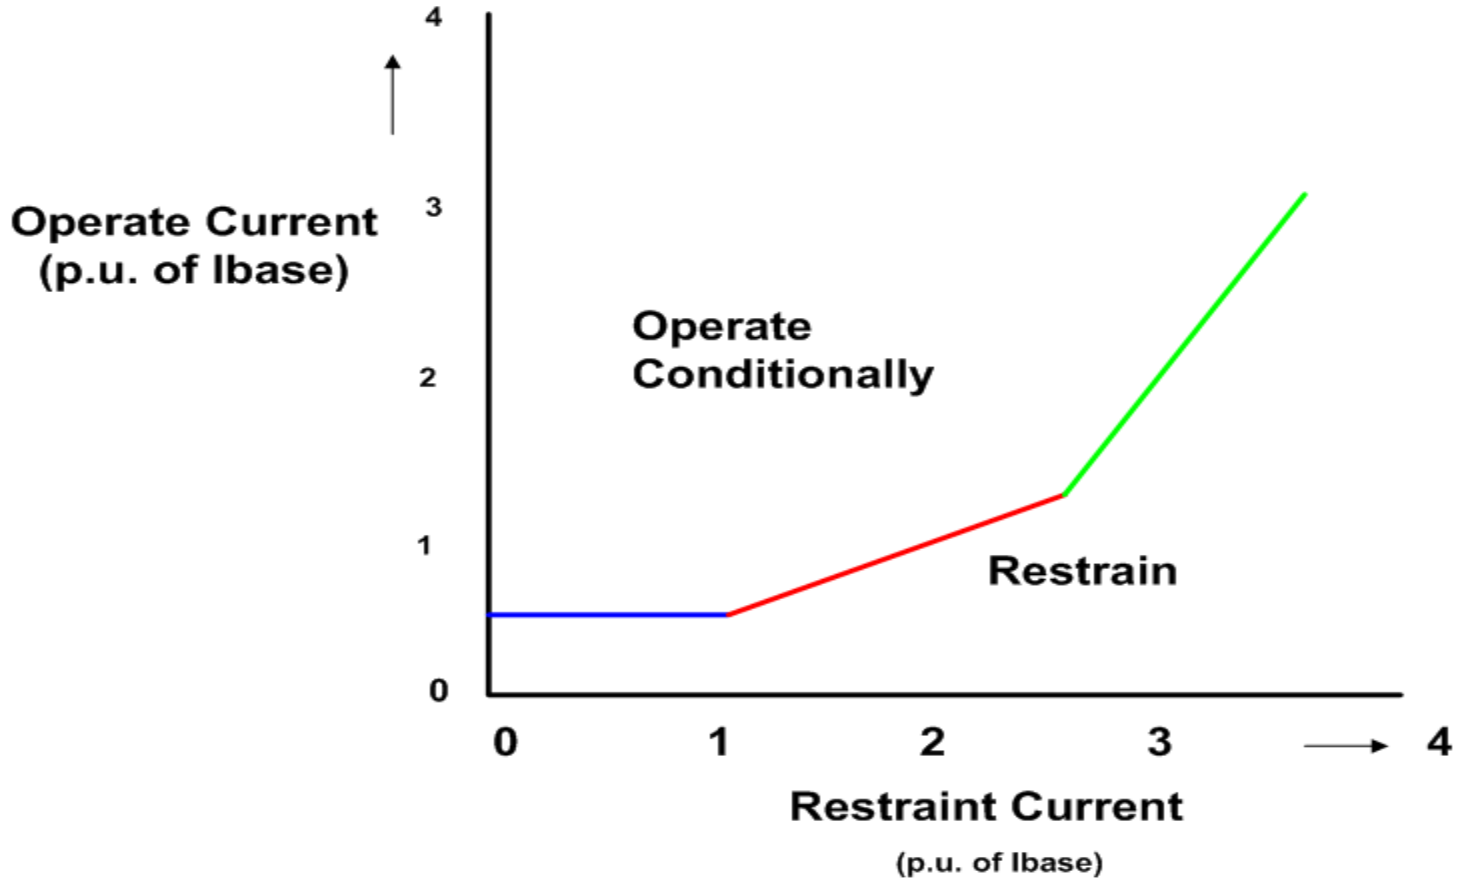


Line current differential relays

- Two terminals physically separated
- Two relays
- Communication between two terminals


Line current differential relays

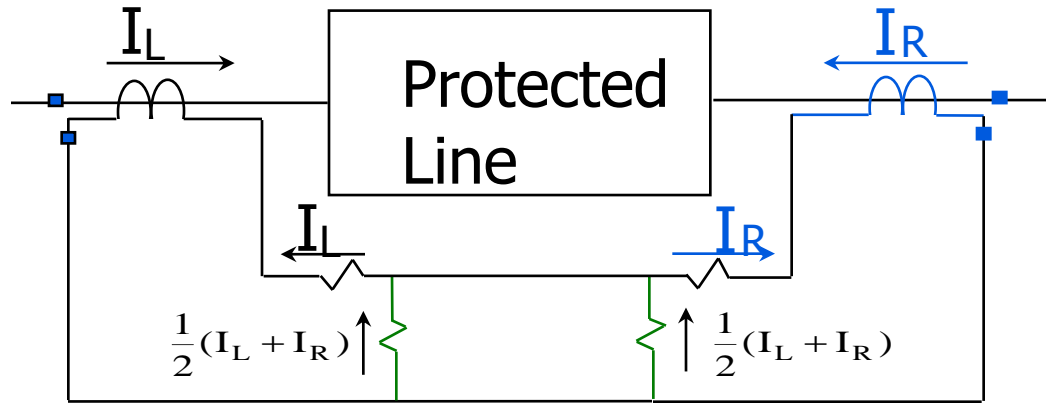


Normal conditions or external faults

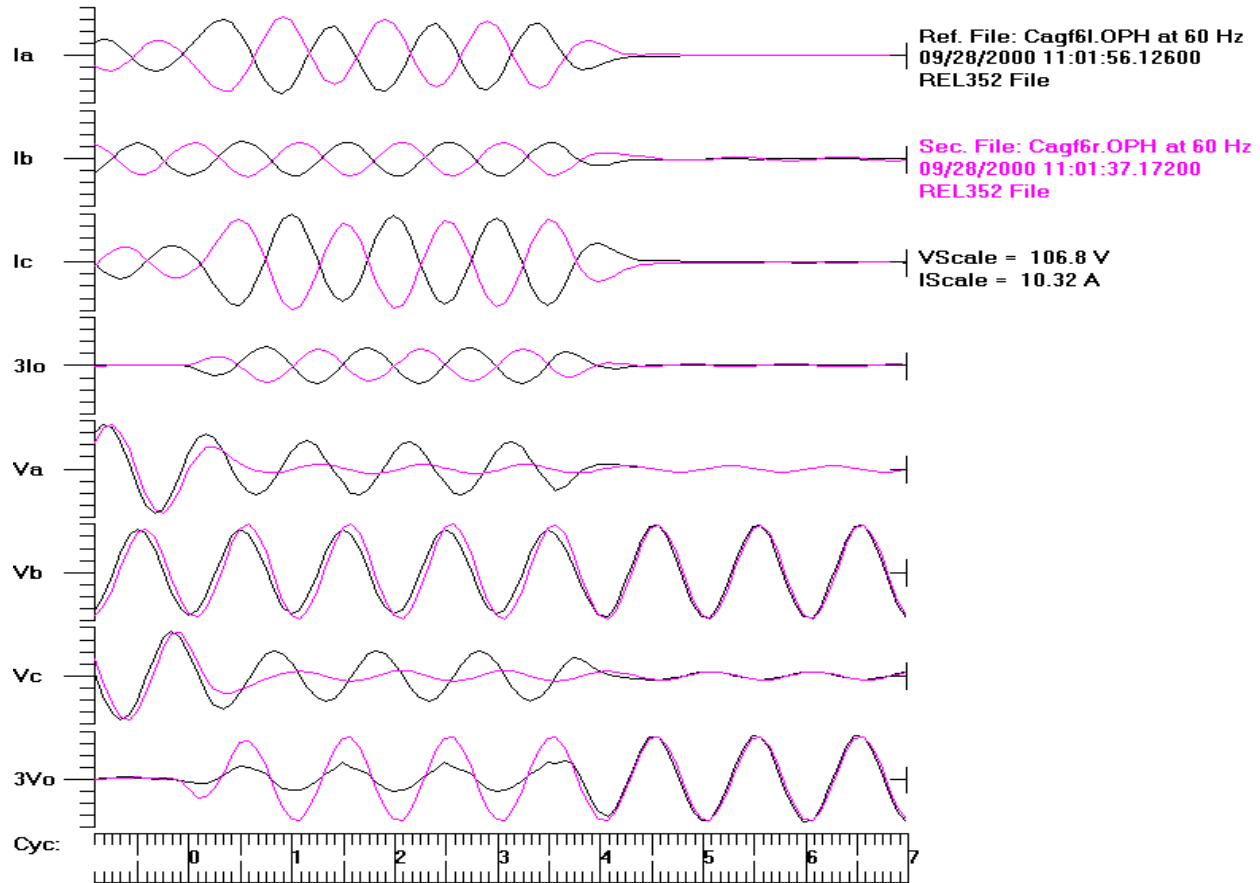

Internal faults

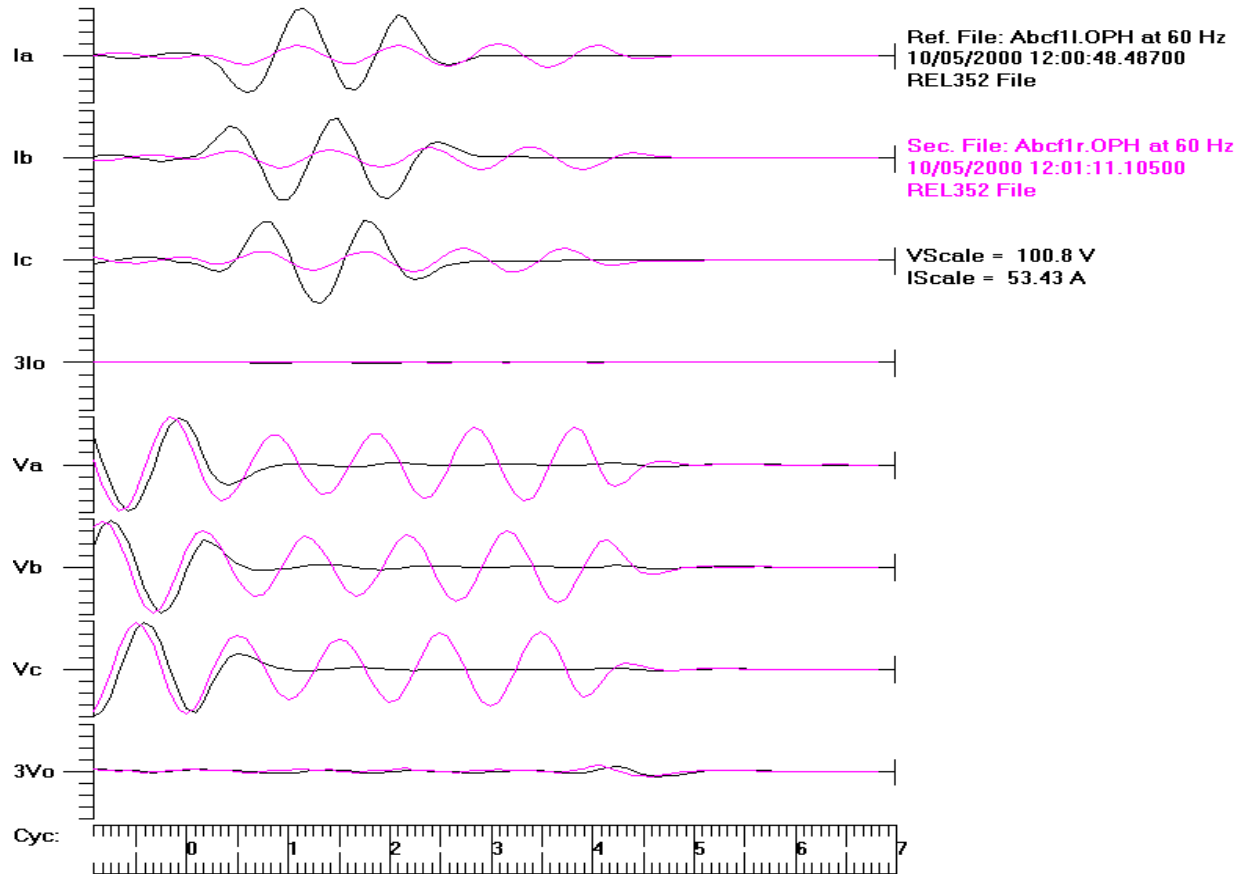

Line differential protection Characteristic

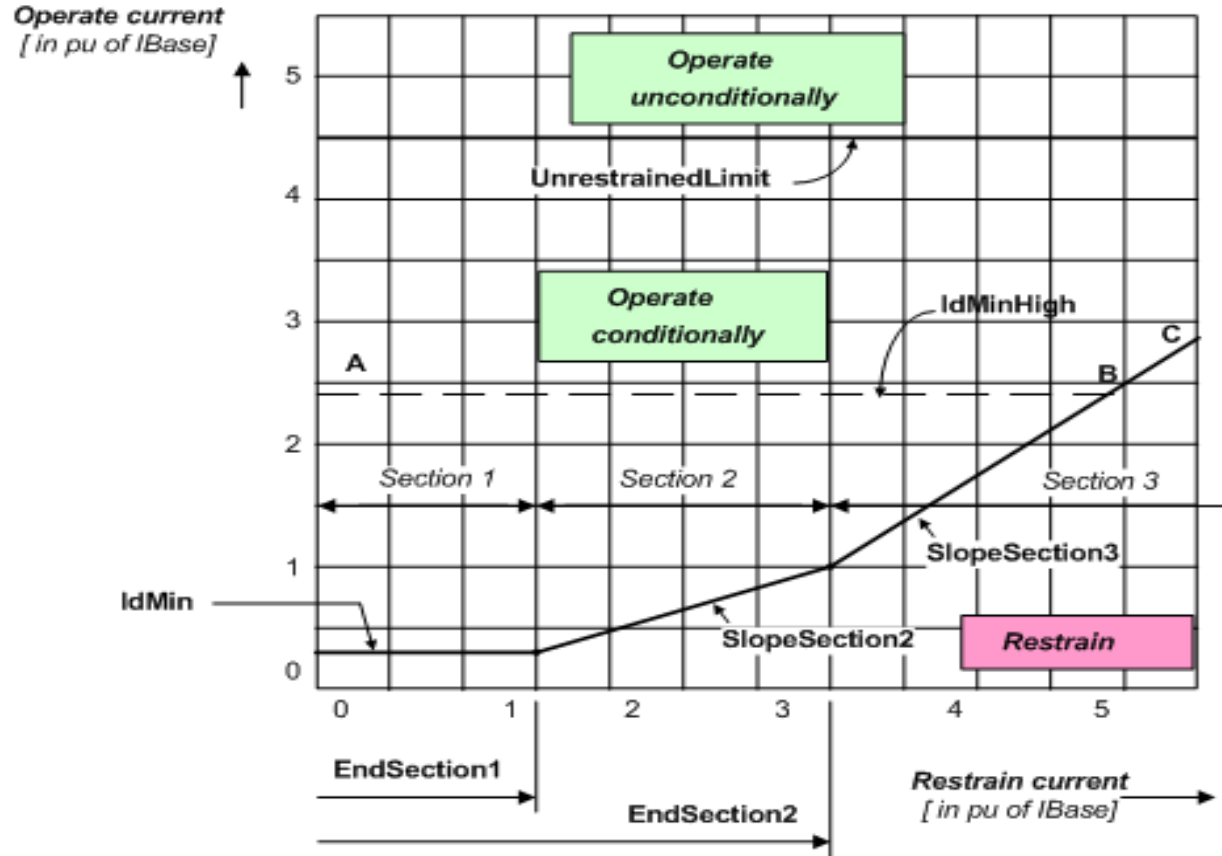


Line current differential relays

First generation

- Reduce communication requirements
- Sequence filter

HCB pilot wire relay

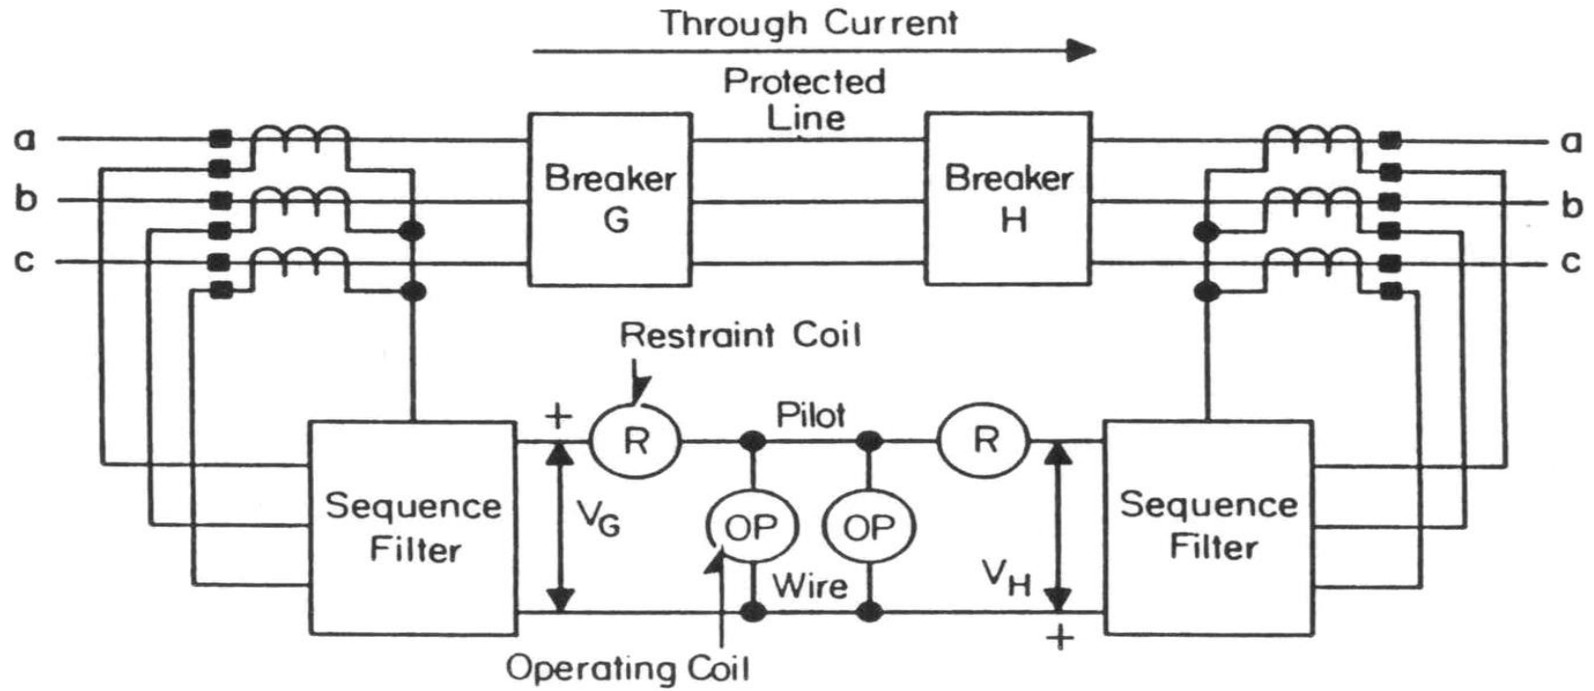

Pilot wire relays

Problems

- Rise in station ground potential
- Induction from power line circuits

Pilot wire relays

Solutions

- Twisted wire pair
- Gaps/arrestors, etc.
- Drainage reactors
- Neutralizing reactors
- Insulating transformers

Non-metallic communications Issues

- Propagation delay-time synchronization
- Signal corruption
- Communication network
 - Bits, bauds, bandwidth, switching, Mux
- Backup protection

Numerical relay

- First generation of numerical relays transmitted Fourier coefficients across channel
- Newest relays transmit sampled data across channel
 - Can do harmonic analysis
 - Calculate sequence components

Channel requirement

- Segregated phase differential protection typically calls for larger information exchange - digital communication
 - Ideal against cross country faults, series compensated lines, single pole tripping etc.


Channel options

- Direct Fiber
 - Short Range 1 – 3 Km
 - Medium Range 3 – 50 Km
 - Long Range 51 – 160 Km
- G.703
- Fiber to multiplexer
- Use C37.94 standard


Line termination

- Single breaker
- Ring bus
- Breaker and one half
- Transformer


Single breaker

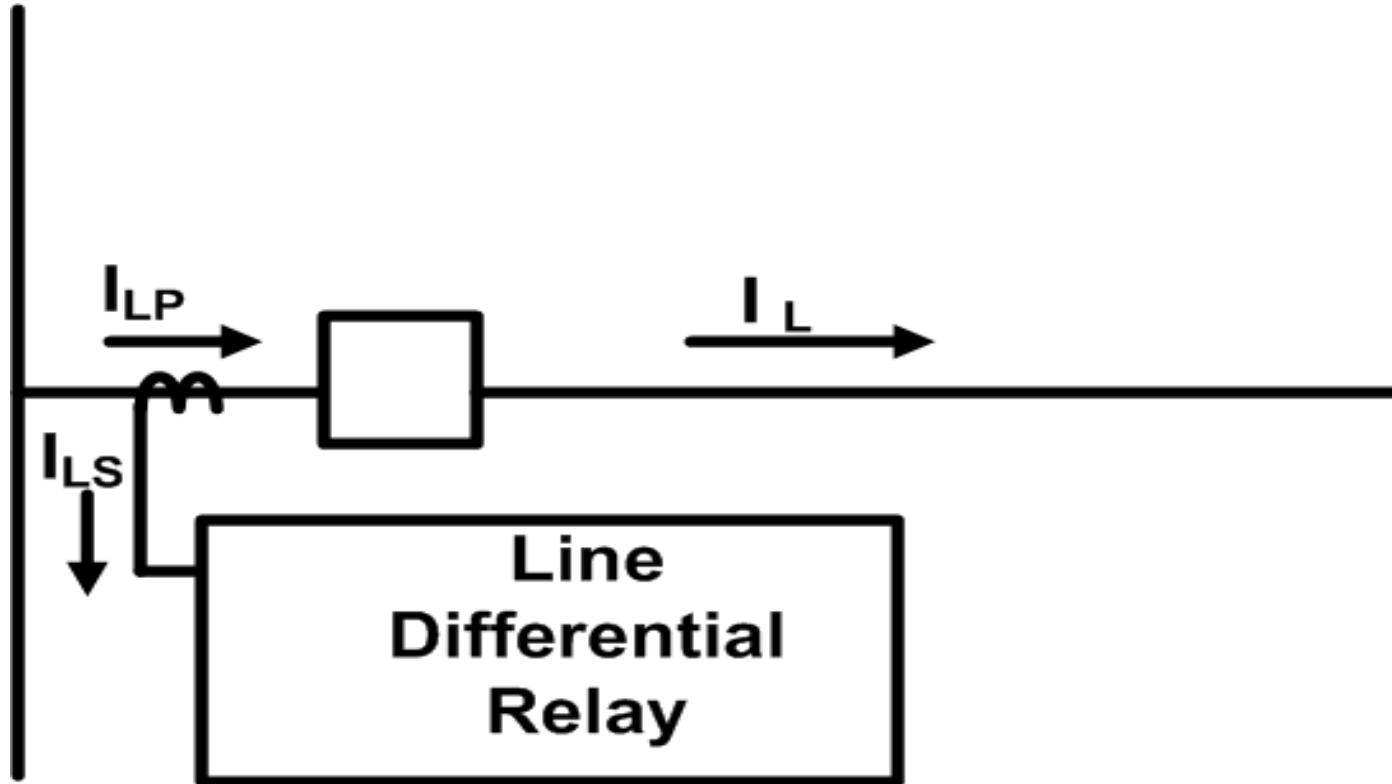

Ring bus or breaker and 1/2

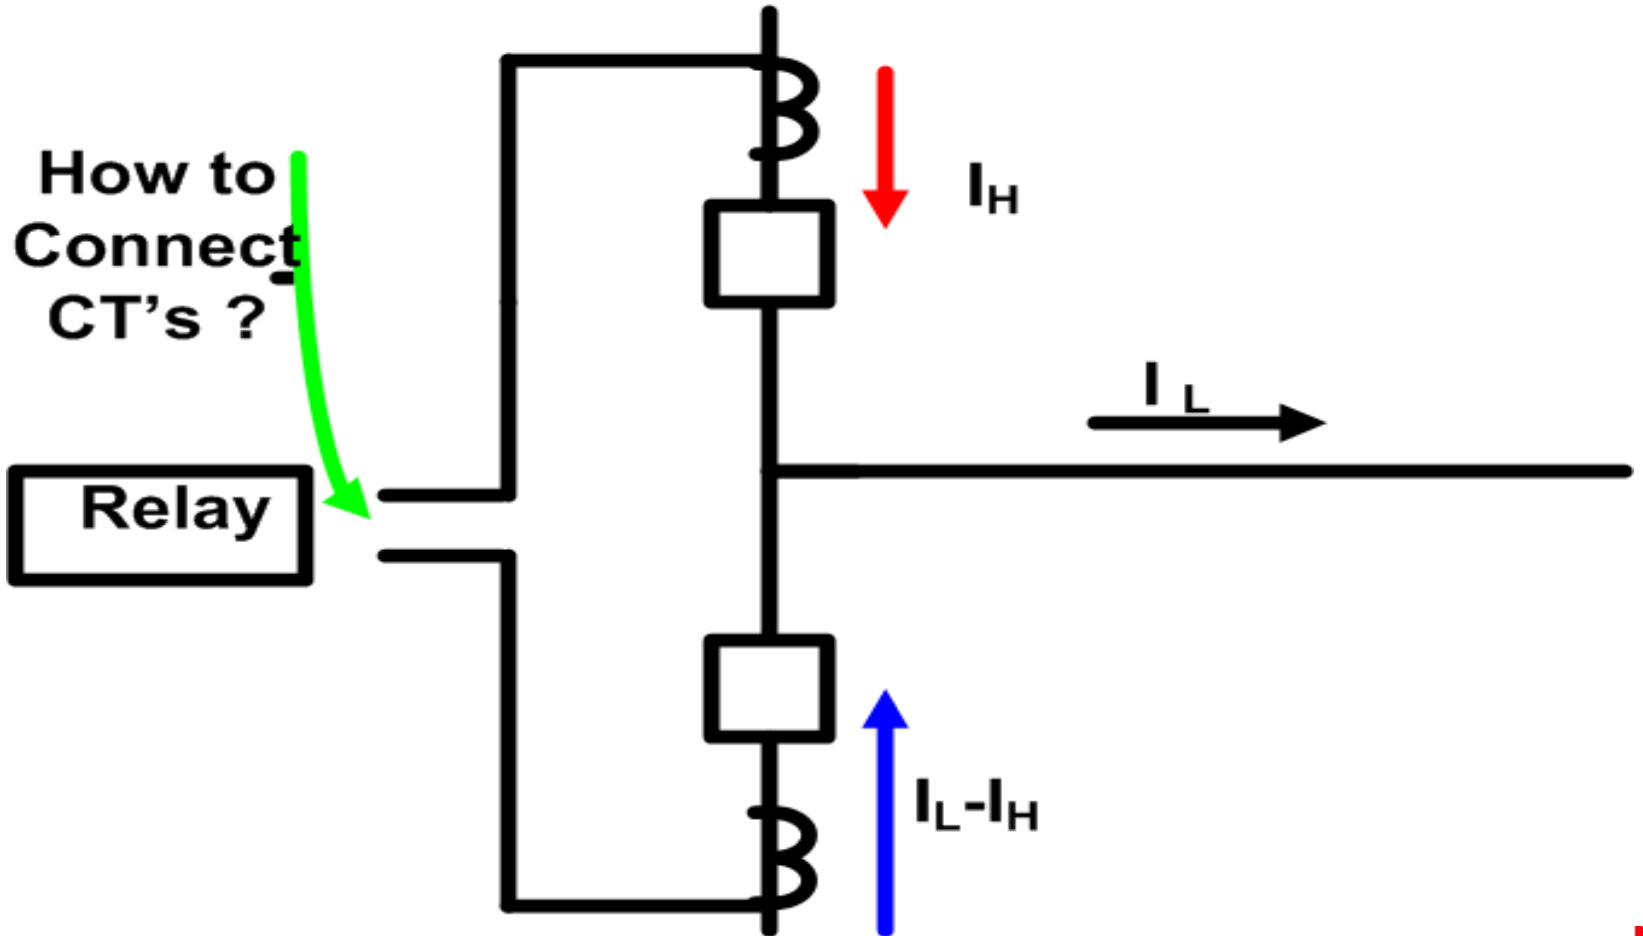


Classical current transformer connection

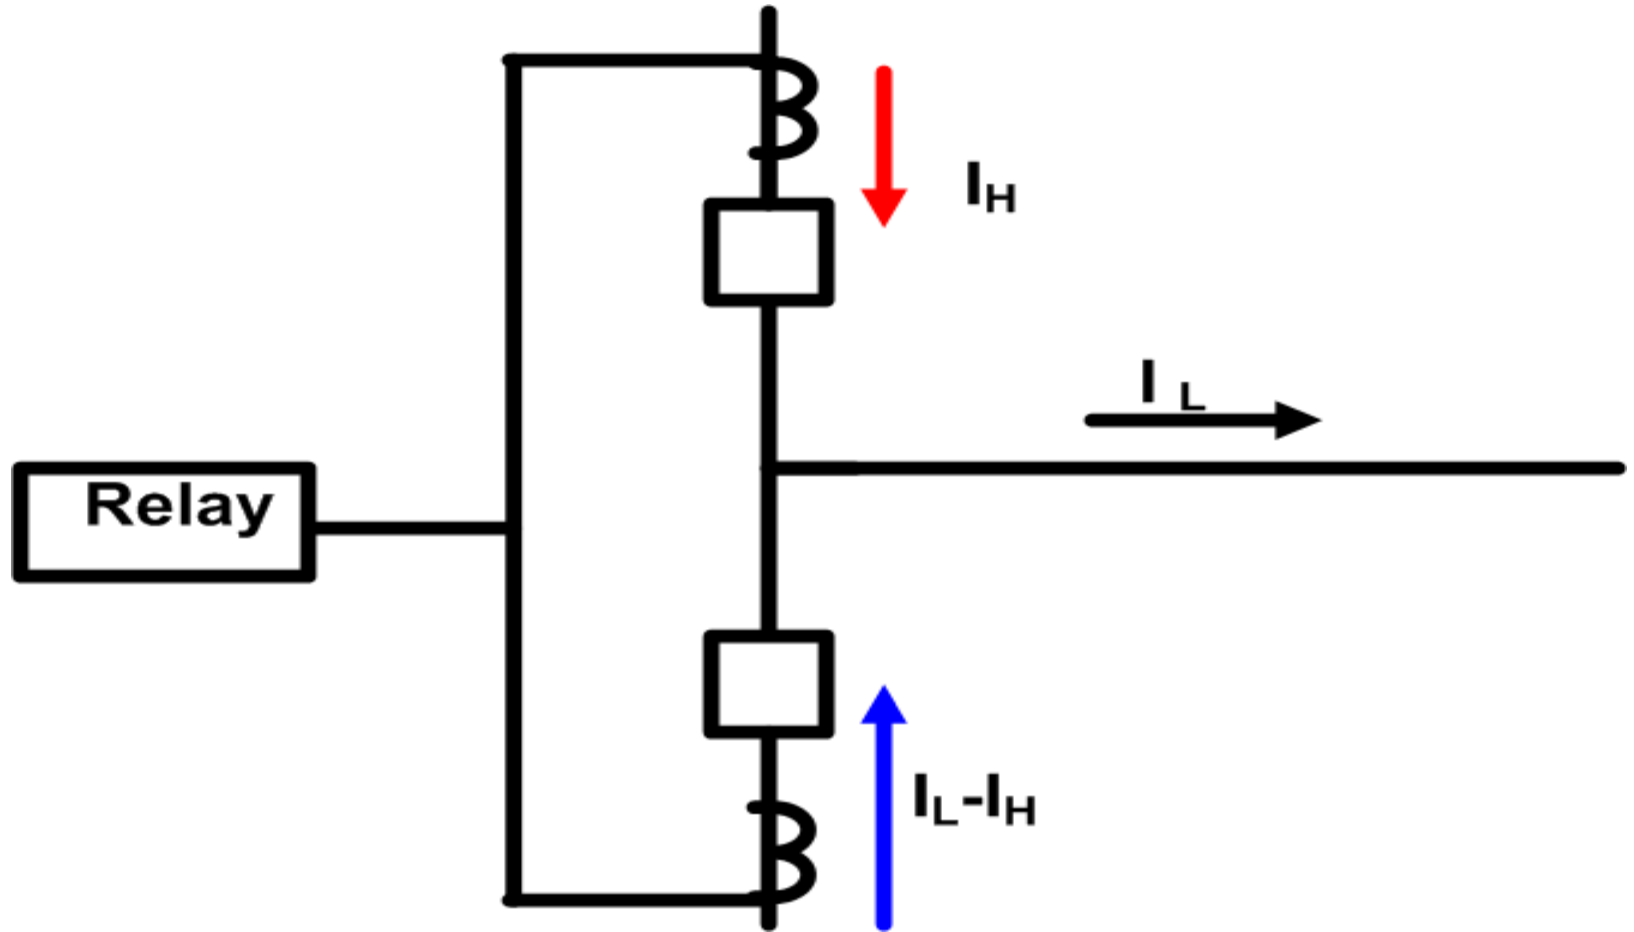


Classical connection Problems

- Individual current transformer information
 - Current transformer health
 - Open circuit
 - Shorted
 - Saturated
 - Metering information
- Larger restraint current requires operate current
 - Reduced sensitivity


Differential characteristic

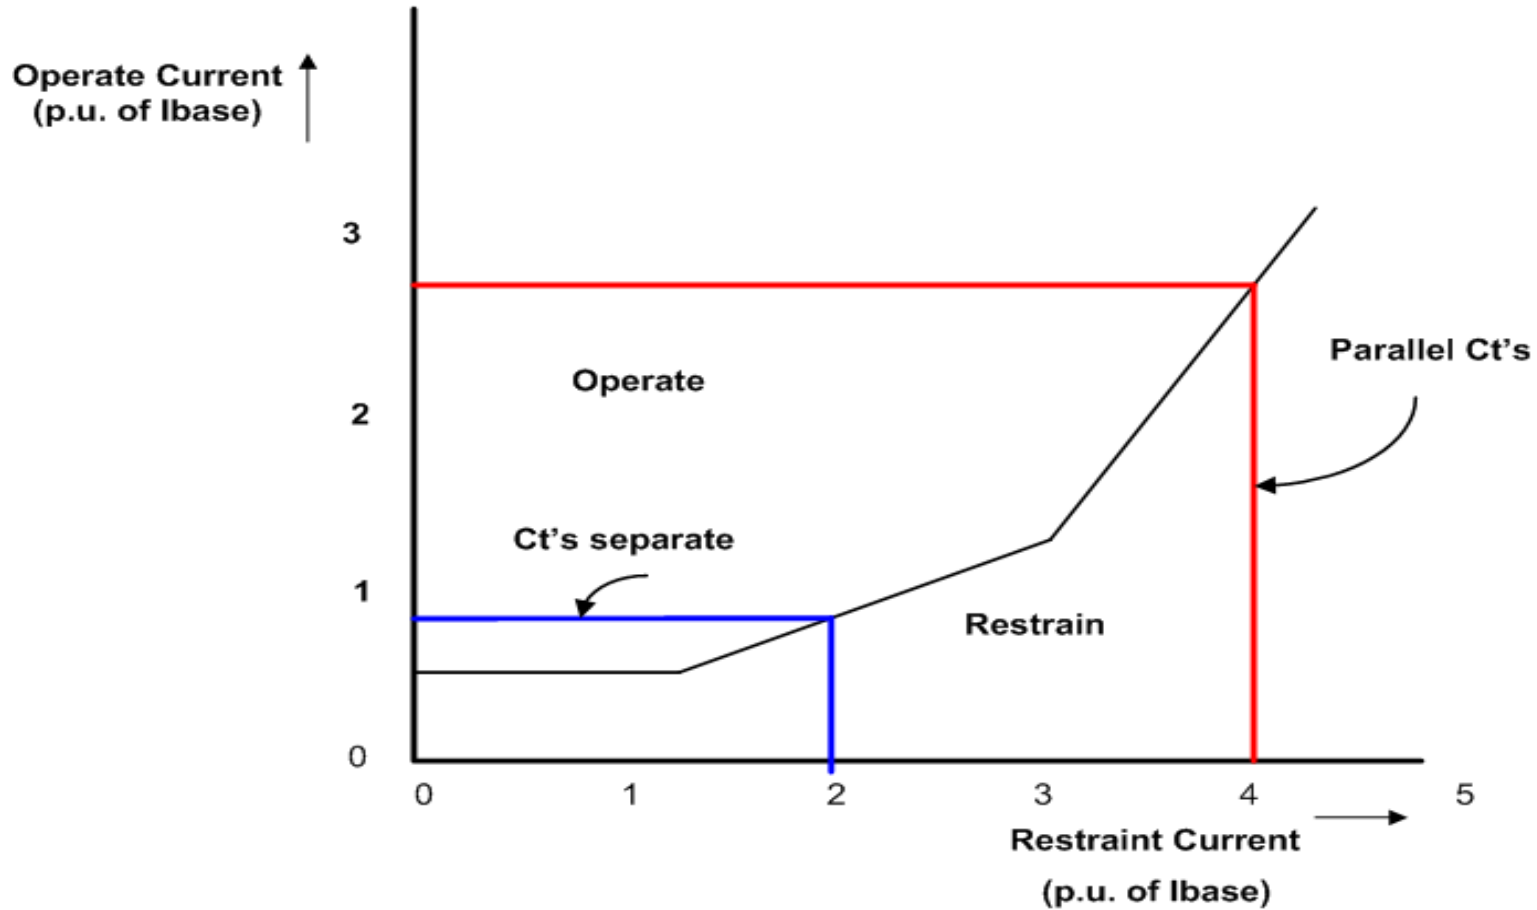

Preferred dual breaker connection

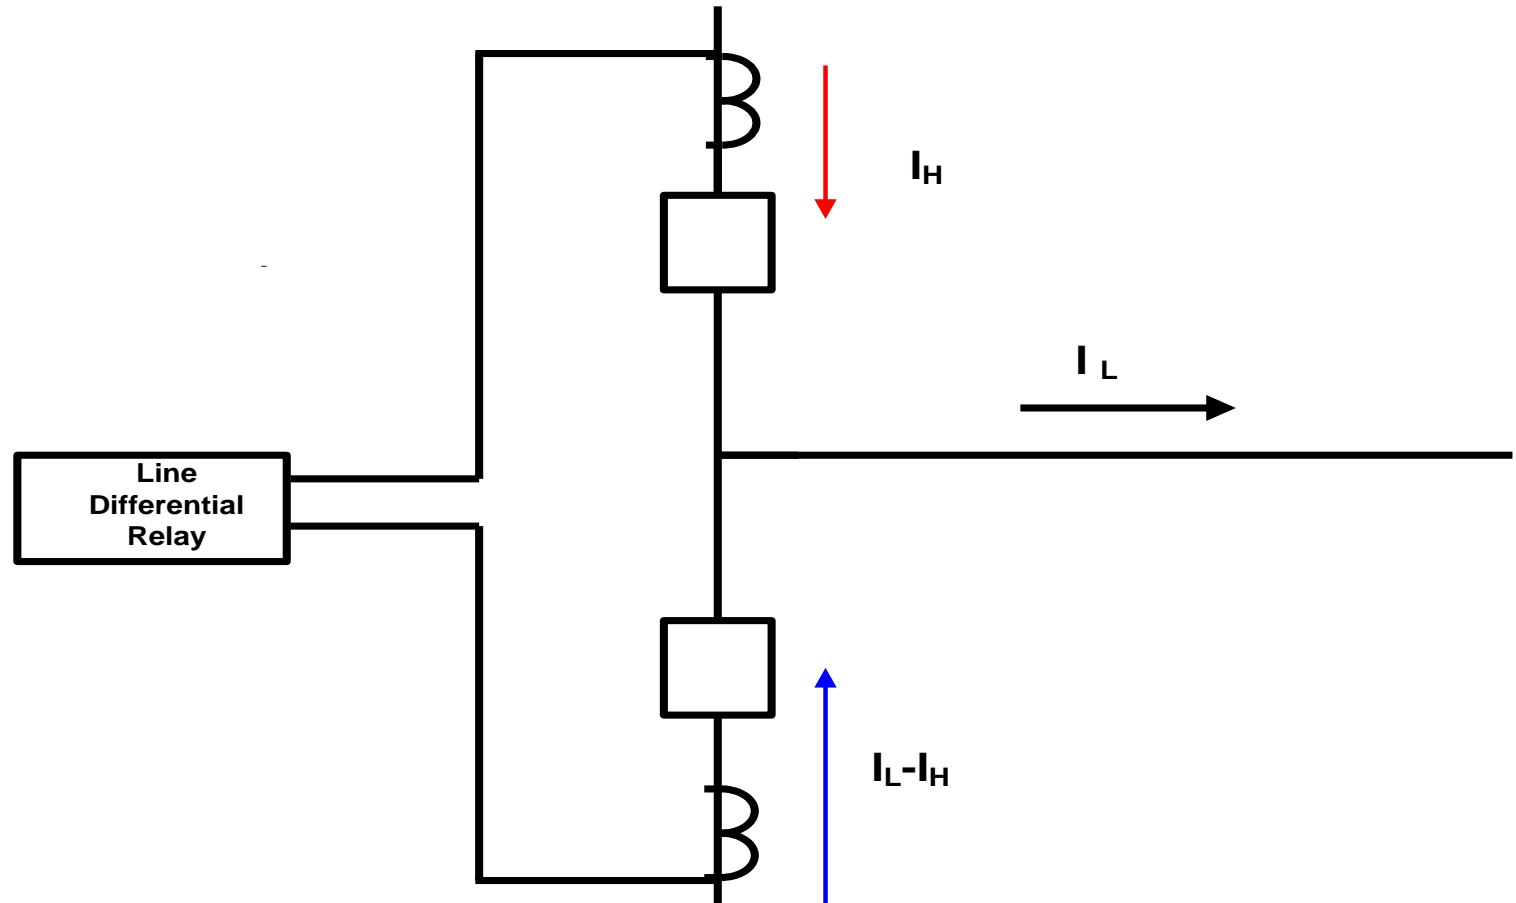

Transformer terminated line

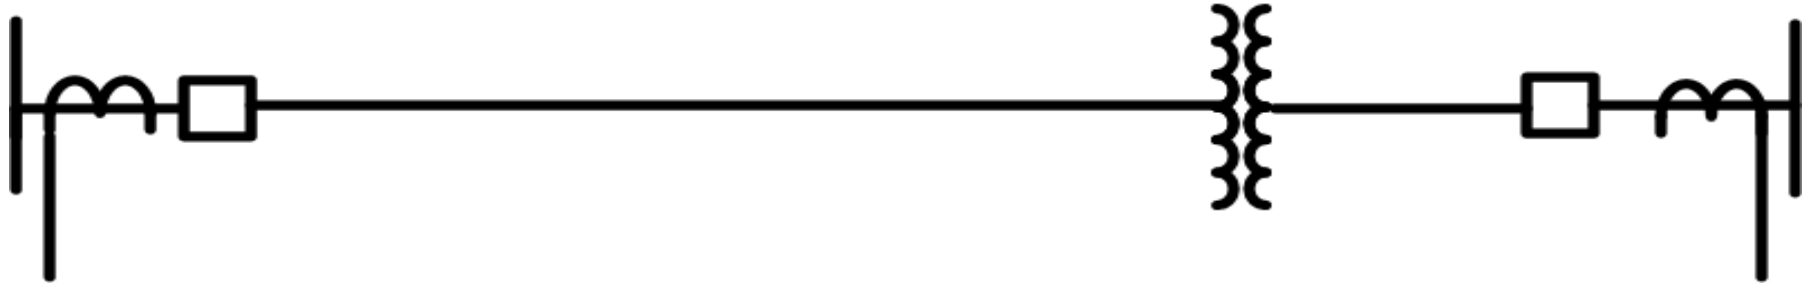


Transformer inrush

Current Phase shift across transformer
Transformer inrush current
Low side faults on delta wye grounded transformer



Take care of in settings by giving vector group of winding configuration

Classical differential operation

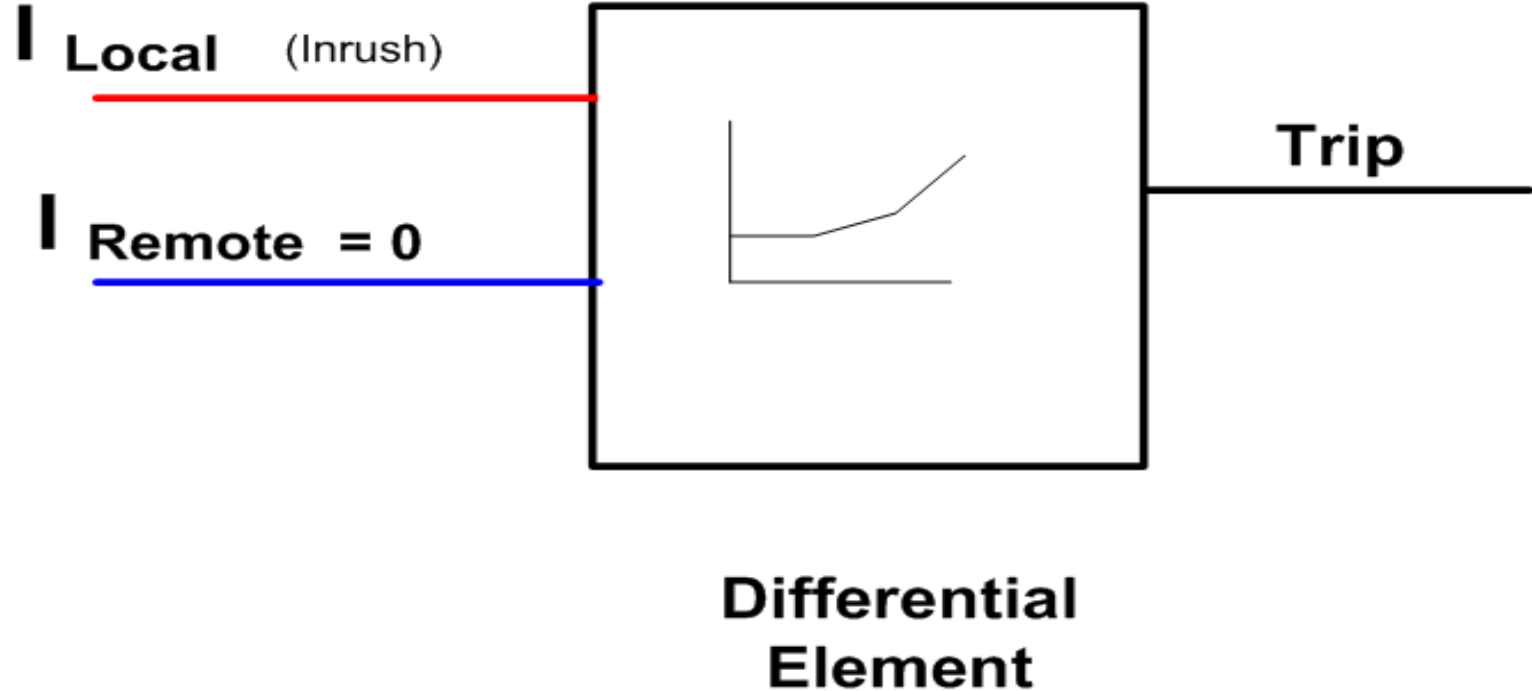


Inrush characteristic

- 2nd Harmonic
- Over 7% of Fundamental (60 HZ) Current

Delta wye transformer


External ground fault

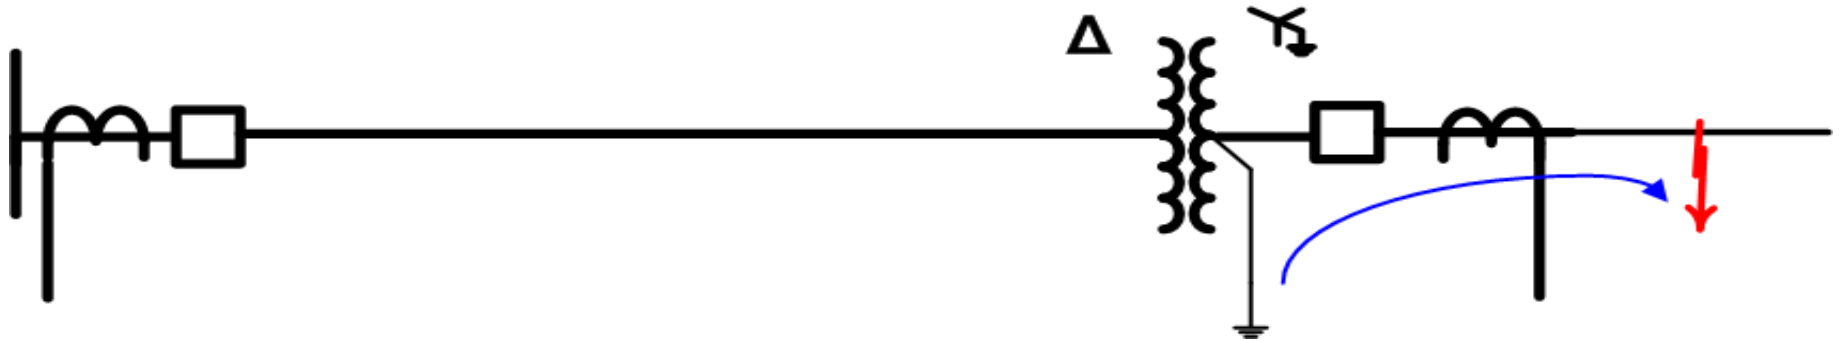


Transformer terminated line Concerns

- External ground faults causing zero sequence current to flow only on one side of transformer (delta – wye)
 - Eliminate zero sequence current
 - Previously done by using auxiliary CT in zero sequence trap
 - Do numerically in relay


Tapped line

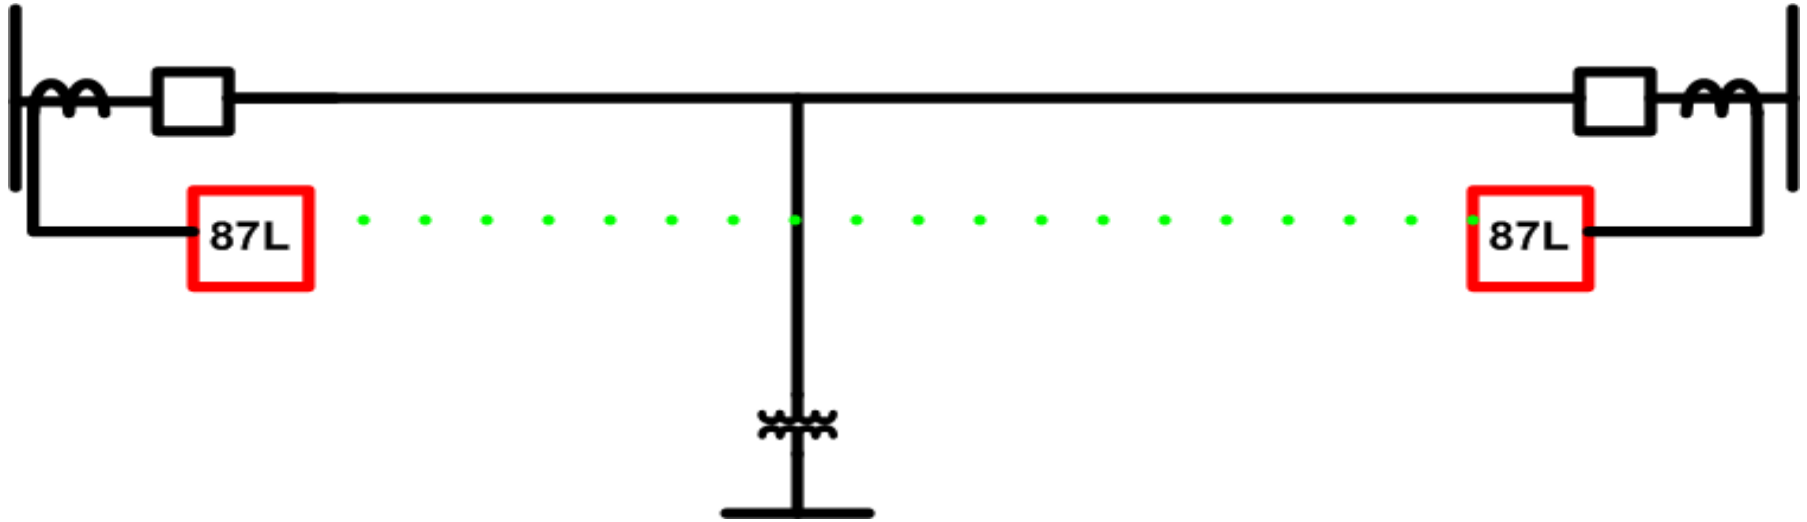

Secondary fault

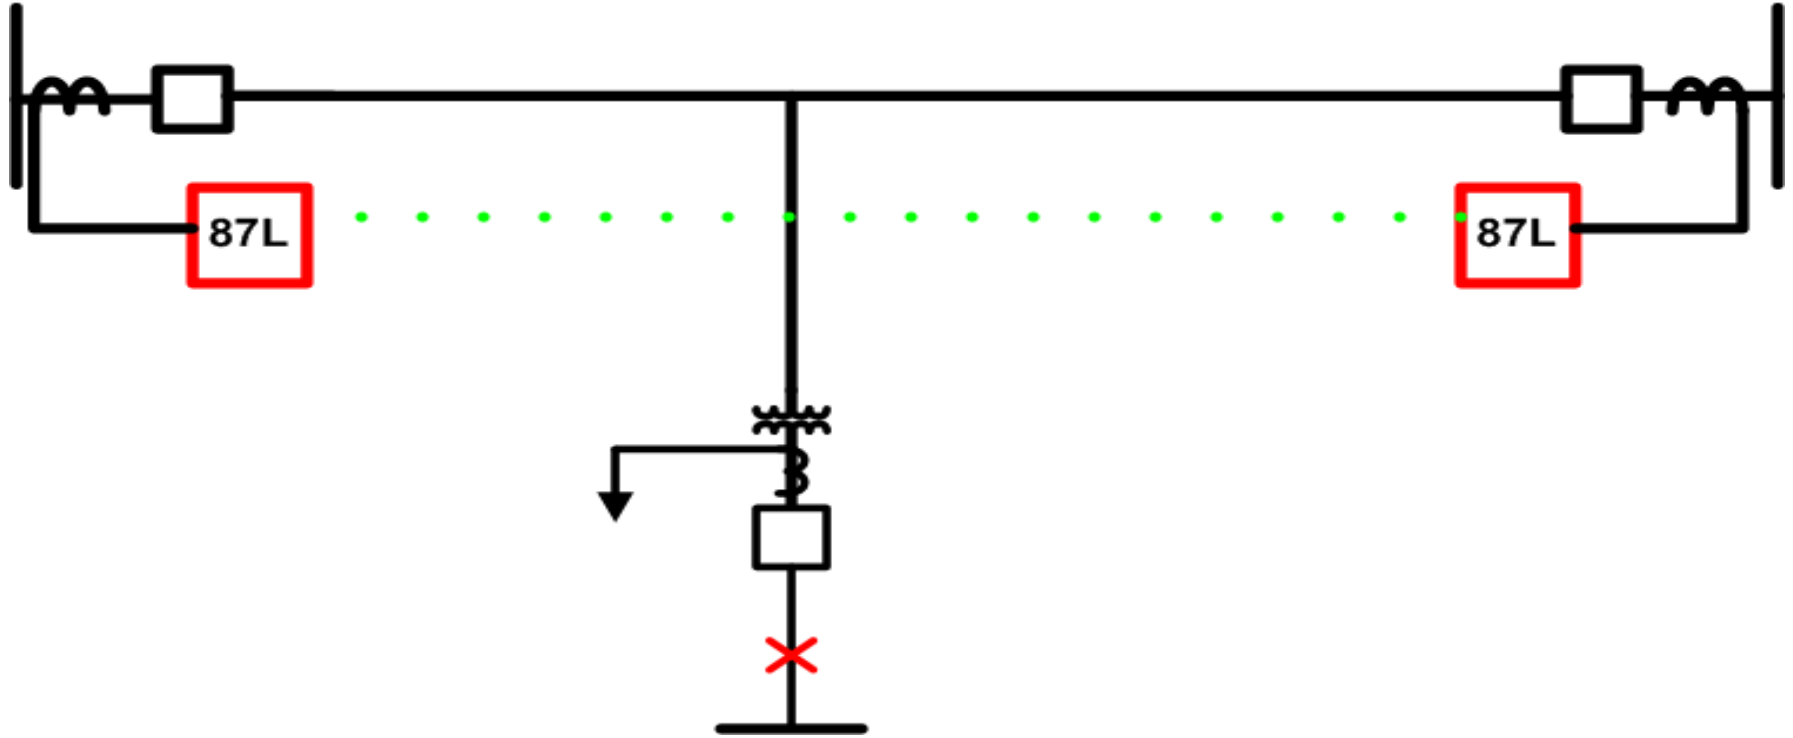

Relative fault currents

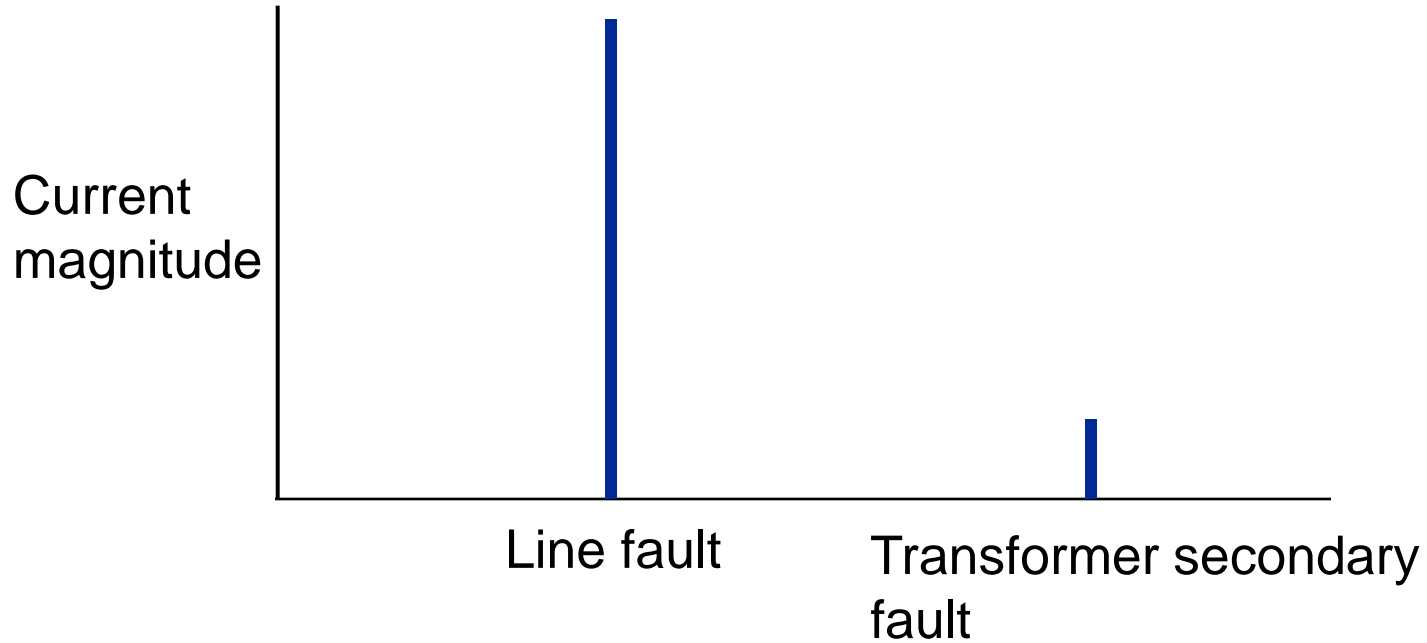


Small power transformer


Tapped line

- Time delay differential function for small differential current below a set limit
- Coordinate with downstream relays at tap
- Differential currents above limit with allow instantaneous operation


Tapped line

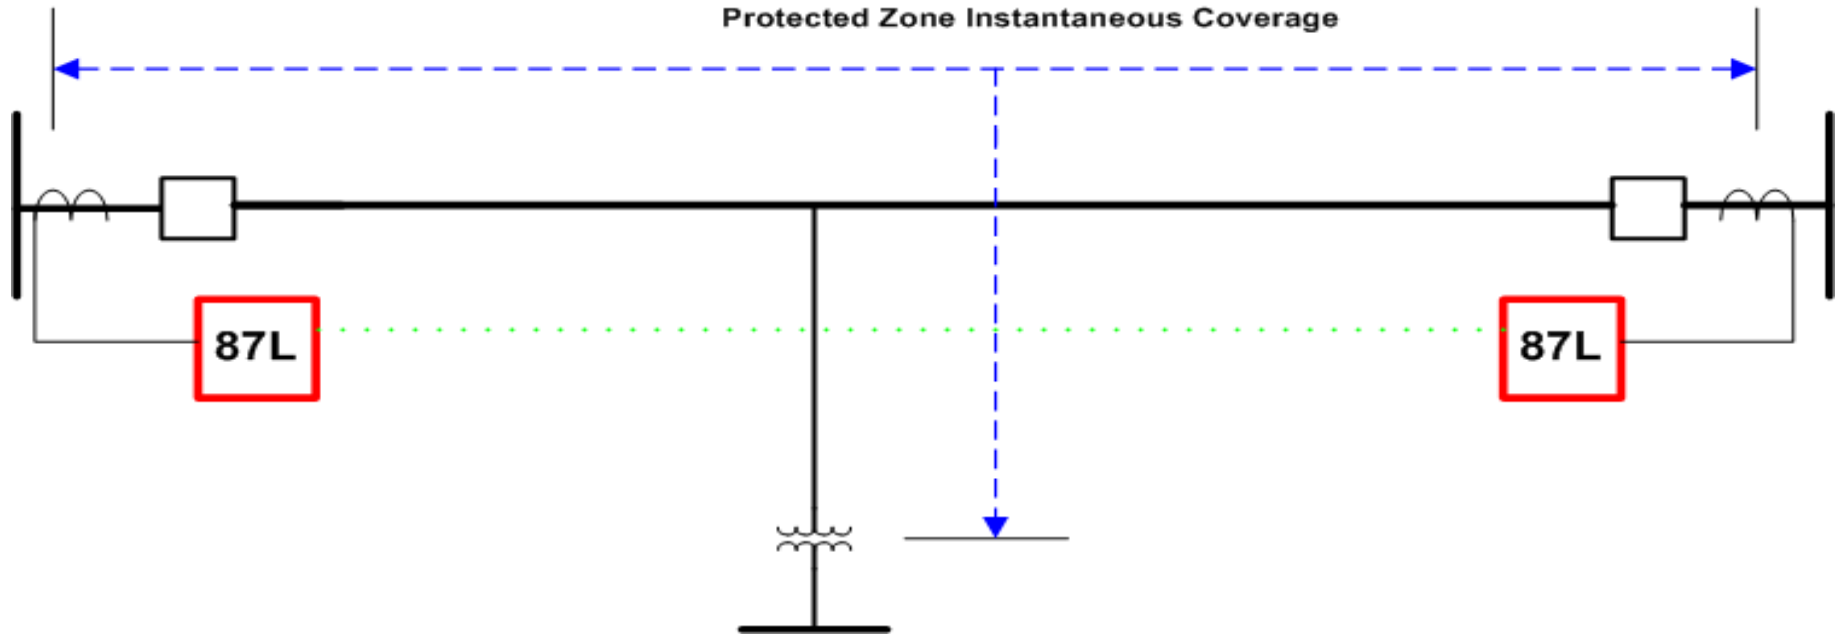


Differential protection Tap to small transformer

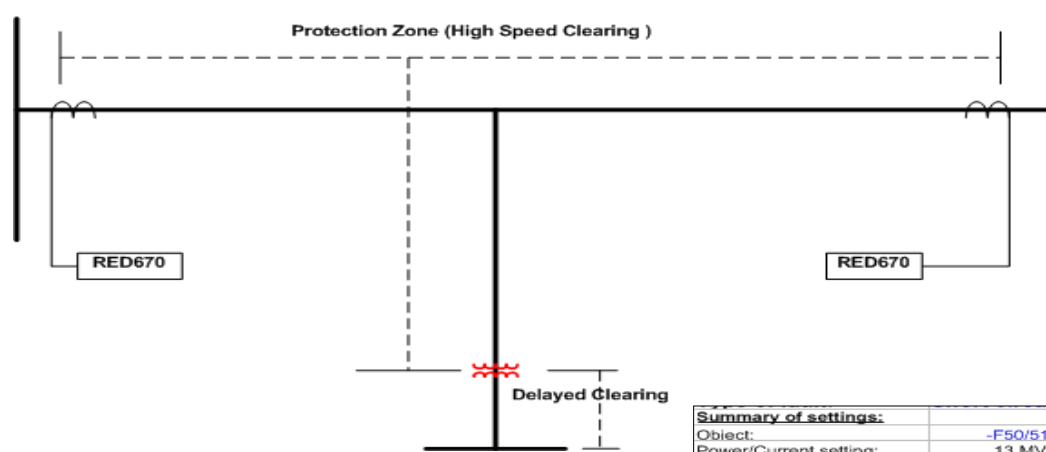

Group / Parameter Name	IED Value	PC Value	Unit	Min	Max
▶ LineTrif3Terminal(PDIF,87L)					
LT3D					
Operation		On			
IdMin		0.25	IB	0.20	2.00
AddDelay		On			
IMaxAddDelay		1.50	IB	0.20	5.00
tMinInv		0.300	s	0.001	6.000
CurveType		IEC Norm. inv.			
k		0.20		0.05	1.10

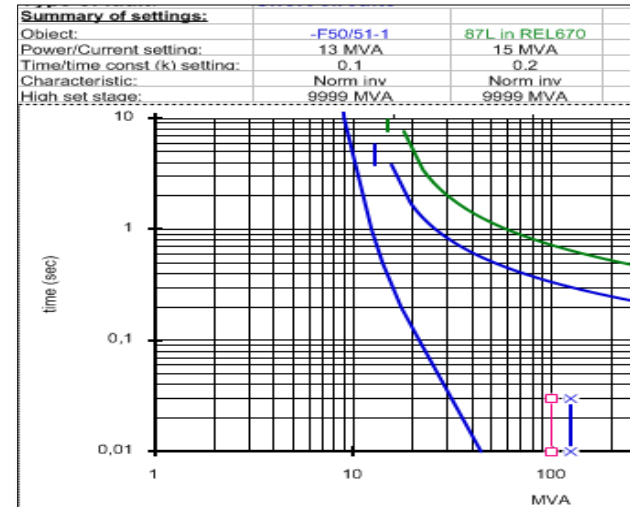


High impedance fault

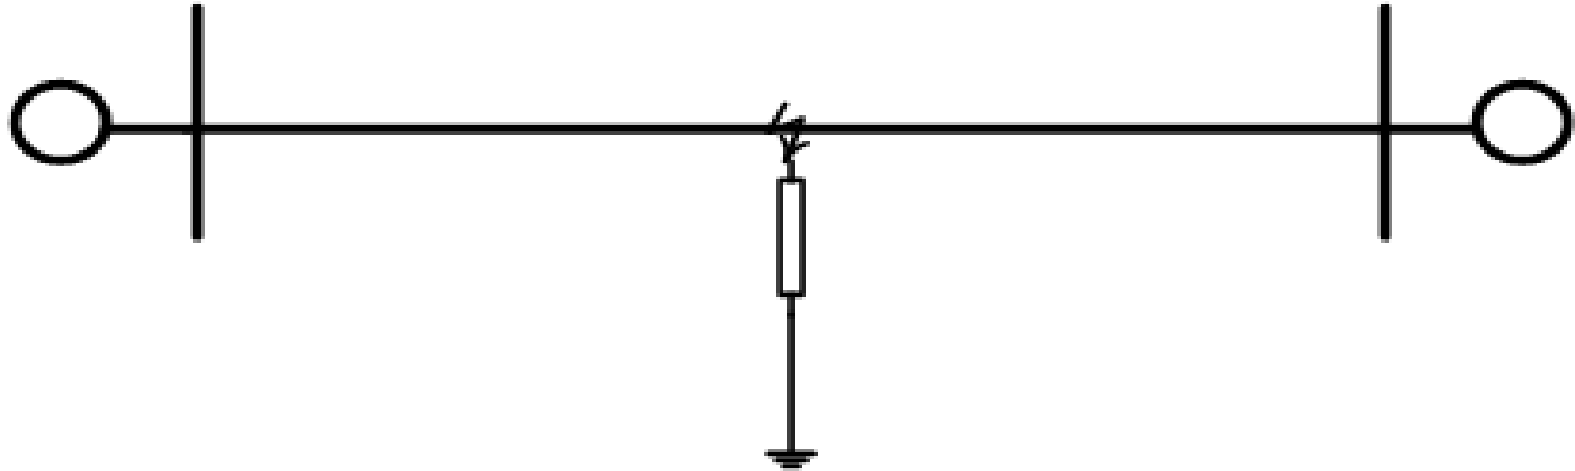


High Resistance Fault

Negative sequence Fault discriminator

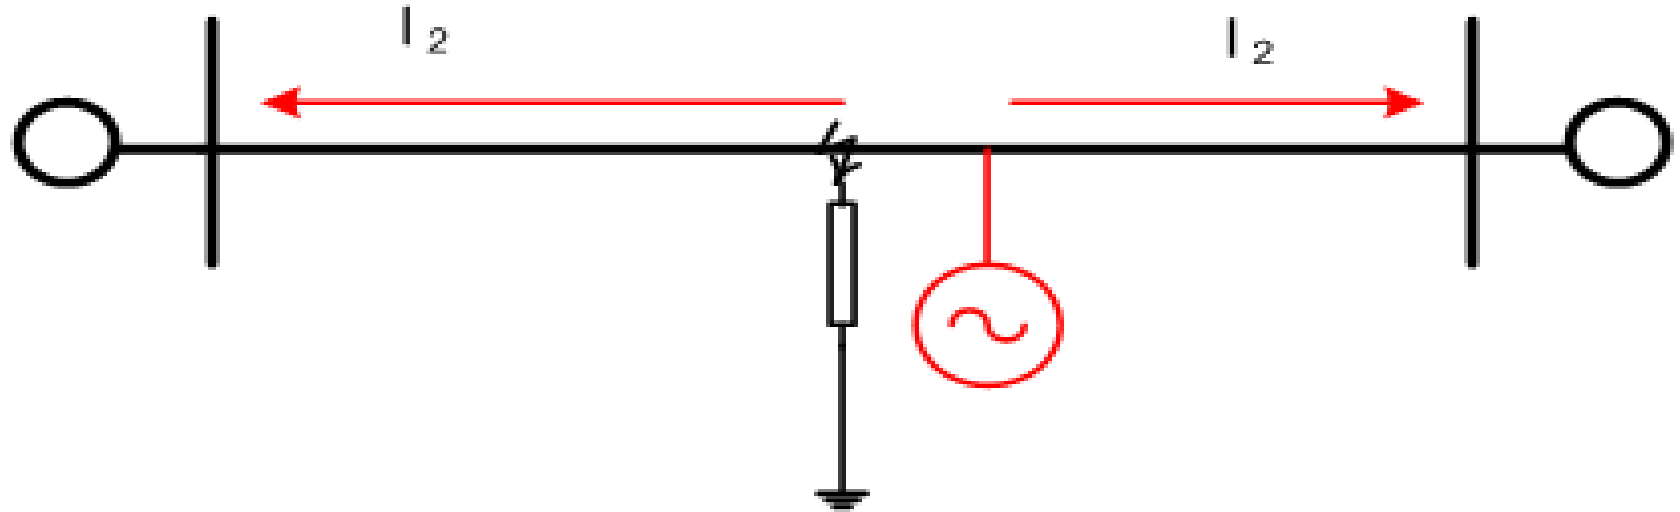


Negative Sequence From Fault

Negative sequence Current fault discriminator

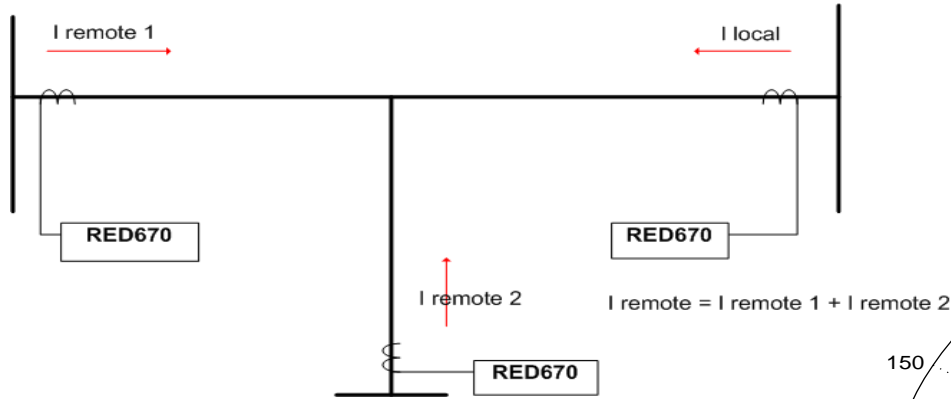


- If the two currents flow in the same direction, the fault is internal.
- If the two currents flow in opposite directions, the fault is external.

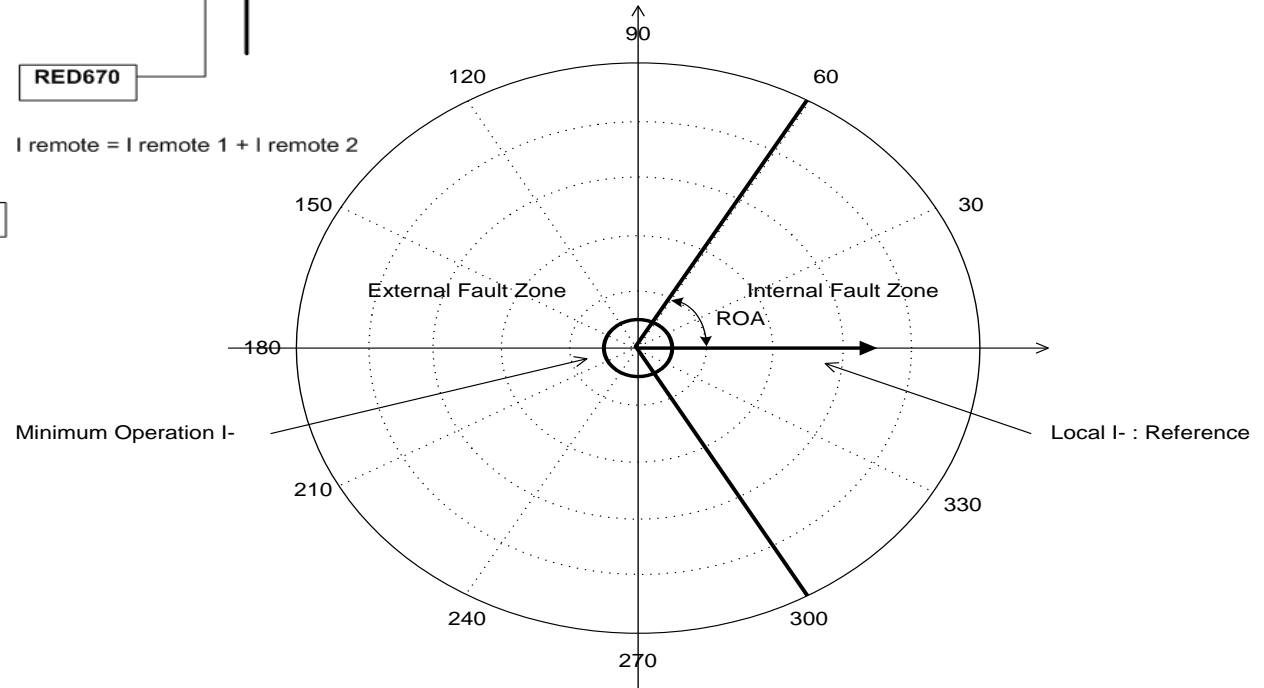

Capacitive current Compensation

Equivalent “PI” Network of Line

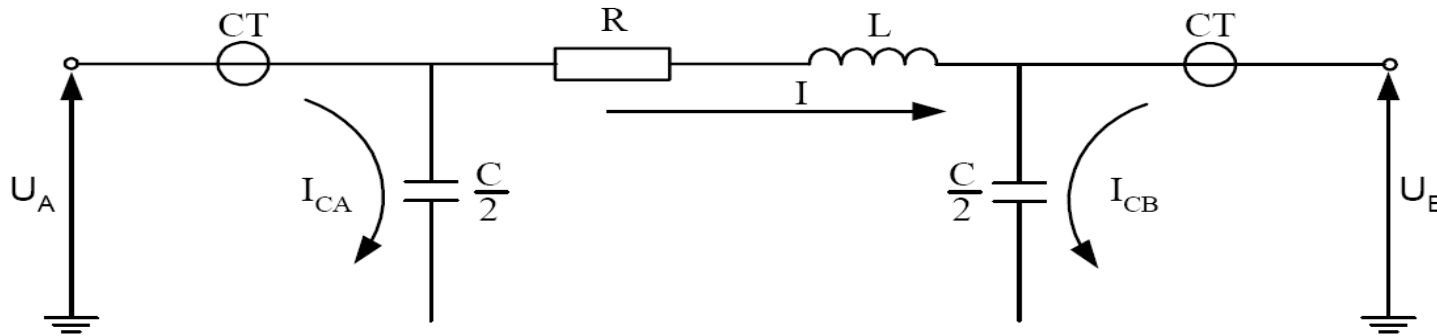


Make pick-up of differential above the capacitive current
Make a compensation in algorithm $I_c = V/X_c$

Charging current Compensation


- Measure fundamental frequency differential current under normal steady state conditions
- Normal means no start signals, neither internal or external fault,
- Subtract it making resulting differential current zero
- No need to raise minimum operate current

Three terminal line Application

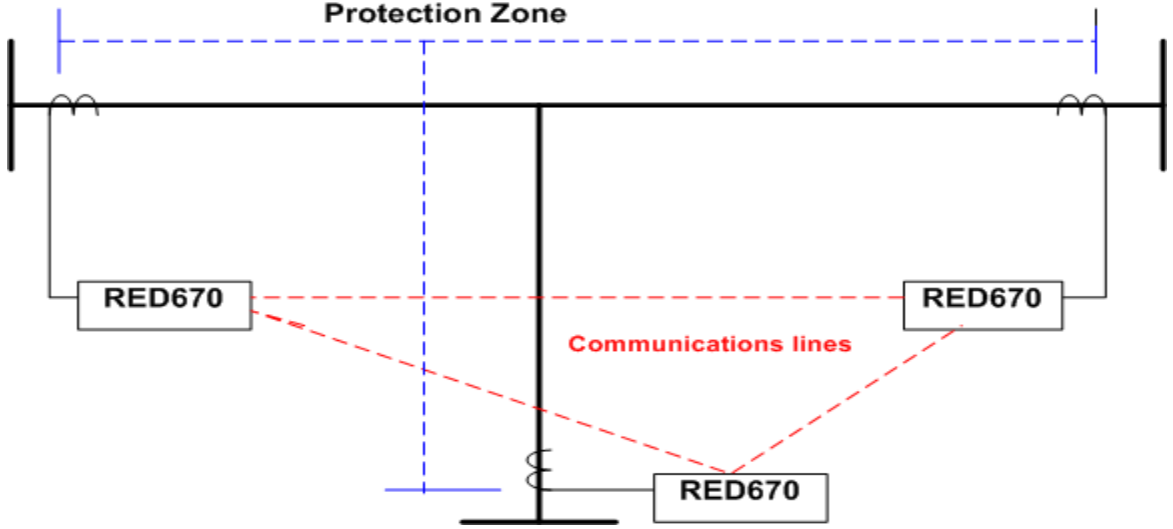

Current from all terminals


Five terminal line Application

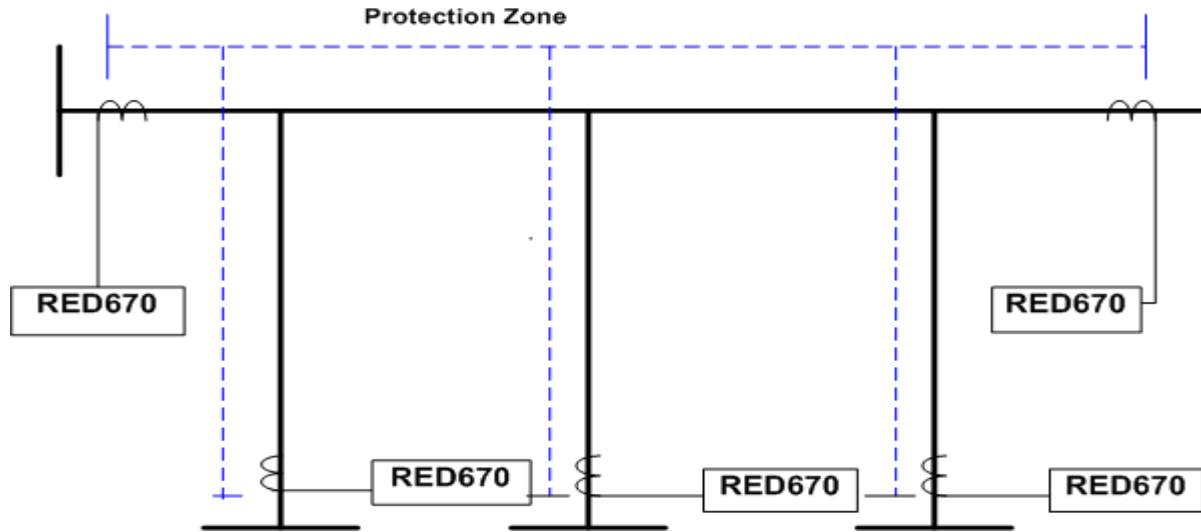

Fault current can be fed from all line ends

Four communications modules


Practical use

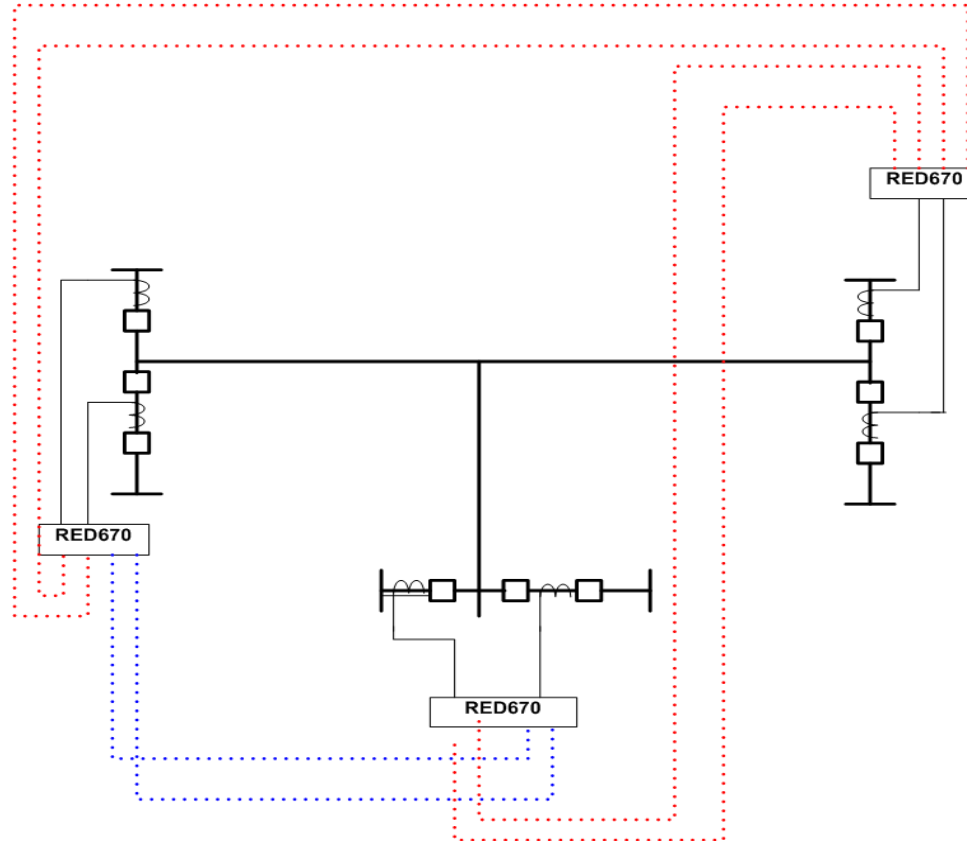

Route switched networks


With delay symmetry

The echo method allows for route switching with equal delay times for send and receive

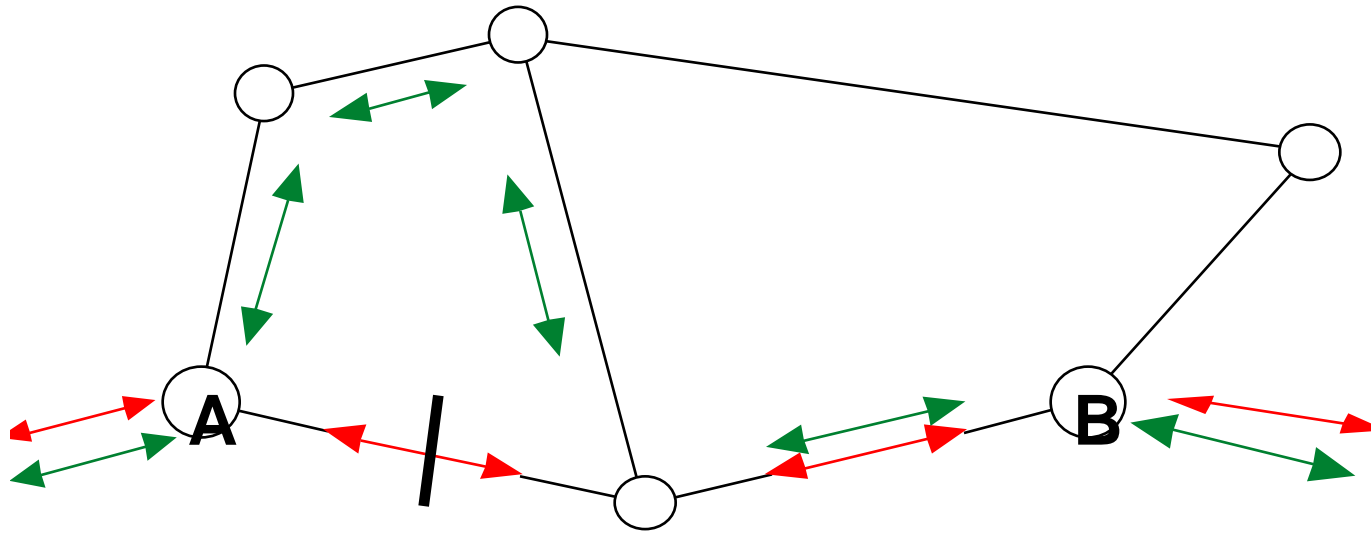


Route switched network Without delay symmetry


GPS time synchronization

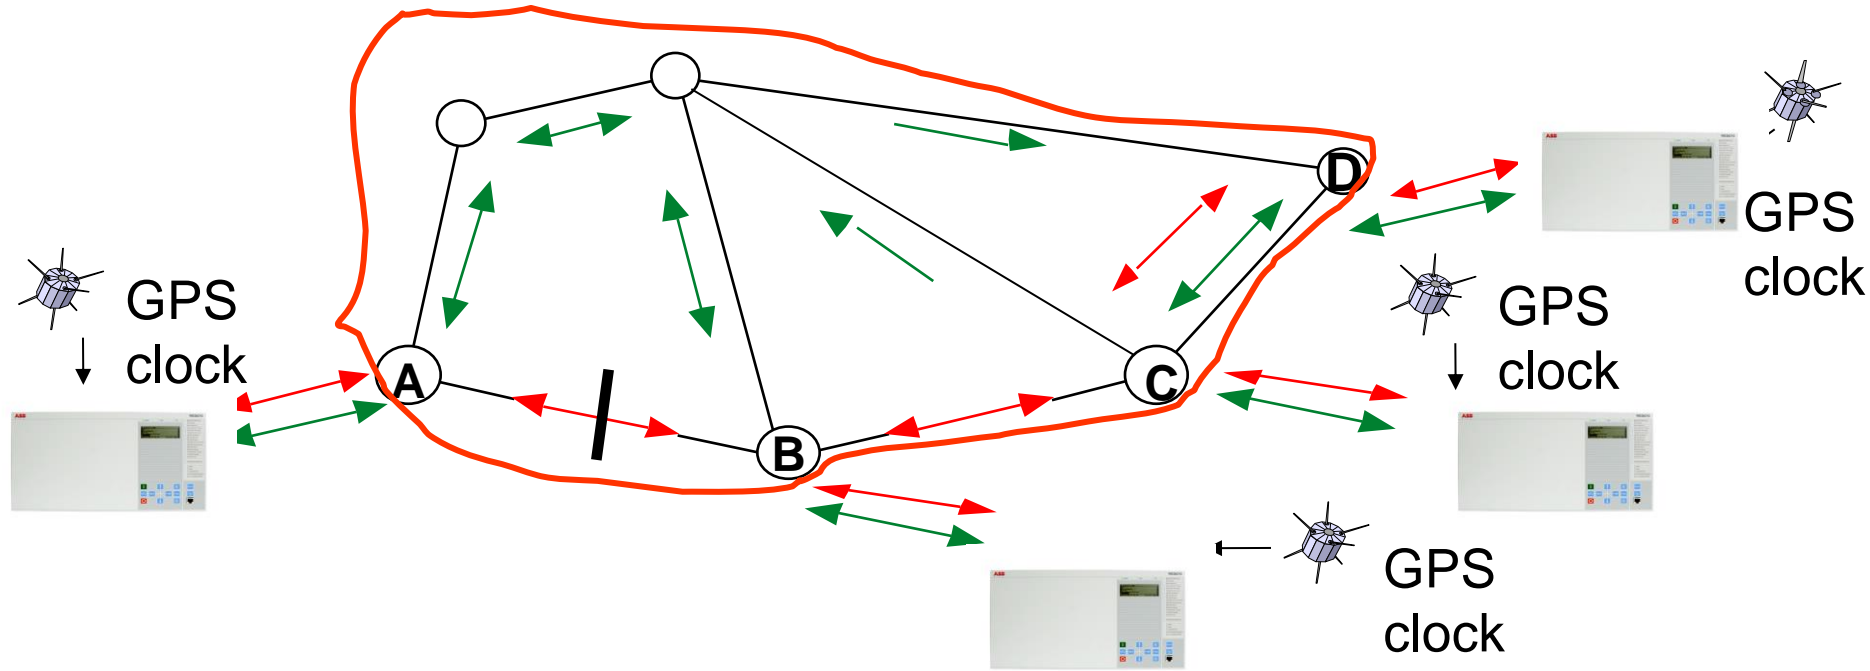


Redundant communication channels

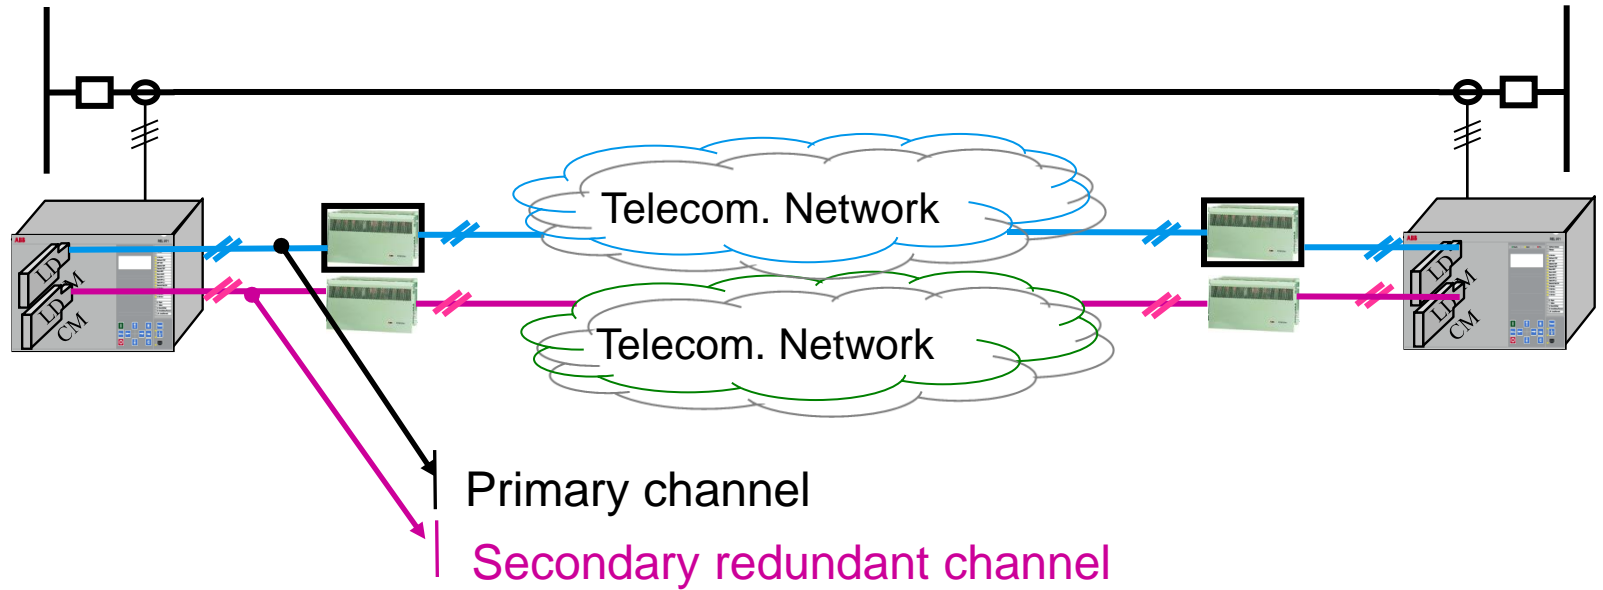

5-Terminal line Master-master system

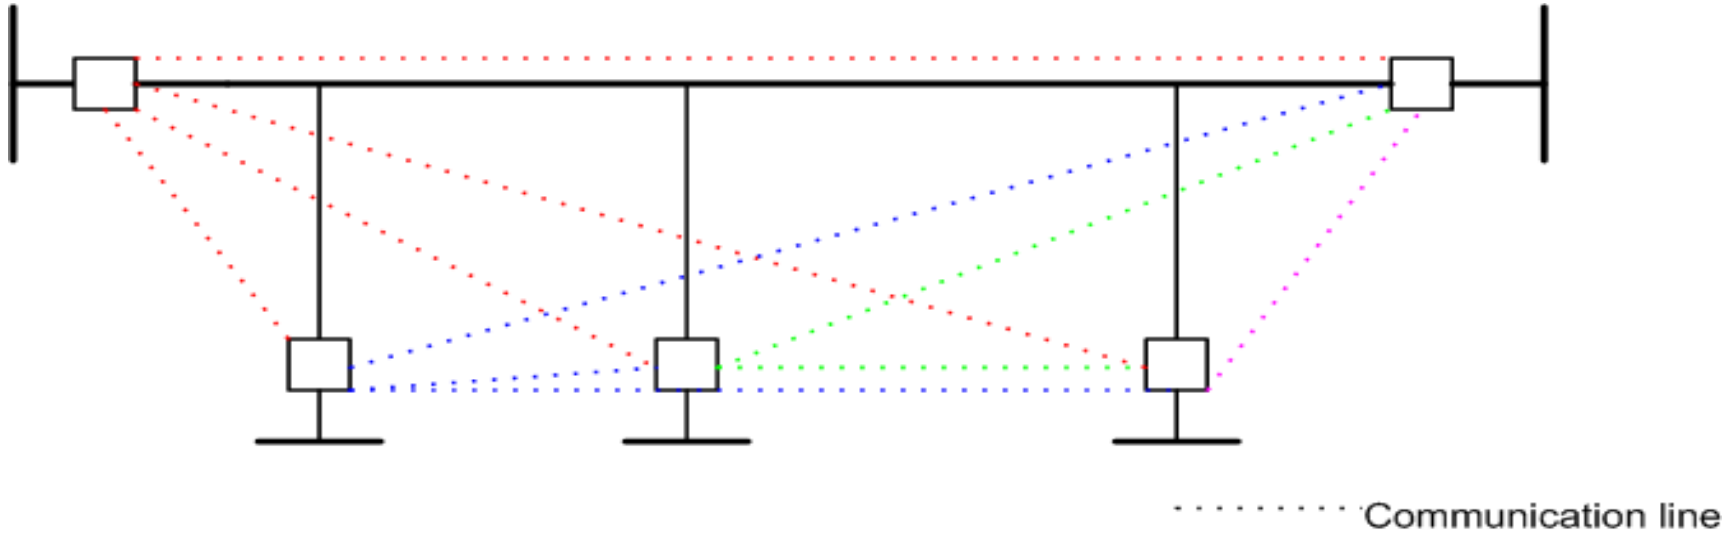


5-Terminal line Master-slave system

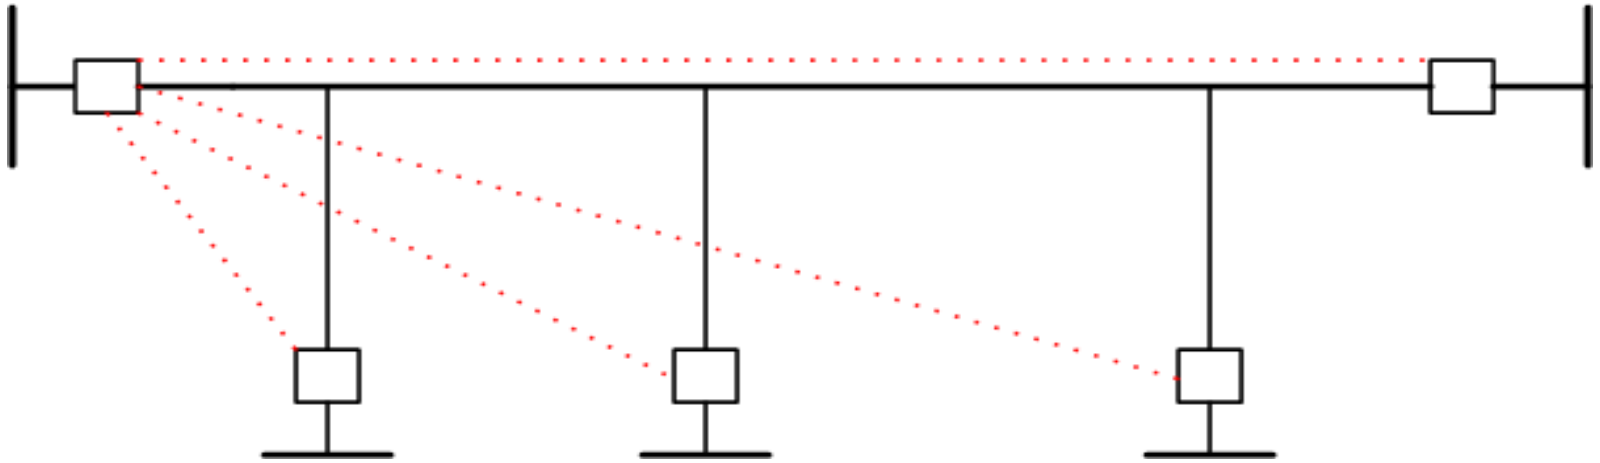


Master-slave

Application example

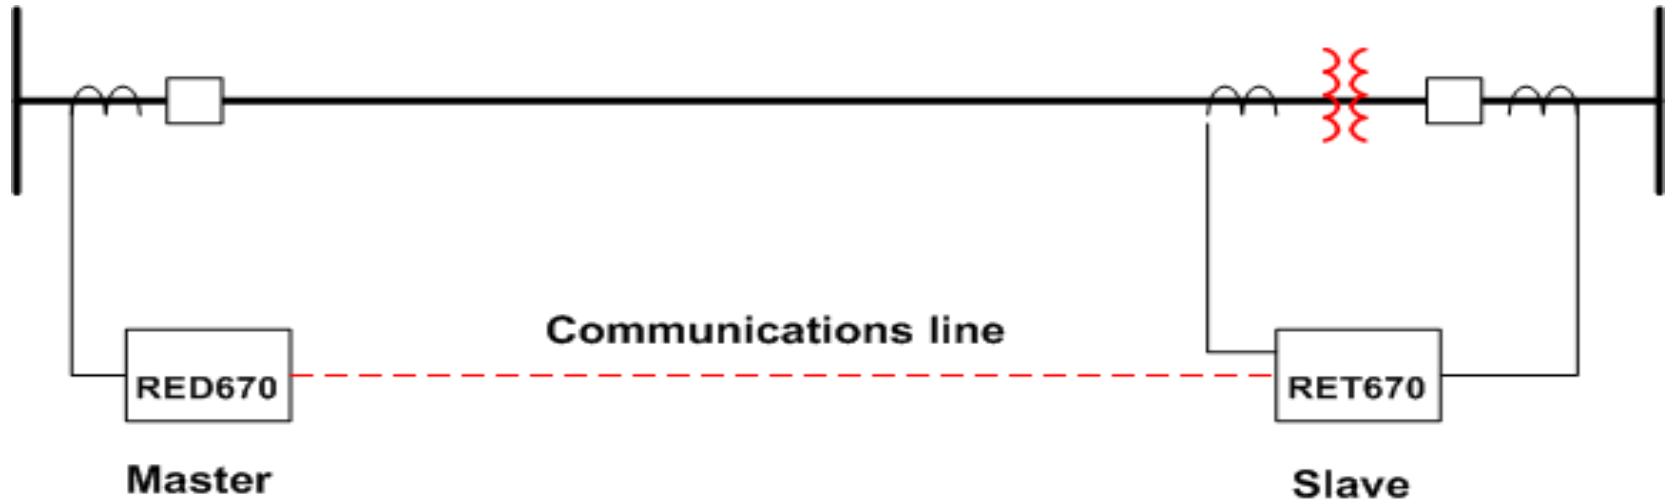

Multifunction line current differential relay

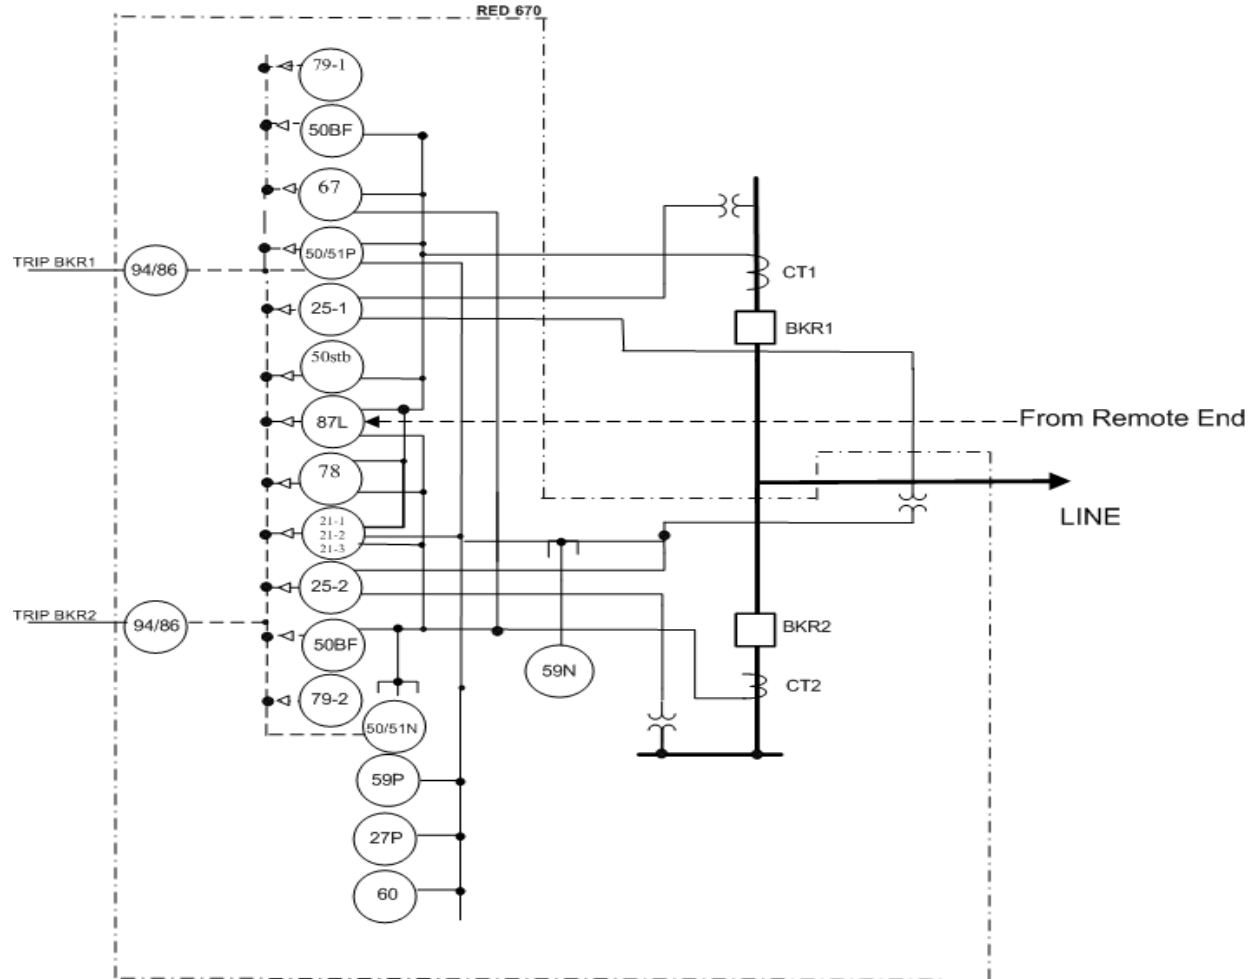

Relion® RED670

Maximum power system reliability

Efficient substation automation for the protection, monitoring and control of high voltage overhead lines and cables



- Delivering significant savings in configuration, setting, erection, commissioning, maintenance, and space
- Improving availability with outstanding performance and efficient information management
- Enabling applications with multiple algorithms, multiple objects, integrated and distributed architectures
- Application flexibility makes them an excellent choice for both new and retrofit installations

Thank you for your participation

Shortly, you will receive a link to an archive of this presentation.
To view a schedule of remaining webinars in this series, or for more
information on ABB's protection and control solutions, visit:

www.abb.com/relion

ABB Protective Relay School Webinar Series

Disclaimer

ABB is pleased to provide you with technical information regarding protective relays. The material included is not intended to be a complete presentation of all potential problems and solutions related to this topic. The content is generic and may not be applicable for circumstances or equipment at any specific facility. By participating in ABB's web-based Protective Relay School, you agree that ABB is providing this information to you on an informational basis only and makes no warranties, representations or guarantees as to the efficacy or commercial utility of the information for any specific application or purpose, and is not responsible for any action taken in reliance on the information contained herein. ABB consultants and service representatives are available to study specific operations and make recommendations on improving safety, efficiency and profitability. Contact an ABB sales representative for further information.