



ABB

The Company

We are an established world force in the design and manufacture of instrumentation for industrial process control, flow measurement, gas and liquid analysis and environmental applications.

As a part of ABB, a world leader in process automation technology, we offer customers application expertise, service and support worldwide.

We are committed to teamwork, high quality manufacturing, advanced technology and unrivalled service and support.

The quality, accuracy and performance of the Company's products result from over 100 years experience, combined with a continuous program of innovative design and development to incorporate the latest technology.

The UKAS Calibration Laboratory No. 0255 is just one of the ten flow calibration plants operated by the Company and is indicative of our dedication to quality and accuracy.

EN ISO 9001:2000



Cert. No. Q 05907

EN 29001 (ISO 9001)



Lenno, Italy – Cert. No. 9/90A

Stonehouse, U.K.



Electrical Safety

This equipment complies with the requirements of CEI/IEC 61010-1:2001-2 'Safety Requirements for Electrical Equipment for Measurement, Control and Laboratory Use'. If the equipment is used in a manner NOT specified by the Company, the protection provided by the equipment may be impaired.

Symbols

One or more of the following symbols may appear on the equipment labelling:

	Warning – Refer to the manual for instructions		Direct current supply only
	Caution – Risk of electric shock		Alternating current supply only
	Protective earth (ground) terminal		Both direct and alternating current supply
	Earth (ground) terminal		The equipment is protected through double insulation

Information in this manual is intended only to assist our customers in the efficient operation of our equipment. Use of this manual for any other purpose is specifically prohibited and its contents are not to be reproduced in full or part without prior approval of the Technical Publications Department.

Health and Safety

To ensure that our products are safe and without risk to health, the following points must be noted:

1. The relevant sections of these instructions must be read carefully before proceeding.
2. Warning labels on containers and packages must be observed.
3. Installation, operation, maintenance and servicing must only be carried out by suitably trained personnel and in accordance with the information given.
4. Normal safety precautions must be taken to avoid the possibility of an accident occurring when operating in conditions of high pressure and/or temperature.
5. Chemicals must be stored away from heat, protected from temperature extremes and powders kept dry. Normal safe handling procedures must be used.
6. When disposing of chemicals ensure that no two chemicals are mixed.

Safety advice concerning the use of the equipment described in this manual or any relevant hazard data sheets (where applicable) may be obtained from the Company address on the back cover, together with servicing and spares information.

Contents

1	Introduction	2
2	Math Configuration	3
2.1	Math Block Description	3
2.2	Typical Math Block	3
2.3	Operators	3
2.4	Constants	3
2.5	Analog Sources	5
2.6	Digital Sources	5
2.7	Functions	6
2.8	Creating Math Blocks	7
2.9	Standard Functions	11
2.9.1	Trigonometric Functions	11
2.9.2	Statistical Functions	11
2.9.3	Logarithmic Functions	11
2.9.4	Relative Humidity	11
2.9.5	Sterilization Fvalue Calculation	13
2.9.6	Switch Functions	15
2.9.7	Absolute Value Function	15
2.10	Application Examples	15
2.10.1	Liquid Flow	15
2.10.2	Ideal Gas Flow	17
3	Logic Configuration	18
3.1	Logic Equation Description	18
3.2	Worked Example – Reservoir Level Control	18
3.3	Creating Logic Equations	19
4	Diagnostics	20
4.1	Introduction	20

1 Introduction

This supplement details the programming and operation of the math equations and logic editor option on the SM1000 and SM2000 Videographic Chart Recorders.

These instructions must be read in conjunction with the recorder's User Guide (IM/SM1000 or IM/SM2000).

SM1000 recorders with the optional math equations and logic editor functionality are identified by the appearance of the respective items in the Configuration system's menus – see Fig. 1.2.

SM2000 recorders with the optional math equations and logic editor functionality are identified by the appearance of the respective icons in the main Configuration window – see Fig. 1.2.

For information on accessing Configuration mode, refer to Section 4 of the appropriate User Guide (IM/SM1000 or IM/SM2000).

Note.

- All views in this manual (except Fig. 1.1) are of the configuration screens of the SM2000 but the screens from the SM1000 are similar.
- The SM1000 is not equipped with a touchscreen therefore all menu selections etc. are made using the operator keys.

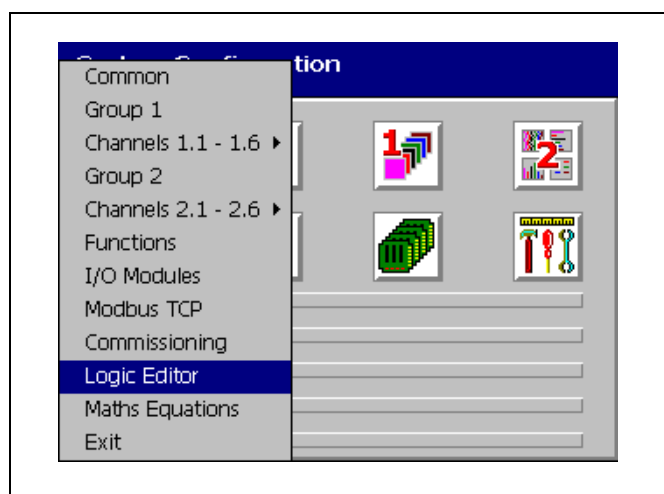


Fig. 1.1 Math and Logic Menu Items – SM1000

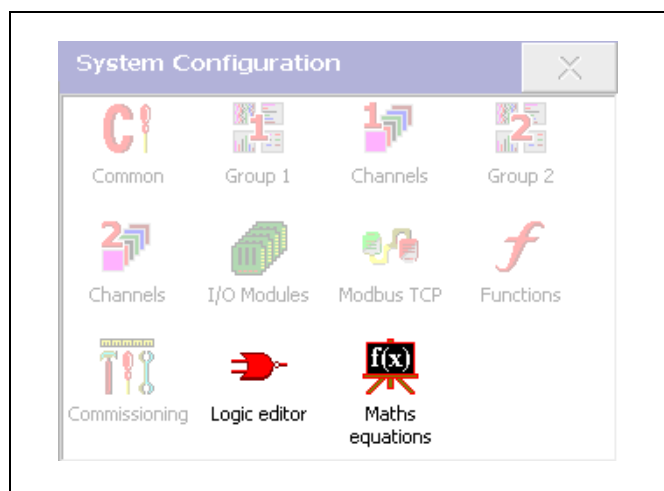


Fig. 1.2 Math and Logic Icons – SM2000

2 Math Configuration

2.1 Math Block Description

Note.

- Up to twelve Math Blocks, configured individually using the 'Math Pad' – see Fig. 2.2, page 7.
- Each Math result has its own Long and Short Tags and Engineering Range
- Up to 18 different preset functions – see Table 2.4, page 6
- Constants up to three decimal places
- Maximum equation length – 40 characters
- Up to three digital signals per equation

Individual recording channel signals, analog and digital sources can be combined in a Math Block to produce a customized recording channel or retransmission source.

Typical examples include adding/subtracting the values of a number of analog sources together to form one recording channel.

More complex blocks can also be implemented that determine relative humidity, mass flow or zirconia oxygen concentration.

Digital signals can be used in Math Blocks to enable/disable the output when certain conditions are true.

2.2 Typical Math Block – Fig. 2.1

Each math block comprises any number of sources, constants, operators and functions, to a maximum length of 40 characters, – see Fig. 2.1, page 4.

Possible operators, sources and functions are listed in Tables 2.1 to 2.4.

2.3 Operators – Table 2.1

Operator	Description	Operator	Description
+	Add	–	Subtract
*	Multiply	/	Divide

Table 2.1 Operators

2.4 Constants

Math blocks may contain any number of constants, each with a limit of three decimal places, up to the maximum of 40 characters for the whole block. The maximum range of each constant is 9999 to – 999

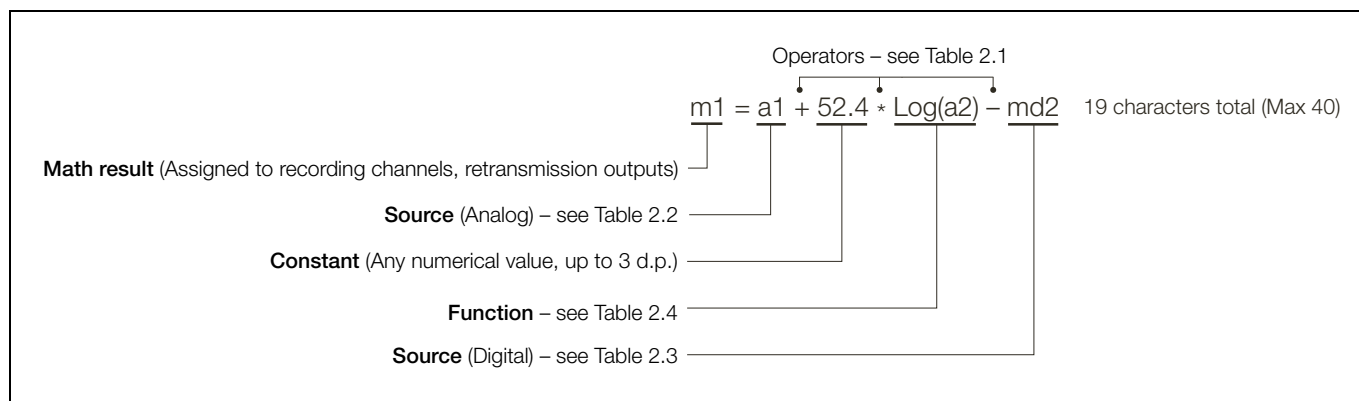


Fig. 2.1 Typical Math Block

Note.

- Operators are evaluated from left to right therefore the above equation is evaluated as:
 $[(a1 + 52.4) * \text{Log}(a2)] - md2$ and NOT as $a1 + (52.4 * \text{Log}(a2)) - md2$.
- Functions cannot be nested within other functions. To enter an equation requiring nested functions it is necessary to use another math block, e.g. to evaluate the equation:
 $\frac{a1 + a2}{52.4 - a3}$ proceed as follows:
 - Enter math block 1 as $m1 = a1 + a2/m2$
 - Enter math block 2 as $m2 = 52.4 - a3$
- Digital signals (md1 to md3) are evaluated as 0 (inactive) and 1 (active), thus in the following example:
 $m1 = a1 + a2 * md1$
 the sum of $(a1 + a2)$ is set to zero if the digital input md1 is also zero.

2.5 Analog Sources – Table 2.2

Sources can be either analog or digital.

Analog sources are identified within a math block by the preset mnemonic shown in Table 2.2.

Source Name		Mnemonic	Description
Analog input values	Analog I/P A1	a1	From Analog input module.
	to	to	
	Analog I/P B6	b6	
Comms Analog input values	Comms AIN 1	c1	Received via the Modbus/Modbus TCP serial communications link – see Appendix B in the User Guide (IM/SM1000 or IM/SM2000).
	to	to	
	Comms AIN 24	c24	
Maximum Statistics Input Value	Stats 1.1 max	sh11	Value since the totalizer on a given channel last wrapped or reset. Available only on analog channels and if the relevant totalizer is enabled in the Configuration level.
	to	to	
	Stats 2.6 max	sh26	
Minimum Statistics Input Value	Stats 1.1 min	sl11	Value since the totalizer on a given channel last wrapped or reset. Available only on analog channels and only if the relevant totalizer is enabled in the Configuration level.
	to	to	
	Stats 2.6 min	sl26	
Average Statistics Input Value	Stats 1.1 avg	sa11	Value since the totalizer on a given channel last wrapped or reset. Available only on analog channels and only if the relevant totalizer is enabled in the Configuration level.
	to	to	
	Stats 2.6 avg	sa26	
Math Blocks	Math Block 1	m1	Current value of the math result. Enabled math blocks only.
	to	to	
	Math Block 12	m12	

Table 2.2 Analog Sources

2.6 Digital Sources – Table 2.3

Up to three digital signals, identified within the Math Pad as md1, md2 and md3, can be used within each math block. These signals must be assigned to a digital source from Table 2.3 prior to selection within the math pad.

Source Name	Mnemonic	Description
Any internal or external digital signal available in the recorder		See Appendix A in the User Guide (IM/SM1000 or IM/SM2000).
Math Block 1 Failure to Math Block 12 Failure	md1 md2 md3	Active when math block result falls outside the $\pm 10\%$ fault detection level
Logic Equation 1 to Logic Equation 12		Logic equation results.

Table 2.3 Digital Sources

2.7 Functions – Table 2.4

All functions begin with an uppercase character to distinguish them from sources.

Function	Description
Trigonometric Functions: – see Section 2.9.1, page 11	
Sin(x)	The sine of x (x specified in radians, Rad = $\pi/180^\circ$)
Cos(x)	The cosine of x (x specified in radians, Rad = $\pi/180^\circ$)
Tan(x)	The tangent of x (x specified in radians, Rad = $\pi/180^\circ$)
Statistical Functions: – see Section 2.9.2, page 11	
Avg(x, n, t)	The average of variable x, over n samples at a sample rate of t seconds. n=1 to 9999 samples, t=1 to 9999 seconds. The average resets after n samples.
Rav(x, n, t)	The rolling average of variable x, over n samples at a sample rate of t seconds. The oldest sample in each Rav calculation is lost and the new result is calculated by taking into account the current sample. N=1 to 9999 samples, T=1 to 9999 seconds.
Sd(x, n, t)	Standard Deviation of variable x, over n samples at a sample rate of t seconds. N = 1 to 200 samples; t = 1 to 9999 seconds.
Logarithmic Functions: – see Section 2.9.3, page 11	
Log(x)	Log base 10 of x. For Antilog, see $X^a(x, a)$
Ln(x)	Natural log of x
Exp(x)	e to the power x
Special Functions: – see Section 2.9.4, page 11	
RH(x, y)	Relative humidity calculation using wet(x) & dry(y) bulb readings
F0(x, y, z)	Optimization of sterilization times using F0 calculation and measured temperature(x), target temperature(y) and Z factor(z)
Abs(x)	The absolute value of variable x
Switch Functions: – see Section 2.9.6, page 15	
Hs(x, y, z)	Returns the variable with the greatest magnitude
Ms(x, y, z)	Returns the variable whose magnitude is between the upper & lower limits of the three variables
Ls(x, y, z)	Returns the variable with the smallest magnitude
Mux(x, y, s)	Selects x if s is false, otherwise y
Power Functions:	
$X^a(x, a)$	Raises the variable x to the power a
Sqr(x)	Returns the square root of variable x

Table 2.4 Functions

2.8 Creating Math Blocks – Figs. 2.2 and 2.3

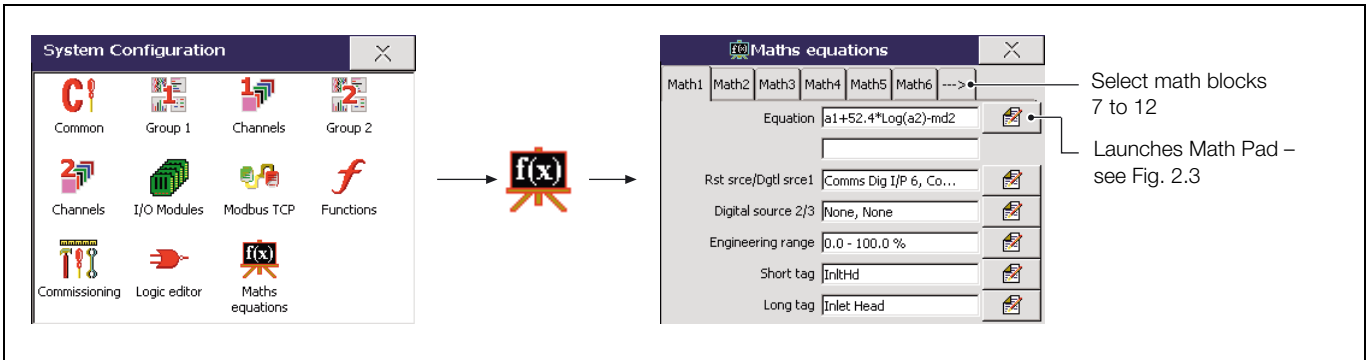


Fig. 2.2 Launching the Math Block Editor (Math Pad)

Note. For further information on accessing the Configuration level, refer to Section 4 of the appropriate User guide (IM/SM1000 or IM/SM2000).


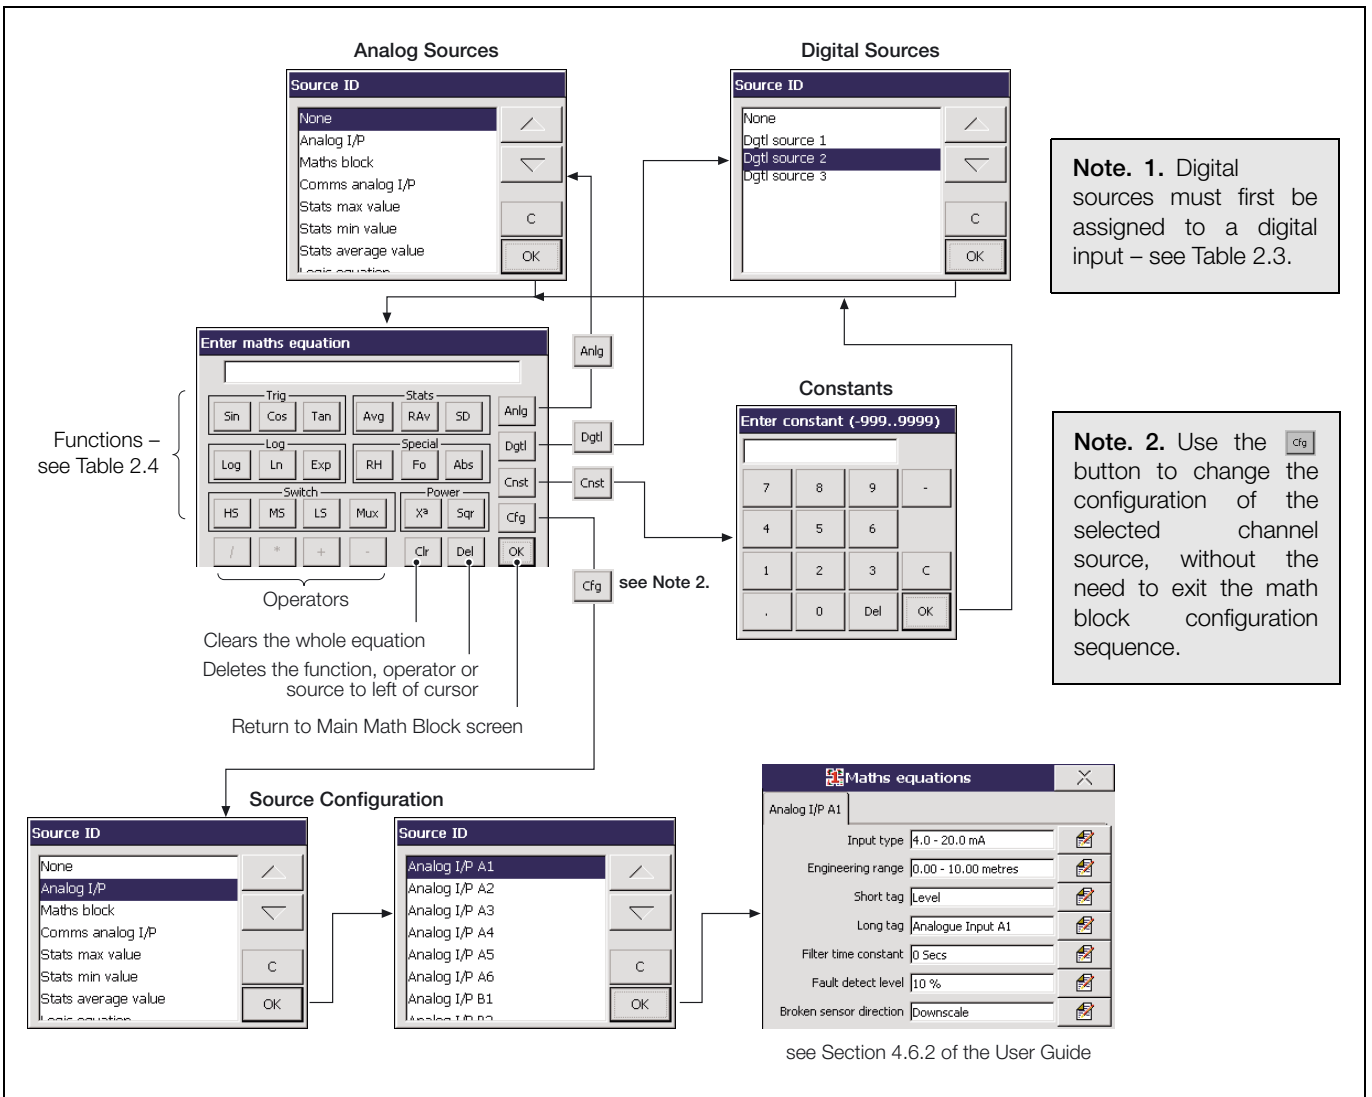




Fig. 2.3 Math Pad



Select the Math Block to configure – M1 to M12.

Set the equation using the math pad – see Fig. 2.4, page 6.

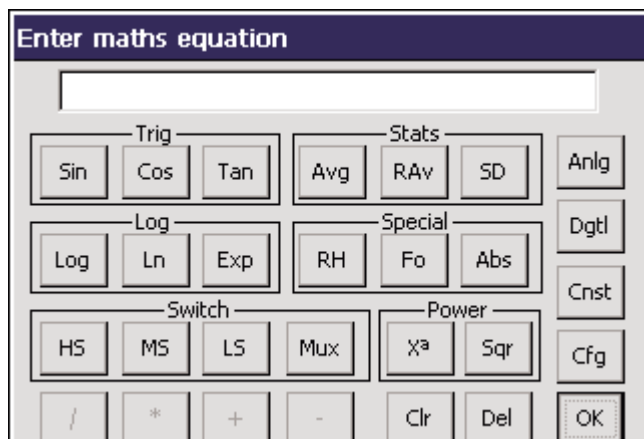Note. Digital sources must first be assigned to a valid digital signal – see below.





Reset Source / Digital Source 1

Set the digital source (e.g. alarm signal, real-time event) used to reset the equation.

Select the digital signal (e.g. alarm signal, real-time event) used as Digital Source 1 (md1) within the math block.

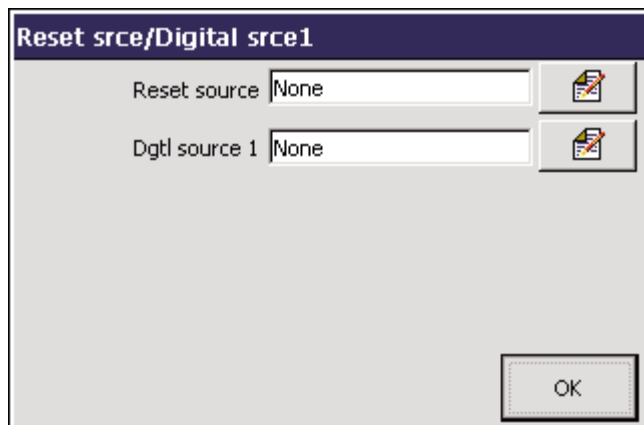Note. When used in a Math Block, an active digital signal has a numerical value of 1 and an inactive digital signal has a value of 0.



Select the digital sources (e.g. alarm signal, real-time event) used as Digital Source 2 and 3 (md2 and md3) within the equation.

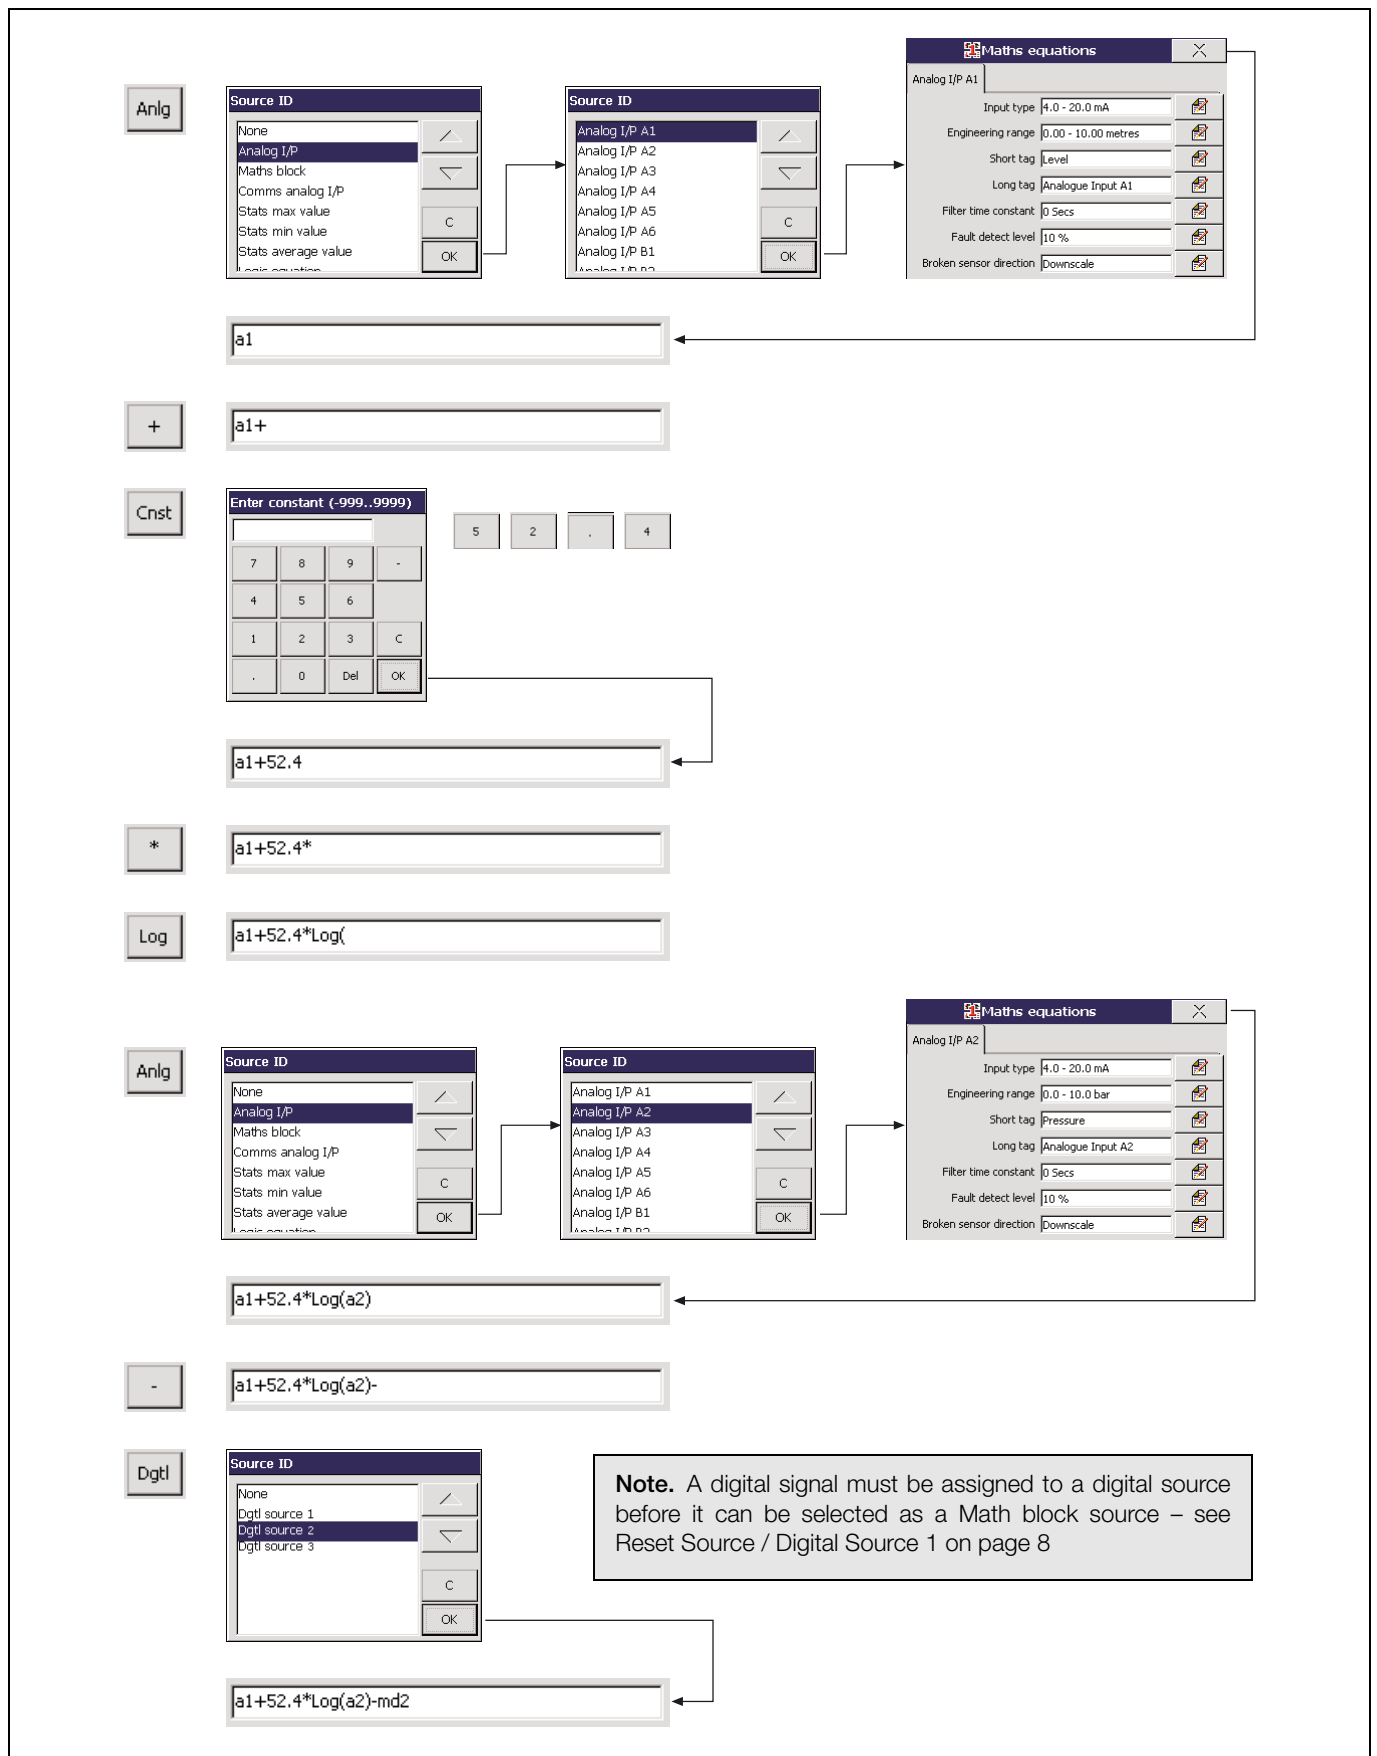






Fig. 2.4 Worked Example

Engineering range 

Engineering range

Low 

High 

Units 

Short tag 

Long tag 

Specify the display range and units of the engineering value corresponding to the electrical high and low values, within the limits defined below:

Example – Maximum and minimum calculated values function.

$a1 + a2$, where $a1 \equiv 0$ to 150 l/s, $a2 \equiv -50$ to 100 l/s, Engineering High = 250.0, Engineering Low = -50.0.

Note. For the best resolution enter engineering ranges to the maximum permissible number of decimal places.

Enter the tag name to be displayed on channel indicators and used to identify the channel in archive files. (8 characters max.).

Note. Tags with a high percentage of capital letters and wide characters such as 'W' or 'M' may appear truncated in some Operator Views. In such cases, use lower case letters or fewer characters.

Enter the tag name to be displayed in the process view and used in the archive files (20 characters max.).

2.9 Standard Functions

The following examples, using preset functions available on the Math Pad, are included for easier reference.

2.9.1 Trigonometric Functions

Three trigonometric functions, Sin(x), Cos(x) and Tan(x) return the Sine, Cosine and tangent of the variable x.

Note. The variable x must be specified in Radians, where $1^\circ = \pi/180$ Radians.

For example, to find the Sine of 90° , first convert degrees to radians:

$$90^\circ = (90 \times \pi) / 180 = \pi/2 \approx 1.571 \text{ Radians}$$

The equation is entered as Sin(1.571)

2.9.2 Statistical Functions – Table 2.5 and Fig. 2.5

Statistical functions can be used to calculate the average, rolling average and standard deviation of an analog variable.

Instantaneous Samples		Avg()Average		RAv()Rolling Average		SD() Standard Deviation
No.	Value	Value	Samples	Value	Samples	
1	40	–	–	–	–	–
2	80	–	–	–	–	–
3	70	–	–	–	–	–
4	50	–	–	–	–	–
5	60	60	1 to 5	60	1 to 5	20.8
6	30			58	2 to 6	18.3
7	40			50	3 to 7	12.9
8	100			56	4 to 8	17.1
9	120			70	5 to 9	12.9
10	110	80	6 to 10	80	6 to 10	31.0

Table 2.5 Sample Statistical Calculations

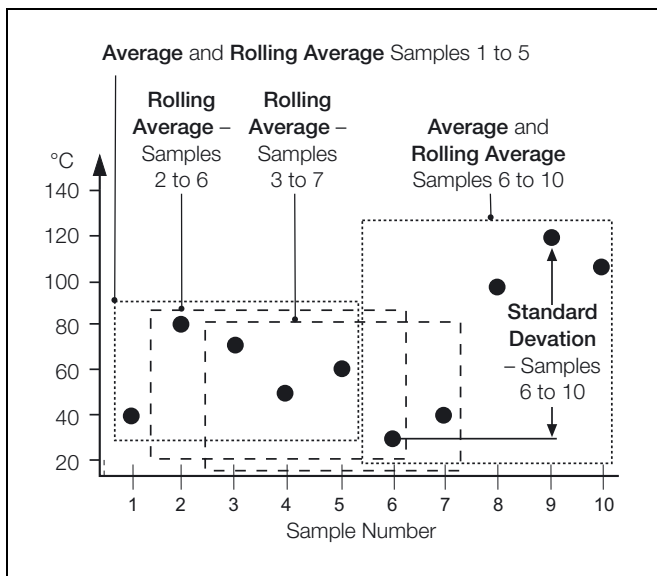


Fig. 2.5 Samples Included

2.9.3 Logarithmic Functions

The logarithmic functions Log(x), Ln(x) and e^x can be used to scale process inputs.

Example – the output of vacuum gauges follow a logarithmic curve and this must be linearized, therefore the antilog of the input must be derived:

$$\text{Linear Vacuum} = k.10(\text{Vacuum Gauge Output})$$

2.9.4 Relative Humidity – Fig. 2.6

Relative humidity is calculated using the following formula:

$$\text{RH} = 100 \times \frac{\text{VPSw} - \text{AP} \times (\text{Td} - \text{Tw})}{\text{VPSd}}$$

Where:

VPSw = Saturation Vapour Pressure at Wet Bulb Temperature

VPSd = Saturation Vapour Pressure at Dry Bulb Temperature

Td = Dry Bulb Temperature

Tc = Wet Bulb Temperature

P = Total Atmospheric Pressure (1000 mbar)

A = Psychometric Constant (6.66×10^{-4})

RH = % of Relative Humidity

A relative humidity calculation requires two inputs, one from a wet bulb sensor and one from a dry bulb sensor. Both of these inputs are incorporated into the equation as analog.

RH tables are based on the use of an aspirated psychrometer having an air velocity of at least 11.5 feet per second or 3.5 meters per second across the bulb sensors.

Inputs used for wet and dry bulb measurement must be in the ranges 0 to 100°C or 32 to 212°F . The result must be set to 0 to 100.0% RH.

System Configuration

Common Group 1 Channels Group 2

Channels I/O Modules Modbus TCP Functions

Commissioning Logic editor Maths equations

Math1 Math2 Math3 Math4 Math5 Math6 -->

Equation

Enter maths equation

Trig: Sin, Cos, Tan, Avg, Stats: RAv, SD, Anlg

Log: Log, Ln, Exp, RH, Fo, Abs, Dgtl

Special: MS, LS, Mux, Xⁿ, Sqr, Crg

Switch: HS, MS, LS, Mux, Xⁿ, Sqr, Crg

Power: Crst, Crg

Select the RH function

RH

RH(

Select the wet bulb source

Anlg

Source ID

- None
- Analog I/P
- Maths block
- Comms analog I/P
- Stats max value
- Stats min value
- Stats average value

Source ID

- Analog I/P A1
- Analog I/P A2
- Analog I/P A3
- Analog I/P A4
- Analog I/P A5
- Analog I/P A6
- Analog I/P B1
- Analog I/P B2

Maths equations

Analog I/P A1

- Input type: 4.0 - 20.0 mA
- Engineering range: 0.00 - 10.00 metres
- Short tag: Level
- Long tag: Analogue Input A1
- Filter time constant: 0 Secs
- Fault detect level: 10 %
- Broken sensor direction: Downscale

RH(a1,

Select the dry bulb source

Anlg

Source ID

- None
- Analog I/P
- Maths block
- Comms analog I/P
- Stats max value
- Stats min value
- Stats average value

Source ID

- Analog I/P A1
- Analog I/P A2
- Analog I/P A3
- Analog I/P A4
- Analog I/P A5
- Analog I/P A6
- Analog I/P B1
- Analog I/P B2

Maths equations

Analog I/P A2

- Input type: 4.0 - 20.0 mA
- Engineering range: 0.0 - 10.0 bar
- Short tag: Pressure
- Long tag: Analogue Input A2
- Filter time constant: 0 Secs
- Fault detect level: 10 %
- Broken sensor direction: Downscale

RH(a1,a2)

OK

Set the engineering range
0 - 100.0% RH

Engineering range: 0.0 - 100.0 %Rh

Engineering range

- Low: 0.0
- High: 100.0
- Units: %Rh

OK

Fig. 2.6 Relative Humidity Calculation

2.9.5 Sterilization Fvalue Calculation – Fig. 2.8

The ability of heat to kill micro-organisms varies with the type of organism and increases exponentially with rising temperature.

Therefore, the time taken in sterilization is reduced if the target temperature is increased and the time spent approaching and receding from the target temperature can be taken into account.

Example – an increase of 10°C from 121.1 to 131.1°C in the steam sterilizing temperature of the *Bacillus stearo-thermophilus* organism increases the death rate by a factor of ten.

The change in sterilization temperature which causes a factor of 10 change in the death rate is unique to each organism and is called the Z value.

Although 121.1°C is universally accepted as a reference for steam sterilization processes, the actual sterilizing temperature varies, depending on the products involved and on each sterilization process.

The Fvalue is calculated using the general formula:

$$F_{val(t)} = F_{val(t-1)} + \frac{(10^{\frac{x-y}{z}})}{60}$$

Where

- F_{val(t)} = Current Fvalue
- F_{val(t-1)} = Fvalue at last sample
- x = Actual temperature
- y = Target temperature
- z = Z-factor (i.e. the temperature interval representing a factor of 10 reduction in killing efficiency)

Example – A typical steam sterilizing cycle – refer to Fig. 2.7 below.

The period AB is the chamber evacuation part of the cycle, when the chamber is alternatively evacuated and purged with steam to remove air. The ramp up to final sterilizing temperature starts at B. The thermal conductivity of the load determines the time taken to achieve point D, but is typically 30% of the total cycle time. It is in the area, C D, and E F, that Fvalues make their contribution to shortening sterilization time, by accumulating credit for the time spent approaching and receding from the sterilizing temperature.

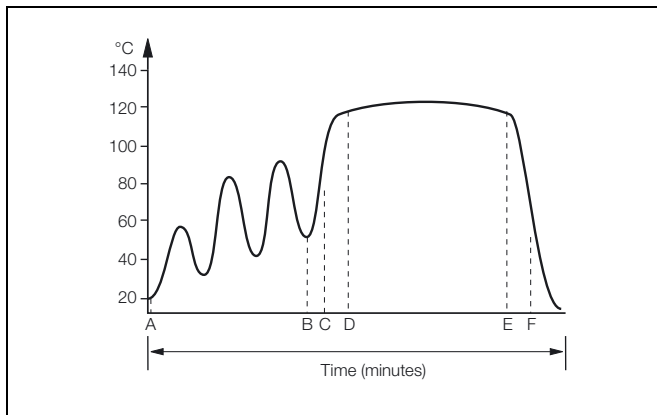


Fig. 2.7 Typical Steam Sterilization Cycle

It is important to note the large change in equivalent sterilizing time which results from a small increase in the sterilizing temperature. Going from 121°C to 122°C, an increase of only 1°C, reduces the time needed to kill an equal number of organisms by a factor of 26%. Likewise, a measurement error which results in the set point being 1°C too low could result in a product not being sterilized properly.

As the Fvalue calculation is essentially a logarithmic function, the effect of measurement errors is significant on the resultant Fvalue.

Table 2.6 shows the resultant error in the Fvalue resulting from various measurement errors with a Z value of 10°C.

Temperature Error (°C)	Fvalue Error (Fo)
0.1	2.3%
-0.1	-2.3%
0.5	12.0%
-0.5	-11.0%
1.0	26.0%

Table 2.6 Fvalue Accuracy

The recorder can measure TC and RTD inputs with an accuracy of better than 0.1%. This results in superior Fvalue calculation accuracy.

To improve the accuracy even further the Scale Adjust facility can be used to adjust the individual channel readings to be correct at the sterilizing temperature.

As Fvalue calculation is an integrating function, the sample rate has a direct effect on the accuracy when the temperature is changing. With a steady state signal the sample rate does not affect accuracy.

The figure illustrates the step-by-step configuration of a math equation for sterilization Fvalue calculation. The process is as follows:

- System Configuration:** The user navigates to the 'Maths equations' option in the 'System Configuration' menu.
- Equation Editor:** The user selects the 'Fo' function from the 'Enter maths equation' dialog.
- Source Selection:** The user selects the 'Anlg' (Analog Input) source for the temperature measurement.
- Source ID Selection:** The user selects 'Analog I/P A1' as the source ID for the temperature measurement.
- Equation Entry:** The user enters the target temperature '121.1' and the Z factor '7.5' into the equation editor, resulting in the equation: $Fo(a1, 121.1, 7.5)$.
- Final Configuration:** The user selects a digital source (Comms Dig I/P 6, Co...) for the 'Rst srce/Dgtl srce1' field.
- Reset Source:** The user selects 'None' for the 'Reset source' field.

Fig. 2.8 Sterilization Fvalue Calculation

2.9.6 Switch Functions – Figs. 2.9 and 2.10

The switch functions, HS (High Select), MS (Median Select) and LS (Low Select) are used to select between the highest, median and lowest of three analog values – see Fig. 2.9.

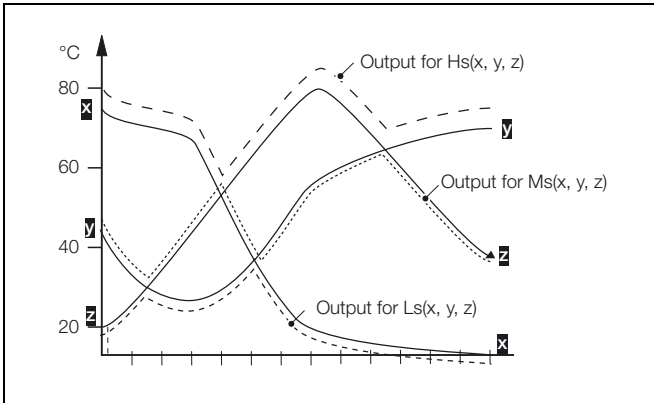


Fig. 2.9 High, Median and Low Select

The switch function Mux (Multiplexer) is used to switch between 2 analog values when a third value becomes true – see Fig. 2.10.

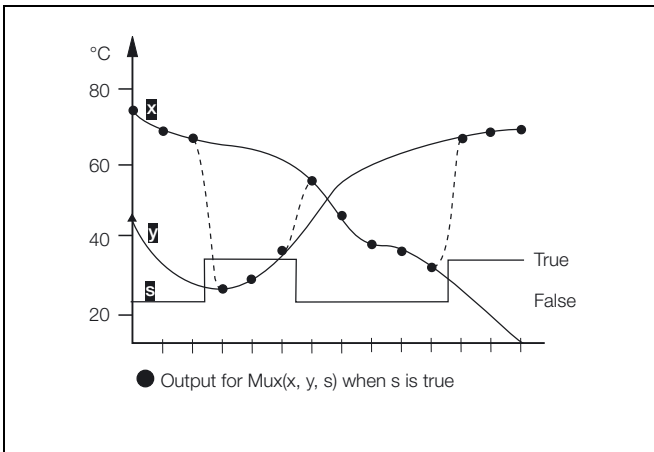


Fig. 2.10 Multiplexer Operation

2.9.7 Absolute Value Function – Fig. 2.11

The Absolute Value Function converts any negative value to its positive equivalent – see Fig. 2.11.

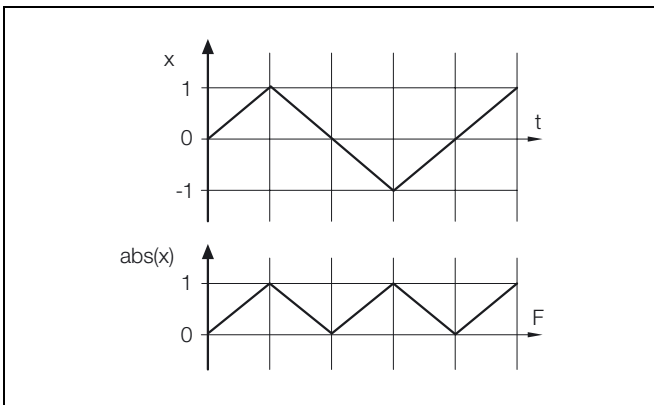


Fig. 2.11 Absolute Value Function

Therefore, if the Absolute Value Function is used to monitor the difference between two flows A and B, where Flow A could be greater than or less than Flow B, the function will always return a positive value, which represents the unsigned magnitude of the difference between the flow rates.

2.10 Application Examples

2.10.1 Liquid Flow – Fig. 2.12

Liquid Flow is measured in two ways:

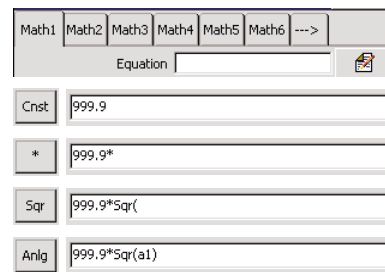
1. Using a linear flow device such as Vortex, Swirl, Ultrasonic, Turbine and Magnetic Flowmeters
2. Using a differential pressure transmitter across an orifice plate or wedge.

Corrections can be applied to compensate for variations in temperature and density – see Fig. 2.12, page 16.

Square Root Extraction and Scaling

Normally, square root extraction and scaling ($Q = K\sqrt{h}$) is achieved in the DP transmitter or using an input linearizer within the recorder.

If this is not possible, a math block can be used as follows:



Temperature Compensation

Assuming linearization and scaling has been achieved on either the DP transmitter or linearizer input, temperature compensation can be calculated as follows:

$$Qc = \frac{Q}{1 + (t_r - t_b)a}$$

This is implemented in the recorder (assuming the linearized flow is on input a1) as follows:

$$Qc = \frac{a1}{t_r - t_b \times a + 1}$$

This requires two math blocks:

$$m2 = t_r - t_b \times a + 1 \text{ and } m3 = a1 / m2 \text{ created as follows:}$$

Math1	Math2	Math3	Math4	Math5	Math6	-->
Gleichung						
Cnst	29.9					
-	29.9-					
Anlg	29.9-a2					
*	29.9-a2					
Cnst	29.9-a2*1.01					
+	29.9-a2*1.01+					
Cnst	29.9-a2*1.01+1					

Reference Temperature, t_r

Actual Temperature, t_b
(Input a2)

Coefficient of Expansion

Math1	Math2	Math3	Math4	Math5	Math6	---
Equation						
Anlg	a1					
/	a1/					
Anlg	a1/m2					

Linearized Volume Flow

Mass Flow Calculation – Average density correction

The average density over a given temperature range is used to calculate the mass flow as follows:

$$Q_m = Q_c \times D_a$$

where Q_c is the temperature compensated flow and D_a (a constant) is the average density.

This is implemented as follows:

$$m_3 = \frac{a_1 \times D_a}{m_2}$$

where a_1 and m_2 are the linearized flow and temperature compensation from the previous example:

Math1	Math2	Math3	Math4	Math5	Math6	---
Equation						
Anlg	a1					
*	a1*					
Cnst	a1*1.99					
/	a1*1.99/					
Anlg	a1*1.99/m2					

Linearized Volume Flow

Average Density Constant

Temperature Compensation

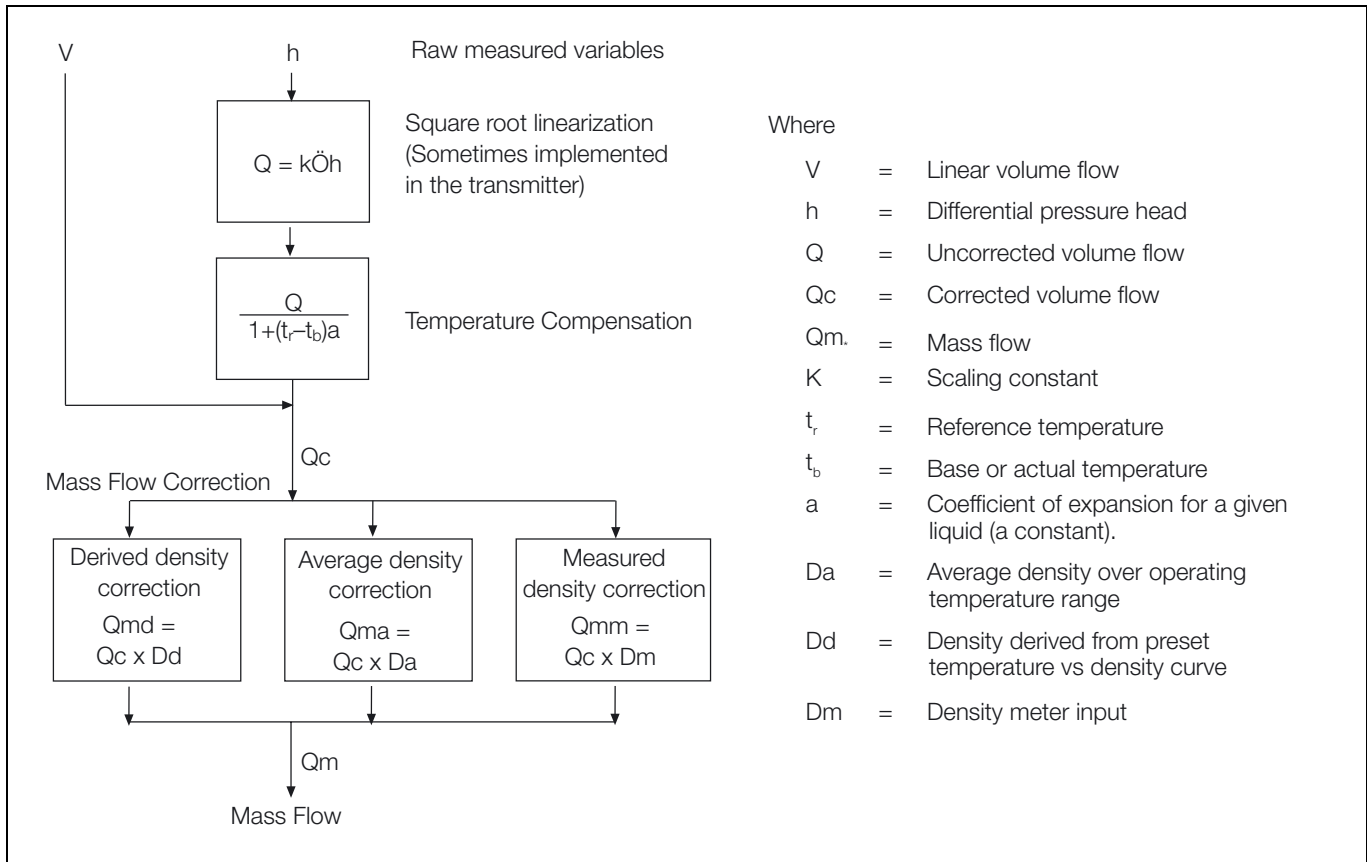


Fig. 2.12 Temperature and Density Compensation

Mass Flow – Derived density correction

This method uses a preset table of temperature and density values to define the correction, which is calculated as follows:

$$Q_{md} = Q_c \times \text{density correction}$$

$$m_3 = \frac{a_1 \times a_3 \times \text{scaling factor}}{m_2}$$

Note. Input a3 is the actual product temperature input (as a2 in previous examples) but with the density correction applied using a custom linearizer – see Section 4.9.1 of the User Guide (IM/SM1000 or IM/SM2000).

Mass Flow – Measured Density Correction

$Q_{mm} = Q_c \times \text{input from density meter.}$

$$m_3 = \frac{a_1 \times a_3 / m_2}{m_2}$$

Where a3 is the input from an external density meter.

Note. With all of the above calculations the engineering range should allow for the extremes of all the input variables.

2.10.2 Ideal Gas Flow

Gas flow is usually measured using a differential pressure device across orifice plates and wedges.

Corrections can be applied to compensate for variations in temperature and pressure – see Fig. 2.13.

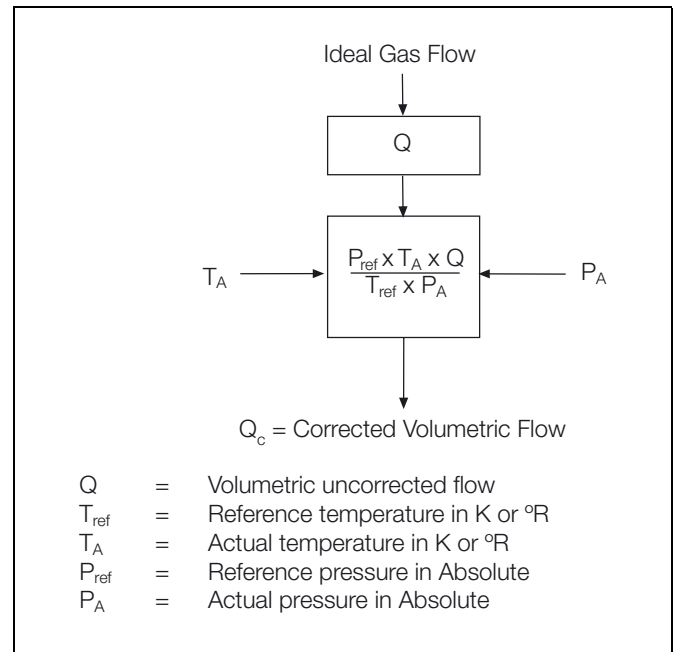


Fig. 2.13 Temperature and Pressure Compensation

Where $Q = K\sqrt{h}$, the square root extraction and scaling can be achieved on the DP device or on the input set up of the recorder.

Let $m_1 = \text{constant } 1 \times a_3$

$Q_c = m_2 = a_1 \times \text{constant2} \times a_2 / m_1$

Note. The engineering range should allow for the extremes of all the input variables.

3 Logic Configuration

3.1 Logic Equation Description

Note.

- 12 logic equations
- Up to 6 operands and 5 operators per equation
- OR/AND/NOR/XOR/NAND/NOT operators – see Table 3.1 overleaf
- Can combine internal and external digital signals – i.e. alarms, digital inputs, other logic equation results and real time events (timer option).

3.2 Worked Example – Reservoir Level Control – Fig. 3.1

Note. This example uses an optional Hybrid I/O Module in position D – see Appendix E in the User Guide (IM/SM1000 or IM/SM2000).

- Channel 1.1 records the reservoir level, with an engineering range 0 to 100 feet.
- Alarms 1.1A, 1.1B and 1.2A monitor the reservoir level.
- Digital output D6 to drive the control valve from Logic Equation 1
- Digital input D1 to operate the manual override.

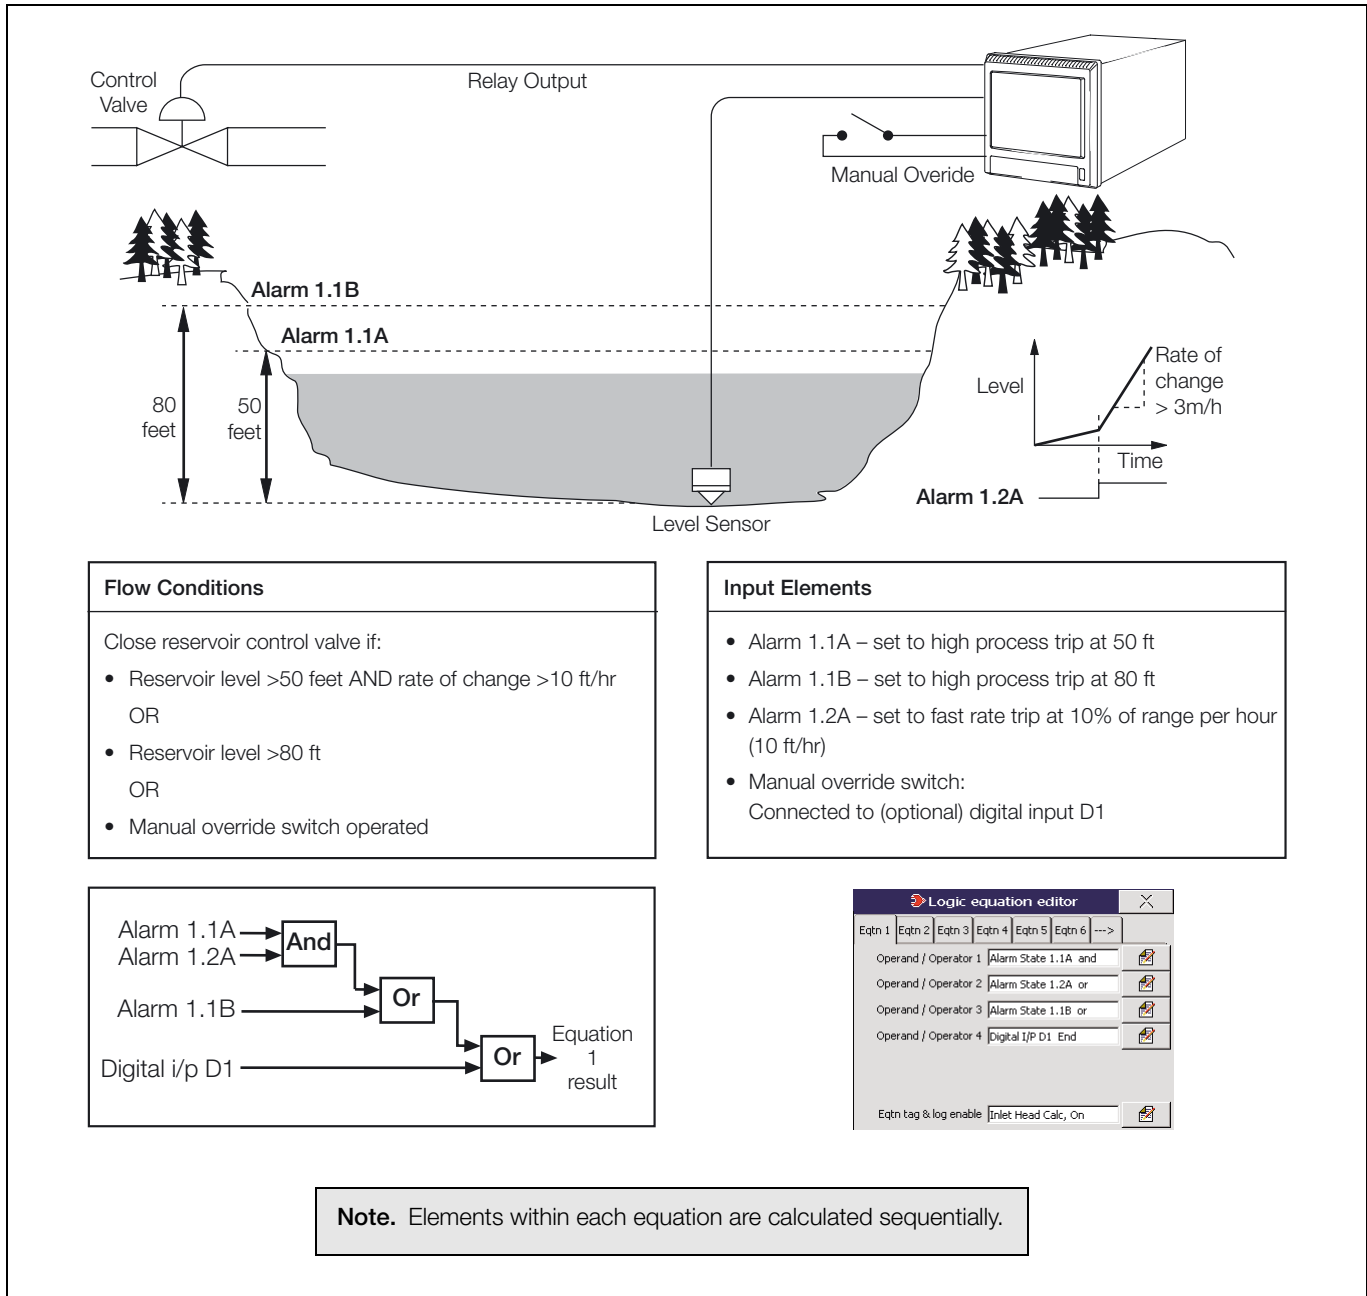


Fig. 3.1 Logic Equation Example

3.3 Creating Logic Equations – Fig. 3.2


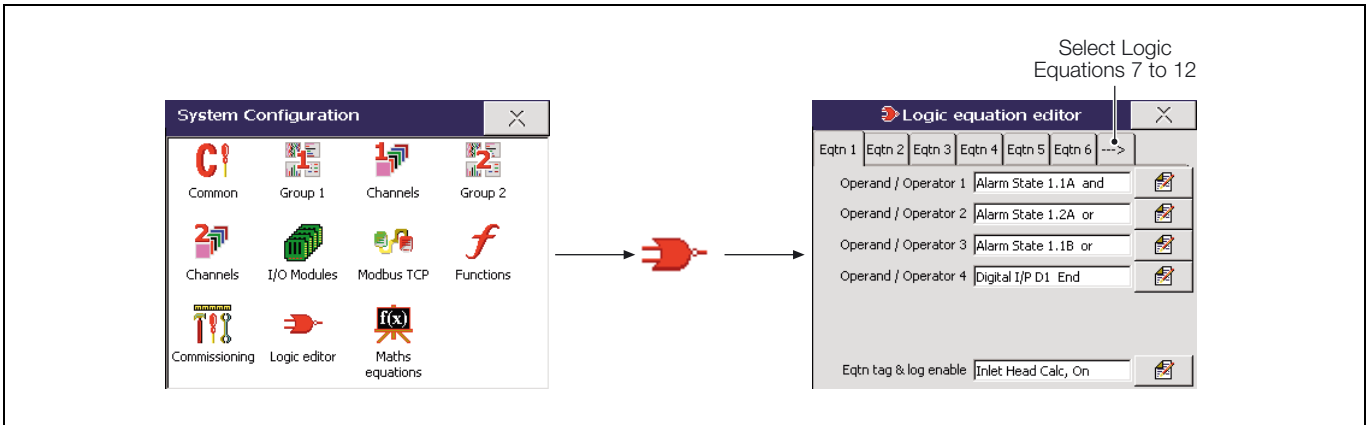



Fig. 3.2 Launching the Equation Editor




Select the logic equation to create or modify



Specify the first operand – can be any digital signal.



Invert the signal, if required.

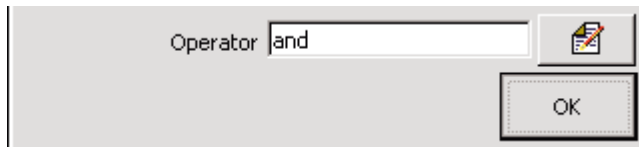

Select an operator for the next input


Inputs	A	0	0	1	1
	B	0	1	0	0
	Operators	Outputs			
All inputs high	AND	0	0	1	1
Any (or All) input(s) low	NAND	1	1	1	0
Any (or All) input(s) high	OR	0	1	1	1
No inputs high	NOR	1	0	0	0
Any, but not All, input(s) high	XOR	0	1	1	0

Table 3.1 Logic Operators

Repeat these steps until the equation is complete.



Set the equation tag (20 characters maximum) displayed in alarm/event logs.



Allow changes in the equation's state to be recorded in the Alarm event log.

4 Diagnostics

4.1 Introduction

Note. Math blocks and logic equations can be tested for correct operation and monitored using the diagnostics facility in the Set Up level. For information on accessing the Set Up level, see Section 3 of the User Guide (IM/SM1000 or IM/SM2000).

Recording Control ▶
Reset archiving
On-line
✓ Off-line
File Viewer ▶
Diagnostics ▶
 Maths ▶
 Logic ▶

MathsBlock 1
MathsBlock 2
MathsBlock 3
MathsBlock 4
MathsBlock 5
MathsBlock 6
MathsBlock 7
MathsBlock 8
MathsBlock 9
MathsBlock 10
MathsBlock 11
MathsBlock 12

Math block equation and result when the key was last pressed

Value when key last pressed.

$a1 \cdot 52.4 \cdot \text{Log}(a2) - md1 = 24.099$

Srce Pos	Mnemonic	Source	Value
1	a1	Analog I/P A1	1.259
2	a2	Analog I/P A2	2.935
3	md1	Comms Dig I/P 1	1.000

Update Exit

Only configured math blocks can be displayed. Others are shown 'greyed out'

Press to display values and result based on most recent calculations.

Fig. 4.1 Math Block Diagnostics

Recording Control ▶
Reset archiving
On-line
✓ Off-line
File Viewer ▶
Diagnostics ▶
 Maths ▶
 Logic ▶

Logic Eqtn 1
Logic Eqtn 2
Logic Eqtn 3
Logic Eqtn 4
Logic Eqtn 5
Logic Eqtn 6
Logic Eqtn 7
Logic Eqtn 8
Logic Eqtn 9
Logic Eqtn 10
Logic Eqtn 11
Logic Eqtn 12

Logic equation and result when the key was last pressed

Value when the key was last pressed.

$D1 \text{ and } D2 \text{ or } D3 \text{ or } D4 = 0$

Srce Pos	Mnemonic	Source	Value
1	D1	Alarm State 1.1A	1
2	D2	Alarm State 1.2A	0
3	D3	Alarm State 1.1B	0
4	D4	Digital I/P D1	0

Update Exit

Only configured logic equations can be displayed. Others are shown 'greyed out'

Press to display values and result based on most recent calculations.

Fig. 4.2 Logic Equation Diagnostics

PRODUCTS & CUSTOMER SUPPORT

Products

Automation Systems

- for the following industries:
 - Chemical & Pharmaceutical
 - Food & Beverage
 - Manufacturing
 - Metals and Minerals
 - Oil, Gas & Petrochemical
 - Pulp and Paper

Drives and Motors

- AC and DC Drives, AC and DC Machines, AC Motors to 1kV
- Drive Systems
- Force Measurement
- Servo Drives

Controllers & Recorders

- Single and Multi-loop Controllers
- Circular Chart and Strip Chart Recorders
- Paperless Recorders
- Process Indicators

Flexible Automation

- Industrial Robots and Robot Systems

Flow Measurement

- Electromagnetic Flowmeters
- Mass Flowmeters
- Turbine Flowmeters
- Wedge Flow Elements

Marine Systems & Turbochargers

- Electrical Systems
- Marine Equipment
- Offshore Retrofit and Refurbishment

Process Analytics

- Process Gas Analysis
- Systems Integration

Transmitters

- Pressure
- Temperature
- Level
- Interface Modules

Valves, Actuators and Positioners

- Control Valves
- Actuators
- Positioners

Water, Gas & Industrial Analytics Instrumentation

- pH, Conductivity and Dissolved Oxygen Transmitters and Sensors
- Ammonia, Nitrate, Phosphate, Silica, Sodium, Chloride, Fluoride, Dissolved Oxygen and Hydrazine Analyzers
- Zirconia Oxygen Analyzers, Katharometers, Hydrogen Purity and Purge-gas Monitors, Thermal Conductivity

Customer Support

We provide a comprehensive after sales service via a Worldwide Service Organization. Contact one of the following offices for details on your nearest Service and Repair Centre.

United Kingdom

ABB Limited
Tel: +44 (0)1480 475321
Fax: +44 (0)1480 217948

United States of America

ABB Inc.
Tel: +1 215 674 6000
Fax: +1 215 674 7183

Client Warranty

Prior to installation, the equipment referred to in this manual must be stored in a clean, dry environment, in accordance with the Company's published specification.

Periodic checks must be made on the equipment's condition. In the event of a failure under warranty, the following documentation must be provided as substantiation:

1. A listing evidencing process operation and alarm logs at time of failure.
2. Copies of all storage, installation, operating and maintenance records relating to the alleged faulty unit.

ABB has Sales & Customer Support expertise
in over 100 countries worldwide

www.abb.com

The Company's policy is one of continuous product
improvement and the right is reserved to modify the
information contained herein without notice.

Printed in UK (01.09)

© ABB 2009



ABB Limited
Howard Road, St. Neots
Cambridgeshire
PE19 8EU
UK
Tel: +44 (0)1480 475321
Fax: +44 (0)1480 217948

ABB Inc.
125 E. County Line Road
Warminster
PA 18974
USA
Tel: +1 215 674 6000
Fax: +1 215 674 7183