


NOTES:


- Prior to any installation in a classified hazardous location, verify installation methods by the Control Drawing referenced on the product's name tag.
- To access termination board, remove Power I/O Junction Box front cover.

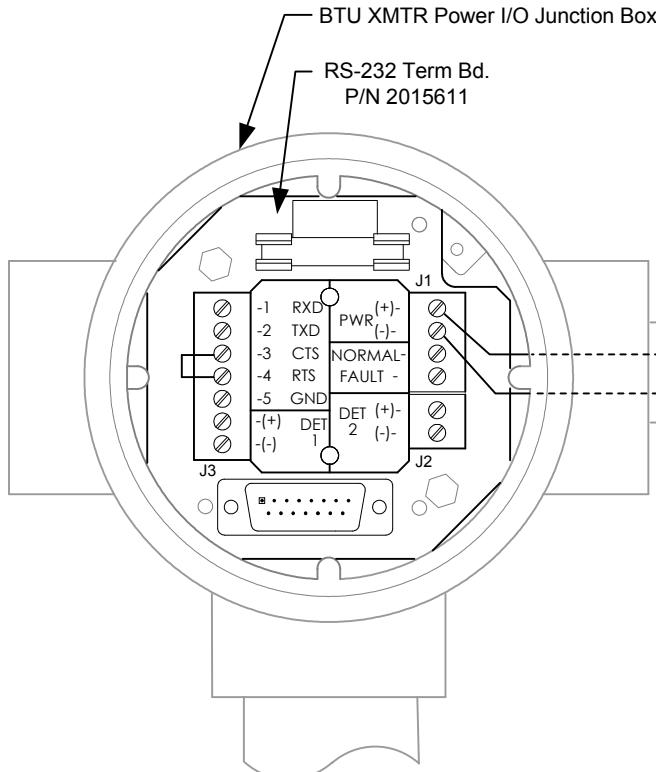

Hazardous Area

Non-Hazardous Area

Power Supply  
IPS, Inc.  
P/N 2015440-007

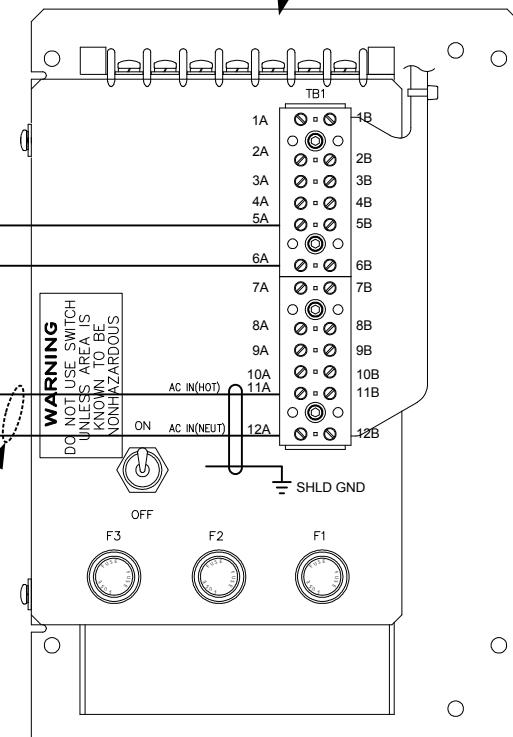

SEE NOTE 3

- Wire size is a function of the distance between the BTU XMTR and the DC Power Supply. Using 2.5 Amps as the maximum current draw, calculate an adequate wire size so that the voltage measured at the BTU XMTR's Power I/O Junction Box is a minimum of 12.5 Volts.

REF: N/A



TOTALFLOW  
Products

ACTION  
L17580

DOC TYPE  
UD

TITLE  
BTU 8000\8100 TO IPS 240V AC POWER SUPPLY

DWG NO.  
2102276

REV  
AA

SHEET  
1 OF 1