


Pressure Transmitters

Model 267C

Model 269C

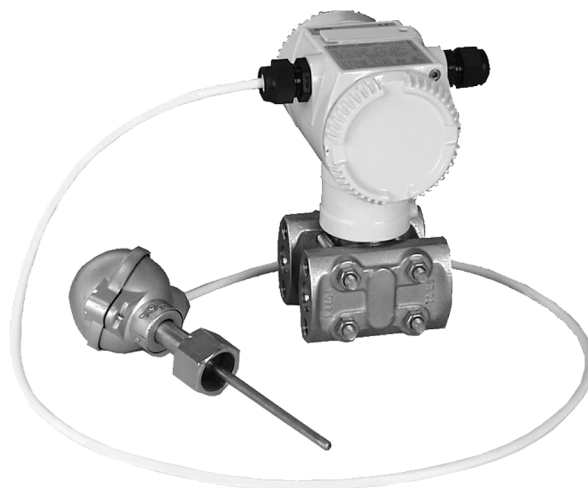

# Contents

	Page
<b>1 Safety</b> .....	2
General safety precautions and health protection .....	2
Correct usage .....	2
<b>2 Transport and Storage</b> .....	3
<b>3 General Description</b> .....	3
Principle of operation and construction .....	3
<b>4 Mass Flow Measurement</b> .....	3
Functional Specifications .....	3
<b>5 Mounting</b> .....	5
General .....	5
Transmitter .....	5
Pressure / differential pressure measurement .....	5
Temperature measurement .....	5
Measurement piping .....	5
<b>6 Electrical Connection</b> .....	5
Electrical connection in the cable connection compartment .....	6
Electrical connection with plug .....	6
Mounting of the socket connector .....	6
Protective conductor / grounding .....	6
Set-up of the signal circuit / communication circuit of transmitters with 4...20 mA output signal .....	7
Notes on connecting cable .....	7
Notes on PROFIBUS-PA transmitters .....	7
Notes on explosion protection .....	7
<b>7 Commissioning</b> .....	8
Notes on transmitters with 4...20mA output signal .....	8
Write protection .....	8
Oblique sensor / zero correction .....	8
Rotate housing with regard to the sensor .....	8
Assembly / disassembly of push button unit .....	9
Assembly / disassembly of LCD indicator .....	9
Secure enclosure cover for EEx d .....	9
<b>8 Operation</b> .....	9
Operation with SMART VISION® .....	9
Operation with "local keys" with LCD indicator .....	10
Measured value display .....	10
Program control .....	12
Operation with PC / laptop .....	13
Configuration of flow measurement with SMART VISION® .....	13
<b>9 Maintenance</b> .....	15
Dismantling / fitting the process flanges .....	15
<b>10 Repairs</b> .....	16
Return .....	16
<b>11 Technical Data</b> .....	16
<b>12 Certificates and approvals</b> .....	21
<b>13 Dimensional Drawings</b> .....	27
<b>14 Mounting Options</b> .....	29
<b>15 EC Declaration of Conformity</b> .....	30

# 1 Safety

## General safety precautions and health protection

To ensure safe operation of the 267/269C Transmitter, the following instructions have to be observed:

### Please read these instructions / operating manual carefully prior to assembly and commissioning!

For reasons of clarity, the instructions do not contain all details on all types of product and do therefore not take into account every conceivable case of assembly, operation or maintenance. If you want further information or if special problems arise which are not treated in detail in the instructions, please ask the manufacturer for the necessary information.

Moreover we would like to point out that the content of these instructions is neither part of nor provided for changing a previous or existing agreement, promise or legal relationship.

All obligations of ABB Automation Products GmbH result from the respective sales contract which also comprises the complete and solely valid warranty clauses. Such contractual warranty clauses will neither be limited nor extended by the content of these instructions.

### Observe warning signs at packaging, etc.!

### For assembly, electrical connection, commissioning and maintenance of the transmitter, only qualified and authorized specialists are to be employed.

Qualified specialists are persons who are experienced in the assembly, electrical connection, commissioning and operation of the transmitter or similar devices holding the necessary qualifications for their job, e.g.:

- Training or instruction and / or authorization to operate and maintain devices / systems according to the safety engineering standard for electric circuits, high pressures and aggressive media.
- Training or instruction according to the safety engineering standard regarding maintenance and use of adequate safety systems.



For the sake of your own safety, we draw your attention to the fact that for the electrical connection, only sufficiently isolated tools acc. to DIN EN 60 900 may be used.

- Furthermore, the pertinent safety regulations concerning the construction and operation of electrical installations, e.g. the rule regarding technical working material §3 (safety rule for instruments), have to be observed.
- The pertinent standards, e.g. DIN 31 000 / VDE 1000.
- The regulations and recommendations relating to explosion protection if explosion-proof transmitters are to be installed.
- The device can be operated with high pressure and aggressive media.



Serious injury and / or considerable material damage can therefore be caused when this device is handled incorrectly.

- The regulations, standards, recommendations and rules mentioned in these instructions are valid in Germany. When using the transmitter in other countries, the pertinent national rule-shave to be observed.

### Correct usage

The 267/269C Transmitter measures accurately and simultaneously the differential pressure (effective pressure), the static pressure and, with a PT 100 in four-wire technique, the process temperature of aggressive and non-aggressive gases, vapors and liquids. The measuring ranges are graduated from 10 mbar to 20 bar, each for the safe working pressure stages 6 bar (only sensor code A), 20 bar, 100 bar and 410 bar. The transmitter can be overloaded on one side up to the relevant no-minal pressure.

## 2 Transport and Storage

After unpacking the transmitter, check the device for transport damage. Check the packing material for accessories. During the intermediate storage / transport, store and transport the transmitter in the original packaging only. See section 11 "Technical Data" for permissible ambient conditions regarding storage and transport. The storage time is indefinite, however, the warranty conditions stipulated in the order confirmation of the supplier are valid.

## 3 General Description

The digital 267/269C Transmitter is a communicating field device with microprocessor-controlled electronic in multi-sensor technology for multivariable applications.

For bi-directional communication, an FSK signal according to the HART® Protocol is overlaid to transmitters with 4 ... 20 mA output signal whereas, in case of fully digital transmitters, communication is effected via the fieldbus protocols PROFIBUS-PA or FOUNDATION Fieldbus, depending on the model.

The communication software SMART VISION® in touch with the graphical user interface (DTM) allows PC-based configuration, scanning and testing of transmitters according to the respective protocol.

For "local" operation, a control unit is optionally available which can also be retrofitted. The control unit consists of two keys for the adjustment of zero and span and a write protect key (except for devices with FOUNDATION Fieldbus Protocol). In conjunction with an installed LCD indicator, a complete external configuration and parameter setting of the transmitter is possible via the "local control unit", irrespective of the selected communication protocol.

As standard, the amplifier housing has a coat of varnish resistant to aggressive atmosphere; the process connection is made of stainless steel or Hastelloy C. The housing cover and the push button unit can be sealed.

The relevant transmitter data, such as transmitter type, communication, wetted parts material (flange, gasket, diaphragm), fill fluid, measuring range, min. span, operating voltage, output signal, adjusted span and serial number (S/N-No. + year) are to be found on the type plate. **In case of inquiries, please always indicate this number which is valid worldwide!**

For explosion-proof transmitters, the explosion protection type is described on a separate plate.

Another separate plate in front of the "local" control unit shows the functions of the three control elements by means of readily comprehensible symbols. Additionally, a tie-on plate indicating the measuring point identification may be attached (optional).

### Principle of operation and construction

The transmitter has a modular design and consists of the differential pressure sensor module with an integrated electronic matching unit and an amplifier with control unit as well as an input for a PT 100 resistance thermometer in four-wire technique for process temperature.

The completely welded sensor body is a twin-chamber system with an integral overload diaphragm, an internal silicon absolute pressure sensor and a silicon differential pressure sensor. The absolute pressure sensor, which is only exposed to the pressure at the high pressure side (⊕), acts as a reference value to compensate for the static pressure. The differential pressure sensor is connected via a capillary tube to the negative side / reference vacuum of the sensor body. The applied differential pressure (dp) is transferred via the separating diaphragm and the fill fluid to the measuring diaphragm of the silicon differential pressure sensor.

A minimal deflection of the silicon diaphragm changes the output voltage of the pick-up system. This pressure-proportional output voltage is digitized by the electronic matching unit and fed to the electronic. The electronic linearizes and temperature compensates this signal before it is converted, together with the state variables dp, p and T, into a compensated electric signal proportional to mass flow. Apart from the mass flow (qm), the process variables dp, p, T and qv are also available for further processing.

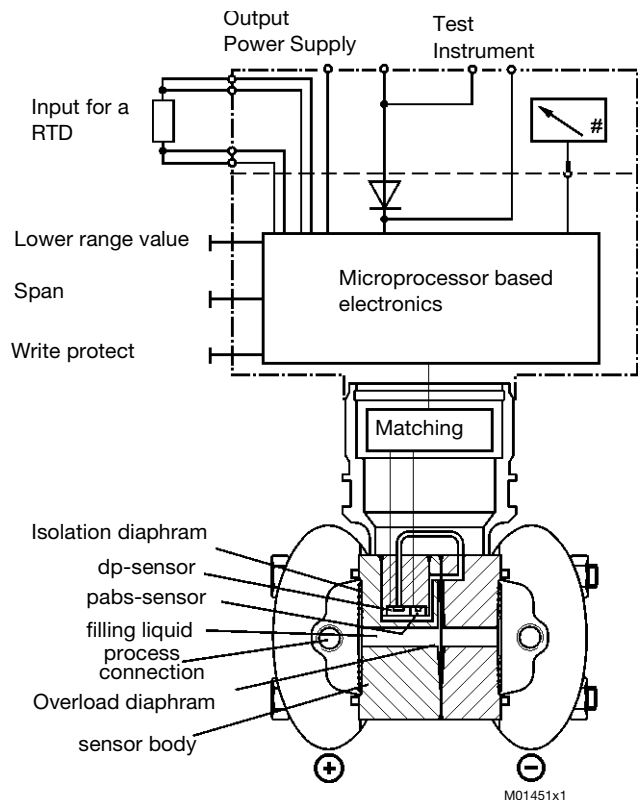


Figure 1. Transmitter 267/269C

Depending on the model, the transmitter is connected to the process by means of oval flanges with fastening threads according to DIN 19213 (M10 / M12) or 7/16-20 UNF, 1/4-18 NPT female thread or remote seal.

The transmitter operates with a 2-wire system. The same wires are used for the operating voltage (depending on the transmitter, see section 11 "Technical Data") and the output signal (4...20 mA or digital). The electrical connection is made via cable entry or plug.

In case of HART® devices, the output signal 4...20 mA can be measured at the "TEST" sockets without interrupting the signal circuit (not applicable in case of fieldbus devices!).

A fixing possibility is provided for a stainless steel tie-on plate indicating the measuring point identification.

Lower range value and upper range value can be set by means of "local" keys (optional, can be retrofitted) and, if required, the keys can be interlocked with the write protect switch (except for devices with FOUNDATION Fieldbus Protocol).

The transmitter may be equipped with an LCD indicator which can be read from the front (optional, can be retrofitted).

In conjunction with the LCD indicator, an external parameter setting and configuration of the most important transmitter functions / data is possible via the "local" control unit (see section 7 "Operation").

## 4 Mass Flow Measurement

### Functional Specifications

The 267/269C allows due to its multisensor technology the measurement of three separate process variables simultaneously and provides the ability of dynamic calculation of fully compensated mass or volume flowrate for gases, steam and liquids.

It measures differential pressure and absolute pressure from a single sensor and process temperature from a standard 100 Ohm Resistance Temperature Detector (RTD).

The flow calculation of 267/269C includes compensation of pressure and/or temperature as well as more complex variables such as discharge coefficient, thermal expansion, Reynold's number and compressibility factor.

The 267/269C includes flow equations for superheated steam, saturated steam, gases and liquids so that one model is all you need in your plant. The enhanced compensation approach of 267/269C provides a much better accuracy than the "old approach" where three different transmitters, differential pressure, absolute pressure and temperature, report their values to a DCS, PLC or flow computer and where the calculation considers changes in temperature and pressure according to:

$$Q_m \approx \sqrt{dp \frac{D}{T}}$$

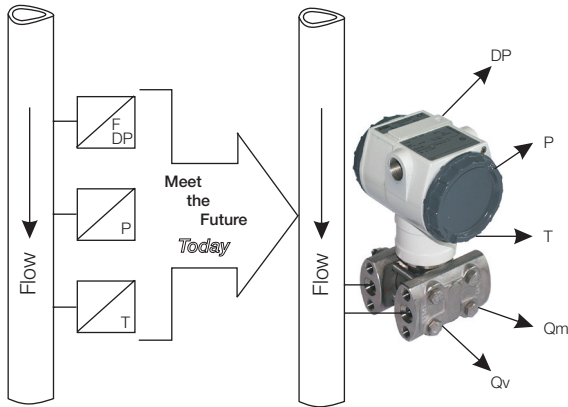


Figure 2.

The dynamic mass flow compensation of 267/269C is based on AGA 3 and EN ISO 5167:

$$Q_m \approx C \cdot E_v \cdot Y_1 \cdot d^2 \sqrt{dp \cdot \rho}$$

- $Q_m$  = mass flowrate
- $C$  = discharge coefficient
- $E_v$  = velocity of approach factor
- $Y_1$  = gas expansion factor
- $d$  = bore diameter
- $dp$  = differential pressure
- $\rho$  = fluid density

#### Discharge coefficient

It is defined as the true flowrate divided by the theoretical flowrate and corrects the theoretical equation for the influence of velocity profile (Reynolds number), the assumption of no energy loss between taps, and pressure tap location. It is dependent on the primary flow element, the  $\beta$  ratio and the Reynolds number. Reynolds number is in turn dependent on the viscosity, density and velocity of the fluid as well as the pipe diameter per the following equation:

$$Re = \frac{v \cdot D \cdot \rho}{\nu}$$

- $v$  = velocity
- $D$  = inside pipe diameter
- $\rho$  = fluid density
- $\nu$  = fluid viscosity

Dynamical compensation for discharge coefficient provides high accuracy for orifice, Venturi and nozzles.

#### Gas expansion factor

It corrects for density differences between pressure taps due to expansion of compressible fluids. It does not apply for liquids which are essentially non-compressible.

The gas expansion factor is dependent on the Beta ratio, the Isentropic exponent, the differential pressure and the static pressure of the fluid per the following equation.

For orifices:

$$Y_1 = 1 - (0,41 + 0,35 \cdot \beta^4) \frac{dp}{p \cdot \kappa}$$

For nozzles:

$$Y_1 = \left[ \left( \frac{\kappa \left( \frac{dp}{p} \right)^\kappa}{\kappa - 1} \right)^{\frac{2}{\kappa - 1}} \left( \frac{1 - \beta^4}{1 - \beta^4 \left( \frac{dp}{p} \right)^\kappa} \right)^{\frac{2}{\kappa - 1}} \right]^{\frac{\kappa - 1}{2}}$$

- $\beta$  = beta ratio
- $dp$  = differential pressure
- $p$  = static pressure
- $\kappa$  = Isentropic exponent

#### Velocity of approach factor

Is dependent on the Beta ratio as defined by the following equation:

$$E_v = \frac{1}{\sqrt{1 - \beta^4}}$$

In turn, Beta ratio is dependent on bore diameter and pipe diameter which are functions on temperature. The material of process pipe and primary flow element expands or contracts with changes in temperature of the fluid being measured. The thermal expansion coefficients are dependent on the material of pipe and flow element and are used for calculating the change in diameters. This ensures high flowrate accuracy at low and high temperature applications.

#### Density of fluids

It directly effects the flowrate calculation. The 267/269C compensates for density of fluids for changes in temperature and/or pressure as follows:

- Gases as a function of P and T per the gas law equations.
- Heated steam as function of P and T based on steam tables
- Saturated steam as function of P based on steam tables
- Liquids as a function of T

Mass flow calculation with 267/269C will be configured for the following primary elements:

- Orifice Corner Taps, ISO
  - Orifice Flange Taps, ISO
  - Orifice D- and D/2-Taps, ISO
  - Orifice Corner Taps, ASME
  - Orifice Flange Taps, ASME
  - Orifice D- and D/2-Taps, ASME
  - Orifice Flange Taps, AGA3
  - Orifice 2,5D- and 8D-Taps
  - Small bore orifice, flange taps
  - Small bore orifice, corner taps
  - Nozzle ISA 1932
  - Nozzle, Long Radius Wall Tap, ISO
  - Nozzle, Long Radius Wall Tap, ASME
  - Venturi, Rough Cast Inlet, ISO
  - Venturi, Machined Inlet, ISO
  - Venturi, Welded Inlet, ISO
  - Venturi, Rough Cast Inlet, ASME
  - Venturi, Machined Inlet, ASME
  - Venturi, Welded Inlet, ASME
  - Venturi, Nozzle, ISO
  - Area Averaging Meter
  - Pitot tube, ISO 3966
  - V-Cone
  - Wedge Element
  - Integral Orifice Assembly
  - Density Correction (unknown Primary Element)
- Configuration of full functionality of 267/269C including all data necessary or mass flow compensation will be done via the PC based graphical user interface „DTM MV2600“.

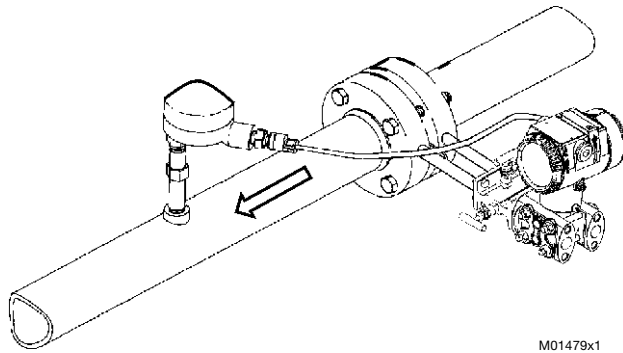


Figure 3. Mounting example - 267/269C with "Barrel housing"

## 5 Mounting

### General

Before mounting the transmitter, check whether the model meets the measurement and safety requirements of the measuring point, e.g., with regard to materials, pressure rating, temperature, explosion protection and operating voltage. The relevant recommendations, regulations, standards and the rules for prevention of accidents must also be observed! (e.g. VDE / VDI 3512, DIN 19210, VBG, Elex V, etc.)

Measurement accuracy is largely dependent upon correct installation of the transmitter and the related measurement piping. The measuring set-up should be screened as much as possible from critical ambient conditions such as major temperature variations, vibration and shock. If unfavorable ambient conditions cannot be avoided owing to reasons related to building structure, measuring requirements or other reasons, this may influence the measurement quality! (see section 11 "Technical Data").

If remote seals with capillary tubes are attached to the transmitter, see also the Instructions 42/15-813 EN.

### Transmitter

The transmitter can be flanged directly to the shut-off armature. There is also a mounting bracket for wall or pipe mounting (2" pipe) available as an accessory.

The transmitter has to be mounted in such a way that the process flange axes are vertical (horizontal in case of barrel-type amplifier housing) in order to avoid zero shifts. If the transmitter were installed inclined, the hydrostatic pressure of the filling fluid would exert pressure on the measuring diaphragm and thus cause a zero shift! A zero point correction would then be necessary.

Various versions are available for connecting the measurement piping. Unconnected process connections on the sensor must be sealed with the enclosed screw plugs (1/4-18 NPT). For this purpose, use your officially approved sealing material. Please refer to section 12 "Dimensional Diagrams" for possible mounting with bracket.

### Pressure / differential pressure measurement

(please also refer to VDE/VDI 3512 parts 1 and 3)

- For a liquid medium, as far as possible, the transmitter has to be attached below, but at least on the same height so that possibly arising gas can get back into the process.
- For a vapor medium, the transmitter has to be mounted below the sampling studs so that the measurement piping remains filled with condensate. Balancing vessels are not absolutely necessary, but vapor must not get into the measuring chambers of the sensor. Pay attention to equal liquid columns in both effective pressure lines above the transmitter.
- For small spans and vapor measuring medium, condensate vessels possibly have to be used.
- In case of using condensate vessels (vapor measurement), the equal height of the vessels in the effective pressure lines has to be observed.
- The transmitter can be connected directly onto the shut-off armature. There is also a mounting bracket for wall or pipe mounting (2" pipe) available as an accessory. The transmitter has to be mounted in such a way that the caps are vertical so as to avoid

zero shifts. If the transmitter were installed inclined, the hydrostatic pressure of the filling fluid would exert pressure on the measuring diaphragm and thus cause a zero shift! A zero point correction would then be necessary.

### Temperature measurement

(please also refer to VDE/VDI 3511)

- Resonance vibrations, e.g., by changing the immersion depth, have to be avoided.
- In case of a large temperature difference between measuring medium and ambience, the measurement error due to heat conduction has to be minimized by a suitable isolation of the mounting place.
- In pipelines with large diameter, important temperature differences arise which are kept in strands even over long distances. These temperature layers have to be prevented by sufficiently long mixing sections / whirl installations.
- Sensors of class "A" have to be used in order to achieve the maximum accuracy.
- The lengths of the protective tubes should be 15...20 times the protective tube diameters for gas measurements and / or 3...5 times for liquid measurements.
- Resistance thermometers are described in the Data Sheets: 10/10-3.22 to 10/10-3.24

### Measurement piping

- The following points must be observed for correct installation:
- Keep the measurement piping as short as possible and avoid sharp bends.
- Lay the measurement piping so that no deposits can accumulate. Gradients should not be less than 8 %.
- Measurement piping should be blown through with compressed air or, better still, flushed through with the measuring medium before connecting to the measuring element.
- If the medium is a liquid / vapor, the filling liquid must be at the same level in both pipes. If using separating liquids, both pipes must be filled to the same height.
- Keep both pipes at the same temperature whenever possible.
- Completely bleed measurement piping if the medium is a liquid.
- Lay the measurement piping so that gas bubbles, when measuring liquids, or condensate when measuring gases, can flow back into the process piping.
- Ensure that the measurement piping is correctly connected + HP and - LP side on sensor, seals,...).
- Ensure that there are no leaks in the piping.
- Lay the measurement piping so that blowouts do not occur via the sensor.

## 6 Electrical Connection

**The relevant guidelines must be observed during the electrical installation!**

**Since the transmitter has no switch-off elements, overcurrent protection devices or mains disconnection possibilities must be provided on the system side (overvoltage protection at option).**

Check that the existing operating voltage corresponds to that indicated on the type plate.

For power supply and output signal, the same lines are used. **Consult the enclosed connection diagram!** Depending on the supplied model, the electrical connection is made via cable entry 1/2-14 NPT or M 20 x 1.5 or via plug Han 8 U / plug M12. The screw terminals are suitable for wire cross-sections up to 2.5 mm<sup>2</sup>.

**Caution:** For transmitters of category 3 regarding the application in "Zone 2" the cable gland has to be provided by the customer. For this purpose there is a thread of size M 20 x 1.5 in the electronic housing. The cable gland must comply with the protection type "Increased Safety EEx e" according to the directions 94/9/EC (ATEX). Furthermore, the conditions stated in the type test certificate of the cable gland have to be observed!

**Note:**

1. (Applies to transmitters acc. to Canadian Standard (CSA) explosion proof „Electrical connection with cable conduit“) To ensure the Type 4X and IP 67 degree of protection the conduit must be screwed into the housing 1/2“ NPT female using a suitable sealing compound. The blanking plug has been sealed with Molykote DX, the use of any other sealing compound is done so at owners own risk.

2. If the type of protection "Flameproof enclosure" (EEx d) applies to the transmitter, lock the enclosure cover by means of the attachment screw (Fig. 10).

Here we would like to point out that an increased expenditure of force will be necessary to remove the enclosure cover after several weeks. This effect is not caused by the thread, but just by the kind of sealing.

**Attention:** Attention: For the purpose of simulation a 178 Ohm resistance (206°C / 403°F) incl. 2 wire straps have been assembled between the terminals 11 to 14. This (incl. wire straps at 4 wire connection) must be removed before connecting the PT 100.

Measurement of saturated steam (no PT 100 necessary): The factory build in resistor has not to be removed, unless for temperature information purposes only, a PT 100 may be connected.

**Electrical connection in the cable connection compartment**

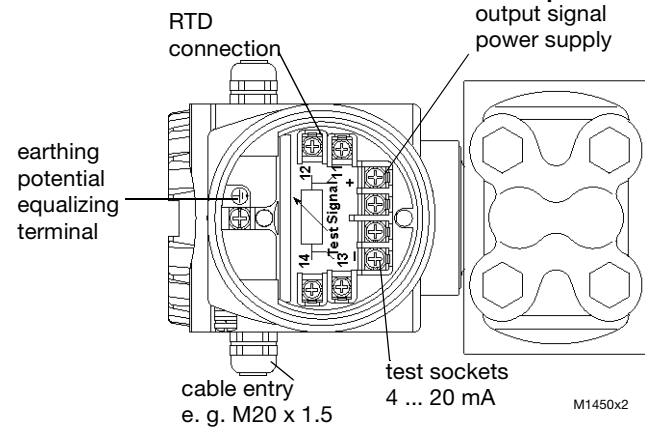


Figure 4. Cable connection compartment

The electrical connection is effected behind the enclosure cover on the side of the connection compartment which can be screwed off. The signal line and the line for the PT 100 resistance thermometer are led separately into the cable connection compartment. On principle, an M 20 x 1.5 screwed cable gland made of metal is provided for the PT 100 cable as, preferably, shielded cable should be used. The screen has to be connected within the metal screwing!

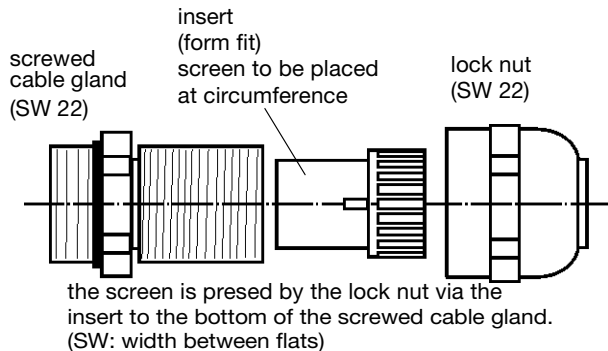


Figure 5. Metal screwing

For the signal line, the screwed cable gland is always made of plastic. The M 20 x 1.5 screwed cable gland and the plug Han 8U including socket connector are supplied whereas the screwed cable gland 1/2-14NPT has to be provided by the customer. Please take care that here, too, a metal screwing is used.

The screwed cable glands M 20 x 1.4 made of plastic which are supplied by the factory are only loosely screwed into the electronic housing. To achieve the degree of protection IP 67, the screwing must be hand-tight by means of a suitable tool (hexagon insert bit, SW 22).

- SIGNAL (+) and (-): Operating voltage
- TEST (+) and (-): Test sockets for 4...20 mA (HART), not available for fieldbus transmitters

- Terminals 11 to 14: Connection for PT 100
- 12 and 14 = Supply
- 11 and 13 = Signal

**Electrical connection with plug**

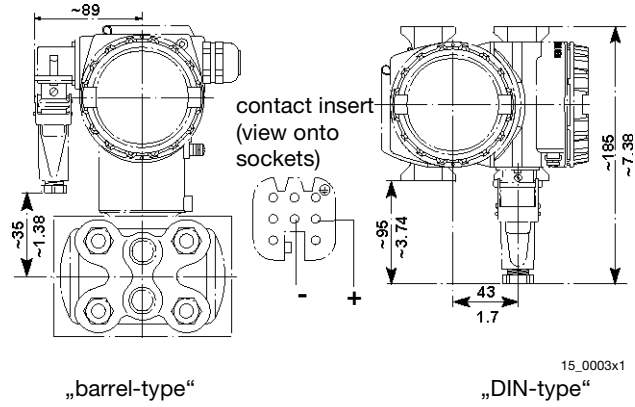


Figure 6. Plug connection

**Mounting of the socket connector**

The socket connector for the cable connection is attached to the transmitter in component parts.

**Installation (see Figure 5):**

The contact sockets (2) are crimped or soldered onto the cable ends (wire cross-section 0.75...1 mm<sup>2</sup>) from which 1.5...2 cm of the sheath and about 8 mm of the insulation has been removed and inserted from the rear into the contact insert (1). The screwed gland (5), thrust ring (7), sealing ring (4) and grommet housing (3) must be pushed onto the cable in the specified order prior to installation (the sealing ring (4) may have to be adapted to the cable diameter first).

**Attention:**

Check the connecting points again before pressing the sockets all the way into the contact insert. Incorrectly installed sockets can only be removed again with a special removal tool (item no.: 0949 813) or with a standard ball pen refill.

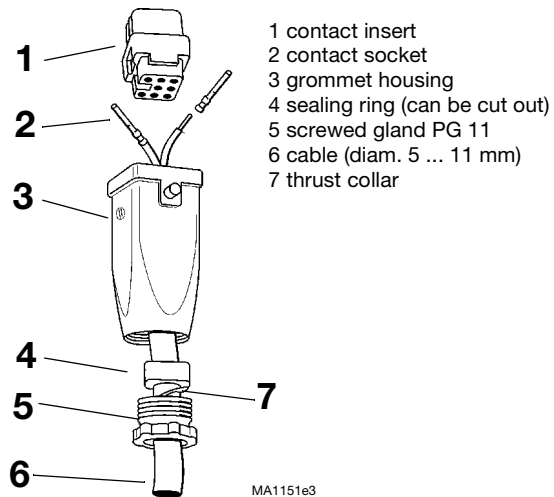


Figure 7. Mounting of the socket connector

A connection terminal is available for grounding (PE) on the transmitter exterior and also in the plug. Both terminals are electrically interconnected.

**Protective conductor / grounding**

The transmitter operates within the specified accuracy with common mode voltages between the signal lines and the housing up to 250 V. On principle, the transmitter has to be supplied from a voltage source, which is safely separated from the mains, with an output voltage of max. 60 VDC. In order to fulfill the requirements of the low-voltage guidelines and the relevant EN 61010 rules for the installation of electrical components, the housing must be provided with a protective circuit (e.g. grounding, protective conductor) if voltages of > 60 VDC could occur.

### Set-up of the signal circuit / communication circuit for transmitters with 4...20 mA output signal (HART® Protocol)

The transmitter can be operated via a modem by means of a PC or laptop. The modem can be connected in parallel to the transmitter at any place in the signal circuit. Communication between transmitter and modem is made via AC signals which are overlaid to the analog 4...20 mA output signal. This modulation is effected without averaging and therefore, it does not influence the measuring signal.

Communication between transmitter and PC or laptop is only possible if the signal circuit is set up as shown in Figure 6. The resistance between the connecting point of the FSK modem and the power supply must be at least 250 Ohm including the internal resistance of the supply unit. If this value is not reached with the normal installation, an additional resistance must be used.

The additional resistance has already been installed by the manufacturer in the supply units TZN 128 and TZN 129.

In the "FSK bus" mode, the TZN 128 allows to communicate directly via the supply unit..

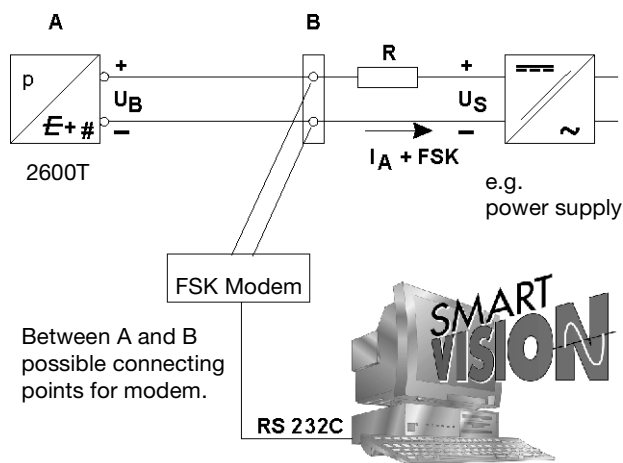


Figure 8. Communication mode: "point-to-point "

For power supply, either supply units, batteries or power packs can be used which must be designed to ensure that the operating voltage  $U_B$  of the transmitter is always between 10.5 and 45 V DC (for backlit LCD indicator 14 ... 45 V DC).

The max. current of 20 ... 22.5 mA which may occur by overranging according to the respective parameter setting, must be taken into account. The minimum value for  $U_S$  results from this. If further signal receivers (e.g. indicators) are connected into the signal circuit, their resistance must also be taken into account.

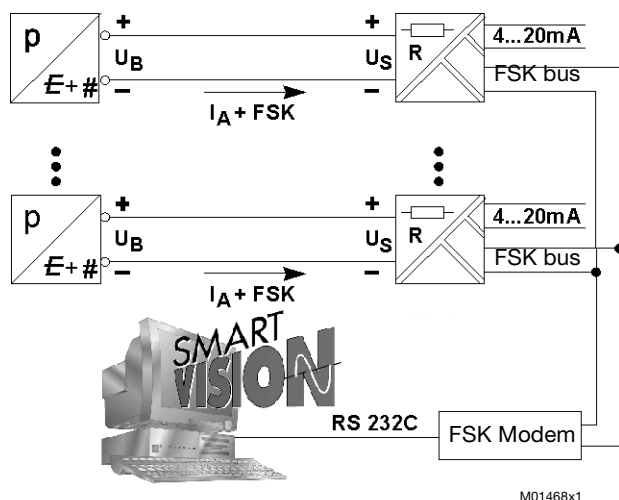


Figure 9. Communication mode: "FSK bus"

#### Notes on connecting cable

To allow communication between transmitter and PC/laptop, cabling must meet the following requirements:

It is recommended to use shielded and twisted pair lines.

The minimum wire diameter should be:

- 0.51 mm for lines up to 1500 m
- 0.81 mm for lines longer than 1500 m

The maximum line length is limited to:

- 3000 m for twin-core cable
- 1500 m for multicore cable

The actually possible line length of the electric circuit depends on the total capacitance and joint resistance; it can be estimated according to the following formula:

$$L = \frac{65 \times 10^6}{R \times C} - \frac{C_f + 10000}{C}$$

- L = Line length in m
- R = Joint resistance in
- C = Line capacitance in pF
- Cf = Capacitance of the devices existing within the circuit

The shield should be grounded on one side only.

Laying together with other electric circuits (with inductive load, etc.) and the proximity of large electrical installations should be avoided.

#### Notes on PROFIBUS-PA transmitters

PROFIBUS-PA transmitters are provided for the connection to segment couplers DP / PA. The permissible terminal voltage ranges from 10.2... 32 V DC.

A shielded cable is recommended. Contacting of the shield is effected in the metal screwing. The transmitter must be grounded. The transient behavior corresponds to the draft DIN IEC 65C / 155 / CDV dated June 1996. When operating with an Ex-segment coupler according to DIN EN 61 158-2 October 1994, the max. number of devices may be reduced by a time-dependent current limitation.

During cyclic data traffic, the OUT variable is transmitted. It is composed of the output value and 1 byte status information. The output value is transmitted with 4 bytes as IEEE-754 Floating-Point-Type.

For further notes on PROFIBUS-PA, e.g. on the subject "Ident Number", please refer to the "Supplementary Instructions", the Data Sheet "Installation Proposals" and the Internet address <http://www.profibus.com>.

#### Notes on explosion protection

For the installation (electrical connection, grounding / potential equalization, etc.) of explosion-proof transmitters, the national statutory orders, DIN/VDE rules, guidelines for explosion protection and the explosion proofness test certificate of the device have to be observed. The certified explosion proofness of the transmitter is indicated on the type plate.

#### Transmitters of the type of protection "Intrinsically safe

##### EEx i" according to Directive 94 / 9 / EC (ATEX):

- Install only intrinsically safe devices within the transmitter signal circuit.
- The signal circuit may be interrupted even when the transmitter is in operation (e.g. disconnect and connect signal lines).
- The housing may be opened during operation.
- Transmitters with and without remote seal of the type of protection "Intrinsically safe EEx i" may be mounted directly at zone 0 if they are supplied by means of an intrinsically safe electric circuit EEx ia or EEx ib.
- Test circuit (terminals "TEST + / -"): of the type of protection "Intrinsically safe" only for connection to passive intrinsically safe electric circuits. Category, explosion group as well as the maximum values for  $U_o$ ,  $I_o$  and  $P_o$  of the intrinsically safe test circuit are determined by the connected intrinsically safe signal circuit. Observe the rules of interconnection!

#### Transmitters of the category 3 to be used in "Zone 2" according to Directive 94 / 9 / EC (ATEX):

- The transmitter has to be connected by means of a certified screwed cable gland (type of protection "Increased safety EEx e" according to ATEX).
- It is not permitted to open the housing during operation (operating voltage switched on)!

### **Transmitters for use in areas with inflammable dust in acc. with guideline 94 / 9 / EC (ATEX)**

The transmitter can only be connected via a certified cable gland in acc. with EN 50 014: 1997 ( not in scope of supply ). The cable gland must also meet the degree of protection IP 67 requirements. Under consideration of the intrinsic heat generation, the smoulder temperature of the dusts must be at least 85 deg. K above the ambient temperature.

When using remote seals with an anti-stick coating, one must consider the possible danger of an electro-static discharge under consideration of the medium and the transportation speed.

### **Transmitters of the type of protection "Flameproof enclosure EEx d" according to Directive 94 /9 / EC (ATEX):**

- It is not permitted to open the housing during operation (operating voltage switched on)!
- The following set-up instructions have to be observed:
  1. The transmitter has to be connected via suitable cable and line entries or piping systems which meet the requirements according to EN 50 018:1994, Section 13.1 and / or 13.2 and for which a separate test certificate is available!
  2. Unused openings of the housing have to be closed according to EN 50 018:1994, Section 11.9!
  3. Cable and line entries as well as blanking plugs which do not correspond to the points 1. and 2. must not be used!
- To align the transmitter (torsion by max. 360°) at the measuring point, the rotatable housing can be loosened at the shaft between sensor and housing:
  - Release the attachment screw by max. 1 rotation.
  - Align the housing.
  - Retighten the attachment screw!
- Before switching on the operating voltage:
  - Close the housing.
  - Secure enclosure cover by turning the attachment screw (hexagon socket screw) to the left.
  - Protect housing from torsion by turning the attachment screw (stud) to the right.
- Enclosure cover, electronic housing and sensor may only be replaced by approved components!

### **Type Examination Certificate / Conformity Statement**

For transmitters in explosion-proof design, the EC Type Examination Certificate and / or Conformity Statement must be observed as part of these Instructions.

## **7 Commissioning**

After installing the transmitter, it is placed into operation by switching on the operating voltage.

- Check the following before switching on the operating voltage:
  - Process connections.
  - Electrical connections.
  - That the measurement piping and measuring chamber of the transmitter are completely filled with the medium.
- Subsequently it is placed into operation.  
The shut-off armatures should be operated in the following sequence (basic setting: all valves closed):
  1. Open the shut-off valves on the pressure tap connections
    - if present.
  2. Open the pressure compensation valve of the shut-off armature.
  3. Open the positive shut-off valve.
  4. Close the pressure compensation valve.
  5. Open the negative shut-off valve.
- Proceed in the reverse order when taking the unit out of operation.

If, in case of transmitters of the type of protection "Intrinsically safe", a current meter is connected to the test sockets or a modem is connected in parallel when an explosion hazard is existing, the sums of the capacitance and inductance of all circuits including transmitter (see type plate) must be equal to or smaller than the

permissible capacitance and inductance of the intrinsically safe signal circuit (see type plate of the supply unit). Only passive or explosion-proof test devices or indicators may be connected.

If the output signal is slow to stabilize, a high damping time constant has probably been set in the transmitter.

### **Notes on transmitters with 4...20 mA output signal (HART® - Protocol)**

If the applied pressure is within the values indicated on the type plate, the output current ranges between 4 and 20 mA. If the applied pressure exceeds the calibrated range, the output current is between 3.5 mA and 4 mA in case of underranging or between 20 mA and 22.5 mA (according to the respective parameter setting) in case of overranging; standard setting: 3.8 / 20.5 mA.

In order to prevent errors in the lower flow ranges, it is possible, via the communication tool SMART VISION, to adjust the "Zero suppressor" and / or the "Lin./Sq. rt. transition point". Should no values have been given, then the factory set values will be: 5 % for the "Lin./Sq. rt. transition point" and 6 % for the "Zero suppressor" of the maximum flow, i.e. the 267/269C operates only with the "Zero suppressor".

A current of < 4 mA or > 20 mA may also indicate that the micro-processor has detected an internal error; standard setting: 21 mA. Via the graphical user interface (DTM), an exact diagnosis of the error can be performed. A short-time interruption of power supply results in an initialization of the electronic (restart of the program).

### **Write protection**

Write protection prevents an illegal overwriting of the configuration data. If write protection is activated, the function of the keys 0 % and 100 % is disabled. However, it is still possible to read out the configuration data by means of the graphical user interface (DTM), (or another comparable communication tool).

If necessary, the control unit can be leaded.

Write protection is activated as follows (see also symbolism on the plate):

1. First, fully press down the switch with an appropriate screw driver.
2. Then turn the switch clockwise by 90 °∠ .

For deactivation, the switch has to be pushed down a little and turned counterclockwise by 90 °∠ .

### **Oblique sensor / zero correction**

During the installation of the transmitter, zero shifts (e.g. slightly inclined mounting position, different liquid columns in the differential pressure lines, remote seals, etc.) caused by mounting may occur which have to be corrected.

**Note:** For correction, the transmitter must have reached its operating temperature (approx. 5 min after switch-on if the transmitter has already assumed ambient temperature). The correction has to be made at "zero" flow (dp = 0)! There are two possibilities (point 1A or 1B) to perform the correction:

1A. Push button unit and LCD indicator have to be available. Call up the menu item "SHIFT ZERO" via the keys "M" and "+". The correction is made by pressing the key "M" (refer to section 7 "Operation").  
or

1B. By means of the graphical user interface (DTM), using the menu path **Configuration\_Differential Pressure Measurement\_Process Variable** and the button <Balance> in the field "Oblique Sensor" .

2. The transmitter has to be put into the operating state.

### **Rotate housing with regard to the sensor**

The electronic housing can be rotated through 360° and can be fixed in any position. A stop prevents the housing from being turned too far.

To this effect, the fixing screw at the housing shaft (hexagon socket screw SW 2.5 mm, see section 12 "Dimensional Diagrams") must be released and hand-tightened after the position has been reached.



### Assembly / disassembly of push button unit (Figure 8)

- Loosen the screw of the protective cap and turn it aside.
- Push the lock completely out of the push button unit, e.g., by means of a suitable screw driver.
- Remove the uncovered square nut from the push button unit.
- Loosen the fastening screw of the push button unit by a Torx screw driver (size T10) and pull the latter out of the electronic housing.
- If necessary, insert a spacer and tighten it by the attached screw.

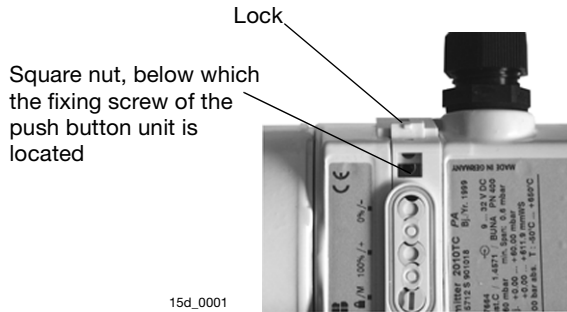


Figure 10. Push button unit - disassembly / assembly

### Assembly / disassembly of LCD indicator

- Unscrew enclosure cover of the electronic compartment (see Figure 8) (in case of EEx d type, observe section "Secure enclosure cover for EEx d").
- Plug LCD indicator. Depending on the mounting position of the transmitter, the LCD indicator can be slipped on in four different positions; in this way turns by  $\pm 90^\circ$  or  $\pm 180^\circ$  are possible.

**Note:** If the LCD indicator is backlit (option, however, not for field-bus transmitters) there is a three-core cable with plug on the back of the indicator. Connect this plug with the 3-pole plug strip in the electronic compartment (see Figure 9) before slipping on the indicator.

If there is a jumper on the 3-pole plug strip, it has to be removed and plugged into the "socket for jumper".

- Fasten LCD indicator with both screws.
- Hand-screw the enclosure cover (if necessary, observe section "Secure enclosure cover for EEx d").

#### Jumper position

if the LCD indicator is not backlit and / or

**3-pole plug strip**  
for backlit LCD indicator

**Socket for jumper**  
for backlit LCD indicator

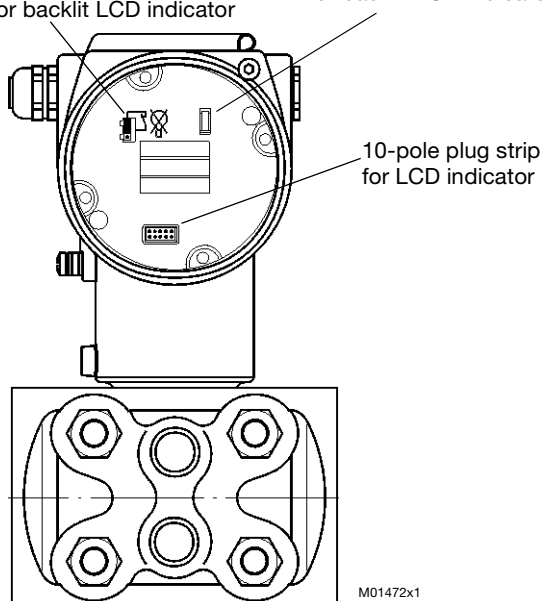


Figure 11. Electronic compartment - LCD indicator mounting

### Secure enclosure cover for EEx d

On the top right of the electronic housing front, there is an attachment screw (hexagon socket screw, SW 3 mm).

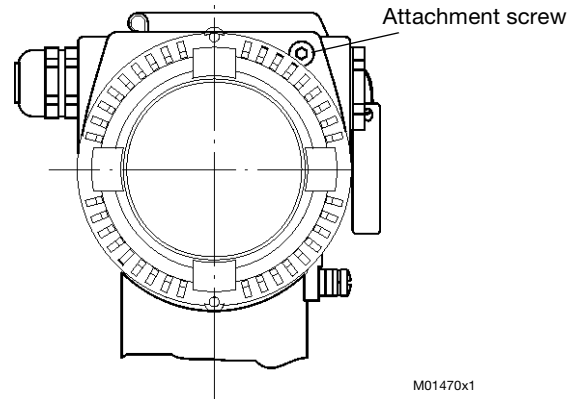


Figure 12. Secure enclosure cover

- Turn enclosure cover hand-tight into the housing.
- Secure enclosure cover by turning the attachment screw to the left. In doing so, the screw must be unscrewed to the stop of the screw head at the housing cover.

## 8 Operation



- There is no protection against electric shock when the enclosure covers are open. Do not touch live parts.
- The key functions "0 %" (for lower range value setting) and "100 %" (for upper range value setting) are not available. The write protection (lock symbol), however, is active.
- The key functions "M", "+" and "-" for the configuration of the transmitter together with the LCD indicator are available.



Figure 13. Key legend plate



Lower and upper range value can only be calibrated by means of the graphical user interface (DTM). Please observe that the 267/269C is a flow transmitter and that the lower range value must always be set to 0 % = 0 mbar.

The transmitter has been calibrated by the manufacturer according to the order data. The set values for lower range and upper range are indicated on the type plate.

### Operation via SMART VISION®

#### System requirements

- SMART VISION®  
SMART VISION® as from Version DSV401
- Operating systems
  - Windows NT 4.0 with service pack 5 or 6a (do not use service pack 6!), Win 2000
  - Internet Explorer as from Version 5.0

#### Note:

The DTM is started by means of the right mouse button or via the menu item "Device" in 2 steps with: 1. "More", 2. "Edit". After a "Connection setup", first the data of the 267/269C should be loaded completely. Changed data are underlined and displayed in blue. These data are transmitted to the device via "Store data in the device".

After the data have been saved in the transmitter, their nonvolatile storage is effected automatically. To do this, power supply to the transmitter must be continued for 2 minutes. If this is not observed, the previous data will become active again during the next operation.

For Profibus devices, the disconnection of "Local operation" only becomes effective in case of cyclic communication. If write protection is set by means of the DTM, the setting of the 267/269C can no more be changed via the control keys.

For Profibus devices, the slave address must be indicated correctly in the project tree of SMART VISION®. Communication name and description are automatically updated when loading the device data.

The most important calibration / parameterization possibilities under the graphical user interface (DTM) are shortly described in the following. You will find further notes on the menu items in the context-sensitive help.

Before carrying out any setting, please ensure that write protection has neither been activated on the transmitter itself (Key with lock symbol), or via the graphical user interface (DTM) (menu path **Configuration\_Basic Parameters\_General\_Local Operation**).

#### ● Adjust damping

Menu path:

##### **Configuration\_Differential Pressure Measurement\_Output**

The required value has to be entered in the field "Output parameters" in the line "Damping".

#### ● Correct sensor misalignment

Menu path:

##### **Configuration\_Differential Pressure Measurement\_Process Variable**

Actuate the button <Balance> in the field "Sensor misalignment". Balancing is immediately effected with nonvolatile storage in the transmitter.

#### ● Change flow unit

Menu path:

##### **Configuration\_Flow Measurement\_Primary Device**

The required unit has to be selected from the pop-up list in the line "Mass flow" or "Volume flow".

#### ● Adjust lower and upper range value

Menu path:

##### **Configuration\_Differential Pressure Measurement\_Process Variable**

In the field "Scaling", the adjustment is possible in two ways:

**Value input:** The required value / values has / have to be entered in the input fields "Lower range value" and / or "Upper range value".

or

**Process pressure acceptance:** For the adjustment, the lower range value (always 0 mbar !) and the upper range value are preset as pressure at the sensor. Make sure that the measuring limits are not exceeded. Pressure reducing stations with adjustable pressure and comparative displays can be used as sensors. When connecting, take care to avoid residual liquids (with gaseous test media) or air bubbles (with liquid test media) in the piping since they can cause errors. The pressure reducing station should have an accuracy of at least 3 times better than the transmitter to be tested.

**Attention:** The lower range value must always be 0 mbar. It is only useful to change the upper range value, if the primary element is also changed and thus the orifice calculation data. Otherwise, a change of the upper range value will have no effect on the calculation of mass flow or of the analog output current here.

#### Operation with "local keys" (at the device) with LCD indicator

The control unit comprises 2 keys and a write protect switch. For the keys / the switch, physical connections through the housing are not required.

In conjunction with an LCD indicator, the transmitter can be configured with the keys (- / + / M) as follows:

(Note: Indications in ( ) designate the menu item, they are shown in the 1st and 2nd line of the indicator.

The complete structure tree is shown in Figure 14.

● Exit the menu (EXIT).

● Display of measured and calculated values (VIEW).

● Correct zero drift (e.g. sensor misalignment) (SHIFTZERO).

● Damping (DAMPING).

● Output current in case of an error (ALARM CURRENT); only available for 4...20 mA devices with HART® Protocol.

● Displayed value on the LCD indicator (DISPLAY).

● Temperature unit (UNIT) of internal temperature sensor.

● Fieldbus address (ADDRESS); only available for devices with PROFIBUS-PA Protocol (for devices with FOUNDATION Fieldbus and / or HART® Protocol, configuration of the fieldbus address is only possible by means of a communication tool such as SMART VISION®).

The following functions must not be executed as they will lead to wrong functions:

● GET 0%

● GET 100%

● SET 0%

● SET 100%

● OFFSET SHIFT (parallel shift) and

● UNIT (unit for pressure, differential pressure and temperature).

**Attention:** The unit for mass / standard volume flow or operating volume flow can only be changed by means of the graphical user interface (DTM).

In the following, some of the a.m. menu items are described in detail.

#### Notes on "Display of values (VIEW)" / "(DISPLAY)"

**2** Percent value of mass flow, e.g.: 63.75 %

**3** Output signal in mA for HART; for PROFIBUS-PA and

FOUNDATION Fieldbus this is the OUT value of static pressure

**6** Static pressure (incl. condensate column), e.g.: 3 bar

The values **1** to **5** can optionally be displayed during running operation when adjusting the indicator with "DISPLAY".

#### Notes on "Damping (DAMPING)"

A fluctuating output signal of the transmitter, caused by the process, can be electrically smoothed (damped).

The additional time constant is adjustable between 0 sec. and 60 sec. in step sizes of 0.001s.

The damping set in this way does not affect the measured value indicated digitally in physical units, but only the derivatives such as analog output current, free process variable, input signal for controller, etc.

#### Notes on "Fieldbus address (ADDRESS)"

Under this path, the fieldbus-slave-address may be changed. Enter a figure between 0 and 126 for the selected transmitter.

**Remark:** Generally, the manufacturer assigns the address 126 to all new devices! The transmitters should get different addresses in order to allow the addressing of a specific device. If, e.g., the device data are loaded via the communication tool SMART VISION after the address has been changed, the connection set-up is executed again, and possibly an error message appears. Acknowledge this with "Repeat", then the data will be loaded without any problem.

#### Measured value display

##### The LCD indicator

2-line, 7-character, 19-segment alphanumeric display with additional bar chart display. Optionally, the indicator is available with back illumination (not combinable with fieldbus transmitters).

- Characters for:
- Transfer function; e. g. linear
  - Mode
  - Status / Code

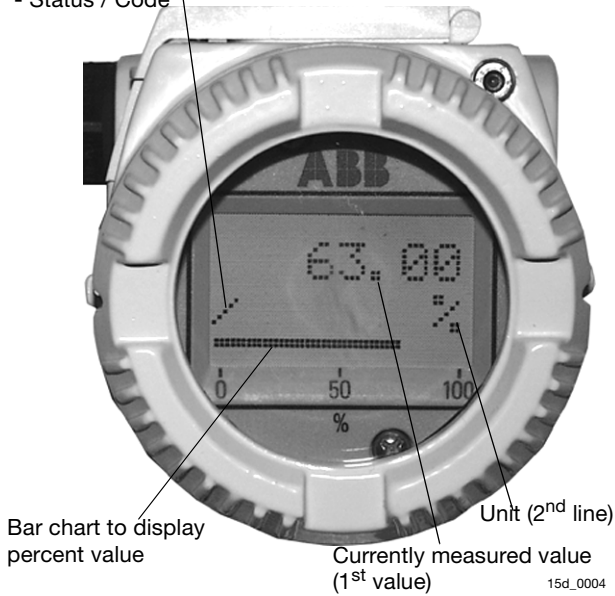


Figure 14. LCD-indicator (optional)

#### Display of the physical value

At the first position of the first line, the sign is displayed, and the following six positions show the amount of the measured value.

The comma is placed in such a way that the maximum value can be displayed with these six positions. The place of the comma is not changed. A comma at the sixth position is not displayed. Thus it is possible to display max. +/-999999. If this value is exceeded Overflow . indicated. In the second line, the unit is displayed with the last five positions.

The first position shows the following characters, if necessary, one after the other. Display changes every second

Display for	Character	Comment
Transfer function	$\int$ , $\sqrt$ or /	Always one of these characters appears.
Write protection		Only if write protection has been set.
Cyclic communication	.....	Only in case of PROFIBUS-PA
Status available (e.g. measuring range infringement or hardware error)		Only if a status is available.
Code of displayed value	1...9	see menu Display (see structure tree)
Transmitter is busy		This character overwrites other characters.

Table 1: Legend

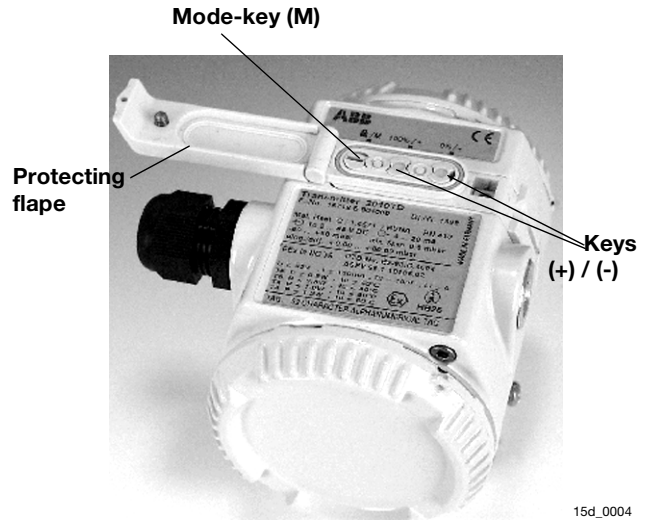


Figure 15. Control elements (optional)

#### Display of the percent value

	Display on LCD indicator
1st line	Percent value, limits: -25% to 125%, 2 decimal places
2nd line	1st position: Transfer function (Table 1) 2nd position: Write protection (Table 1) 7th position: %
Bar chart	2% steps - from -2% to +10%, no hysteresis

Table 2: Percent value display on LCD indicator

**Program control**

To make the keys accessible, release the screw and turn the protection cap aside (see Figure 13). With the mode key "M", you can start menu-controlled programming. To call the next menu item, press the key "+". You will return via the key "-". Submenu items / selection lists are activated via the mode key "M". A numerical value can only be changed via the keys "+" and "-". It must be taken into account that the key "+" changes the value (each keystroke increases the value by 1), whereas the position of the value to be changed is reached via the key "-". Acknowledge changes with the mode key "M"; the subsequent OK acknowledgement (via the key "M", "+" or "-") writes the new value into the failsafe storage. An adjusting process can be aborted by pressing simultaneously the keys "+" and "-". From any main menu item, you can return to the menu item "EXIT" by simultaneously pressing the "+" and "-" keys. When the adjustment has been finished, quit the program via the menu item "EXIT".

By means of the following structure tree, you will get an overview of the selection / programming possibilities

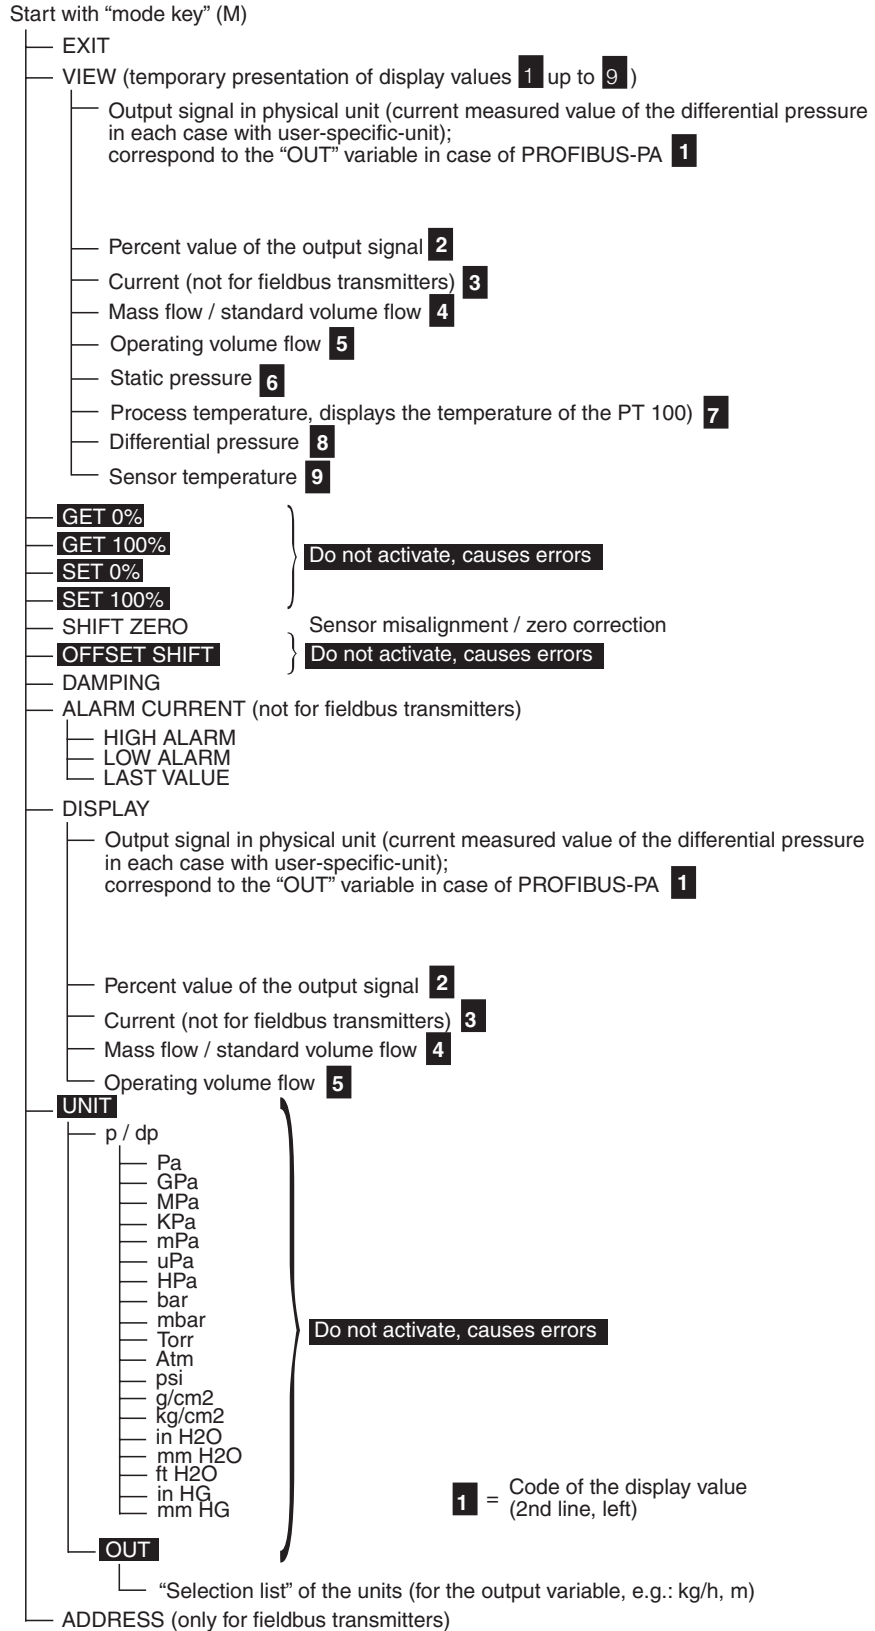


Figure 16. Structure tree

## Operation with PC / laptop

To configure the transmitter via PC / laptop, the software SMART VISION and the graphical user interface (DTM 2600T) is required. Please refer to the software description for operating instructions.

Communication protocol: PROFIBUS-PA® or  
Foundation Fieldbus® or  
HART®  
Hardware: for HART® :  
FSK modem for PC / notebook

### Configuration of flow measurement with SMART VISION®

If the transmitter has been configured at the manufacturer's work for the measuring point according to the specifications given by the user in the questionnaire (refer to page 20), you do not have to do anything else than to assemble the transmitter as specified (perhaps correct the sensor misalignment - refer to menu path **Configuration Differential Pressure Measurement Process Variable**), pressurize the transmitter and connect it to power supply; then the measuring point is ready for operation. If the transmitter is equipped with an LCD indicator, the current mass flow (default setting) is displayed immediately.

However, if you want to make changes, e.g., concerning the configuration of mass flow measurement, you need a communication tool, e.g., SMART VISION and the graphical user interface (DTM 2600T). By means of this tool, the device can be configured completely. It supports the HART Protocol as well as the fieldbus protocols "PROFIBUS-PA and FOUNDATION Fieldbus", and it is operable on a PC / notebook and / or in an automation system.

The necessary working steps for the installation of SMART VISION are described in the installation instructions delivered with the software. The parameters can be adjusted via the path **Configuration Flow Measurement**.

The program offers the possibility to configure, to interrogate and to test the transmitter. Furthermore, an offline configuration can be carried out via an internal database. Each configuration step is submitted to a plausibility check. The <F1> key provides extensive context-sensitive help at very stage throughout the complete program.

**Attention:** Immediately after the delivery of the transmitters and / or before changing the configuration, we recommend to save the existing configuration data on a data medium using the path **File\_Save**.

### Notes on configuration

#### ● Configuration\_Flow Measurement\_Basic Setting

Here measuring medium and correction range are defined. The units being displayed for differential pressure, static pressure and temperature are identical with the units specified using the path **Configuration Differential Pressure Measurement (and / or Static Pressure Measurement or Temperature Measurement)**. The min. and max. values which are indicated for the operating range should be within the setting values specified using the path **Configuration Differential Pressure Measurement (and / or Static Pressure Measurement or Temperature Measurement)**.

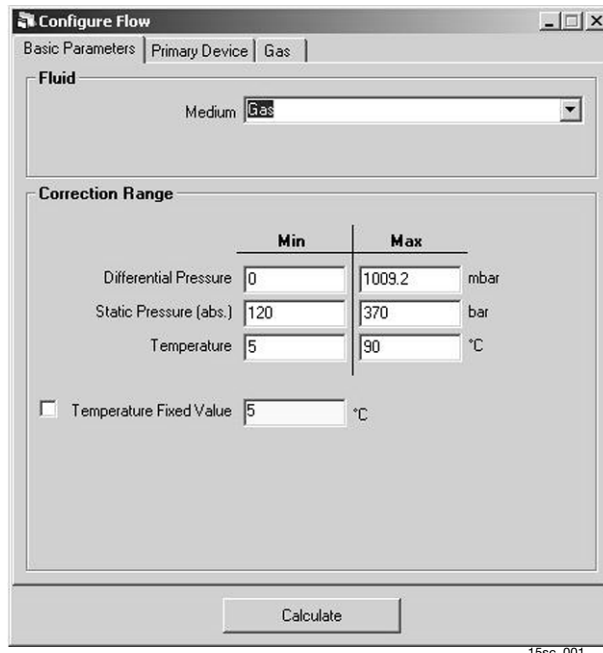


Figure 17. Configuration window - Basic setting

#### ● Configuration\_Flow Measurement\_Primary Device

The calculation values of the throttling device entered here are the basis for flow calculation. Incomplete or wrong data will lead to calculation errors. Please take care that the values are transferred from a valid calculation sheet to the window!

The following specifications regarding the primary device are required:

#### Throttling device

- Throttling device
- For selection:
  - "Orifice" with threshold pressure tapping according to ISO,
  - ISA 1932 - nozzle
  - further primary devices see questionnaire „Flow Compensation“ ff.
- Differential pressure, calculation value of the primary device.
- Absolute pressure, calculation value of the primary device.
- Temperature, calculation value of the primary device.
- Density of measuring medium, calculation value of the primary device.
- Mass flow, calculation value of the primary device.
- Volume flow, calculation value of the primary device.
- Ratio of diameters, calculation value of the primary device.
- Reynolds' number, calculation value of the primary device.
- Percent value for Re, calculation value of the primary device. This percent value shows at which flow the Reynolds' number is indicated. Typical values are 100% and 67%.

Only required for gas measurement:

- Standard density, calculation value of the primary device.
- Isotropic exponent, calculation value of the primary device.
- For detailed specification please refer to questionnaire „Flow Compensation“

Depending on the software variant of the 267/269C, the displayed values for absolute pressure, temperature and density can be provided with a gray background and underlined in blue even if the data have been loaded directly from the device. Due to the adjusted units, a conversion has been performed here for the representation in the DTM.

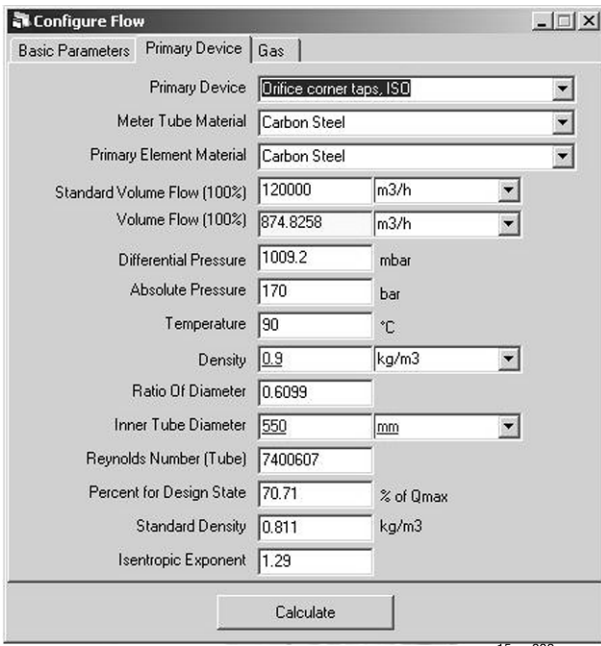


Figure 18. Configuration window - Primary device

● **Configuration\_Flow Measurement\_Gas**

In case of gaseous measuring media, the name of the medium can be entered and saved in the transmitter.

For exact calculations, it is possible to indicate real gas factor and / or compressibility factors for the respective measuring medium. To do this, select <With correction > and enter the corresponding values into the table.

The real gas factor / compressibility factor is only calculated for "Real gases". For "Ideal gases", K=1 (at low pressures and high temperatures, air and other gases behave like an "Ideal gas").

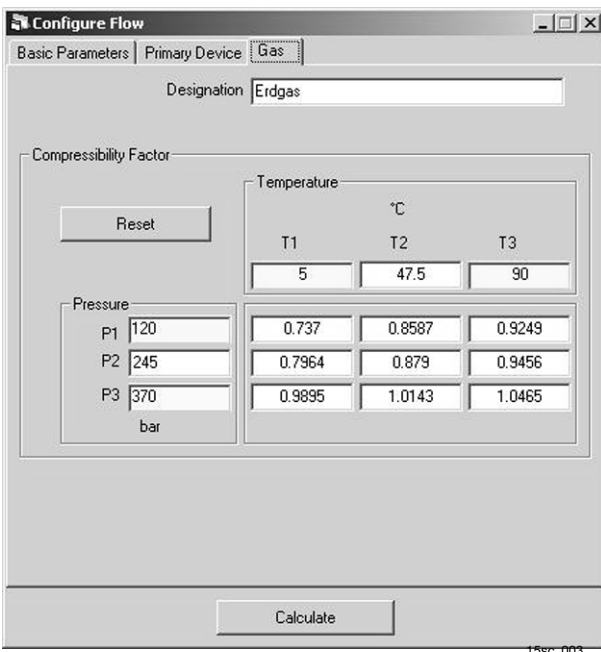


Figure 19. Configuration window - Gas

● **Configuration\_Flow Measurement\_Liquid**

In case of liquids, the density must be indicated for at least two (min./max.) temperature values to perform correction computing. Between these values, the density is interpolated.

To achieve a higher accuracy, up to four other temperature values can be indicated with the density.

For the measuring medium water, the density is calculated automatically as a function of temperature and static pressure.

● **Configuration\_Basic Parameters**

**Write protection**

If "Device write-protected" is selected, no data can be written from the communication tool into the device.

**Local Operation**

Via this function, the keyboard on the transmitter can be switched off completely. Thus it is possible to protect the setting from unauthorized access (for PROFIBUS-PA devices, only possible with cyclic communication).

**Indicator value**

Depending on the type, the alphanumeric indicator can display the following values:

- Output pressure (pressure, differential pressure or absolute pressure in the selected unit),
- Percent value pressure, differential pressure, absolute pressure or flow,
- Current (output current in mA, only for HART devices),
- Mass flow and / or standard volume flow (in case of gas),
- Volume flow.

In addition to measured values, the indicator displays diagnostic messages, max. and min. alarm, measured value overflow (OVER-FL) as well as configuration changes. An indicator can be installed later without any difficulty.

**Sensor temperature unit**

Please enter here the unit for the sensor temperature.

If the temperature dimension is changed, all associated values will be converted to this dimension and displayed accordingly.

Temperature values for the process temperature (PT100) are not affected by this dimensional change.

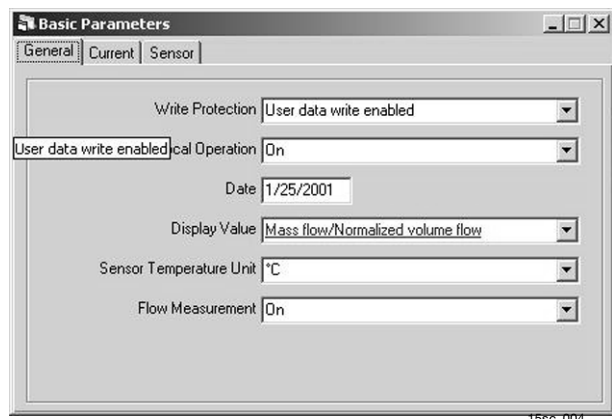


Figure 20. Configuration window - Basic parameters

# 9 Maintenance

## The transmitter is maintenance-free.

It is sufficient to check the output signal - depending on the operating conditions - at regular intervals according to section 7 "Operation".

If deposits in the sensor are to be expected, the sensor should also be cleaned at regular intervals - depending on the operating conditions. Cleaning should preferably be carried out in the workshop.

Replace defective transmitters / units according to the "Spare Parts Data Sheet".

## Dismantling / fitting the process flanges

If remote seals are fitted to the sensor, **do not** dismantle the process flanges!

1. Undo the process flange screws diagonally opposite each other. (hexagon insert bit, SW 13 mm)
2. Carefully remove the process flanges so as not to damage the separating diaphragms.
3. Using a soft brush and a suitable solvent thoroughly clean the separating diaphragms and, if necessary, the process flanges. Do not use sharp or pointed tools.
4. Renew the process flange O-rings (Parts List 10/15-9.00).
5. Fit the process flanges onto the sensor body. Take care not to damage the separating diaphragms.

**Note:** The flange faces of the 2 process flanges must be in one plane and at right angles to the electronic housing.

6. Check that the process flange screw thread moves easily: Tighten the nut by hand up to the screw head. If this is not possible, use new screws and nuts (Parts List 10/15-9.00).
7. Lubricate the screw threads and contact faces of the screwed joint with, for instance, "Anti-Seize AS 040 P" (supplier: P.W. Weidling & Sohn GmbH & Co. KG, D-Münster). With cleanliness stages, the corresponding regulations must be observed, e.g. DIN 25410!
8. **For 267/269C with measuring ranges  $\geq 60\text{mbar}$**   
First tighten the diagonally opposite process flange screws or nuts to the initial torque  $M_F = 10\text{ Nm}$  (1.0 kpm) using a torque wrench. Then tighten fully by continuing to turn each diagonally opposite screw or nut in two steps of  $90^\circ$  each through the tightening angle  $\alpha_A = 180^\circ$ .
9. **For 267/269C with measuring range 10mbar**  
Tighten the diagonally opposite process flange screws alternately in two steps using a torque wrench. Tightening torque  $M_A = 10\text{ Nm}$  (1.0 kpm).
10. Check for leaks.  
Apply pressure with max.  $1.3 \times P_N$  (bar) where the pressure has to be applied simultaneously to both sides of the sensor.
11. Check the lower range value and the upper range value in accordance with section 7 "Operation".

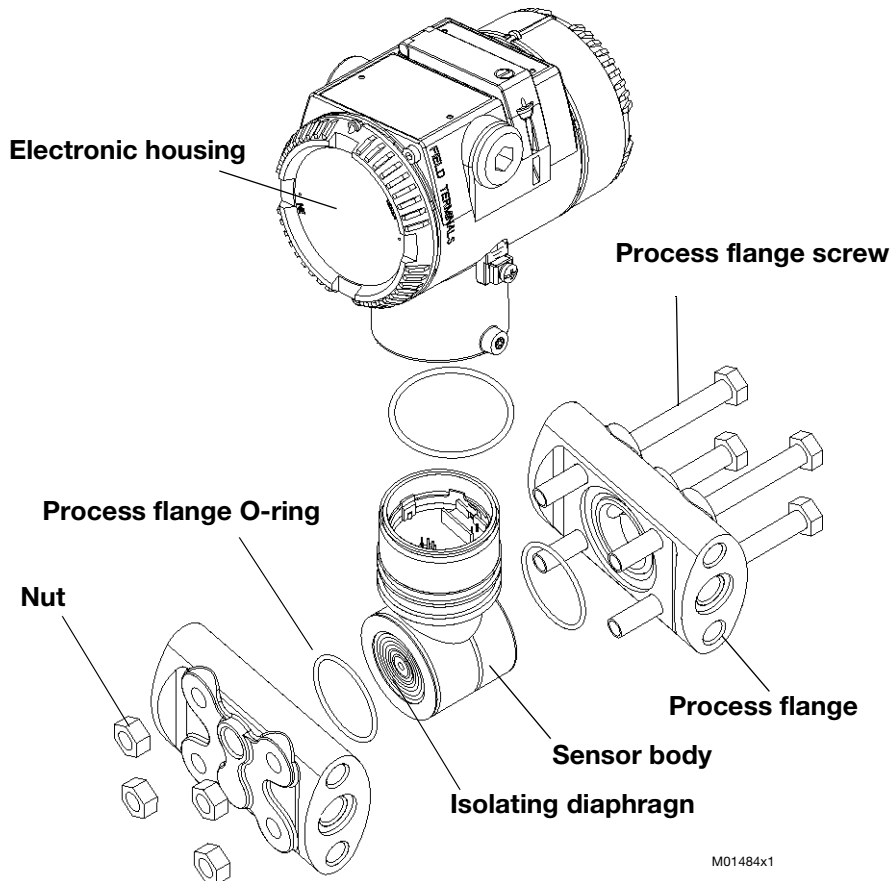


Figure 21. Exploded view

M01484x1

# 10 Repairs

**Attention:** Explosion-proof transmitters may only be repaired by the manufacturer, or they must be certified by an acknowledged expert after the repair has been carried out!

Observe the pertinent safety regulations before, during and after repairs.

Disassemble the transmitter only to such extent as necessary for cleaning, checking, repairing and replacement of defective parts. Observe section 8 "Maintenance"!

Sensor as well as sensor with attached remote seal can only be repaired by the manufacturer.

If it is necessary to screw off the electronic housing from the sensor / sensor body, first remove the electronic from the electronic housing in order to prevent it from being damaged. To do this, first screw off the enclosure cover (Attachment screw!, see Figure 10), then remove a possible LCD indicator from the electronic (loosen 2 screws), loosen both fastening screws of the electronic and carefully withdraw it from the electronic housing. Pull off the two plugs from the electronic. (Both plugs are equipped with a mechanical polarity safeguard and the smaller one additionally with a mechanical locking: Take the plug on the face between thumb and index finger and press the locking bar into the plug direction, then remove the plug from the holder.) Put the electronic on a suitable support. Screw off the electronic housing from the sensor / sensor body.

## Return

Defective transmitters / units are to be sent to the repair department, if possible, stating the fault and its cause.

**Note:** When ordering spare parts or instruments, please quote the serial number (F.-No.) of the original transmitter.

## Address:

ABB Process Industries  
 Department SPM  
 Schillerstraße 72  
 D-32425 Minden

# 11 Technical Data

## 11.1 Functional Specifications

### Range and span limits

#### - differential pressure sensors

Sensor Code	Upper Range Limit (URL)	Lower Range Limit (LRL)	Minimum Span
<b>A</b>	1 kPa 10 mbar 4 inH <sub>2</sub> O	0	0,05 kPa 0,5 mbar 0,2 inH <sub>2</sub> O
<b>C</b>	6 kPa 60 mbar 24 inH <sub>2</sub> O	0	0,2 kPa 2 mbar 0,8 inH <sub>2</sub> O
<b>F</b>	40 kPa 400 mbar 160 inH <sub>2</sub> O	0	0,4 kPa 4 mbar 1,6 inH <sub>2</sub> O
<b>L</b>	250 kPa 2500 mbar 1000 inH <sub>2</sub> O	0	2,5 kPa 25 mbar 10 inH <sub>2</sub> O
<b>N</b>	2000 kPa 20 bar 290 psi	0	20 kPa 0,2 bar 2,9 psi

#### - absolute pressure sensors

Sensor Code	Upper Range Limit (URL)	Lower Range Limit (LRL)	Minimum Span
<b>1</b>	600 kPa 6 bar 87 psi	0 abs	6 kPa 0,06 bar 0,87 psi
<b>2</b>	2000 kPa 20 bar 290 psi	0 abs	20 kPa 0,2 bar 2,9 psi
<b>3</b>	10000 kPa 100 bar 1450 psi	0 abs	100 kPa 1 bar 14,5 psi
<b>4</b>	41000 kPa 410 bar 5945 psi	0 abs	410 kPa 4,1 bar 59,5 psi

## Span limits

Maximum span = URL

IT IS RECOMMENDED TO SELECT THE TRANSMITTER SENSOR CODE PROVIDING THE TURNDOWN VALUE AS LOWEST AS POSSIBLE TO OPTIMIZE PERFORMANCE CHARACTERISTICS.

## Zero suppression and elevation

No suppression or elevation but zero based range as long as  
 - calibrated span ≥ minimum span

## Process temperature range

-50°C to +650°C (-58°F to 1200°F) by external four-wire RTD

## Damping

Adjustable time constant : 0 to 60s.

This is in addition to sensor response time

## Turn on time

Operation within specification in less than 2.5s with minimum damping.

## Insulation resistance

> 100MΩ at 1000VDC (terminals to earth)

## 11.2 Operative limits

### Temperature limits °C (°F) :

#### Ambient (is the operating temperature)

Silicone oil filling: -40°C and +85°C (-40°F and +185°F)

Inert filling: -20°C and +85°C (-4°F and +185°F)

Lower ambient limit for Viton and PTFE gaskets: -20°C (-4°F)

Note: For Hazardous Atmosphere applications see the temperature range specified on the certificate/approval relevant to the aimed type of protection.

## Process

Lower limit

- refer to lower ambient limits

Upper limit

- Silicone oil: 121°C (250°F)

for working pressure above 10kPa abs, 100mbar abs, 1.45psia(1)

- Inert fluid: 121°C (250°F) (2)

for working pressure above atmospheric pressure

(1) 85°C (185°F) for application below 10kPa abs, 100mbar abs, 1.45psia down to 3.5 kPa abs, 35mbar abs, 0.5psia

(2) 85°C (185°F) for application below atmospheric pressure down to 40kPa abs, 400mbar abs, 5.8psia.

## Storage

Lower limit: -50°C (-58°F); -40°C (-40°F) for LCD indicators

Upper limit: +85°C (+185°F)

## 11.3 Pressure limits

### Overpressure limits (without damage to the transmitter)

Lower limit

- 0.5kPa abs, 5mbar abs, 0.07psia for silicone oil

- 40kPa abs, 400mbar abs, 5.8psia for inert fluid

Upper limit

- 0.6MPa, 6bar, 87psi for differential pressure sensor code A

- 2MPa, 20bar, 290psi or 10MPa, 100bar, 1450psi or

41MPa, 410bar, 5945psi for differential pressure sensor codes C, F, L, N according to selected code variant.



## Static pressure

Transmitters for differential pressure model 267CS operates within specifications between the following limits

Lower limit

- 3.5kPa abs, 35mbar abs, 0.5psia for silicone oil
- 40kPa abs, 400mbar abs, 5.8psia for inert fluid

Upper limit

- 0.6MPa, 6bar, 87psi for differential pressure sensor code A
- 2MPa, 20bar, 290psi or 10MPa, 100bar, 1450psi or 41MPa, 410bar, 5945psi for differential pressure sensor codes C, F, L, N according to selected code variant.

## Proof pressure

The transmitter can be exposed without leaking to line pressure of up to 1.5 times the nominal pressure simultaneously on both sides.

## 11.4 Environmental limits

### Electromagnetic compatibility (EMC)

Definition Class 3  
Radio suppression Limit class B  
(according to EN 550011)  
Fulfills NAMUR recommendation

### Low voltage directive

Comply with 73/23/EEC

### Pressure equipment directive (PED)

Instruments with maximum working pressure 41MPa, 410bar, 5945psi comply with 97/23/EEC Category III module H.

### Humidity

Relative humidity: up to 100% annual average  
Condensing, icing: admissible

### Vibration resistance

Accelerations up to 2g at frequency up to 1000Hz  
(according to IEC 60068-2-26)

### Shock resistance (according to IEC 60068-2-27)

Acceleration: 50g  
Duration: 11ms

### Wet and dust-laden atmospheres

The transmitter is dust and sand tight and protected against immersion effects as defined by IEC EN60529 (1989) to IP 67 (IP 68 on request) or by NEMA to 4X or by JIS to C0920.

## 11.5 Electrical Characteristics and Options

### HART digital communication and 4 to 20mA output

#### Power Supply

The transmitter operates from 10.5 to 45VDC with no load and is protected against reverse polarity connection (additional load allows operations over 45VDC).

Minimum power supply is 14VDC with backlight indicator.

For EEx ia and other intrinsically safe approval power supply must not exceed 30VDC.

#### Ripple

Maximum permissible voltage ripple of power supply during the communication:

- 7Vpp at f = 50 to 100Hz
- 1Vpp at f = 100 to 200Hz
- 0.2Vpp at f = 200 to 300Hz

#### Load limitations

4 to 20mA and HART total loop resistance :

$$R(k\Omega) = \frac{\text{Supply voltage} - \text{min. operating voltage (VDC)}}{22,5 \text{ mA}}$$

A minimum of 250Ω is required for HART communication.

## 11.6 Optional indicators

### Integral display

2-line, 6-character 19-segment alphanumeric display with additional bar chart display, optionally with back illumination. User-specific display:

percentage of the output current or  
output current in mA or  
free process variable

Diagnostic message, alarms, measuring range infringements and changes in the configuration are also displayed.

### Output signal

Two-wire 4 to 20mA, related to mass flow calculation, compensating all pressure (p) and temperature (T) effects completely. HART® communication provides digital process variable (% , mA or engineering units) superimposed on 4 to 20mA signal, with protocol based on Bell 202 FSK standard.

### Output function

Mass flow calculation performed as per formula:

$$Q_m \approx C \cdot E_v \cdot Y_1 \cdot d^2 \cdot \sqrt{dp \cdot \rho}$$

where

$Q_m$  = mass flowrate  
 $C$  = discharge coefficient  
 $E_v$  = velocity of approach factor  
 $Y_1$  = gas expansion factor  
 $d$  = bore diameter  
 $dp$  = differential pressure  
 $\rho$  = fluid density

### Output current limits (to NAMUR standard)

Overload condition

- Lower limit: 3.8mA (configurable down to 3.5mA)
- Upper limit: 20.5mA (configurable up to 22.5mA)

### Alarm current

Min. alarm current: configurable from 3.5mA to 4mA,  
standard setting: 3.6mA  
Max. alarm current: configurable from 20mA to 22.5mA,  
standard setting: 21mA  
Standard setting: max. alarm current

## 11.7 PROFIBUS PA output

### Device type

Pressure transmitters compliant to Profiles 3.0 class A and B Identnumber 062D HEX.

### Power supply

The transmitter operates from 10.2 to 32VDC with no polarity. For EEx ia approval power supply must not exceed 17.5VDC. Intrinsic safety installation according to FISCO model.

### Current consumption

operating (quiescent): 11.7mA  
fault current limiting: 17.3mA max.

### Output signal

Physical layer in compliance to IEC 1158-2/EN 61158-2 with transmission to Manchester II modulation, at 31.25kbit/sec.

### Output interface

PROFIBUS PA communication according to Profibus DP50170 Part 2/DIN 19245 part 1-3.

### Output update time

250 ms

### Function blocks

3 analog input, 1 transducer, 1 MV block (flow), 1 physical

### Integral display

2-line, 6-character 19-segment alphanumeric display with additional bar chart display, optionally with back illumination. User-specific display:  
percentage of the output or  
OUT (input flow)  
Diagnostic message, alarms, measuring range infringements and changes in the configuration are also displayed.

### Transmitter failure mode

Permanent self-diagnostic; possible errors indicated in diagnostic parameters and in the status of process values.

## 11.8 FOUNDATION Fieldbus output

### Power supply

The transmitter operates from 10.2 to 32VDC polarity independent.  
For EEx ia approval power supply must not exceed 17.5VDC (FISCO certification).

### Current consumption

operating (quiescent): 11.7mA  
fault current limiting: 17.3mA max.

### Output signal

Physical layer in compliance to IEC 1158-2/EN 61158-2 with transmission to Manchester II modulation, at 31.25kbit/sec.

### Function blocks/execution period

3 standard analog input blocks, 1 application specific MV block (flow) / 250 ms max (each)

### Additional blocks

1 extended standard pressure transducer block with calibration, 1 standard recourse block and 1 extended standard temperature transducer block with calibration

### Number of link objects

10

### Number of VCRs

16

### Output interface

FOUNDATION fieldbus digital communication protocol to standard H1, compliant to specification V. 1.5; FF registration in progress.

### Integral display

2-line, 6-character 19-segment alphanumeric display with additional bar chart display, optionally with back illumination. User-specific display:  
percentage of the output or  
OUT (input flow)  
Diagnostic message, alarms, measuring range infringements and changes in the configuration are also displayed.

### Transmitter failure mode

Permanent self-diagnostic; possible errors indicated in diagnostic parameters and in the status of process values.

## 11.9 Performance specifications Model 267C

Stated at reference condition to IEC 60770 ambient temperature of 20°C (68°F), relative humidity of 65%, atmospheric pressure of 1013hPa (1013mbar), mounting position with vertical diaphragm and zero based range for transmitter with isolating diaphragms in Hastelloy and silicone oil fill and HART digital trim values equal to 4-20mA span end points.

Unless otherwise specified, errors are quoted as % of span. Some performance data are affected by the actual turndown (TD) as ratio between Upper Range Limit (URL) and calibrated span. IT IS RECOMMENDED TO SELECT THE TRANSMITTER SENSOR CODE PROVIDING THE TURNDOWN VALUE AS LOWEST AS POSSIBLE TO OPTIMIZE PERFORMANCE CHARACTERISTICS.

## Dynamic performance (according to IEC 61298-1 definition)

Standard configuration for instruments with turndown up to 30:1.  
Dead time: 30ms  
Time constant (63.2% of total step change):  
- sensors F to N: 150ms  
- sensor C: 400ms  
- sensor A: 1000ms

### Accuracy rating

% of calibrated span, including combined effects of terminal based linearity, hysteresis and repeatability.

For fieldbus versions SPAN refer to analog input function block outscale range

For differential pressure sensor  
±0.075% for TD from 1:1 to 10:1

$$\pm 0,075 + \left( 0,005 \times \frac{\text{URL}}{\text{Span}} - 0,05 \right) \% \text{ for TD greater than 10:1}$$

For absolute pressure sensor  
- 0.1% URL of absolute pressure sensor

### Operating influences

#### Ambient temperature (for turndown up to 15:1)

per 20K (36°F) change between the limits of  
-20°C to +65°C (-4 to +150°F)

for differential pressure sensor  
- ±(0.04% URL + 0.065% span)

per 20K (36°F) change between the limits of -40°C to +80°C  
(-40°F to +176°F)

for absolute pressure sensor  
- ±(0.08% URL + 0.08% span)

limited to ±(0.1% URL + 0.1% span) per the complete  
temperature range of 120K (216°F)

#### Static pressure (zero errors can be calibrated out at line pressure)

Measuring range	Sensor A	Sensors C, F, L, N
on zero	bis 2 bar; 0,05 % URL	bis 100 bar; 0,05 % URL
	>2 bar; 0,05 % URL/bar	>100 bar; 0,05 % URL/100 bar
on span	bis 2 bar; 0,05 % span	bis 100 bar; 0,05 % span
	>2 bar; 0,05 % span/bar	>100 bar; 0,05 % span/100 bar

### Supply voltage

Within voltage/load specified limits the total effect is less than 0.001% of URL per volt.

### Load

Within load/voltage specified limits the total effect is negligible.

### Radio frequency interference

Total effect : less than 0.05% of span from 20 to 1000MHz and for field strengths up to 10V/m when tested with unshielded conduit, with or without meter.

### Common mode interference

No effect from 250Vrms @ 50Hz, or 50VDC

### Mounting position

Rotations in plane of diaphragm have negligible effect. A tilt from vertical causes a zero shifts of  $\sin \alpha \times 0.35\text{kPa}$  (3.5 mbar, 1.4inH2O) of URL which can be corrected with the zero adjustment. No span effect.

### Stability

±0.10% of URL over a thirty-six-month period

### Vibration effect

±0.10% of URL (according to IEC 61298-3)

### 11.10 Performance specifications Model 269C

Stated at reference condition to IEC 60770 ambient temperature of 20°C (68°F), relative humidity of 65%, atmospheric pressure of 1013hPa (1013mbar), mounting position with vertical diaphragm and zero based range for transmitter with isolating diaphragms in Hastelloy and silicone oil fill and HART digital trim values equal to 4-20mA span end points.

Unless otherwise specified, errors are quoted as % of span.

Some performance data are affected by the actual turndown (TD) as ratio between Upper Range Limit (URL) and calibrated span.

IT IS RECOMMENDED TO SELECT THE TRANSMITTER SENSOR CODE PROVIDING THE TURNDOWN VALUE AS LOWEST AS POSSIBLE TO OPTIMIZE PERFORMANCE CHARACTERISTICS.

#### Dynamic performance (according to IEC 61298-1 definition)

Standard configuration for instruments with turndown up to 30:1.

Dead time: 30ms

Time constant (63.2% of total step change):

- sensors F to N: 150ms

- sensor C: 400ms

- sensor A: 1000ms

#### Accuracy rating

% of calibrated span, including combined effects of terminal based linearity, hysteresis and repeatability.

For fieldbus versions SPAN refer to analog input function block outscale range

For differential pressure sensor

±0.04% for TD from 1:1 to 10:1

± 0,04 +  $\left(0,005 \times \frac{\text{URL}}{\text{Span}} - 0,05\right)\%$  for TD greater than 10:1

For absolute pressure sensor

- 0.1% URL of absolute pressure sensor

#### Operating influences

##### Ambient temperature (for turndown up to 15:1)

per 20K (36°F) change between the limits of

-20°C to +65°C (-4 to +150°F)

for differential pressure sensor

- ±(0.03% URL + 0.05% span)

per 20K (36°F) change between the limits of -40°C to +80°C

(-40°F to +176°F)

for absolute pressure sensor

- ±(0.08% URL + 0.08% span)

limited to ±(0.1% URL + 0.1% span) per the complete temperature range of 120K (216°F)

#### Static pressure (zero errors can be calibrated out at line pressure)

Measuring range	Sensor A	Sensors C, F, L, N
on zero	bis 2 bar; 0,05 % URL	bis 100 bar; 0,05 % URL
	>2 bar; 0,05 % URL/bar	>100 bar; 0,05 % URL/100 bar
on span	bis 2 bar; 0,05 % span	bis 100 bar; 0,05 % span
	>2 bar; 0,05 % span/bar	>100 bar; 0,05 % span/100 bar

#### Supply voltage

Within voltage/load specified limits the total effect is less than 0.001% of URL per volt.

#### Load

Within load/voltage specified limits the total effect is negligible.

#### Radio frequency interference

Total effect : less than 0.05% of span from 20 to 1000MHz and for field strengths up to 10V/m when tested with unshielded conduit, with or without meter.

#### Common mode interference

No effect from 250Vrms @ 50Hz, or 50VDC

#### Mounting position

Rotations in plane of diaphragm have negligible effect. A tilt from vertical causes a zero shifts of  $\sin \alpha \times 0.35\text{kPa}$  (3.5 mbar, 1.4inH<sub>2</sub>O) of URL which can be corrected with the zero adjustment. No span effect.

#### Stability

±0.10% of URL over a thirty-six-month period

#### Vibration effect

±0.10% of URL (according to IEC 61298-3)

#### 11.11 Physical Specification

(Refer to ordering information sheets for variant availability related to specific model or versions code)

#### Materials

##### Process isolating diaphragms (\*)

AISI 316 L ss; Hastelloy C276™; Monel 400™; Tantalum;

##### Process flanges, adapters, plugs and drain/vent valves (\*)

AISI 316 L ss; Hastelloy C276™; Monel 400™, Kynar (PVDF)

##### Sensor fill fluid

Silicone oil; inert fill (Carbon Fluoride).

##### Mounting bracket (\*\*)

AISI 316 L ss.

##### Gaskets (\*)

Viton™; Perbunan (NBR); EPDM;

PTFE (for sensors C, F, L, N) or FEP coated Viton™ (for sensor A)

##### Sensor housing

AISI 316 L ss.

##### Bolts and nuts

Stainless steel bolts and nuts Class A4-70 per ISO 3506, in compliance with NACE MR0175 Class II.

##### Electronic housing and covers

Barrel version

- Low-copper content aluminium alloy with baked epoxy finish;

- AISI 316 L ss.

DIN version

- Low-copper content aluminium alloy with baked epoxy finish.

##### Covers O-ring

Viton™.

##### Local zero and span adjustments

Glass filled polycarbonate plastic (removable).

##### Tagging

AISI 316ss or plastic data plate attached to the electronics housing.

##### Calibration

Standard: at maximum span, zero based range, ambient temperature and pressure;

Optional: at specified range and ambient conditions.

##### Optional extras

##### Mounting brackets

For vertical and horizontal 60mm. (2in) pipes or wall mounting.

##### Integral display

plug-in rotatable LCD indicator.

##### Supplemental customer tag

AISI 316 ss tag fastened to the transmitter with stainless steel wire for customer's tag data up to a maximum of 30 characters and spaces.

##### Cleaning procedure for oxygen service

##### Hydrogen preparation

##### Test Certificates (test, design, calibration, material traceability)

## Tag and manual language

### Communication connectors

#### Process connections

on flanges: 1/4 in NPT on process axis selectable with 7/16 in-20 UNF fixing threads or DIN 19213 connection with M10 fixing threads for working pressure up to 16MPa, 160bar , 2320psi or M12 fixing threads for greater working pressure up to 41MPa, 410bar, 6000psi

on adapters: 1/2 in NPT on process axis  
centre distance: 54mm (2.13in ) on flange;  
51, 54 or 57mm (2.01, 2.13 or 2.24in) as per adapters fittings.

#### Electrical connections

Two 1/2 NPT or M20x1.5 threaded conduit entries, direct on housing.

Special communication connector (on request)

- HART : straight or angle Harting HAN connector and one plug.
- FOUNDATION Fieldbus and PROFIBUS PA: M12x1 or 7/8.

#### Terminal block

HART version: four terminals for signal/external meter plus four terminals for RTD connection wiring up to 2.5mm<sup>2</sup> (14AWG) and four connection points for test and communication purposes.

Fieldbus versions: two terminals for signal (bus connection) plus four terminals for RTD connection wiring up to 2.5mm<sup>2</sup> (14AWG).

#### Grounding

Internal and external 4mm<sup>2</sup> (12AWG) ground termination points are provided.

#### Mounting position

Transmitter can be mounted in any position.

Electronics housing may be rotated to any position. A positive stop prevents over travel.

#### Mass (without options)

3.5kg approx (8lb); add 1.5kg (3.4lb) for AISI housing.

Add 650g (1.5lb) for packing.

#### Packing

Carton 23 x 25 x 27cm approx (9 x 10 x 11in).

<sup>TM</sup> Hastelloy is a Cabot Corporation trademark

<sup>TM</sup> Monel is an International Nickel Co. trademark

<sup>TM</sup> Viton is a Dupont de Nemour trademark

(\*) Wetted parts of the transmitter.

(\*\*) U-bolt material: AISI 400 ss; screws material: AISI 316 ss.

## 11.12 Configuration

### Transmitter with HART communication and 4 to 20 mA

#### Standard configuration

Transmitters are factory calibrated to customer's specified range. Calibrated range and tag number are stamped on the type plate. If calibration range and tag data are not specified, the transmitter will be supplied configured as follows:

4 mA	Zero
20 mA	Upper Range Limit (URL)
Output	Linear
Damping	0.125s
Transmitter failure mode	21mA

Any or all the above configurable parameters, including lower range value and upper range value can be easily changed using the PC based configuration tool Smart Vision. The transmitter database is customized with specified flange type and material, O-ring material and filling liquid.

### Transmitter with PROFIBUS PA communication

Transmitters are factory calibrated to customer's specified range. Calibrated range and tag number are stamped on the type plate. If calibration range and tag data are not specified, the transmitter will be supplied configured as follows:

Measure Profile	Pressure
Engineering Unit	mbar/bar
Output scale 0%	Lower Range Limit (LRL)
Output scale 100%	Upper Range Limit (URL)
Output	Linear
Hi-Hi Limit	Upper Range Limit (URL)
Hi Limit	Upper Range Limit (URL)
Low Limit	Lower Range Limit (LRL)
Low-Low Limit	Lower Range Limit (LRL)
Limits hysteresis	0.5% of output scale
PV filter	0.125s.
Address	126

Any or all the above configurable parameters, including lower range value and upper range value can be easily changed using the PC based configuration tool Smart Vision. The transmitter database is customized with specified flange type and material, o-ring and filling liquid.

### Transmitter with FOUNDATION Fieldbus communication

Transmitters are factory calibrated to customer's specified range. Calibrated range and tag number are stamped on the type plate. If calibration range and tag data are not specified, the transmitter will be supplied configured as follows:

Measure Profile	Pressure
Engineering Unit	mbar/bar
Output scale 0%	Lower Range Limit (LRL)
Output scale 100%	Upper Range Limit (URL)
Output	Linear
Hi-Hi Limit	Upper Range Limit (URL)
Hi Limit	Upper Range Limit (URL)
Low Limit	Lower Range Limit (LRL)
Low-Low Limit	Lower Range Limit (LRL)
Limits hysteresis	0.5% of output scale
PV filter	0.125s
Address	Not necessary

Any or all the above configurable parameters, including lower range value and upper range value can be easily changed using the PC based configuration tool Smart Vision. The transmitter database is customized with specified flange type and material, o-ring and filling liquid.

# 12 Certificates and approvals

Observe mounting conditions according to EN 60079-10; 1966ff!

## Transmitters of the type of protection "Intrinsically safe EEx ia" according to the directions 94 / 9 / EC (ATEX)

Transmitters with 4...20 mA output signal and HART communication

Marking: II 1/2 GD T 50°C EEx ia IIC T6  
II 1/2 GD T 95°C EEx ia IIC T4

EC-Type-Examination Certificate no.:

ZELM 01 ATEX 0064  
and 1<sup>st</sup> + 2<sup>nd</sup> Supplement

Supply and signal circuit type of protection Intrinsic Safety EEx ib IIB/IIC resp. EEx ia IIB/IIC for connection to supply units with maximum values:

II 1/2 GD T 50°C EEx ia resp. ib IIC T6

II 1/2 GD T 95°C EEx ia resp. ib IIC T4

for Temperature class T4:

$U_i = 30 \text{ V}$

$I_i = 200 \text{ mA}$

$P_i = 0.8 \text{ W}$  for T4 with  $T_a = (-40...+85)^\circ\text{C} / (-40...+185)^\circ\text{F}$

$P_i = 1.0 \text{ W}$  for T4 with  $T_a = (-40...+70)^\circ\text{C} / (-40...+185)^\circ\text{F}$

for Temperature class T6:

$P_i = 0.7 \text{ W}$  for T6 with  $T_a = (-40...+40)^\circ\text{C} / (-40...+104)^\circ\text{F}$

effective internal capacitance  $C_i \leq 10 \text{ nF}$

effective internal inductance  $L_i \approx 0$

## Fieldbus-transmitters

(PROFIBUS PA / FOUNDATION Fieldbus)

Marking: II 1/2 GD T 50°C EEx ia IIC T6  
II 1/2 GD T 95°C EEx ia IIC T4

EC-Type-Examination Certificate no.:

ZELM 01 ATEX 0063  
and 1. Supplement

Supply and signal circuit type of protection Intrinsic Safety EEx ib IIB/IIC resp. EEx ia IIB/IIC for connection to FISCO supply units with rectangular or trapezoidal characteristics with maximum values:

II 1/2 GD T 50°C EEx ia resp. ib IIC T6  $U_i = 17.5 \text{ V}$

II 1/2 GD T 95°C EEx ia resp. ib IIC T4  $I_i = 360 \text{ mA}$

$P_i = 2.52 \text{ W}$

II 1/2 GD T 50°C EEx ia resp. ib IIB T6  $U_i = 17.5 \text{ V}$

II 1/2 GD T 95°C EEx ia resp. ib IIB T4  $I_i = 380 \text{ mA}$

$P_i = 5.32 \text{ W}$

resp. for connection to supply unit or barrier with linear characteristics with maximum:

II 1/2 GD T 50°C EEx ia bzw. ib IIC T6  $U_i = 24 \text{ V}$

II 1/2 GD T 95°C EEx ia bzw. ib IIC T4  $I_i = 250 \text{ mA}$

$P_i = 1.2 \text{ W}$

effective internal inductance  $L_i \leq 10 \mu\text{H}$ ,

effective internal capacitance  $C_i \approx 0$

Maximum permissible ambient temperatures depending on the temperature class:

T4:  $-40^\circ\text{C} \dots +85^\circ\text{C} (-40^\circ\text{F} \dots +185^\circ\text{F})$

T5, T6:  $-40^\circ\text{C} \dots +40^\circ\text{C} (-40^\circ\text{F} \dots +104^\circ\text{F})$

## Transmitters of category 3 for the application in "Zone 2" according to the directions 94 / 9 / EC (ATEX)

Transmitters with 4...20 mA output signal and HART communication

Marking: II 3 GD T 50°C EEx nL IIC T6

II 3 GD T 95°C EEx nL IIC T4

EC-Type-Examination Certificate no:

ZELM 01 ATEX 3059  
and 1. Supplement

Operating conditions:

Supply and signal circuit (terminals signal + /-):

$U \leq 45 \text{ V}$

$I \leq 22.5 \text{ mA}$

Maximum permissible ambient temperatures depending on the temperature class:

T4:  $T_a = -40^\circ\text{C} \dots +85^\circ\text{C} (-40^\circ\text{F} \dots +185^\circ\text{F})$

T5, T6:  $T_a = -40^\circ\text{C} \dots +40^\circ\text{C} (-40^\circ\text{F} \dots +104^\circ\text{F})$

## Transmitters of the type of protection "flameproof enclosure EEx d" according to the directions 94 / 9 / EC (ATEX)

Transmitters with 4...20 mA output signal and HART communication and Fieldbus-transmitters (PROFIBUS PA / FOUNDATION Fieldbus)

Marking: II 1/2 G EEx d IIC T6

EC-Type-Examination Certificate no: PTB 00 ATEX 1018

Ambient temperature range:  $-40^\circ\text{C} \dots +75^\circ\text{C} (-40^\circ\text{F} \dots +167^\circ\text{F})$

## Factory Mutual (FM)

Transmitters with 4...20 mA output signal and HART communication

Intrinsically Safe:

Class I; Division 1; Groups A, B, C, D;

Class I; Zone 0; Group IIC; AEx ia IIC

Degree of protection:

NEMA Type 4X (indoor or outdoor)

Maximum permissible ambient temperatures depending on the temperature class:

$U_{\max} = 30 \text{ V}, C_i = 10.5 \text{ nF}, L_i = 10 \mu\text{H}$			
Ambient temperature	Temperature class	$I_{\max}$	$P_i$
$-40 \dots +85^\circ\text{C}$ $(-40 \dots +185^\circ\text{F})$	T4	200 mA	0.80 W
$-40 \dots +70^\circ\text{C}$ $(-40 \dots +129^\circ\text{F})$			1.00 W
$-40 \dots +40^\circ\text{C}$ $(-40 \dots +104^\circ\text{F})$	T5	25 mA	0.75 W
	T6		0.50 W

Fieldbus-transmitters (PROFIBUS PA / FOUNDATION Fieldbus)

Intrinsically Safe:

Class I, II, and III Division 1,

Groups A, B, C, D, E, F, G;

Class I, Zone 0, AEx ia Group IIC T6; T4

Non- incensive Class I, II, and III, Division 2,

Groups A, B, C, D, F, G

Transmitters with 4...20 mA output signal and HART communication and Fieldbus-transmitters (PROFIBUS PA / FOUNDATION Fieldbus)

Explosion Proof:

Class I, Division 1, Groups A, B, C, D

Class II/III, Division 1, Groups E, F, G

Degree of protection:

NEMA Type 4X (indoor or outdoor)

## Canadian Standard (CSA)

Transmitters with 4...20 mA output signal and HART communication and Fieldbus-transmitters (PROFIBUS PA / FOUNDATION Fieldbus)

Explosion Proof:

Class I, Division 1, Groups B, C, D

Class II/III, Division 1, Groups E, F, G

Degree of protection:

NEMA Type 4X (indoor or outdoor)

Company	
Order No.	
Measuring point	
In charge	
Dept. / Phone	
Date / Signature	
ABB order no.	
ABB Position no.	
ABB in charge	
Dept. phone	

Primary Device	Orifice Corner Taps, ISO	
	Orifice Flange Taps, ISO	
	Orifice D- and D/2-Taps, ISO	
	Orifice Corner Taps, ASME	
	Orifice Flange Taps, ASME	
	Orifice D- and D/2-Taps, ASME	
	Orifice Flange Taps, AGA3	
	Orifice 2,5D- and 8D-Taps	
	Small bore orifice, flange taps	
	Small bore orifice, corner taps taps	
	Nozzle ISA 1932	
	Nozzle, Long Radius Wall Tap, ISO	
	Nozzle, Long Radius Wall Tap, ASME	
	Venturi, Rough Cast Inlet, ISO	
	Venturi, Machined Inlet, ISO	
	Venturi, Welded Inlet, ISO	
	Venturi, Rough Cast Inlet, ASME	
	Venturi, Machined Inlet, ASME	
	Venturi, Welded Inlet, ASME	
	Venturi, Nozzle, ISO	
	Area Averaging Meter	
	Pitot tube, ISO 3966	
	V-Cone	
	Wedge Element	
	Integral Orifice Assembly	
	Density Correction (unknown Primary Element)	

<b>Pipe Diameter</b>			mm	
Material Primary Element		Material Pipe		
Carbon steels		Carbon steels		
Stainless steels, ferritic		Stainless steels, ferritic		
Stainless steels, austenitic		Stainless steels, austenitic		
Copper-base alloys		Copper-base alloys		
Brass		Brass		
Nickel		Nickel		
Hastelloy C		Hastelloy C		
Monel		Monel		

Measuring Range				
		max. measuring range	limits of compensation	
			Lower range value	Upper range value
Differential pressure				mbar
Abs. pressure	0 ... 20 bar			bar
	0 ... 100 bar			bar
	0 ... 411 bar			bar
Hydrostatic pressure of liquid column (condensate) (requires zero shift for absolute pressure measurement)				mbar
Temperature measurement (not for saturated steam)	-50 ... +650 °C			°C
Fixed value for temperature				°C

Calculation values primary element			
Medium	Water Saturated Steam Heated Steam		
Abs. pressure		$P_{abs,r} =$	bar
Temperature measurement (not for saturated steam)		$t_r =$	°C
Mass flow rate		$Q_{m,r} =$	kg/s
Differential pressure		$\Delta p_r =$	mbar

Isentropic exponent (not for saturated steam and heated steam)	$\kappa =$	
Ratio of diameters (not for Integral Orifice Assembly, Area Averaging Meter, Pitot tube, Density Correction)	$\beta = d/D =$	
Reynolds number (only for nozzles and orifices)	$Re_D =$	
Correction Factor Area Averaging Meter <sup>1)</sup> (not for water)		
Calculation done for flow		% x Q <sub>r</sub>

1) Only necessary if Area Averaging Meter is used as primary element.

If factor should not be taken into consideration or is unknown, please add "0"

Measuring Range		limits of compensation		
	max. measuring range	Lower range value	Upper range value	
Differential pressure				mbar
Abs. pressure	0 ... 20 bar			bar
	0 ... 100 bar			bar
	0 ... 411 bar			bar
Hydrostatic pressure of liquid column (requires zero shift for absolute pressure measurement)				mbar
Temperature measurement (not for saturated steam)	-50 ... +650 °C			°C
Fixed value for temperature				°C

Calculation values primary element			
Medium (Flüssigkeit)			
Abs. pressure	$p_{abs,r} =$		bar
Temperature	$t_r =$		°C
Density	$\rho_r$		kg/m <sup>3</sup>
Mass flow rate	$Q_{m,r} =$		kg/s
Differential pressure	$\Delta p_r =$		mbar

Ratio of diameters (not for Integral Orifice Assembly, Area Averaging Meter, Pitot tube, Density Correction)	$\beta = d/D =$	
Reynolds number (only for nozzles and orifices)	$Re_D =$	
Calculation done for flow		% x Q <sub>r</sub>

Measurement of liquid Density = f(t), (p = const.)	
t (°C)	$\rho$ (kg/m <sup>3</sup> )

Min.2, max. 6 value pairs necessary



Measuring Range		Limits of compensation	
	Max. range	Lower range value	Upper range value
Differential pressure			mbar
Abs. pressure	0 ... 20 bar		bar
	0 ... 100 bar		bar
	0 ... 411 bar		bar
Temperature measurement	-50 ... +650 °C		°C
Fixed value for temperature			°C

Calculation values primary element			
Medium (Gas)			
Abs. pressure	$p_{abs,r} =$		bar
Temperature	$t_r =$		°C
Standard density	$\rho_n$		kg/m <sup>3</sup>
Density	$\rho_r$		kg/m <sup>3</sup>
Standard volume flow rate	$Q_{m,r} =$		kg/s
Differential pressure	$\Delta p_r =$		mbar

Ratio of diameters (not for Integral Orifice Assembly, Area Averaging Meter, Pitot tube, Density Correction)	$\beta = d/D =$	
Reynolds number (only for nozzles and orifices)	$Re_D =$	
Isentropic exponent	$\kappa =$	
Correction Factor Area Averaging Meter <sup>1)</sup>		
Calculation done for flow		% x Q <sub>r</sub>

<sup>1)</sup> Only necessary if Area Averaging Meter is used as primary element.  
 If factor should not be taken into consideration or is unknown, please add "0"  
 K-factor should be also compensated, then the following table has to be fulfilled

If the influence of temperature and pressure on real gas factor /

For correction of real gas factor / compressibility factor			
Real gas factor $Z = f(p, t)$ <sup>1)</sup>			Please mark with cross where applicable
Compressibility factor $K = Z/Z_n$ <sup>1)</sup>			
	t (°C) min =	average =	max =
p <sub>abs</sub> (bar)			
min =			
average =			
max =			

**Linearization Primary Element**

If the non-linearity is known for a primary element, e. g. from calibration, a linearization can be done with max. 22 pairs of values. Enter these values (actual differential pressure and ideal theoretical differential pressure) into the table below.


Input	Differential Pressure
act. value [%]	set point [%]
0	0
100%	100%

**12.1 Compliance with pressure device rules (97/23/EC)**

**12.1.1 Devices with PS >200 bar**

Devices with a permissible pressure PS >200 bar have been subject to a conformity validation by TÜV NORD (0045)acc. to module H. They may be used for liquids of group 1 (PED:1G).

The data label contents the following specifications:

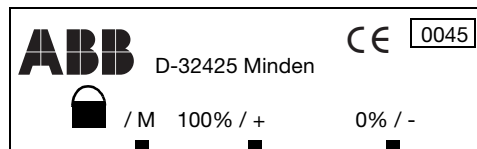

← **CE 0045**

**PED: 1G** →

Model: Transmitter	xx	<i>HART</i>	Made in Germany
S/N xxxxxxxxxx	Year	2003	
PED: 1G	PS: 410 bar	IP ≥ 65	
Flange 1.4404	Gasket Buna		
Diaph Hast. C	Fill Siliconoel		
○ LRL -2.5 bar	⊕	10.5 ... 30V DC	
○ URL +2.5 bar	⊖	4 ... 20 mA	
MWP 410 bar	P: 0 ... 410 bar abs.		
min. Span 0.025 bar			
adjusted: +0.00...+0.650 bar			
TAG: /			

**12.1.2 Devices with PS ≤200 bar**

Devices with a permissible pressure PS ≤200 bar correspond to article 3 paragraph (3). They have not been subject to a conformity validation. These instruments were designed and manufactured acc. to the proven and practical engineer experiences (SEP).

The CE-label on the data label does not apply for the pressure device rules.

In this case the data label contents the following specification: PED: SEP.

# 13 Dimensional Drawings

## Transmitter with barrel-type amplifier housing

Errors and omissions excepted. All dimensions in inches; mm in brackets

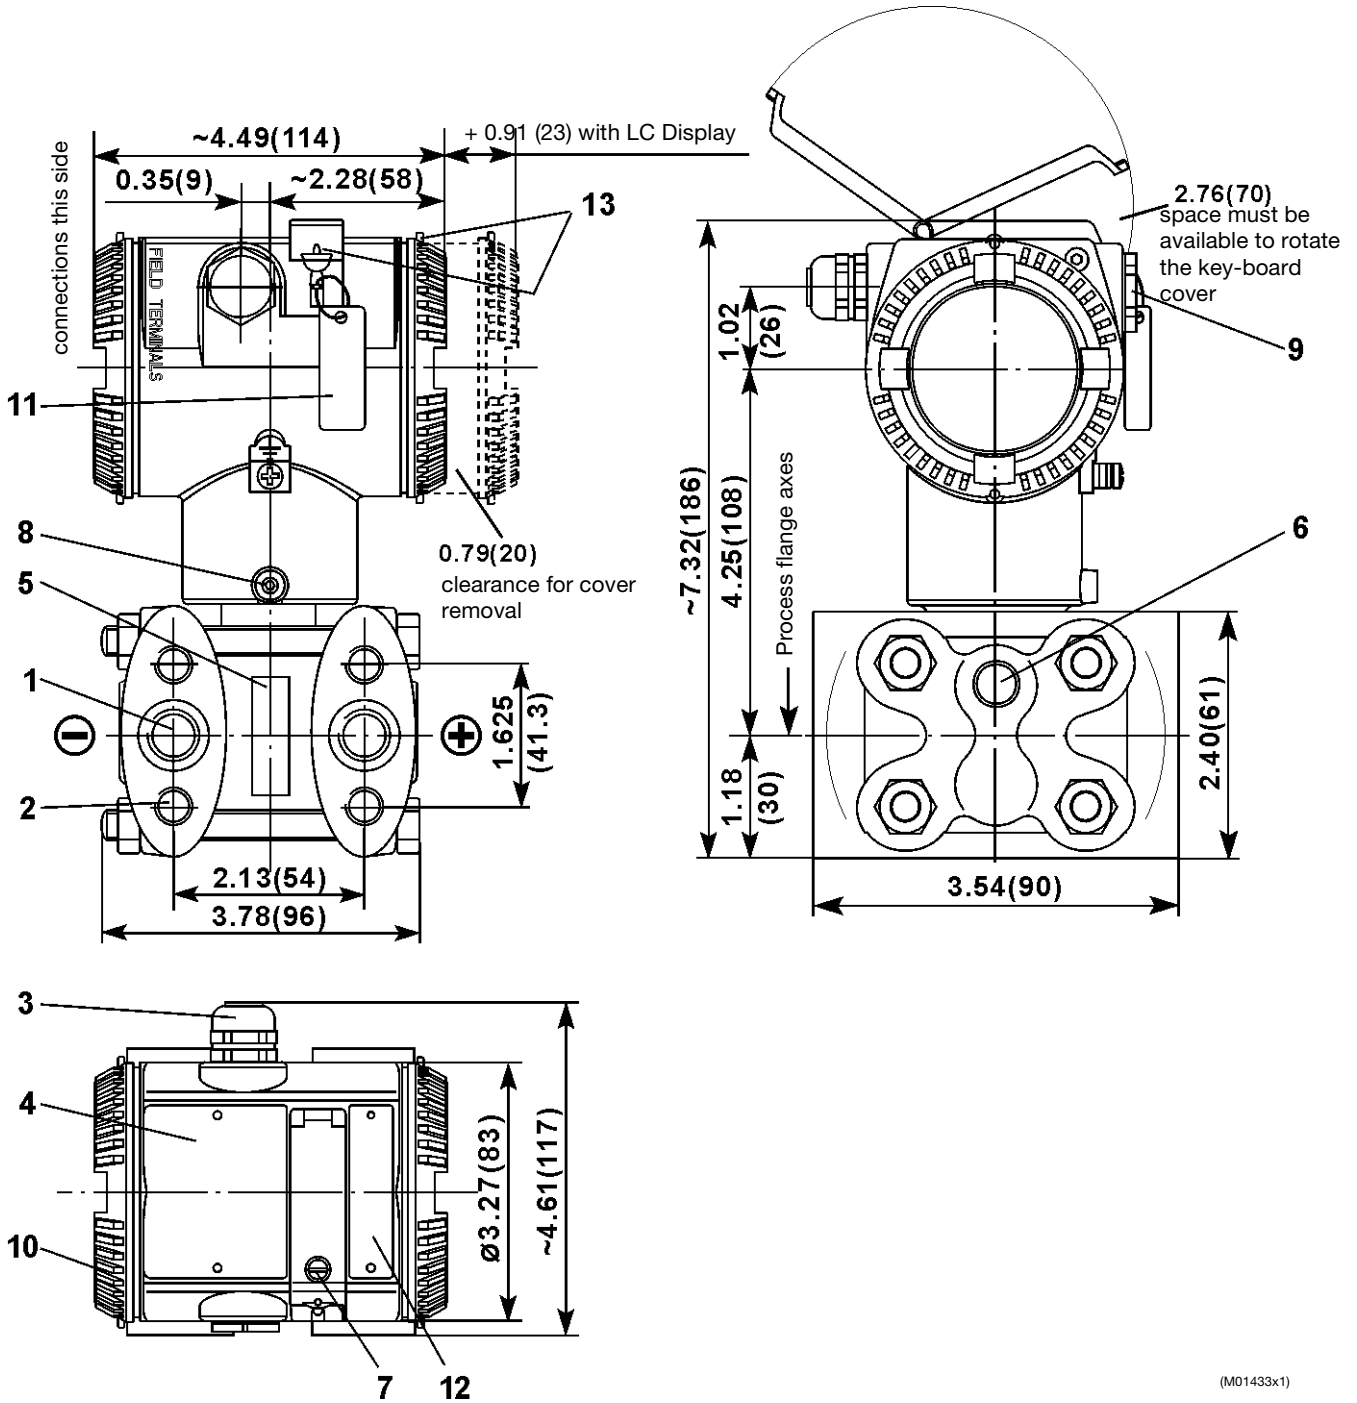


Figure 22.

- |   |  |
|---|--|
| <p>1 1/4-18 NPT female thread for process connection or screw plug</p> <p>2 Thread for fastening screws:<br/>7/16-20 UNF, 16mm deep. Minimum screw-in length: 12mm; however, 15mm for MWP 410.<br/>For flange acc. to DIN 19 213: M10 with MWP 6, MWP 20 and MWP 100<br/>M12 with MWP 410. Minimum screw-in length acc. to DIN 19 213</p> <p>3 Electrical connection:<br/>M 20x1.5 cable gland or<br/>1/2-14 NPT female thread or<br/>plug Han 8U<br/>(PROFIBUS PA and FOUNDATION Fieldbus: M12x1 or 7/8)</p> <p>4 Type plate</p> <p>5 Sensor plate</p> | <p>6 Threaded hole 1/4-18 NPT for drain or vent valve</p> <p>7 Captive screw for key unit cover</p> <p>8 Housing rotation stop screw</p> <p>9 Blind plug</p> <p>10 Enclosure cover</p> <p>11 Tie-on plate, e.g., for measuring point identification (optional)</p> <p>12 Plate, also with key legend.</p> <p>13 Fastener for seal ring (cover and key-board cover)</p> |
|---|--|

(M01433x1)

### Transmitter with DIN-type amplifier housing

Errors and omissions excepted. All dimensions in inches; mm in brackets.

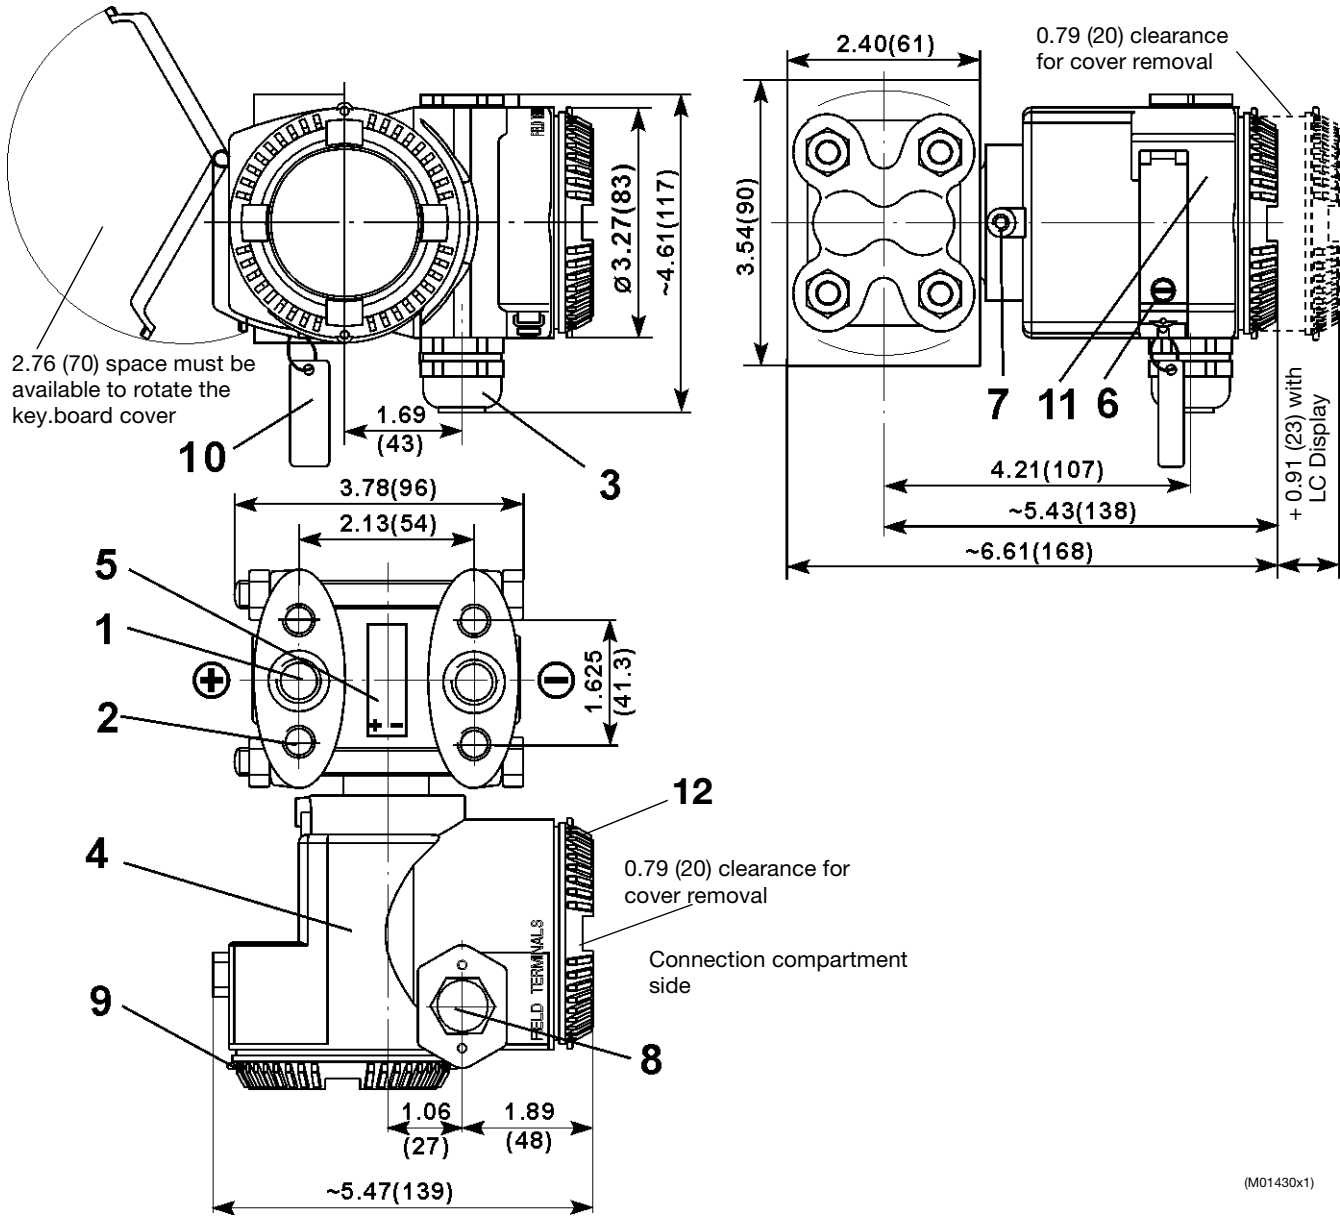


Figure 23.

- 1 1/4-18 NPT female thread for process connection or screw plug
- 2 Thread for fastening screws:  
7/16-20 UNF, 16mm deep. Minimum screw-in length:  
12mm; however, 15mm for MWP 410.  
For flange acc. to DIN 19 213: M10 with MWP 6, MWP 20 and  
MWP 100, M12 with MWP 410.  
Minimum screw-in length acc. to DIN 19 213.
- 3 Electrical connection:  
M 20x1.5 cable gland or  
1/2-14 NPT female thread or plug Han 8U  
(PROFIBUS PA and FOUNDATION Fieldbus: M12x1 or 7/8)
- 4 Type plate
- 5 Sensor plate
- 6 Captive screw for key unit cover
- 7 Housing rotation stop screw
- 8 Blind plug
- 9 Enclosure cover
- 10 Tie-on plate, e.g. for measuring point identification (optional).
- 11 Plate, also with key legend
- 12 Fastener for seal ring (cover and key-board cover)

(M01430x1)

# 14 Mounting Options

With bracket for barrel type electronic housing.

(optional, code B2/B4)

Errors and omissions excepted. All dimensions in mm.

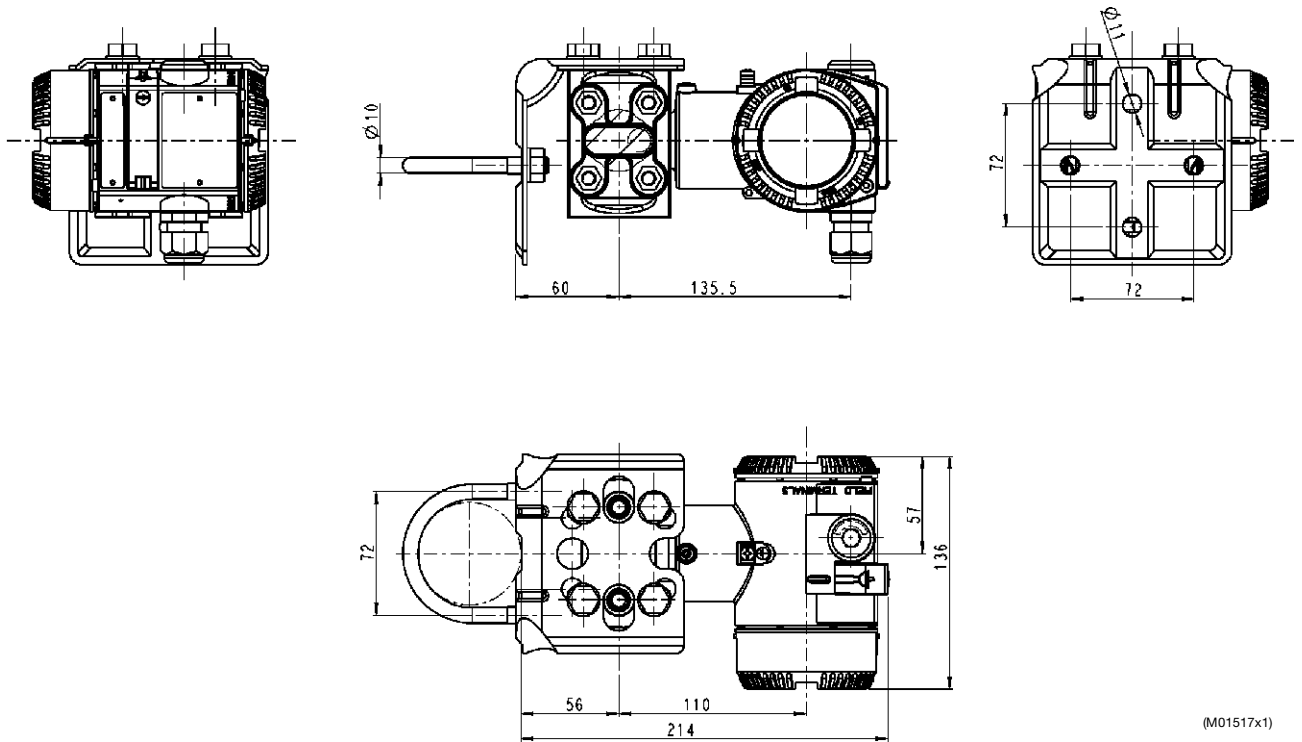


Fig. 24:

Vertical pipe mounting

Horizontal pipe mounting

Vertical pipe mounting and transmitter above the mounting bracket

Horizontal pipe mounting and transmitter above the mounting bracket

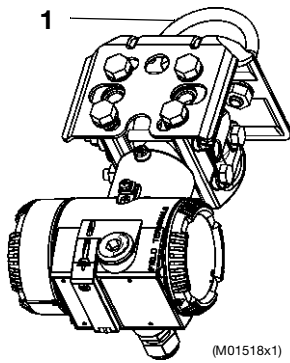


Fig. 25:

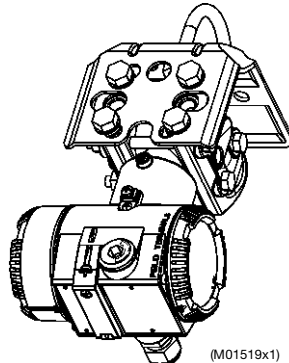


Fig. 26:

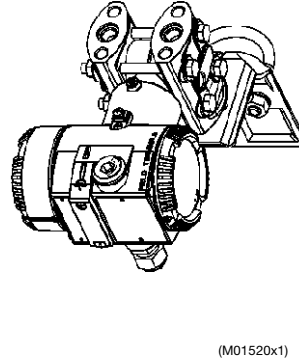


Fig. 27:

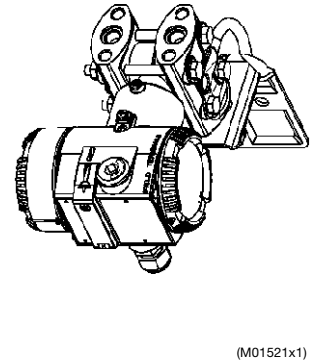


Fig. 28:

1 U-bolt for pipe mounting.  
Pipe: 2" (int. diam.)  
Permissible pipe diam.  
53...64 mm



**EG-KONFORMITÄTSERKLÄRUNG**

EC DECLARATION OF CONFORMITY  
 ATTESTATION DE CONFORMITE C.E.

**Hersteller:** ABB Automation Products GmbH  
*Manufacturer / Fabricant:* Minden  
**Anschrift:** Schillerstraße 72  
*Address / Adresse:* D-32425 Minden  
**Produktbezeichnung:** Druck-Messumformer - 263/265A, 263/265D, 263/265G, 263/265J, 267/269C  
*Product name:* Pressure Transmitter – 263/265A, 263/265D, 263/265G, 263/265J, 267/269C  
*Désignation du produit:* Transmetteur de Pression – 263/265A, 263/265D, 263/265G, 263/265J, 267/269C

**Das Produkt stimmt mit den Vorschriften folgender Europäischer Richtlinien überein:**

*This product meets the requirements of the following European directives:  
 Les produits répondent aux exigences des Directives C.E. suivantes:*

- |  |   |  |
|--|---|--|
| <b>89/336/EWG</b><br>89/336/EEC<br>89/336/C.E.E. | <b>EMV-Richtlinie *</b><br><i>Electromagnetic Compatibility Directive *</i><br><i>Directives concernant la compatibilité électromagnétique *</i>  |  |
| <b>73/23/EWG</b><br>73/23/EEC<br>73/23/C.E.E.    | <b>Niederspannungsrichtlinie *</b><br><i>EC-Low-Voltage Directive *</i><br><i>Directives concernant la basse tension *</i>  |  |
| <b>97/23/EG</b><br>97/23/EEC<br>97/23/C.E.E.     | <b>Druckgeräterichtlinie, Kategorie III Modul H</b><br><i>Pressure Equipment Directive, Category III Module H</i><br><i>Directive Equipements sous Pression, Catégorie III Module H</i> | <b>(für Druck PS &gt; 200bar)</b><br><i>(for pressure PS &gt; 200 bar)</i><br><i>(pour pression PS &gt; 200 bar)</i> |
- Druck/Pressure/Pression PS ≤ 200bar: SEP**

CE 0045

**Für Geräte in Ex-Ausführung gemäß Kennzeichnung auf Typschild gilt zusätzlich:**

*For products in Ex design according to identification on nameplate the following is additionally applicable:  
 Pour des produits en exécution Ex selon marque sur plaque signalétique le suivant est aussi applicable:*



**94/9/EG**  
94/9/EEC  
94/9/C.E.E.
 **ATEX-Richtlinie** *ATEX Directive* *ATEX Directive* |

\* einschließlich Änderungen und deutscher Umsetzung durch das EMVG und Gerätesicherheitsgesetz  
 \* including alterations and German realization by the EMC law and the instruments safety law  
 \* y compris les modifications et la réalisation allemande par la loi cocernant la compatibilité électromagnétique et la sécurité d'appareils

**Die Übereinstimmung mit den Vorschriften dieser Richtlinien wird nachgewiesen durch die vollständige Einhaltung folgender Normen:**

*Conformity with the requirements of these Directives is proven by complete adherence to the following standards:  
 La conformité avec les exigences de ces directives est prouvée par l'observation complète des normes suivantes:*

EN 50 081-1 / EN 50 082-2 / EN 61 010-1  
 Ex: EN 50 014 / EN 50 284 / EN 50 018 / EN 50 020

24.06.2003

Datum  
Date  
Date

**Dr. Wolfgang Scholz**  
**Leiter R&D**  
 Head of R&D  
 Responsable R&D

**Bernhard Kruse**  
**Leiter Qualitätsmanagement**  
 Head of Quality Management  
 Responsable Assurance de la Qualité

**ABB Automation Products GmbH**

---

Postanschrift:  
Schillerstr. 72  
D-32425 Minden

Besuchsanschrift:  
Schillerstr. 72  
D-32425 Minden  
Telefon +49 (0) 571 830 0  
Telefax:+49 (0) 571 830 1846  
Internet: http://www.abb.com/de

Sitz der Gesellschaft:  
Eschborn  
Registergericht:  
Amtsgericht Frankfurt/Main  
Handelsregister:  
HRB 49651  
USt-IdNr.: DE 115 300 097

Vorsitz des Aufsichtsrates:  
Bernhard Jucker  
Geschäftsführung:  
Heinz-Peter Paffenholz (Vorsitz)  
Joachim Braun  
Erik Huggare  
Dr. Peter Terwiesch

Bankverbindung:  
Commerzbank AG Frankfurt  
Konto: 589 635 200  
BLZ: 500 400 00

30





---

**ABB Automation Products GmbH**  
Schillerstraße 72  
D 32425 Minden  
Phone +49 (0) 571 8 30-0  
Fax +49 (0) 571 8 30-18 60

Rights reserved to make technical revisions  
Printed in the Fed. R. of Germany  
267C/269C Rev. A  
Issued 06.03