



中国国家强制性产品认证证书

证书编号: 2013010304647116

委托人名称、地址

ABB France
3 Rue Jean Perrin CS 90009 69687, Chassieu Cedex, FRANCE

生产者(制造商)名称、地址

ABB France
3 Rue Jean Perrin CS 90009 69687, Chassieu Cedex, FRANCE

生产企业名称、地址

ABB新会低压开关有限公司
广东省江门市新会区今古洲工业开发区

产品名称和系列、规格、型号

接触器

AX32-30-□□、AX40-30-□□;规格参数和型号解释见附件

产品标准和技术要求

GB 14048.4-2010

上述产品符合强制性产品认证实施规则
CNCA-01C-011: 2007的要求, 特发此证。

发证日期: 2013年10月10日 有效期至: 2018年10月10日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

本证书的相关信息可通过国家认监委网站www.cnca.gov.cn查询



主任:

中国质量认证中心

中国·北京·南四环西路188号9区100070

<http://www.cqc.com.cn>



Q 0818738



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

No. : 2013010304647116

NAME AND ADDRESS OF THE APPLICANT

ABB France
3 Rue Jean Perrin CS 90009 69687, Chassieu Cedex, FRANCE

NAME AND ADDRESS OF THE MANUFACTURER

ABB France
3 Rue Jean Perrin CS 90009 69687, Chassieu Cedex, FRANCE

NAME AND ADDRESS OF THE FACTORY

ABB Xinhui Low Voltage Switchgear Co., Ltd
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City,
Guangdong Province, P. R. China

NAME, MODEL AND SPECIFICATION

contactor

AX32-30-□□、AX40-30-□□; See the Appendix

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB 14048.4-2010

This is to certify that the above mentioned products have met the requirements of implementation rules for compulsory certification (REF NO. CNCA-01C-011:2007).

Date of issue: Oct. 10, 2013 Date of expiry: Oct. 10, 2018

Validity of this certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

This certificate can be verified through CNCA's website: www.cnca.gov.cn



President:

Wang Kejiao

CHINA QUALITY CERTIFICATION CENTRE

Section 9, No. 188, Nansihuan Xilu, Beijing 100070 P.R. China

<http://www.cqc.com.cn>



Q 0818738



中国国家强制性产品认证证书

附录:

第 1 页 共 2 页

证书编号: 2013010304647116

纸号: 818738

型号: AX32-30-□□、AX40-30-□□;

I_{th} : 65A; U_i : 690V;

U_s :

频率	U_s (V~)							
50Hz	24	48	110	190	220-230	230-240	380-400	400-415
60Hz	24	48	110-120	220	230-240	240-260	400-415	415-440

极数: 3P;

使用类别、 U_e 、 I_e :

使用类别	U_e (V~)	I_e (A)	
		AX32	AX40
AC-3	220-230-240V	32A	40A
AC-3	380-400V	32A	40A
AC-3	415V	32A	40A
AC-3	440V	32A	37A
AC-3	500V	28A	33A
AC-3	690V	21A	25A
AC-8a	400V	40A	50A
AC-1	690V	55A	60A

内置式辅助触头:

I_{th} : 16A;

使用类别、 U_e 、 I_e :

使用类别	U_e (V)	I_e (A)
AC-15	24-127VAC	6
AC-15	220-240VAC	4
AC-15	380-440VAC	3
AC-15	500VAC	2
AC-15	690VAC	2
DC-13	24VDC	6
DC-13	48VDC	2.8

注: 此附录与证书同时使用时有效。



主任:

中国质量认证中心

中国·北京·南四环西路188号9区100070

<http://www.cqc.com.cn>





中国国家强制性产品认证证书

附录:


第 2 页 共 2 页

证书编号: 2013010304647116

纸号: 818738

DC-13	72VDC	2
DC-13	125VDC	1.1
DC-13	250VDC	0.55

AX □□ - 3 0 - □□

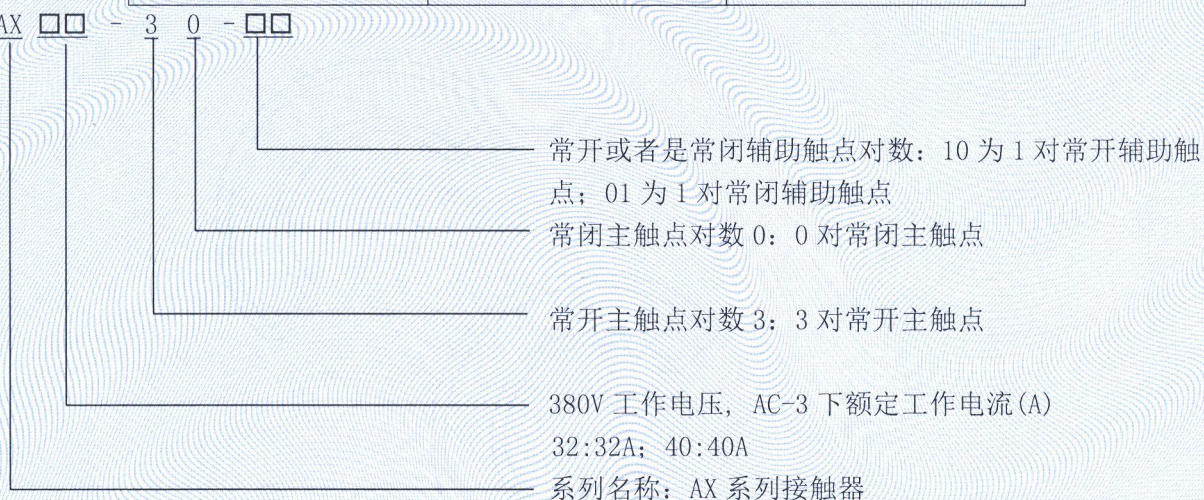

注: 此附录与证书同时使用时有效。



主任:

中国质量认证中心

中国 · 北京 · 南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

