We reserve all rights in this document and in the information contained therein. Reproduction, use or disclosure to third parties without express authority is strictly forbidden. ©ABB

Valve	A
R 1 1/2"	74
1 1/2" NPT	64
1 1/2" NPT with test device	109

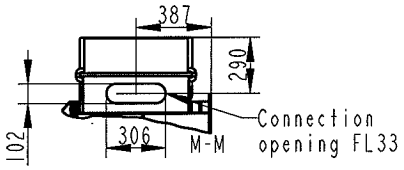

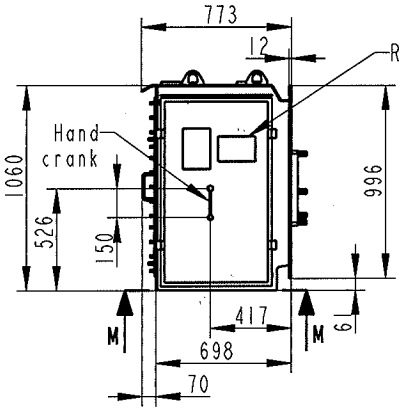

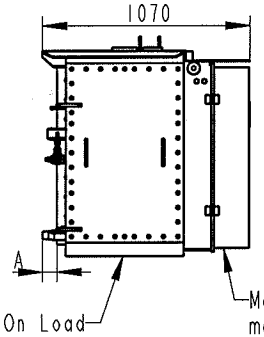

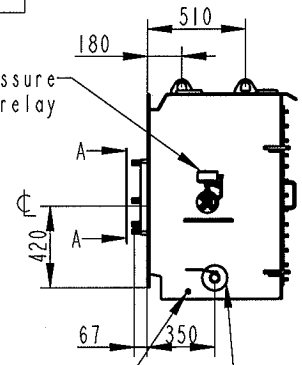

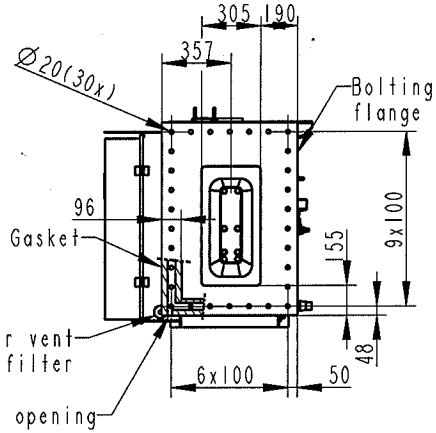

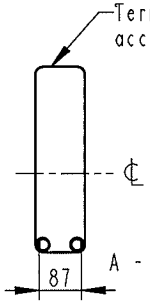

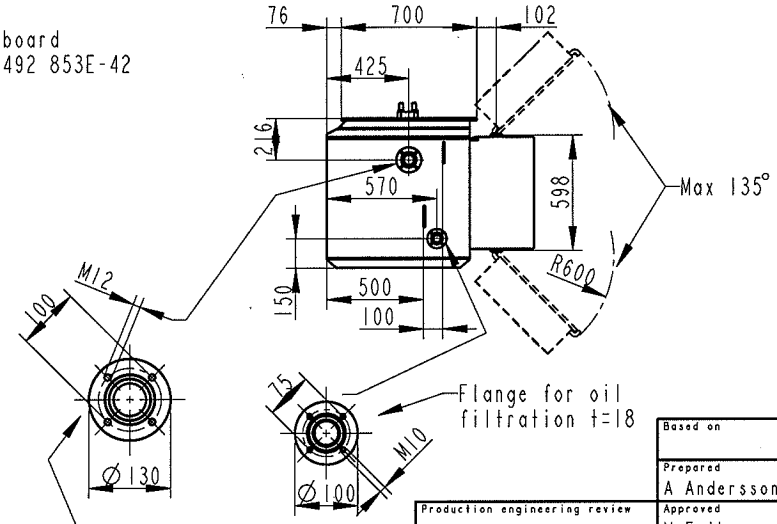





All flanges without accessories delivered with cover plates

Mass: 475 kg without oil
Required oil: 250 kg

Based on		Reg. No.	Title
	Prepared: A Andersson	Responsible department: COM/TK 02.05	OLTC tank 250 kV 1-phase
Production engineering review	Approved: M Eriksson	Take over department	Lindnkopplåda 250 kV 1-fas
Inspection engineering review	Revision: Rev 1 06-10-09	Database	Language: 82
Design engineering review: A Bergkvist	ABB		Page: 1(1)
			Document No.: 54920089-18