


NOTES:

1. WARNING: This drawing does not illustrate completely the installation methods required for hazardous locations. Prior to any installation in a Classified Hazardous Location, verify installation methods by the Control Drawing referenced on the product's name tag and national and local codes.

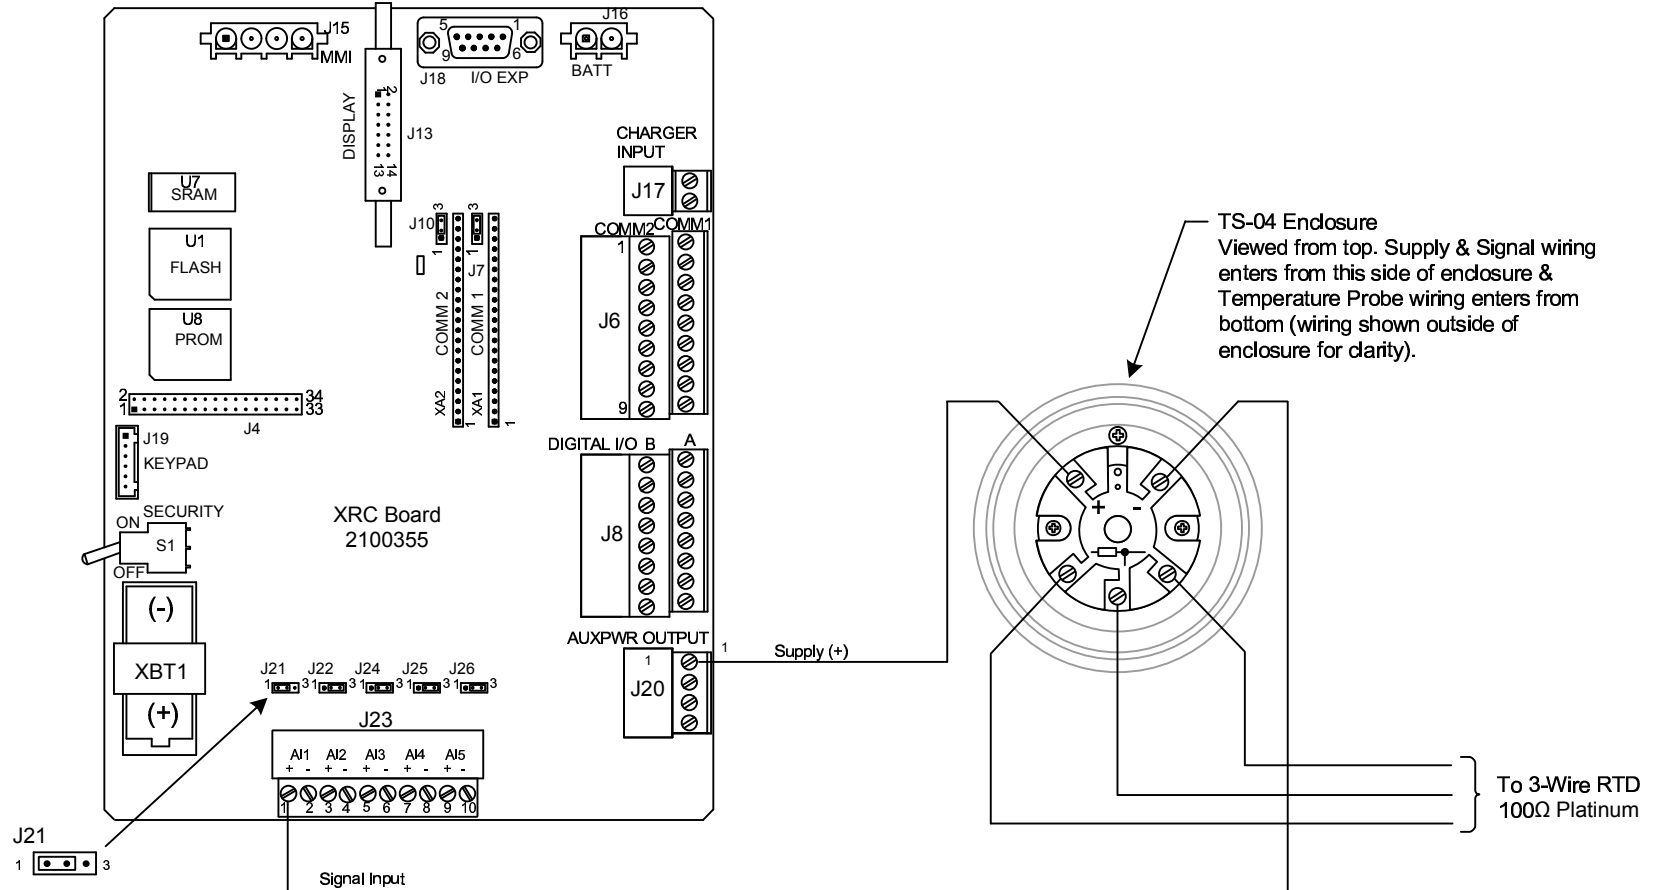

The Jumpers J21, J22, J24, J25 & J26 are selections for Analog Input Pairs on J23 (Those are 1&2, 3&4, 5&6, 7&8 and 9&10, respectively).

Setting the jumpers Pin-1 to Pin-2 = 0-20mA
 Setting the jumpers Pin-2 to Pin-3 = 0-10V.

Any of the pairs may be selected for Signal Input (+). In this instance, the Transducer uses the AIs set to 0-20mA on Pin-1 of J23; Jumper J21, Pin-1 to Pin-2, as shown.

REF: N/A

ABB TOTALFLOW Products	ACTION	DOC TYPE	TITLE	DWG NO.	REV	SHEET
	L19631	UD	XRC 6490/6790/6890 (2100355 BD) TO ABB TS-04 4-20mA TEMP TRANSMITTER	2103072	AA	1 OF 1