


NOTES:

- WARNING**
Using a non-factory RS485 data cable between UC12 and first unit may result in damage and may void system warranty.
- All installations in hazardous locations must comply with requirements of Certification Drawing 2015246-CD.
- For switched power or to enable Power Scheduler for UC12, remove the jumper from 1 to 9 on P1 of UC12.
- Maximum length of RS485 bus is 4000 Ft. @9600 baud using Totalflow cable P/N 2011648-001 or equivalent.
- No Star Configurations.

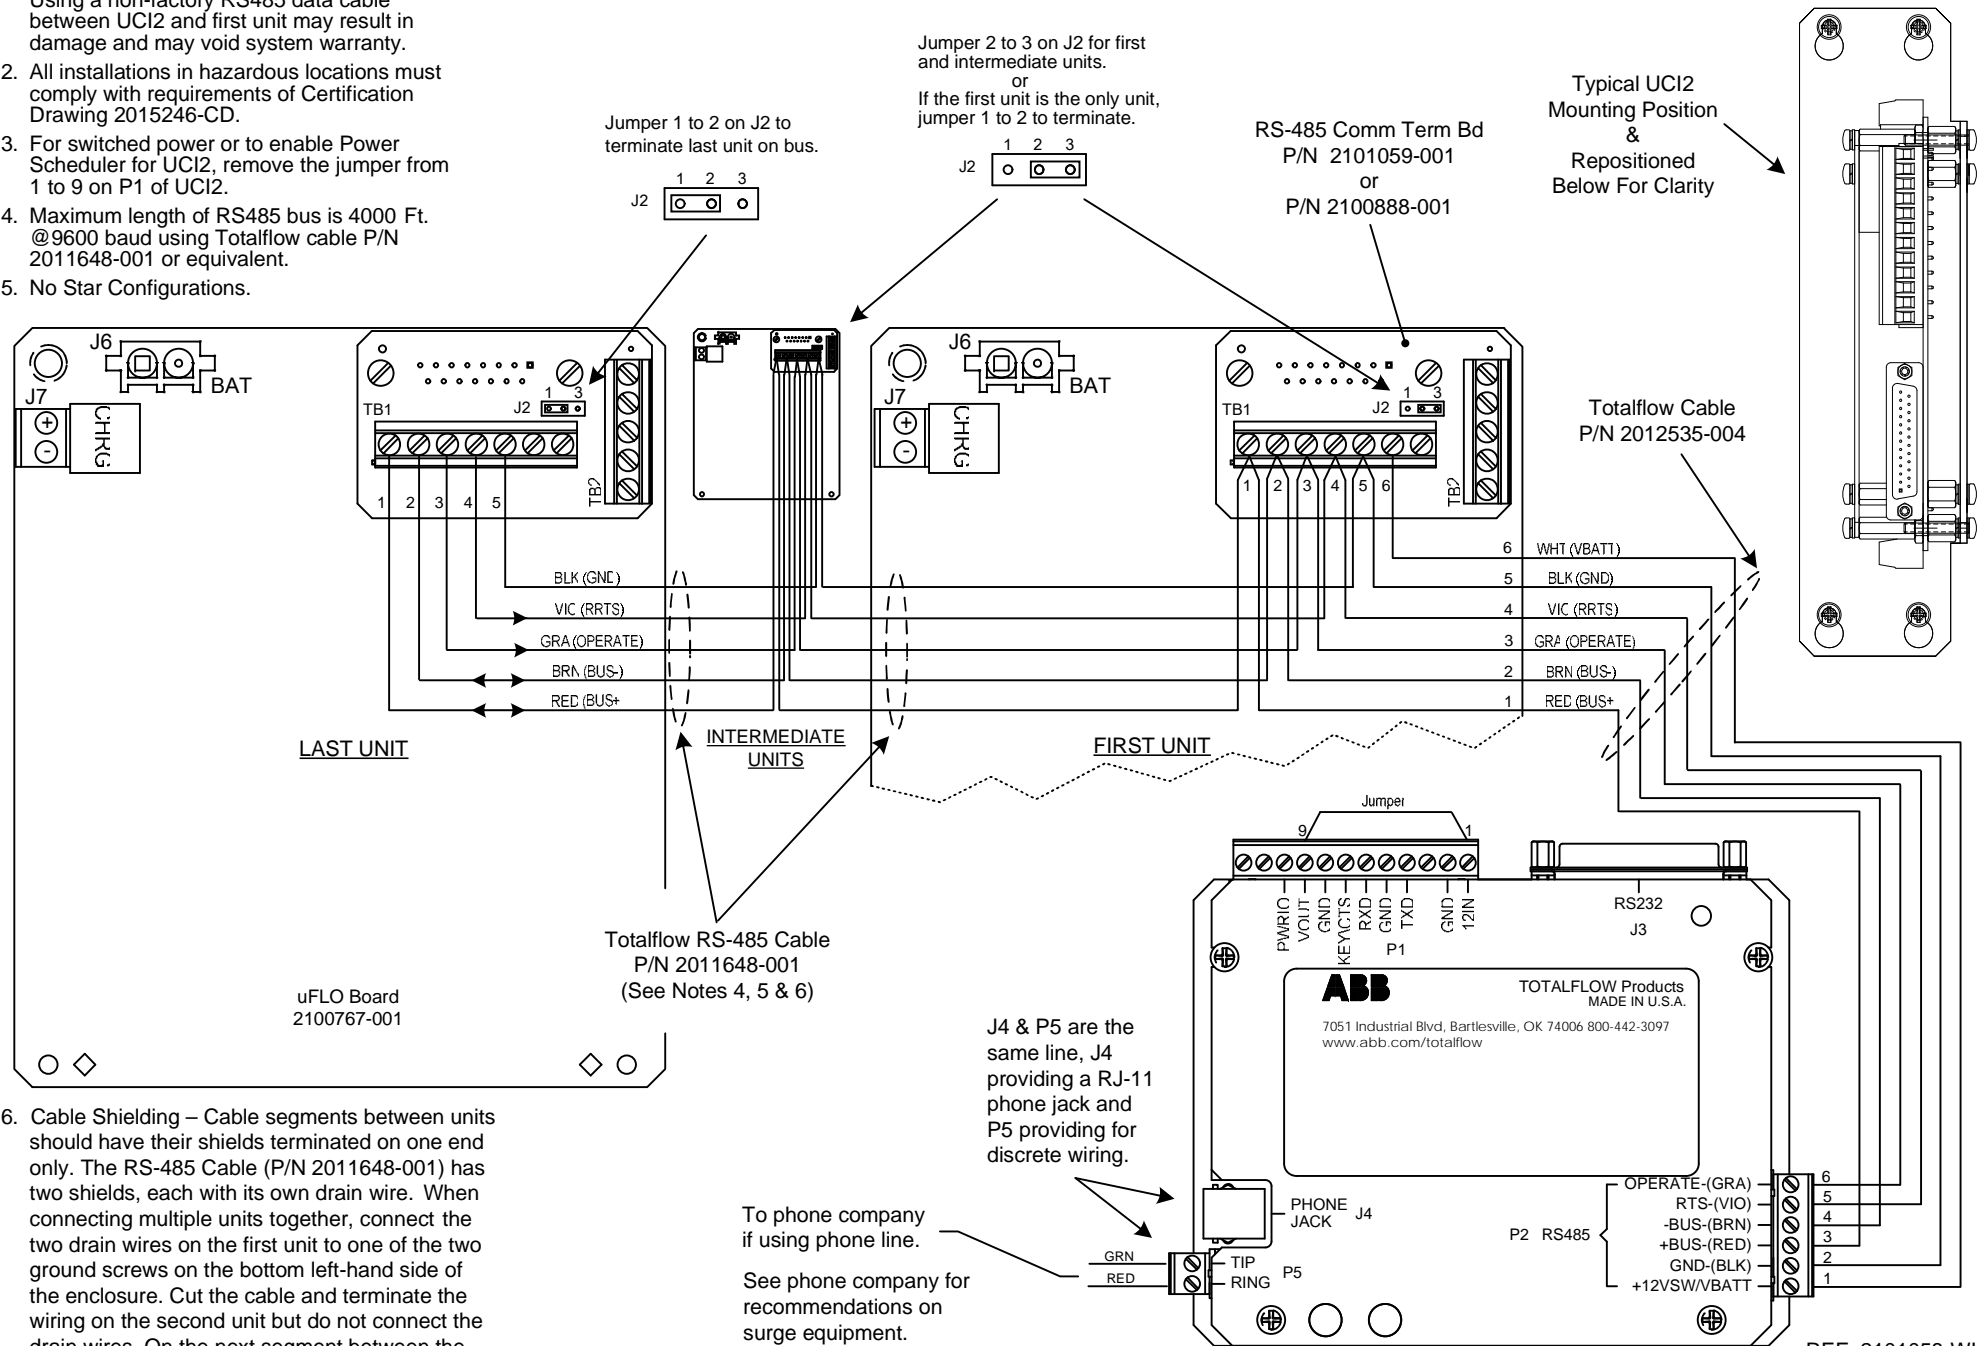

- Cable Shielding** – Cable segments between units should have their shields terminated on one end only. The RS-485 Cable (P/N 2011648-001) has two shields, each with its own drain wire. When connecting multiple units together, connect the two drain wires on the first unit to one of the two ground screws on the bottom left-hand side of the enclosure. Cut the cable and terminate the wiring on the second unit but do not connect the drain wires. On the next segment between the second and third units, connect the two drain wires to the second unit but not to the third unit. Repeat this process until all units are wired.

To phone company if using phone line.
See phone company for recommendations on surge equipment.

REF: 2101058-WI

ABB	TOTALFLOW Products	ACTION	DOC TYPE	TITLE	DWG NO.	REV	SHEET
		L15851	UD	UFLO W/ RS-485 COM TERM BD TO UC12 POWERED BY UFLO	2101727	AA	1 OF 1