


NOTES:

1. All installations in hazardous locations must comply with requirements of certification drawing 2015246-CD.

Plug in modules with smooth side of the module on the left which puts pin 1 on the bottom.

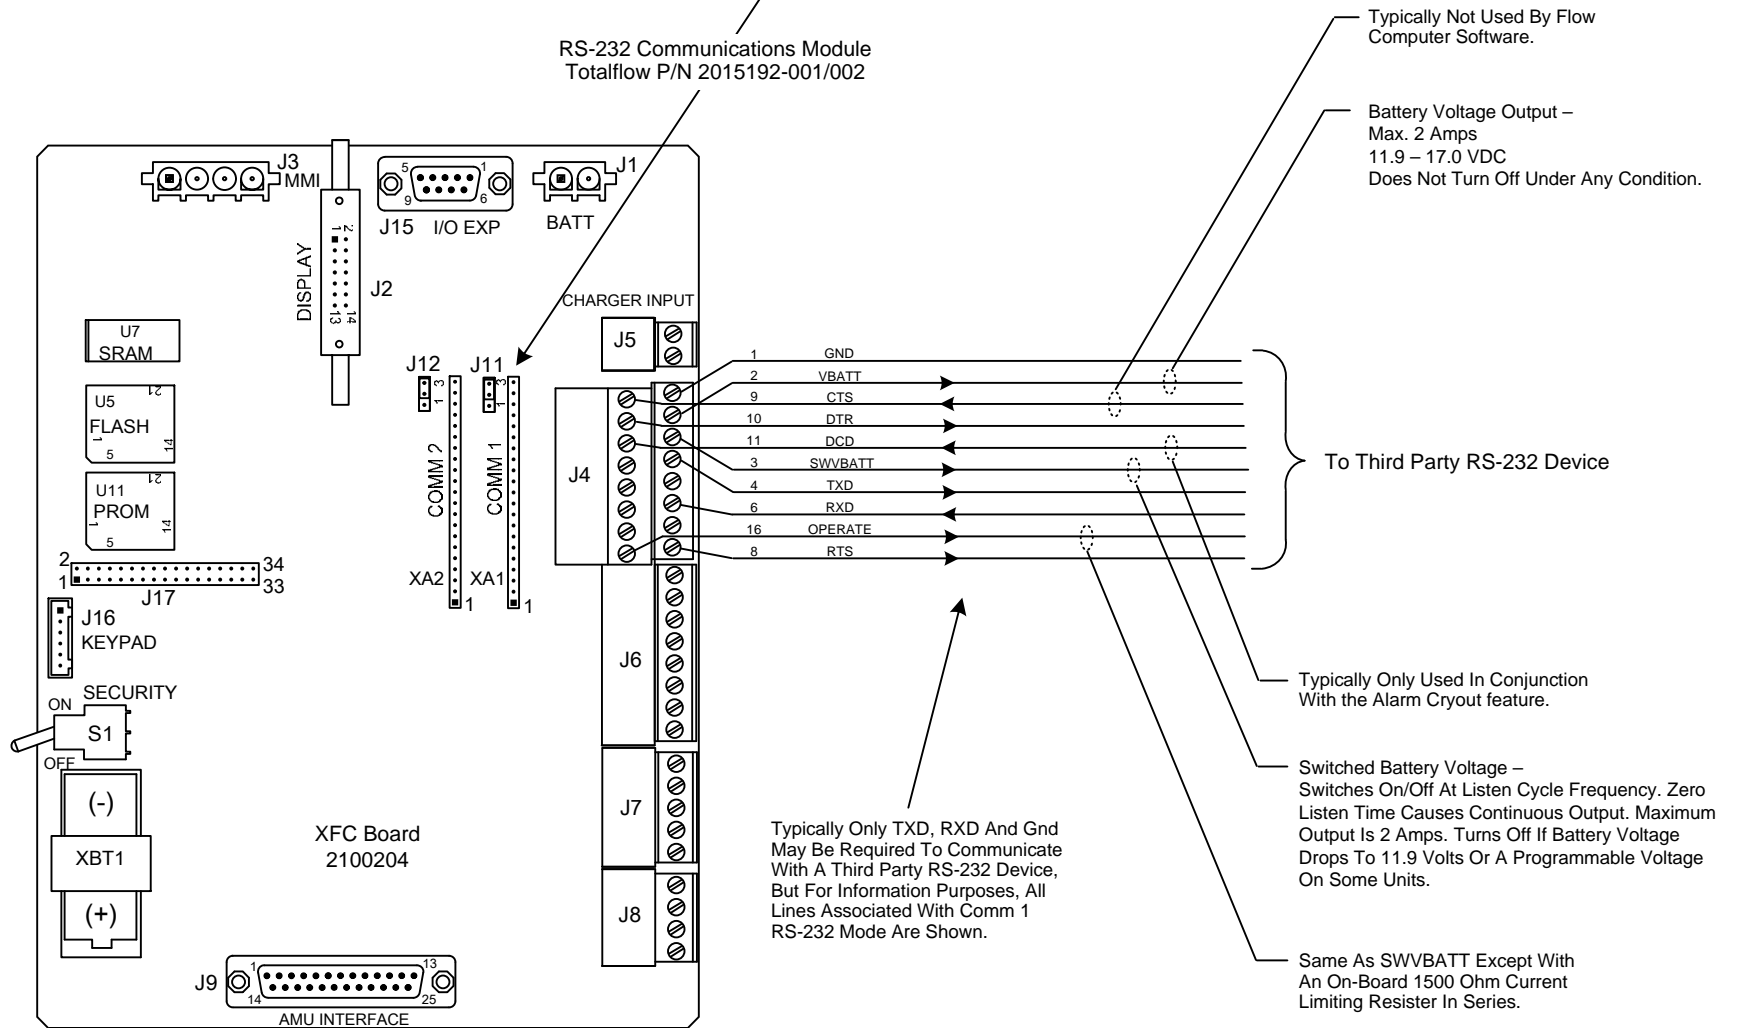

	TOTALFLOW	ACTION	DOC TYPE	TITLE	DWG NO.	REV	SHEET
	Products	L16919	UD	XFC COMM 1 (2100204 BD) RS-232 GENERIC WIRING GUIDE	2101961	AA	1 OF 1