


NOTES:

- WARNING:** This drawing does not illustrate completely the installation methods required for hazardous locations. Prior to any installation in a Classified Hazardous Location, verify installation methods by the Control Drawing referenced on the product's name tag and national and local codes.
- CAUTION:** Only activate ONE (1) DO at a time on J4. That is the normal condition for Valve Control
- Assume Full Open is Full Clockwise
Assume Full Closed is Full Counter Clockwise
- The 1st valve control module is address '0', 2nd module is address '1', etc.
- 'Local Lockout' activated by closed contact.
- LED Indicators:**
Run LED – Blinking indicates on-board PIC running.
Activity LED – Blinking indicates buss activity.
Mode LED – 00 = Normal 01 = Reset
- LED Operation:**
Register 0.7.7 = 0 – Power Save Mode (LEDs off when MMI disconnected)
Register 0.7.7 = 1 – LEDs on all the time.

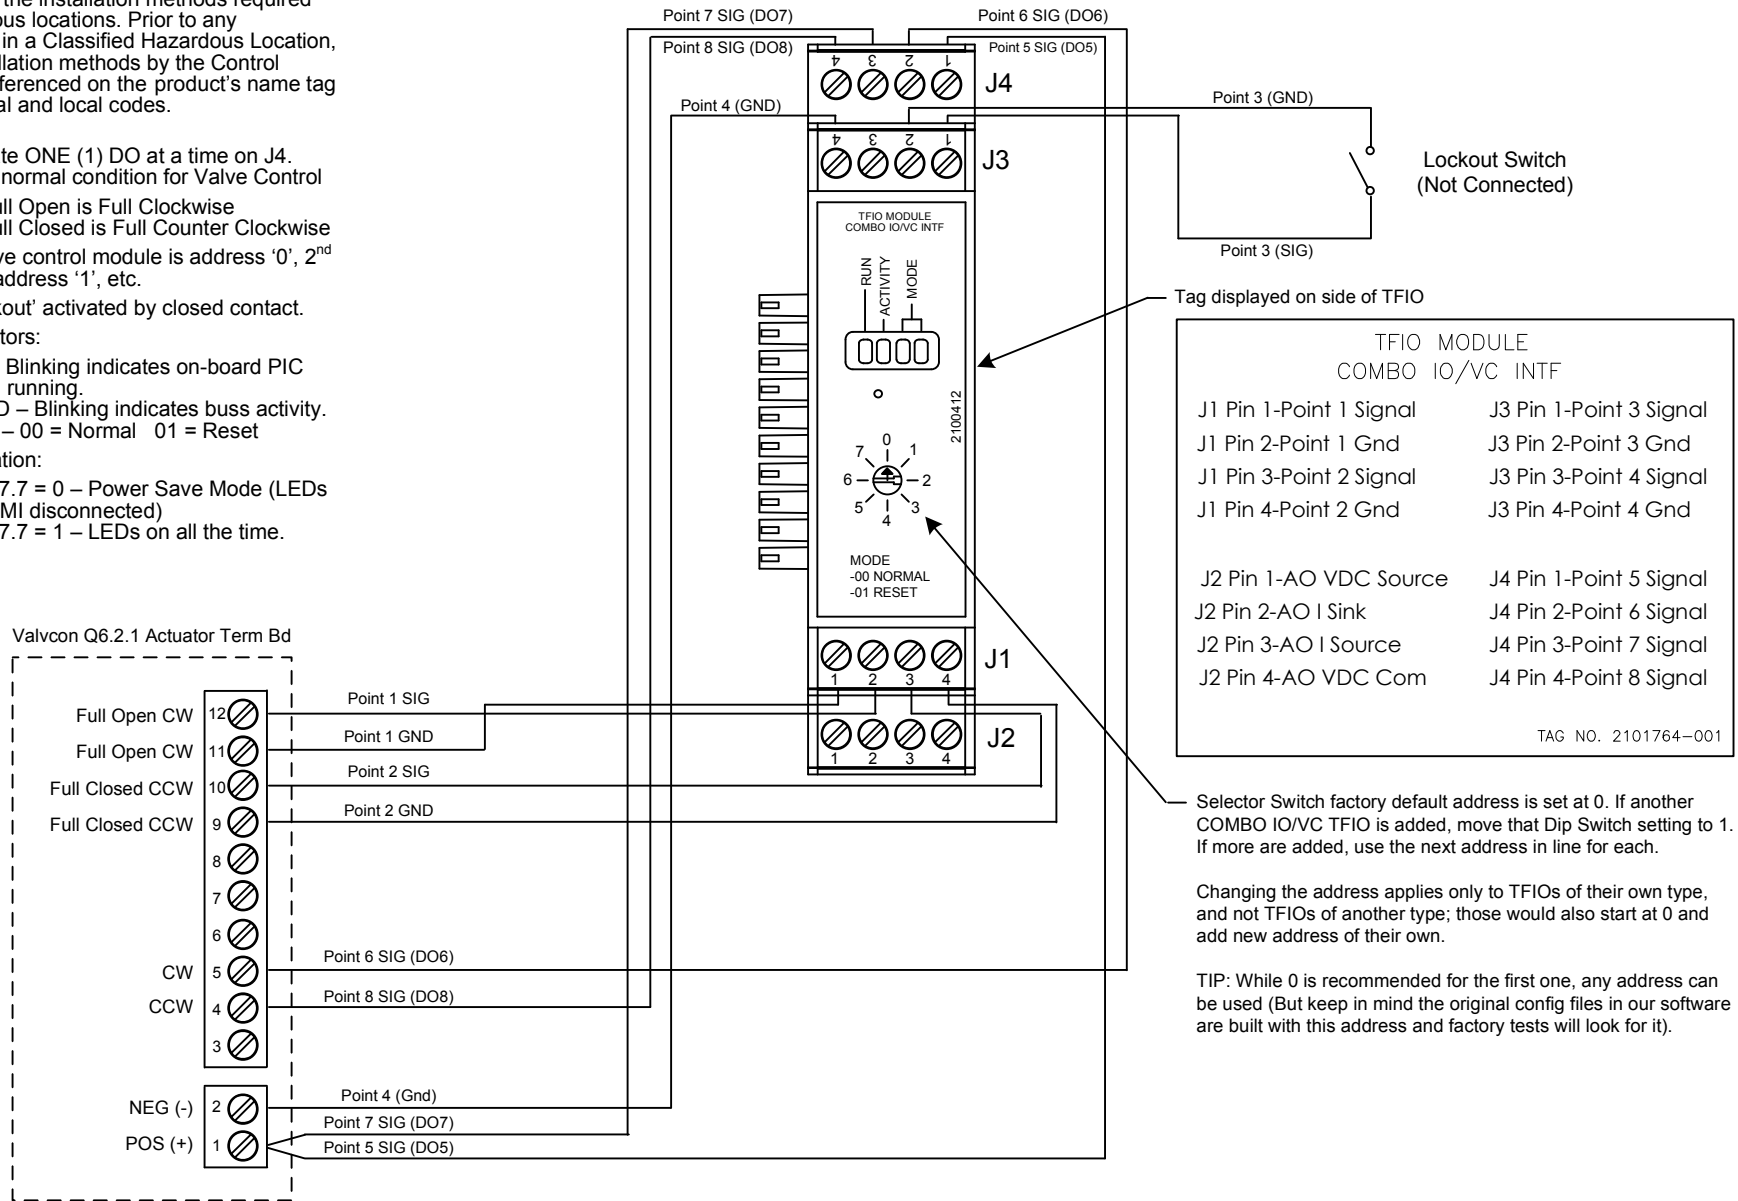

TOTALFLOW
Products

ACTION
L19710

DOC TYPE
UD

TITLE
TFIO COMBO IO/VC MODULE (2100412)
TO VALVCON Q6.2.1 ACTUATOR

DWG NO.
2103151

REV
AA

SHEET
1 OF 1