



中国国家强制性产品认证证书

证书编号: 2010010305427787

委托人名称、地址

ABB 新会低压开关有限公司
广东省江门市新会区今古洲工业开发区

生产者(制造商)名称、地址

ABB 新会低压开关有限公司
广东省江门市新会区今古洲工业开发区

生产企业名称、地址

ABB 新会低压开关有限公司
广东省江门市新会区今古洲工业开发区

产品名称和系列、规格、型号

指示装置

CP1*-***-**, CP2*-***-**, CP3*-***-**, CP4*-***-**: 详情详见附件

产品标准和技术要求

GB/T14048.5-2017

上述产品符合强制性产品认证实施规则 CNCA-C03-02:2014 的要求,
特发此证。

发证日期: 2019 年 11 月 14 日 有效期至: 2024 年 11 月 14 日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

本证书为变更证书, 证书首次颁发日期: 2010 年 09 月 13 日

本证书的相关信息可通过国家认监委网站 www.cnca.gov.cn 查询



主任:

陆梅



中国质量认证中心



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

CERTIFICATE NO.: 2010010305427787

NAME AND ADDRESS OF THE APPLICANT

ABB Xinhui Low Voltage Switchgear Co., Ltd.
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen, Guangdong Province,
P.R.China

NAME AND ADDRESS OF THE MANUFACTURER

ABB Xinhui Low Voltage Switchgear Co., Ltd.
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen, Guangdong Province,
P.R.China

NAME AND ADDRESS OF THE FACTORY

ABB Xinhui Low Voltage Switchgear Co., Ltd.
Jinguzhou Industrial Development Zone, Xinhui District, Jiangmen City, Guangdong Province,
P.R.China

PRODUCT NAME, MODEL AND SPECIFICATION

Pilot Device

CP1*-***-**, CP2*-***-**, CP3*-***-**, CP4*-***-**: See the Appendix for type explanation

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB/T14048.5-2017

This is to certify that the above mentioned product(s) complies with the requirements of implementation rules for compulsory certification(REFNO.CNCA-C03-02:2014).

Valid from: Nov.14,2019

Valid until: Nov.14,2024

The validity of the certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

Date of original issued: Sep.13,2010

The certificate information is available through CNCA's website: www.cnca.gov.cn



President:

Lu Mei



CHINA QUALITY CERTIFICATION CENTRE



中国国家强制性产品认证证书

附 录

证书编号: 2010010305427787

第 1 页 共 2 页

纸 号: 2459018

CP1*—***—**, CP2*—***—**, CP3*—***—**, CP4*—***—**

Ui: 300V;

Uimp: 6kV;

Ith: 5A;

AC-15: Ue/Ie: 120V/3A、240V/2A, DC-13: Ue/Ie: 24V/0.3A、

125V/0.2A;

安装在特定面板后头部外壳防护等级可达到 IP66

型号解释:

注: 此附录与证书同时使用时有效。



主 任:

陆 楠



中国质量认证中心




中国国家强制性产品认证证书

附 录

第 2 页 共 2 页

证书编号: 2010010305427787

纸 号: 2459018

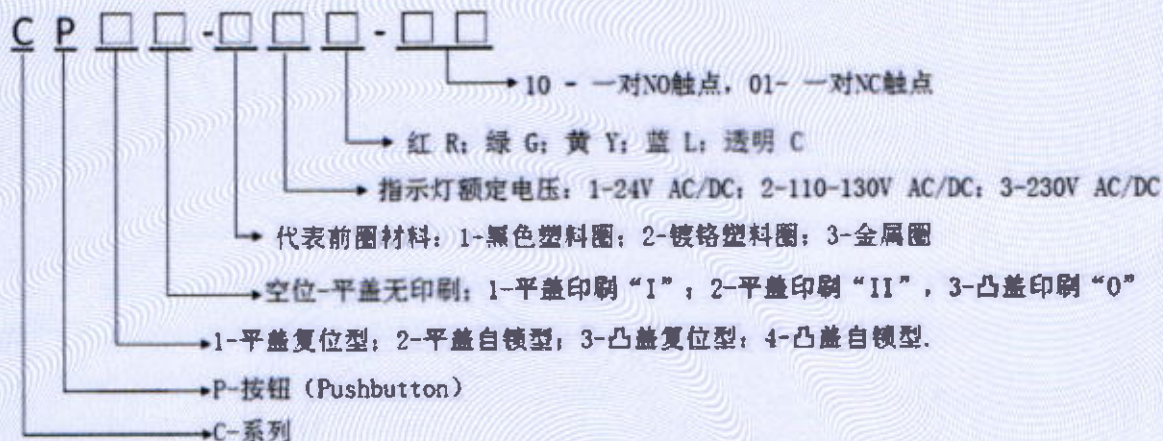

注: 此附录与证书同时使用时有效。



主 任:

陆梅



中国质量认证中心